



**THE CITY OF DAYTONA BEACH  
OFFICE OF THE PURCHASING AGENT**

Post Office Box 2451  
Daytona Beach, Florida 32115-2451

Phone (386) 671-8080  
Fax (386) 671-8085

**ADDENDUM NO. 2**

DATE: November 16, 2018

PROJECT: ITB 19023  
DR. MARTIN LUTHER KING, JR. BOULEVARD ROADWAY &  
PEDESTRIAN IMPROVEMENTS PROJECT


OPENING DATE: DECEMBER 19, 2018, 2:00 PM

This addendum is hereby incorporated into the Request for Proposal for the project referenced above. The following items are clarifications, corrections, additions, deletions and/or revisions to and shall take precedence over the original documents. Additions are indicated by underlining, deletions are indicated by ~~strikethrough~~.

1. Attached are revised plan sheets to replace the landscaping and irrigation sheets from the original plans.
2. All other terms and conditions remain the same.

Proposers will acknowledge receipt of this addendum where indicated on BID PROPOSAL FORM.

The City of Daytona Beach  
Kirk Zimmerman, CPPB  
Buyer

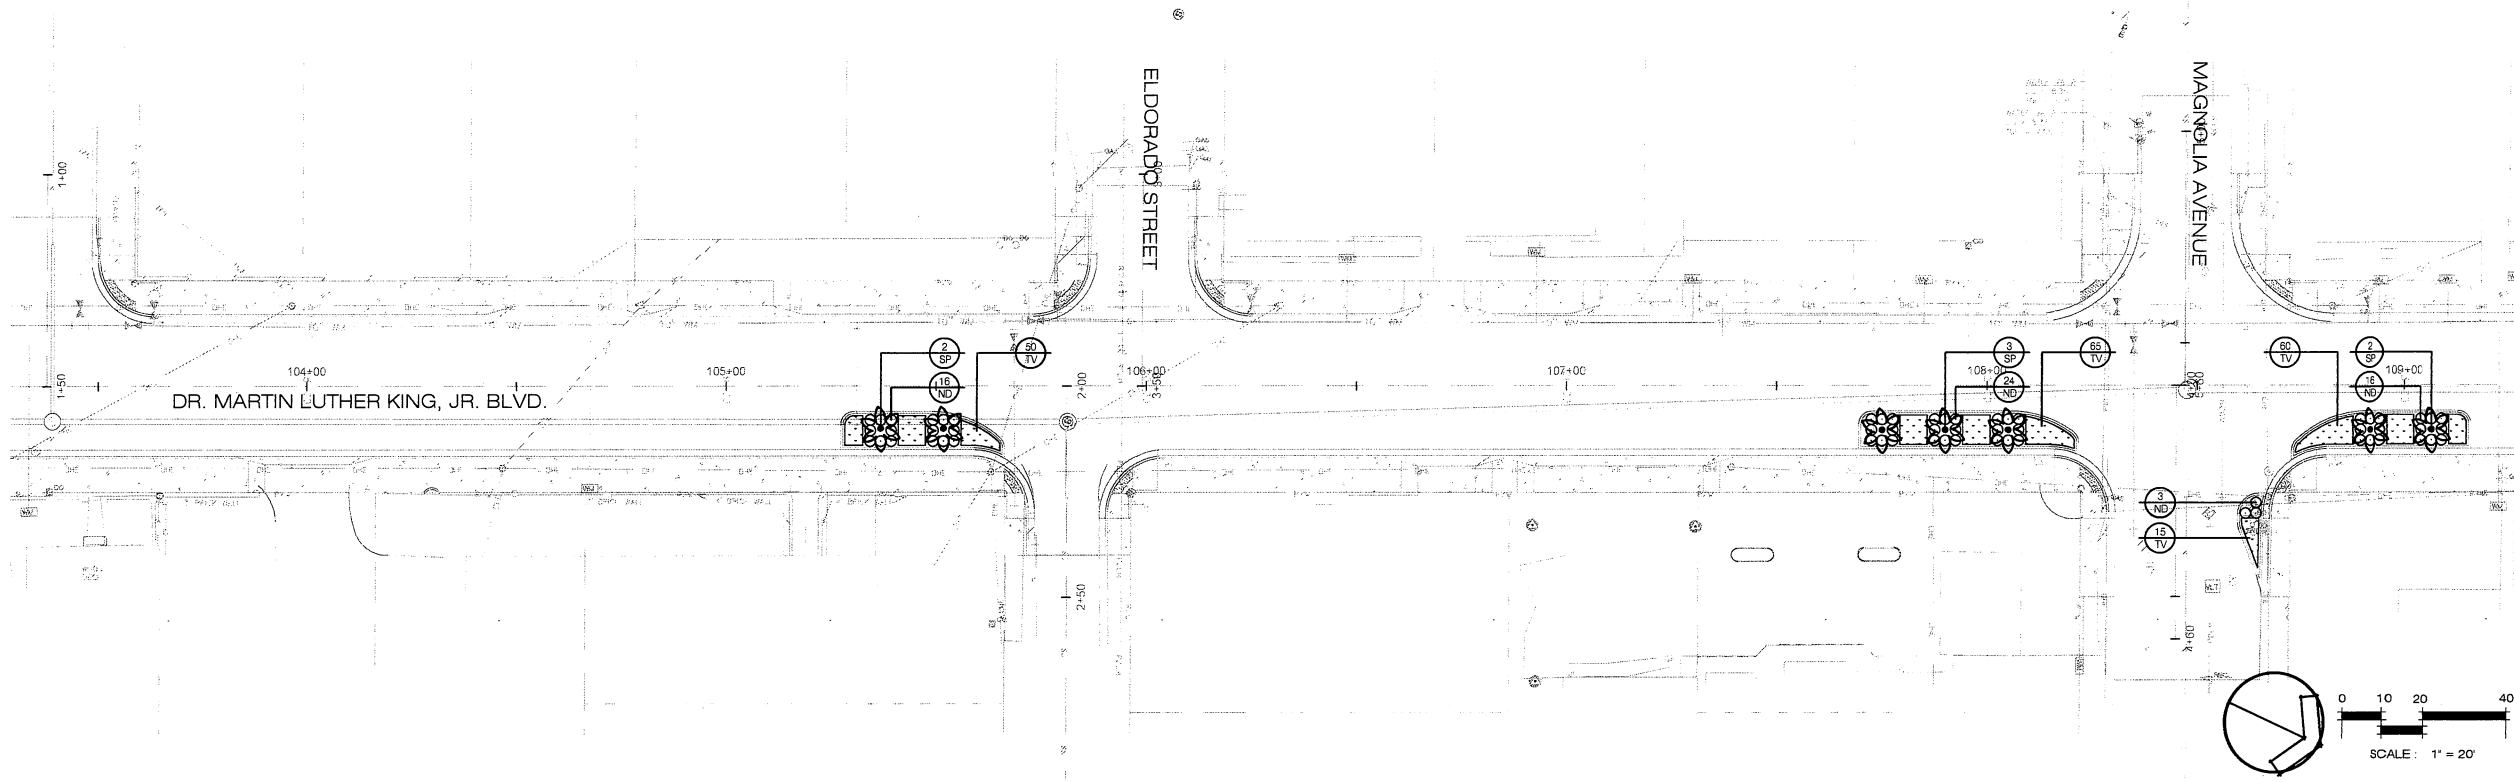

MATCHLINE SEE SHEET L-3.02 FOR CONTINUATION

REVISIONS	
NO.	DATE
1.	03/27/17
2.	03/27/17
3.	03/27/17
4.	03/27/17
5.	03/27/17
6.	03/27/17
7.	03/27/17
8.	03/27/17
9.	03/27/17
10.	03/27/17
11.	03/27/17
12.	03/27/17
13.	03/27/17
14.	03/27/17
15.	03/27/17
16.	03/27/17
17.	03/27/17
18.	03/27/17
19.	03/27/17
20.	03/27/17

DR. MARTIN LUTHER KING, JR. BOULEVARD  
 ROAD RECONSTRUCTION  
 LANDSCAPE PLAN  
 DAYTONA BEACH, FLORIDA



PROJECT NO: MLK BLVD.  
 ISSUE DATE: 3/20/2017  
 DRAWING FILE: MLK BLVD.  
 XREFS:  
 DRAFTED BY: JD  
 DESIGNED BY: JDSBK  
 CHECKED BY: SBK  
 SCALE: 1" = 20'

NOT VALID WITHOUT SEAL

SHEET L-3.01

PLANT LIST				
SYMBOL	QTY.	SPECIES	COMMON NAME	SPECIFICATIONS
<b>PALMS</b>				
SP	10	SABAL PALMETTO	CABBAGE PALM	14' CLEAR TRUNK, SLICK
<b>SHRUBS &amp; GROUNDCOVER</b>				
ND	83	NANDINA DOMESTICA FIREPOWER	FIREPOWER NANDINA	3 GAL., 18" HT., 30" OC.
TV	265	TULBAGHIA VIOLACEA	SOCIETY GARLIC	1 GAL., 12" SPRD., 18" O.C.

**LANDSCAPE GENERAL NOTES**

- FLORIDA #1:** ALL PLANT MATERIAL SHALL BE GRADE FLORIDA NO. 1 OR BETTER IN QUALITY AS DESIGNATED IN THE MOST RECENT PUBLICATION OF "GRADES AND STANDARDS FOR NURSERY PLANTS", PUBLISHED BY THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES.
- MULCH:** ALL PLANTING BEDS SHALL BE TOP DRESSED WITH 3" PINE BARK MULCH. ALL TREES NOT IN BEDS SHALL HAVE A 5' DIAMETER MULCH RING. ALL PALMS NOT IN BEDS SHALL HAVE A 3' DIAMETER MULCH RING.
- QUANTITIES:** IN THE EVENT OF A VARIATION BETWEEN THE QUANTITIES SHOWN ON THE PLANT LIST AND THE ACTUAL QUANTITY OF PLANTS SHOWN ON THE PLAN, THE PLAN SHALL CONTROL. SOD QUANTITY TAKEOFFS ARE THE RESPONSIBILITY OF THE CONTRACTOR.
- UNFORESEEN CONFLICTS:** CONTRACTOR SHALL NOT WILLFULLY INSTALL ANY PORTION OF THE LANDSCAPE PLAN AS SHOWN ON THE DRAWINGS WHEN IT IS OBVIOUS IN THE FIELD THAT UNFORESEEN OBSTRUCTIONS, GRADE DIFFERENCES, STANDING WATER, SOIL CONDITIONS OR OTHER CONFLICTS EXIST. SUCH UNFORESEEN CONFLICTS SHALL BE BROUGHT TO THE ATTENTION OF THE OWNERS REPRESENTATIVE AND THE LANDSCAPE ARCHITECT PRIOR TO INSTALLATION.
- SUBSTITUTIONS:** NO SUBSTITUTIONS OR VARIATIONS OF ANY PLANT MATERIAL OR ITS INSTALLED LOCATION WILL BE PERMITTED WITHOUT THE PRIOR WRITTEN CONSENT AND APPROVAL FROM THE LANDSCAPE ARCHITECT.
- CONTAINERS:** IF GALLONAGE FOR PLANTS OR TREES IS SHOWN THEY SHALL BE CONTAINER GROWN AND THE SIZE SHOWN SHALL REPRESENT THE MINIMUM ALLOWABLE GALLONAGE ACCEPTED. IN ALL CASES THE PLANT SPECIFIED SIZE SHALL GOVERN OVER THE GALLONAGE INDICATED.
- PLANTING SOIL:** CONTRACTOR SHALL VERIFY THAT SOIL CONDITIONS ARE SUITABLE TO THE PLANT SPECIES SPECIFIED. IF SOIL CONDITIONS ARE DEEMED UNSUITABLE FOR PROPER PLANT HEALTH, CONTRACTOR SHALL NOTIFY LANDSCAPE ARCHITECT AND PROPER SUBSTITUTIONS SHALL BE SPECIFIED BY THE LANDSCAPE ARCHITECT PRIOR TO INSTALLATION. ADDITIONALLY, IF PRESENT, THE CONTRACTOR SHALL REMOVE LIME ROCK, CONCRETE AND OTHER DELETERIOUS DEBRIS FROM PLANTING BEDS. IF DEBRIS IS INTEGRATED IN THE SOIL, THE SOIL MUST BE EXCAVATED AND REPLACED WITH ACCEPTABLE SOIL. LASTLY, ALL FILL TO BE PLACED IN LANDSCAPE AREAS MUST HAVE A pH RANGE BETWEEN 5.8 AND 7.5, BE ORGANIC IN NATURE, AND BE FREE OF ROCKS AND DEBRIS.
- TOPSOIL:** TOPSOIL MATERIAL, IF REQUIRED, SHALL BE FREE FROM ALL HARD CLODS, WEEDS, STONES OVER 1" IN DIAMETER, CLAY, HARD PAN, NOXIOUS PLANTS, SOD, INSECTS, OR OTHER UNDESIRABLE PLANTS, SEEDS, OR MATERIAL WHICH MAY BE HARMFUL FOR GROWTH AND SHALL BE CERTIFIED AS STERILE.
- WEEDS:** IF PRESENT, THE CONTRACTOR SHALL BE RESPONSIBLE TO REMOVE ANY WEEDS FROM PLANTING AREAS PRIOR TO THE INSTALLATION OF PROPOSED PLANT MATERIAL AND MULCH COVER. CONTRACTOR SHALL BE RESPONSIBLE TO KEEP BEDS FREE OF WEEDS FOR THE DURATION OF THE 90 DAY MAINTENANCE PERIOD.
- GRADING:** UNLESS OTHERWISE STATED ON THESE PLANS, THE LANDSCAPE CONTRACTOR SHALL FINE GRADE ALL AREAS TO BE PLANTED AND SODDED IN ORDER TO ELIMINATE BUMPS AND DEPRESSIONS. FINE GRADING SHALL BE DEFINED AS THE FINAL 2" OF GRADE TO BE ACHIEVED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRING AND REGRADING WASHOUT AREAS CAUSED BY EROSION UNTIL FINAL ACCEPTANCE OF THE PROJECT.
- STAKING:** ALL TREES, AND PALMS ARE TO BE STAKED ACCORDING TO THE DETAILS IN THESE PLANS. IF THE CONTRACTOR PREFERENCES TO USE OTHER STAKING METHODS THAN SHOWN IN THE DETAILS, HE OR SHE MUST SUBMIT PROPOSED STAKING DETAILS TO THE LANDSCAPE ARCHITECT FOR APPROVAL PRIOR TO INSTALLATION. THE LANDSCAPE CONTRACTOR SHALL STRAIGHTEN, REPAIR, AND/OR REPLACE ANY PLANTS DAMAGED BY FAILURE TO PROPERLY STAKE OR GUY ANY TREES ON SITE, AT THEIR OWN EXPENSE.
- CURVILINEAR:** CURVILINEAR LANDSCAPE BEDS ARE TO BE EDGED WITH SMOOTH FLOWING CURVES. STRAIGHT-LINE LANDSCAPE BEDS ARE TO BE EDGED IN A STRAIGHT LINE PARALLEL TO PARKING LOTS AND STRUCTURES UNLESS DESIGNED OTHERWISE.
- FERTILIZER:** OSMOCOTE SLOW RELEASE FERTILIZER OR EQUIVALENT SHALL BE APPLIED TO ALL TREE, SHRUB, AND GROUNDCOVER PLANTING AREAS AT THE RATE OF THREE (3) TABLESPOONS PER 2 S.F. OF PLANTING AREA.
- DRAINAGE:** THE LANDSCAPE CONTRACTOR SHALL ASSURE THAT THIS WORK DOES NOT INTERRUPT EXISTING OR PROPOSED DRAINAGE PATTERNS AND SHALL NOTIFY THE OWNERS REPRESENTATIVE IMMEDIATELY SHALL A CONFLICT ARISE.
- SPECIFICATIONS:** THE LANDSCAPE ARCHITECT SHALL BE PERMITTED THE RIGHT DURING INSTALLATION, TO REJECT ANY AND ALL PLANT MATERIAL AND WORKMANSHIP WHICH IN HIS OR HER OPINION DOES NOT MEET THE REQUIREMENTS OF THESE SPECIFICATIONS.
- TURNOVER:** CONTRACTOR SHALL CONTACT OWNERS REPRESENTATIVE FOR A TURNOVER DATE TO INCLUDE A WALK-THROUGH AND ACCEPTANCE OF WORK BY THE LANDSCAPE ARCHITECT. ANY WORK DEEMED UNACCEPTABLE SHALL BE CORRECTED IMMEDIATELY AND REINSPECTED AS SCHEDULED.
- MAINTENANCE:** CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTENANCE TO BEGIN AFTER EACH PLANT HAS BEEN INSTALLED AND SHALL CONTINUE 90 DAYS AFTER FINAL WRITTEN ACCEPTANCE BY THE OWNER. MAINTENANCE SHALL INCLUDE WATERING, PRUNING, WEEDING, MULCHING, MOWING, REPLACEMENT OF SICK OR DEAD PLANTS, AND ANY OTHER CARE NECESSARY IN ORDER TO MAINTAIN PROPER PLANT HEALTH AND SOIL MOISTURE CONTENT.
- GUARANTEE:** CONTRACTOR SHALL GUARANTEE ALL INSTALLED PLANT MATERIAL FOR ONE (1) CALENDAR YEAR STARTING FROM THE TURNOVER DATE SHOULD WORK BE FOUND ACCEPTABLE. ANY CORRECTED WORK SHALL HAVE A PROPORTIONAL EXTENSION OF WARRANTY ONCE APPROVED. ANY SICK OR DEAD MATERIAL SHALL BE REPLACED IMMEDIATELY. THE LANDSCAPE CONTRACTOR SHALL NOT BE RESPONSIBLE TO HONOR ANY WARRANTY FOR THE LOSS OF ANY PLANT MATERIAL CAUSED BY FLOODING, FIRE, FREEZING TEMPERATURES, WINDS OVER 50 MPH, LIGHTNING, ANY OTHER NATURAL DISASTER, OR ANY LOSS/DAMAGE CAUSED BY VANDALISM OR NEGLIGENCE ON THE PART OF THE OWNER.






**IRRIGATION GENERAL NOTES**

- AN AUTOMATIC TIME CONTROLLED IRRIGATION SYSTEM WITH A RAIN SENSOR SHALL BE INSTALLED TO PROVIDE 100% HEAD TO HEAD COVERAGE OF ALL NEW PLANTINGS. SEE IRRIGATION PLAN L-4.01 - L-4.02.

MATCHLINE SEE SHEET L-3.01 FOR CONTINUATION

DR. MARTIN LUTHER KING, JR. BLVD.

FOOTE COURT

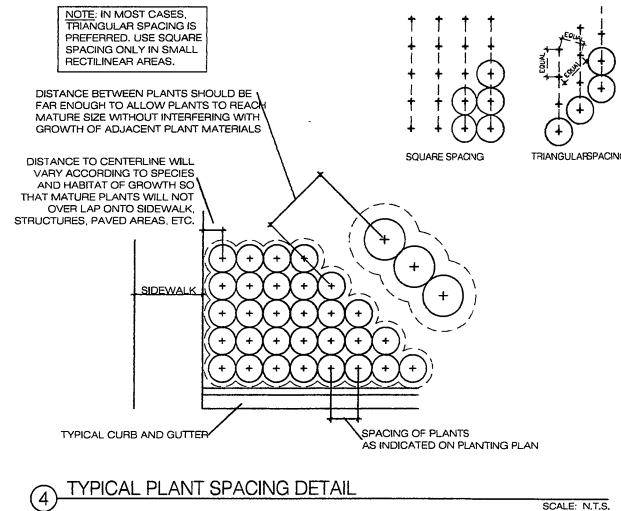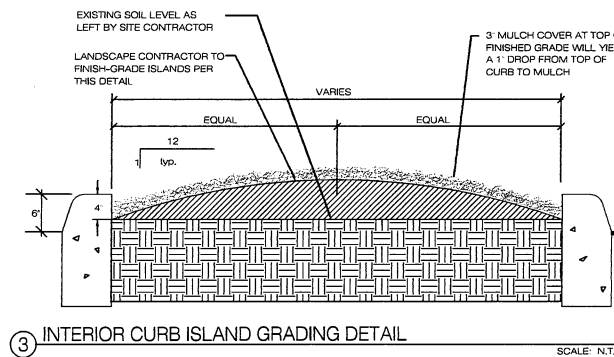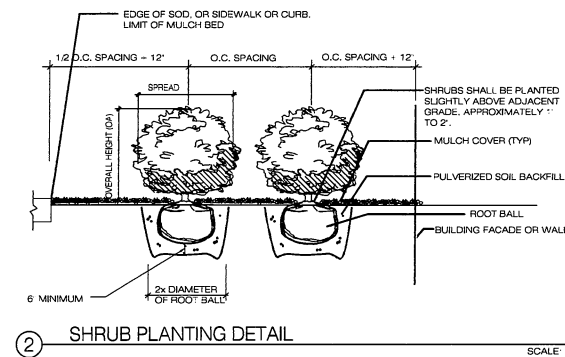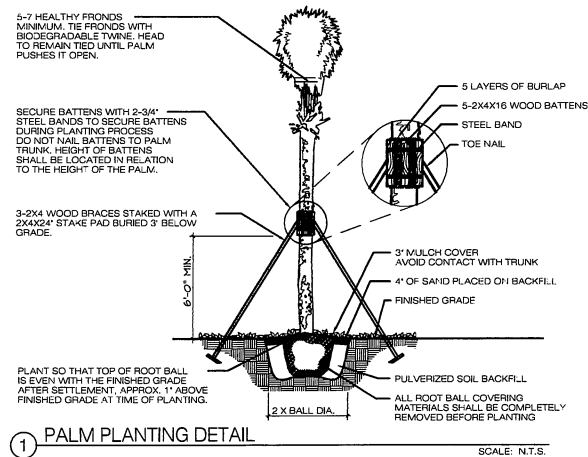


REVISIONS	
NO.	DESCRIPTION
1.	ISSUED FOR BIDDING
2.	REVISED PER CLIENT REQUEST

DR. MARTIN LUTHER KING, JR. BOULEVARD  
ROAD RECONSTRUCTION  
LANDSCAPE PLAN  
DAYTONA BEACH, FLORIDA



PROJECT NO: MLK BLVD.  
ISSUE DATE: 3/30/2017  
DRAWING FILE: MLK BLVD. XREF'S  
DRAFTED BY: JD  
DESIGNED BY: JDSBK  
CHECKED BY: SBK  
SCALE: 1" = 20'

NOT VALID WITHOUT SEAL  
SHEET  
L-3.02

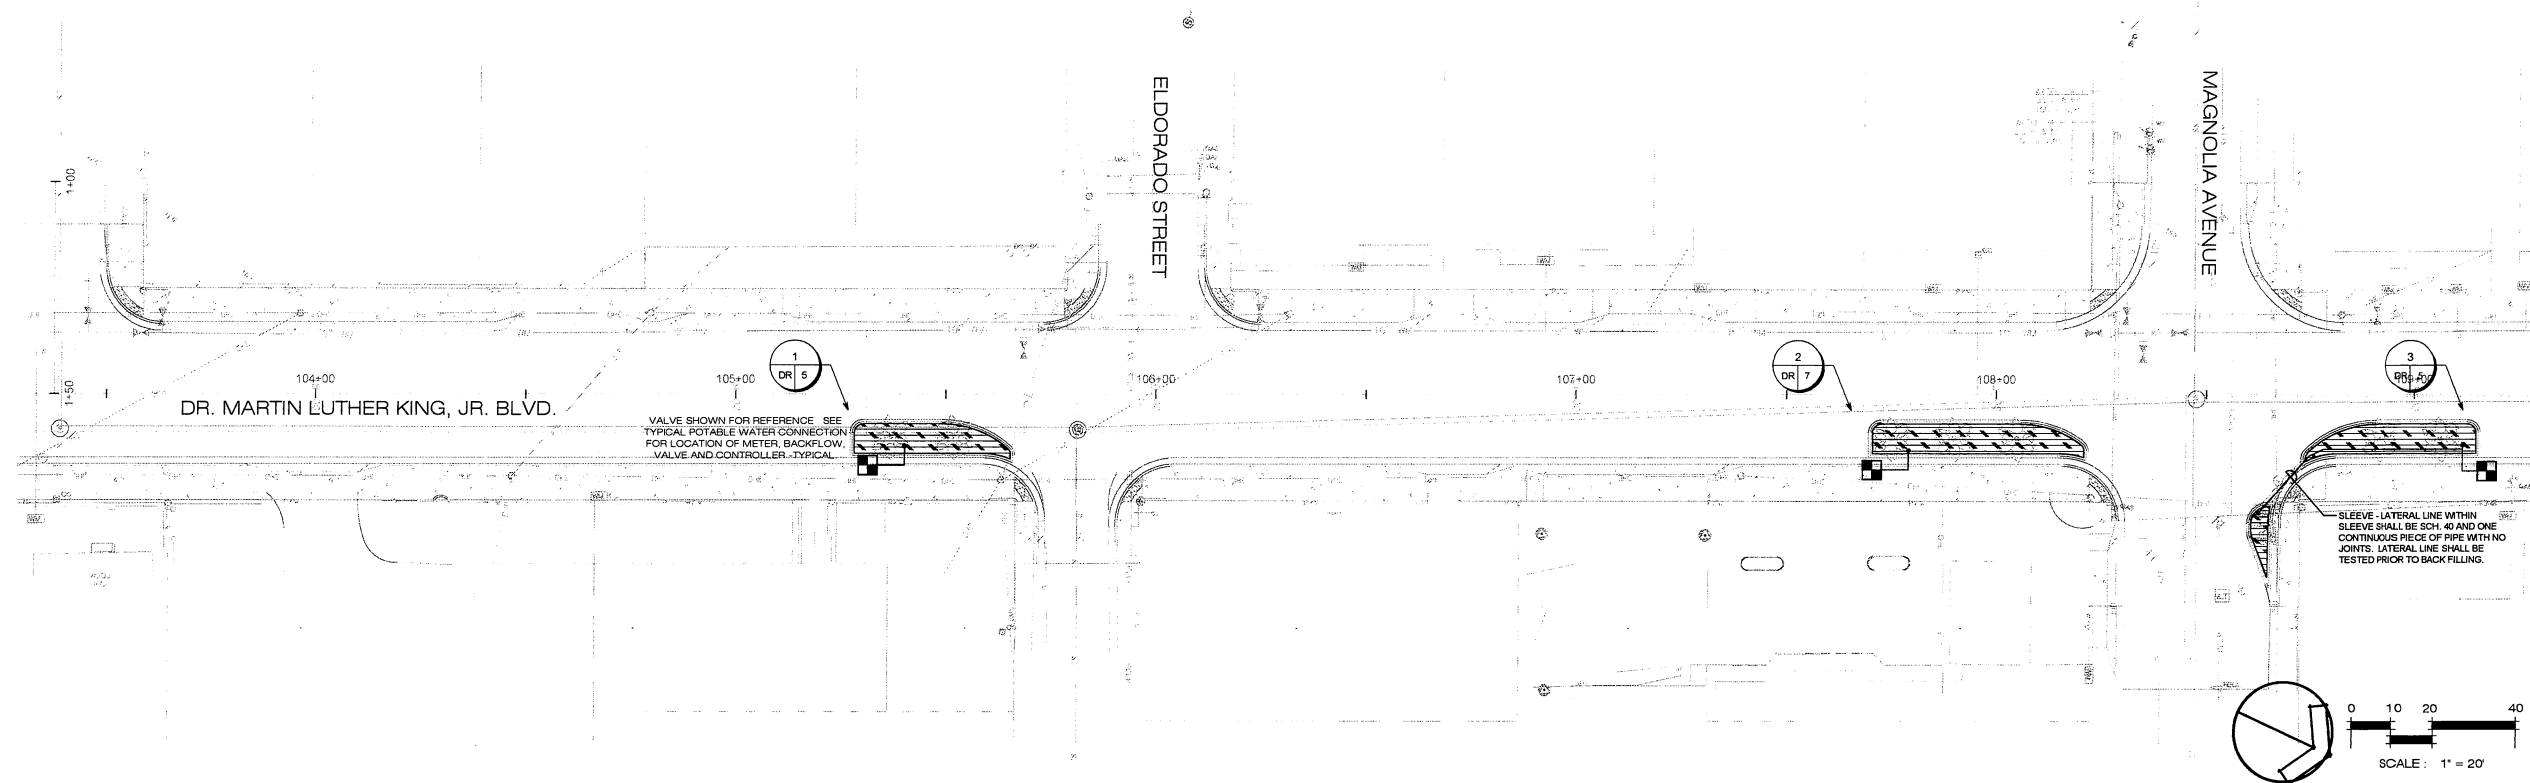

MATCHLINE SEE SHEET L-4.02 FOR CONTINUATION

NO.	DATE	BY	REVISION
1	12/15/17	JD	ISSUE FOR BIDDING
2	5/20/17	JD	REVISED PER CLIENT REQUEST

DR. MARTIN LUTHER KING, JR. BOULEVARD  
ROAD RECONSTRUCTION  
IRRIGATION PLAN  
DAYTONA BEACH, FLORIDA



PROJECT NO: MLK BLVD.  
ISSUE DATE: 3/30/2017  
DRAWING FILE: MLK BLVD. XREFS  
DRAFTED BY: JD  
DESIGNED BY: JD/SBK  
CHECKED BY: SBK  
SCALE: 1" = 20'

NOT VALID WITHOUT SEAL  
SHEET L-4.01

**LEGEND**

**RAIN BIRD XFS-09-12 SUB-SURFACE DRIFLINE** INSTALLED AT 12" O.C. WITH EMITTERS IN A TRIANGULAR PATTERN 1" BELOW GRADE. SEE SHEET L-308 FOR TYPICAL INSTALLATION DETAILS. RAIN BIRD COMPRESSION FITTINGS AND BARBED TUBING STAKES SHALL BE USED. EACH ZONE SHALL HAVE A MIN. OF ONE FLUSH VALVE, ONE AIR RELIEF VALVE, AND ONE OPERATION INDICATOR. INSTALL ALL DRIFLINE PER RAIN BIRD SPECIFICATIONS AND DETAILS.

**HUNTER INDUSTRIES IC2-101-40 DRIP CONTROL ZONE KIT** WITH 40 PSI REGULATOR (CONTRACTOR TO INSTALL NODE-100 AND REMOVE/REPLACE CONVENTIONAL SOLENOID WITH DC LATCHING SOLENOID). INSTALL VALVE IN A RAIN BIRD V8-MB JUMBO VALVE BOX WITH LOCKING LID. VALVE LOCATION SHOWN FOR REFERENCE. INSTALL ALL VALVES IN A LANDSCAPE AREA WITH A MINIMUM 24" CLEARANCE FROM SIDEWALK/CURB.

**ZONE TAG**

**SCHEDULE 40 PVC MAINLINE - 1"**

**1" SCHEDULE 40 PVC LATERAL LINE**

**2" SCHEDULE 40 PVC SLEEVE**


**HUNTER INDUSTRIES NODE-100 BATTERY POWERED IRRIGATION CONTROLLER** CONTRACTOR TO REMOVE/REPLACE EXISTING CONVENTIONAL SOLENOID WITH DC LATCHING SOLENOID PROVIDED WITH NODE-100 (SEE VALVE SPECIFICATION ABOVE). CONTRACTOR TO PROVIDE TWO 9-VOLT BATTERIES (ALKALINE) FOR EACH CONTROLLER. INSTALL CONTROLLER PER DETAIL ON SHEET L-4.02.

**5/8" IRRIGATION METER** INSTALL IN A LANDSCAPE AREA WITH A MINIMUM 24" CLEARANCE FROM SIDEWALK/CURB.

**1" REDUCED PRESSURE BACKFLOW PREVENTER** INSTALL IN A LANDSCAPE AREA WITH A MINIMUM 24" CLEARANCE FROM SIDEWALK/CURB.

**GENERAL NOTES**









- IRRIGATION CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL APPLICABLE PERMITS REQUIRED TO PERFORM WORK.
- REFER TO THE LANDSCAPE PLANS WHEN TRENCHING TO AVOID TREE AND SHRUB LOCATIONS.
- ALL MAINLINE PIPING SHALL BE BURIED TO A MINIMUM DEPTH OF 18" OF COVER AND ALL LATERAL PIPING SHALL BE BURIED TO A MINIMUM DEPTH OF 12" OF COVER.
- PIPE SIZES SHALL CONFORM TO THOSE SHOWN ON THE DRAWINGS. THE SMALLEST LATERAL PIPE SIZE TO A SINGLE SPRAY OR ROTOR HEAD SHALL BE 3/4".
- ALL REMOTE CONTROL VALVES, GATE VALVES AND QUICK COUPLERS SHALL BE INSTALLED IN VALVE BOXES.
- ANY PIPING OR VALVES SHOWN OUTSIDE THE PROPERTY LINE OR OUTSIDE OF A LANDSCAPE AREA IS SHOWN THERE FOR DESIGN CLARITY ONLY. ALL PIPING AND VALVES SHALL BE INSTALLED ON THE PROPERTY AND WITHIN LANDSCAPE AREAS.
- IT IS THE RESPONSIBILITY OF ALL SITE CONTRACTOR TO FAMILIARIZE THEMSELVES WITH, AND EXERCISE CARE SO AS TO NOT DAMAGE ANY EXISTING IRRIGATION COMPONENTS (TO REMAIN), BERMS, WALLS, STRUCTURES, PLANT MATERIALS AND UTILITIES. ANY CONTRACTOR SHALL BE RESPONSIBLE FOR THE IMMEDIATE REPAIR OR REPLACEMENT OF ALL ITEMS DAMAGED BY HIS WORK. HE SHALL COORDINATE HIS WORK WITH OTHER CONTRACTORS FOR THE LOCATION AND INSTALLATION OF SLEEVES AND PIPING THROUGH WALLS, UNDER ROADWAYS AND PAVING, ETC.
- DO NOT WILLFULLY INSTALL THE SPRINKLER SYSTEM AS SHOWN ON THE DRAWINGS WHEN IT IS OBVIOUS IN THE FIELD THAT UNKNOWN OBSTRUCTIONS, GRADE DIFFERENCES OR DIFFERENCES IN AREA DIMENSIONS EXIST THAT MIGHT NOT HAVE BEEN CONSIDERED IN THE ENGINEERING. SUCH OBSTRUCTIONS OR DIFFERENCES SHOULD BE BROUGHT TO THE ATTENTION OF THE OWNER'S AUTHORIZED REPRESENTATIVE. IN THE EVENT THIS NOTIFICATION IS NOT PERFORMED, THE IRRIGATION CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR ANY REVISIONS.
- FINAL LOCATION OF THE AUTOMATIC CONTROLLER(S) SHALL BE APPROVED BY THE OWNER'S AUTHORIZED REPRESENTATIVE PRIOR TO INSTALLATION.
- THE IRRIGATION CONTRACTOR SHALL FLUSH AND ADJUST ALL SPRINKLER HEADS AND VALVES TO PROVIDE OPTIMUM COVERAGE WITH MINIMAL OVERSPRAY ONTO WALKS, STREETS, WALLS, ETC. IN ORDER TO ACCOMPLISH THIS, THE CONTRACTOR MAY SUBSTITUTE VARIABLE ARC NOZZLES IN PLACE OF THE SPECIFIED FIXED ARC NOZZLES WHERE NECESSARY. PRESSURE COMPENSATING SCREENS MAY ALSO BE USED TO REDUCE SPRAY DISTANCE.
- THE CONTRACTOR SHALL COMPLETE ALL WORK IN ACCORDANCE WITH ALL PREVAILING LAWS, CODES AND REGULATIONS.
- ALL SPRINKLER EQUIPMENT NOT OTHERWISE DETAILED OR SPECIFIED SHALL BE INSTALLED AS PER MANUFACTURER'S RECOMMENDATIONS AND SPECIFICATIONS.
- THE CONTRACTOR SHALL PREPARE AN AS-BUILT DRAWING IN AUTOCAD FORMAT SHOWING ALL IRRIGATION INSTALLATION. THE AS-BUILT DRAWING SHALL LOCATE ALL MAINLINE AND VALVES BY SHOWING EXACT MEASUREMENTS FROM HARD SURFACES.
- ALL WORK SHALL BE GUARANTEED FOR ONE YEAR FROM THE DATE OF FINAL ACCEPTANCE AGAINST ALL DEFECTS IN EQUIPMENT AND WORKMANSHIP.

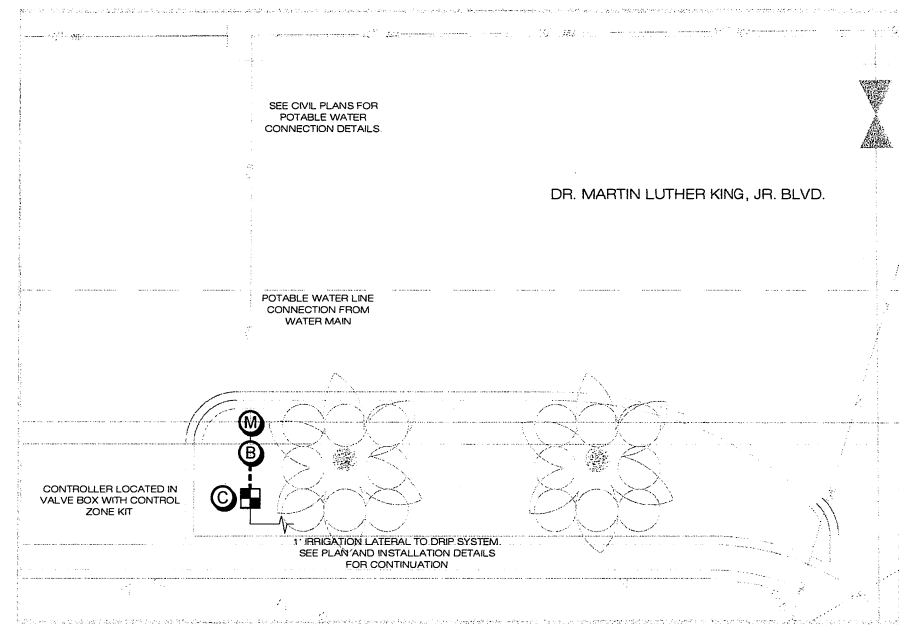

1 TYPICAL POTABLE WATER CONNECTION (ONE CONNECTION PER ISLAND)  
L-4.01 SCALE: NOT TO SCALE

MATCHLINE SEE SHEET L-4.01 FOR CONTINUATION

110+00 111+00 112+00 113+00 114+00 115+00  
 DR. MARTIN LUTHER KING, JR. BLVD.  
 VALVE SHOWN FOR REFERENCE. SEE TYPICAL POTABLE WATER CONNECTION FOR LOCATION OF METER, BACKFLOW VALVE AND CONTROLLER - TYPICAL.  
 FOOTCOURT

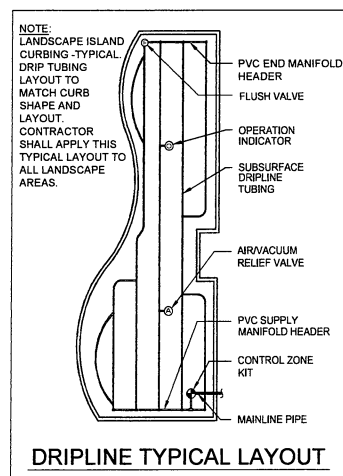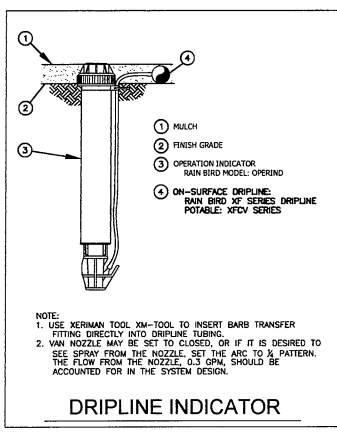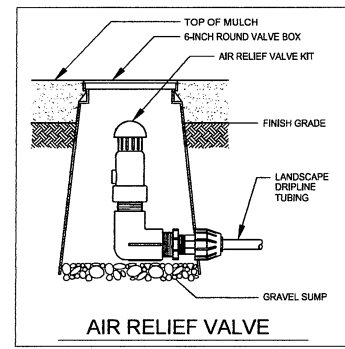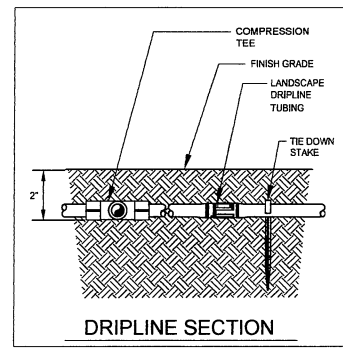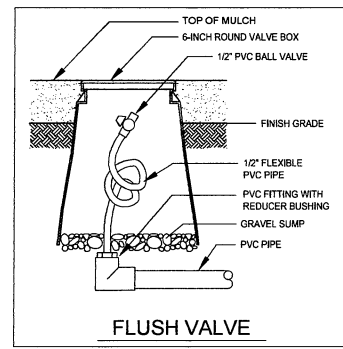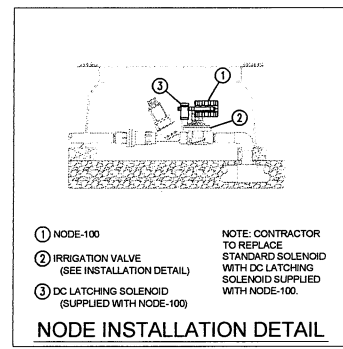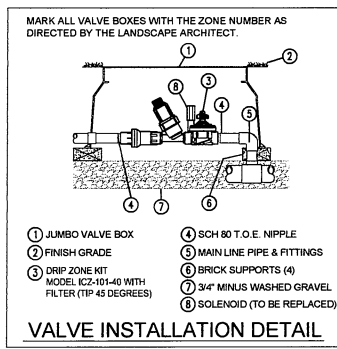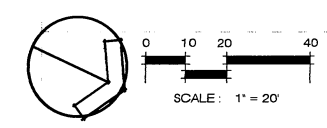


**DRIPLINE IRRIGATION NOTES**

- 1) INSTALL ALL DRIPLINE TUBING 2" BELOW GRADE. USE STAKES TO HOLD THE TUBING IN PLACE.
- 2) KEEP DRIPLINE TUBING CLEAN AT ALL TIMES BEFORE THE FINAL CONNECTION. TAPE ALL TUBE ENDS OR USE DIRT CAPS.
- 3) AVOID SHARP BENDS IN THE TUBING. DO NOT BEND THE TUBING WITH LESS THAN A 12" RADIUS.
- 4) ALL DRIPLINE TUBING SHALL HAVE UNIFORM SPACING AND BURIAL DEPTH.
- 5) INSTALL DRIPLINE TUBING IN ALL AREAS THAT SHALL RECEIVE PLANT MATERIAL. REFER TO THE PLAN FOR THE EXACT LOCATIONS.
- 6) SPACE TUBING AS NOTED ON THE PLANS AND/OR DETAILS. THE PLAN DOES NOT ALWAYS SHOW ALL DRIPLINE TUBING. THE PLAN LAYOUT IS SHOWN FOR CLARITY ONLY.
- 7) REFER TO THE MANUFACTURER'S DRIPLINE INSTALLATION MANUAL FOR SPECIFIC INSTALLATION INSTRUCTIONS AND DETAILS.
- 8) ALWAYS FLUSH ALL LINES BEFORE FINAL CONNECTION.
- 9) REFER TO THE LANDSCAPE PLAN TO AVOID LAYOUT WHERE TREES SHALL BE INSTALLED WITHIN LANDSCAPE BEDS.
- 10) INSTALL ALL AIR RELIEF AND FLUSH VALVES INSIDE A VALVE BOX.
- 11) CLEARLY AND NEATLY MARK THE TOP OF EACH VALVE BOX WITH THE TYPE OF EQUIPMENT THAT IT CONTAINS. (I.E. AIR RELIEF VALVE, FLUSH VALVE, ETC.)
- 12) ALL VALVE BOXES SHALL HAVE A 6" LAYER OF PEA GRAVEL IN THE BASE.

REVISIONS	
NO.	DESCRIPTION
1.	ISSUE FOR BIDDING
2.	REVISED PER CLIENT REQUEST

DR. MARTIN LUTHER KING, JR. BOULEVARD  
 ROAD RECONSTRUCTION  
 IRRIGATION PLAN  
 DAYTONA BEACH, FLORIDA

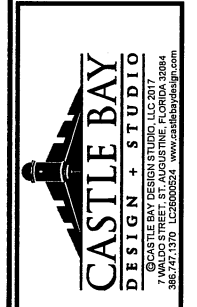

PROJECT NO: MLK BLVD.  
 ISSUE DATE: 3/30/2017  
 DRAWING FILE: MLK BLVD.  
 XREF'S:  
 DRAFTED BY: JD  
 DESIGNED BY: JDSBK  
 CHECKED BY: SBK  
 SCALE: 1" = 20'

NOT VALID WITHOUT SEAL  
 SHEET L-4.02