











KEYNOTES	
REPRESENTED BY [n]	
APPLIES TO DRAWING A2.1 & A10.1	
1	REMOVE OVERHEAD DOOR, DO NOT SALVAGE.
2	SALVAGE EXISTING DOOR AND FRAME.
3	REMOVE PORTION OF WALL INDICATED.
4	REMOVE EXISTING WALL AND ALL HOSTED ELEMENTS INCLUDING DOORS, ELEC OUTLETS, ETC.
5	EXISTING PIPING TO REMAIN.
6	REMOVE EXISTING GEAR GRID.
7	SALVAGE DOOR, FRAME SHALL REMAIN, REMOVE STRIKE AND PROVIDE STEEL OR ALUMINUM CLOSURE PLATE, PT TO MATCH FRAME COLOR.
8	EXISTING EXTERIOR FIXTURES SHALL REMAIN.
9	HANGING GEAR GRID NIC.
10	INFILL OPENING, MATCH ADJACENT CONSTRUCTION.
11	REFER TO ELEC DOCUMENTS, ELEC ITEMS WHICH SERVE FIXTURES AND EQUIPMENT AT THE EXTERIOR OF THE BUILDING SHALL REMAIN.
14	GYP BD FINISH SHALL COVER PLYWOOD.
15	CENTER ELECTRICAL JUNCTION BOX OR BOXES WITHIN THE PLYWOOD BLOCKING.
16	REMOVE SINK.
17	1/2" PLYWOOD FLUSH WITH FACE OF STUD, TYPICAL.
18	REMOVE COUNTERTOP AND SHELVING.
19	REMOVE EXISTING CONCRETE SLAB.
21	DEMO EXISTING CONCRETE AS REQUIRED TO PROVIDE PLUMBING SCOPE, AFTER INSTALLATION, INSPECTION, AND APPROVAL, PROVIDE MIN 4,000 PSI CONCRETE, MATCH EXISTING THICKNESS, REINFORCE WITH 6X6-W2.9WV2.9 WWF.
22	REMOVE EXISTING PARAPET COPING AS NECESSARY TO PROVIDE THE WORK SCOPE.
23	PROVIDE CONCRETE SLAB, REFER TO STRUCTURAL DOCUMENTS.
26	APPROXIMATE OUTLINE OF EXISTING WALL.

KEYNOTES	
REPRESENTED BY [n]	
APPLIES TO DRAWING A2.1 & A10.1	
27	CLEAN THE INTERIOR FACE OF EXISTING MASONRY WALLS. REFER TO PROJECT MANUAL FOR ADDITIONAL PREPARATION REQUIRED.
28	WOOD BLOCKING, TYPICAL.
29	REMOVE SHELF.
30	PAINT EXPOSED STRUCTURE, TYPICAL.
31	WALL MOUNTED TV, TV AND HANGING EQUIPMENT NIC, CONTRACTOR SHALL PROVIDE TV BLOCKING.
32	PERFORATED METAL PANEL.
33	PREMANUFACTURED ALUMINUM COPING.
34	EXISTING PARAPET COPING TO REMAIN.
35	MECH EQUIPMENT, REFER TO MECH DOCUMENTS.
39	NON-PENETRATING ROOF EDGE FALL PROTECTION, PROVIDE ADDITIONAL LAYER OF ROOFING MEMBRANE BELOW EACH RAIL RECEIVER.
40	CLOSE THE EXPOSED END OF THE BENCH WITH 1/2" PLYWOOD SHEET PAINTED BLACK.
41	REMOVE WOOD TRIM.
42	PROVIDE ROOF WALKWAY PAD, TYPICAL.
43	PROVIDE CAST IRON BOOT WITH CLEANOUT

DEMOLITION PLAN LEGEND	
APPLIES TO DRAWINGS A2.1	
	EXISTING PARTITION/ WALL/ ITEM TO REMAIN
	REMOVE EXISTING PARTITION/WALL/ITEM
	REMOVE EXISTING WINDOW ASSEMBLY AND FRAMING, INCLUDING ANCHORS
	SALVAGE EXISTING DOOR AND FRAME ASSEMBLY INCLUDING DOOR HARDWARE.
	REMOVE EXISTING PLUMBING FIXTURE, REFER TO PLUMBING DEMOLITION PLAN FOR ADDITIONAL INFORMATION.

DEMOLITION PLAN GENERAL NOTES	
A. UNO, SALVAGE DOORS & FRAMES AND TURN OVER TO OWNER, DISCARD THE FRAME IF DAMAGED DURING SALVAGING.	

FLOOR PLAN GENERAL NOTES	
A. THE COUNTY SHALL PROVIDE GYM LOCKERS AND GEAR GRIDS, THESE ITEMS ARE SHOWN ON THE FLOOR PLANS FOR COORDINATION PURPOSES ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF EXISTING GEAR GRIDS WHERE INDICATED IN THE DOCUMENTS.	
B. WHERE PATCHING FLOORS OR WALL BASES, MATCH THE ADJACENT MATERIALS, IF EXACT MATCHES CANNOT BE PROCURED, COORDINATE WITH THE OWNER AND PROVIDE SIMILAR MATERIAL.	

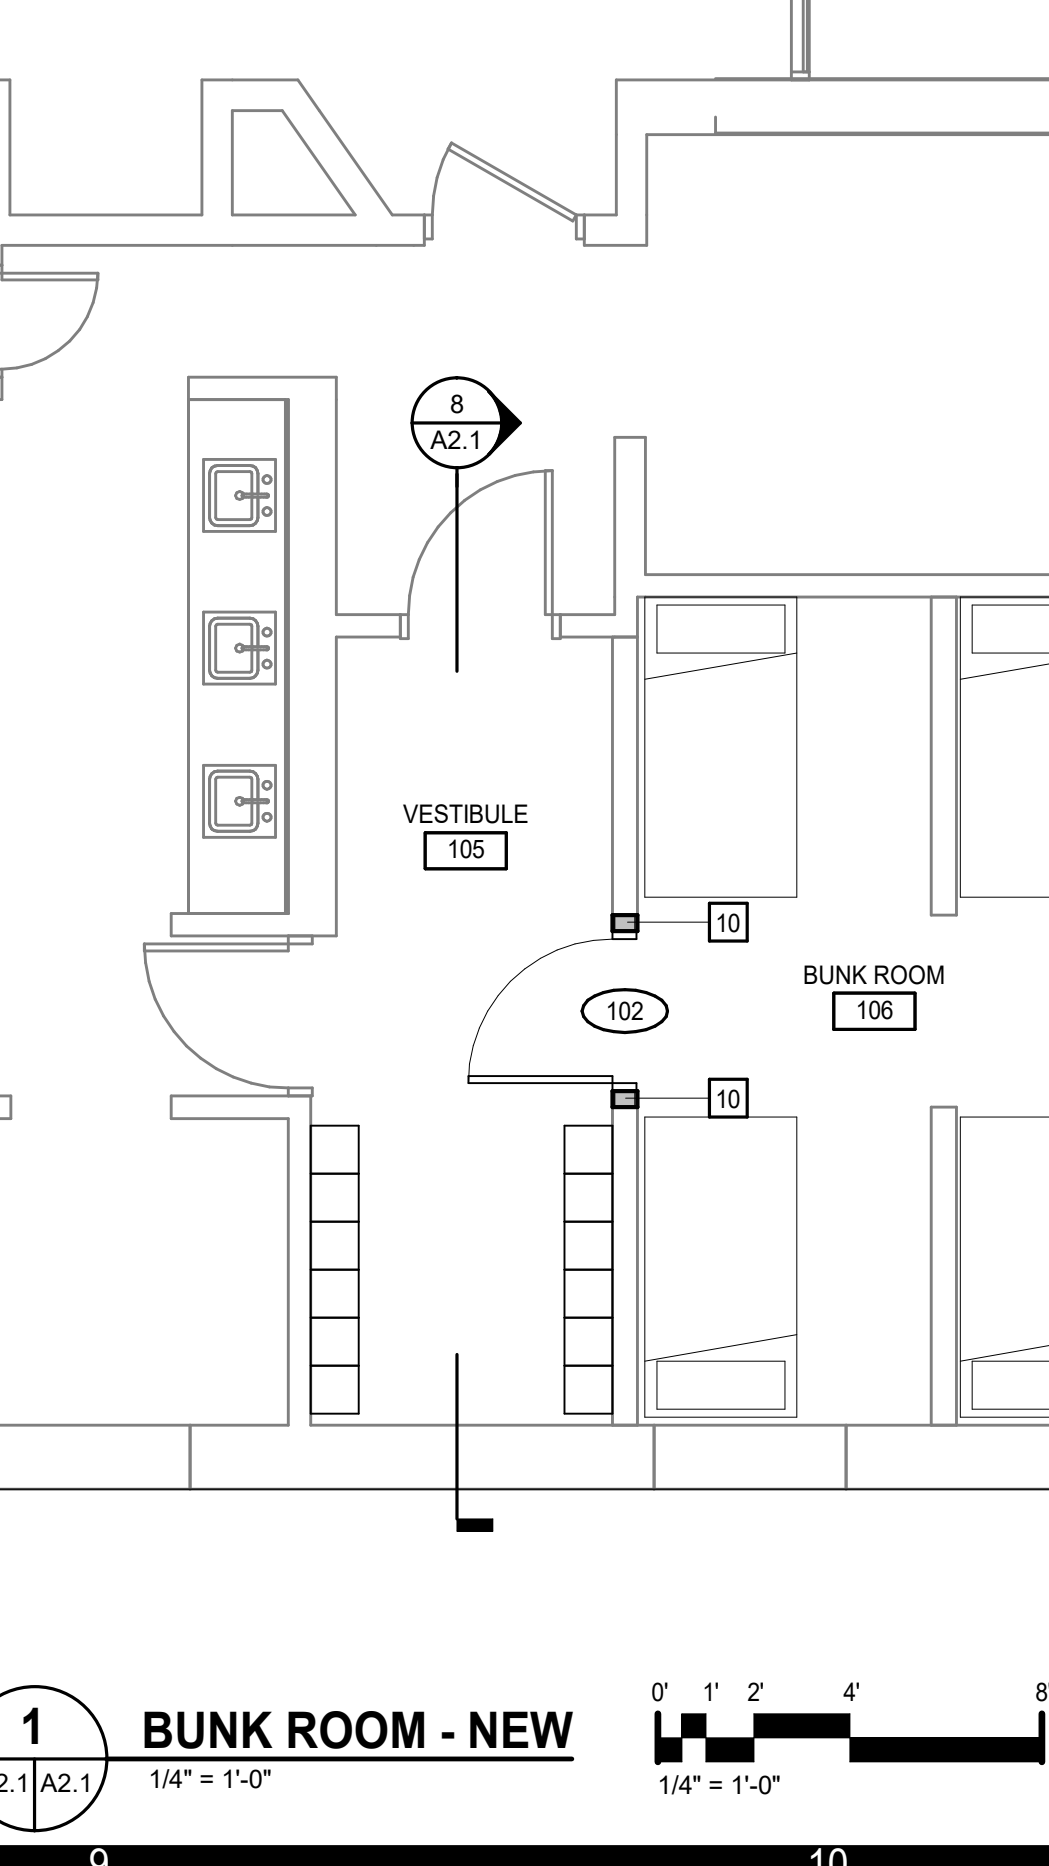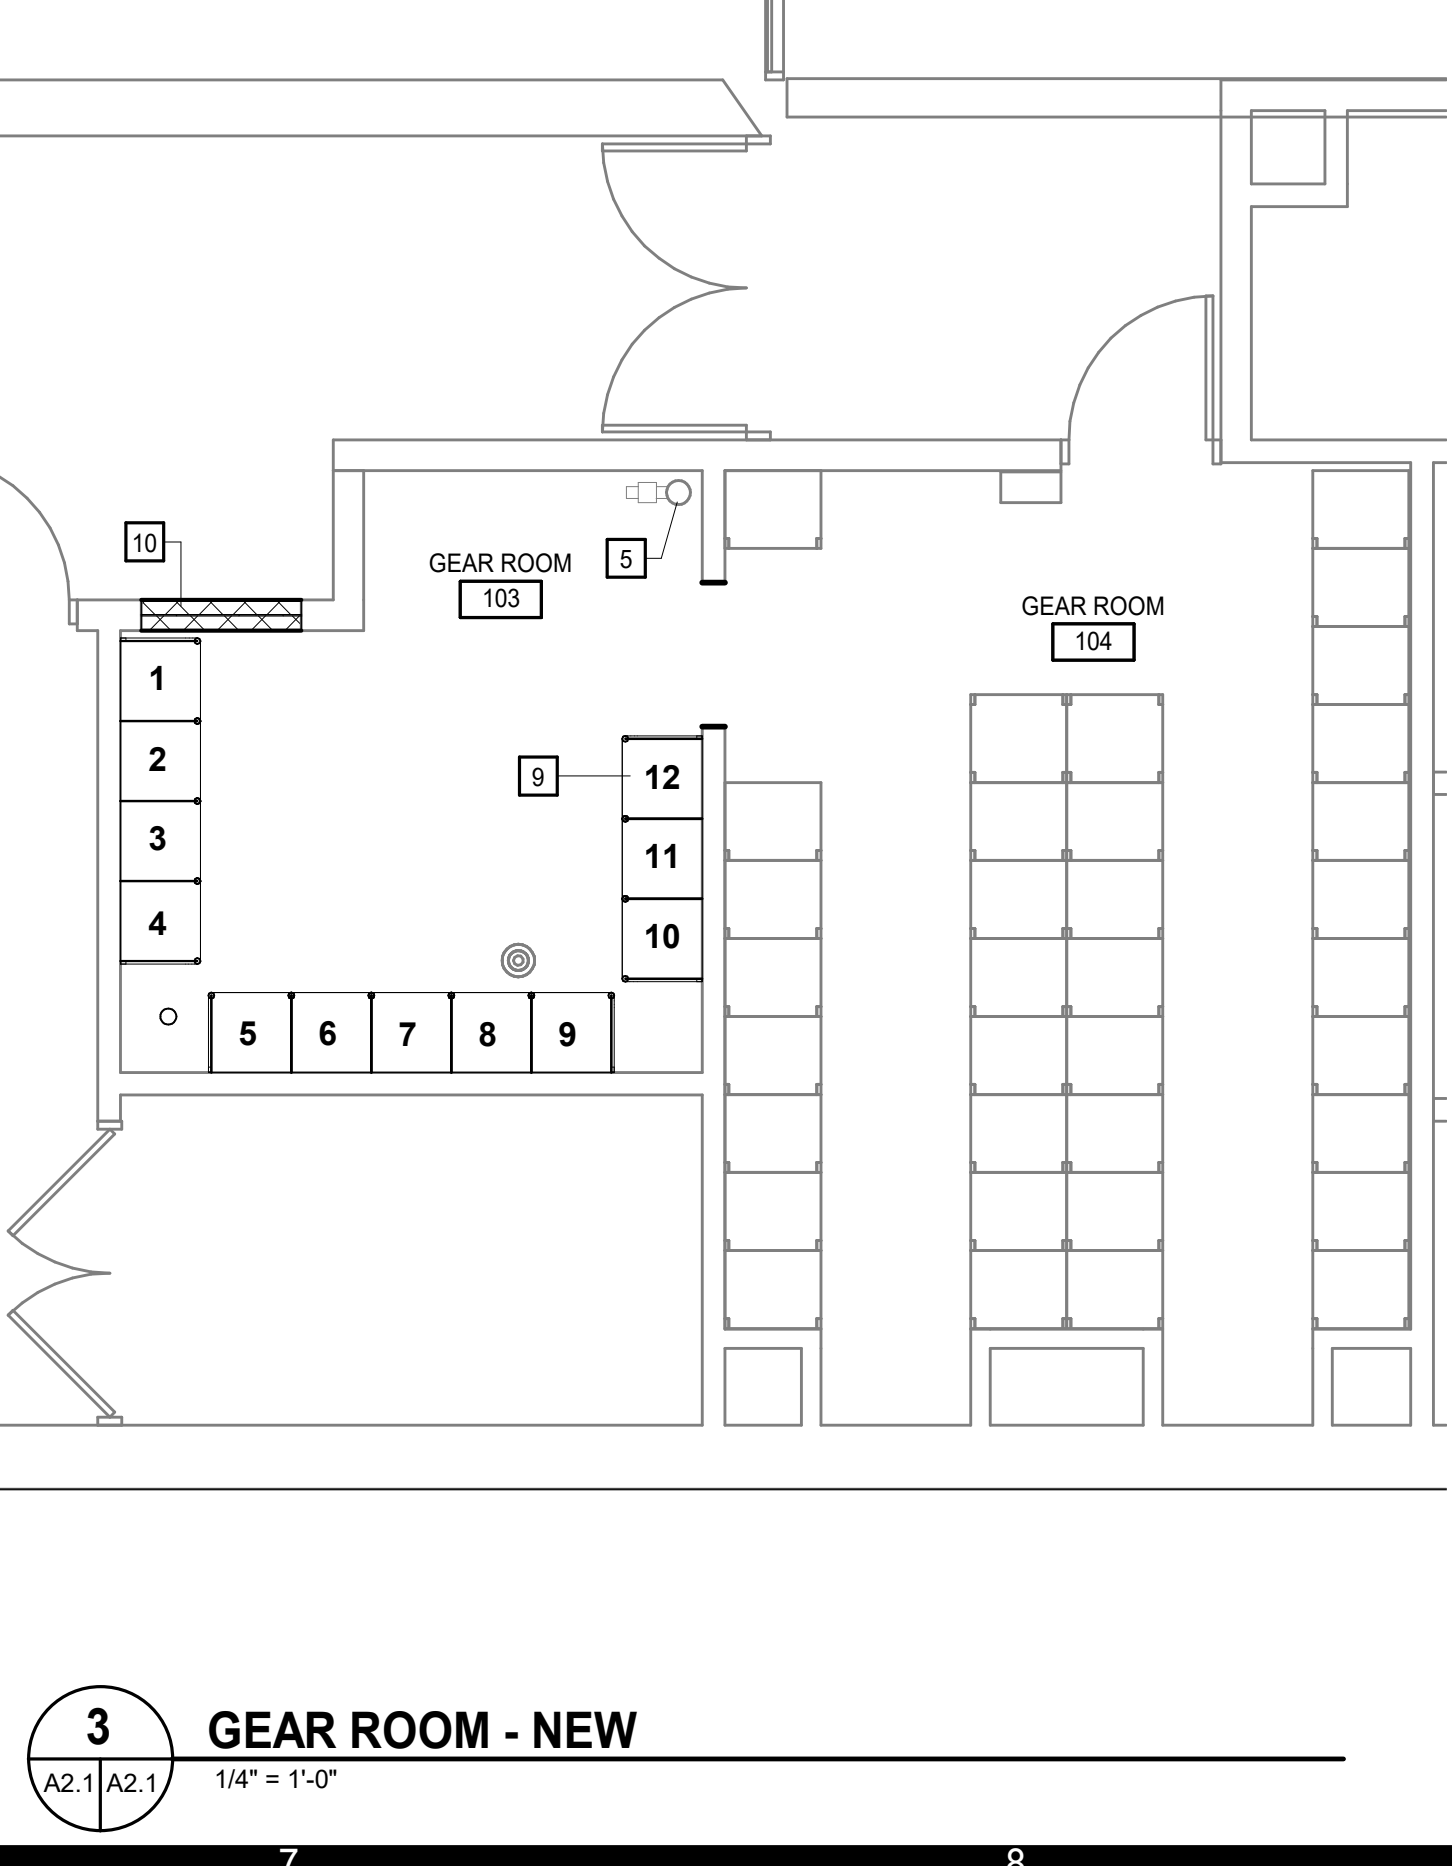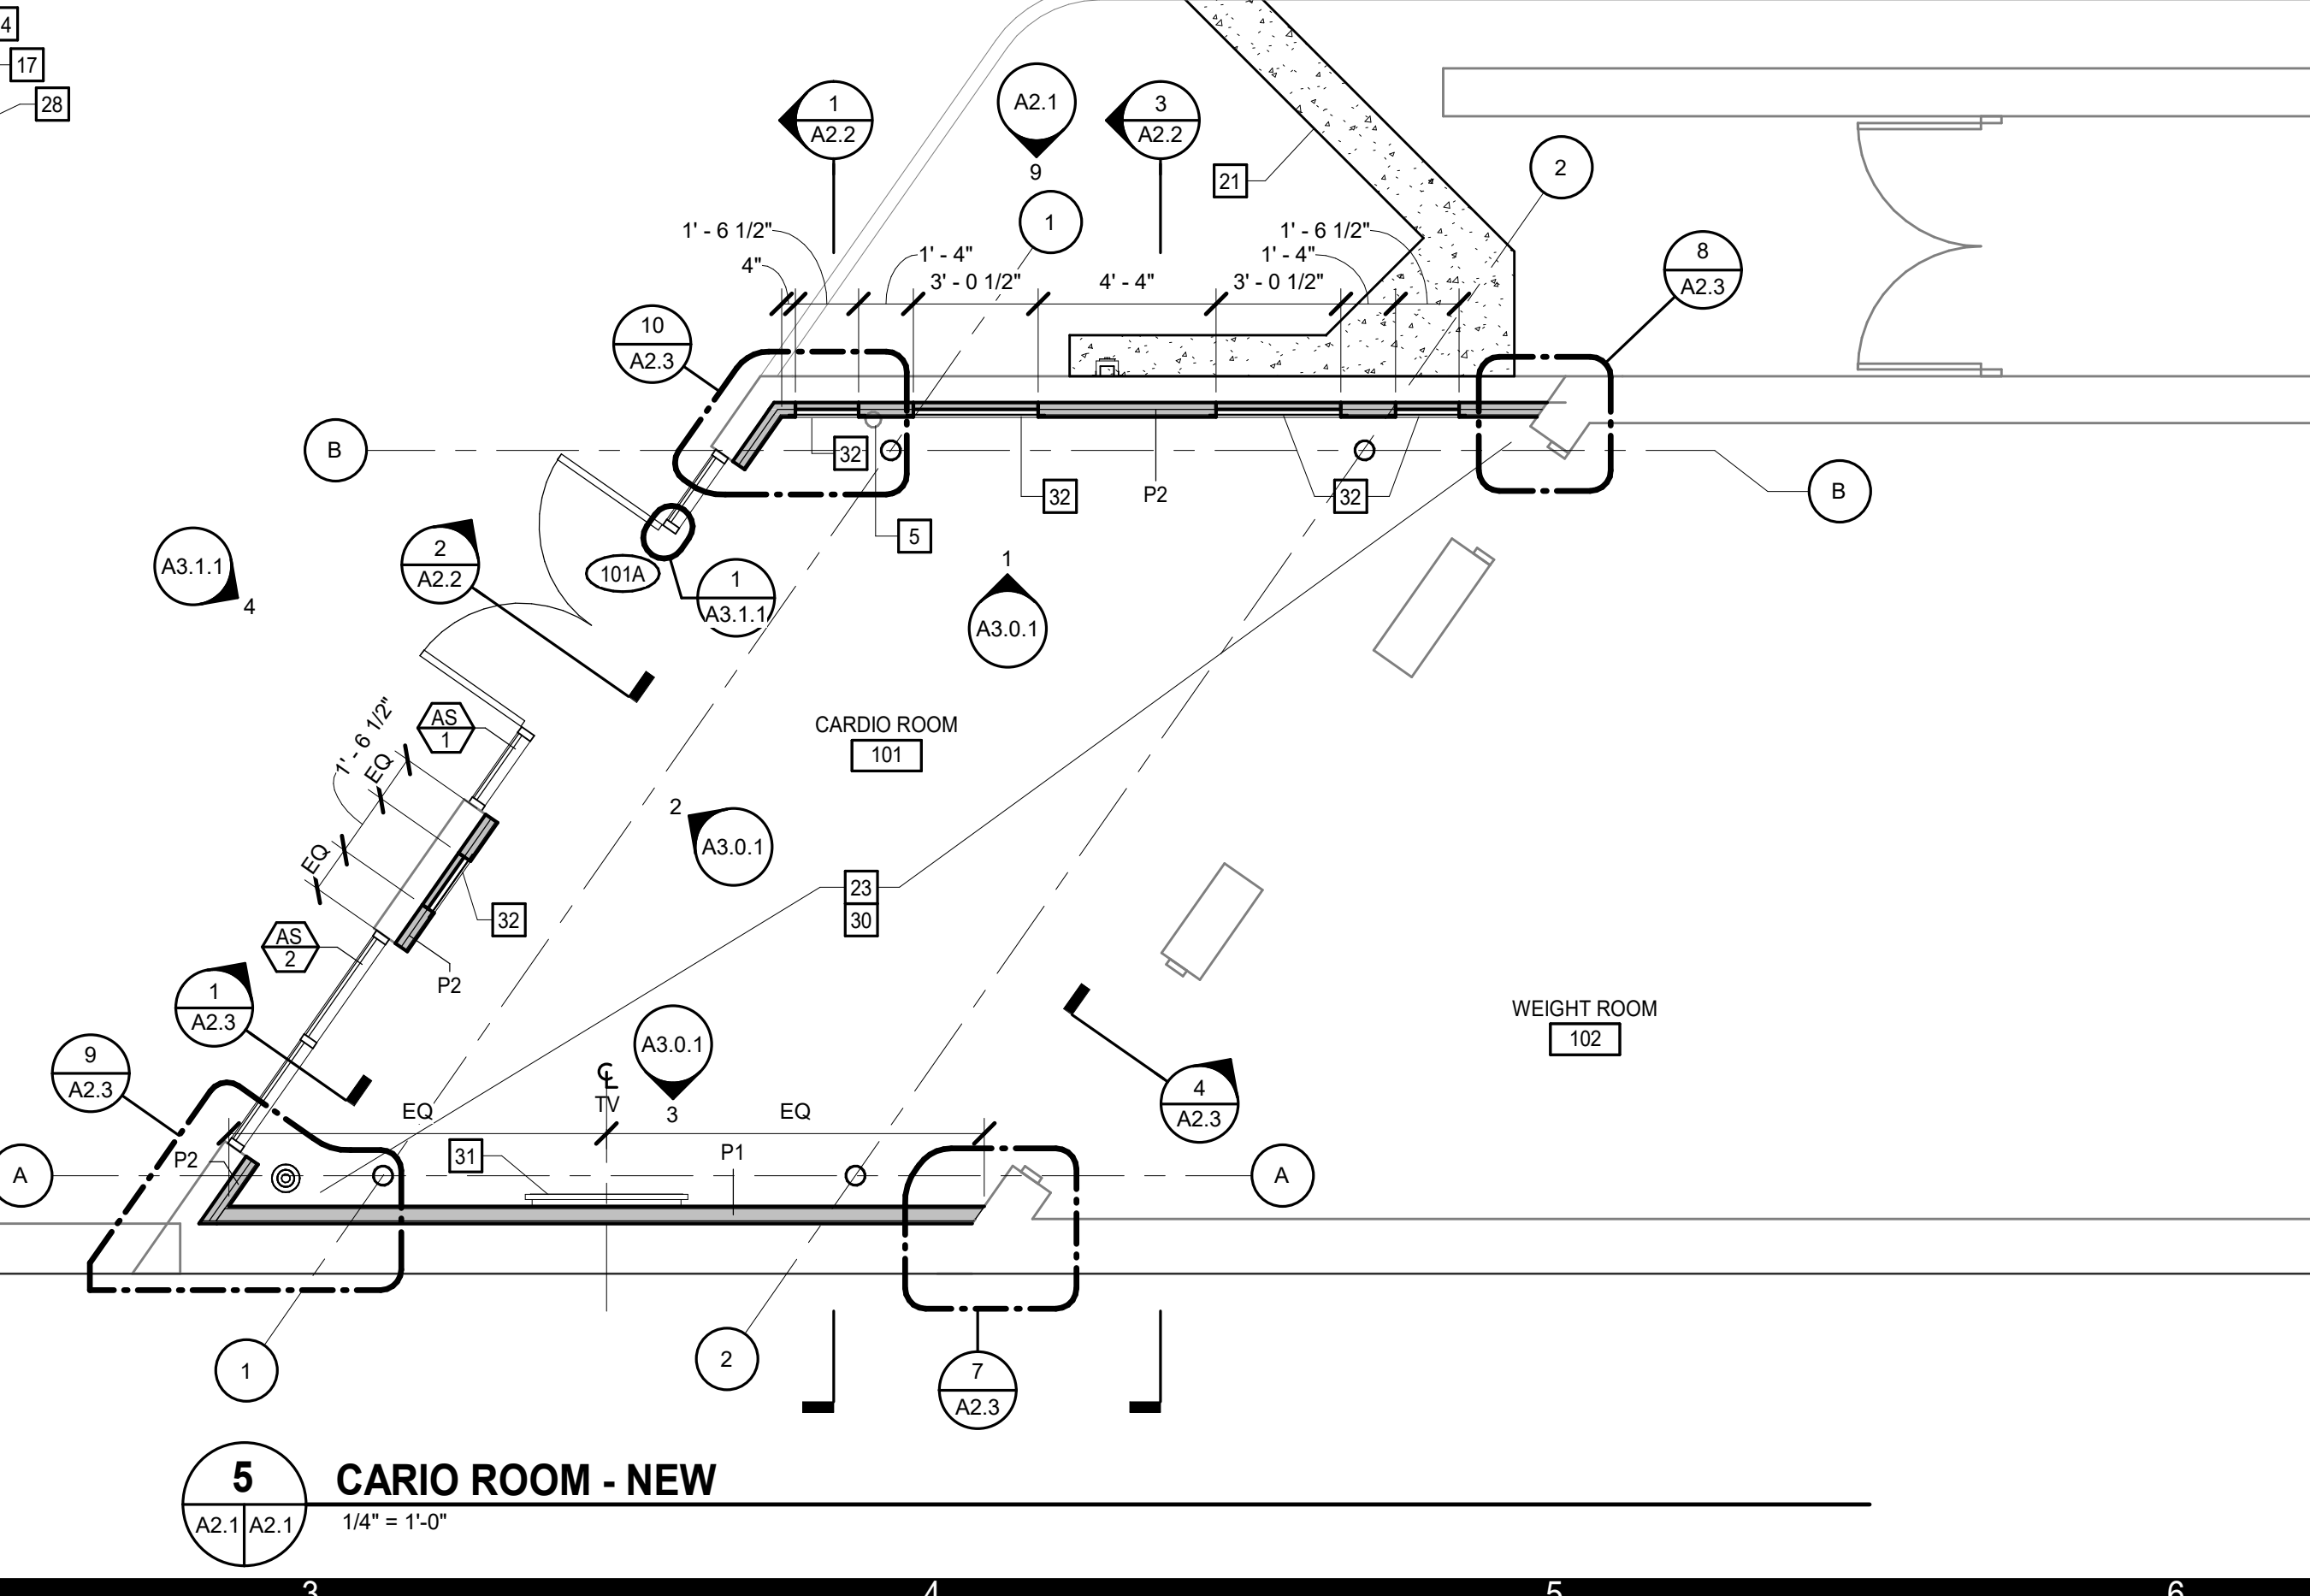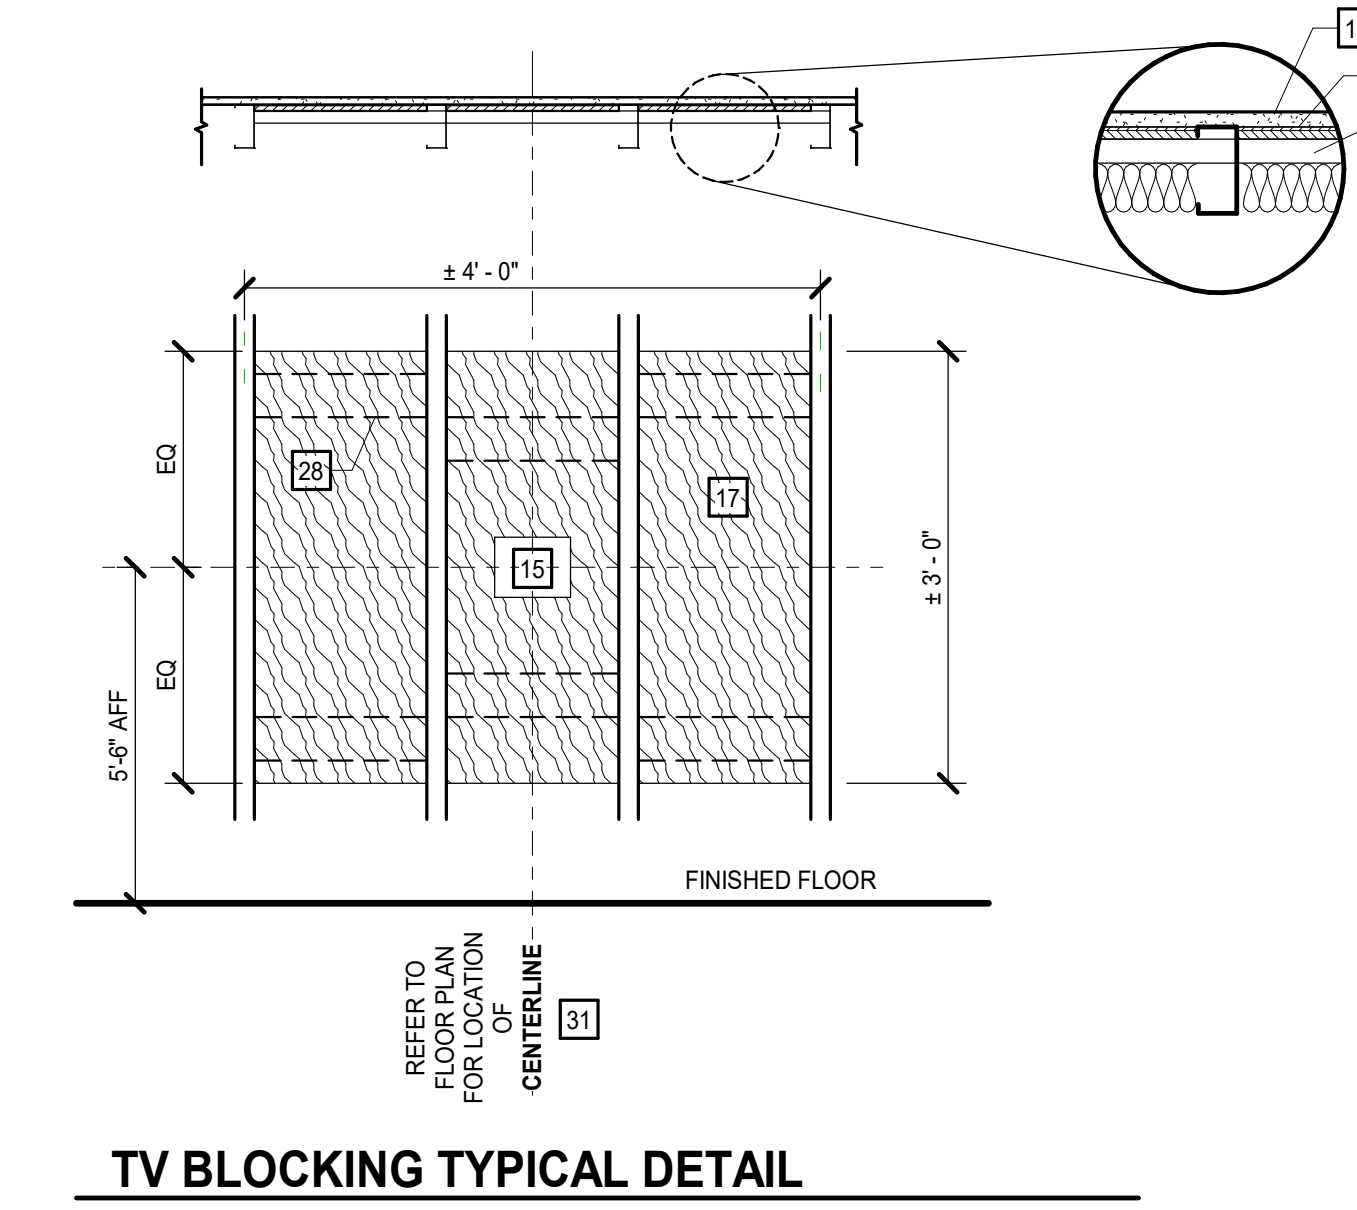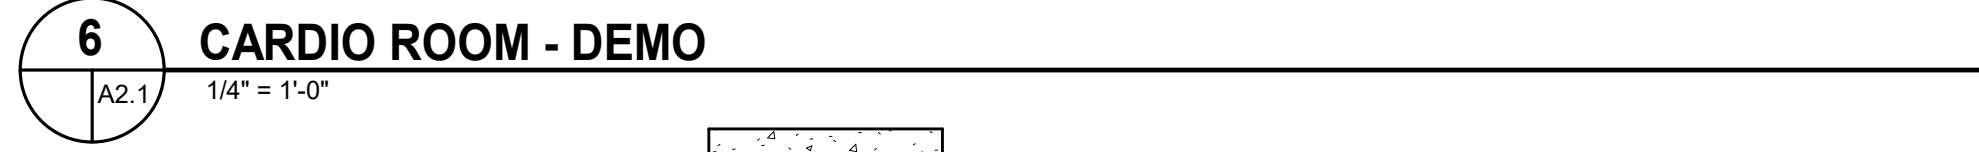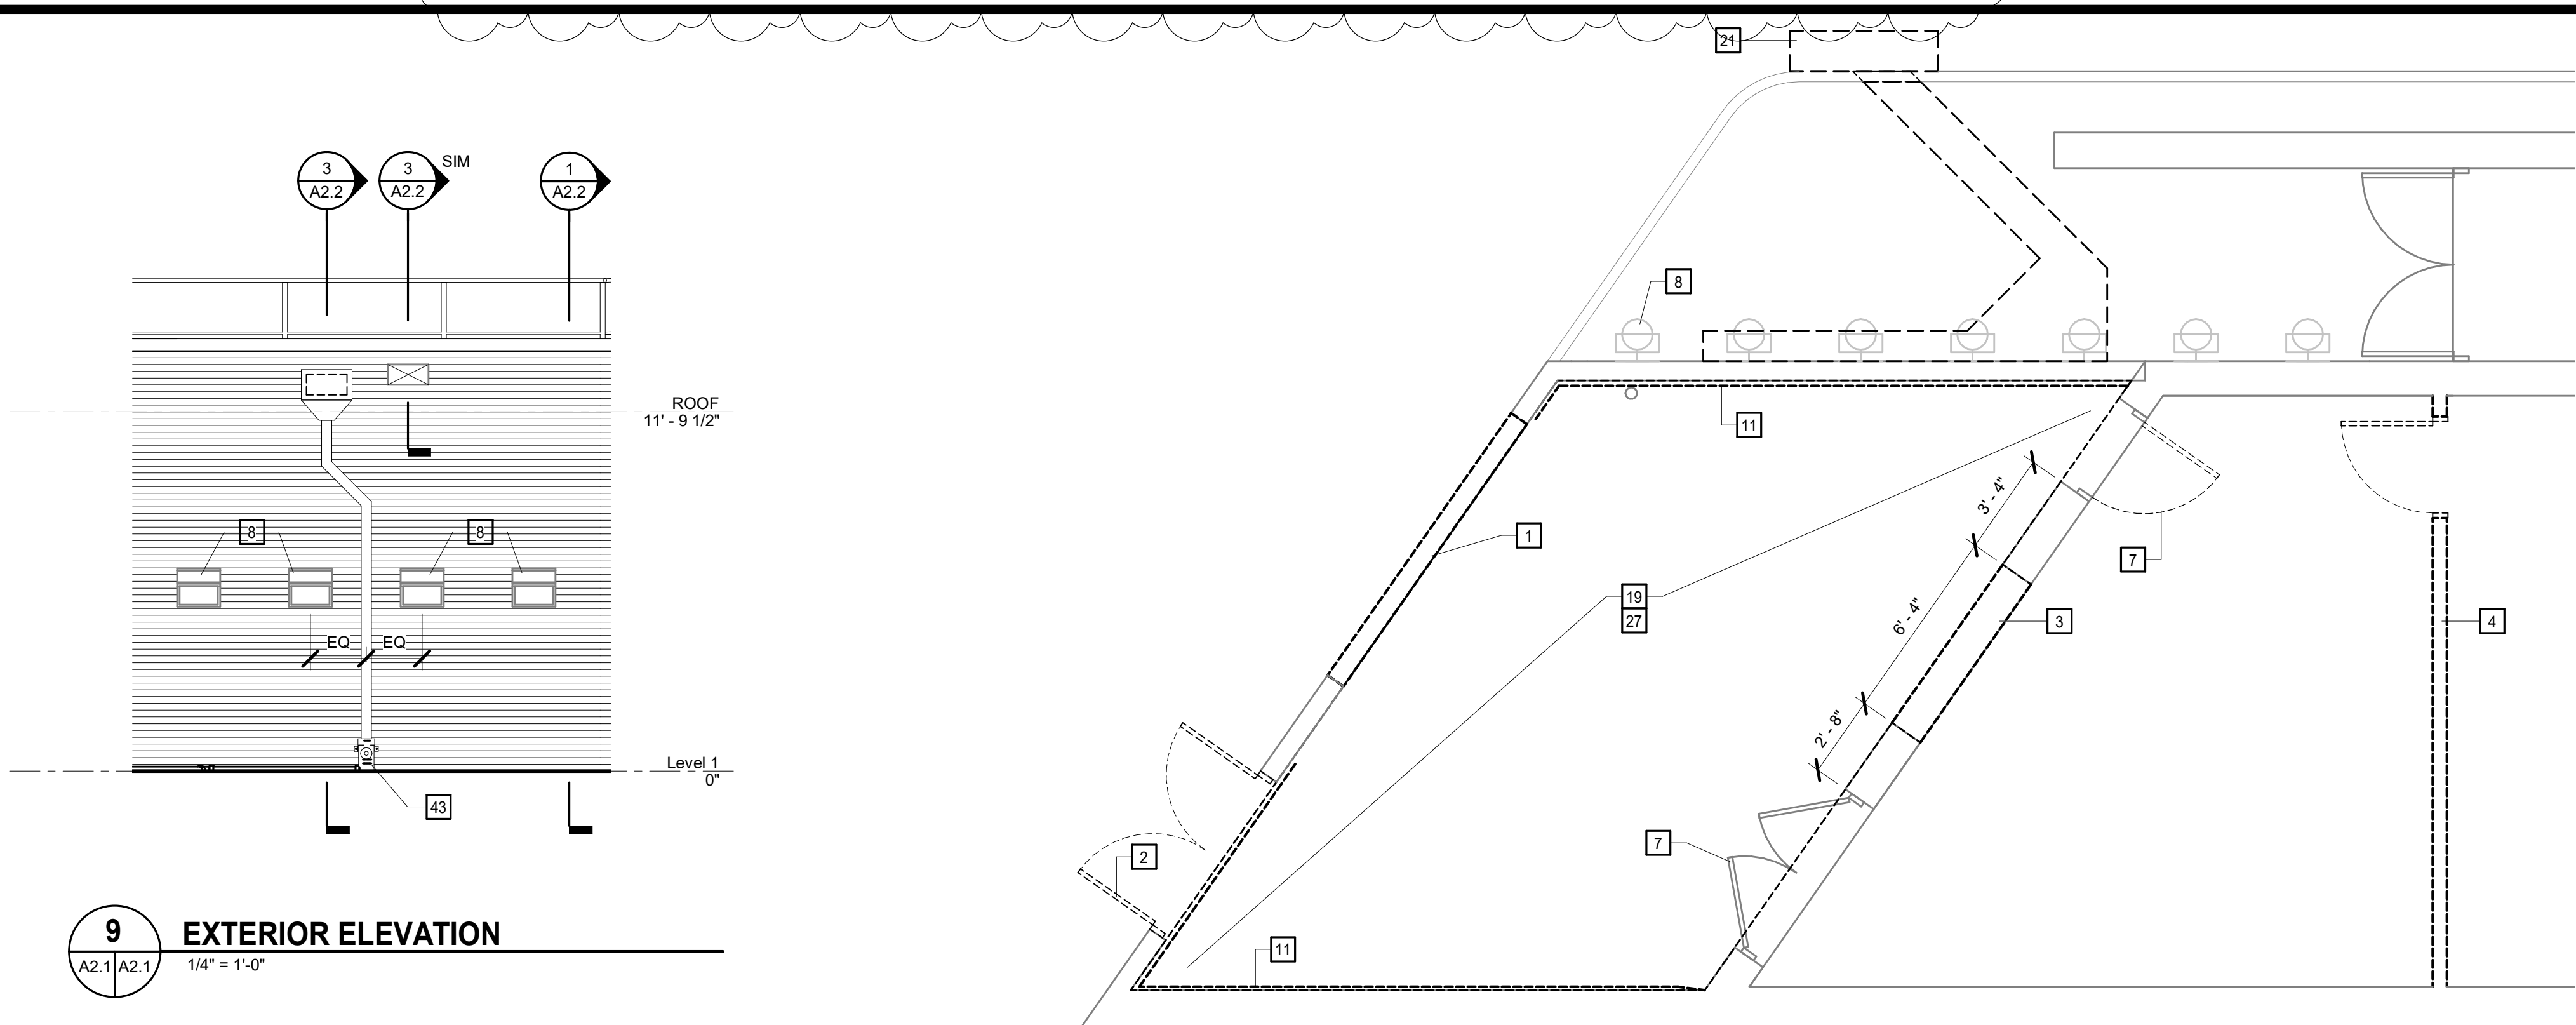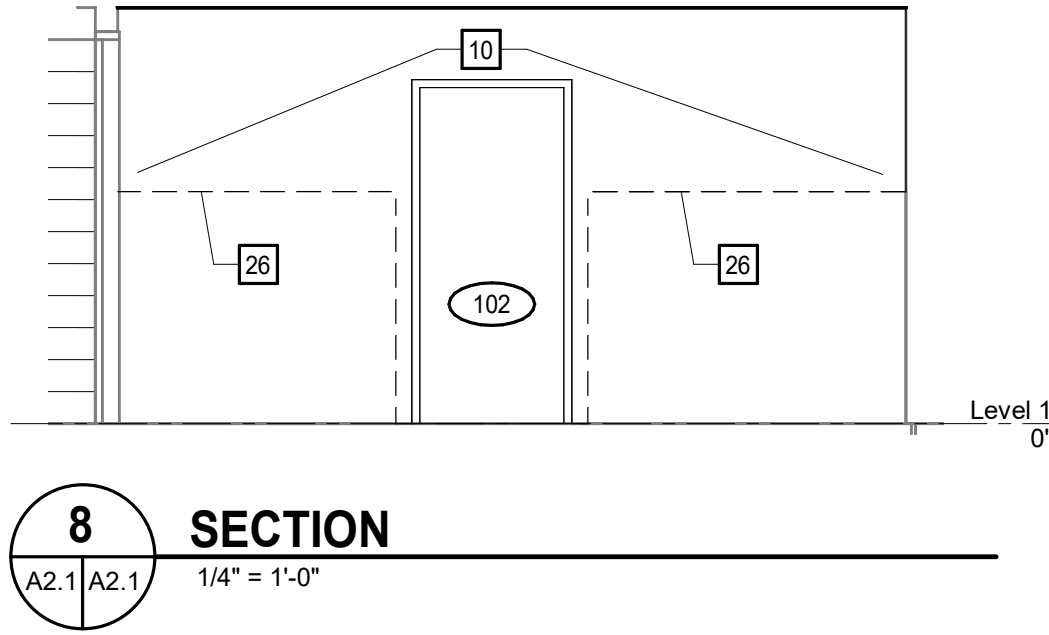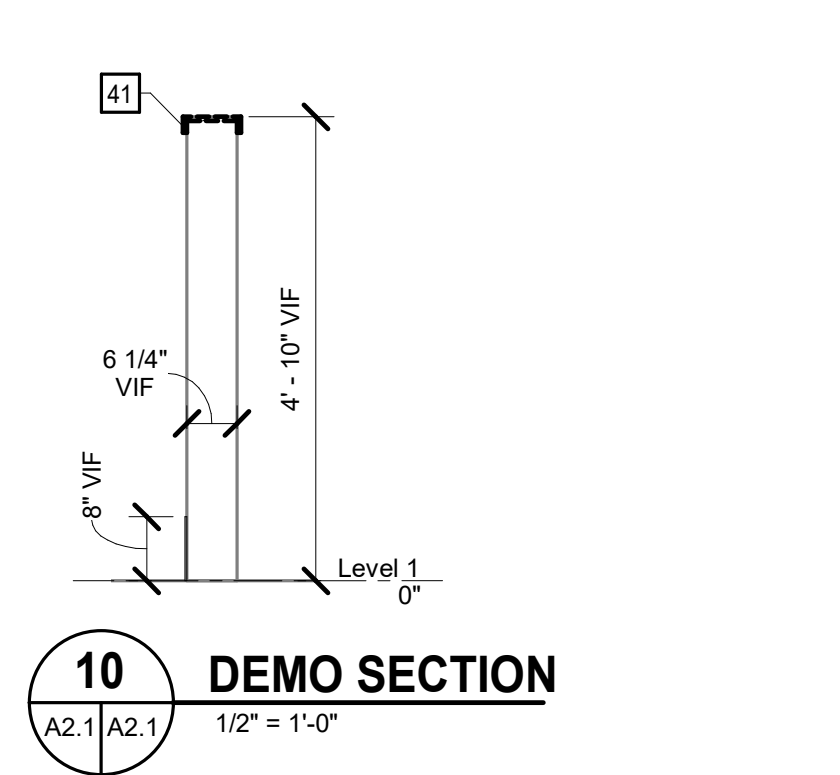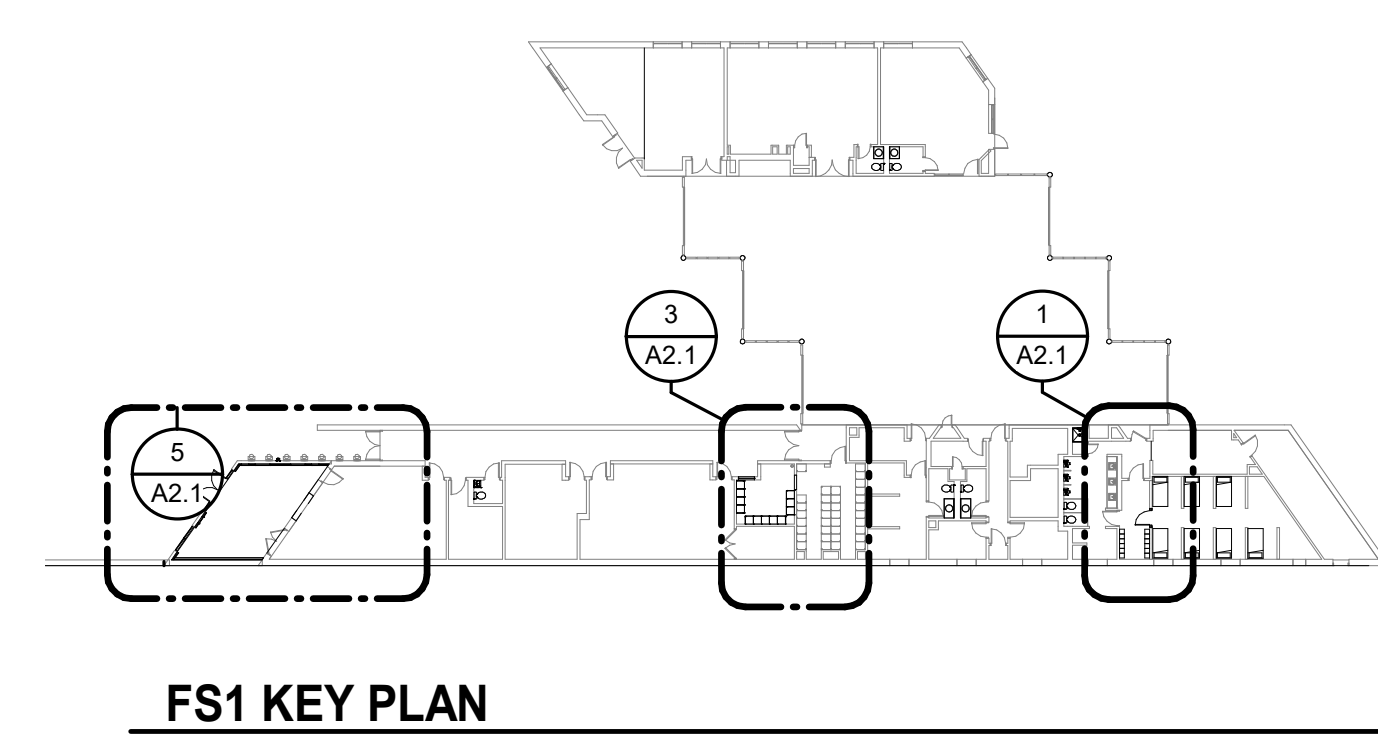


ADDENDUM  
1

- A. FINISH SCHEDULE DESCRIBES ONLY THE BASIC OR PREDOMINANT SURFACE FINISH.
- B. PROVIDE SAME FINISHES AS THE ADJACENT SPACE IN ALCOVES AND CONTINUOUS SPACES WITHOUT DESIGNATED SPACE NUMBERS.
- C. DIRECTIONAL WALL FINISH INDICATORS (NORTH, EAST, SOUTH, WEST) REFER TO THE "PLAN" NORTH ORIENTATION.
- D. BULKHEADS AND SOFFITS MAY NOT BE INDICATED IN FINISH SCHEDULES. REFER TO RCP DETAILS, AND OTHER DOCUMENTS FOR EXTENT.
- E. PROVIDE CONTINUOUS SEALANT BETWEEN INTERIOR SLAB-ON-GRADE AND VERTICAL ELEMENT WHERE JOINT IS NOT CONCEALED BY FINISH BASE OR OTHER CONSTRUCTION

MOSELEYARCHITECTS

3200 NORFOLK STREET, RICHMOND, VA 23230  
PHONE (804) 794-7555 FAX (804) 355-5690  
MOSELEYARCHITECTS.COM

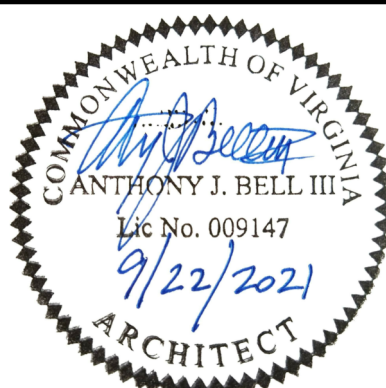

# KELLY DAY RENOVATIONS FS 1

**563006**


500 South Glebe Road, Arlington, VA 22204

**Owner: Arlington County**


PROJECT NO: 563006	
DATE: SEPTEMBER 22, 2021	
REVISIONS	
DATE	DESCRIPTION
12/15/21	ADDENDUM 1

## FINISH SCHEDULE


## A3.0.1

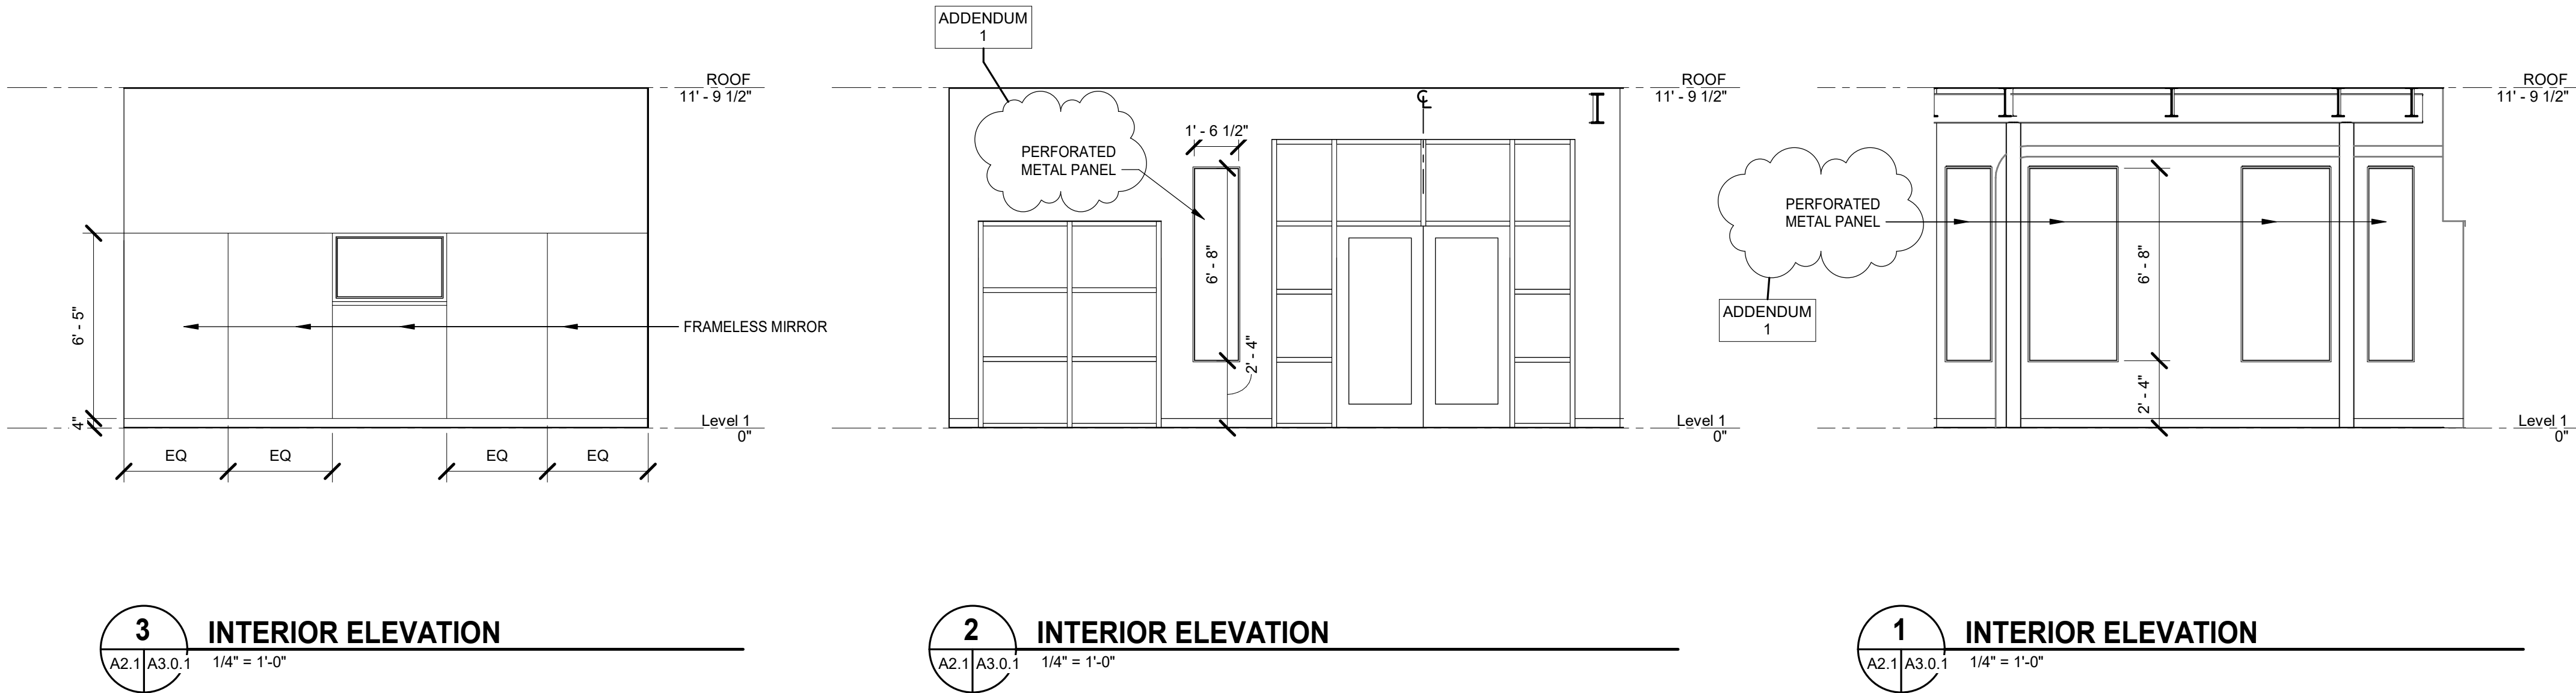




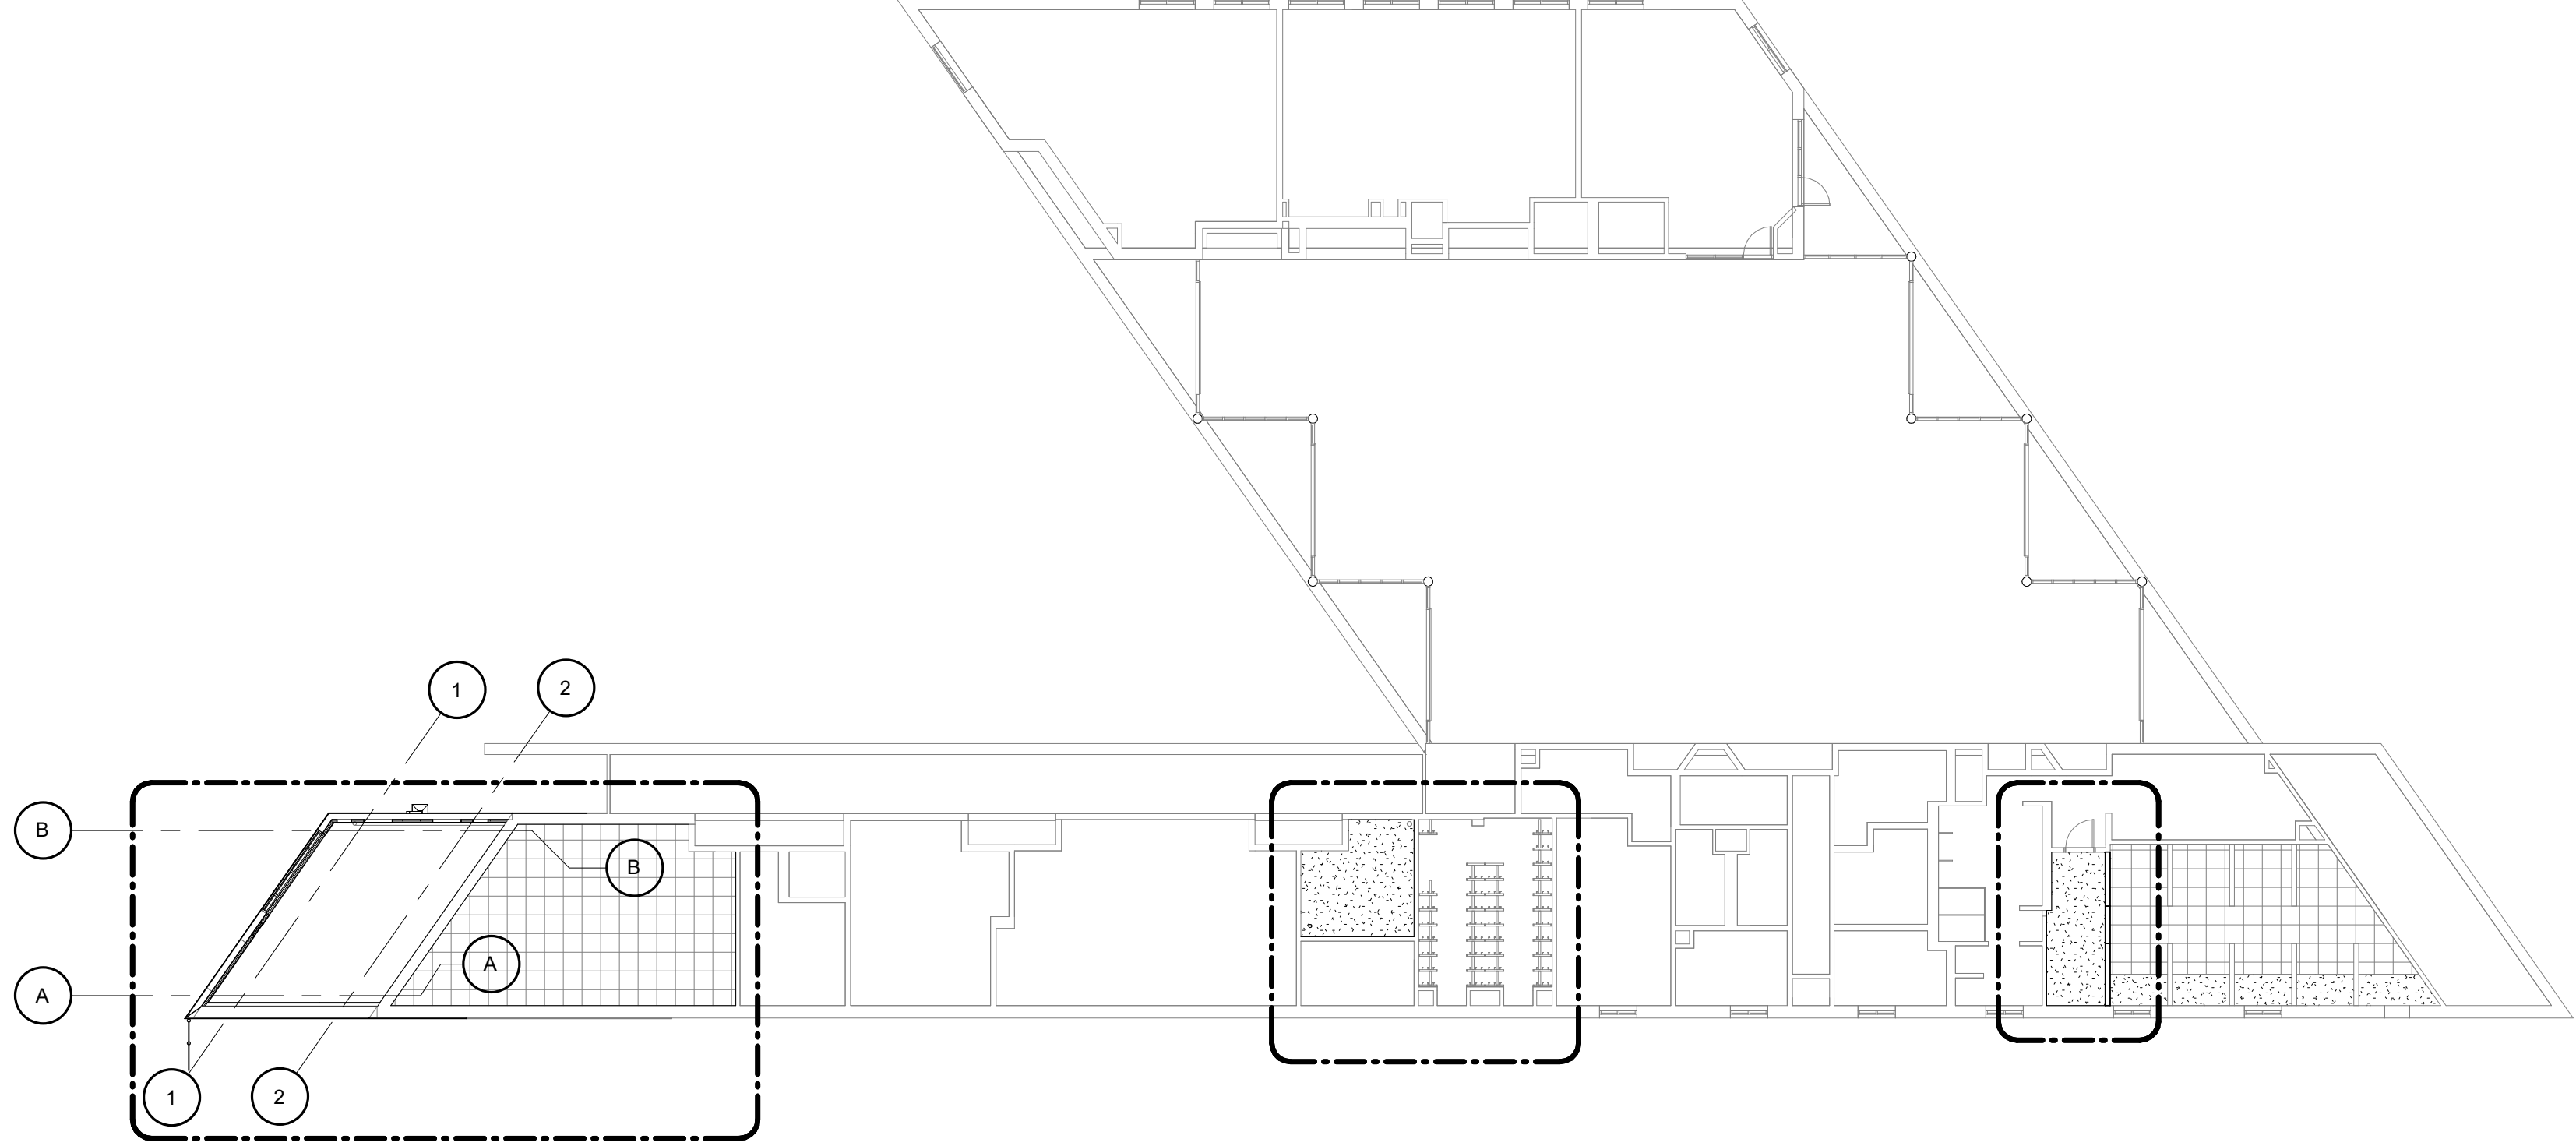


**7 RCP KEYPLAN**  
A2.1 | A9.1  
1/16" = 1'-0"

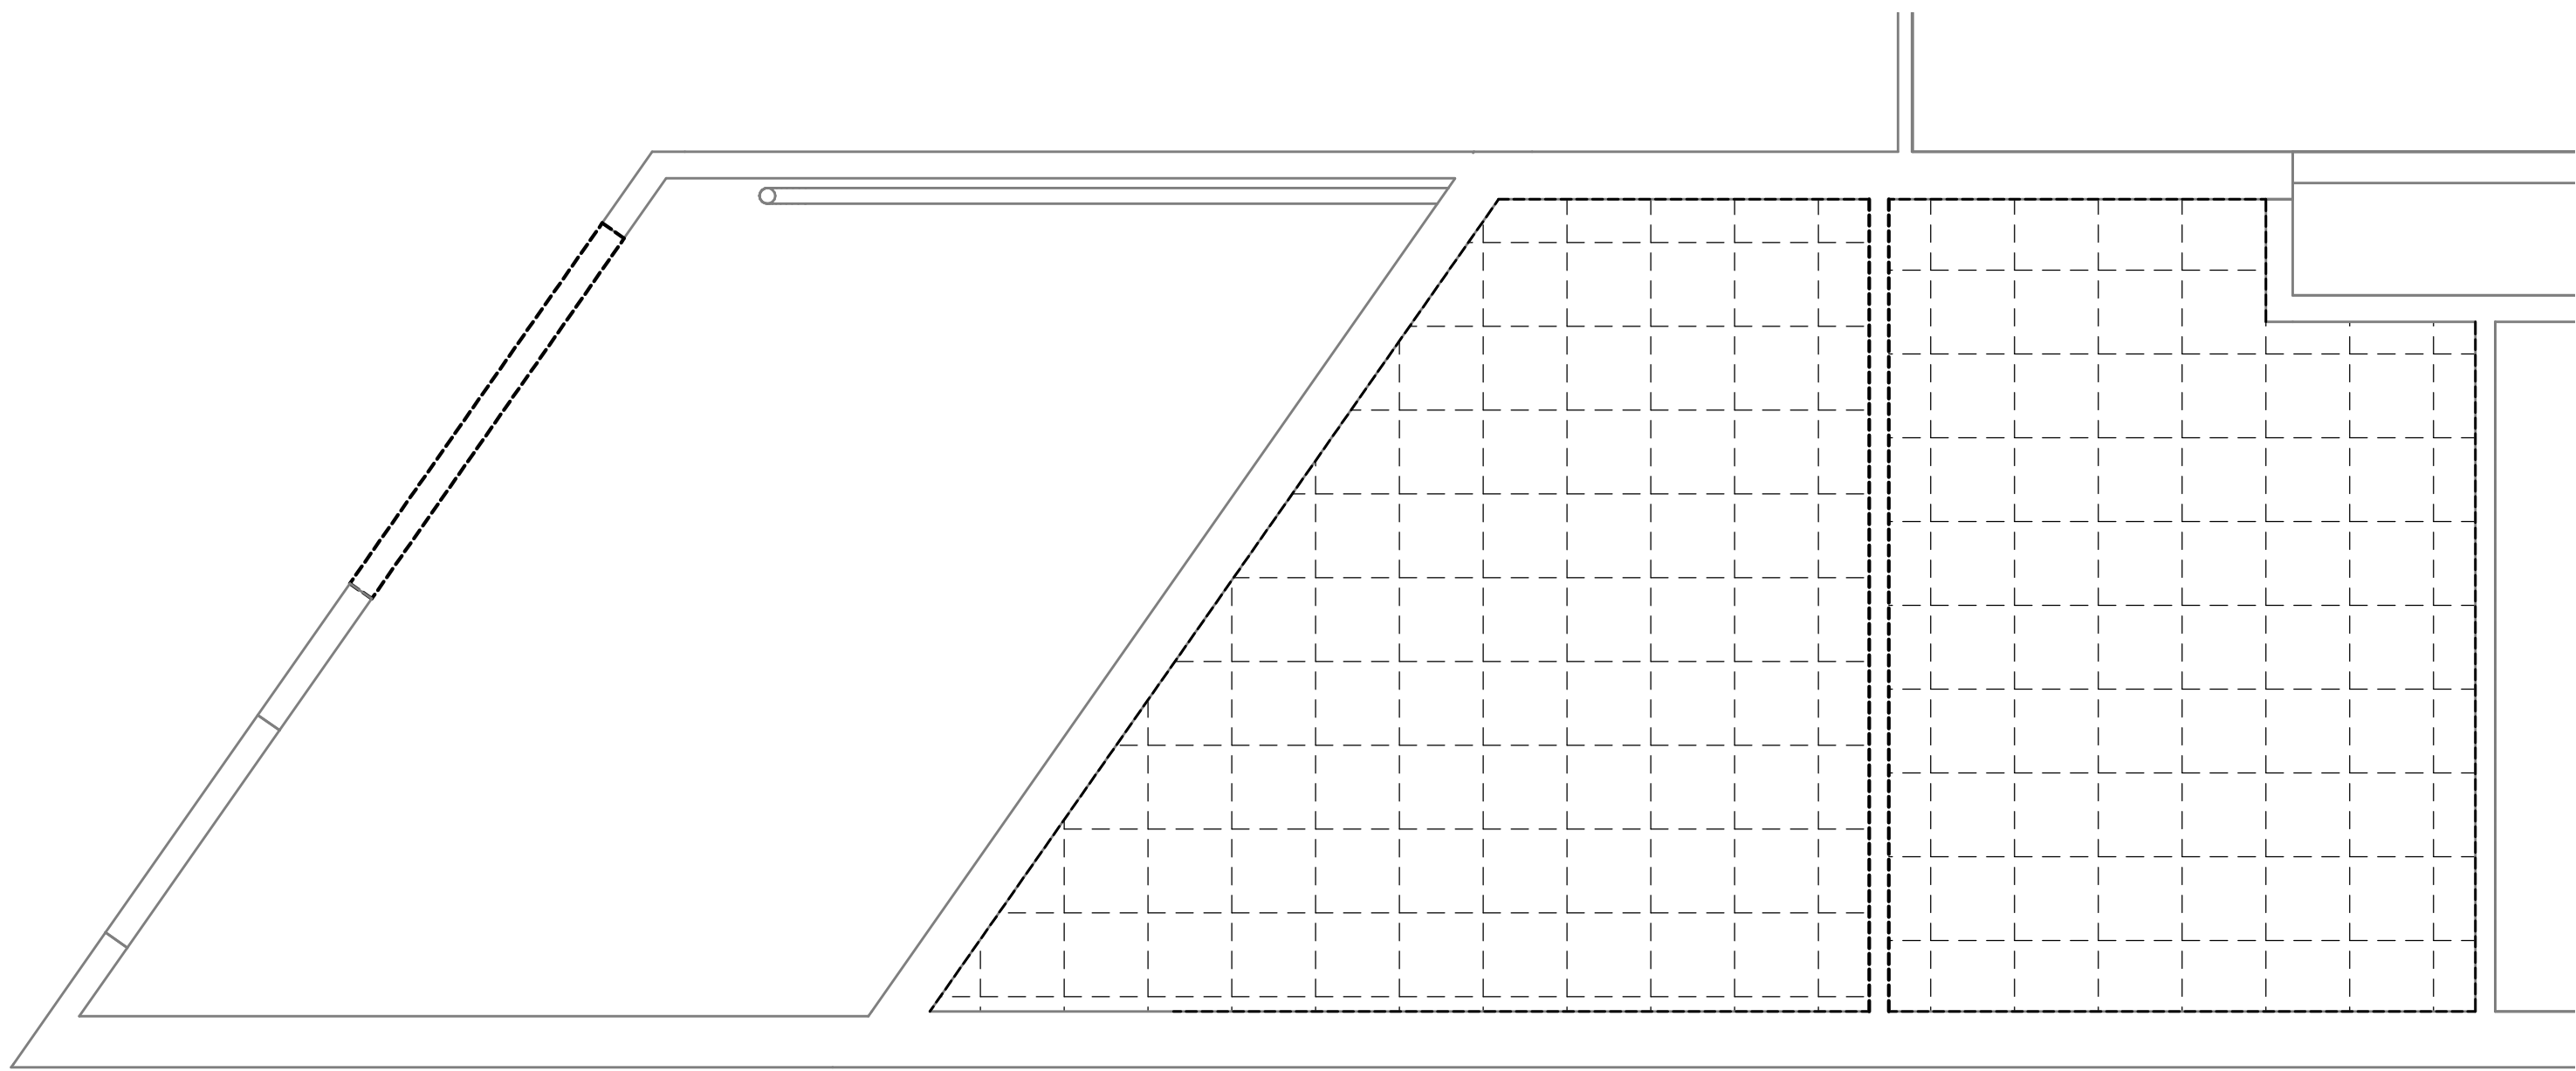

**6 RCP - DEMO**  
A9.1 | A9.1  
1/4" = 1'-0"

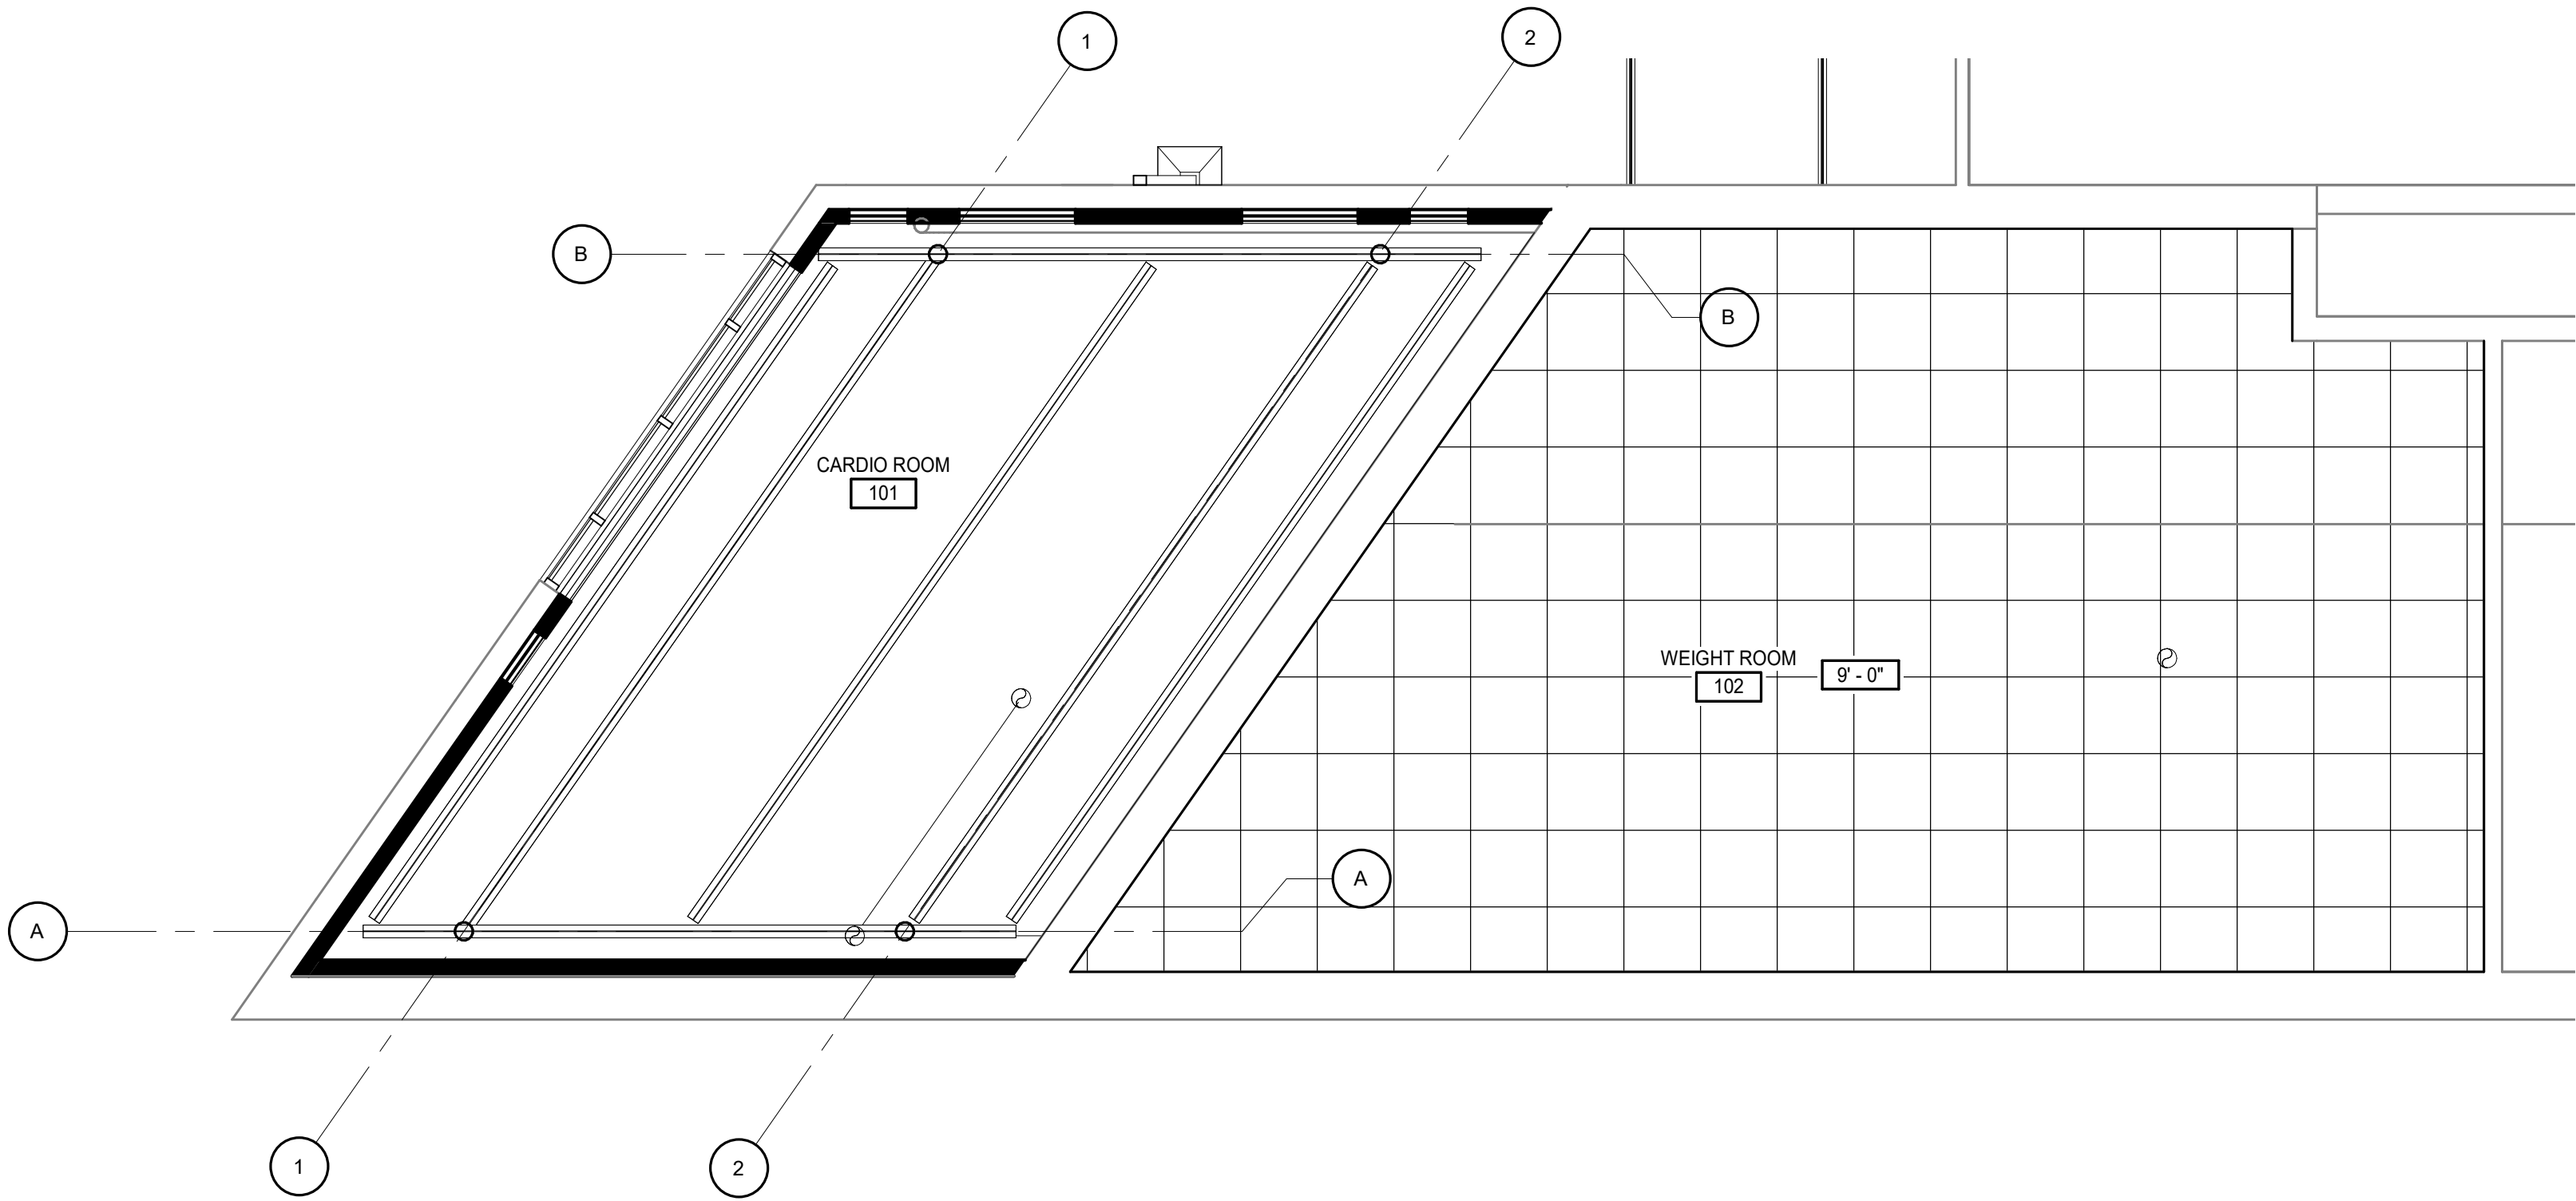

**5 RCP - CARDIO & WEIGHT ROOM**  
A9.1 | A9.1  
1/4" = 1'-0"

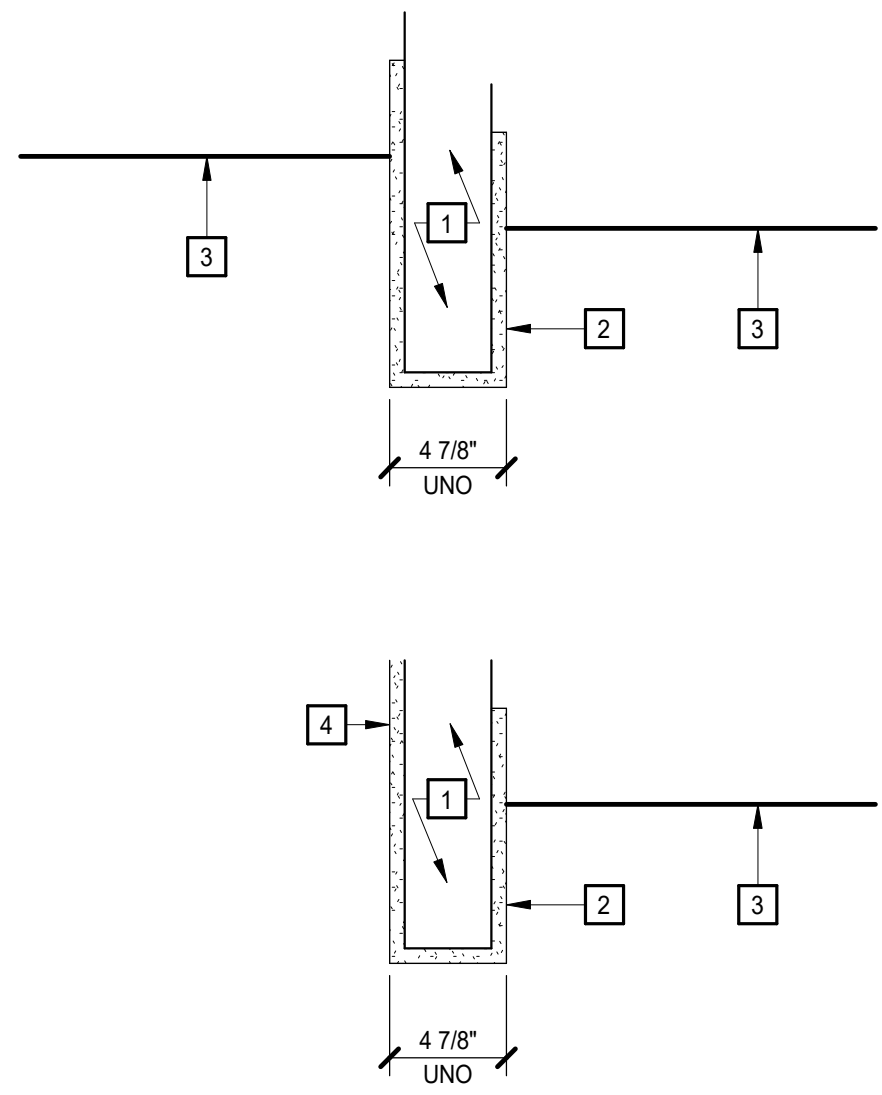

**BULKHEAD DETAILS**  
NO SCALE

**REFLECTED CEILING PLAN/DETAIL GENERAL NOTES**

A. ALL CEILING HEIGHTS SHALL BE 9'-0" AFF UNLESS INDICATED OTHERWISE.


B. DRAWINGS INDICATE GRID LAYOUT DIAGRAMMATICALLY. REFER TO SPECIFICATIONS FOR SPECIFIC GRID LAYOUT CRITERIA AT PERIMETER CONDITIONS THAT MAY DIFFER FROM GRID LAYOUT INDICATED ON DRAWINGS.

C. CENTER CEILING MOUNTED ITEMS WITHIN CEILING PANELS, UNLESS INDICATED OTHERWISE.


D. IF ADDITIONAL SPRINKLER HEADS ARE REQUIRED TO SATISFY CODE OR COVERAGE DENSITIES (OTHER THAN THOSE THAT MAY BE INDICATED), PROVIDE ADDITIONAL SPRINKLER HEADS AT NO ADDITIONAL COST AND OBTAIN APPROVAL OF ARCHITECT FOR LOCATION OF SUCH HEADS, IF ANY.

REFLECTED CEILING PLAN KEYNOTES	
REPRESENTED BY   n	
APPLIES TO DRAWINGS A9.1	
1	CFSF-S
2	5/8" GYP BD. TERMINATE 4" ABV FIN CLG
3	FIN CLG: FINISH AND/OR HEIGHT AFF VARIES
4	GYP BD: EXTEND FULL HEIGHT, UNLESS INDICATED OTHERWISE


REFLECTED CEILING PLAN LEGEND	
APPLIES TO DRAWINGS A9.1 REFER TO MEP DRAWINGS FOR REFLECTED CEILING PLAN SYMBOLS NOT INDICATED BELOW	
	SPACE NUMBER CEILING HEIGHT, AFF UNO
	INTERIOR APPLICATIONS: GYPSUM BOARD CEILING
	EXTERIOR APPLICATIONS: GYPSUM SOFFIT BOARD OR GYPSUM SHEATHING
	2'-0" x 2'-0" LAY-IN ACOUSTICAL CEILING PANELS IN SUSPENDED GRID
	ACCESS PANEL
	EXTERIOR WALL
	INTERIOR WALL/PARTITION TO UNDERSIDE OF DECK
	INTERIOR WALL/PARTITION TO CAP ABOVE OR TERMINATES ADJACENT TO A RATED HORIZONTAL ASSEMBLY
	INTERIOR WALL/PARTITION 4' MIN ABOVE HIGHEST ADJACENT CEILING. IF NECESSARY TO ACHIEVE RESULTS DESIRED, EXTEND WALL HEIGHT SO WALL BRACING IS NOT EXPOSED TO VIEW IN FINISHED SPACES
	INTERIOR WALL/PARTITION TO UNDERSIDE OF CEILING
	EXISTING TO REMAIN, VERIFY VERTICAL EXTENTS WHERE THE HEIGHT IMPACTS THE WORK

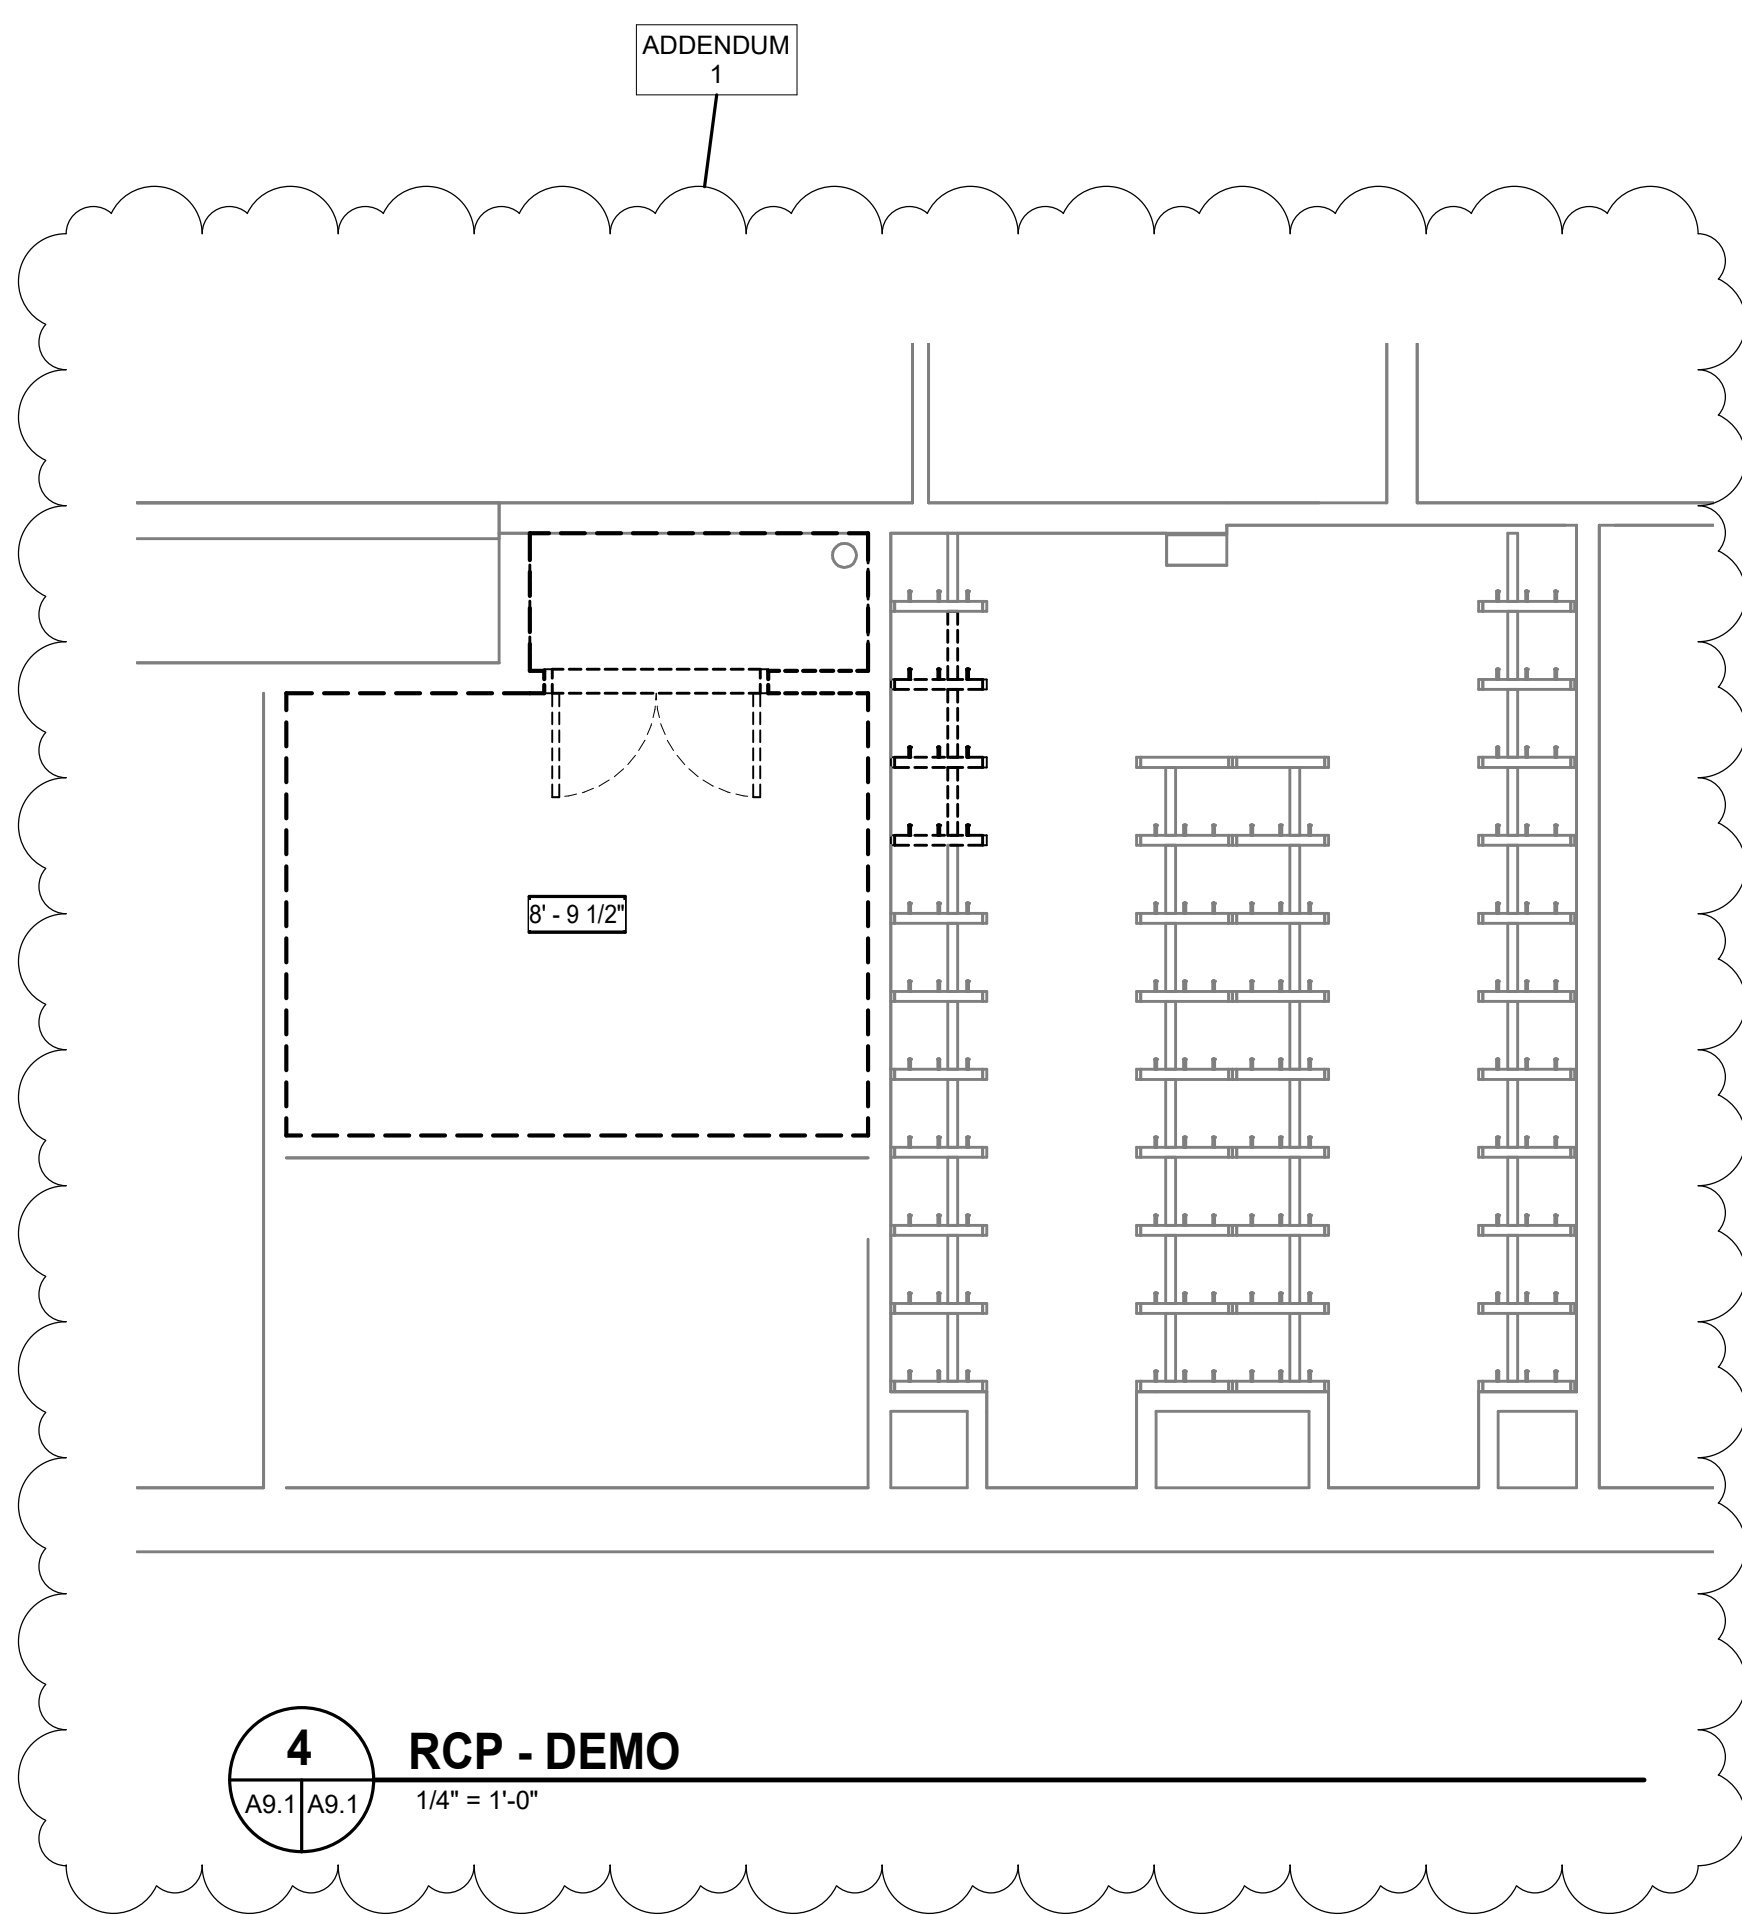


**4 RCP - DEMO**  
A9.1 | A9.1  
1/4" = 1'-0"

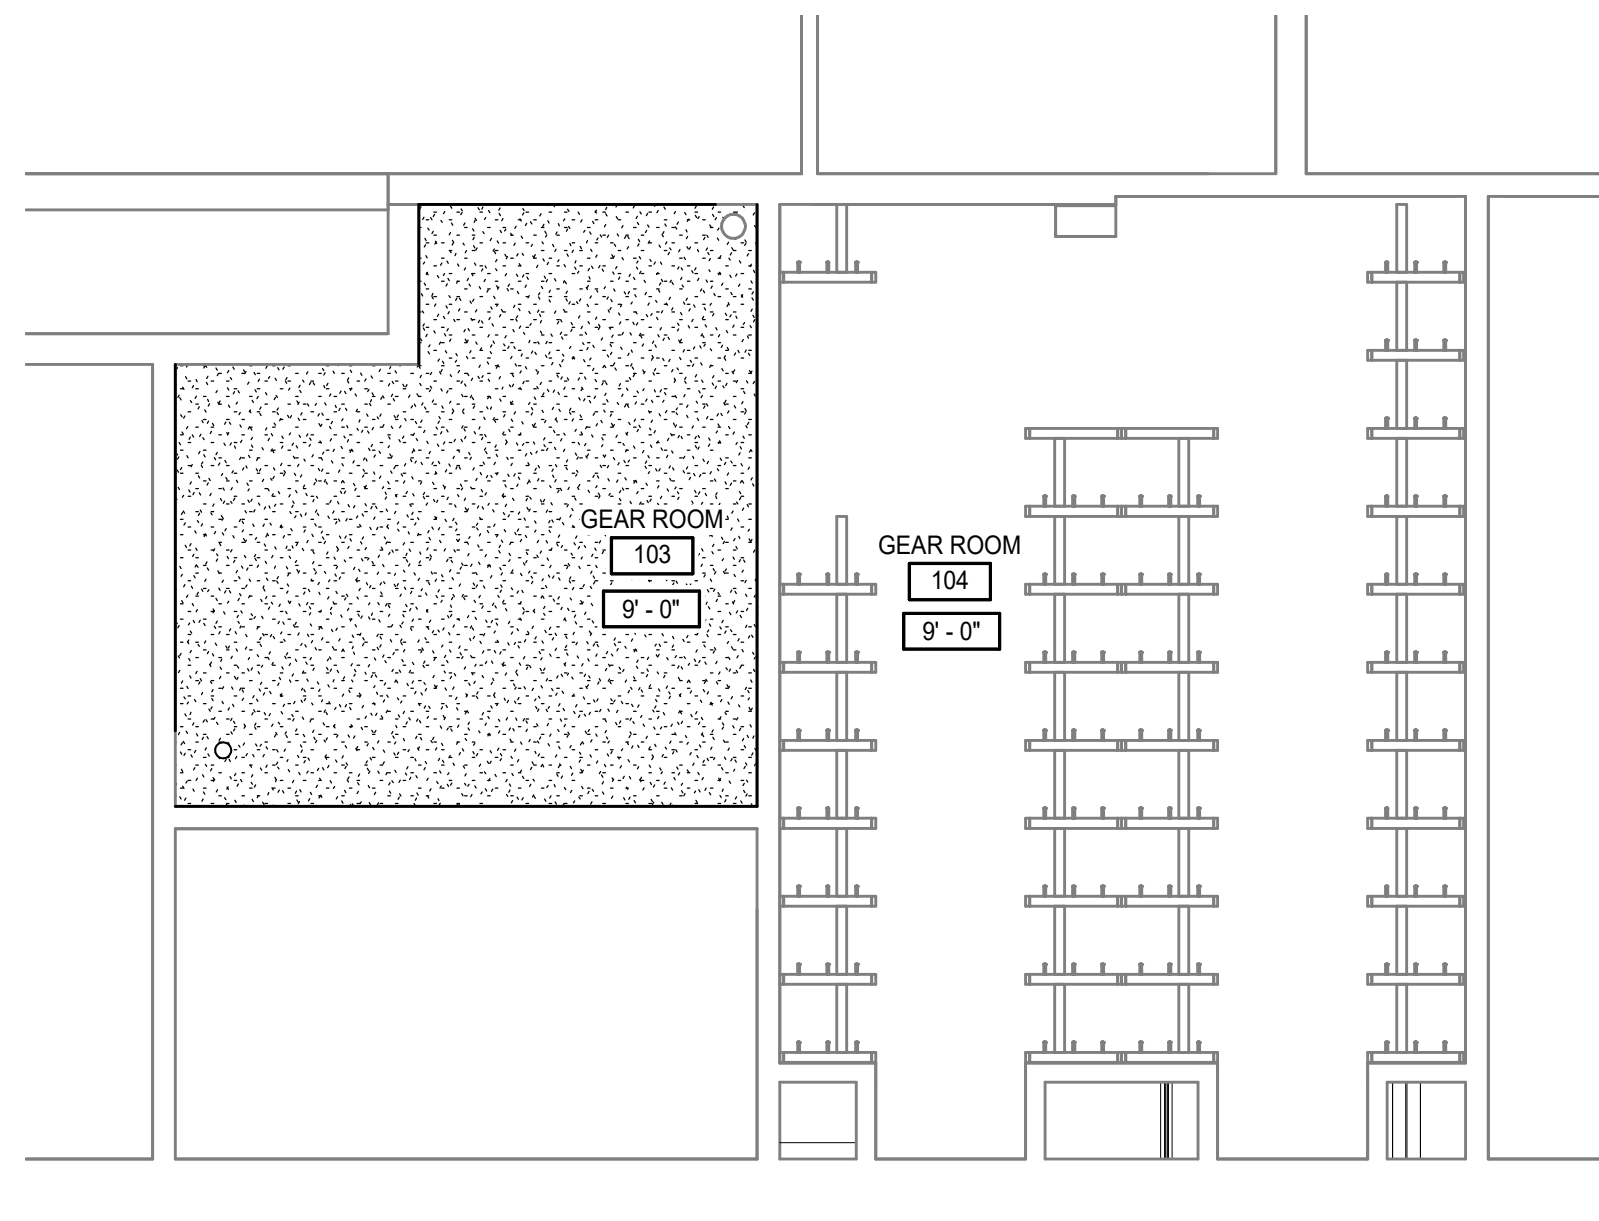

**3 RCP - GEAR ROOM**  
A9.1 | A9.1  
1/4" = 1'-0"

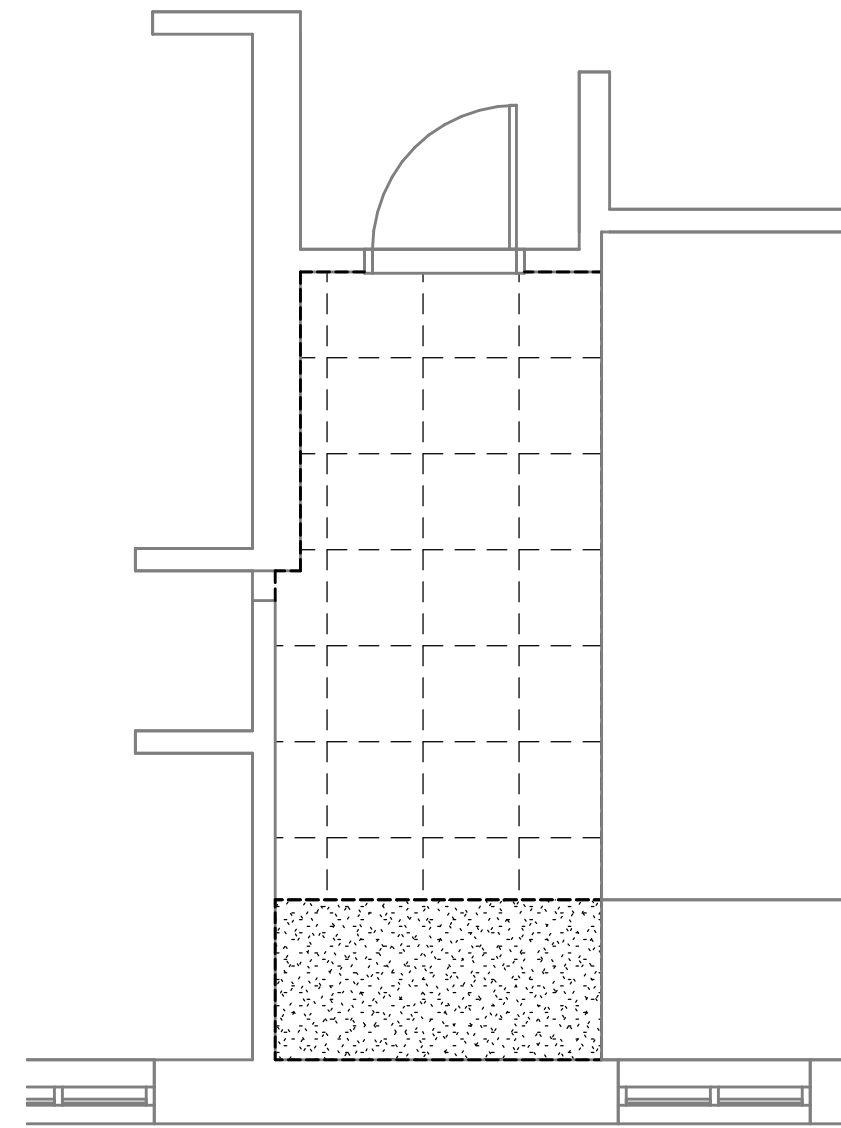

**2 RCP - DEMO**  
A9.1 | A9.1  
1/4" = 1'-0"

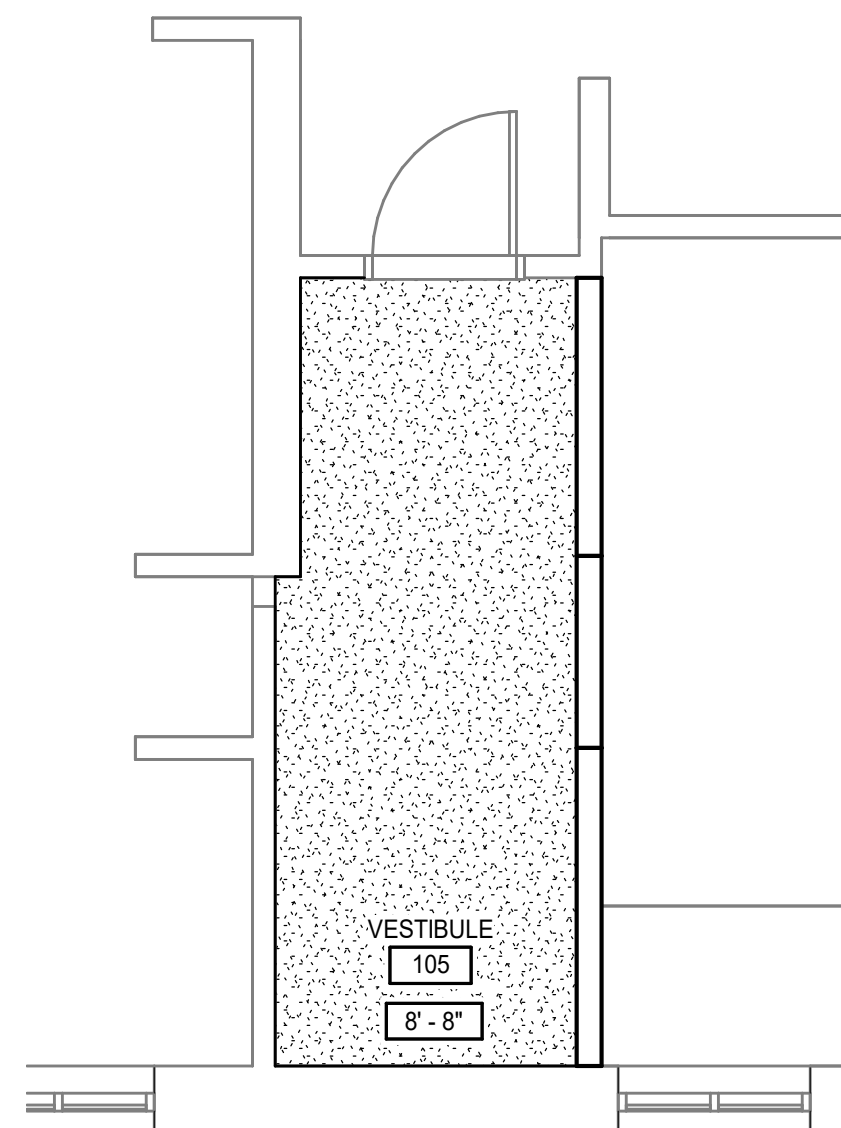

**1 RCP - BUNK ROOM**  
A9.1 | A9.1  
1/4" = 1'-0"



12/15/2021 7:03:05 PM

J  
I  
H  
G  
F  
E  
D  
C  
B  
A

1

2

3

4

5

6

7


8

9



10

KEYNOTES	
REPRESENTED BY [1]	
APPLIES TO DRAWING A2.1 & A10.1	
1	REMOVE OVERHEAD DOOR. DO NOT SALVAGE.
2	SALVAGE EXISTING DOOR AND FRAME.
3	REMOVE PORTION OF WALL INDICATED.
4	REMOVE EXISTING WALL AND ALL HOSTED ELEMENTS INCLUDING DOORS, ELEC OUTLETS, ETC.
5	EXISTING PIPING TO REMAIN.
6	REMOVE EXISTING GEAR GRID.
7	SALVAGE DOOR: FRAME SHALL REMAIN. REMOVE STRIKE AND PROVIDE STEEL OR ALUMINUM CLOSURE PLATE. PT TO MATCH FRAME COLOR.
8	EXISTING EXTERIOR FIXTURES SHALL REMAIN.
9	HANGING GEAR GRID NIC.
10	INFILL OPENING. MATCH ADJACENT CONSTRUCTION.
11	REFER TO ELEC DOCUMENTS. ELEC ITEMS WHICH SERVE FIXTURES AND EQUIPMENT AT THE EXTERIOR OF THE BUILDING SHALL REMAIN.
14	GYP BD FINISH SHALL COVER PLYWOOD.
15	CENTER ELECTRICAL JUNCTION BOX OR BOXES WITHIN THE PLYWOOD BLOCKING.
16	REMOVE SINK.
17	1/2" PLYWOOD FLUSH WITH FACE OF STUD. TYPICAL.
18	REMOVE COUNTERTOP AND SHELVEING.
19	REMOVE EXISTING CONCRETE SLAB.
21	DEMO EXISTING CONCRETE AS REQUIRED TO PROVIDE PLUMBING SCOPE. AFTER INSTALLATION, INSPECTION, AND APPROVAL, PROVIDE MIN 4,000 PSI CONCRETE. MATCH EXISTING THICKNESS. REINFORCE WITH 6X6-W2.9XW2.9 WWF.
22	REMOVE EXISTING PARAPET COPING AS NECESSARY TO PROVIDE THE WORK SCOPE.
23	PROVIDE CONCRETE SLAB. REFER TO STRUCTURAL DOCUMENTS.
26	APPROXIMATE OUTLINE OF EXISTING WALL.


KEYNOTES	
REPRESENTED BY [n]	
APPLIES TO DRAWING A2.1 & A10.1	
27	CLEAN THE INTERIOR FACE OF EXISTING MASONRY WALLS. REFER TO PROJECT MANUAL FOR ADDITIONAL PREPARATION REQUIRED.
28	WOOD BLOCKING. TYPICAL.
29	REMOVE SHELF.
30	PAINT EXPOSED STRUCTURE. TYPICAL.
31	WALL MOUNTED TV, TV AND HANGING EQUIPMENT NIC. CONTRACTOR SHALL PROVIDE TV BLOCKING.
32	PERFORATED METAL PANEL.
33	PREMANUFACTURED ALUMINUM COPING.
34	EXISTING PARAPET COPING TO REMAIN.
35	MECH EQUIPMENT. REFER TO MECH DOCUMENTS.
39	NON-PENETRATING ROOF EDGE FALL PROTECTION. PROVIDE ADDITIONAL LAYER OF ROOFING MEMBRANE BELOW EACH RAIL RECEIVER.
40	CLOSE THE EXPOSED END OF THE BENCH WITH 1/2" PLYWOOD SHEET PAINTED BLACK.
41	REMOVE WOOD TRIM.
42	PROVIDE ROOF WALKWAY PAD. TYPICAL.
43	PROVIDE CAST IRON BOOT WITH CLEANOUT

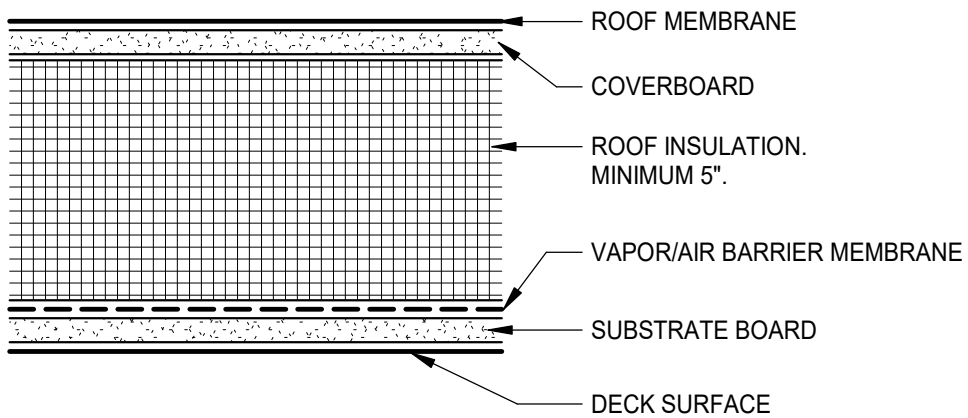ROOF ASSEMBLIES		
APPLIES TO A10.1 REPRESENTED BY [n]		
MARK	REMARKS	INFORMATION
RFA1	MINIMUM R-VALUE OF ASSEMBLY SHALL BE R-30.	ROOF ASSEMBLIES ARE SHOWN DIAGRAMMATICALLY. REFER TO SPECS FOR REQUIRED R-VALUE AND MATERIAL THICKNESS. 


ADDENDUM  
1

ROOF PLAN LEGEND	
APPLIES TO DRAWINGS A10.1.1 - A10.1.n REFER TO M, E & FP DRAWINGS FOR ROOF SYMBOLS NOT INDICATED BELOW	
	CRICKET
	INDICATES DIRECTION OF ROOF ASSEMBLY SLOPE

ROOF PLAN GENERAL NOTES	
A. ALL ROOF ASSEMBLIES, RFA1, UNO.	
B. ROOF PLAN DOES NOT INDICATE ALL EQUIPMENT AND PENETRATIONS. REFER TO OTHER DISCIPLINE'S DRAWINGS FOR QUANTITIES AND LOCATIONS OF ROOFTOP EQUIPMENT AND ASSOCIATED PENETRATIONS.	
C. COORDINATE LOCATION AND SIZE OF ROOF OPENINGS AND ASSOCIATED PENETRATIONS WITH STRUCTURE.	
D. ROOF DETAILS MAY NOT ENTIRELY REPRESENT ACTUAL CONSTRUCTION CONDITIONS. ACTUAL DETAIL ASSEMBLIES SHALL BE APPROVED BY ROOFING MANUFACTURER.	
E. ROOF PLAN DOES NOT INDICATE ALL ROOFING DETAILS (INCLUDING BUT NOT LIMITED TO ROOF DRAINS, VTR; CURBS; EXPANSION JOINTS; ROOF HATCHES). PROVIDE MFR'S DETAILS AS REQUIRED TO SUIT SPECIFIC APPLICATION AND SPECIFICATIONS.	
F. PROVIDE CRICKETS AT DRAINS, WALLS, CURBS, MECHANICAL EQUIPMENT, AND OTHER OBSTRUCTIONS SUCH THAT 1/4" PER FOOT MINIMUM POSITIVE DRAINAGE SLOPE IS MAINTAINED AT ALL SUCH AREAS.	

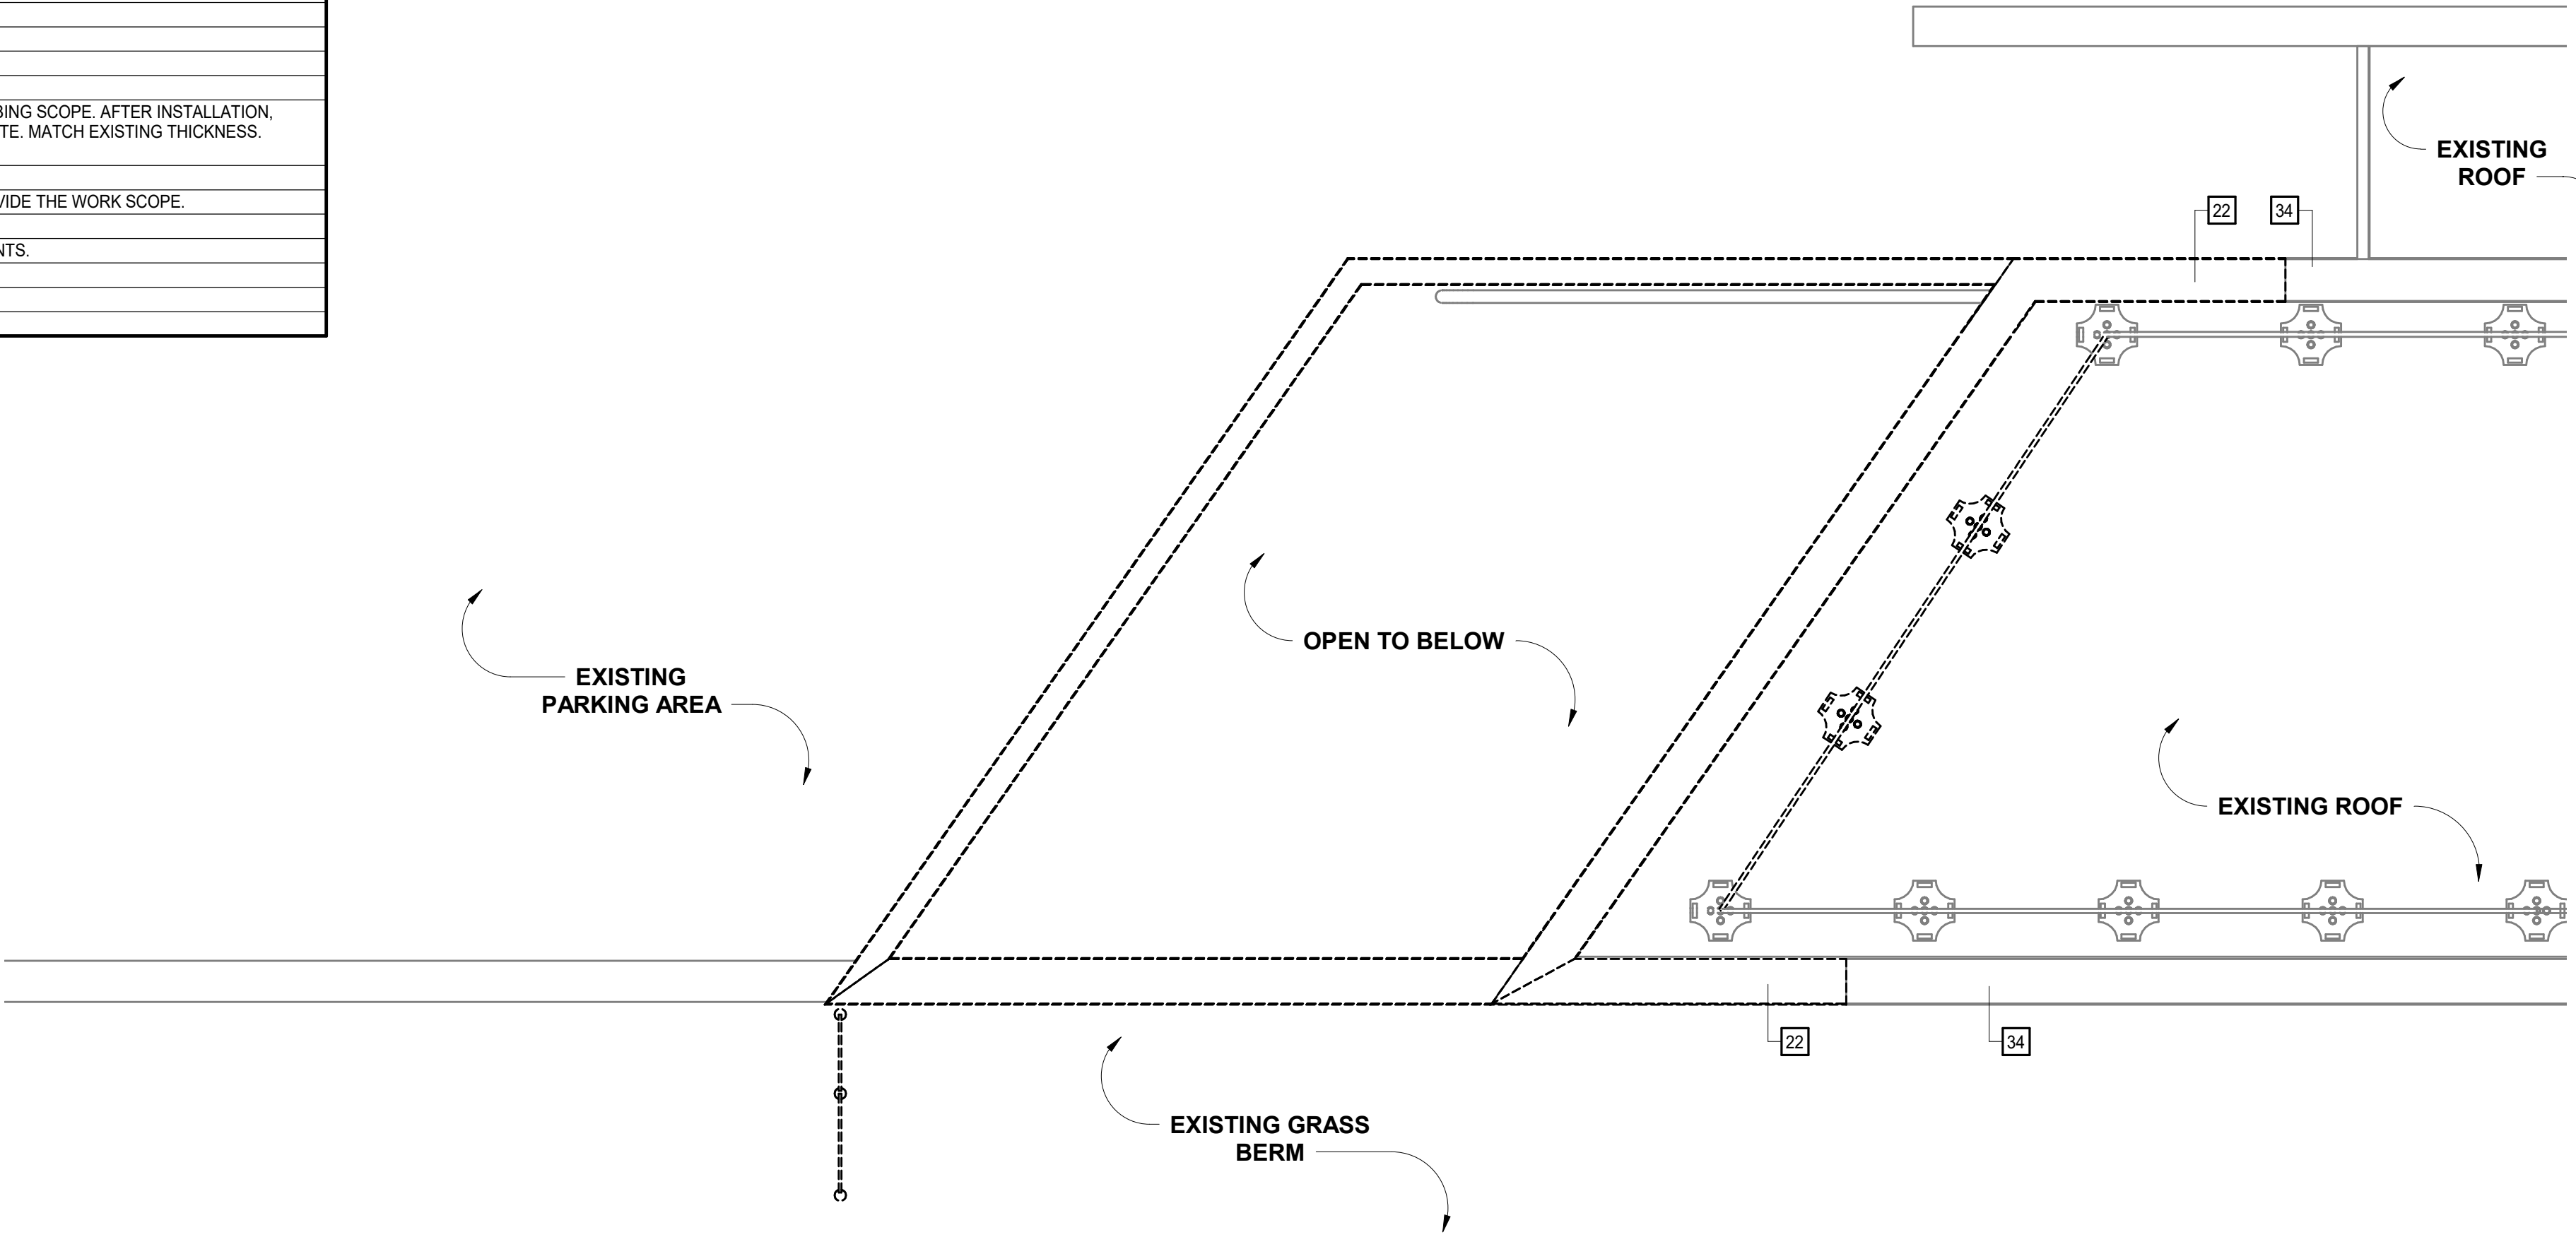

2 ROOF PLAN DEMO  
A2.1 | A10.1 1/4" = 1'-0"

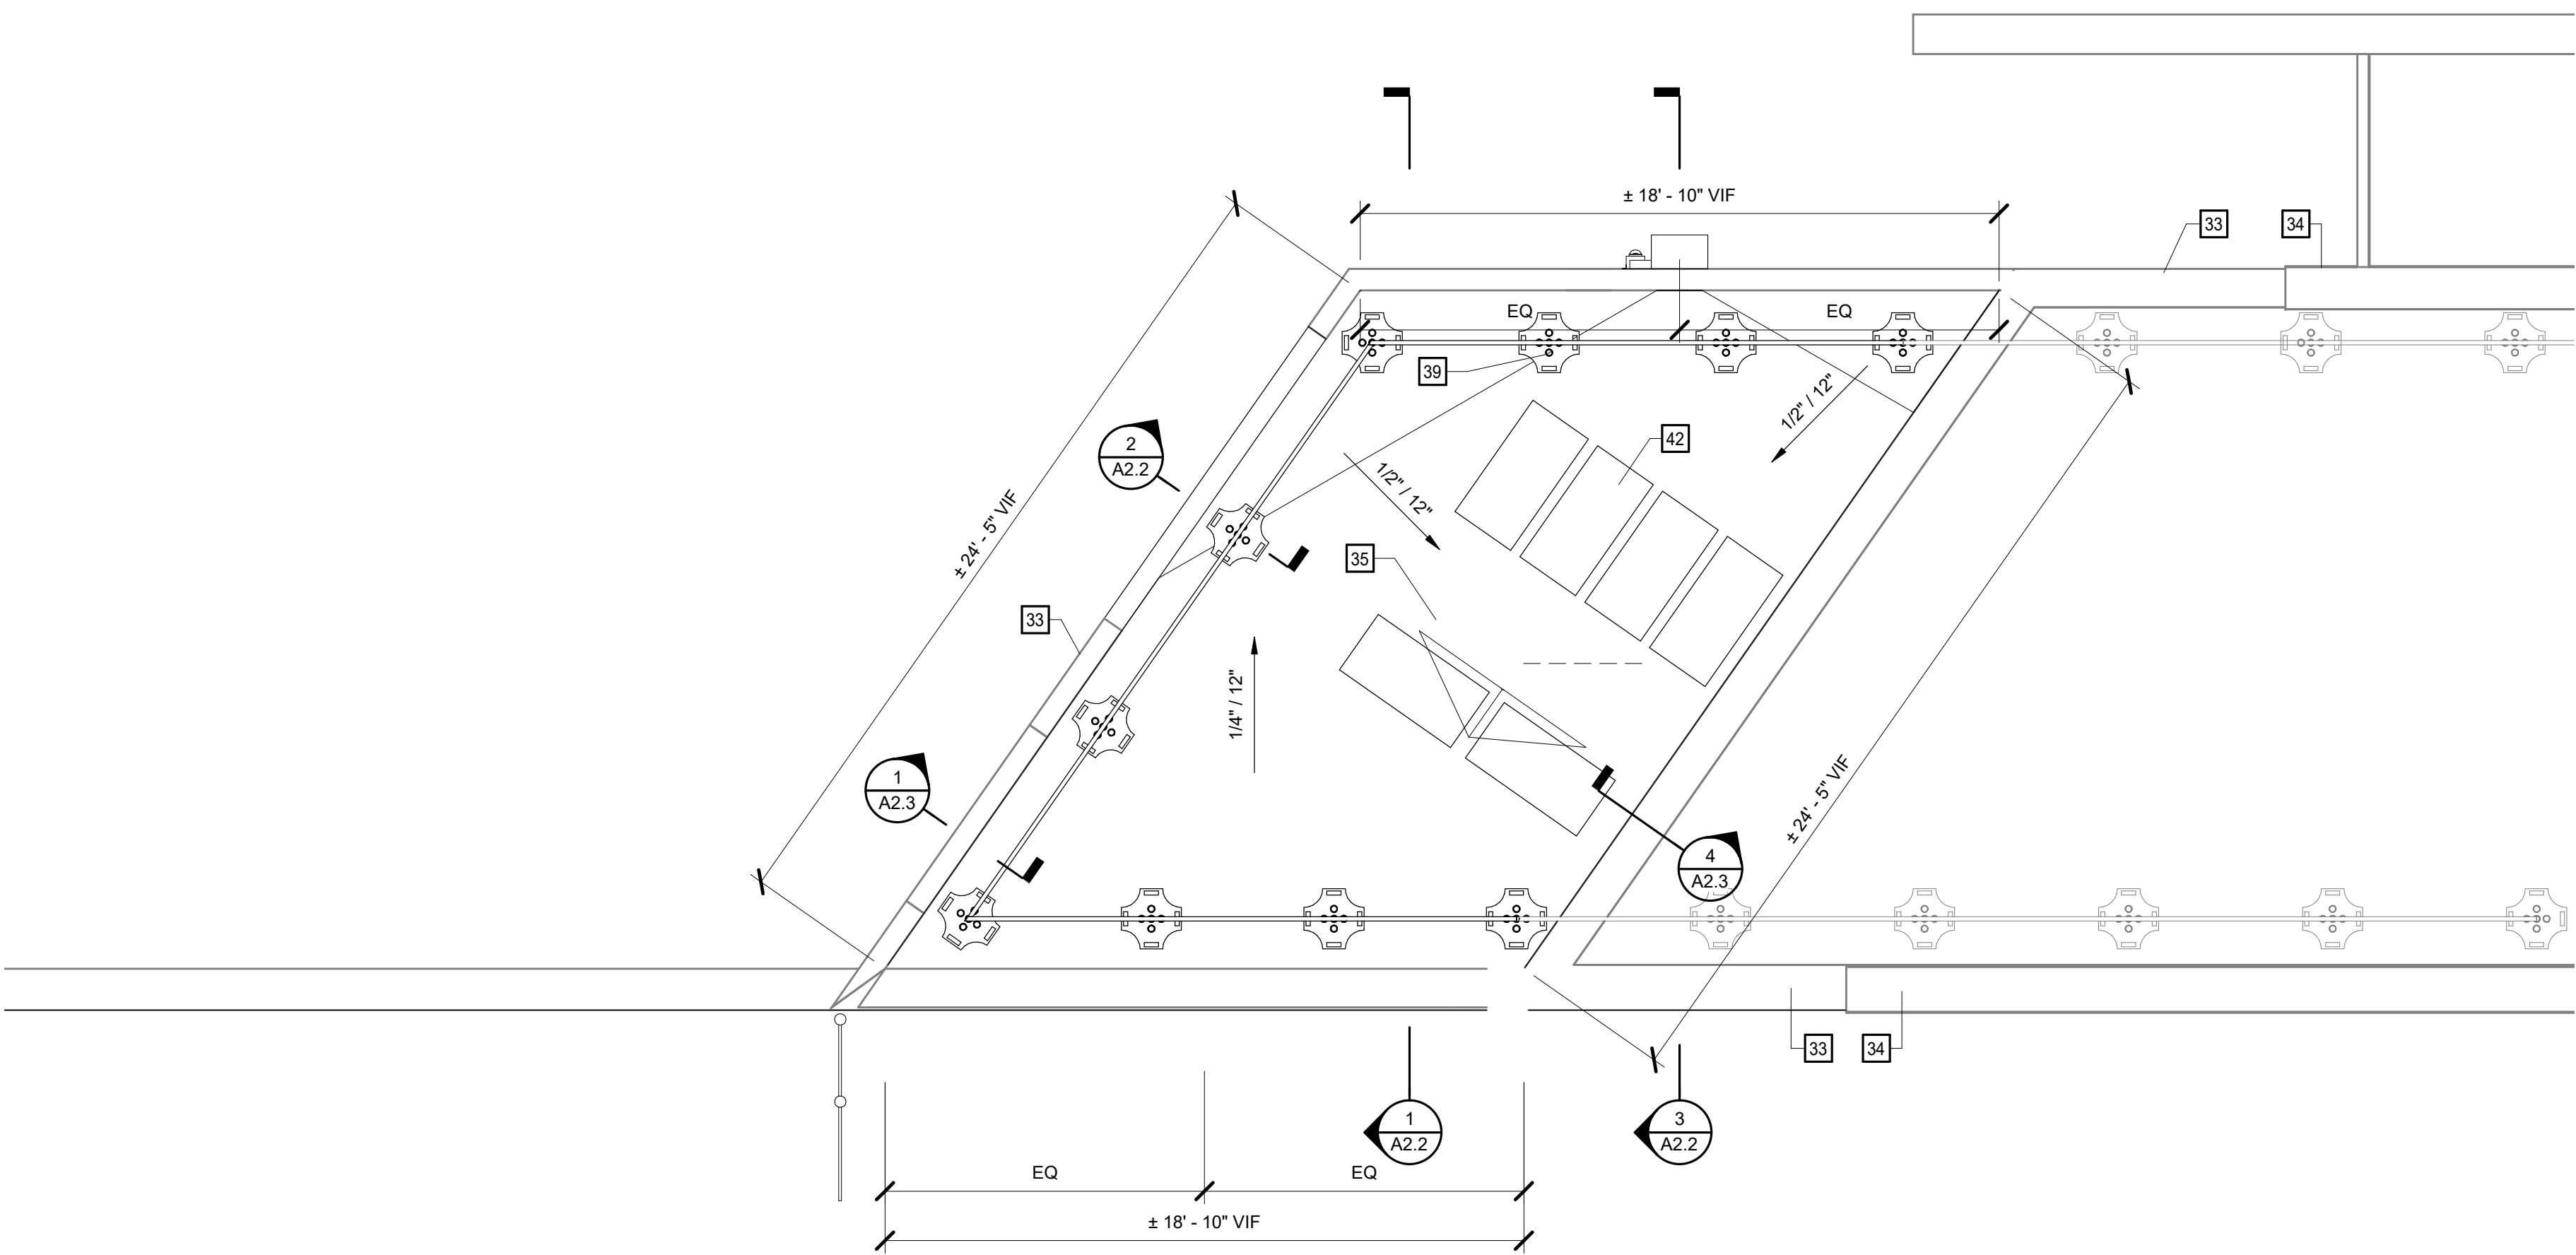

1 ROOF PLAN  
A2.1 | A10.1 1/4" = 1'-0"

MOSELEYARCHITECTS

3200 NORFOLK STREET, RICHMOND, VA 23230  
PHONE (804) 784-7555 FAX (804) 355-5690

MOSELEYARCHITECTS.COM



KELLY DAY RENOVATIONS FS 1

563006

500 South Glebe Road, Arlington, VA 22204


Owner: Arlington County

PROJECT NO: 563006	
DATE: SEPTEMBER 22, 2021	
REVISIONS	
DATE	DESCRIPTION
12/15/21	ADDENDUM 1

ROOF PLAN

A10.1

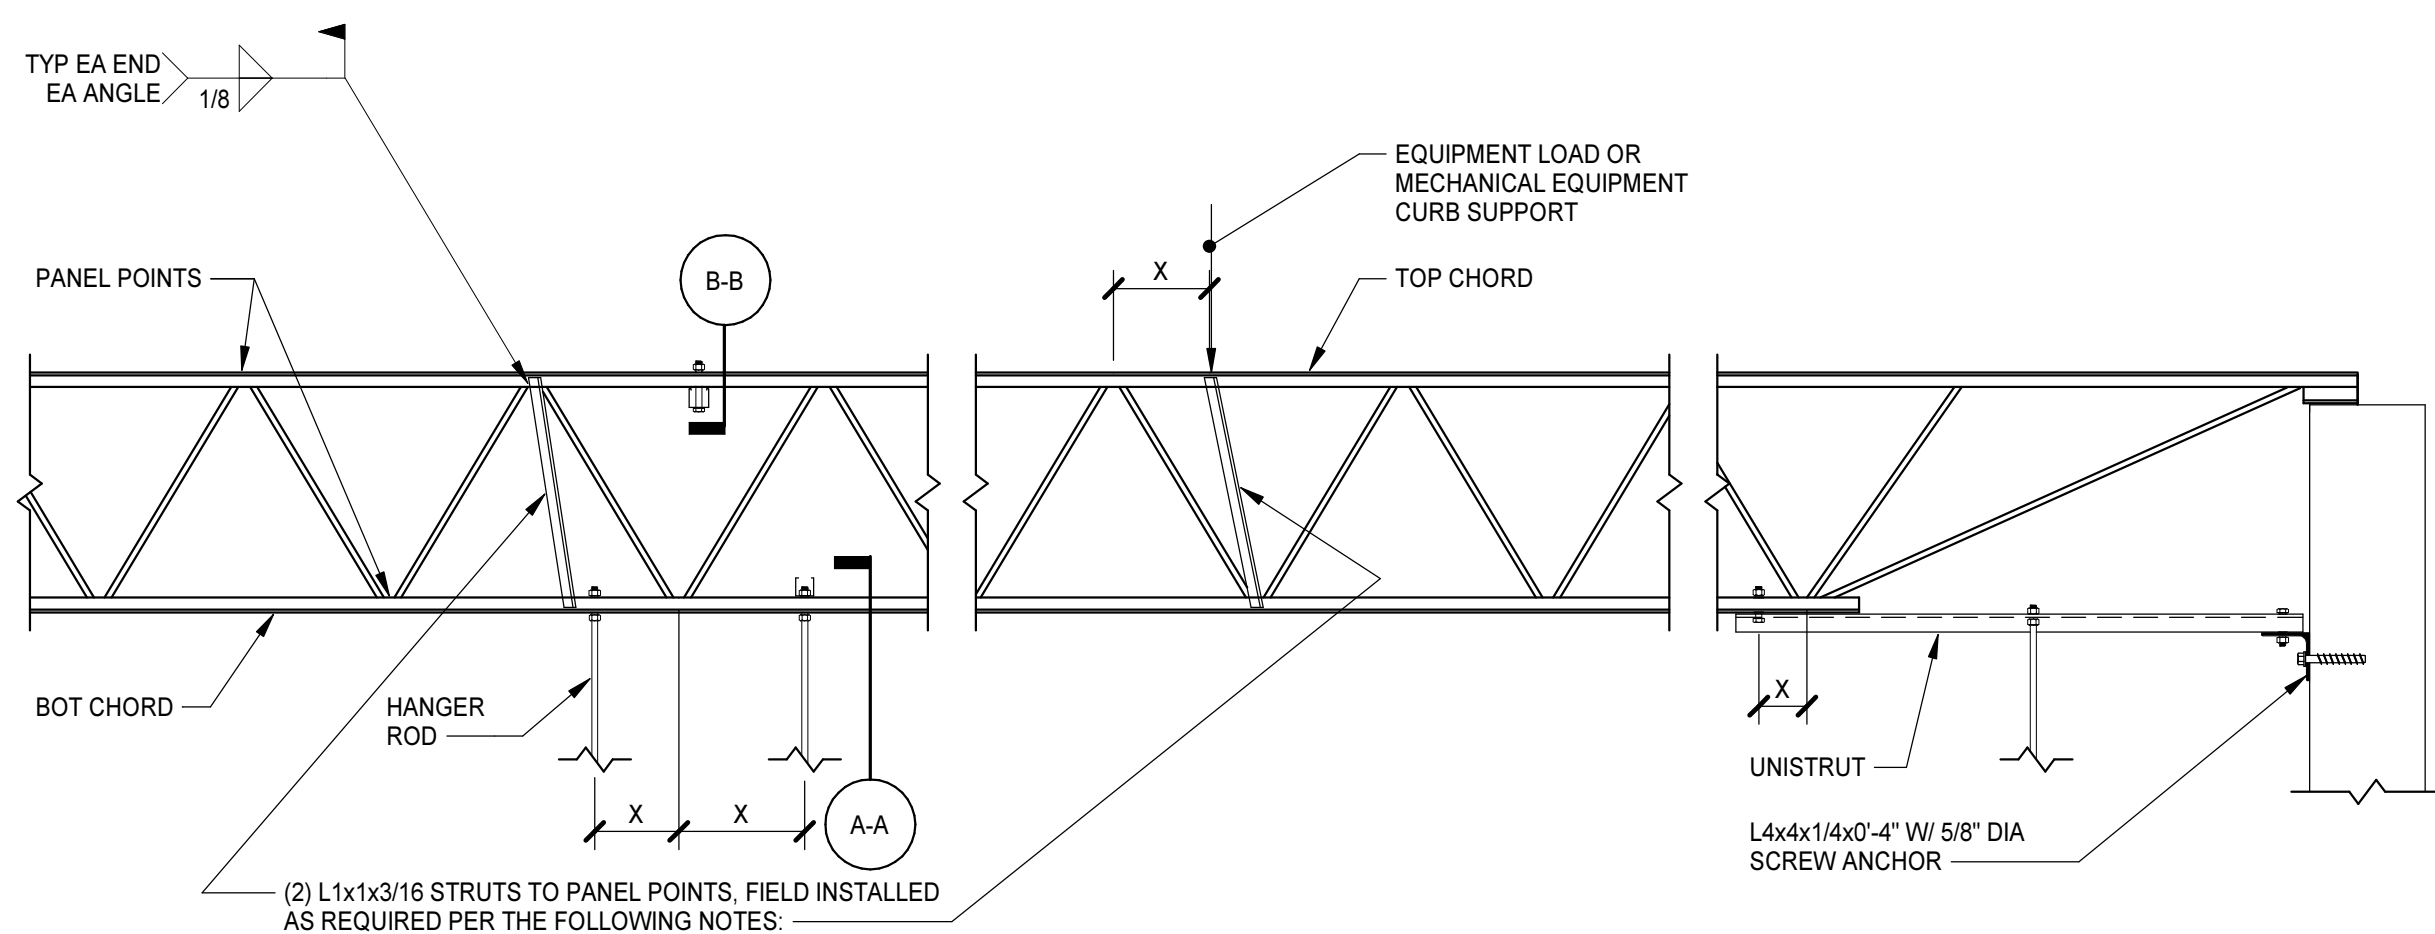

**K-SERIES JOISTS**


- WHERE UTILITIES RUN PARALLEL TO JOISTS, INDIVIDUAL HANGERS SHALL BE SPACED SUCH THAT HANGER LOAD (IF DIRECTLY BELOW JOIST), OR UNISTRUT REACTION (IF PIPE IS BETWEEN JOISTS) DOES NOT EXCEED 200 LBS.
- WHERE UTILITIES RUN PERPENDICULAR TO JOISTS, INDIVIDUAL HANGERS SHALL BE SPACED SUCH THAT HANGER LOAD DOES NOT EXCEED 200 LBS.
- IF INDIVIDUAL HANGER LOAD EXCEEDS 200 LBS ON ANY JOIST, AND DIMENSION 'X' EXCEEDS 6", STRUTS SHALL BE INSTALLED AS INDICATED ABOVE.
- WHERE MULTIPLE HANGERS ARE LOCATED BETWEEN PANEL POINTS, THE CUMULATIVE LOAD SHALL NOT EXCEED 200 LBS.

**KCS AND LH-SERIES JOISTS**

- WHERE UTILITIES RUN PARALLEL TO JOISTS, INDIVIDUAL HANGERS SHALL BE SPACED SUCH THAT HANGER LOAD (IF DIRECTLY BELOW JOIST), OR UNISTRUT REACTION (IF PIPE IS BETWEEN JOISTS) DOES NOT EXCEED 500 LBS.
- WHERE UTILITIES RUN PERPENDICULAR TO JOISTS, INDIVIDUAL HANGERS SHALL BE SPACED SUCH THAT HANGER LOAD DOES NOT EXCEED 500 LBS, OR HANGER SHALL BE LOCATED AT EA JOIST.
- IF INDIVIDUAL HANGER LOAD EXCEEDS 500 LBS ON ANY JOIST, AND DIMENSION 'X' EXCEEDS 6", STRUTS SHALL BE INSTALLED AS INDICATED ABOVE.
- WHERE MULTIPLE HANGERS ARE LOCATED BETWEEN PANEL POINTS, THE CUMULATIVE LOAD SHALL NOT EXCEED 500 LBS.

**GENERAL**


- C-CLAMPS SHALL NOT BE USED WHERE HANGER LOAD EXCEEDS 50 LBS.
- REFER TO DRAWING S0 D.1 FOR STEEL JOIST NOTES.

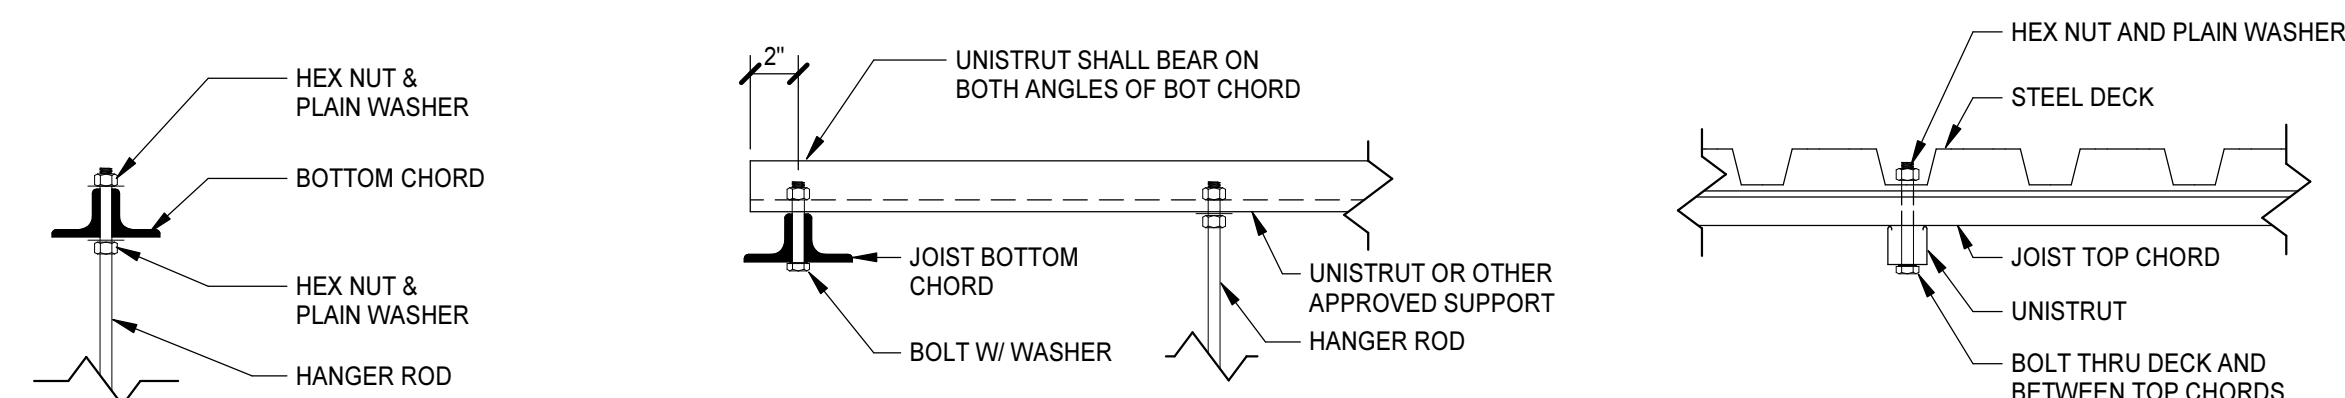


**NOTE:** CONTRACTOR SHALL PROVIDE DESIGN OF HANGER ASSEMBLY. C-CLAMPS PERMITTED WHEN LOAD IS LESS THAN 50 LBS.

**SECTION A-A****SECTION B-B****TYPICAL LOAD SUPPORTED FROM EX JOIST DETAIL**


NO SCALE

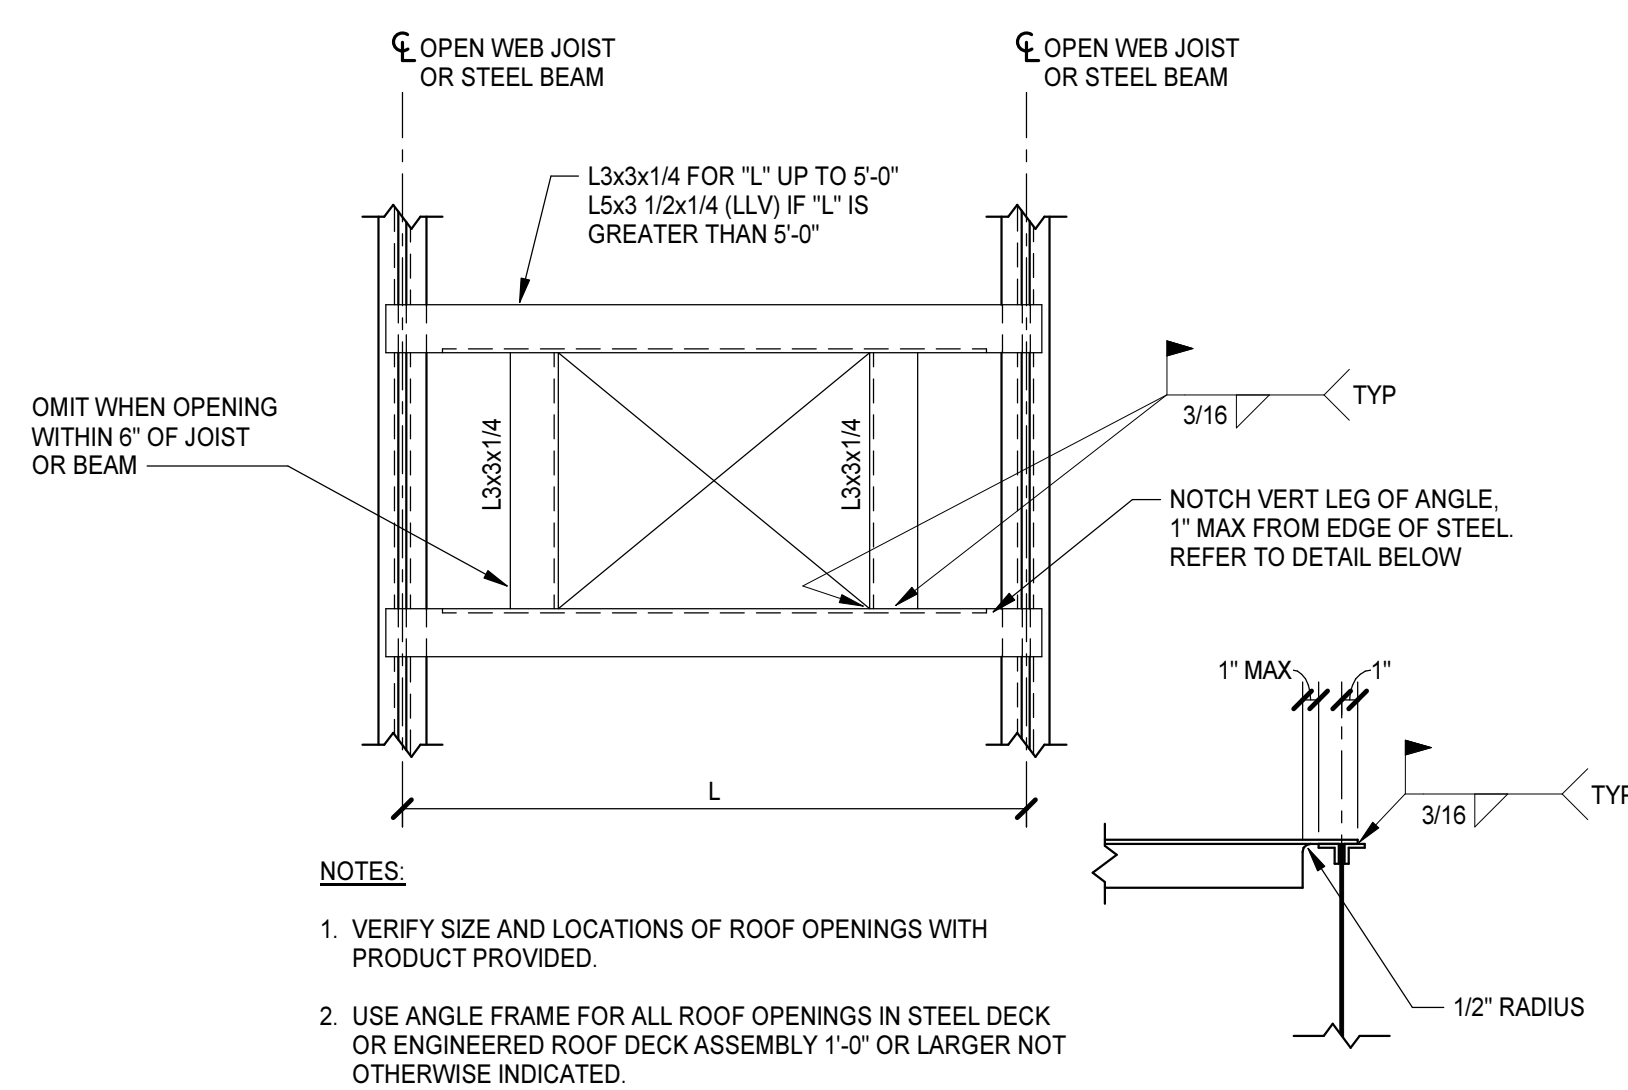**ROOF OPENING SUPPORT DETAIL - NEW CONSTRUCTION**

NO SCALE

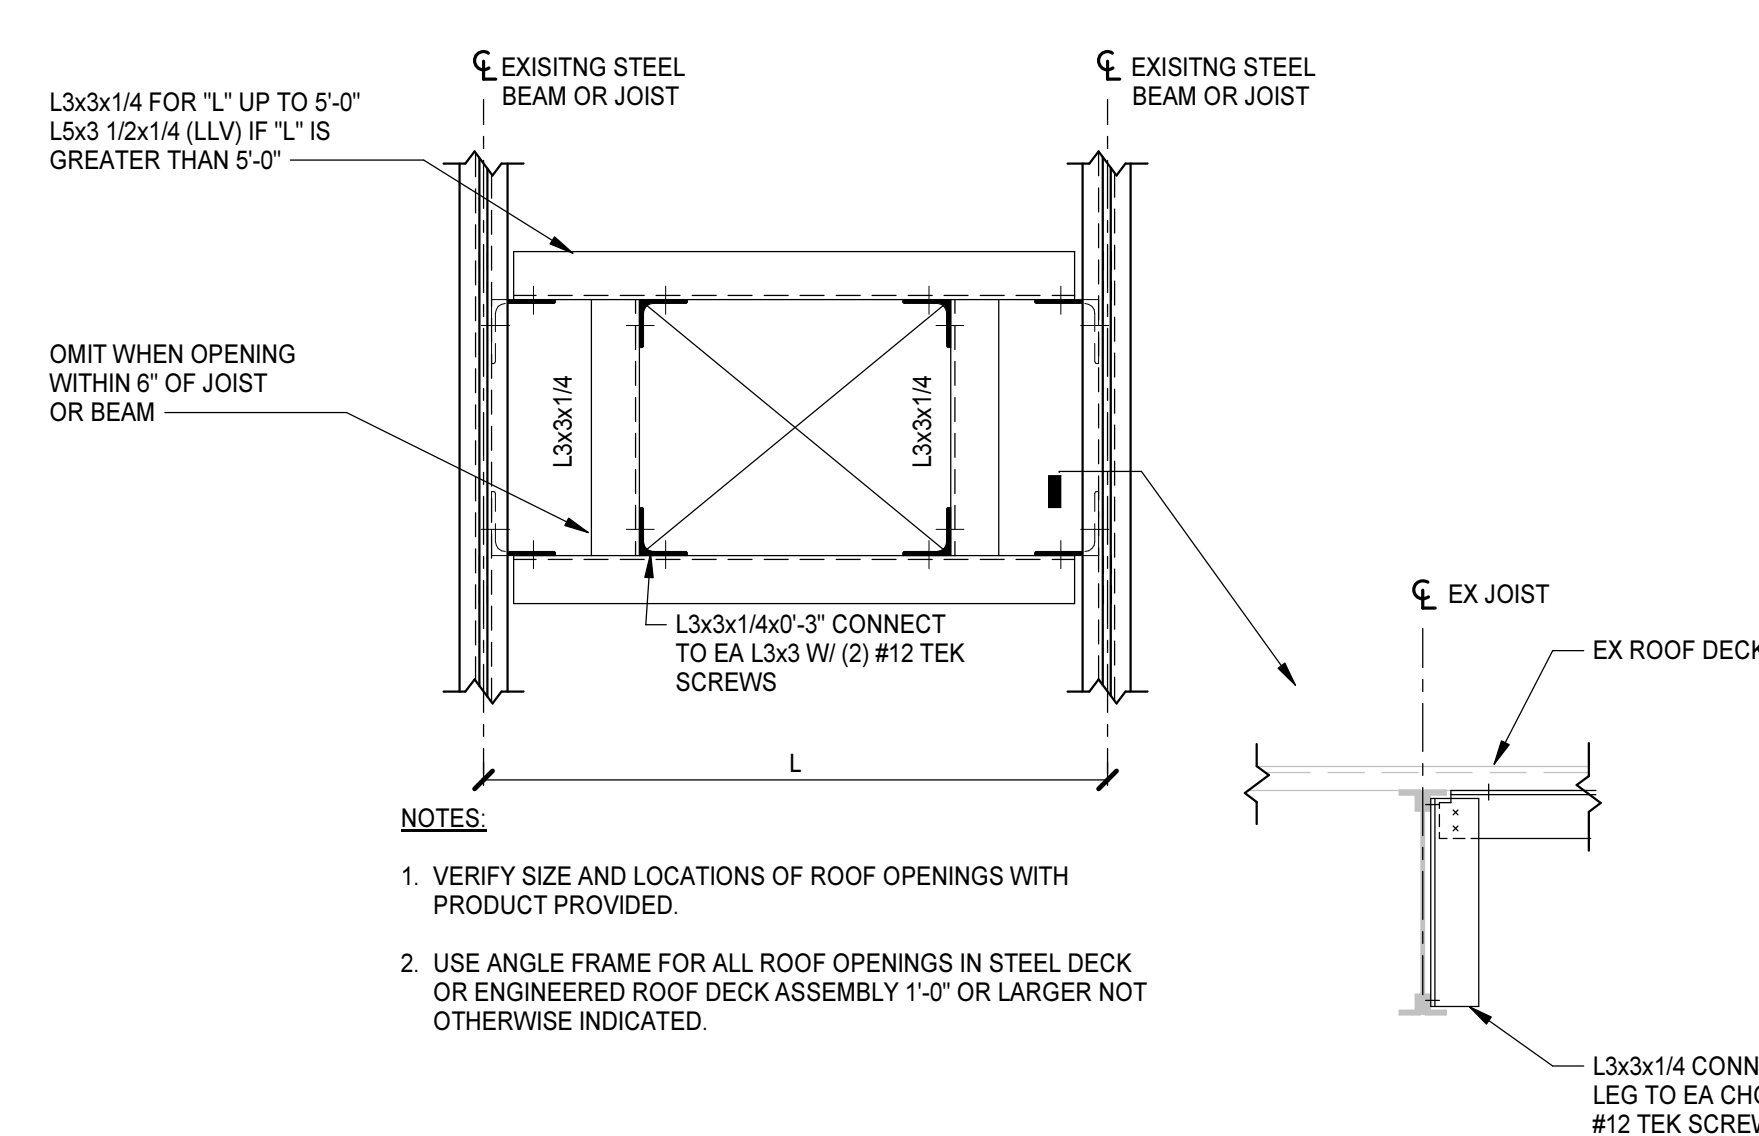**ROOF OPENING SUPPORT DETAIL - EXISTING CONSTRUCTION**



NO SCALE

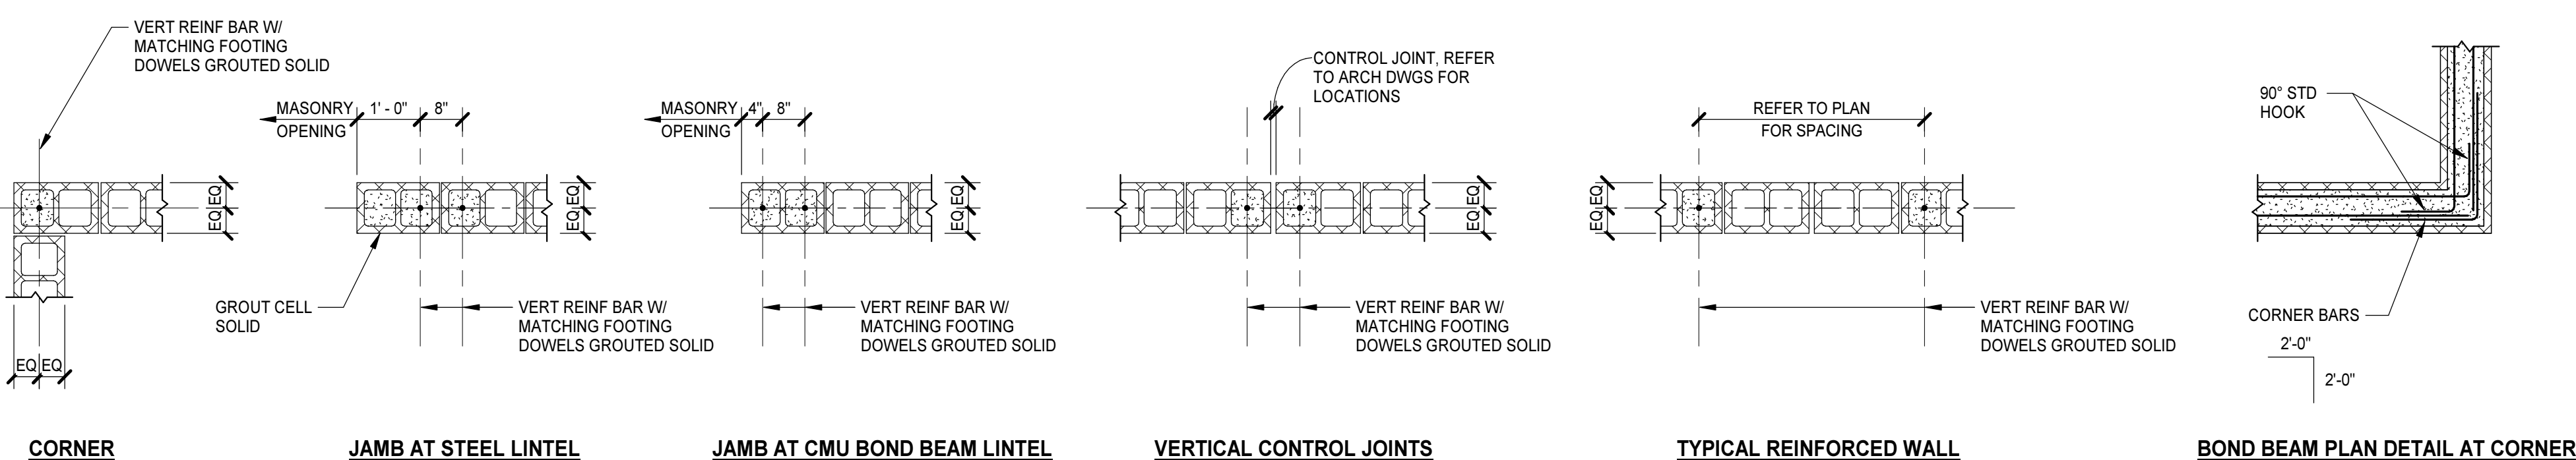**NOTES**


- REINFORCING BAR SIZE INDICATED ON FOUNDATION PLAN.
- DETAILS ARE PROVIDED FOR VERTICAL REINFORCING STEEL PLACEMENT ONLY. REFER TO ARCHITECTS DRAWINGS FOR SPECIFIC MASONRY DETAILS.

**CMU WALL REINFORCING DETAILS**




NO SCALE

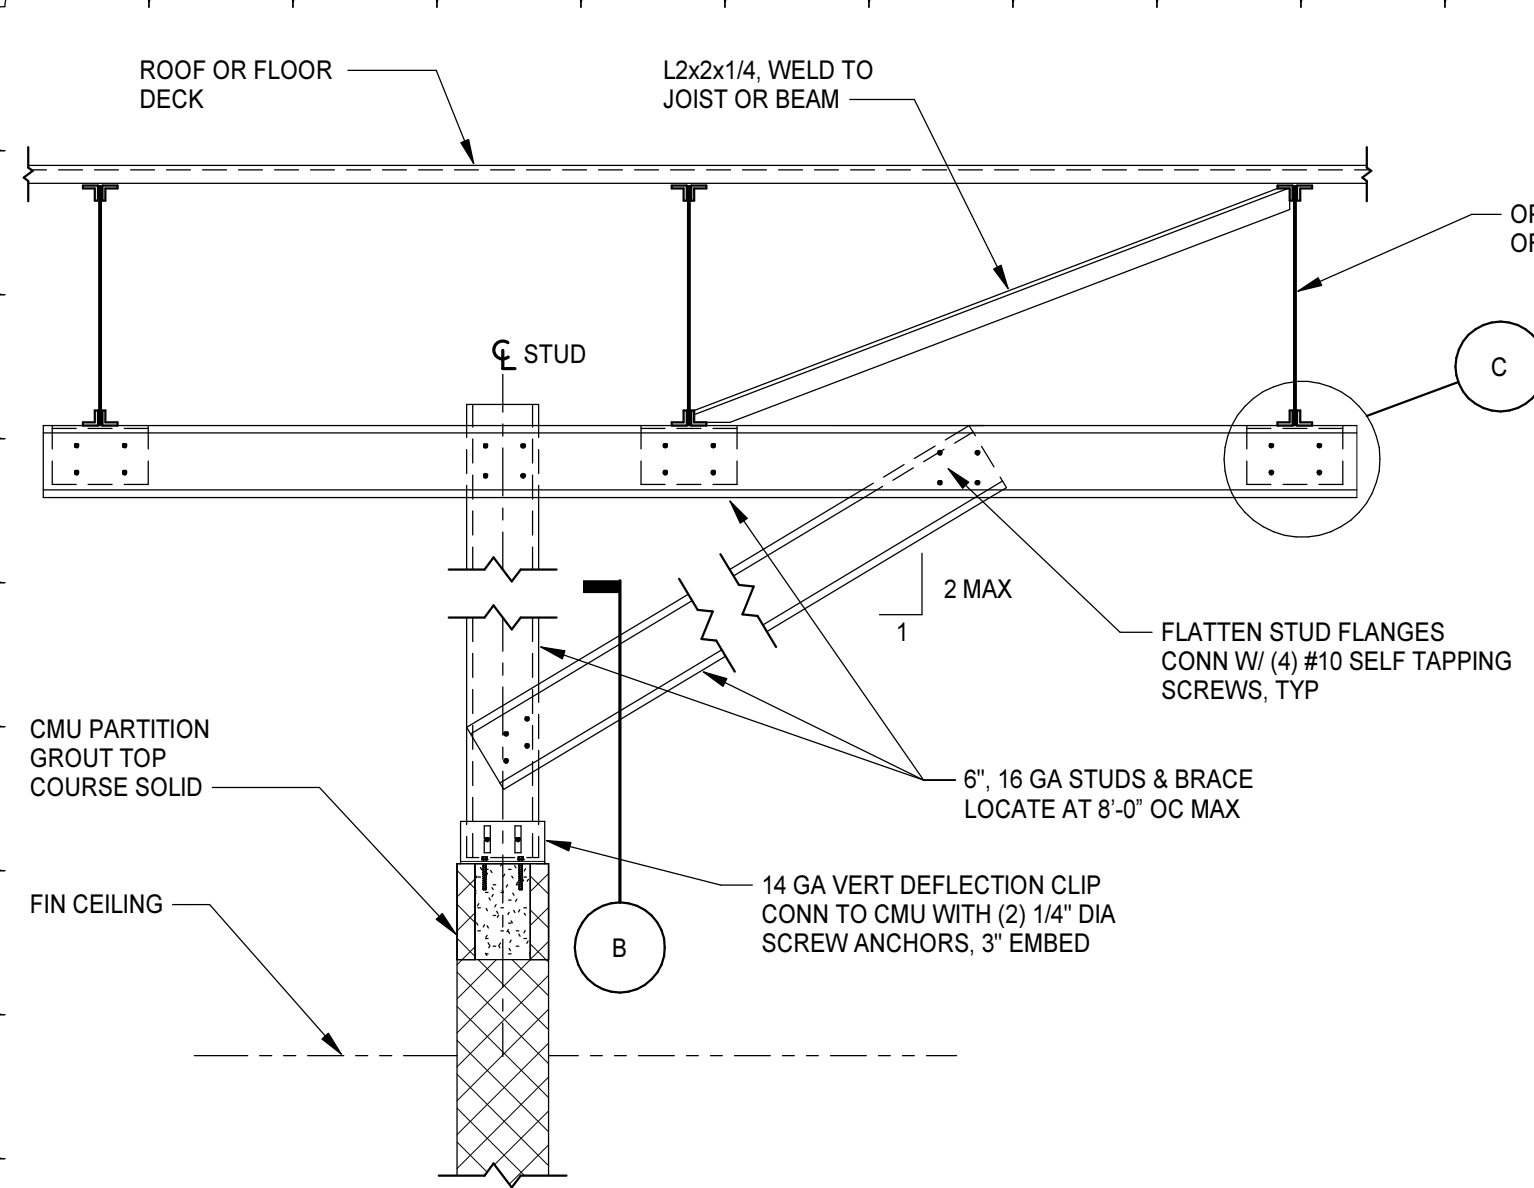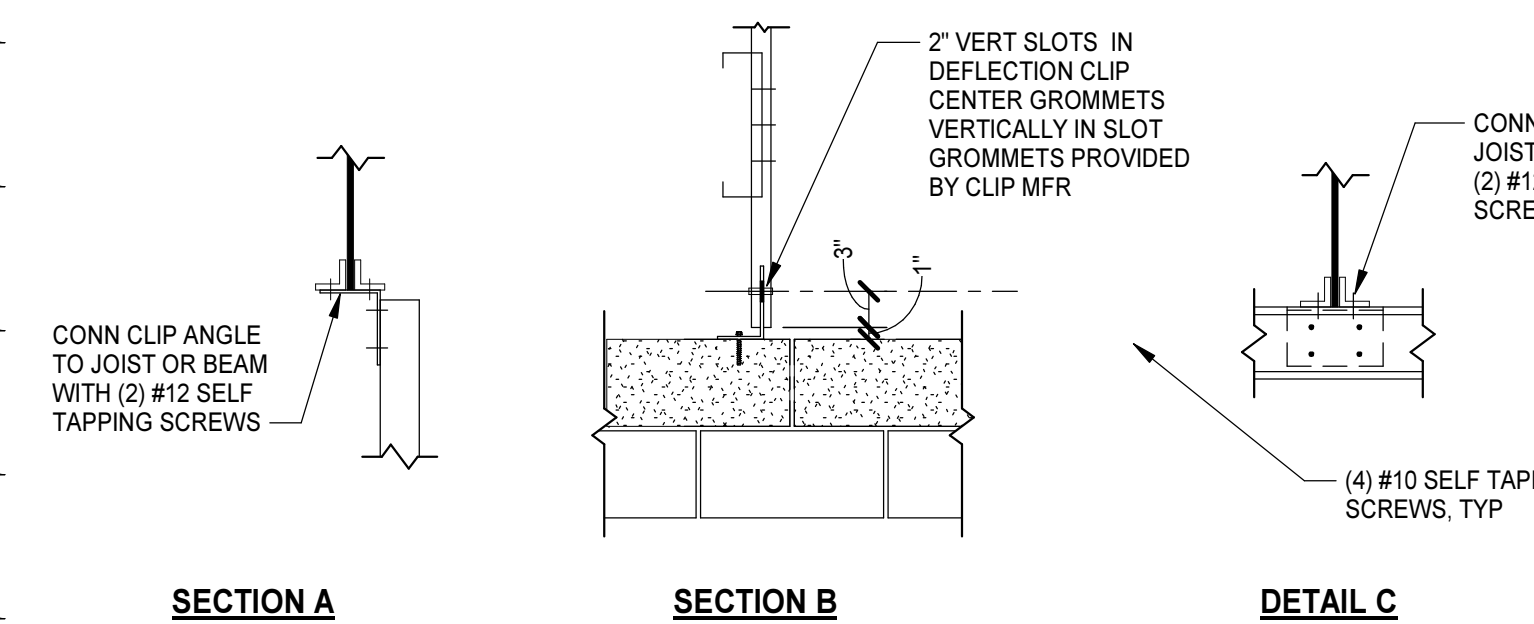**LOW WALL PARALLEL TO JOIST OR BEAM****BRACING DETAILS FOR NON-LOAD BEARING INTERIOR MASONRY PARTITIONS**

NO SCALE

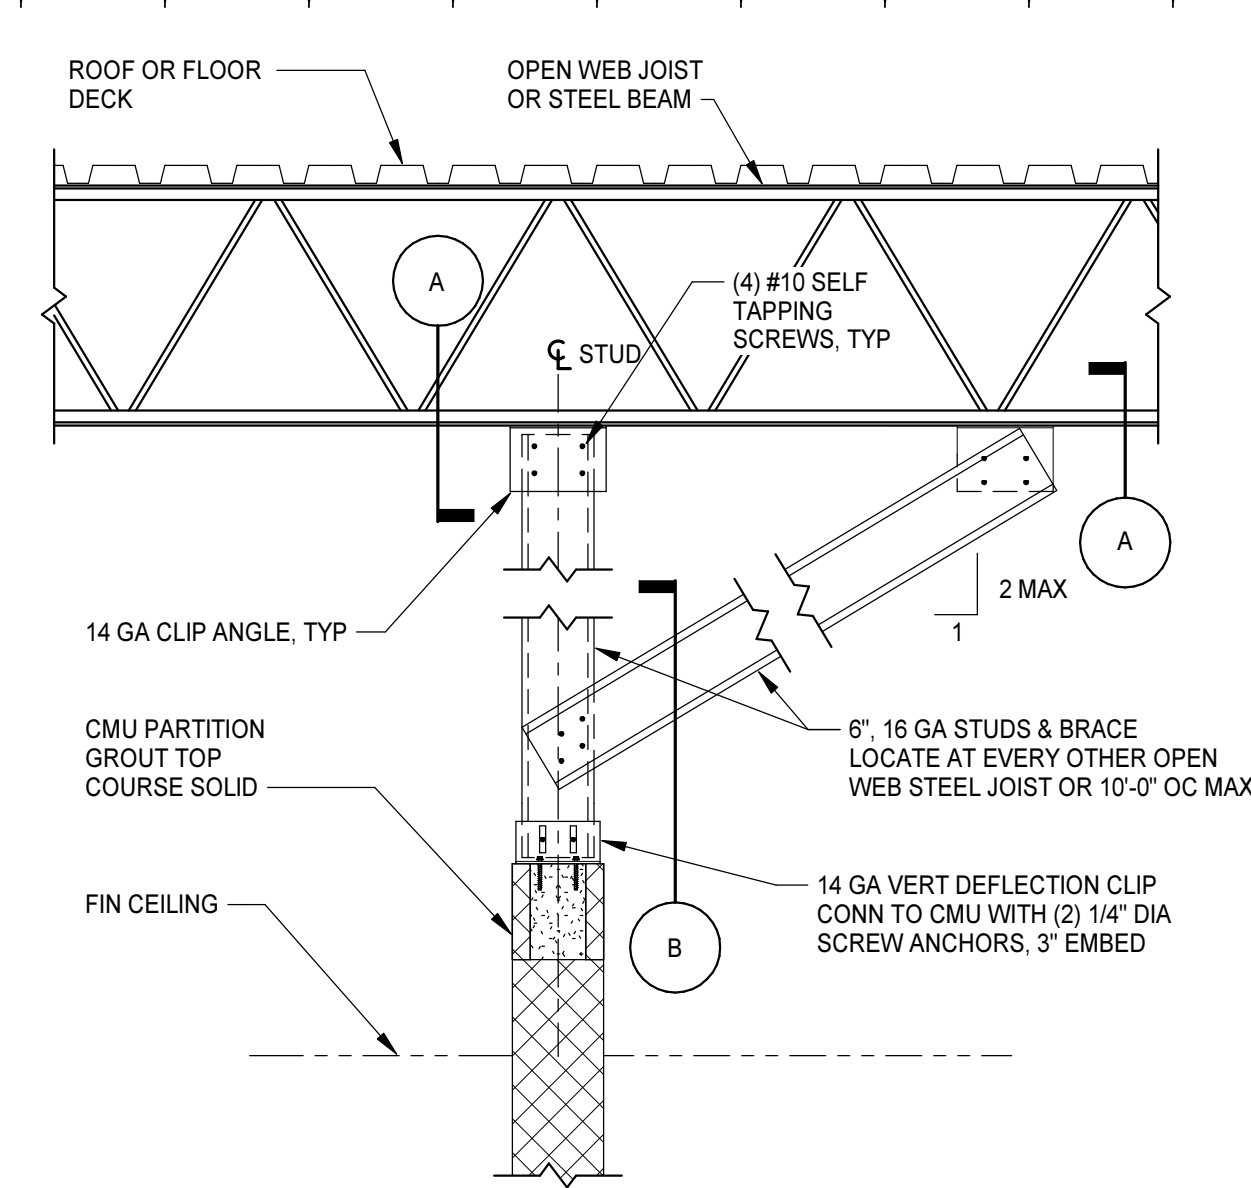**ADDENDUM****LOW WALL PERPENDICULAR TO JOIST OR BEAM****NOTES**

- BRACE INTERIOR NON-LOAD BEARING MASONRY WALLS IN ACCORDANCE WITH THESE DETAILS UNLESS OTHERWISE INDICATED.
  - IN LIEU OF BRACING AT TOPS OF WALLS, BRACING MAY BE PROVIDED BY INTERSECTING MASONRY WALLS WHEN THE DISTANCE BETWEEN THE INTERSECTING WALLS DOES NOT EXCEED THE FOLLOWING.
- | NOMINAL THICKNESS OF BRACED WALLS | MAXIMUM SPACING BETWEEN INTERSECTING WALLS |
|-----------------------------------|--|
| 4"                                | 12'-0"                                     |
| 6"                                | 16'-0"                                     |
| 8"                                | 22'-0"                                     |
| 10"                               | 28'-0"                                     |
| 12"                               | 30'-0"                                     |
- BRACING IS REQUIRED IN ACCORDANCE WITH THESE DETAILS IF A VERTICAL CONTROL JOINT OCCURS BETWEEN INTERSECTING WALLS.
  - REFER TO ARCHITECTURAL DRAWINGS FOR INTERIOR PARTITION TYPES AND LOCATIONS.
  - INSTALL BRACING AFTER ALL ROOF DEAD LOAD IS IN PLACE.

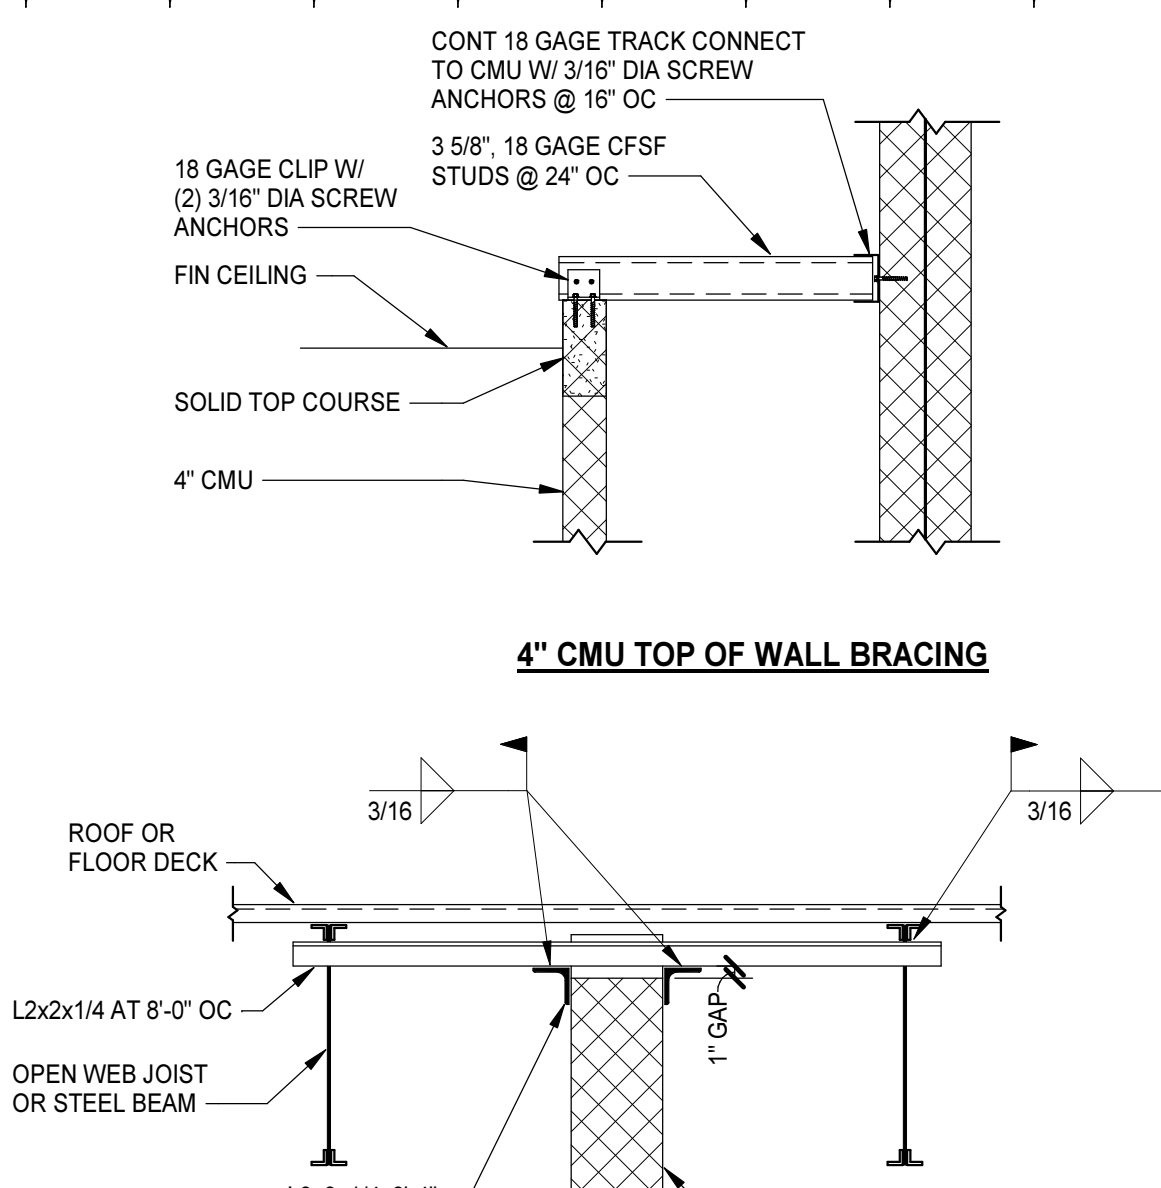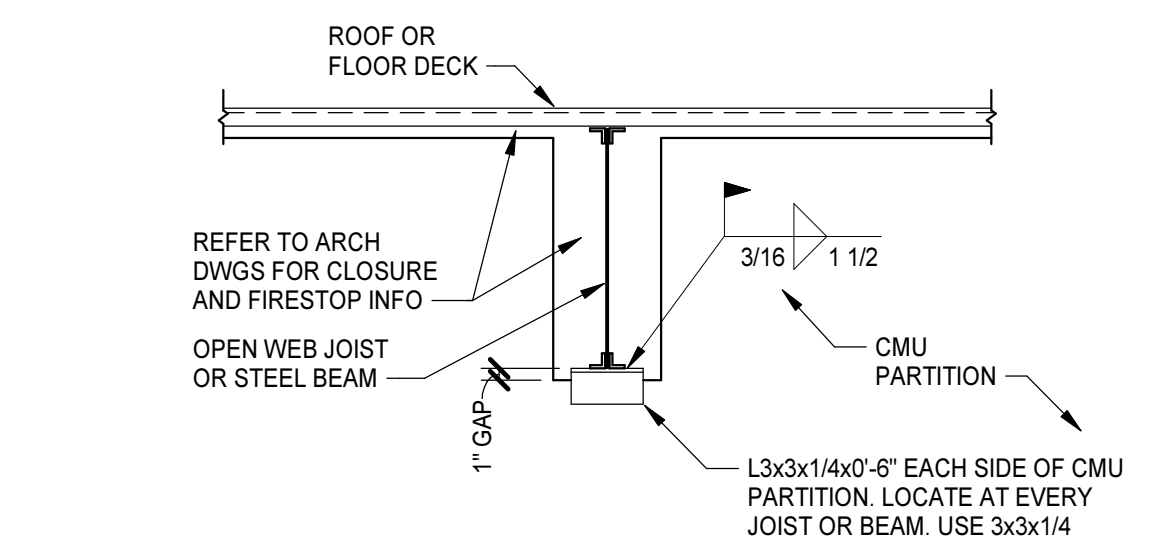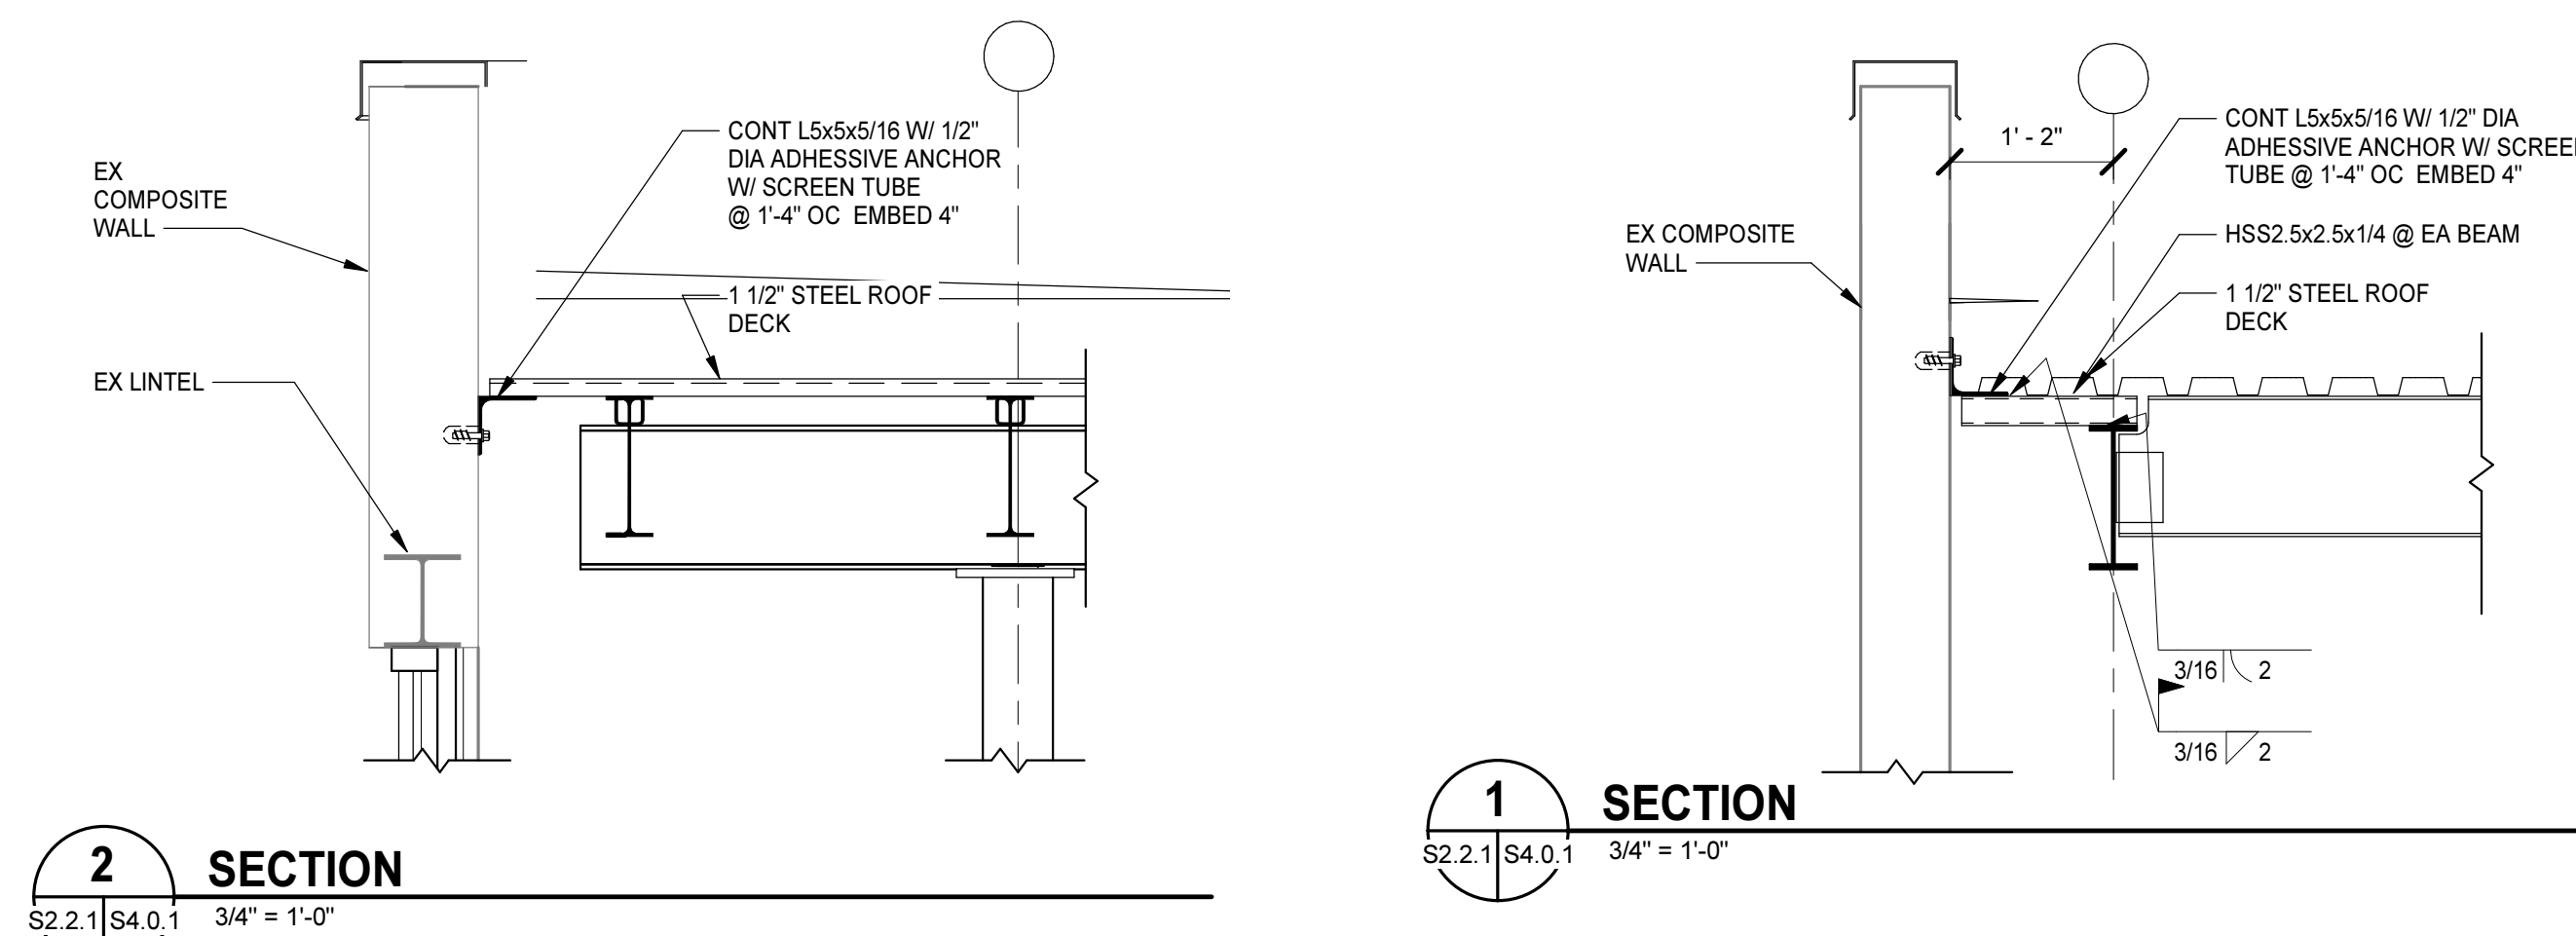**WALL TO UNDERSIDE OF DECK PARALLEL TO JOISTS****WALL TO UNDERSIDE OF DECK PERPENDICULAR TO JOISTS**

LINTEL SCHEDULE					
MARK	DIAGRAM	BOND BEAM (W x H)	REINFORCING	STEEL	NOTES
L1		---	---	L5x3 1/2x3/8 (LLV) AT BRICK AND (2) L5x3 1/2x3/8 (LLV) AT CMU	
L2		---	---	(2) L3 1/2x3 1/2x5/16	

**LINTEL NOTES**

1. LINTELS FOR ARCHITECTURAL OPENINGS (WINDOWS, DOORS, LOUVERS) IN BEARING WALLS AND EXTERIOR WALLS ARE IDENTIFIED BY MARK NUMBER ON THE FRAMING PLAN(S) AND INCLUDED IN THE LINTEL SCHEDULE.

2. LINTELS FOR ARCHITECTURAL OPENINGS IN NON-LOAD BEARING WALLS AND OTHER WALLS WHICH ARE NOT INDICATED ON THE FRAMING PLAN(S) SHALL BE CONSTRUCTED PER NOTES A, B OR C BELOW.

**A. STEEL ANGLE LINTELS**

PROVIDE ONE ANGLE FOR EACH NOMINAL 4" OF WALL THICKNESS PER THE FOLLOWING SCHEDULE.

MASONRY OPENING	ANGLE SIZE
UP TO 5'-0"	L3 1/2x3 1/2x5/16
5'-1" TO 6'-0"	L4x3 1/2x5/16 (LLV)
6'-1" TO 7'-0"	L5x3 1/2x3/8 (LLV)
OVER 7'-0"	AS DETAILED

FOR OPENINGS ON 10" CMU, HORIZONTAL LEGS OF ANGLES SHALL BE A COMBINATION OF 5" AND 4".

FOR OPENINGS IN 6" CMU REQUIRING STEEL LINTELS, USE W7x11 UP TO 7'-0" OPENING.

**B. REINFORCED BOND BEAM LINTELS**

LINTELS SHALL MATCH THICKNESS OF WALL. REINFORCE 8", 10" AND 12" BOND BEAM WITH (2) #5 BARS AT BOTTOM. REINFORCE 6" BOND BEAM WITH (1) #5 BAR AT BOTTOM. BOND BEAM SHALL BE 8" DEEP FOR OPENING WIDTH UP TO 5'-0", AND SHALL BEAR 8" ON SOLID MASONRY EACH END. BOND BEAM SHALL BE 16" DEEP FOR OPENING WIDTH UP TO 8'-0" AND SHALL BEAR 16" ON SOLID MASONRY EACH END WITH REINFORCING TOP AND BOTTOM. PLACE GROUT MONOLITHICALLY IN BOTH COURSES OF 16" DEEP BOND BEAM.

**C. PRECAST CONCRETE LINTELS**

PRECAST CONCRETE LINTELS SHALL BE 3 5/8" x 7 5/8" FOR EACH NOMINAL 4" THICKNESS OF WALL. REINFORCING SHALL BE (1) #4 TOP AND BOTTOM WITH 1 1/2" COVER. FOR OPENINGS IN 6" CMU, LINTEL SHALL BE 5 5/8" x 7 5/8", REINFORCED WITH (1) #5 TOP AND BOTTOM. MASONRY OPENING WIDTH SHALL BE 6'-0" OR LESS. DO NOT USE PRECAST CONCRETE LINTELS IN EXPOSED LOCATIONS.


3. LINTELS FOR MECHANICAL DUCTWORK PENETRATIONS NOT OTHERWISE DETAILED SHALL BE ONE OF THE ABOVE (NOTE 2A, 2B OR 2C).

4. LINTELS SHALL BEAR 8" ONTO SOLID OR GROUT FILLED MASONRY, UNLESS OTHERWISE INDICATED.

5. LINTELS ARE REQUIRED OVER ALL MASONRY OPENINGS GREATER THAN 8" IN WIDTH.

6. LINTELS ARE NOT REQUIRED ABOVE HOLLOW METAL FRAMES IN OPENINGS 3'-4" OR LESS IN 6" NON-BEARING MASONRY PARTITIONS. GROUT HEAD OF FRAMES SOLID BEFORE PLACING MASONRY.

7. ALL LINTELS IN EXTERIOR WALLS SHALL BE GALVANIZED.

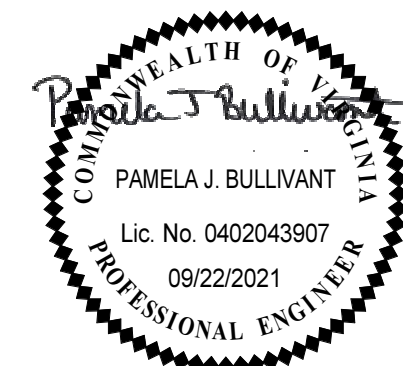

PROJECT NO: 553006	DATE: SEPTEMBER 22, 2021
REVISIONS	
DATE	DESCRIPTION
12/15/21	ADDENDUM 1