



**ADDENDUM NO. 1**  
**TO THE BID DOCUMENTS FOR THE**  
**465 SPRINGHILL – PRESCHOOL ELECTRICAL PROJECT**

**FAYETTE COUNTY PUBLIC SCHOOLS**  
**LEXINGTON, KY**

---


---

This Addendum No. 1 forms a part of the Contract Documents and modifies the original Bidding Documents dated January 11, 2023, as noted below. Bidders shall acknowledge receipt of this Addendum No. 1 on the Bid Form. Failure to do so may subject the Bidder to disqualification.

February 8, 2023

To: **ALL HOLDERS OF BID DOCUMENTS**

- Note about power poles on E1.0 should read, “QUADRUPLEX ON DUAL CHANNEL POWER POLES.”
  
- In the Bid document on page 14 under Scope of Work, item 10 should read, “PANELS SERVING COMPUTER LOADS SHALL BE PROVIDED BY AN EXTERNAL OR INTEGRAL TRANSIENT VOLTAGE SURGE SUPPRESSOR (TVSS)”.
  
- On E1.0 the following should be understood, “ELEC – LUMINAIRE SCHEDULE” OTHER MANUFACTURERS THAN THE ‘BASIS OF DESIGN’ WILL BE CONSIDERED FOR THE WALL PACKS. THE POLE LIGHT CUT SHEET ATTACHED WAS SPECIFICALLY CHOSE FOR THIS PROJECT.”
  
- Add one additional electrical duplex outlet in rooms 16, 30, 35 and 38. Outlet locations in the rooms are provided on the attached drawing E2.0

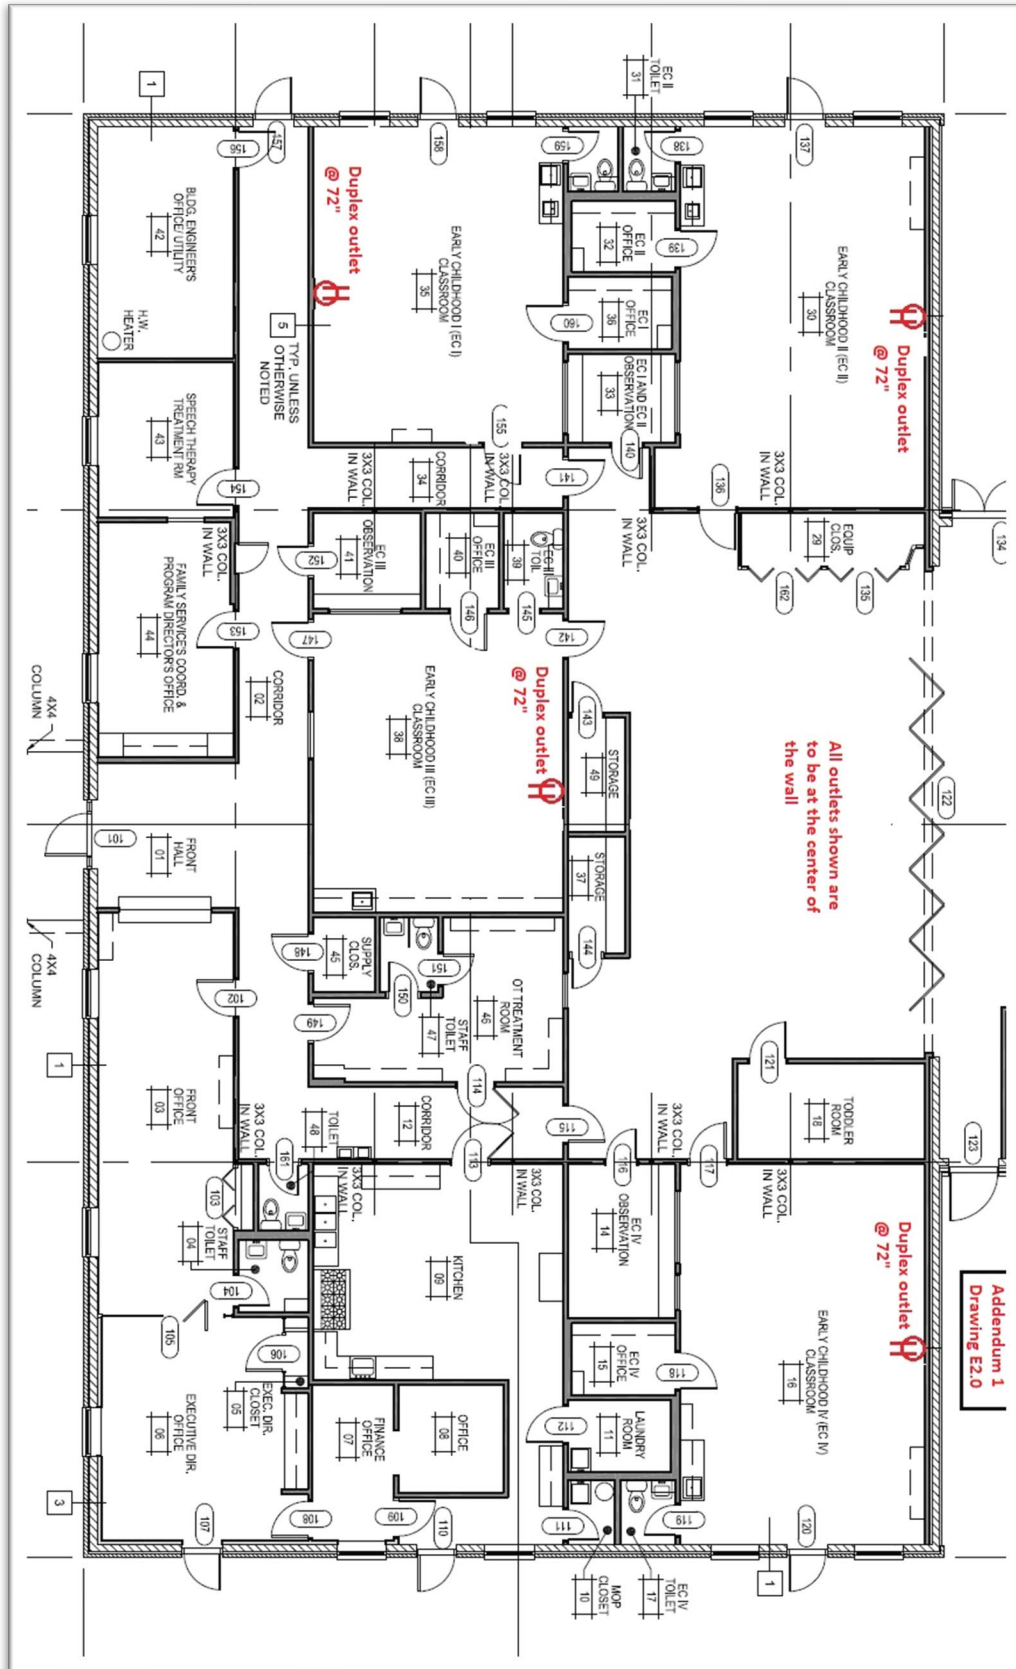

All outlets shown are to be at the center of the wall

Addendum 1  
Drawing E2.0