



ADDENDUM NO. 1
TO THE SPECIFICATIONS
FOR
REPLACE LEAD WATER SERVICE LINES

CITY OF GALESBURG
GALESBURG, IL


APRIL 18, 2017

NOTE: Wherein this Addendum conflicts with the “Specifications” dated February, 2017”, this Addendum shall govern.

SPECIFICATIONS:

1. CLSM Trench Backfill shall be Mix 1 in accordance with article 1019.05 of the “Standard Specifications for Road and Bridge Construction”, adopted on April 1, 2016.
2. **REMOVE** – Check valve from note 6 on meter setting detail for basements and **REPLACE** with the attached note 6.
3. **CLARIFICATION** – Mueller will not be an acceptable manufacturer for the curb boxes due to American Iron and Steel requirements. All products used in this project must comply with American Iron and Steel requirements as described in the Bid Documents.

BIDS ARE DUE: Friday, April 21, 2017 at 11:00 A.M.
at City of Galesburg, City Hall.

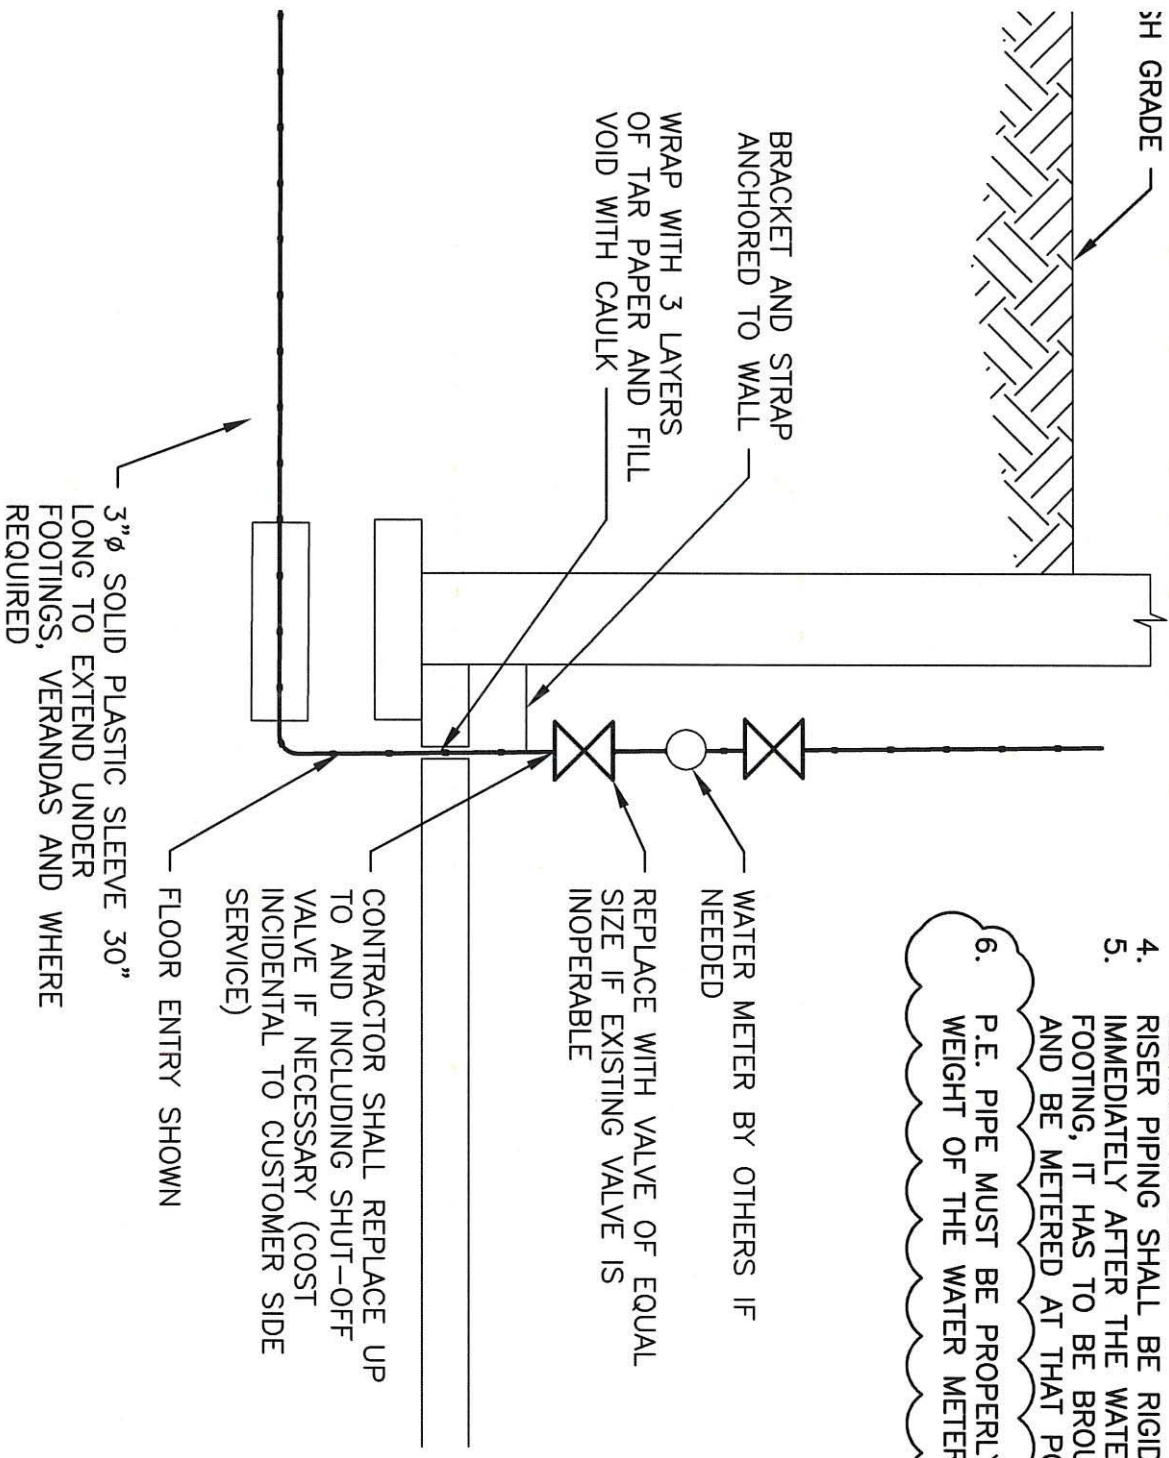

NOTES:
1. MATERIALS:

- A) ALL NIPPLES, FITTINGS, AND CONNECTIONS: BRASS OR SWEATED COPPER TYPE - K OR L
- B) WATER SERVICE PIPE: HDPE
- 2. SERVICE PIPE ENTRY TO BE WATERPROOF.
- 3. SOLDER JOINTS PROHIBITED ON ALL UNDERGROUND WATER SERVICE PIPING.
- 4. RISER PIPING SHALL BE RIGIDLY SUPPORTED TO BACK WALL. IMMEDIATELY AFTER THE WATER SERVICE PASSES UNDER THE FOOTING, IT HAS TO BE BROUGHT UP THROUGH THE FLOOR AND BE METERED AT THAT POINT
- 5.
- 6. P.E. PIPE MUST BE PROPERLY SECURED TO SUPPORT THE WEIGHT OF THE WATER METER.

METER SETTING
 BASEMENT TYPE 1" METER

Brunner, Cooper & Zuck

Civil Engineers • Structural Engineers • Land Surveyors
 201 West 1st Street • Lincoln, Nebraska 68501
 402.441.1111 • www.brunnercooperzuck.com