



NOTE: SUPPLIER OF NEW GUTTERS AND DOWNSPOUTS ARE REQUIRED TO ASSESS AND INSPECT EXISTING CONDITIONS IN THE FIELD. DETERMINE ITEMS TO BE BROUGHT TO THE ARCHITECT'S ATTENTION, AND PROVIDE A LIST OF ITEMS TO BE PROPOSED INSTALLATION FOR REVIEW AND APPROVAL OF THE ARCHITECT.

HIGH ROOF RIDGE

- ASSUMPTIONS
1. 5" PER HOUR RAINFALL
 2. ALL HORIZONTAL SUBGRADE PIPING TO BE SLOPED AT 1/8" PER FT.(1.0%)
 3. ALL HORIZONTAL GUTTERS TO BE SLOPED AT 1/8" PER FT (1.0%)
 4. SOURCE - FLORIDA BUILDING CODE, PLUMBING, 5th EDITION (2014) CHAPTER 11 "STORM DRAINAGE"
 5. REFER TO SECTION 6/A3.1 FOR GUTTER & DOWNSPOUT LOCATIONS

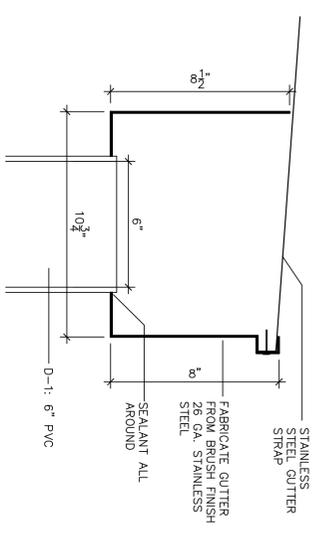

2 DOWNSPOUT & GUTTER DETAIL
SCALE 3" = 1'-0"

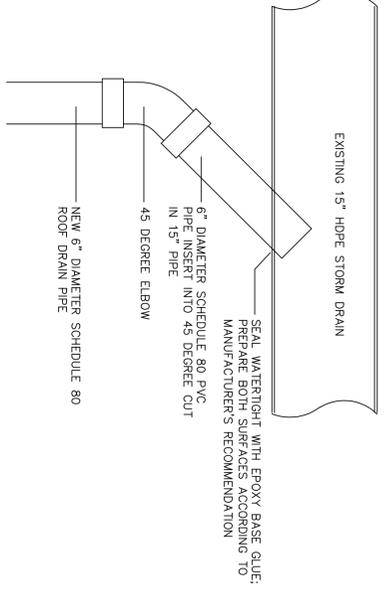

3 DOWNSPOUT CONNECTION DETAIL
SCALE 1" = 1'-0"

1 STORMWATER PLAN
SCALE 1/8" = 1'-0"

Steve Krone AIA
architect
AR 0005770
steve@kronearchitect.com
(407) 461-0406

ADDITIONS TO HORSE ARENA
HORSE ARENA-OKEECHOBEE AGRI-CIVIC CENTER
Okeechobee County, Florida

1.24.18 ADVERTISE FOR BIDS

A-3.2
STORMWATER
MANAGEMENT

The data, information, and concepts in this document incorporate copyright and property rights of Steve Krone AIA architect. Any party accepting this document does so in confidence and agrees that it shall not be duplicated in whole or in part without the written permission of Steve Krone AIA architect.

REVISED 2.15.18

Seal