





63 Blair Avenue  
 CAMDENTON, MO 65020  
 TEL: 573.346.5316  
 krehbiel.darren@gmail.com

MAINGUARD #77 BLOW-OFF HYDRANT OR APPROVED EQUAL SHALL BE SELF-DRAINING, NON-FREEZING TYPE WITH A 2" FIP VERTICAL INLET CONNECTION, A NON-TURNING OPERATING ROD AND SHALL OPEN TO THE LEFT. OUTLET SHALL BE 2-1/8" OR 2-1/2" NST WITH CAP AND EXTEND A MINIMUM OF 12" ABOVE THE GROUND.

HYDRANT SHALL BE SET IN 4 CUBIC FEET OF CRUSHED STONE TO ALLOW FOR PROPER DRAINAGE OF HYDRANT. RECOMMENDATION OF THE AWWA SHOULD BE FOLLOWED WHEN INSTALLING THE HYDRANT.

ITEM	ITEM / DESCRIPTION	NOTES
1	TOP CAP	
2	SLOTTED OPERATING NUT	
3	NST OUTLET	SHOWN WITH CAP
4	2" COUPLING	
5	2" STEEL PIPE	
6	INLET VALVE BODY	
7	LOCKING COVER	
8	DRAIN HOLE	
9	CRUSHED ROCK	BY OTHERS
10	2" STREET ELBOW	BY OTHERS

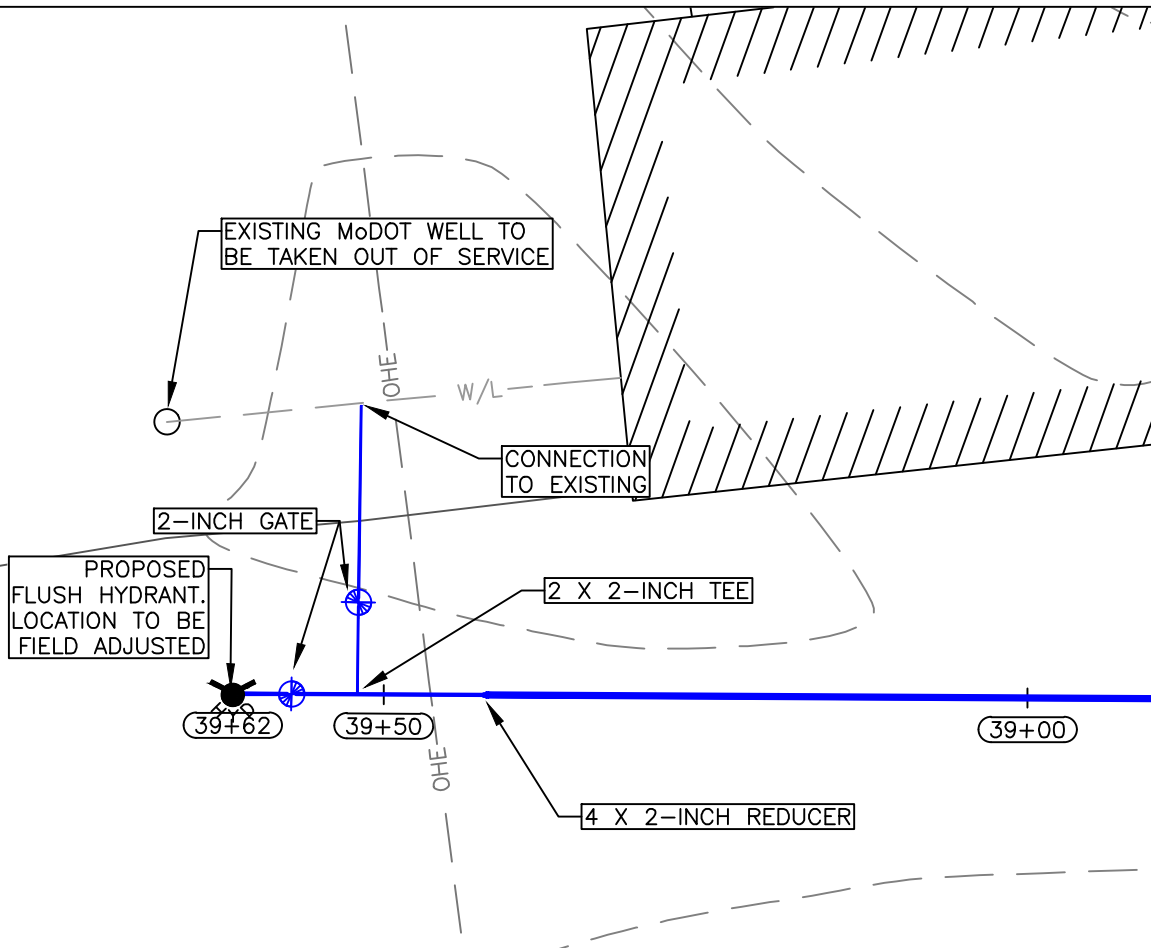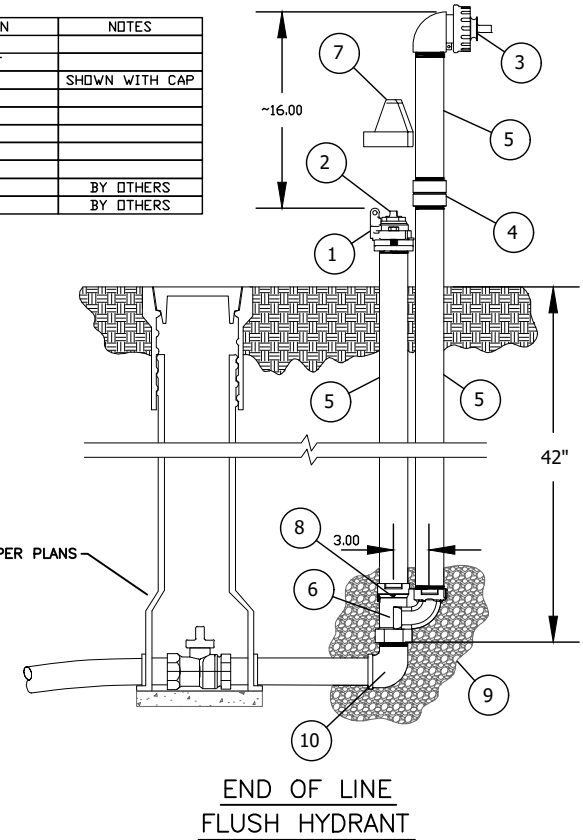

*[Handwritten Signature]*



2/28/2024

ADDENDUM NO. 3

Note: A FLUSH HYDRANT IS BEING ADDED TO THE PROJECT.