

1540
120/208
500KVA

938

WARNING
Compliant Electrical Equipment
High Voltage
Electric Shock
Can shock, burn,
or cause death.
STOP
Keep out
If open or disturbed,
energized and
may be live.





THREE PHASE
TRANSFORMER


HOWARD INDUSTRIES

LAUREL MS 39440
USA

READ INSTRUCTION HI 105 BEFORE OPERATING


KVA 500
HV 12470 GRDY / 7200
WT TANK 1531 C&C 1774 OIL
LB

BIL HV 95 LV 30KV 2%IMP
LV 208Y/120 AMPS 1388
1913 LBS TOTAL 5218 LBS
255 GAL
CONT 65 °C RISE CLASS OA 60HZ
TANK DESIGNED FOR +7 PSIG

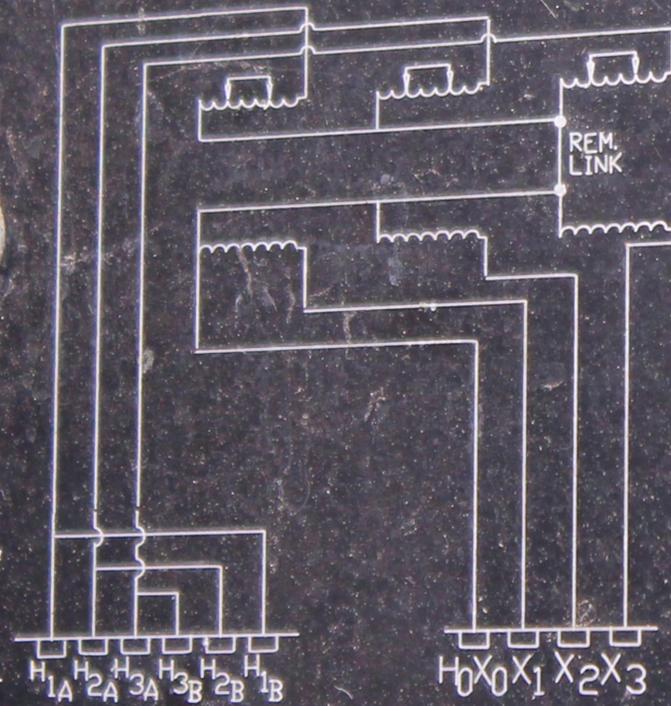

NON PCB

VOLTAGE	POS	AMPS
13090	1/A	22.05
12780	2/B	22.58
12470	3/C	23.15
12160	4/D	23.74
11850	5/E	24.37

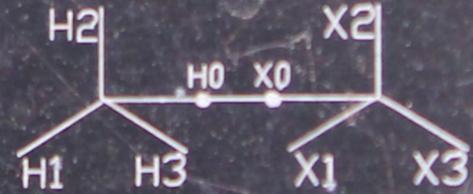

9185435209022

SER. NO 4176565097

1540
120/208
500KVA

938

WARNING
High Voltage Equipment
Do Not Touch
Do Not Open
Do Not Enter
STOP



DE-ENERGIZE TRANSFORMER
BEFORE OPERATING SWITCH



H1A

H1B


H2A


H2B

H3A

H3B

Ho Xo

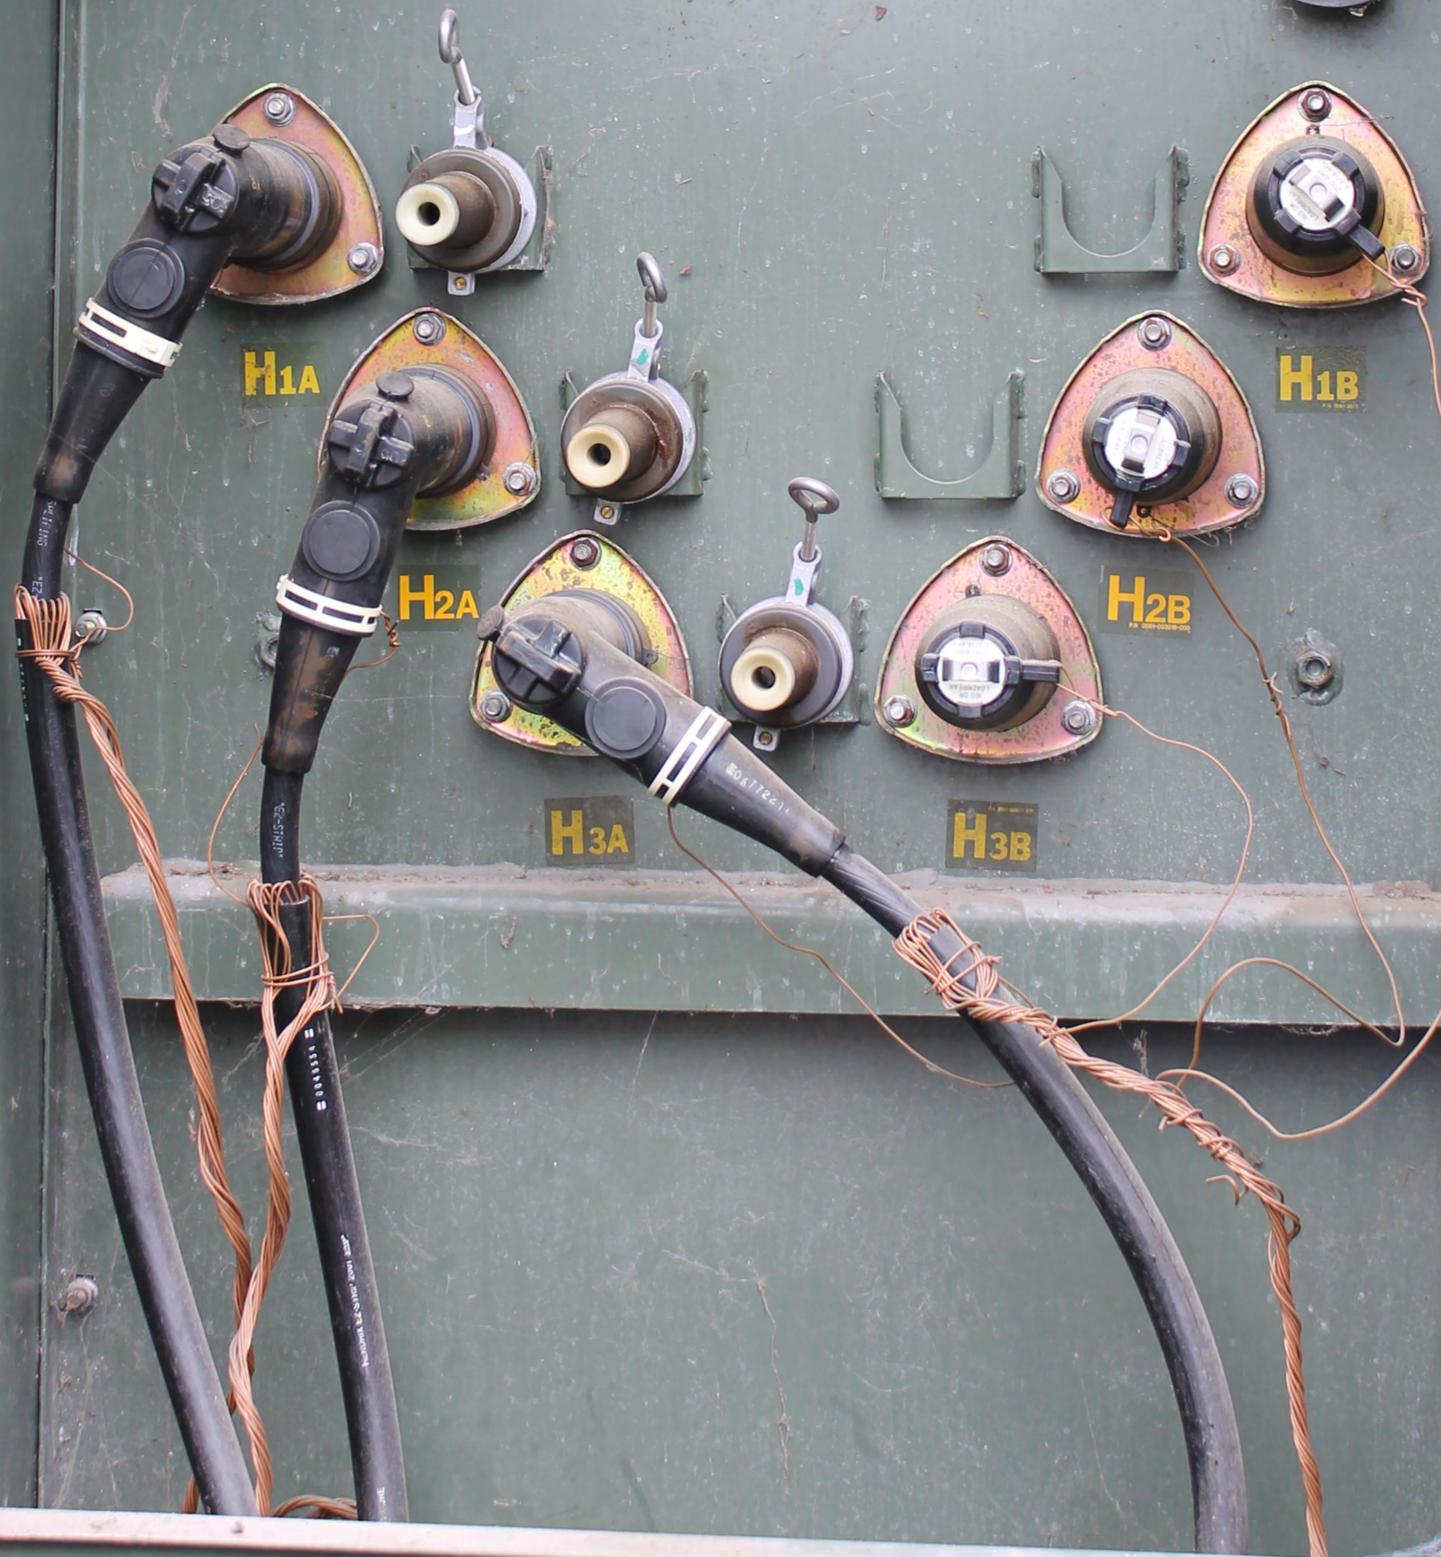

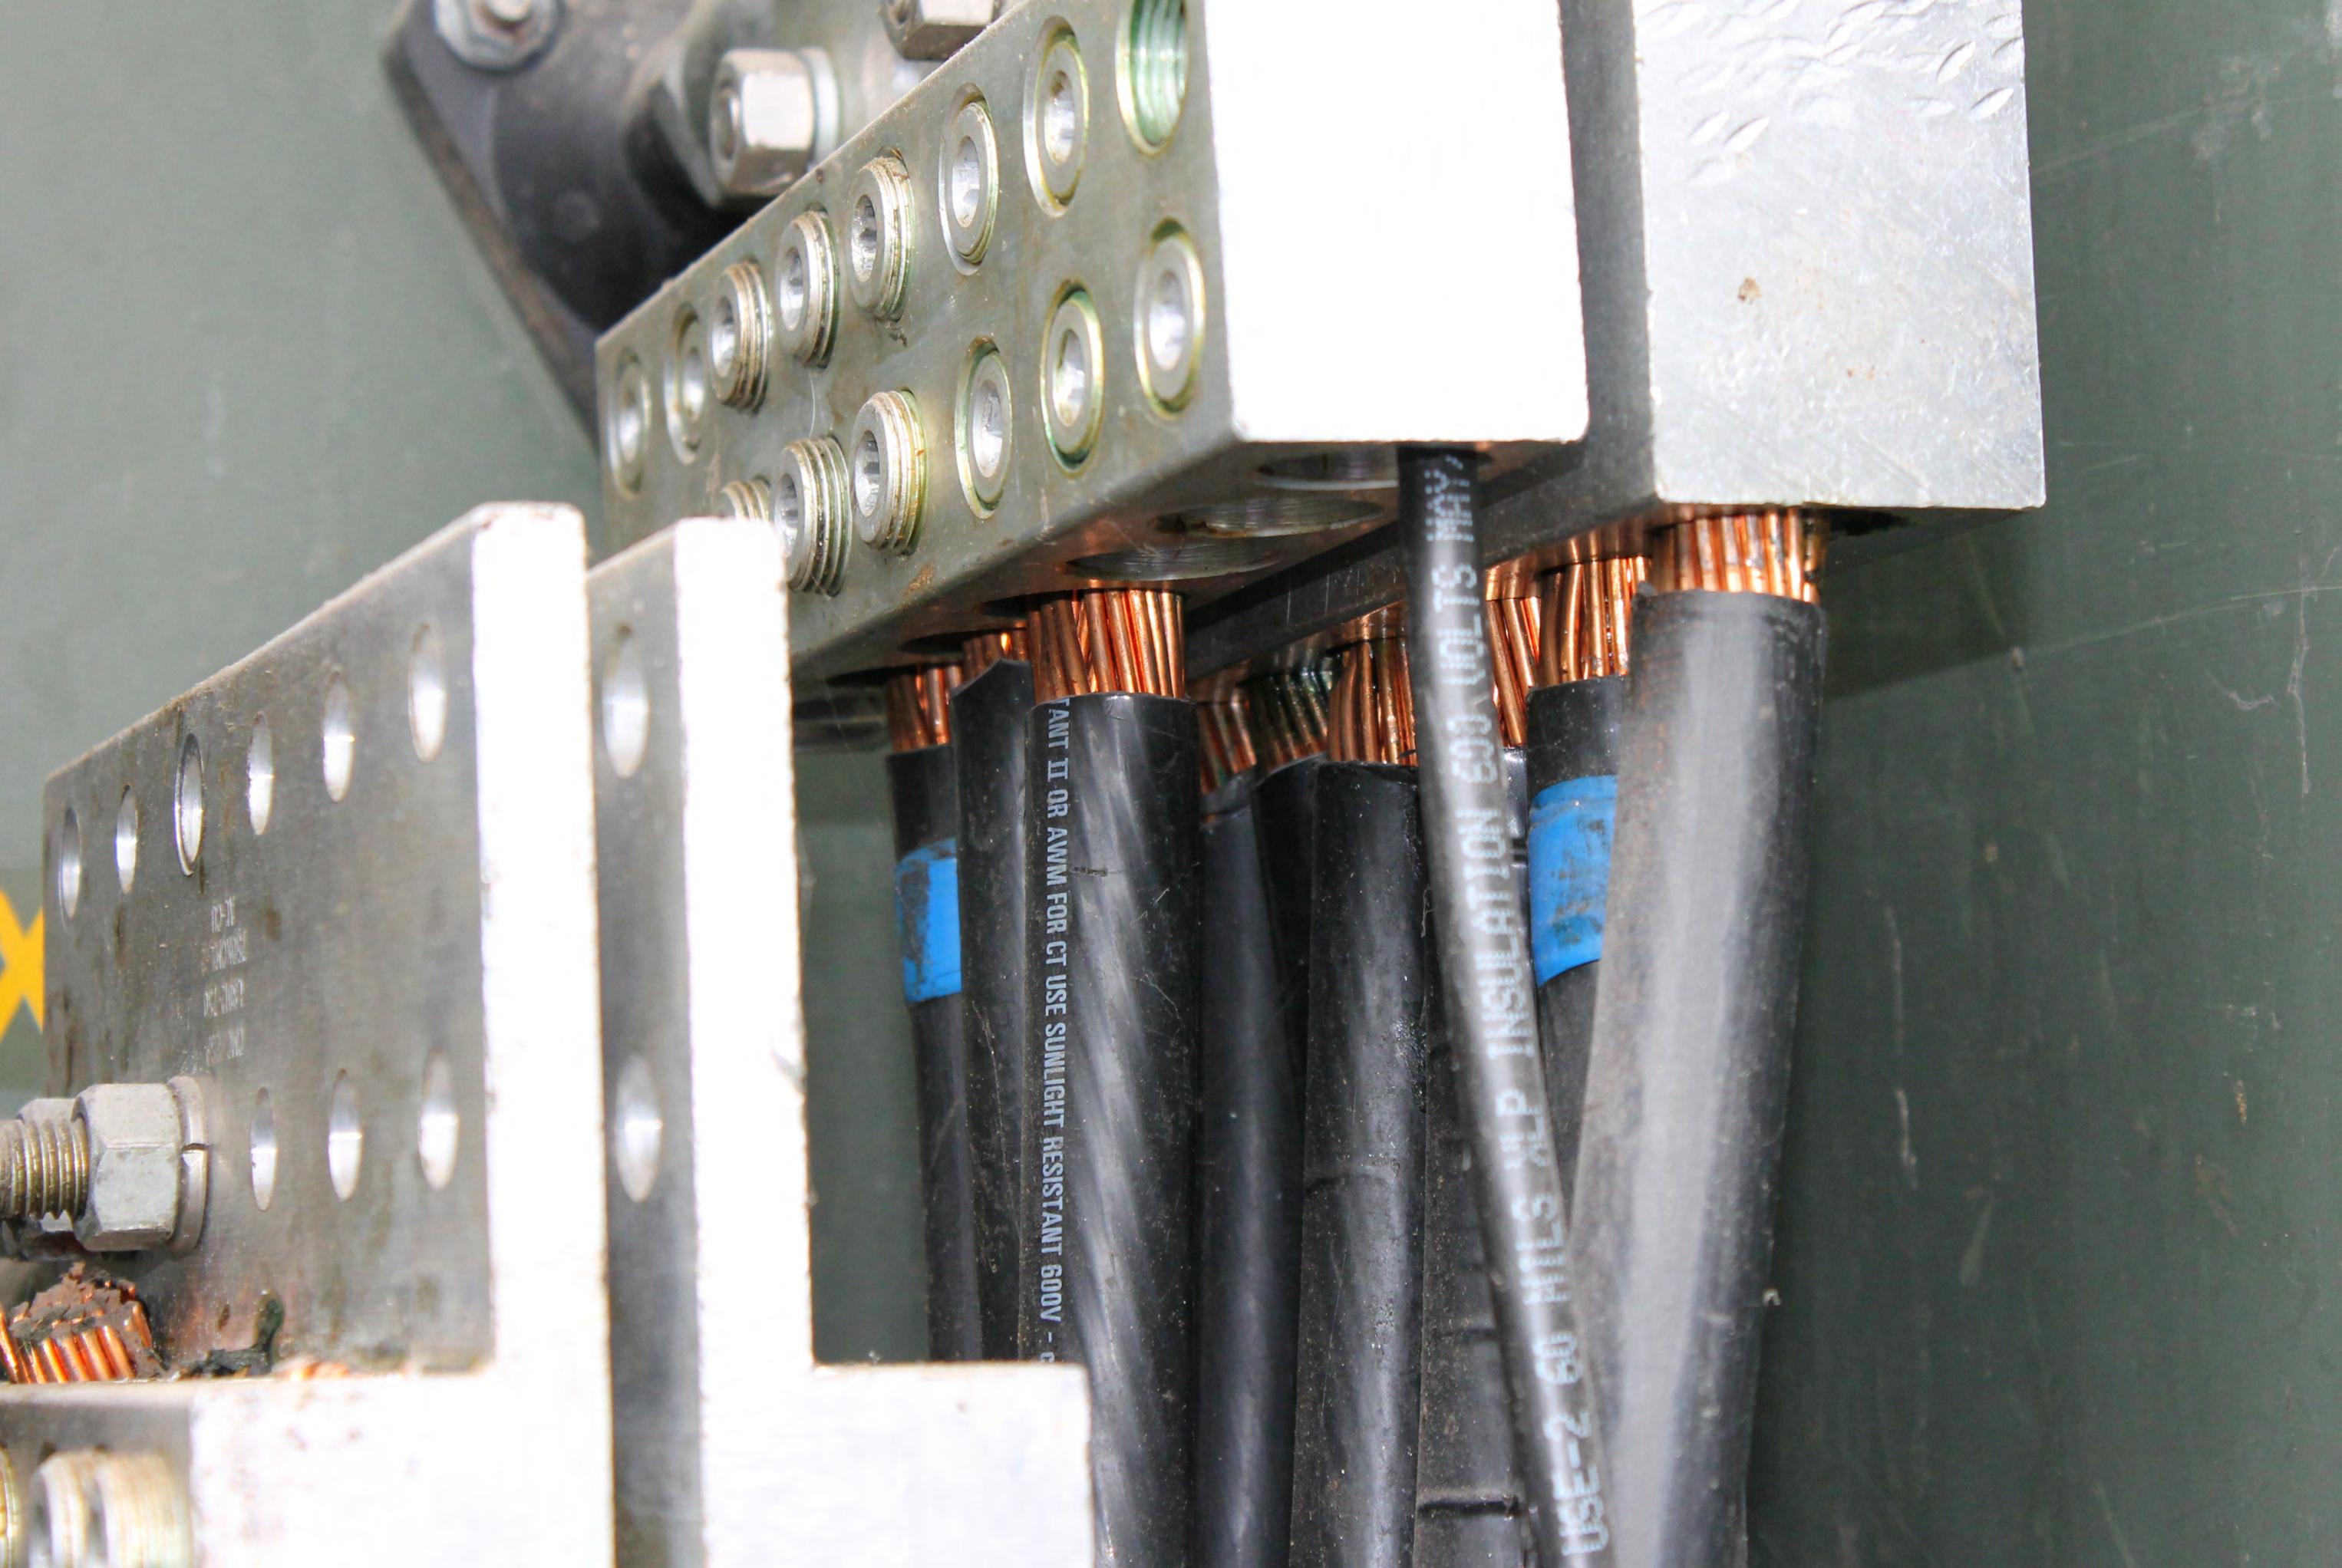

IMPORTANT II - OR AWM FOR CT USE SUNLIGHT RESISTANT 600V -

600V INSULATION
USE-2-60



100V SUNLIGHT RESISTANT FOR GI USE

2

LIGHT RESISTANT FOR CT USE

RESISTANT TO 600V SU
RESISTANT TO GASOLINE AND OIL RESISTANT
UL E14656B (UL)

