


- NOTES:
1. WRITTEN AUTHORIZATION FROM BUWSA IS REQUIRED FOR LESS THAN 18" SEPARATION.
 2. NORMAL JOINT RESTRAINT IS REQUIRED.

**PRESSURE PIPE UNDER WET UTILITY
FOR FINAL DEPTH 5' OR GREATER**

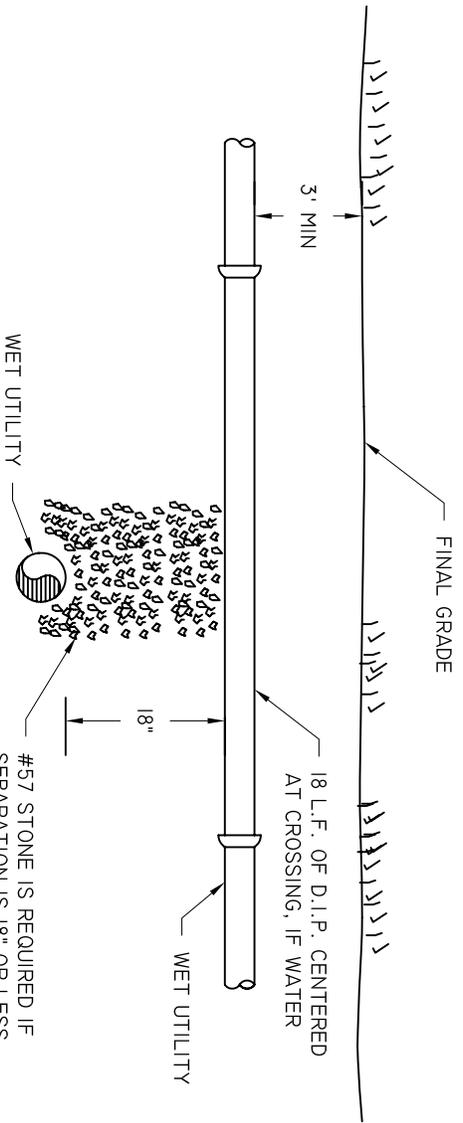

WET UTILITY CROSSING

BEAUFORT - JASPER WATER & SEWER AUTHORITY		
WET UTILITY CROSSING		
DATE 07/01/09	DRAWN BY BMC	DRAWING # G-16
SCALE N.T.S.	APPROVED BY ERS	