


**FACILITY INDEX:**

- 01 NEW MAINTENANCE BUILDING - NMB
- 02 FOUR MILE RUN LIFT STATION - FMRLS
- 03 POTOMAC INTERCEPTOR BACKUP STRUCTURE - PIBS
- PTB BYPASS FLOW DISTRIBUTION STRUCTURE - PBFDS
- 04 DISSOLVED AIR FLOTATION THICKENER BUILDING - DAFT
- 05 PRIMARY GRAVITY THICKENER BUILDING - PGTB
- 06 SLUDGE STORAGE TANKS - SST
- 07 BIOLOGICAL SOLIDS PROCESSING BUILDING - BIO
- HOUSEHOLD HAZARDOUS MATERIAL DROP OFF - HHM
- 08 DEWATERING BUILDING - DWB
- 09 PRELIMINARY TREATMENT BUILDING - PTB
- 10 PRIMARY CLARIFIERS - PCL1 thru PCL10
- 11 FLOW EQUALIZATION TANKS - FEQ1 thru FEQ3
- 12 OPERATIONS CONTROL BUILDING - OCB
- 13 SECONDARY BLOWER BUILDING - SBB
- 14 SECONDARY AERATION TANKS - SAT
- 15 SECONDARY CLARIFIERS - SCL1 thru SCL9
- 16 SECONDARY SERVICES PUMP STATIONS - SPSB
- 17 WEST SECONDARY PUMP SERVICES BUILDING - WSPSB
- 18 WEST MIXED LIQUOR FLOW DISTRIBUTION STRUCTURES - WMLFDS
- 19 WET WEATHER FILTRATION FACILITY - WWFF (AGFB)
- 20 FILTRATION AND DISINFECTION FACILITY - FADF, CCT1, CCT2
- 21 ADVANCED BACKWASH BUILDING - ABWB
- 22 PLANT EFFLUENT WATER FACILITY - PEWF (ACDB)
- 23 CHLORINE CONTACT TANKS - CCT3, CCT4
- 24 POST AERATION FACILITY - PAF (ACDB)
- 25 METHANOL FEED FACILITY - MFF
- 26 NORTH FERRIC FACILITY - NFF
- 27 SOUTH FERRIC FACILITY - SFF
- 28 DISTRIBUTION CENTER BUILDINGS - DCB1, DCB5,
- 29 STANDBY GENERATOR FACILITY - SGF
- 30 PRIMARY EFFLUENT FLUME
- 31 POTOMAC YARD PUMP STATION - PYPS
- 32 EAST MIXED LIQUOR FLOW DISTRIBUTION STRUCTURE - EMLFDS
- 33 FOAM COLLECTION PUMP STATION - FCPS
- 34 SURFACE WASTE PUMP STATION - SWPS
- 35 SODIUM HYPOCHLORITE FACILITY - SHF
- 36 RECYCLE INTERCEPTOR PUMP STATION - RIPS
- 37 ACTIVATED SLUDGE EFFLUENT PUMP STATION1 - ASE1
- 38 ACTIVATED SLUDGE EFFLUENT PUMP STATION2 - ASE2
- 39 WEST FERRIC FACILITY - WFF
- 40 FLOW EQUILIZATION PUMP STATION
- 41 ASE1 METER VAULT
- 42 SOUTH TUNNEL ACCESS BUILDING - STAB
- 43 LOW LEVEL PUMP STATION - LLPS
- 44 SECONDARY AERATION TANK PIPE GALLERY - SATPG

User: hahamed; Sheet: 0001; Date: 11/17/2009; Time: 12:54; Logon: 000-11

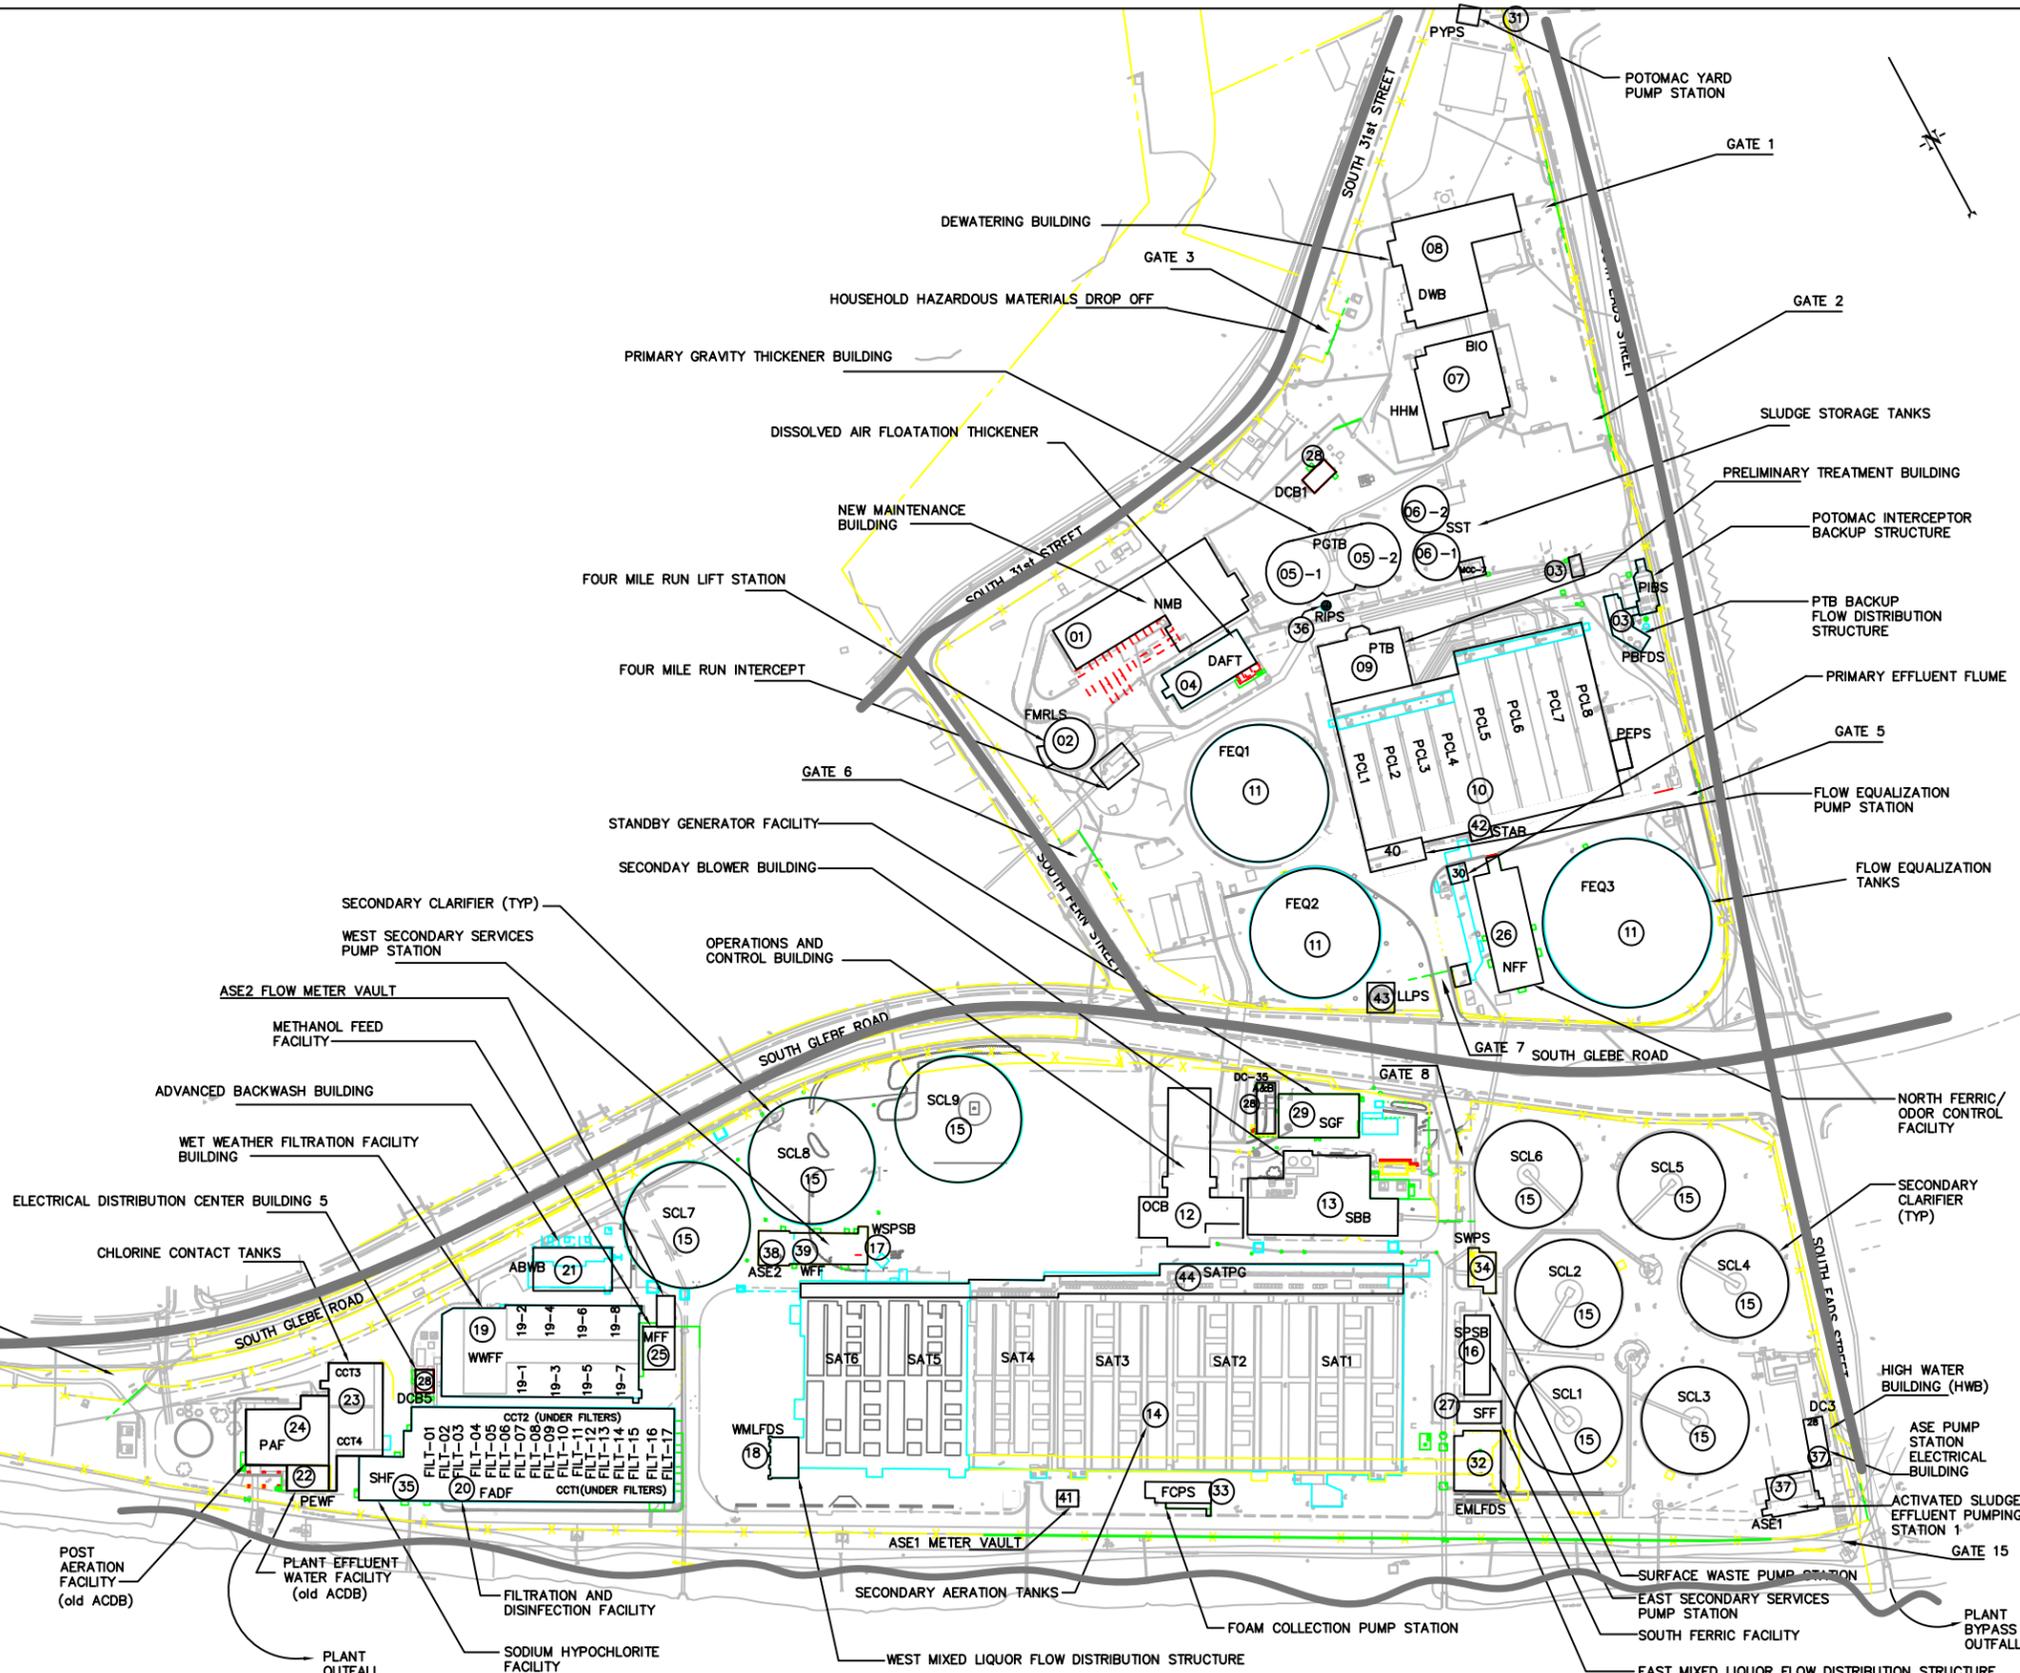

FOUR MILE RUN

DESIGNED	DSBY		
DRAWN	DRBY		
CHECKED	CHKBY		
PROJENGR.	PROJENG		
CAD REF. NO.	###		
APPROVED			

HORIZONTAL DATUM IS REFERENCED TO VIRGINIA STATE GRID, NORTH AMERICAN DATUM 1983 (NAD 83)

VERTICAL DATUM IS REFERENCED TO NATIONAL GEODETIC VERTICAL DATUM OF 1929 (NGVD 29)



**ARLINGTON COUNTY  
WATER POLLUTION CONTROL PLANT  
FACILITY MAP**

NOTES:  
PLANT ACRONYMS ARE FOUND IN MP2 EQUIPMENT TAG NUMBERS

THE SCALE BAR SHOWN BELOW MEASURES ONE INCH LONG ON THE ORIGINAL DRAWING.

DATE: DECEMBER 2005  
DRAWING NUMBER  
**DWG**  
SHEET NO. OF