

**BROADWAY AT THE BEACH PUMP  
STATION REHABILITATION**

DDC Engineers

From: Eric K. Sanford, P.E.

Project No. 19083E

**ADDENDUM NO. 2 - May 18, 2022**

This Addendum forms a part of the Bidding Documents and modifies the original Bidding Documents, dated April 2022, Bid Date Tuesday, May 31, 2022 at 10:00am.

Acknowledge receipt of this Addendum in the space provided on the PROPOSAL. Failure to do so may subject Bidder to disqualification.

The following items clarify, modify, change, delete from or add to the Bidding Documents. When any paragraph, subparagraph, or sub-subparagraph, thereof is modified or deleted by this Addendum, the unaltered provisions of that paragraph, subparagraph, or sub-subparagraph shall remain in effect. When any portion of a drawing is modified or deleted, the unaltered provisions of that drawing shall remain in effect.

1. Is there an electrical schematic or panel drawing available?

**Response: Please see attached photos. The cabinet has caught fire in the past and the schematics have been damaged.**

2. If Thompson Pump can meet the requirements, could they be used as an alternate?


**Response: Yes, Thompson Pump can be used as an alternate.**


3. Please confirm that the City will furnish and install the communication system for monitoring the wet well.

**Response: The contractor will supply the Omni site SCADA system and give it to the City for installation.**

4. Due to the current lead times on the pumps and control panel, is the 180 days flexible?

**Response: Yes, the 180 days is flexible. We understand that there may be some supply chain issues on various equipment and other materials. We will review delivery dates on those materials after the submittals are approved and adjust as needed.**

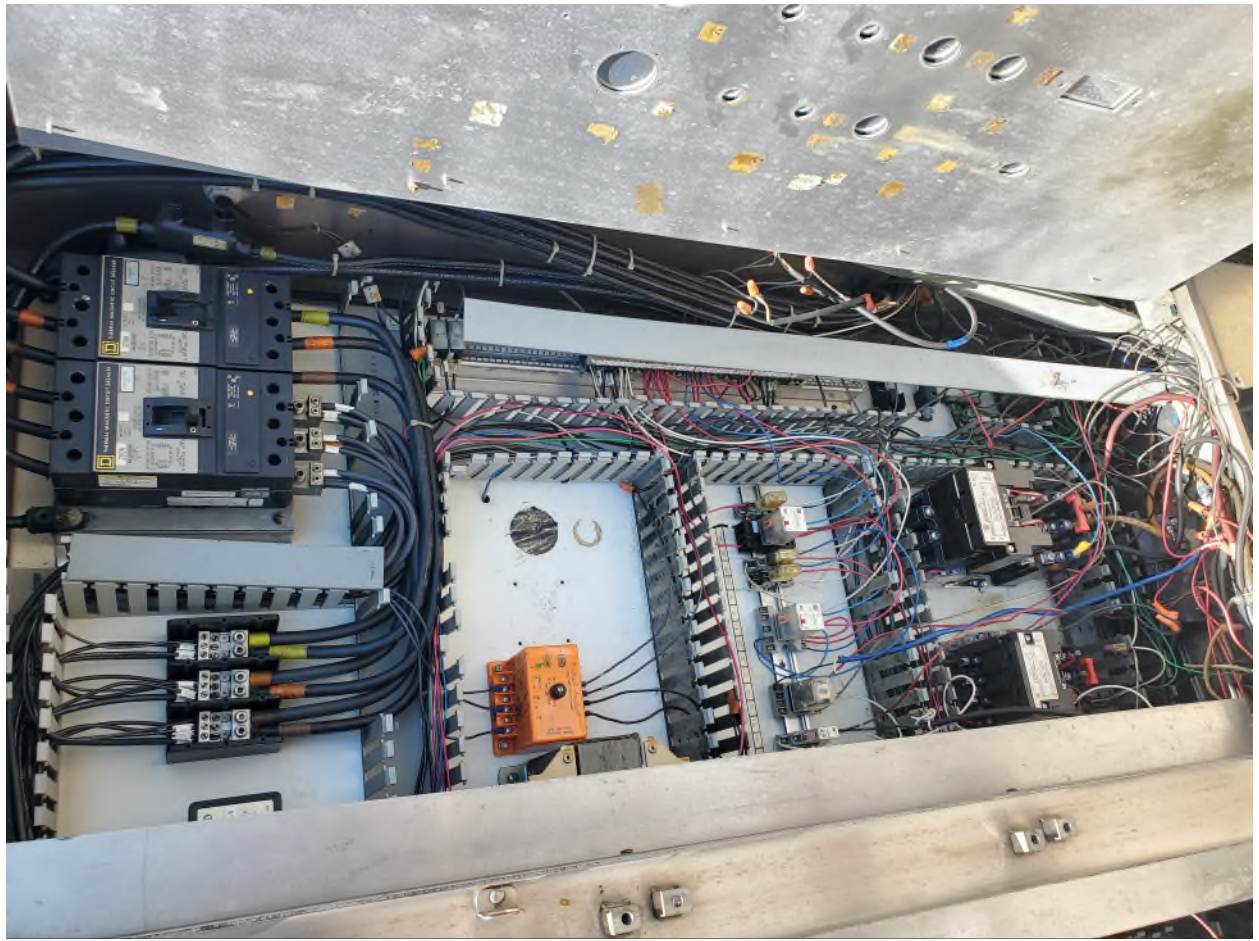

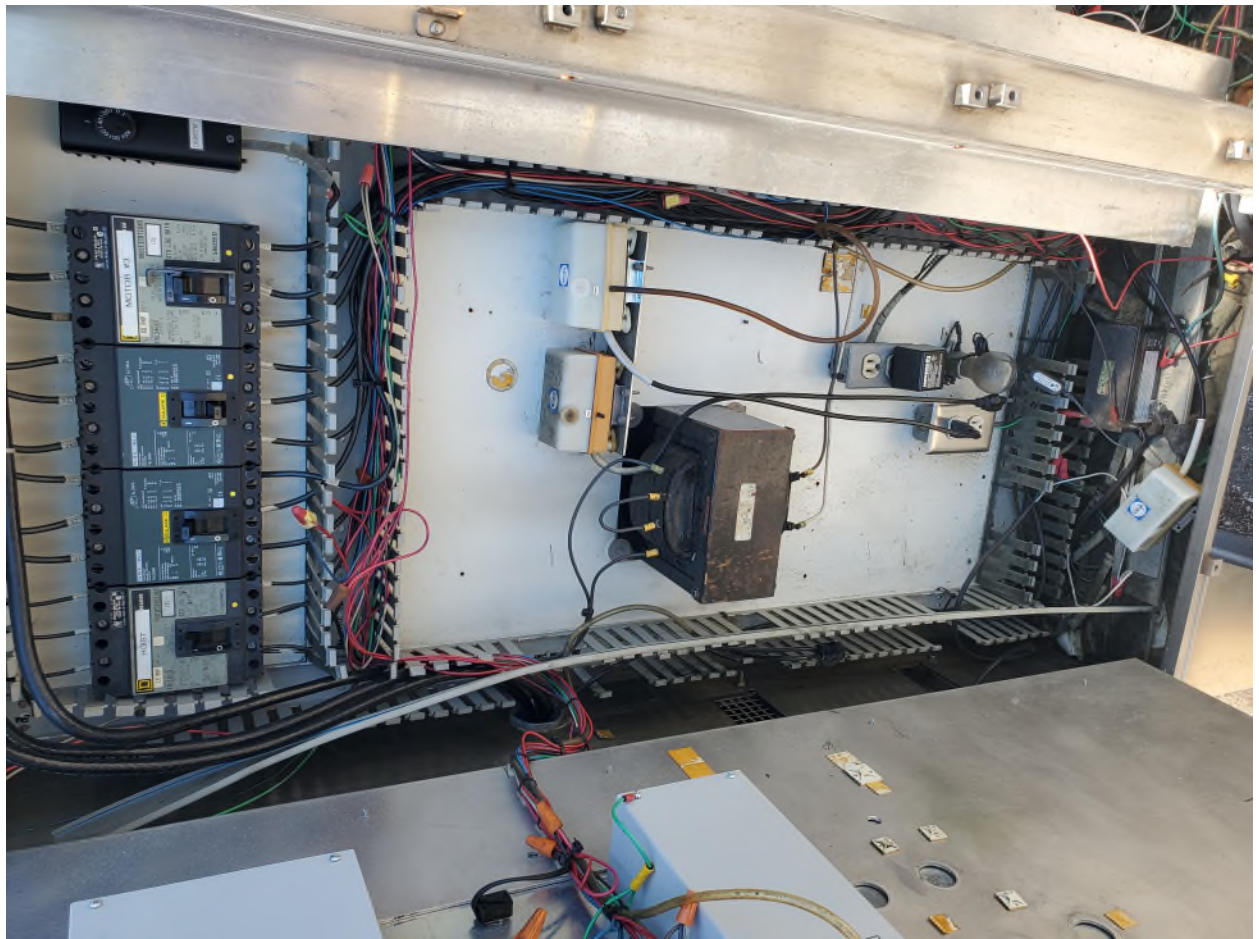



END OF ADDENDUM #2