

**PURCHASING
AND MATERIALS
MANAGEMENT**



(843) 918-2170
FAX: (843) 918-2182
www.cityofmyrtlebeach.com

City of Myrtle Beach
SOUTH CAROLINA

Addendum #01
November 30, 2023
IFB 24-B0023
TPI Altitude Valve Replacement

The purpose of this Addendum #01 to IFB 24-B0023 for TPI Altitude Valve Replacement dated November 30, 2023, is to list the key points of discussion from the informational pre-bid meeting and to provide the pre-bid meeting sign-in sheet as well as the drawings that are attached to and hereby made a part of this addendum.

- This is a 30 day project.
- All bolts, nuts, and rods are to be 316 stainless steel
- All parts and equipment removed from the project shall become the property of the Contractor.
- The City will provide the OS&Y gate valves.
- This project requires four (4) channels in the RAFFA box; PSI, temperature, turbidity, and residual.
- Gaskets may need to be replaced once pipes are removed. The Contractor shall contact the City immediately upon inspection for assessment. The Contractor shall only replace the gaskets after prior authorization from the City.

All questions must be submitted, in writing, to the Buyer no later than 5:00p.m. on Friday, December 8, 2023.

All bid submissions must be received by the Procurement Office prior to 2:00p.m. on Thursday, December 14, 2023. No electronic bid submissions will be accepted.

Thank you,

City of Myrtle Beach
Brandon Hancock/Procurement Office/Buyer
Email: bhancock@cityofmyrtlebeach.com
843-918-2173

OPTIONAL PRE-BID MEETING: Wednesday, November 29, 2023 @ 1:30p.m.

BID: IFB 24-B0023 – TPI Altitude Valve Replacement

BID OPENING: Thursday, December 14, 2023 @ 2:00p.m.

Please sign in:


1) The Gale Force Christian Brown
Company Name Representative Name (Print)
843-902-2578 Chit B
Phone Signature
cbrown@the-gale-force-group.com
Email Address

2) PRESTIGE World Wide Paul Denson Jr
Company Name Representative Name (Print)
704-467-9606 Paul D Denson Jr
Phone Signature
Paul@PRESTIGE WWT.COM
Email Address

3) _____
Company Name Representative Name (Print)


Phone Signature

Email Address

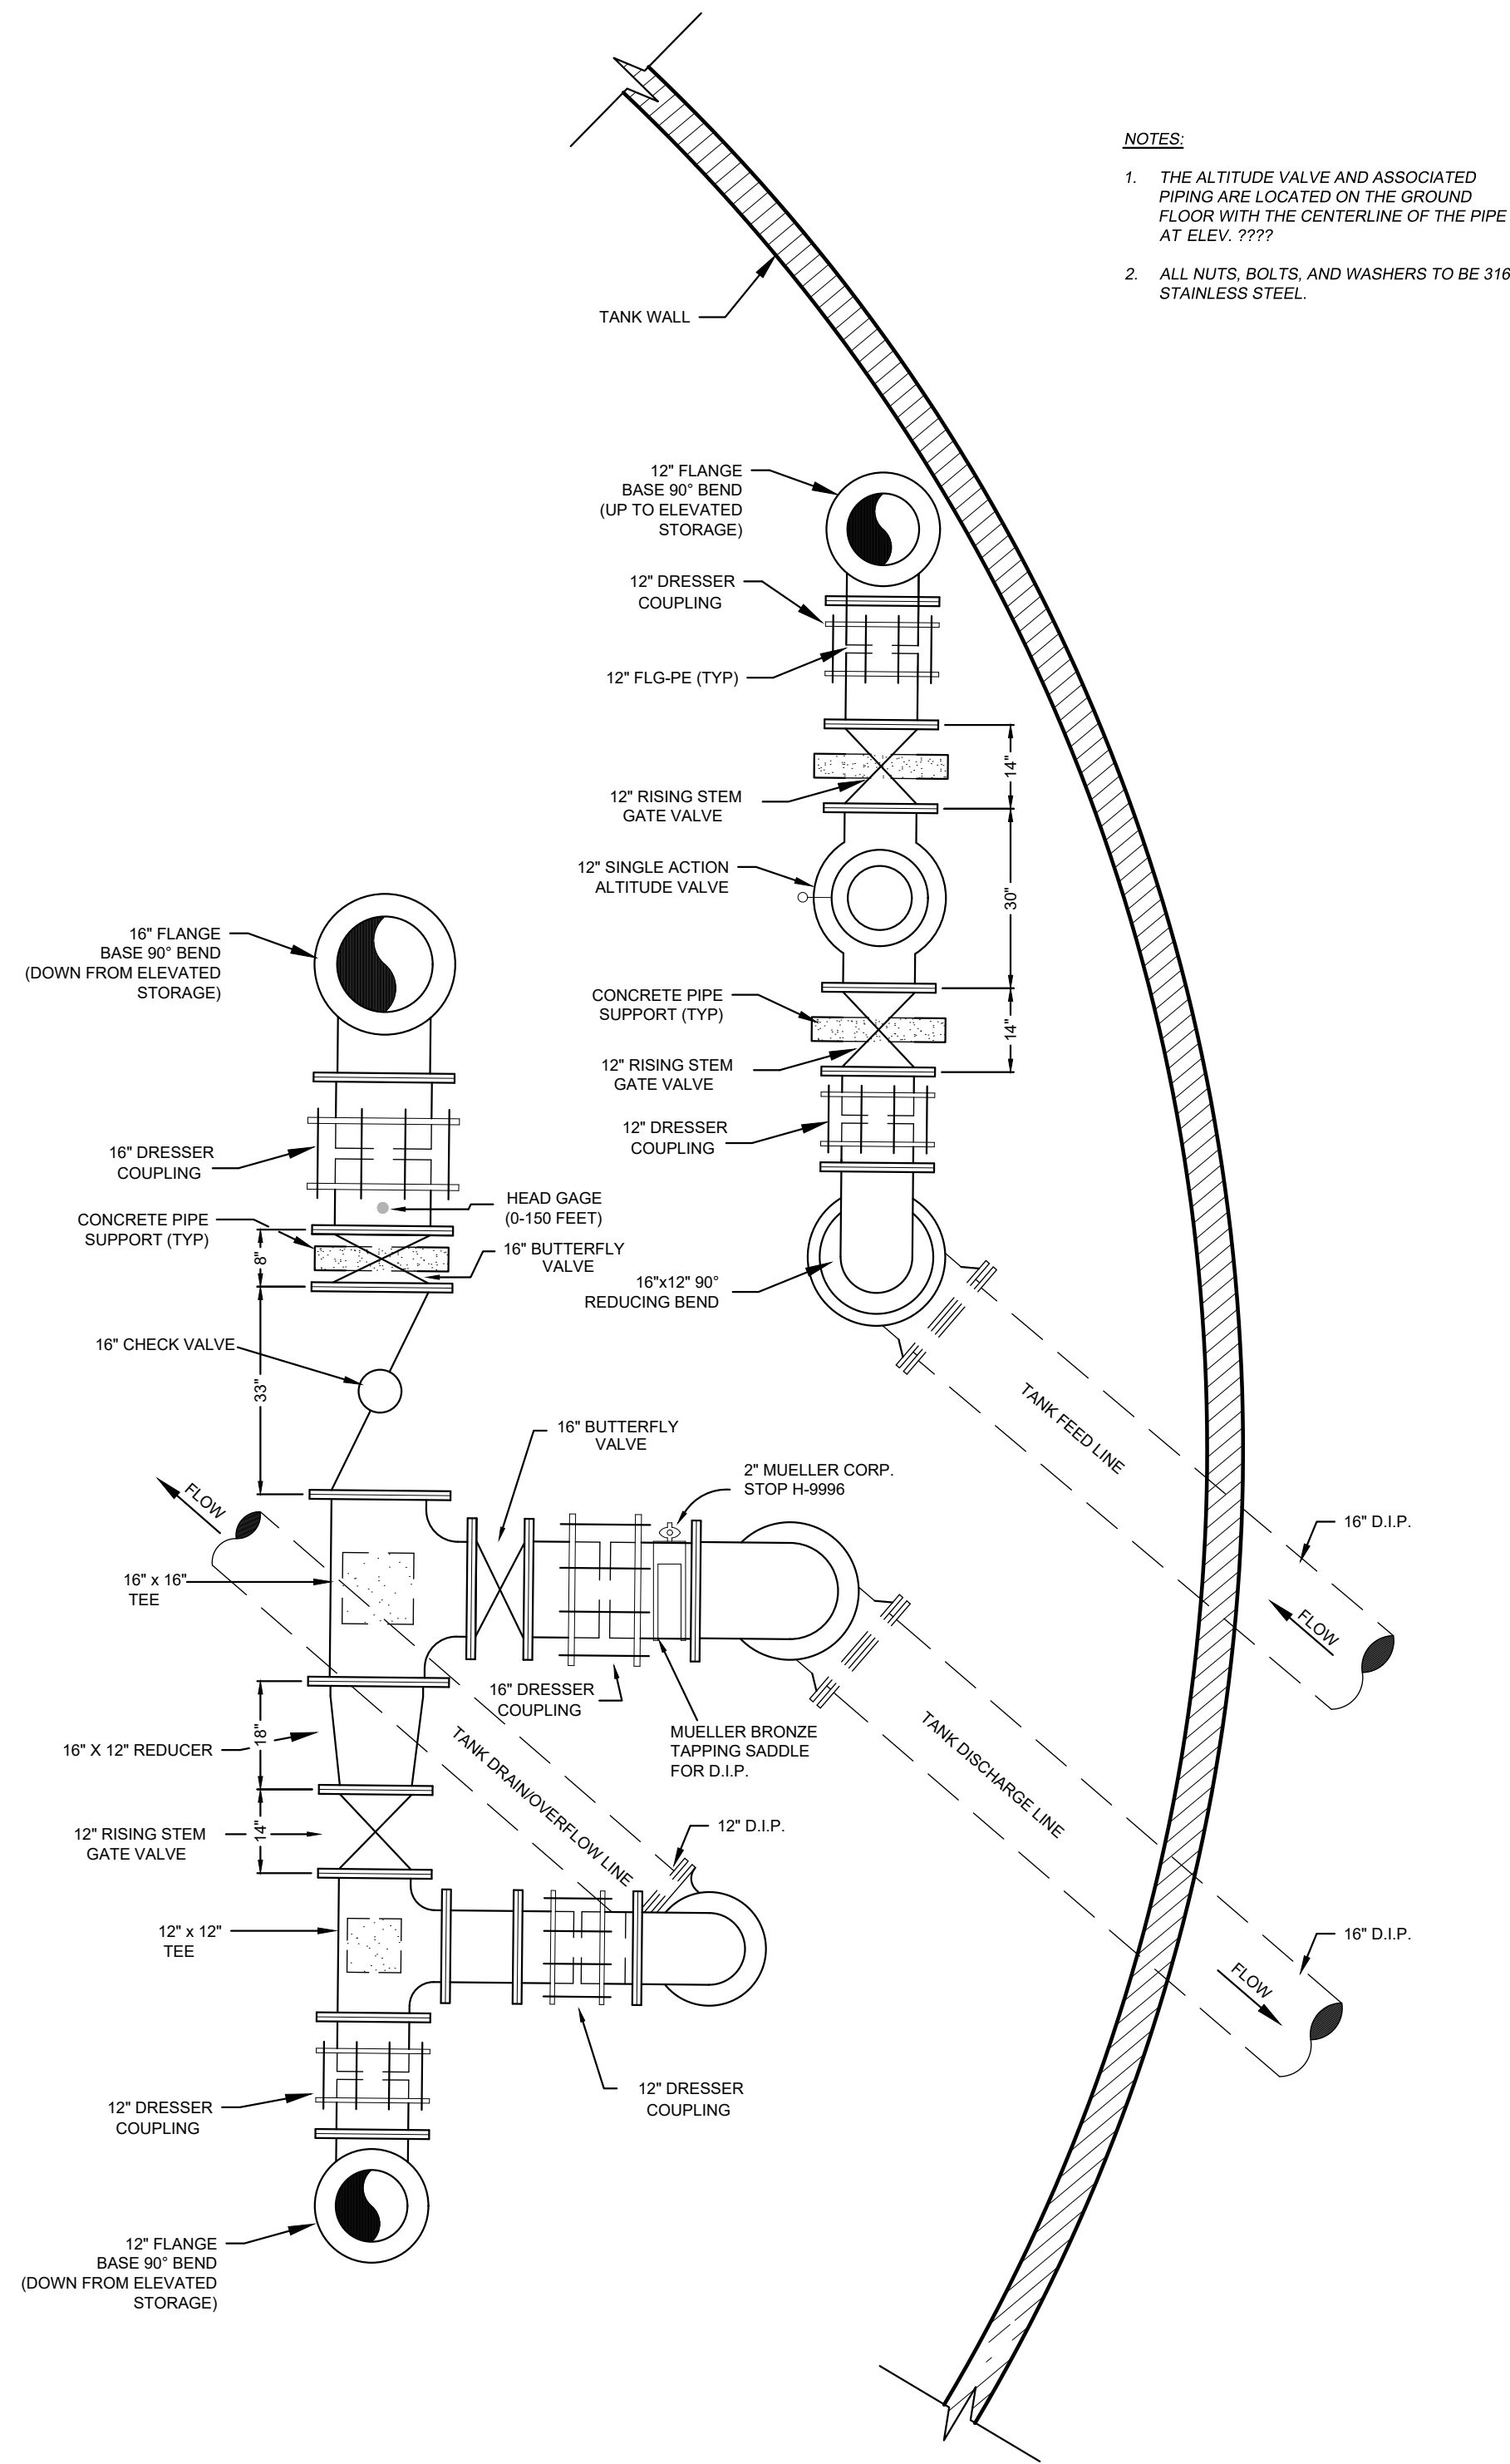

- NOTES:**
1. THE ALTITUDE VALVE AND ASSOCIATED PIPING ARE LOCATED ON THE GROUND FLOOR WITH THE CENTERLINE OF THE PIPE AT ELEV. 7.777
 2. ALL NUTS, BOLTS, AND WASHERS TO BE 316 STAINLESS STEEL.



PLAN VIEW
EXISTING CONDITIONS
SCALE: N.T.S.

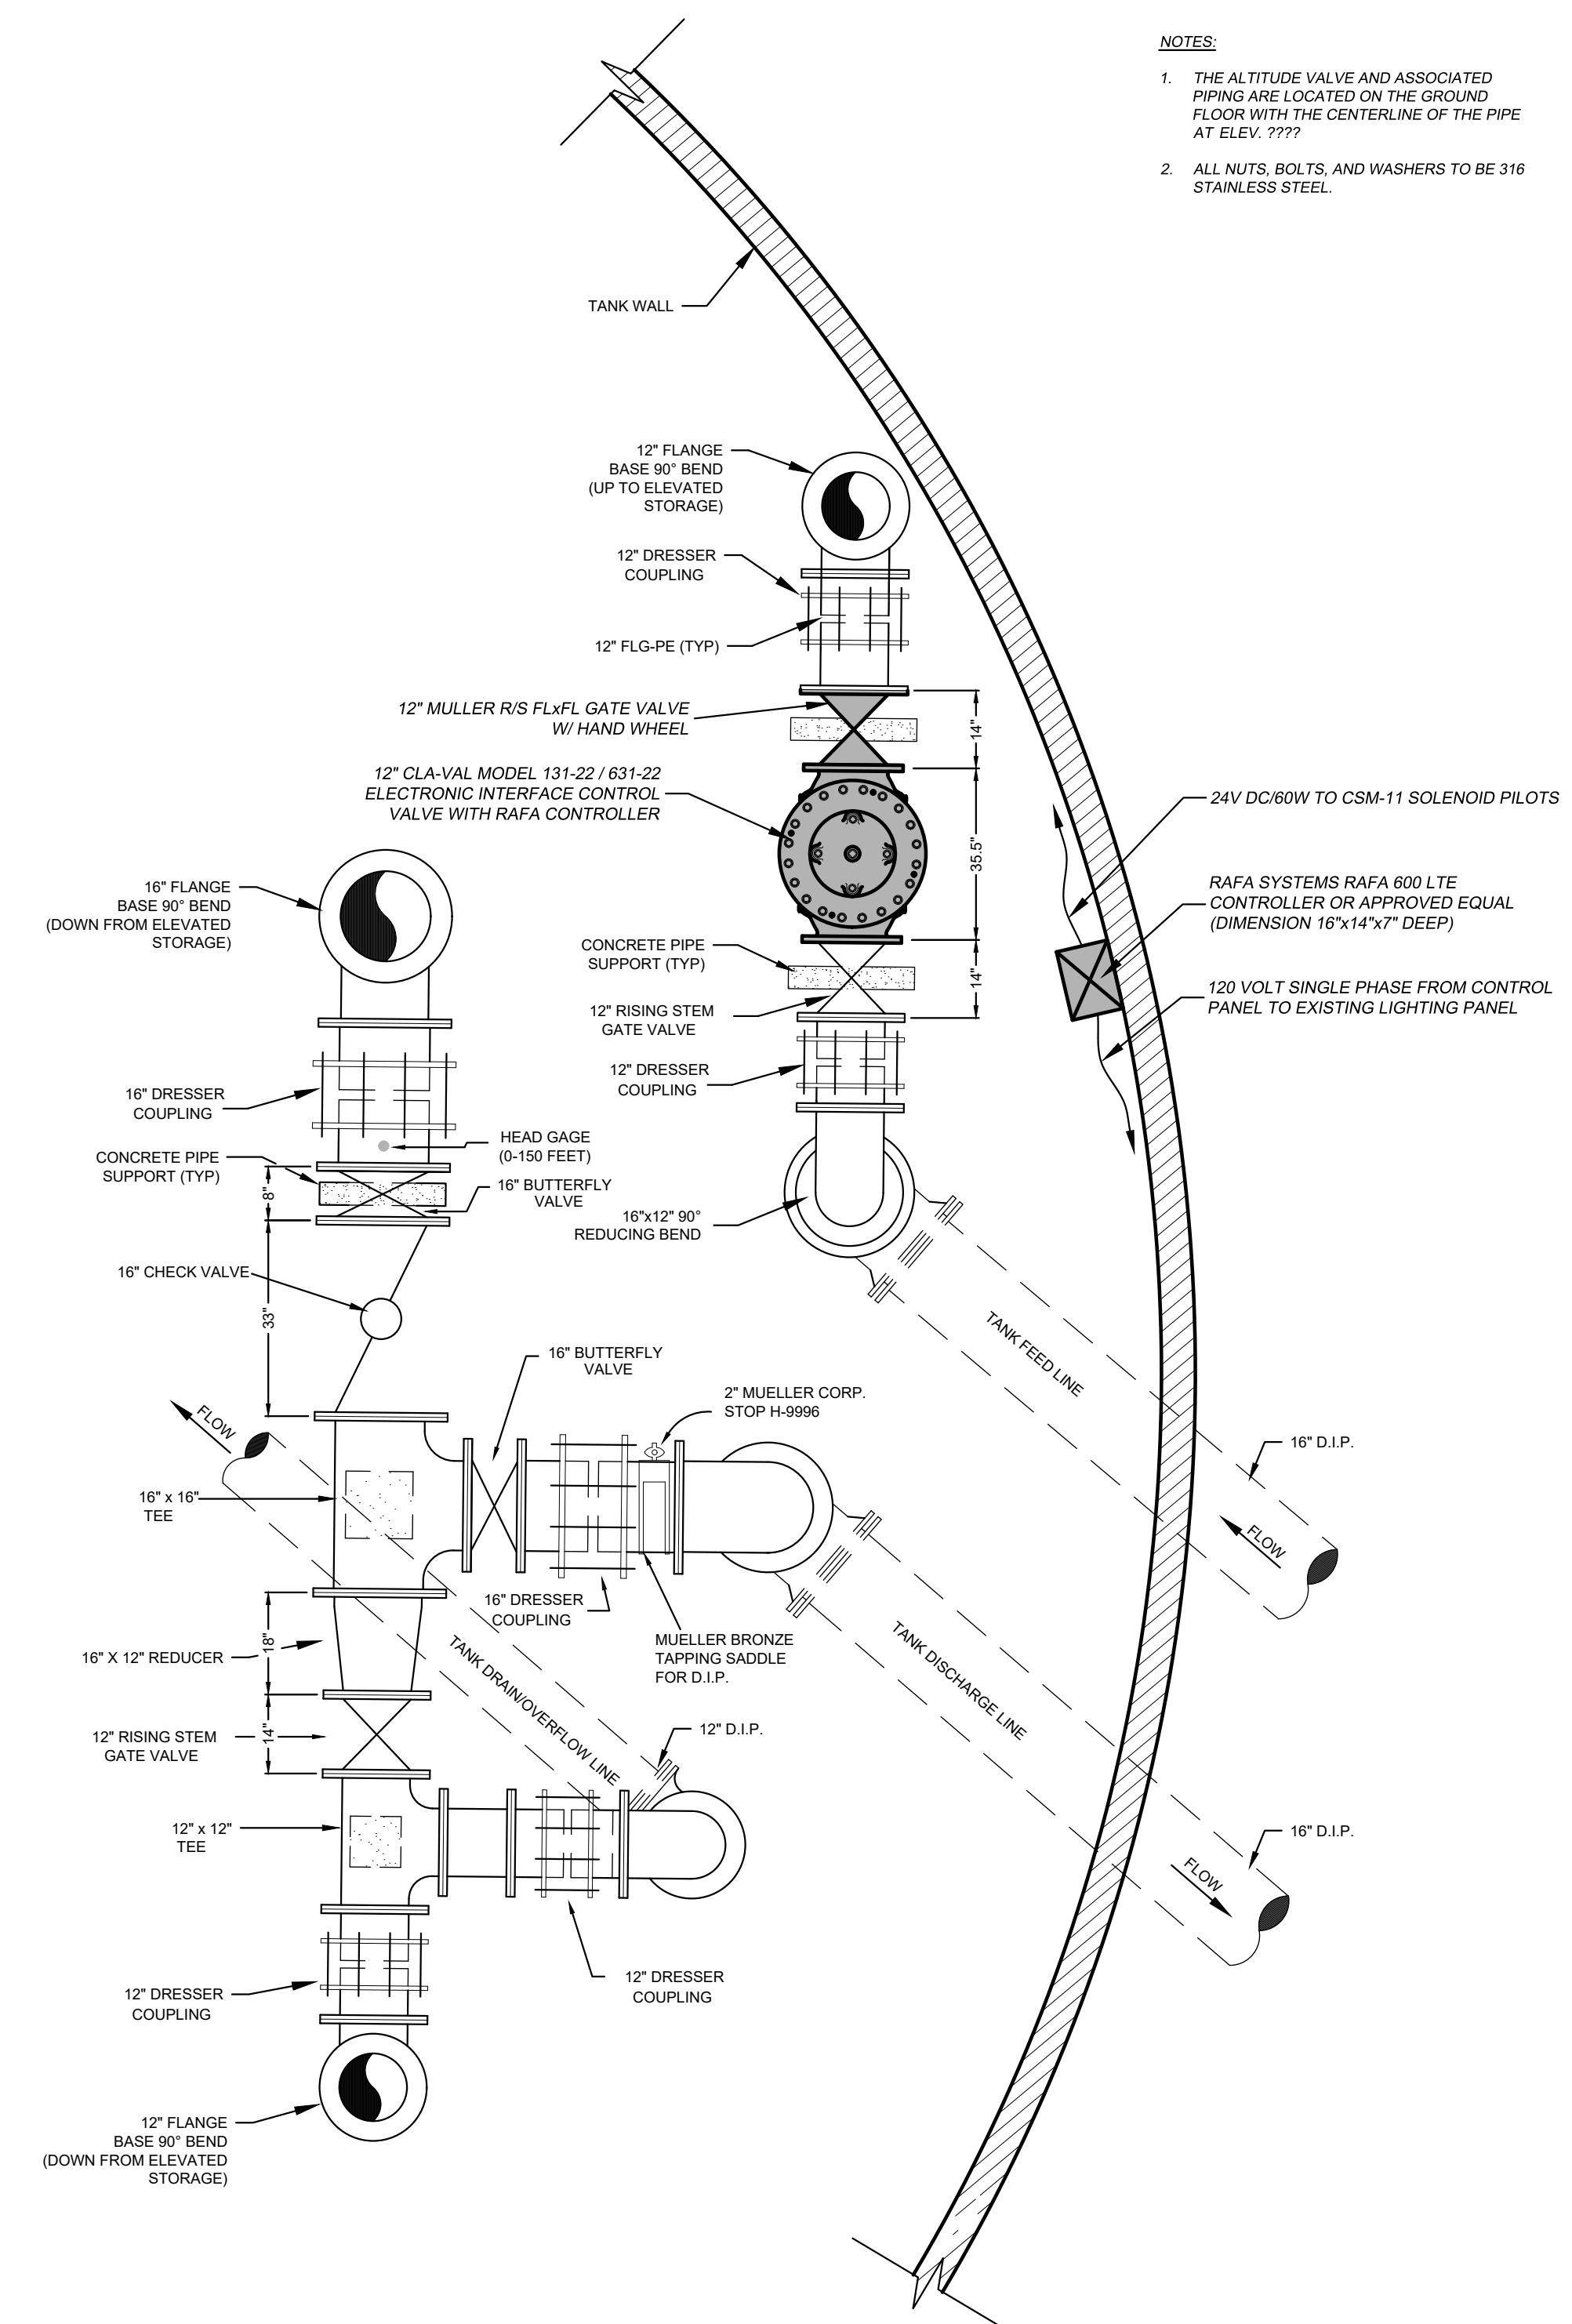

- NOTES:**
1. THE ALTITUDE VALVE AND ASSOCIATED PIPING ARE LOCATED ON THE GROUND FLOOR WITH THE CENTERLINE OF THE PIPE AT ELEV. 7.777
 2. ALL NUTS, BOLTS, AND WASHERS TO BE 316 STAINLESS STEEL.

PLAN VIEW
PROPOSED IMPROVEMENTS
SCALE: N.T.S.

© Bolton & Menk, Inc. 2023. All Rights Reserved

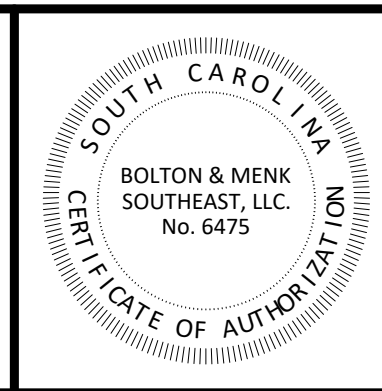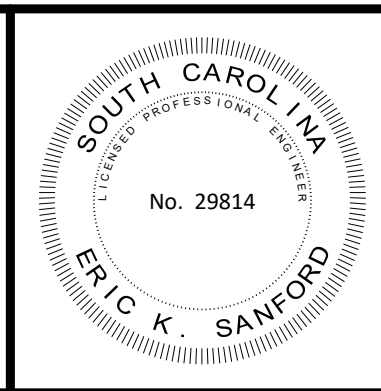

DDC Engineers
BOLTON & MENK, INC.
www.ddcinc.com

1298 PROFESSIONAL DRIVE
MYRTLE BEACH, SOUTH CAROLINA 29577
Phone: (843) 692-3200
Email: bmi@bolton-menk.com
www.bolton-menk.com

DATE	9/29/23				
SCALE	NO SCALE				
DESIGNED	EKS				
DRAWN	PES				
CHECKED	EKS				
CLIENT PROJ. NO.	23049E	NO.	DATE	REVISION DESCRIPTION	BY

CITY OF MYRTLE BEACH
CITY OF MYRTLE BEACH WATER TANK SCADA SYSTEM
Horry County, South Carolina

#1 - TPI TANK
ALTITUDE VALVE DETAIL

SHEET
C5.01