

# ROWLAND ELEMENTARY SCHOOL

1355 E. ROWLAND AVE. WEST COVINA, CA 91790

## COVID 19- COVINA VALLEY DISTRICT WIDE HVAC REPLACEMENT

### 100% CONSTRUCTION DOCUMENTS

11/08/2022

DLR GROUP PROJECT NUMBER: 75-22605-00

DSA APPLICATION #  
A# 03-122233

#### SHEET INDEX

GENERAL		ELECTRICAL	
G0.1	COVER SHEET	E0.1	ELECTRICAL SYMBOLS, ABBREVIATIONS & NOTES
G1.1	GENERAL NOTES, SYMBOLS AND ABBREVIATIONS	E2.1	ROOF ELECTRICAL PLAN
ARCHITECTURAL			
A1.1	ARCHITECTURAL SITE PLAN	E5.1	ELECTRICAL DIAGRAMS AND SCHEDULE
A1.1A	FLOOR PLANS	E6.1	ELECTRICAL DETAILS
A1.3A	ROOF PLANS	TOTAL: 31 SHEETS	
A3.1A	REFLECTED CEILING PLANS		
MECHANICAL			
M0.1	MECHANICAL SYMBOLS, ABBREVIATIONS & NOTES		
M0.2	TITLE 24 COMPLIANCE		
M0.3	TITLE 24 COMPLIANCE		
M0.4	TITLE 24 COMPLIANCE		
M0.5	TITLE 24 COMPLIANCE		
M0.6	TITLE 24 COMPLIANCE		
M0.7	TITLE 24 COMPLIANCE		
M1.1	MECHANICAL SITE PLAN		
MD1.1	MECHANICAL DEMOLITION PLANS		
MD1.2	MECHANICAL DEMOLITION PLANS		
M1.1A	MECHANICAL FLOOR PLANS		
M1.1B	MECHANICAL ROOF PLANS		
M5.1	CONTROLS DIAGRAMS		
M5.2	CONTROLS DIAGRAMS		
M7.1	MECHANICAL DETAILS		
M7.2	MECHANICAL DETAILS		
M7.3	MECHANICAL DETAILS		
M7.4	MECHANICAL DETAILS		
M7.5	MECHANICAL DETAILS		
M8.1	MECHANICAL SCHEDULES		
M8.1	MECHANICAL SCHEDULES		
MP1.1	MECHANICAL PLUMBING SITE PLAN		
MP1.1	MECHANICAL PLUMBING SITE PLAN		

#### Statement of General Conformance

FOR ARCHITECTS/ENGINEERS WHO UTILIZE PLANS, INCLUDING BUT NOT LIMITED TO SHOP DRAWINGS, PREPARED BY OTHER LICENSED DESIGN PROFESSIONALS AND/OR CONSULTANTS

(Application No. 03-122233 File No. 19-25)

HAVE BEEN PREPARED BY OTHER DESIGN PROFESSIONALS OR CONSULTANTS WHO ARE LICENSED AND/OR AUTHORIZED TO PREPARE SUCH DRAWINGS IN THIS STATE. IT HAS BEEN EXAMINED BY ME, AND

1) DESIGN INTENT AND APPEARS TO MEET THE APPROPRIATE REQUIREMENTS OF TITLE 24, CALIFORNIA CODE OF REGULATIONS, AND THE PROJECT SPECIFICATIONS PREPARED BY ME, AND

2) COORDINATION WITH MY PLANS AND SPECIFICATIONS, AND IS ACCEPTABLE FOR INCORPORATION INTO THE CONSTRUCTION OF THIS PROJECT.

THE STATEMENT OF GENERAL CONFORMANCE "SHALL NOT BE CONSTRUED AS RELIEVING ME OF MY RIGHTS, DUTIES, AND RESPONSIBILITIES UNDER SECTIONS 17302 AND 81138 OF THE EDUCATION CODE AND SECTIONS 4-336, 4-341 AND 4-344" OF TITLE 24, PART 1, (TITLE 24, PART 1, SECTION 4-317(b))

I FIND THAT:  ALL DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET FOR EACH DISCIPLINE (SEE SHEET INDEX FOR LIST OF DISCIPLINES)  THIS DRAWING OR PAGE

ARE IN GENERAL CONFORMANCE WITH THE PROJECT DESIGN, AND  HAVE BEEN COORDINATED WITH THE PROJECT PLANS AND SPECIFICATIONS.

**JESSE MILLER**  
05/05/2022  
SIGNATURE DATE  
ARCHITECT OR ENGINEER DESIGNATED TO BE IN GENERAL RESPONSIBLE CHARGE  
PRINT NAME  
C-32306 10/31/2023  
LICENSE NUMBER EXPIRATION DATE

ARE IN GENERAL CONFORMANCE WITH THE PROJECT DESIGN INTENT, AND HAVE BEEN COORDINATED WITH THE PROJECT PLANS AND SPECIFICATIONS.

**JESSE MILLER**  
10/31/2023  
SIGNATURE DATE  
ARCHITECT OR ENGINEER DELEGATED RESPONSIBILITY FOR THIS PORTION OF THE WORK  
PRINT NAME  
C-32306 10/31/2023  
LICENSE NUMBER EXPIRATION DATE

#### SCOPE OF WORK

SCOPE OF WORK SHALL BE AS FOLLOWS:

EXISTING HVAC SYSTEM REPLACEMENT AT CLASSROOM BUILDINGS AND MPR

#### APPLICABLE CODES

- 2019 CALIFORNIA ADMINISTRATIVE CODE (CAC), PART 1, TITLE 24 CCR
- 2019 CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24 CCR
- 2019 INTERNATIONAL BUILDING CODE, VOL. 1 & 2, AND 2019 CALIFORNIA AMENDMENTS)
- 2019 CALIFORNIA ELECTRICAL CODE (CEC), PART 3, TITLE 24 CCR
- (2017 NATIONAL ELECTRICAL CODE AND 2019 CALIFORNIA AMENDMENTS)
- 2019 CALIFORNIA MECHANICAL CODE (CMC), PART 4, TITLE 24 CCR
- (2018 IPMVC UNIFORM MECHANICAL CODE AND 2019 CALIFORNIA AMENDMENTS)
- 2019 CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24 CCR
- (2018 IAPMO UNIFORM PLUMBING CODE AND 2019 CALIFORNIA AMENDMENTS)
- 2019 CALIFORNIA ENERGY CODE (CEC), PART 6, TITLE 24 CCR
- 2019 CALIFORNIA FIRE CODE (CFC), PART 9, TITLE 24 CCR
- (2018 INTERNATIONAL FIRE CODE AND 2019 CALIFORNIA AMENDMENTS)
- 2019 CALIFORNIA EXISTING BUILDING CODE (CEBC), PART 10, TITLE 24 CCR
- (2018 INTERNATIONAL EXISTING BUILDING CODE AND 2019 CALIFORNIA AMENDMENTS)
- 2019 CALIFORNIA GREEN BUILDING STANDARDS CODE (CAL GREEN), PART 11, TITLE 24 CCR
- 2019 CALIFORNIA REFERENCED STANDARDS CODE (CEC), PART 12, TITLE 24 CCR
- TITLE 19 CCR, PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS
- 2016 ASME A17.1/CSA B44-13 SAFETY CODE FOR ELEVATORS AND ESCALATORS (PER 2019 CBC PART 10.05)
- NOTE: CALIFORNIA ELEVATOR UNIT ENFORCES CCR TITLE 8 AND USES THE 2004 ASME A17.1 BY ADOPTION
- 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN
- NFPA 13 - STANDARD FOR INSTALLATION OF SPRINKLERS SYSTEMS (CA AMENDED) 2016 ADDITION
- NFPA 14 - STANDARD FOR INSTALLATION OF SAND PIPE AND HOSE SYSTEMS (CA AMENDED) 2016 ADDITION
- NFPA 17 - STANDARD FOR WET CHEMICAL EXTINGUISHING SYSTEMS 2017 ADDITION
- NFPA 17A - STANDARD FOR WET CHEMICAL EXTINGUISHING SYSTEMS 2017 ADDITION
- NFPA 20 - STANDARD FOR INSTALLATION OF STATIONARY PUMPS FOR FIRE PROTECTION 2017 ADDITION
- NFPA 22 - STANDARD FOR WATER TANKS FOR PRIVATE FIRE PROTECTION 2013 ADDITION
- NFPA 24 - STANDARD FOR THE INSTALLATION OF PRIVATE FIRE SERVICE MAINS AND THEIR APPURTENANCES (CA AMENDED) 2016 ADDITION
- NFPA 72 - NATIONAL FIRE ALARM AND SIGNALING CODE (CA AMENDED) 2016 ADDITION
- NFPA 80 - STANDARD FOR FIRE DOORS AND OTHER OPENINGS PROTECTIVE 2016 ADDITION
- NFPA 2001 - STANDARD ON CLEAN AGENT FIRE EXTINGUISHING SYSTEMS (CA AMENDED) 2015 ADDITION
- UL 300 - STANDARD FOR FIRE TESTING OF FIRE EXTINGUISHING SYSTEMS FOR PROTECTION OF COMMERCIAL COOKING EQUIPMENT 2005 (R2010)
- UL 464 - AUDIBLE SIGNALING DEVICES FOR FIRE ALARM AND SIGNALING SYSTEMS, INCLUDING ACCESSORIES 2003 ADDITION
- UL 521 - STANDARD FOR HEAT DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS 1999 ADDITION
- UL 1971 - STANDARD FOR SIGNALING DEVICES FOR THE HEARING IMPAIRED 2002 (R2010)
- ICC 300 - STANDARD FOR BLEACHERS, FOLDING AND TELESCOPIC SEATING, AND GRANDSTANDS 2017 ADDITION

#### DESIGN ANALYSIS DATA

- WIND DESIGN CRITERIA (CBC 1603A.1.4) - STRUCTURAL DESIGN PARAMETERS
  - RISK CATEGORY: III
  - WIND DESIGN SPEED: V=110 MPH
  - WIND EXPOSURE CATEGORY: B (PER ASCE 7-16)
- EARTHQUAKE DESIGN CRITERIA (CBC 1603A1.5)
  - SEISMIC DESIGN CATEGORY: D
  - SITE CLASS: D
  - S<sub>1</sub> = 1.659
  - S<sub>2</sub> = 0.61
  - S<sub>3</sub> = 1.991
  - S<sub>4</sub> = 1.039
  - S<sub>5</sub> = 1.327
  - S<sub>6</sub> = 0.892
  - Importance Factor = 1.10
  - F<sub>r</sub> (CONTROLLING HOR. SEISMIC FORCE) = 1815 LBS
- DESIGN LOAD BEARING VALUES OF SOILS (CBC 1603A1.6)
  - ALLOWABLE SOIL BEARING PRESSURE: 1,300 PSF
  - ALLOWABLE LATERAL BEARING PRESSURE: 100 PSF MIN.

#### DSA GENERAL NOTES

- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY AN ADDENDUM OR A CONSTRUCTION CHANGE DOCUMENT APPROVED BY THE DIVISION OF THE STATE ARCHITECT (DSA), AS REQUIRED BY SECTION 4-338(b), PART 1, TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR), NOT WITH STANDING OTHER PROVISIONS OF THE PROJECT SPECIFICATIONS, COMPLY WITH ALL PROVISIONS OF THE CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR), SECTION 4-336, FOR ALL ADDENDUM AND CONSTRUCTION CHANGE DOCUMENTS.
- CONSTRUCTION CHANGE DOCUMENTS MUST BE SIGNED BY ALL THE FOLLOWING: ARCHITECT OR ENGINEER HAVING GENERAL RESPONSIBLE CHARGE OF THE PROJECT, AND STRUCTURAL ENGINEER OF RECORD OR DELEGATED PROFESSIONAL ENGINEER (WHEN APPLICABLE).
- SUBSTITUTIONS AFFECTING OSA REGULATED ITEMS (ACCESSIBILITY, STRUCTURAL, ENGINEER, AND FIRE/SAFETY) SHALL BE CONSIDERED AS A CONSTRUCTION CHANGE DOCUMENT, AND SHALL BE APPROVED BY OSA PRIOR TO FABRICATION AND INSTALLATION IN ACCORDANCE WITH DSA IR 4-6 AND SECTION 4-338(b), PART 1, TITLE 24, CCR. SUBSTITUTIONS SHALL BE FOR ANY MATERIALS, SYSTEMS OR PRODUCT THAT WOULD OTHERWISE BE REGULATED BY OSA.
- A DSA-CERTIFIED PROJECT INSPECTOR WITH CLASS 3 CERTIFICATION, EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE ARCHITECT AND BY THE DIVISION OF THE STATE ARCHITECT, SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE PROJECT INSPECTOR ARE DEFINED IN SECTION 4-342, CALIFORNIA BUILDING ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR).
- A DSA-ACCEPTED TESTING LAB EMPLOYED BY THE DISTRICT (OWNER), SHALL CONDUCT ALL REQUIRED TESTS AND INSPECTIONS OF THE WORK.
- THE DSA-CERTIFIED PROJECT INSPECTOR AND DSA-ACCEPTED TESTING LAB SHALL BE EMPLOYED AND PAID BY THE OWNER (DISTRICT) AND APPROVED BY ALL OF THE FOLLOWING: ARCHITECT OR ENGINEER HAVING GENERAL RESPONSIBLE CHARGE OF THE PROJECT, STRUCTURAL ENGINEER OF RECORD, AND DIVISION OF THE STATE ARCHITECT (OSA). THE INSPECTOR OF RECORD FOR THIS PROJECT SHALL BE CLASS 3 OR BETTER.
- ALL WORK SHALL CONFORM TO 2019 TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR).
- A DSA-ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE DISTRICT (OWNER) SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- THE INTENT OF THESE DRAWINGS AND SPECIFICATIONS IS THAT THE WORK OF THE ALTERATION, REHABILITATION OR RECONSTRUCTION IS TO BE IN ACCORDANCE WITH TITLE 24, CCR. SHOULD ANY EXISTING CONDITIONS SUCH AS DETERIORATION OR NON-COMPLYING CONSTRUCTION BE DISCOVERED WHICH IS NOT COVERED BY THE CONTRACT DOCUMENTS WHEREIN THE FINISHED WORK WILL NOT COMPLY WITH TITLE 24, CCR, A CONSTRUCTION CHANGE DOCUMENT (CCD), OR A SEPARATE SET OF PLANS AND SPECIFICATIONS, DETAILING AND SPECIFYING THE REQUIRED WORK SHALL BE SUBMITTED TO AND APPROVED BY OSA BEFORE PROCEEDING WITH THE WORK. (SECTION 4-317(c), PART 1, TITLE 24, CCR)
- FABRICATION AND INSTALLATION OF DEFERRED SUBMITTAL ITEMS SHALL NOT BE STARTED UNTIL CONTRACTOR'S DRAWINGS, SPECIFICATIONS, AND ENGINEERING CALCULATIONS FOR THE ACTUAL SYSTEMS TO BE INSTALLED HAVE ACCEPTED AND SIGNED BY THE ARCHITECT OR STRUCTURAL ENGINEER AND APPROVED BY OSA. LIST DEFERRED SUBMITTAL ITEMS FOR THIS PROJECT. (IF THIS PROJECT HAS NO DEFERRED SUBMITTAL ITEMS, PLEASE INDICATE AS SUCH.)
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- THE CALIFORNIA ENERGY CODE SECTION 10-103 REQUIRES ACCEPTANCE TESTING ON ALL NEWLY INSTALLED LIGHTING CONTROLS, MECHANICAL SYSTEMS, ENVELOPES, AND PROCESS EQUIPMENT AFTER INSTALLATION AND BEFORE PROJECT COMPLETION. AN ACCEPTANCE TEST IS A FUNCTIONAL PERFORMANCE TEST TO HELP ENSURE THAT NEWLY INSTALLED EQUIPMENT IS OPERATING AND IN COMPLIANCE WITH THE ENERGY CODE.
- LIGHTING CONTROLS ACCEPTANCE TESTS MUST BE PERFORMED BY CERTIFIED LIGHTING CONTROLS ACCEPTANCE TEST TECHNICIAN (ATT).
- MECHANICAL SYSTEM ACCEPTANCE TEST MUST BE PERFORMED BY A CERTIFIED MECHANICAL ATT FOR PROJECTS SUBMITTED ON OR AFTER OCTOBER 1, 2021.
- ENVELOPE AND PROCESS EQUIPMENT ACCEPTANCE TESTING SHALL BE PERFORMED BY THE INSTALLING CONTRACTOR, ENGINEER/ARCHITECT OR RECORD OR THE OWNER'S AGENT.
- A LISTING OF CERTIFIED ATT CAN BE FOUND AT [HTTPS://WWW.ENERGY.CA.GOV/PROGRAMS-AND-TOPICS/PROGRAMS/ACCEPTANCE-TESTING-TECHNICIAN-CERTIFICATION-PROVIDER-PROGRAM/ACCEPTANCE-COM](https://www.energy.ca.gov/programs-and-topics/programs/acceptance-testing-technician-certification-provider-program/acceptance-com)
- THE ACCEPTANCE TESTING PROCEDURES MUST BE REPEATED, AND DEFICIENCIES MUST BE CORRECTED BY THE BUILDER OR INSTALLING CONTRACTOR UNTIL THE CONSTRUCTION/INSTALLATION OF THE SPECIFIED SYSTEMS CONFORM AND PASS THE REQUIRED ACCEPTANCE CRITERIA.
- PROJECT INSPECTORS WILL COLLECT THE FORMS TO CONFIRM THAT THE REQUIRED ACCEPTANCE TESTS HAVE BEEN COMPLETED.

#### VICINITY MAP



#### PROJECT DIRECTORY


**OWNER**  
COVINA VALLEY UNIFIED SCHOOL DISTRICT  
519 E. BADILLO ST.  
COVINA, CA 91723  
CONTACT: BRIAN JOHNSON  
PH: 626 974 7000  
BJOHNSON@CVUSD.ORG

**STRUCTURAL ENGINEER**  
ORON STRUCTURAL ENGINEERING, INC.  
11305 RANCHO BERNARDO ROAD, SUITE  
121 SAN DIEGO, CA 92127  
CONTACT: RYAN OMER  
PH: 858 679 1974  
RYAN@ORONSE.COM

**ARCHITECT**  
DLR GROUP  
700 S. FLOWER ST.  
LOS ANGELES, CA 90017  
CONTACT: JESSE MILLER  
PH: 213 800 9400  
JMILLER@DLRGROUP.COM

**ELECTRICAL ENGINEER**  
DLR GROUP  
700 FLOWER ST 22ND FLOOR  
LOS ANGELES, CA 90017  
CONTACT: NORMAN PATENA  
PH: 213 444 8610  
NPATENA@DLRGROUP.COM

**MECHANICAL ENGINEER**  
DLR GROUP  
700 FLOWER ST 22ND FLOOR  
LOS ANGELES, CA 90017  
CONTACT: TONG FANG (DONNA) ZHAO  
PH: 213 444 8610  
DZHAO@DLRGROUP.COM

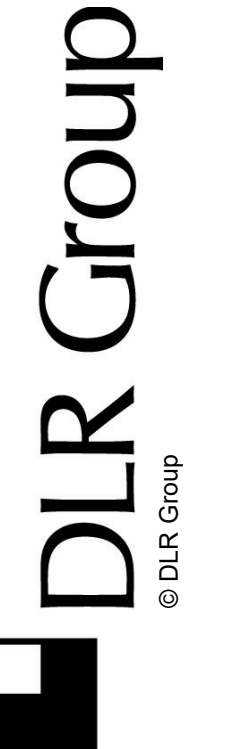

ROWLAND ELEMENTARY SCHOOL  
COVID 19- COVINA VALLEY DISTRICT WIDE HVAC REPLACEMENT  
1355 E. ROWLAND AVE. WEST COVINA, CA 91790

100% CONSTRUCTION DOCUMENTS  
11/08/2022  
REVISIONS

75-22605-00  
DSA A#03-122233  
DSA File #: 19-25  
COVER SHEET

G0.1

Autodesk Docu75-22605-00 CVUSD - District Web-HVAC Replacement/75-22605-00 CVUSD - Rowland ES\_A#\_2022.rvt  
11/22/2022 8:52:21 AM



GENERAL ABBREVIATIONS

#	NUMBER
&	AND
@	AT
ADA	AMERICANS WITH DISABILITY ACT
ADDN	ADDITION OR ADDITIONAL
AFF	ABOVE FINISHED FLOOR
ACT	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
ALT	ALTERNATE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
APPROX	APPROXIMATE
ARCH	ARCHITECTURAL
BLDG	BUILDING
BSMT	BASEMENT
CL	CENTER LINE
CLG	CEILING
CM	CENTIMETER
CONC	CONCRETE
CONN(S)	CONNECTION(S)
CONST	CONSTRUCTION
CONT	CONTINUOUS
CONTR	CONTRACTOR
CTR	CENTER
D	DEPTH
DEG	DEGREE
DEMO	DEMOLISH OR DEMOLITION
DIA	DIAMETER
DM	DIMENSION
DIV	SPECIFICATION DIVISION
DN	DOWN
DTL	DETAIL
DWG(S)	DRAWING(S)
E	EAST
EA	EACH
EC	ELECTRICAL CONTRACTOR
EL	ELEVATION
ELEC	ELECTRICAL
ENG	ENGINEER
EQ	EQUAL
EQUIP	EQUIPMENT
EQUIV	EQUIVALENT
EXST	EXISTING
EXT	EXTERIOR
FIN	FINISHED
FL	FLOOR
FT	FEET
FUT	FUTURE
GC	GENERAL CONTRACTOR
GOVT	GOVERNMENT
H	HEIGHT
HORIZ	HORIZONTAL
HT	HEIGHT
i.e.	THAT IS
IBC	INTERNATIONAL BUILDING CODE
IN	INCH
INT	INTERIOR
LB(S)	POUND(S)
M	THOUSAND
M	METER
MAX	MAXIMUM
MC	MECHANICAL CONTRACTOR
MECH	MECHANICAL
MEZZ	MEZZANINE
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MM	MILLIMETER
N	NORTH
N/A	NOT APPLICABLE
NIC	NOT IN CONTRACT
NTS	NOT TO SCALE
OC	ON CENTER
OPP	OPPOSITE
OVHD	OVERHEAD
PAR	PARALLEL
PENT	PENTHOUSE
PLYWD	PLYWOOD
QTY	QUANTITY
REQ(D)	REQUIRE(D)
REV	REVISION(S)
RM	ROOM
RND	ROUND
S	SOUTH
SCHED	SCHEDULE
SECT	SECTION
SHT	SHEET
SIM	SIMILAR
SPEC	SPECIFICATION(S)
STD	STANDARD
STL	STEEL
STOR	STORAGE
STRUCT	STRUCTURAL
SYM	SYMMETRICAL
TEMP	TEMPORARY
TYP	TYPICAL
UNEX	UNEXCAVATED
UNFN	UNFINISHED
UNO	UNLESS NOTED OTHERWISE
VERT	VERTICAL
VEST	VESTIBULE
VIF	VERIFY IN FIELD
W	WEST
W	WITH
W/O	WITHOUT

ARCHITECTURAL ABBREVIATIONS

A/E	ARCHITECT/ENGINEER
AB	AIR BARRIER
ABS	ASBESTOS
ACC	ADA ACCESSIBLE
ACR	ACRYLIC WALL BOARD
ACT	ACOUSTIC CEILING TILE
AD	ACCESS DOOR
ADJ	ADJUSTABLE
ADJT	ADJACENT
ADMIN	ADMINISTRATION
AEC	AUTOMATED EXTERNAL DEBRILLATORS
AL	ALUMINUM
ALUM	ALUMINUM
AP	ACCESS PANEL
APC	ACOUSTIC PANEL CEILING
ASPH	ASPHALT
AUTO	AUTOMATIC
AVG	AVERAGE
AWP	ACOUSTIC WALL PANEL
B.O.	BOTTOM OF
BCS	BABY CHANGING STATION
BO	BOARD
BLK	BLOCK
BLKG	BLOCKING
BLKHD	BULKHEAD
BM(S)	BEAM(S)
BOT	BOTTOM
BRDG	BRIDGING
BRG	BEARING
BRKT	BRACKET
BATHUB	BATHUB
BETWN	BETWEEN
CAB	CABINET
CB	CHALKBOARD
CER	CERAMIC
CF	CUBIC FEET
CFI	CONTRACTOR FURNISHED CONTRACTOR INSTALLED
CFM	COLD-FORMED METAL FRAMING
CG	CLEAR FLOAT GLASS
CI	CAST IRON
CIG	CLIP-IN INSULATING GLASS
CP	CAST IN PLACE
CJ	CONTROL JOINT
CJA	CONTROL JOINT ABOVE
CLO	CLOSET
CLR	CLEAR
CMU	CONCRETE MASONRY UNIT
COL	COLUMN
COM	COMMON
COMB	COMBINATION
COMM	COMMUNICATIONS
COMPR	COMPRESSIBLE
CONF	CONFERENCE
CONFIG	CONFIGURATION
CORR	CORRIDOR
CP	COVER PLATE
CPT	CARPET
CR	CHAIR RAIL
CS	COUNTERSINK
CS/TJ	CONSTRUCTION JOINT
CSWAK	CASEWORK
CT	CERAMIC TILE
CTG	CLEAR TEMPERED FLOAT GLASS
CTIG	CLEAR TEMPERED INSULATING GLASS
CU	COPPER
CJ	COMBINATION UNIT
CV	CONDOM VENDOR
CY	CUBIC YARD
CYL	CYLINDER
DB	DECIBEL
DBL	DOUBLE
DC	DUST COLLECTOR
DEPR	DEPRESSION(WED)
DEPT	DEPTH
DET	DETENTION
DF	DRINKING FOUNTAIN
DG	DOOR GRILLE
DIAG	DIAGONAL
DR	DAMP ROOFING
DR	DOOR
DSN	DOWNSPOUT NOZZLE
DW	DISHWASHER
DWL(S)	DOWEL(S)
DWR	DRAWER
EB	EXPANSION BOLT
EE	EACH END
EW	EMERGENCY EYE WASH
EWS	EMERGENCY EYE WASH SHOWER
EFF	EFFICIENCY
EJ	EXPANSION JOINT
ELAS	ELASTOMERIC
ELEV	ELEVATION
EMER	EMERGENCY
ENCL	ENCLOSURE
ENTR	ENTRANCE
ERP	EPOXY RESIN FLOORING
ES	EMERGENCY USE INTENSITY
EWC	ELECTRIC WATER COOLER
EXP	EXPANSION
EXP	EXPOSED
F	FABRIC
F.O.	FACE OF
FAB	FABRICATE(D)
FB	FACE BRICK
FD	FLOOR DRAIN
FDN	FOUNDATION
FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FF	FINISH FLOOR
FH	FIRE HYDRANT
FHC	FIRE HOSE CABINET
FIG	FIGURE
FIX	FIXTURE
FLASH	FLASHING
FLEX	FLEXIBLE
FLG	FLOORING
FLM	FULL LENGTH MIRROR
FLUOR	FLUORESCENT
FO	FINISH OPENING
FOC	FACE OF CONCRETE
FOF	FACE OF FINISH
FOM	FACE OF MASONRY
FOS	FACE OF STUD
FOV	FACE OF WALL
FP	FIREPROOFING
FR	FIRE RESISTANT
FRP	FIBERGLASS REINFORCED PANEL
FRT	FIRE RESISTANCE TREATED
FS	FLOOR SINK
FSS	FOLDING SHOWER SEAT
FTG	FOOTING
FVC	FIRE VALVE CABINET
FWC	FABRIC WALL COVERING
G	GROUT
GA	GAUGE
GAL	GALLON
GALV	GALVANIZED
GB	GRAB BAR
GD	GARBAGE DISPOSAL
GEN	GENERAL
GFA	GROSS FLOOR AREA
GL	GLUE LAMINATED
GLASS	GLASS
GMP	GUARANTEED MAXIMUM PRICE
GR	GUARD RAIL
GR	GRADE
GRS	GALVANIZED RIGID STEEL
GRV	GRYTLUM
GYP	GYPSTUM
HC	HOLLOW CORE
HD	HAND DRIVER
HDF	HIGH DENSITY FIBERBOARD
HDR	HEADER
HDWR	HARDWOOD
HDWR	HARDWARE
HM	HOLLOW METAL
HR	HOUR
HR	HANDRAIL
HS	HARDWARE SET
HSS	HOLLOW STRUCTURAL SHAPE
HVAC	HEATING VENTILATING AND AIR CONDITIONING
IAW	IN ACCORDANCE WITH
ID	INSIDE DIAMETER
IF	INSIDE FACE
IFP	INSULATED INFILL PANEL GLASS
IJP	INSULATION JOINT
IJS	IN JOIST SPACE
INC	INCLUDE(ING)
INSUL	INSULATION
JAN	JANITOR
JBE	JOIST BEARING ELEVATION
JCT	JUNCTION
JFB	JOINT FILLER BOARD
JST	JOIST
JT	JOINT
KCJ	KEYED CONSTRUCTION JOINT
KD	KNOCKDOWN
KH	KITCHEN HOOD
KIT	KITCHEN
L	ANGLE
LAB	LABORATORY
LAM	LAMINATED
LAV	LAVATORY
LBR	LUMBER
LDG	LOADING
LF	LINEAR FOOT
LG	LENGTH (LONG)
LG	LAMINATED GLASS
LN	LINEAR
LNO	LINOLEUM
LKR	LOCKER
LOC	LOCATION
LONG	LONGITUDINAL
LSC	LIFE SAFETY CODE
LTV	LIGHTING
LVR	LUXURY VINYL TILE
LVT	LUXURY VINYL TILE
MAG	MAGNETIC
MAINT	MAINTENANCE
MAN	MANUAL
MAS	MASONRY
MATL	MATERIAL
MB	MOP BASIN
MBD	MARKER BOARD
MBH	MOP/SROOM HOLDER
MC	MEDICINE CABINET
MEMB	MEMBRANE
MH	MANHOLE
MRS	MIRROR WITH SHELF
MTD	MOUNTED
MTG	MOUNTING
MUL	MULLION
NC	NOISE CRITERIA
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NOM	NOMINAL
O to O	OUT TO OUT
OA	OVERALL
OFI	OWNER FURNISHED CONTRACTOR INSTALLED
OFF	OFFICE
OFI	OWNER FURNISHED OWNER INSTALLED
OH	OPPOSITE HAND
OP(S)	OPENING(S)
OSHA	OPERATIONAL SAFETY AND HEALTH ADMINISTRATION
OTB	OPEN TO BELOW
OVFL	OVERFLOW
P	PAINT
PAN B	PANIC BOLT
PB	PARTICLE BOARD
PC	PRECAST CONCRETE
PCD	PAPER CUP DISPENSER
PCT	PORCELAIN CERAMIC TILE
PD	PANIC DEVICE
PERF	PERFORATED
PERP	PERPENDICULAR
PG	PATTERN GLASS
PIG	PORCELAIN CERAMIC TILE
PIG	PATTERN INSULATING GLASS
PL	PLATE
PL	PROPERTY LINE
PL	PLASTIC LAMINATE
PLAM	PLASTIC LAMINATE
PLBG	PLUMBING
PR	PAIR
PRFAB	PREFABRICATED
PRD	PROJECT(OR) (CON)
PS	PROJECTION SCREEN
PT	POINT
PTD	POINT OF TANGENCY
PTD	PAPER TOWEL DISPENSER
PTDR	COMBINATION TOWEL DISPENSER/RECEPTACLE
PTN	PARTITION
PVC	POLYVINYL CHLORIDE
PWL	SOUND POWER LEVEL
QT	QUARRY TILE
QTR RND	QUARTER ROUND
R	RISER
RAD	RADIUS
RB	RUBBER BASE
RC	REMOTE CONTROL
RCP	REFLECTED CEILING PLAN
RD	ROOF DRAIN
REF	REFERENCE
REFL	REFLECTED
REM	REMOVABLE
RESIL	RESILIENT
RF	RESILIENT FLOORING
RF	RUBBER FLOOR
RFM	RECESSED FLOOR MAT
RH	ROBE HOOK
R&C	ROUGH IN AND CONNECT
S	SINK
SAT	SPRAYED ACOUSTIC TREATMENT
SAW	SOUND ABSORBING WALL UNITS
SB	SPLASH BLOCK
SC	SOLID CORE
SC	SHOWER CURTAIN
SCD	SEAT COVER DISPENSER
SCH	SHOWER CURTAIN HOOK
SCR	SHOWER CURTAIN ROD
SCR	STRUCTURAL CLAY TILE
SD	SOAP DISPENSER
SECY	SECRETARY
SF	SQUARE FEET
SG	SPANDREL GLASS
SGL	SINGLE
SH	SHOWER
SHM	SECURITY HOLLOW METAL
SLIT	SEALANT
SM	SHEET METAL
SND	SANITARY NAPKIN DISPOSAL
SNV	SANITARY NAPKIN VENDOR
SPL	SOUND PRESSURE LEVEL
SQ	SQUARE
SS	SOLID SURFACE
SSA	STORM SHELTER AREA
SSS	STAINLESS STEEL SHELF
SST	STAINLESS STEEL
ST	STONE
ST	STAIR
STAGD	STAGGERED
STC	SOUND TRANSMISSION CLASS
STR	STRINGER
SUBFL	SUBFLOOR
SURF	SURFACE
SUSP	SUSPENDED
SVP	SHEET VINYL FLOORING
T	TREAD
T&G	TONGUE AND GROOVE
T.O.	TOP OF
TAN	TANGENT
TB	TOWEL BAR
TBD	TACK BOARD
TCP	TOILET COMPARTMENT PARTITION
TERR	TERRAZZO
TFC	TINTED FLOAT GLASS
TG	TEMPERED GLASS
TH	THRESHOLD
THK	THICKNESS
TI	TENANT IMPROVEMENT
TIG	TINTED INSULATING GLASS
TI	TINTED INSULATING GLASS
TMR	TILT MIRROR UNIT
TOIL	TOILET
TOP	TOP OF PAVING
TRANS	TRANSVERSE
TT	TERRAZZO TILE
TTD	TOILET TISSUE DISPENSER
TTG	TINTED TEMPERED FLOAT GLASS
TTIG	TINTED TEMPERED INSULATING GLASS
TW	TACK WALL
UL	UNDERWRITERS LABORATORIES
UR	URINAL
US	UTILITY SHELF
UTL	UTILITY
VB	VAPOR BARRIER
VB	VINYL BASE
VCB	VENTED COVE BASE
VF	VINYL FLOOR
VOC	VOLATILE ORGANIC COMPOUND
VOL	VOLUME
VP	VENEER PLASTER
VNT	VINYL TILE
VWC	VINYL WALL COVERING
W	WIDE
WB	WALL BASE
WC	WATER CLOSET
WC	WALL COVERING
WCL	WATER CLOSET/LAVATORY COMBINATION
WD	WOOD
WDF	WOOD FLOORING
WDW	WINDOW
WG	POLISHED WIRE GLASS
WI	WROUGHT IRON
WOM	WALK OFF MAT
WR	WASTE RECEPTACLE
WRB	WEATHER RESISTANT BARRIER
WW	WARM WHITE
WWF	WELDED WIRE FABRIC
YD	YARD

GENERAL SYMBOLS

XX	BUILDING ELEVATION
XX (A12.3) XX	INTERIOR ELEVATION
XXX	DETAIL REFERENCE
XXX	BUILDING SECTION
XXX	SHEET NOTE
XXX	REFERENCE KEYNOTE
XXX	COLUMN GRID LINE
XXX	ROOM NUMBERNAME
XXX	REVISION NUMBER
XXX	LEVEL ELEVATION
XXX	FINISH FLOOR ELEVATION
XXX	SPOT ELEVATION
XXX	EARTH
XXX	GRAVEL
XXX	SAND
XXX	CONCRETE
XXX	PRECAST CONCRETE
XXX	STEEL
XXX	STONE
XXX	CONCRETE MASONRY UNIT
XXX	BRICK VENEER
XXX	STEEL (LARGE SCALE)
XXX	GYM FLOOR
XXX	WOOD (CONTINUOUS BLOCKING)
XXX	WOOD (NON-CONTINUOUS BLOCKING)
XXX	WOOD (TRIM/FINISH)
XXX	GLASS
XXX	SHINGLES
XXX	PLYWOOD (LARGE SCALE)
XXX	BLANKET INSULATION
XXX	RIGID INSULATION
XXX	SPRAY FOAM INSULATION
XXX	MINERAL WOOL INSULATION
XXX	PROTECTION BOARD
XXX	CARPET (LARGE SCALE)
XXX	ACOUSTIC TILE (LARGE SCALE)
XXX	TILE (LARGE SCALE)

SITE SYMBOLS

---	PROPERTY LINE
---	LOT LINE
---	EASEMENT LINE
---	BUILDING LINE, EXISTING
---	BUILDING LINE, NEW W/D/OOR OPENING AND STRUCTURAL STOOP
---	PRIMARY CONTOUR, EXISTING
---	PRIMARY CONTOUR, NEW
---	SECONDARY CONTOUR, EXISTING
---	SECONDARY CONTOUR, NEW
---	SLOPE, PAVEMENT
---	DRAINAGE DITCH OR SWALE
---	STREET CENTERLINE
---	CURB, THICKENED EDGE
---	CURB, EXISTING
---	CURB, NEW
---	PAVING CONTRACTION JOINT
---	PAVING KEYED CONSTRUCTION JOINT
---	PAVING TIED CONSTRUCTION JOINT
---	PAVING EXPANSION JOINT
---	FENCE, SECURITY
---	FENCE, BARBED WIRE
---	FENCE, CHAIN LINK
---	FENCE, WOOD
---	SEED LIMIT
---	SOD LIMIT
---	FOUNDATION DRAIN, NON-PERFORATED
---	FOUNDATION DRAIN, PERFORATED
---	SUBDRAIN, PERFORATED
---	SANITARY SEWER
---	FORCE MAIN
---	WATER
---	FIRE
---	GAS
---	HPS
---	MPS
---	LPS
---	UG/UGT
---	OHP
---	HOT
---	LAT
---	AREA INLET
---	CURB INLET
---	MANHOLE
---	HEAD WALL
---	FLARED END
---	CLEAN OUT
---	CAP
---	THRUST BLOCK
---	VALVE
---	POST INDICATOR VALVE
---	REDUCER
---	FIRE HYDRANT
---	POWER POLE
---	LIGHT POLE
---	TELEPHONE MANHOLE
---	TELEPHONE BOX
---	SPRINKLER HEAD, 360°
---	SPRINKLER HEAD, 270°
---	SPRINKLER HEAD, 180°
---	SPRINKLER HEAD, 90°
---	QUICK COUPLING
---	TREE, EXISTING DECIDUOUS
---	TREE, EXISTING CONIFER
---	SHADE TREE
---	ORNAMENTAL TREE
---	DECIDUOUS TREE
---	SHRUB
---	CLIPPED SHRUB

ARCHITECTURAL SYMBOLS

XXX	CASEWORK ELEVATION
---	DOOR NUMBER
---	INTERIOR WINDOW NUMBER
---	EXTERIOR WINDOW / CURTAIN WALL NUMBER
---	WALL TYPE
---	CEILING TYPE
---	CEILING HEIGHT


GENERAL NOTES

- GENERAL NOTES APPLY TO ALL SHEETS.
- DIMENSIONS ARE ACTUAL AND ARE TO FACE OF STUDS, FACE OF CONCRETE WALLS, FACE OF CMU WALLS, FACE OF FRAMES, OR CENTERLINE OF COLUMNS, UNLESS NOTED OTHERWISE.
- INCLUDE ALL OWNER-FURNISHED AND INSTALLED ITEMS AND OWNER-FURNISHED AND CONTRACTOR-INSTALLED ITEMS IN THE CONSTRUCTION SCHEDULE, AND SHALL COORDINATE WITH THE OWNER TO ACCOMMODATE THESE ITEMS.
- COORDINATE ALL MECHANICAL CHASE SIZES WITH THE MECHANICAL CONTRACTOR.
- ARCHITECTURAL FINISH FLOOR ELEVATION 100'-0" EQUALS ACTUAL SITE REFERENCE ELEVATION OF FINISH FLOOR ????? FEET.
- SEE FLOOR PLANS FOR LOCATION OF (E) WALLS OF FIRE-RESISTANCE-RATED CONSTRUCTION. ALL WALLS OF FIRE-RESISTANCE-RATED CONSTRUCTION SHALL EXTEND TO UNDERSIDE OF FLOOR OR ROOF DECK ABOVE.
- ALL PENETRATIONS THROUGH WALLS SHALL BE SEALED WITH PENETRATION FIRE STOPPING MATERIAL AS REQUIRED TO ACHIEVE THE RESPECTIVE FIRE-RESISTANCE RATING AND SMOKE STOPPAGE. SEE SPECIFICATION SECTION 07413.
- COORDINATE WITH MECHANICAL AND ELECTRICAL CONTRACTORS THE SIZE AND LOCATION OF EQUIPMENT PADS SHOWN ON PLANS.
- CONSTRUCTION DOCUMENTS ARE COMPLEMENTARY. SEE DRAWINGS FOR QUANTITIES AND LOCATION OF WORK. SEE SPECIFICATIONS FOR QUALITIES AND CONDITIONS OF WORK.
- WORK: ALL ASPECTS OF THE WORK AND ITEMS NOT SPECIFICALLY MENTIONED, BUT NECESSARY TO MAKE A COMPLETE WORKING INSTALLATION, SHALL BE INCLUDED AND INDICATED IN THE CONTRACTOR'S BID.
- GENERAL SHEET NOTES ONLY APPLY TO PARTICULAR DRAWING OR SERIES OF DRAWINGS.








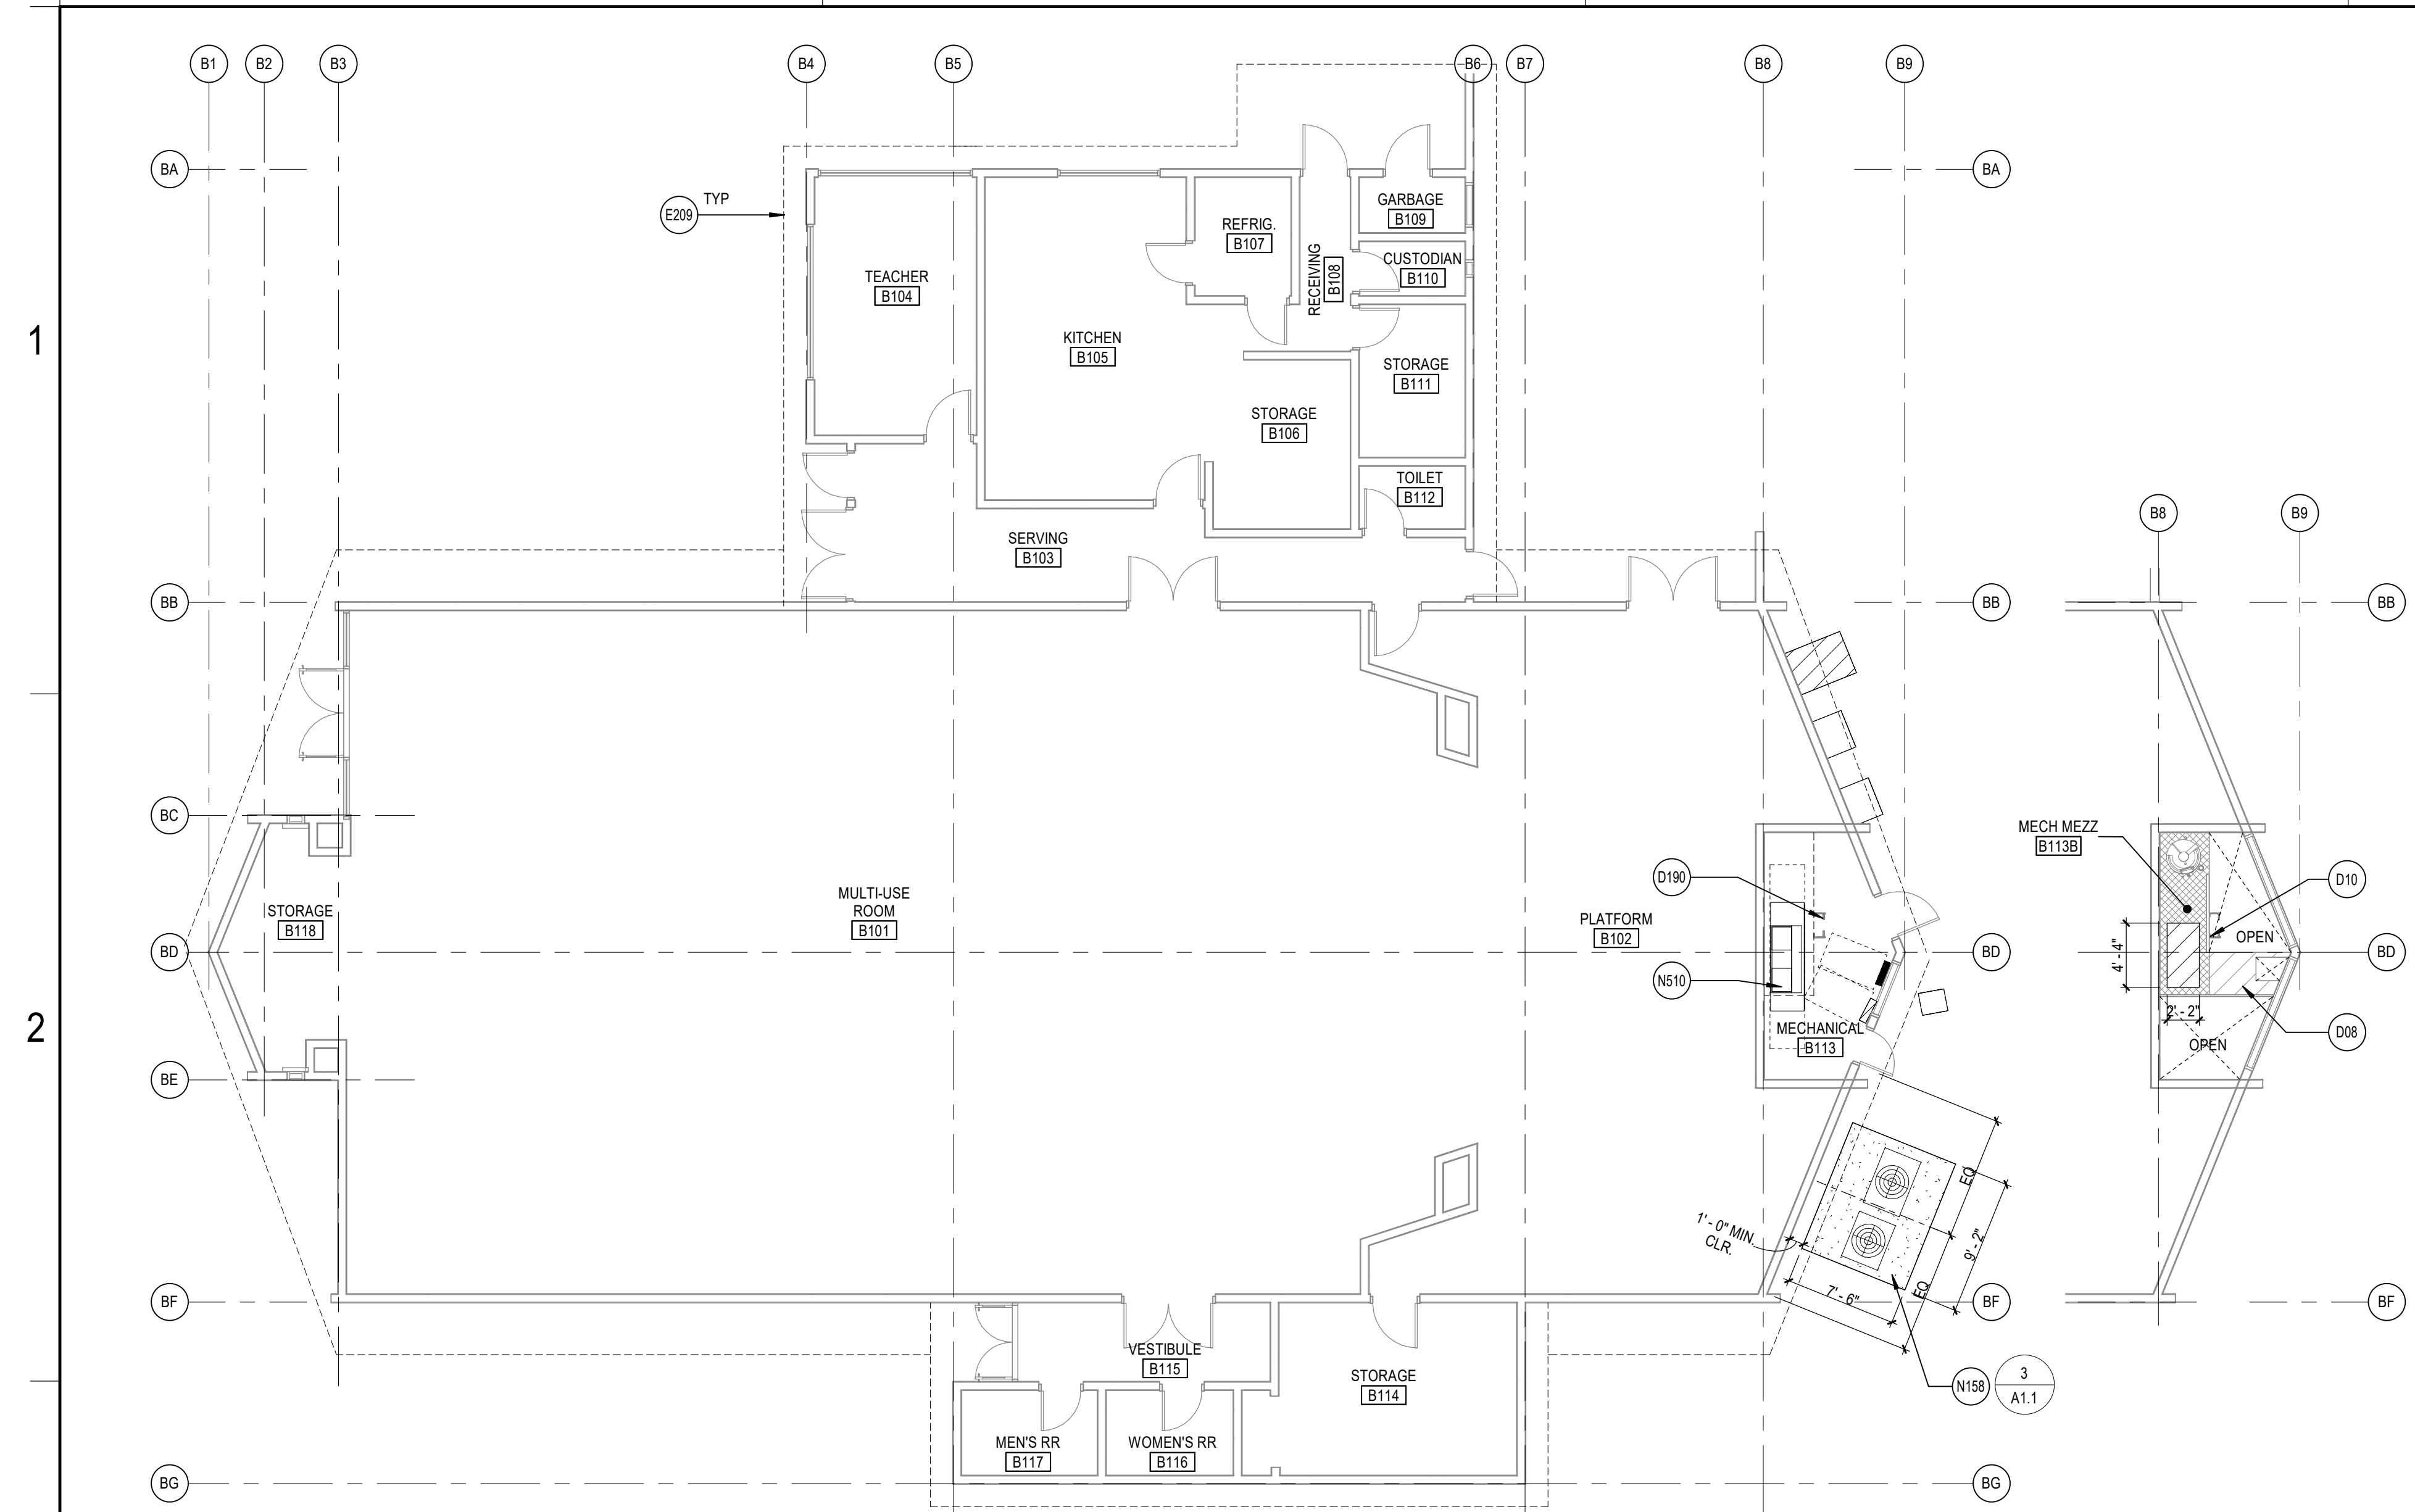


4 BUILDING B FLOOR PLAN  
A1.1A SCALE: 1/8" = 1'-0"


4B MECH. MEZZANINE  
A1.1A SCALE: 1/8" = 1'-0"

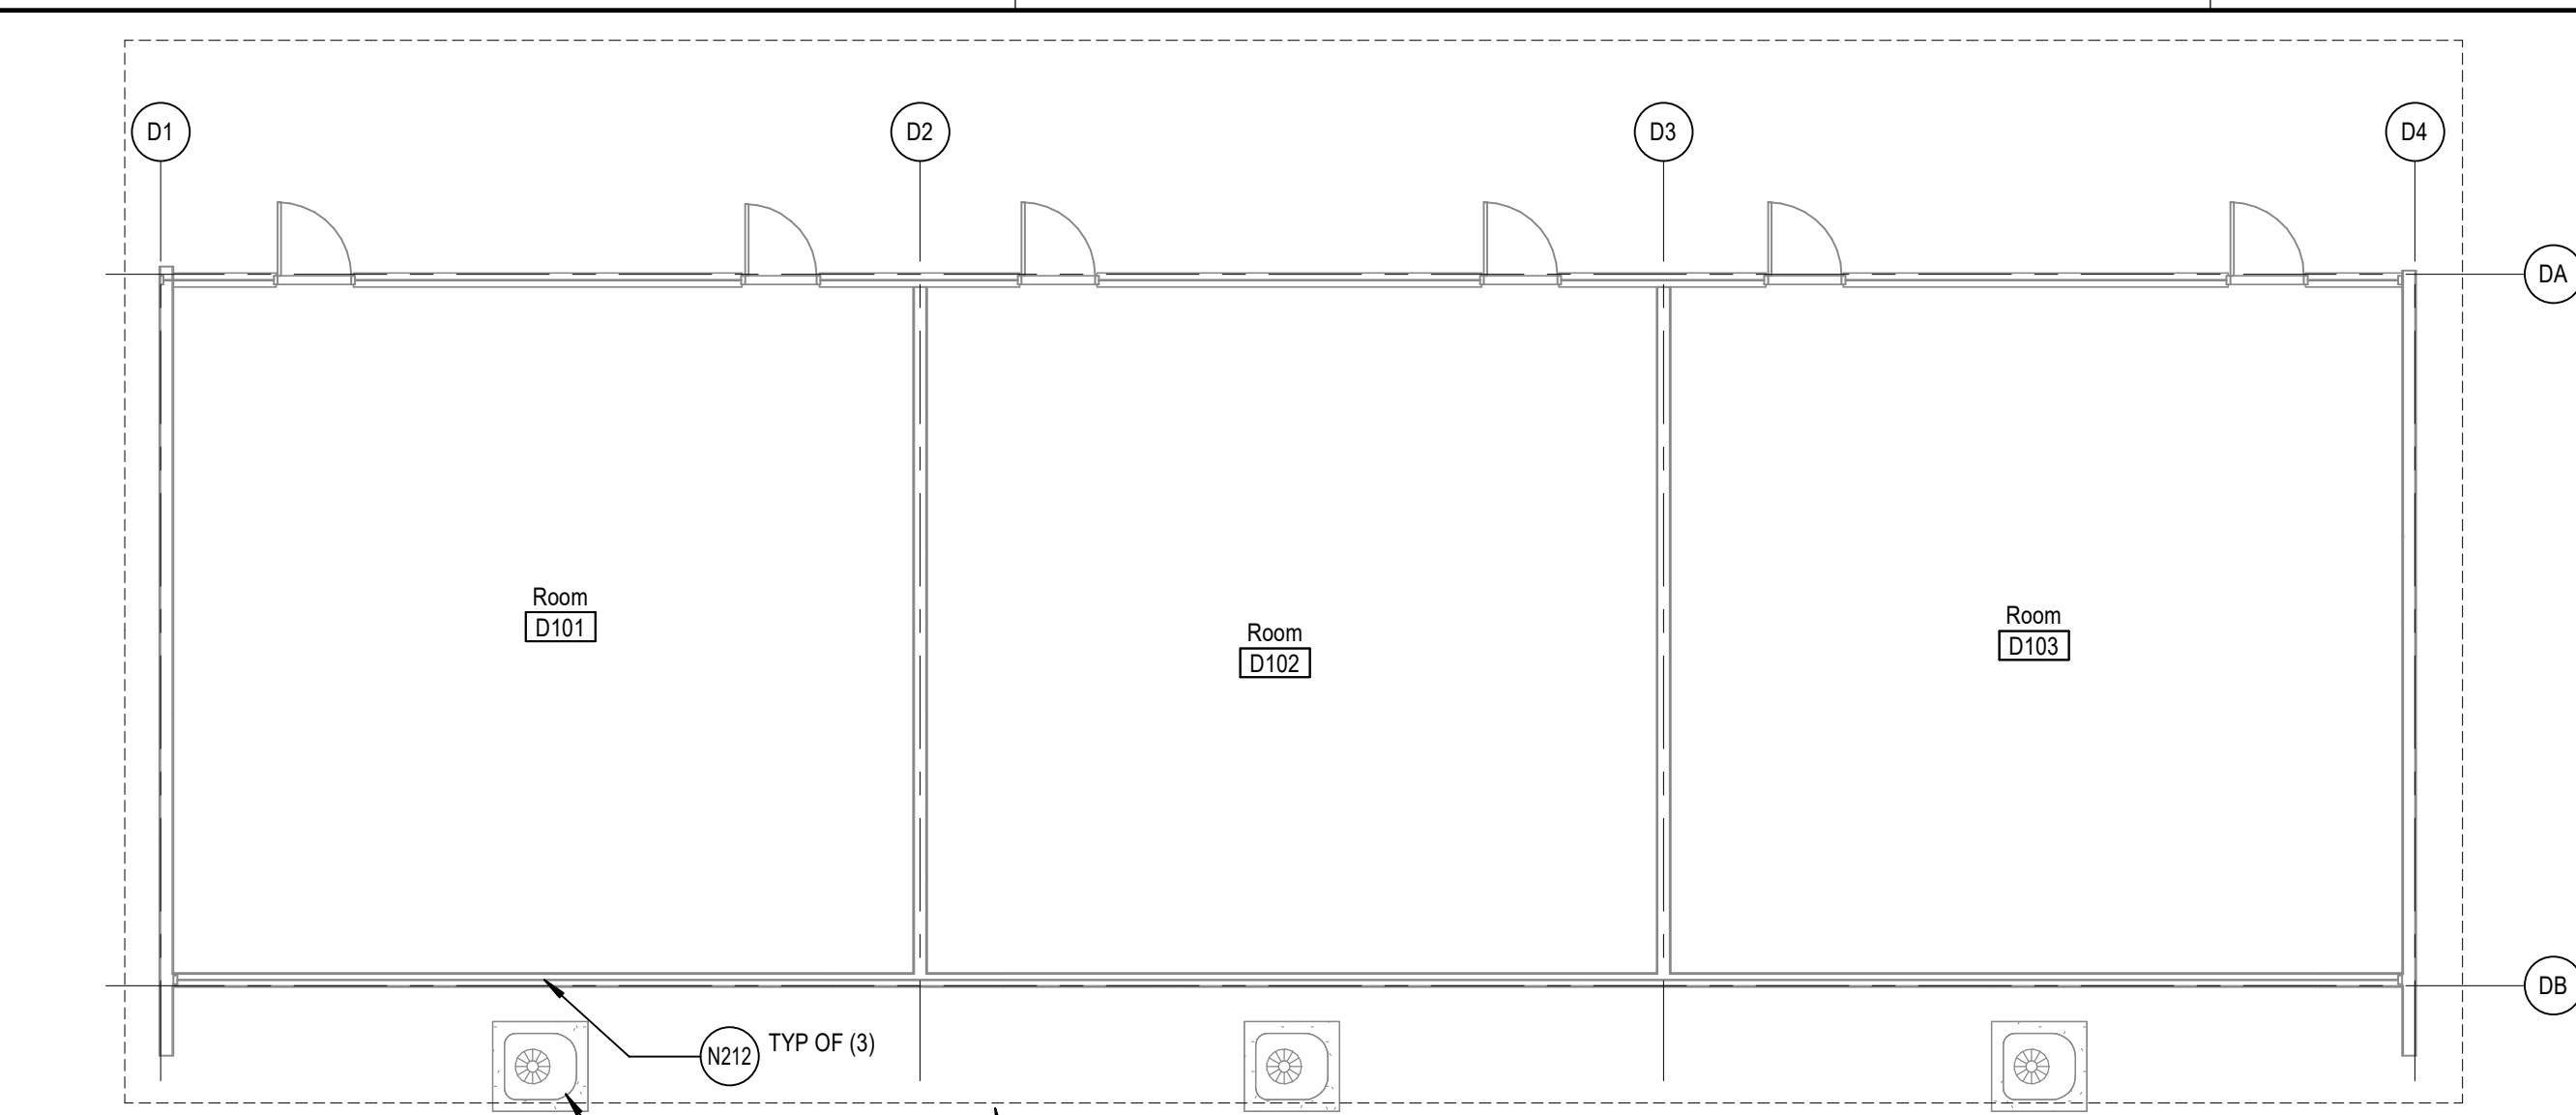


5 BUILDING F FLOOR PLAN  
A1.1A SCALE: 1/8" = 1'-0"

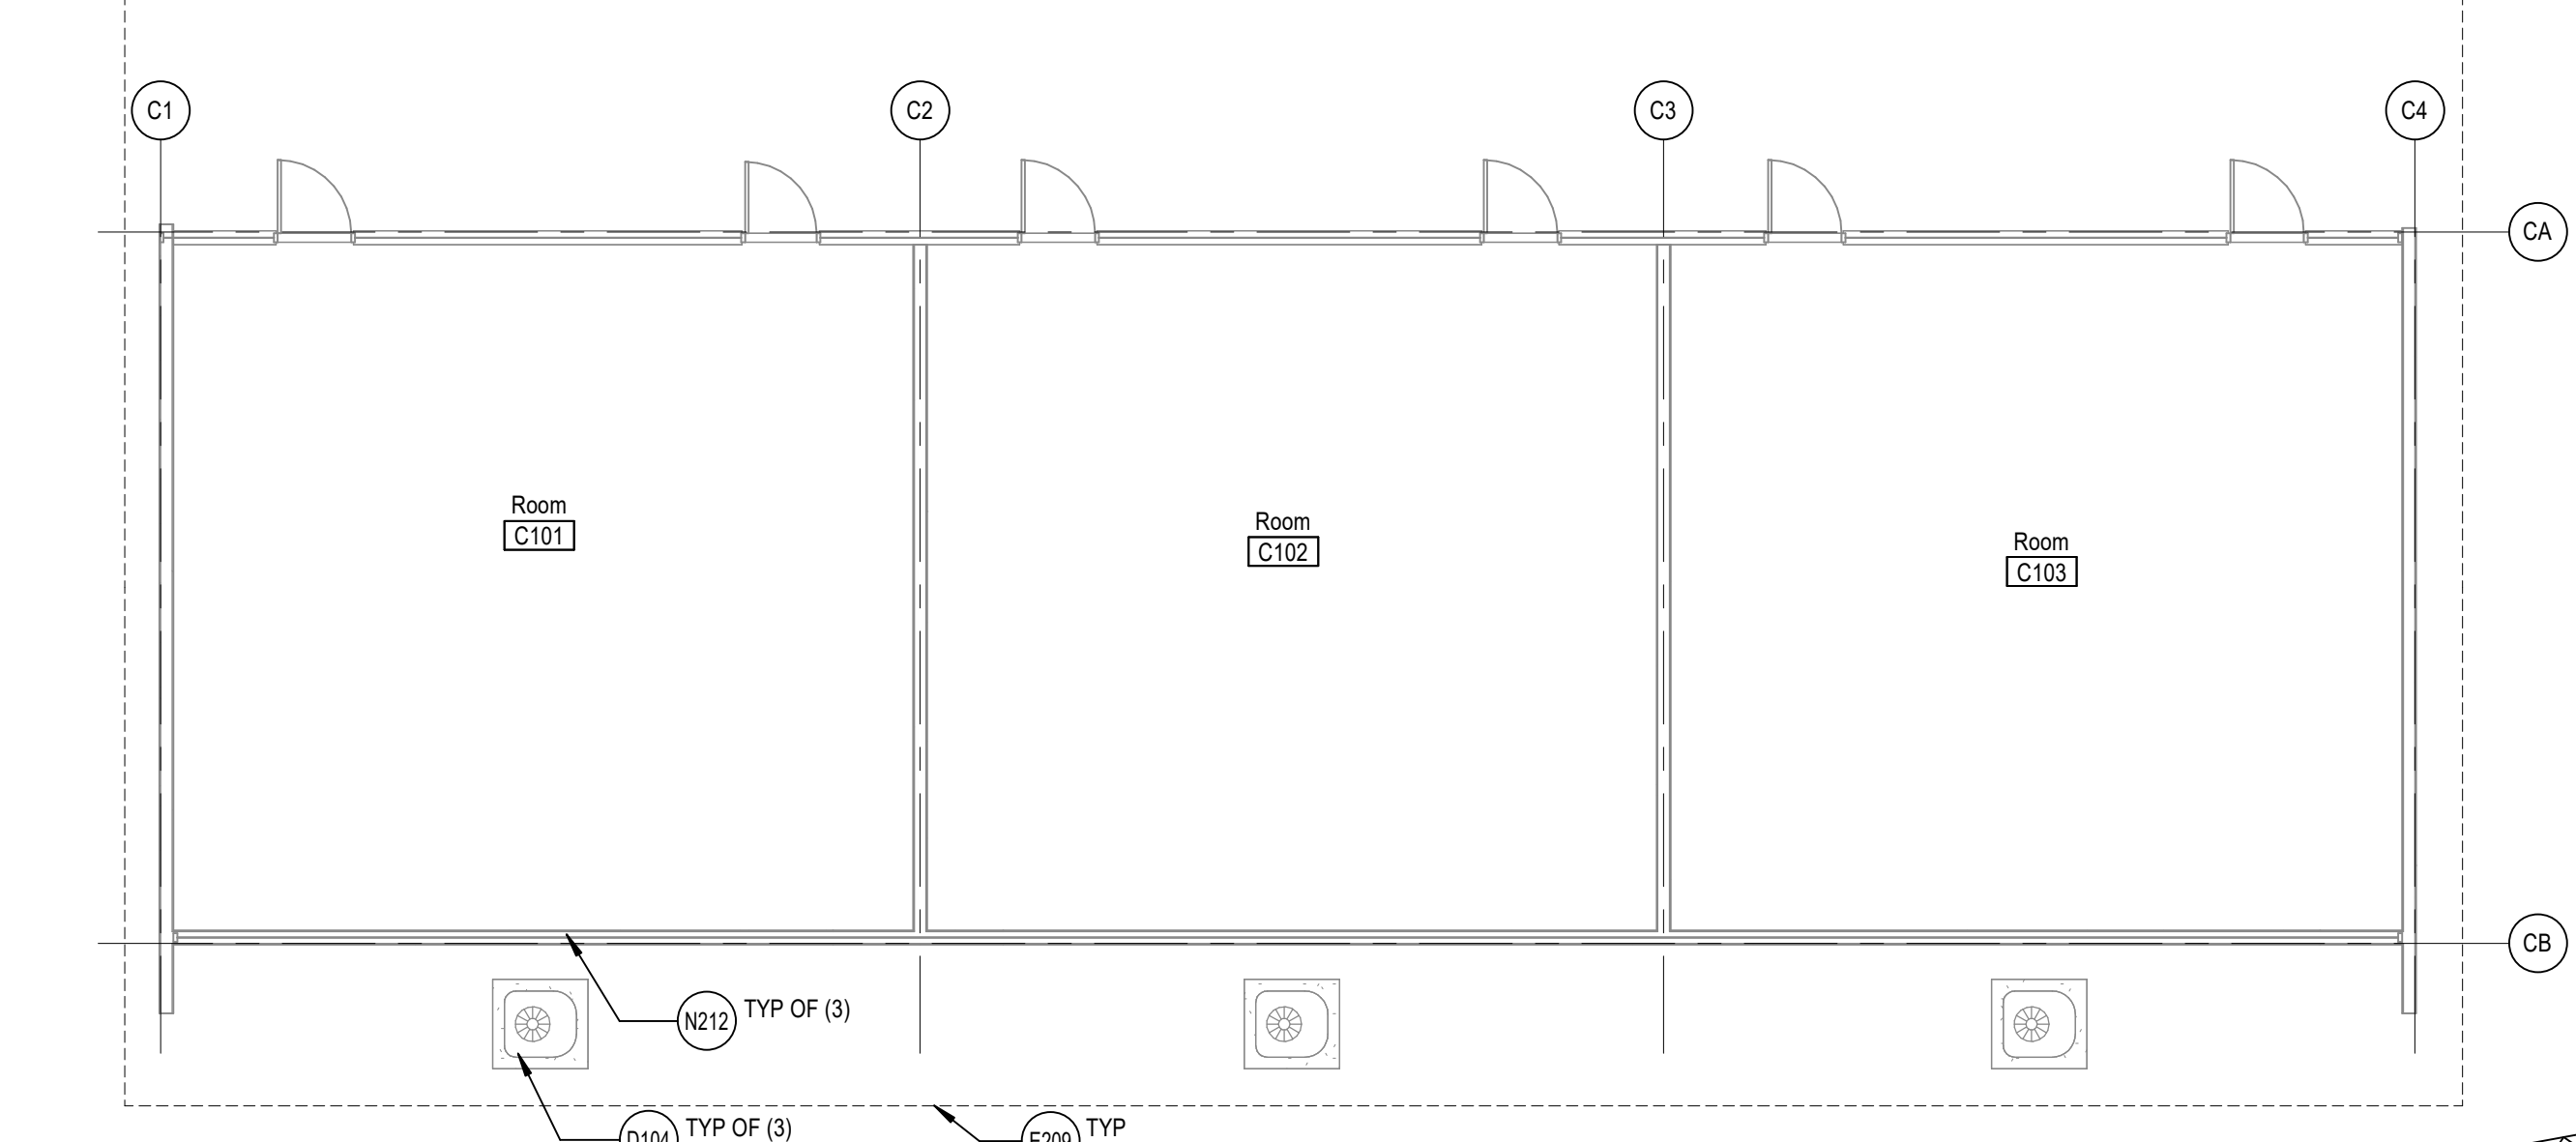


6 BUILDING D FLOOR PLAN  
A1.1A SCALE: 1/8" = 1'-0"

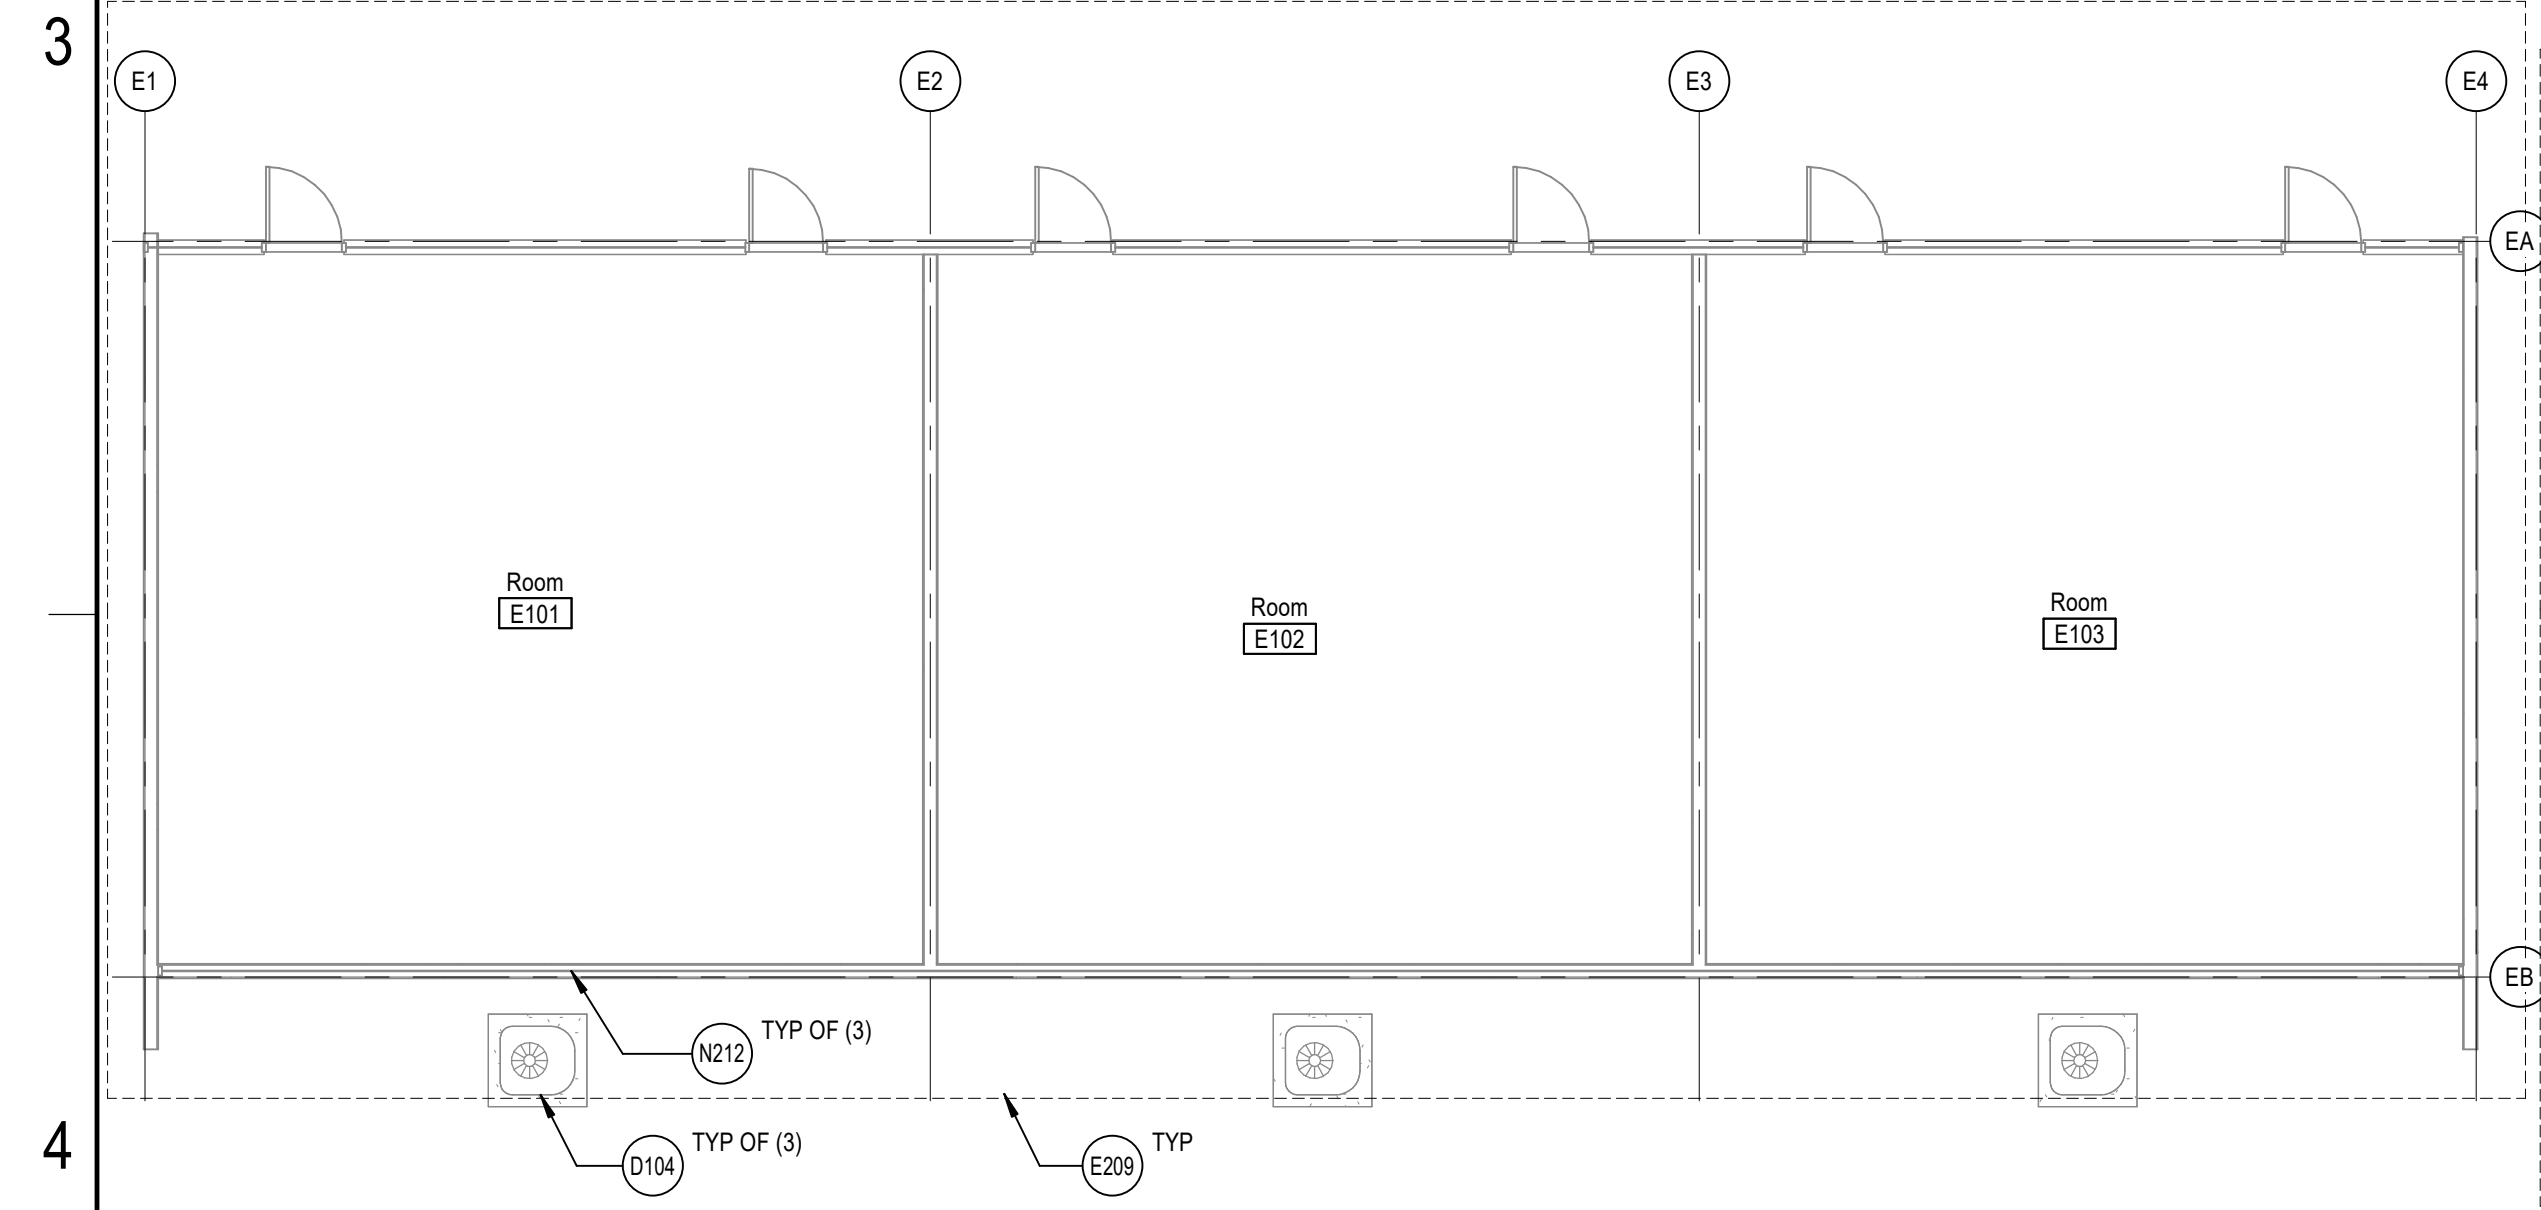


7 BUILDING H FLOOR PLAN  
A1.1A SCALE: 1/8" = 1'-0"

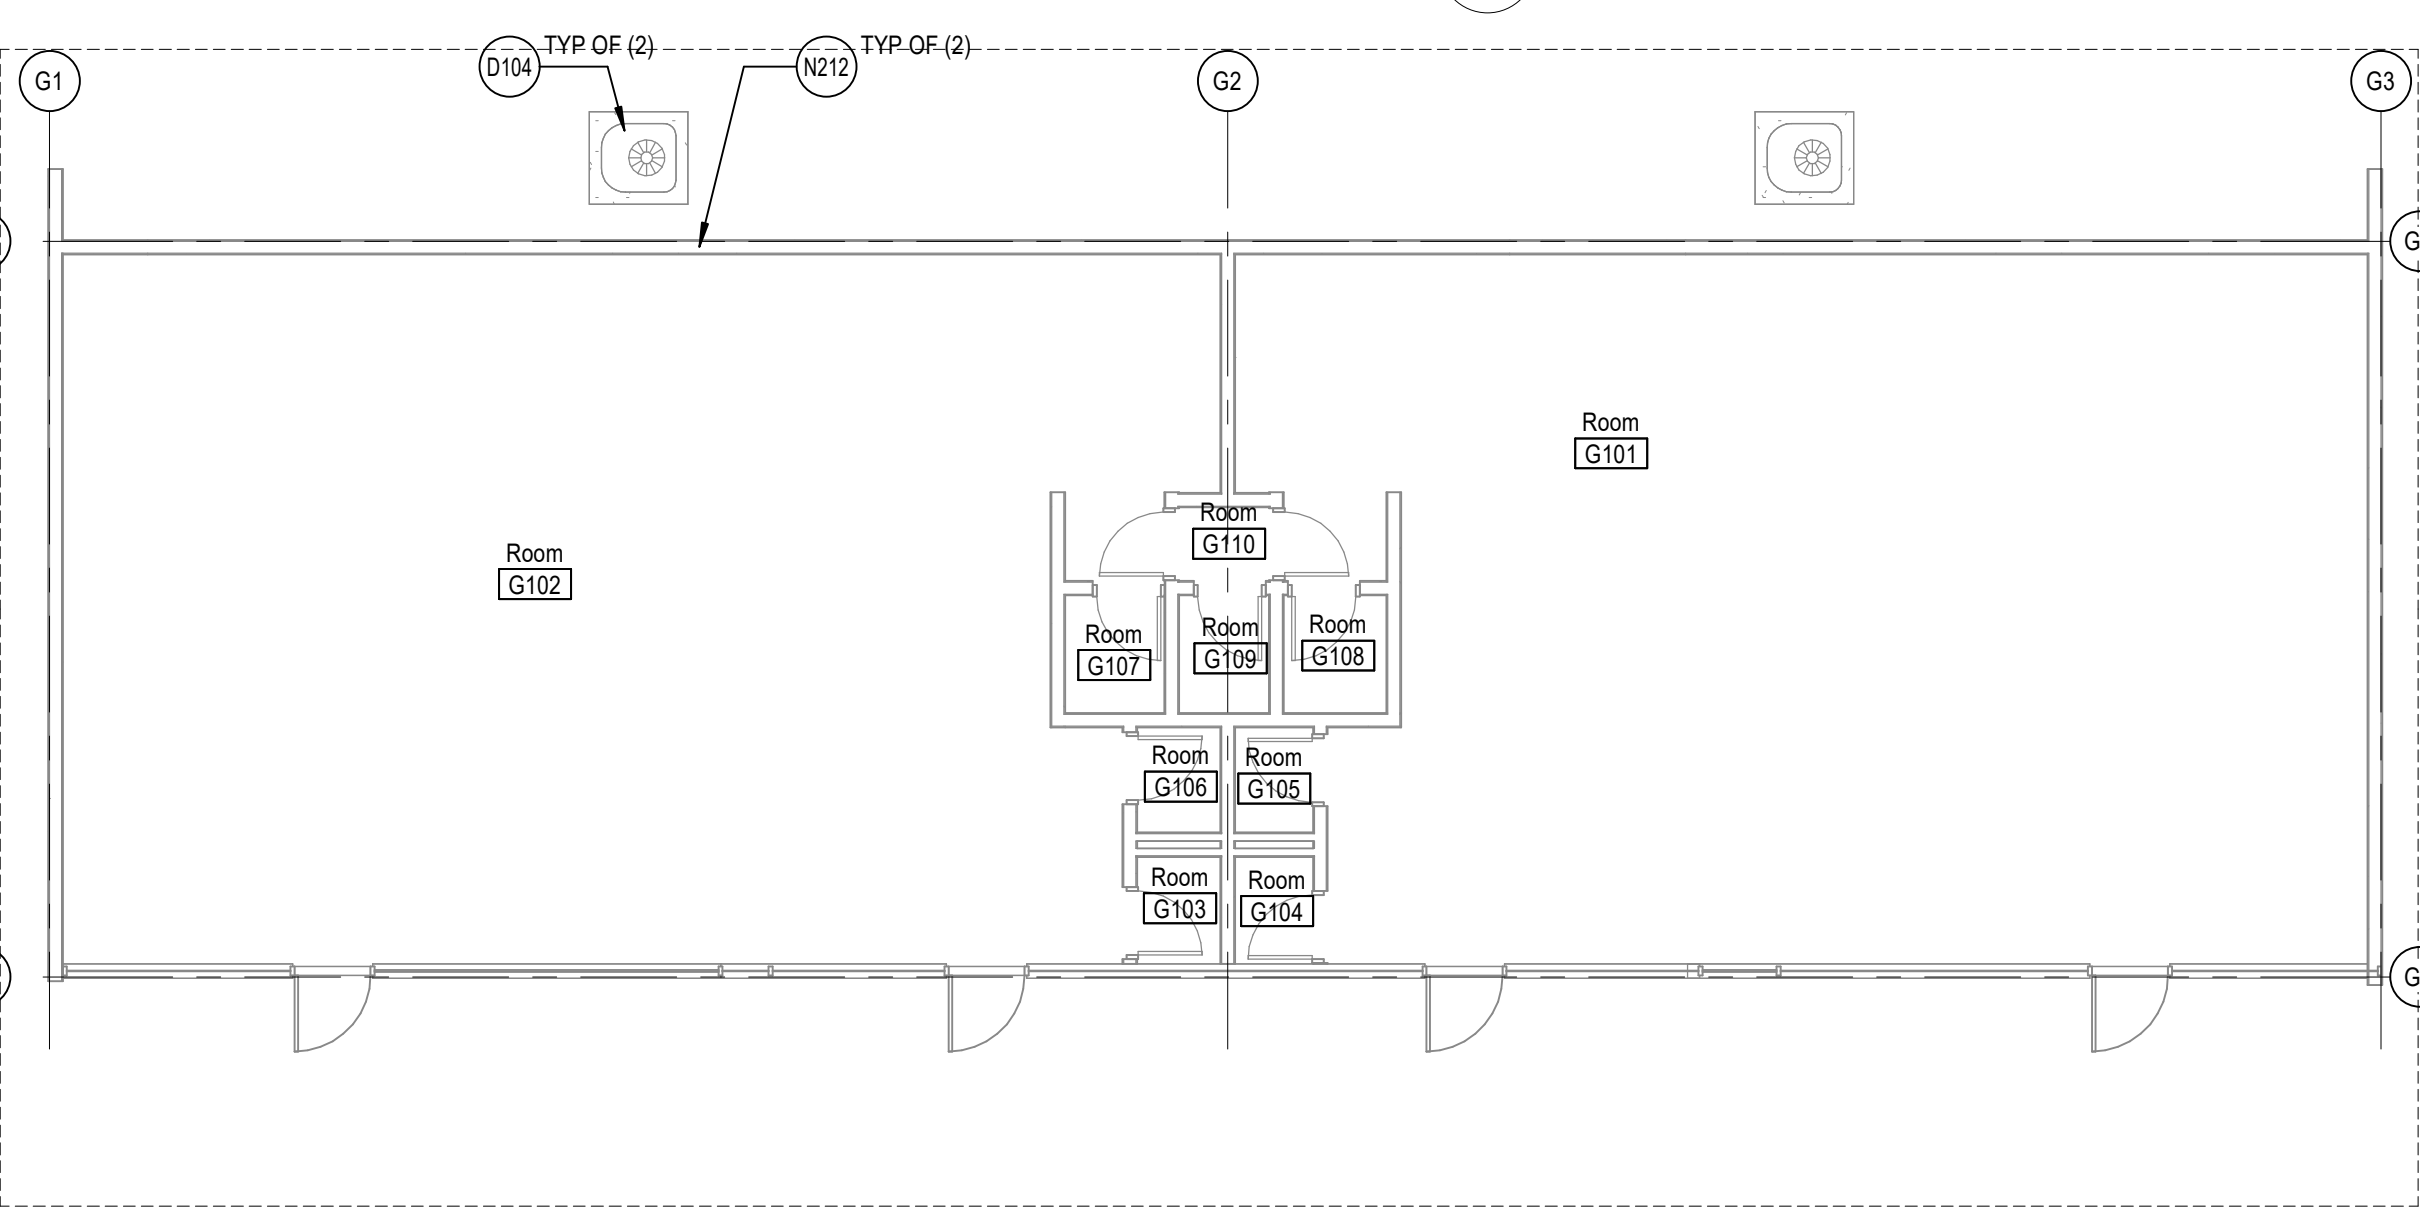


8 BUILDING C FLOOR PLAN  
A1.1A SCALE: 1/8" = 1'-0"

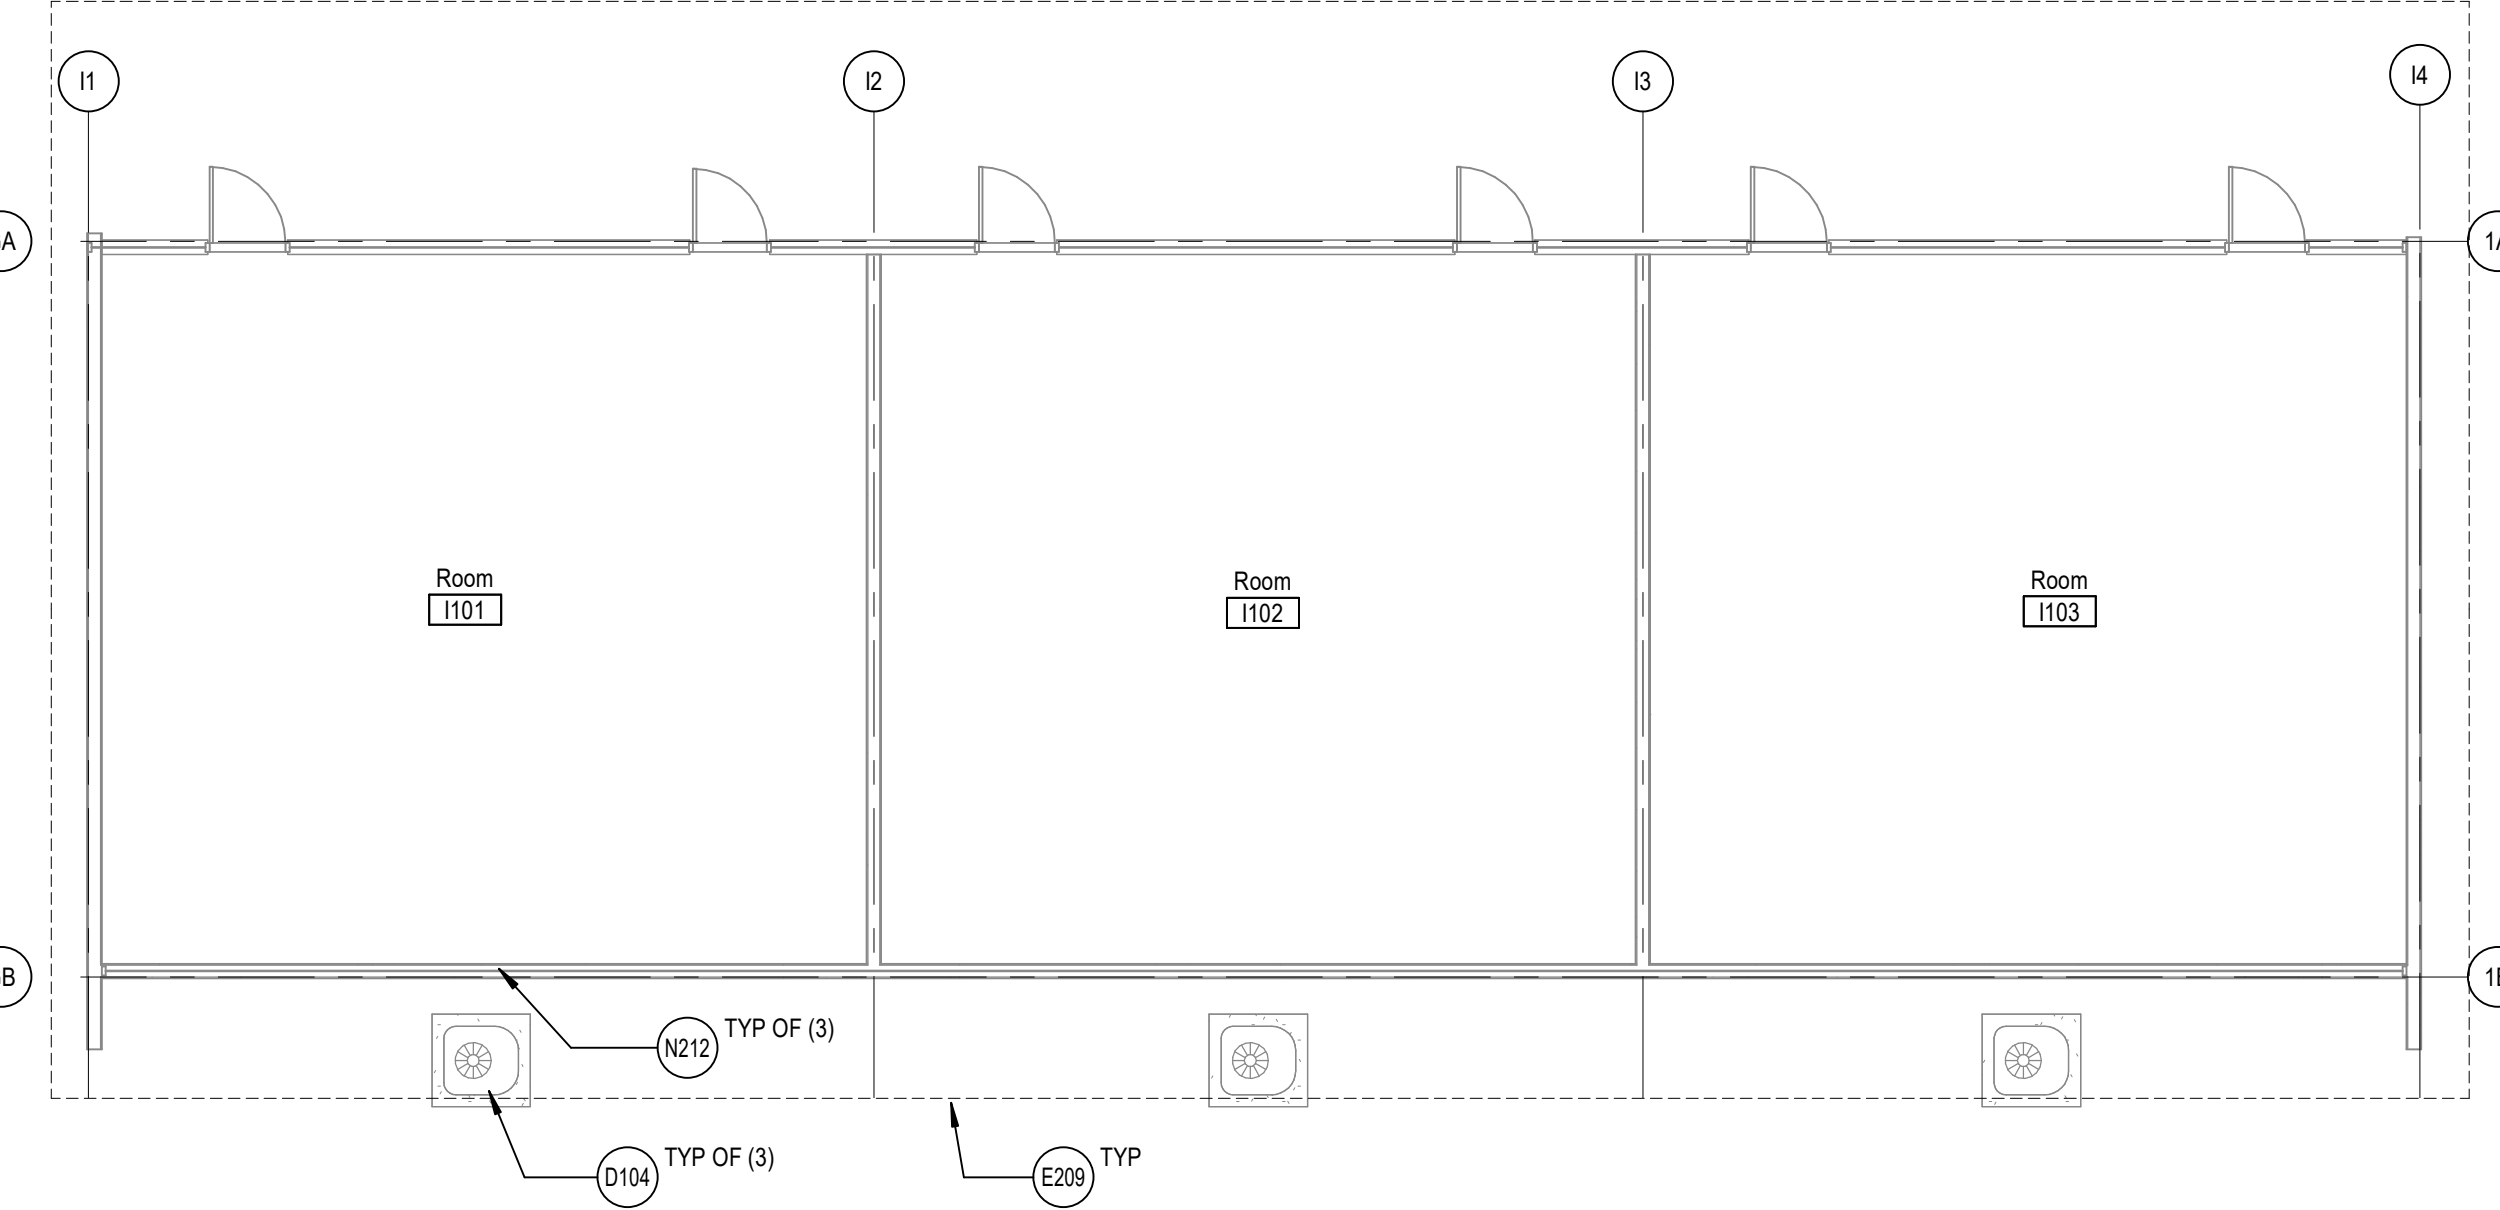

9 BUILDING I FLOOR PLAN  
A1.1A SCALE: 1/8" = 1'-0"

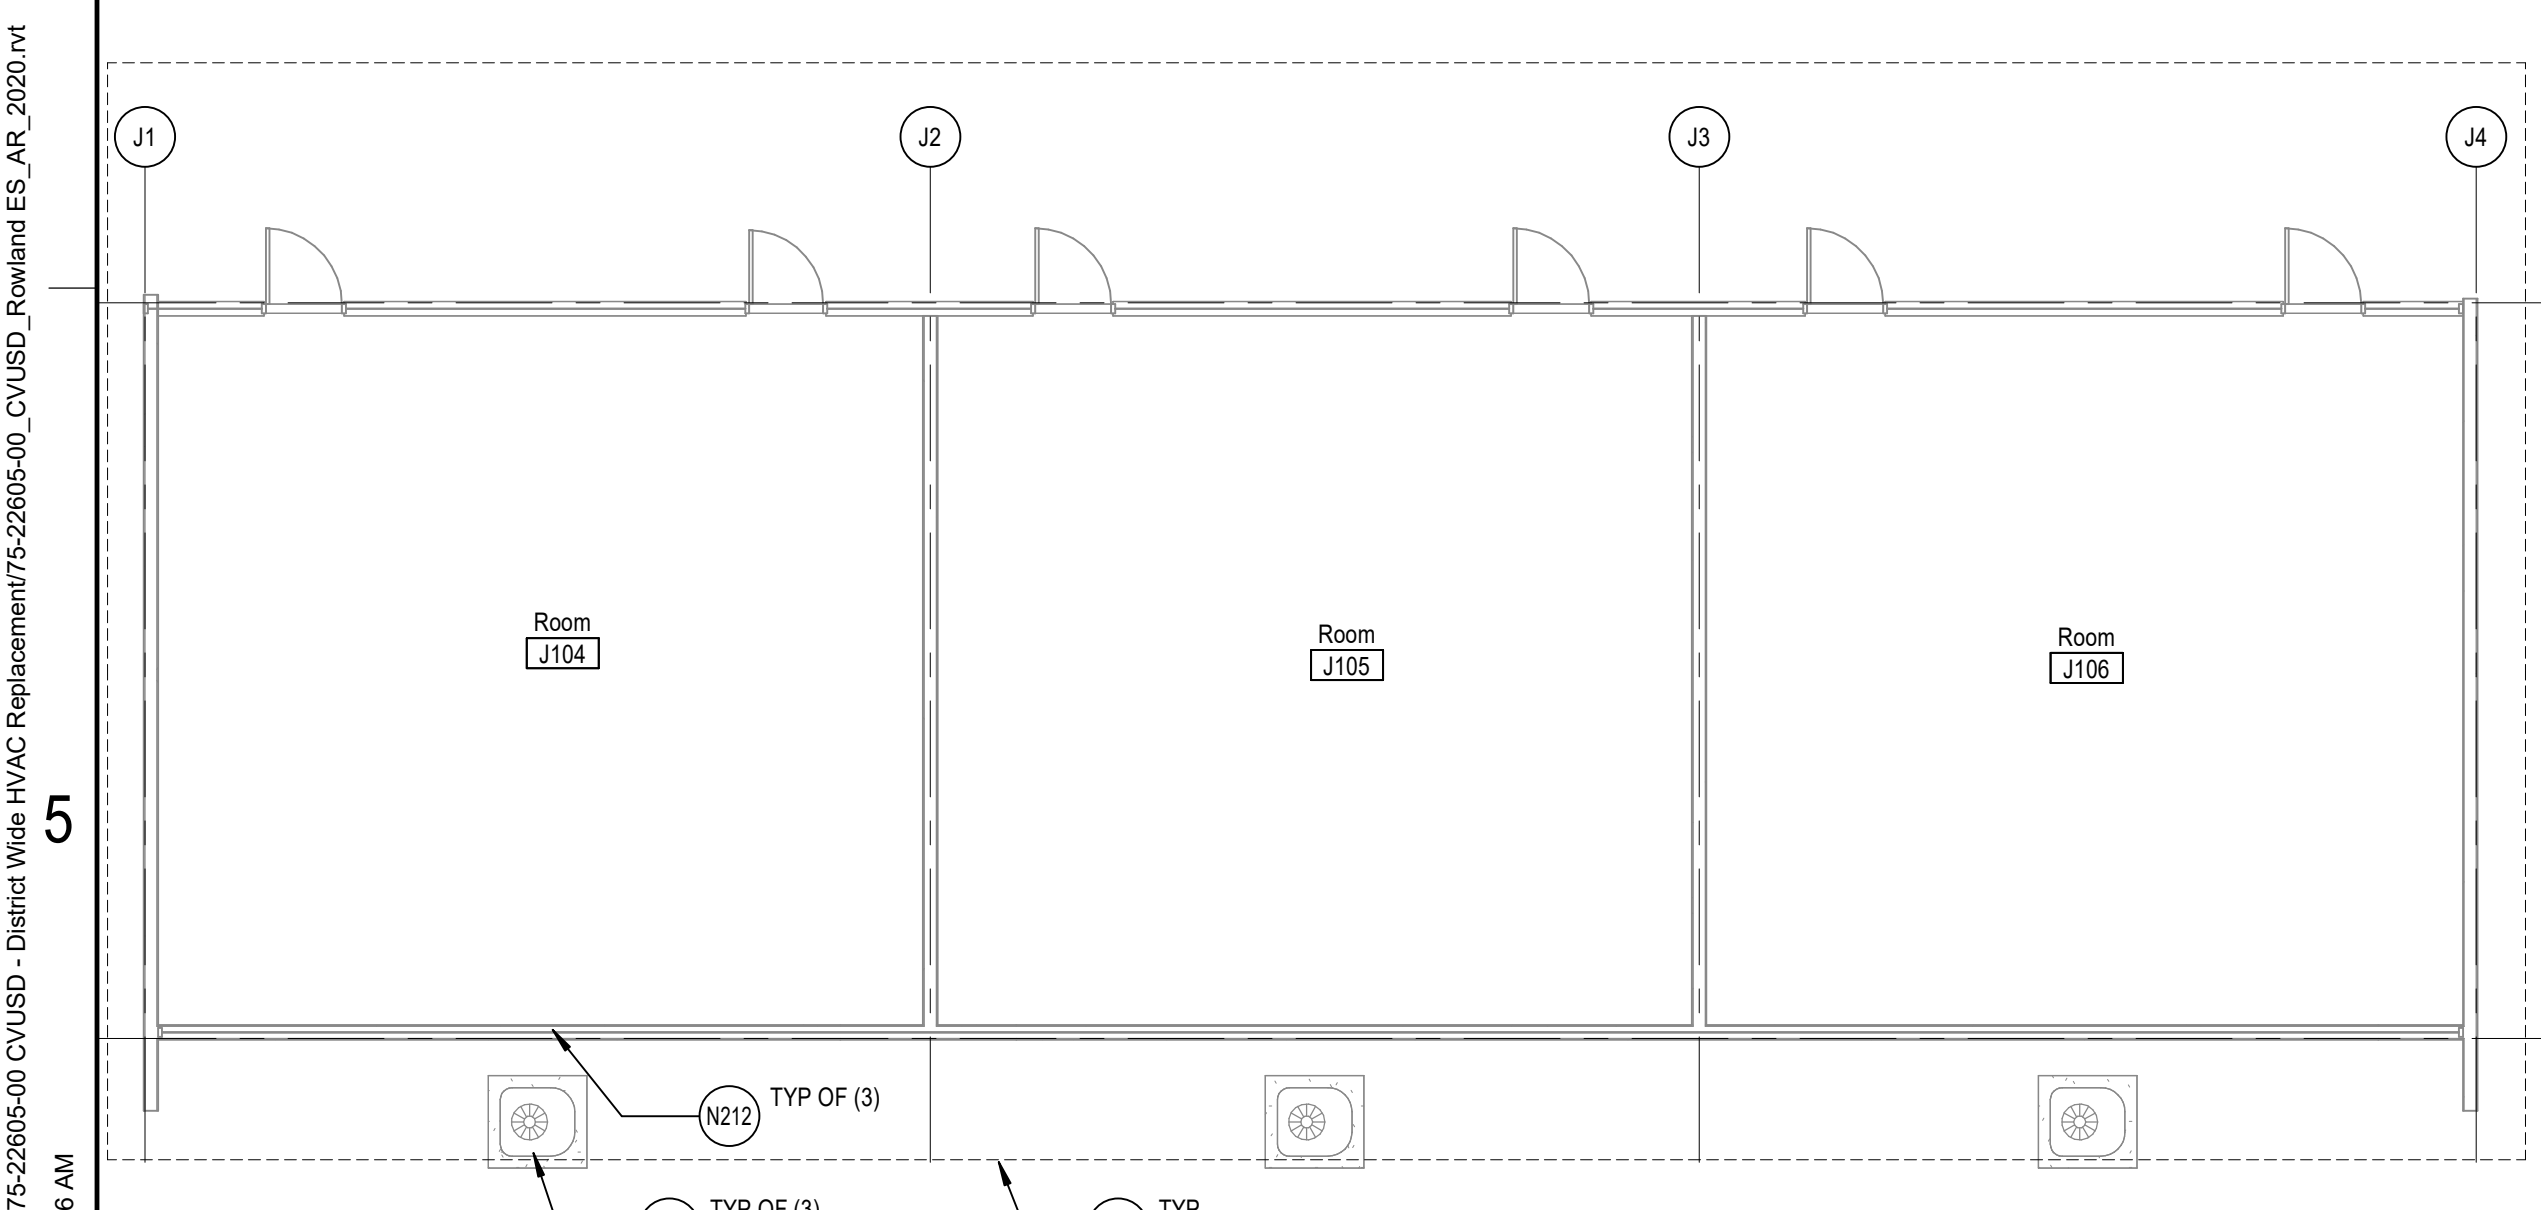

10 BUILDING J FLOOR PLAN  
A1.1A SCALE: 1/8" = 1'-0"

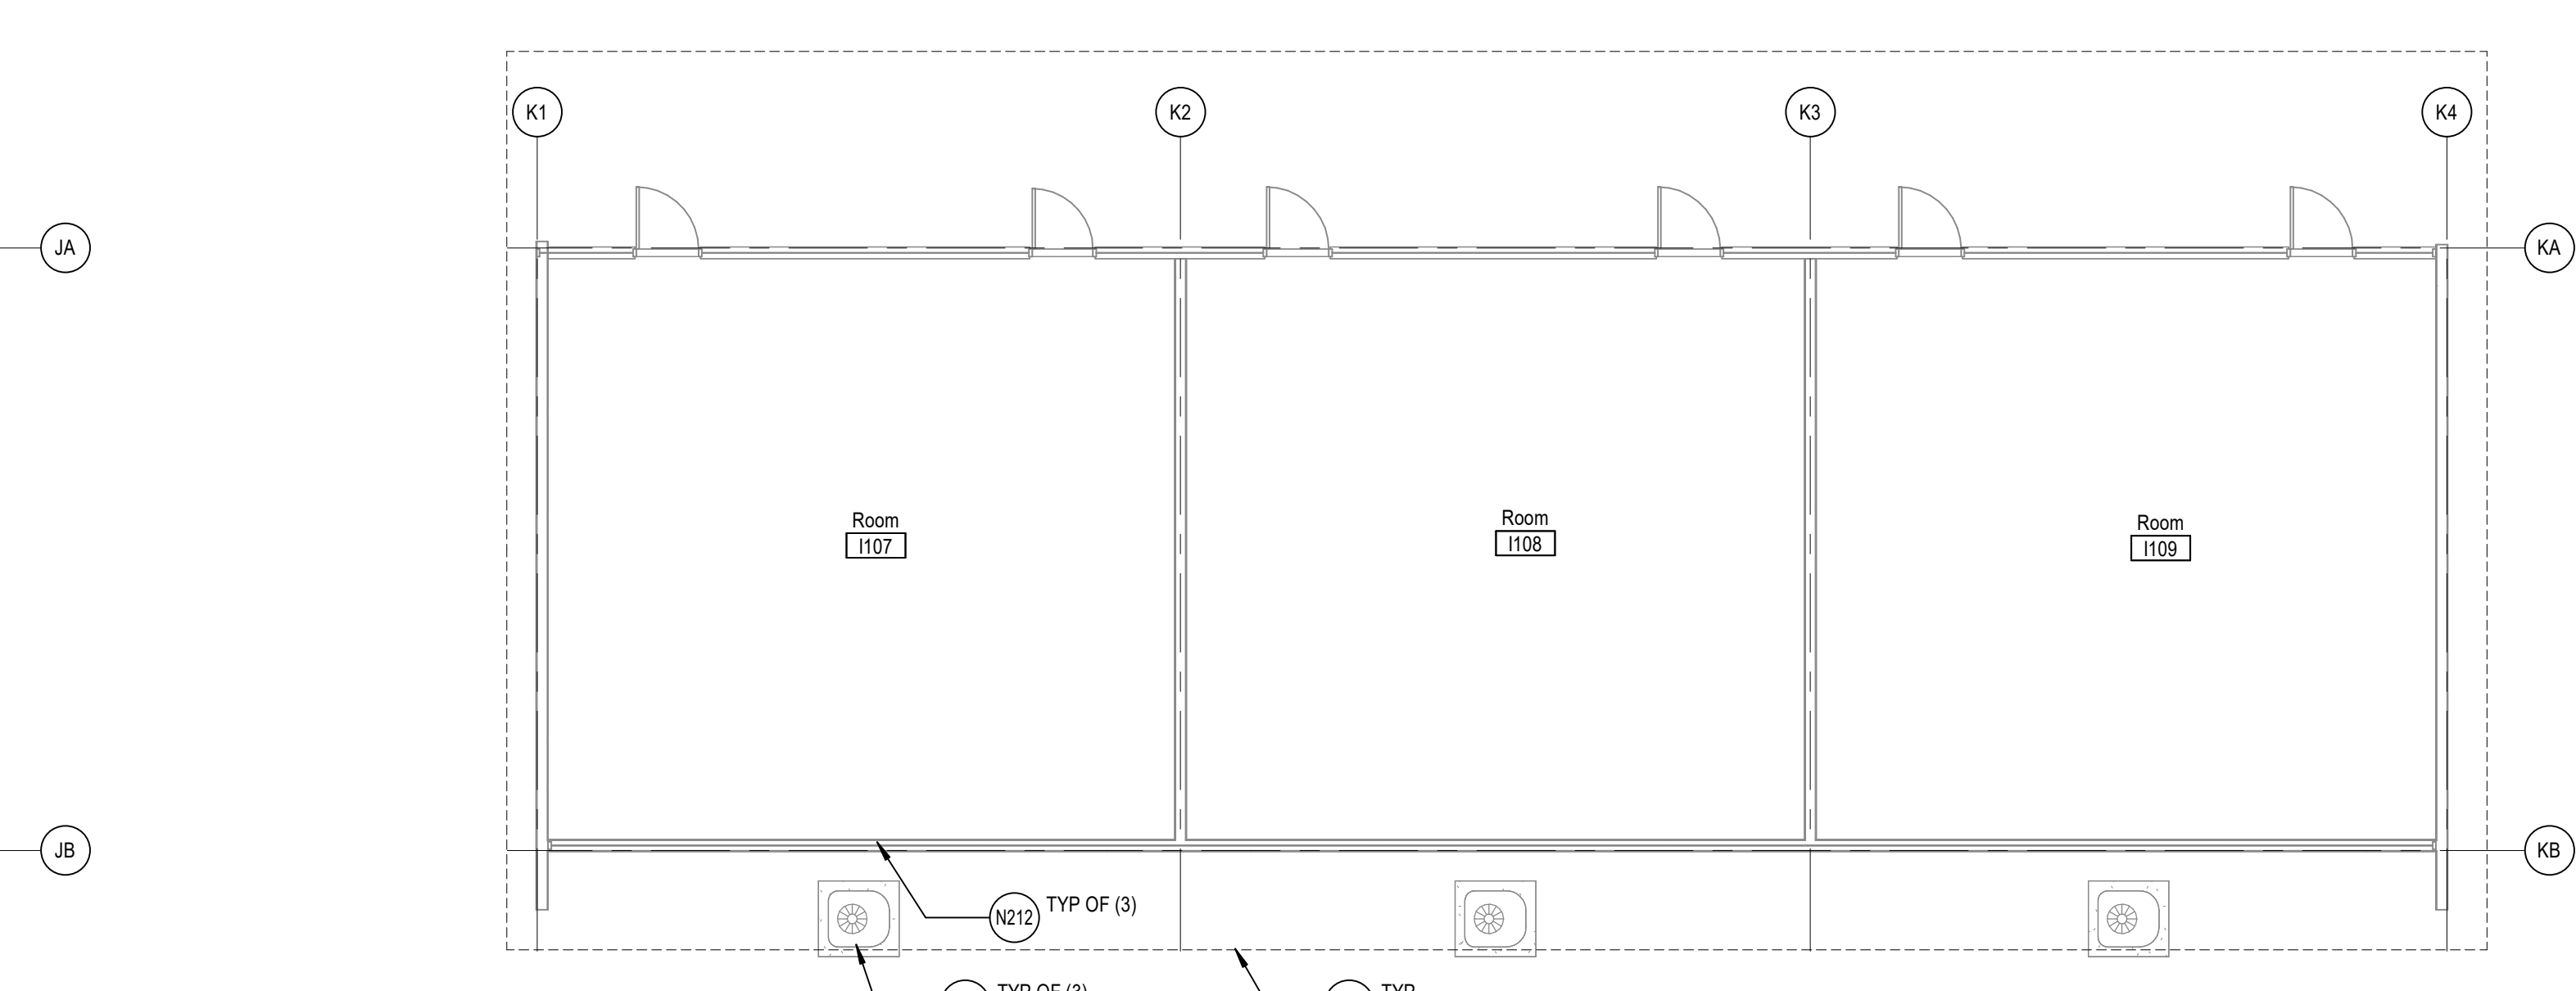

11 BUILDING K FLOOR PLAN  
A1.1A SCALE: 1/8" = 1'-0"

DEMOLITION GENERAL NOTES


- DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.
- THE CONTRACTOR SHALL:
- COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
  - COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
  - CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
  - MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
  - VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
  - REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
  - THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
  - PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
  - REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
  - EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
  - VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
  - PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
  - CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
  - SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
  - AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
  - WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
  - WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

REFERENCE KEYNOTES

- D08 DEMO PORTION OF (E) MEZZANINE FLOOR AND FRAMING. SEE STRUCTURAL DWGS
- D10 ENLARGE (E) OPENING AT (E) MEZZANINE FLOOR TO ALLOW FOR NEW MECH. EQUIPMENT. COORDINATE W/ MECH AND STRUCTURAL
- D104 REMOVE (E) MECHANICAL EQUIP. EQUIP. CONC. PAD, & ITS ASSOCIATED PARTS. SEE MECHANICAL & PLUMBING DWG.
- D190 REMOVE (E) LADDER
- N158 NEW MECHANICAL EQUIPMENT ON NEW 6" THK. TOP LEVEL CONCRETE PAD & PLACED 6" FROM EDGE OF PAD. SEE MECH DWGS
- N212 REPLACE (E) INFILL PANEL AT CONDENSER UNIT PENETRATIONS WITH GLAZING TO MATCH ADJACENT. PAINT FRAME TO MATCH ADJACENT
- N610 NEW MECH. EQUIPMENT. SEE MECHANICAL DWGS.

GENERAL ARCHITECTURAL NOTES

- ALL INTERIOR CMU WALLS SHALL BE TO REMAIN U.N.O.
- SEE STRUCTURAL DRAWINGS FOR BRACING OF NON-LOAD BEARING MASONRY WALLS
- FURNISH AND INSTALL FIRE-TREATED WOOD BLOCKING OR METAL BACKING PLATE IN METAL STUD PARTITIONS FOR THE PROPER ANCHORAGE OF ALL ATTACHED ITEMS, I.E. TOILET ACCESSORIES, CASEWORK, MILLWORK, WALL-MOUNTED FIXTURES, MARKER BOARDS, TACK BOARDS, DOOR STOPS, AUDIO VISUAL BRACKETS, AND OTHER WALL ATTACHED ITEMS WHERE OCCURS
- GYPSUM BOARD SURFACES SHALL BE ISOLATED WITH CONTROL JOINTS WHERE SHOWN ON DRAWINGS AND AS DESCRIBED IN THE SPECIFICATIONS.
- MASONRY CONTROL JOINTS (CJ) AND CONTROL JOINTS ABOVE (CA) SHALL BE LOCATED AS SHOWN ON THE FLOOR PLAN AND BUILDING ELEVATIONS, AND WHERE LARGE PLUMBING VENTS OR RISERS OCCUR IN SINGLE WYTHE MASONRY WALLS, AND WHERE MASONRY WALLS BEARING ON THE CONCRETE FLOOR SLAB ABUT MASONRY WALLS BEARING ON CONCRETE FOOTINGS OR AS INDICATED ON DRAWINGS.
- SCRIBE GYPSUM WALL BOARD OF WALLS AND PARTITIONS TO IRREGULARITIES OF DECK ABOVE. SEAL TIGHTLY AROUND ALL PENETRATIONS.
- MAINTAIN (E) SEISMIC BRACING FOR SUSPENDED CEILINGS OR AS SHOWN ON THE DRAWINGS.

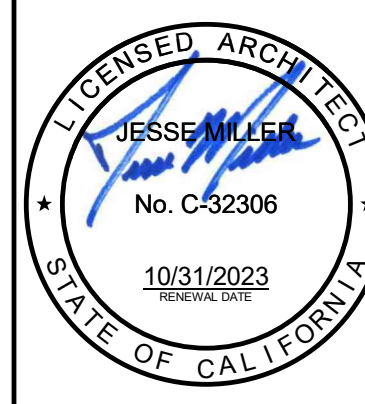

ROWLAND ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY DISTRICT WIDE HVAC REPLACEMENT  
1355 E. ROWLAND AVE. WEST COVINA, CA 91790


100% CONSTRUCTION DOCUMENTS  
11/08/2022 REVISIONS

75-22605-00  
DSA A#03-12233  
DSA File #: 19-25  
FLOOR PLANS


A1.1A

Autodesk Docu/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD - Rowland ES\_A1.1A\_2022.dwg  
 11/20/2022 8:52:18 AM




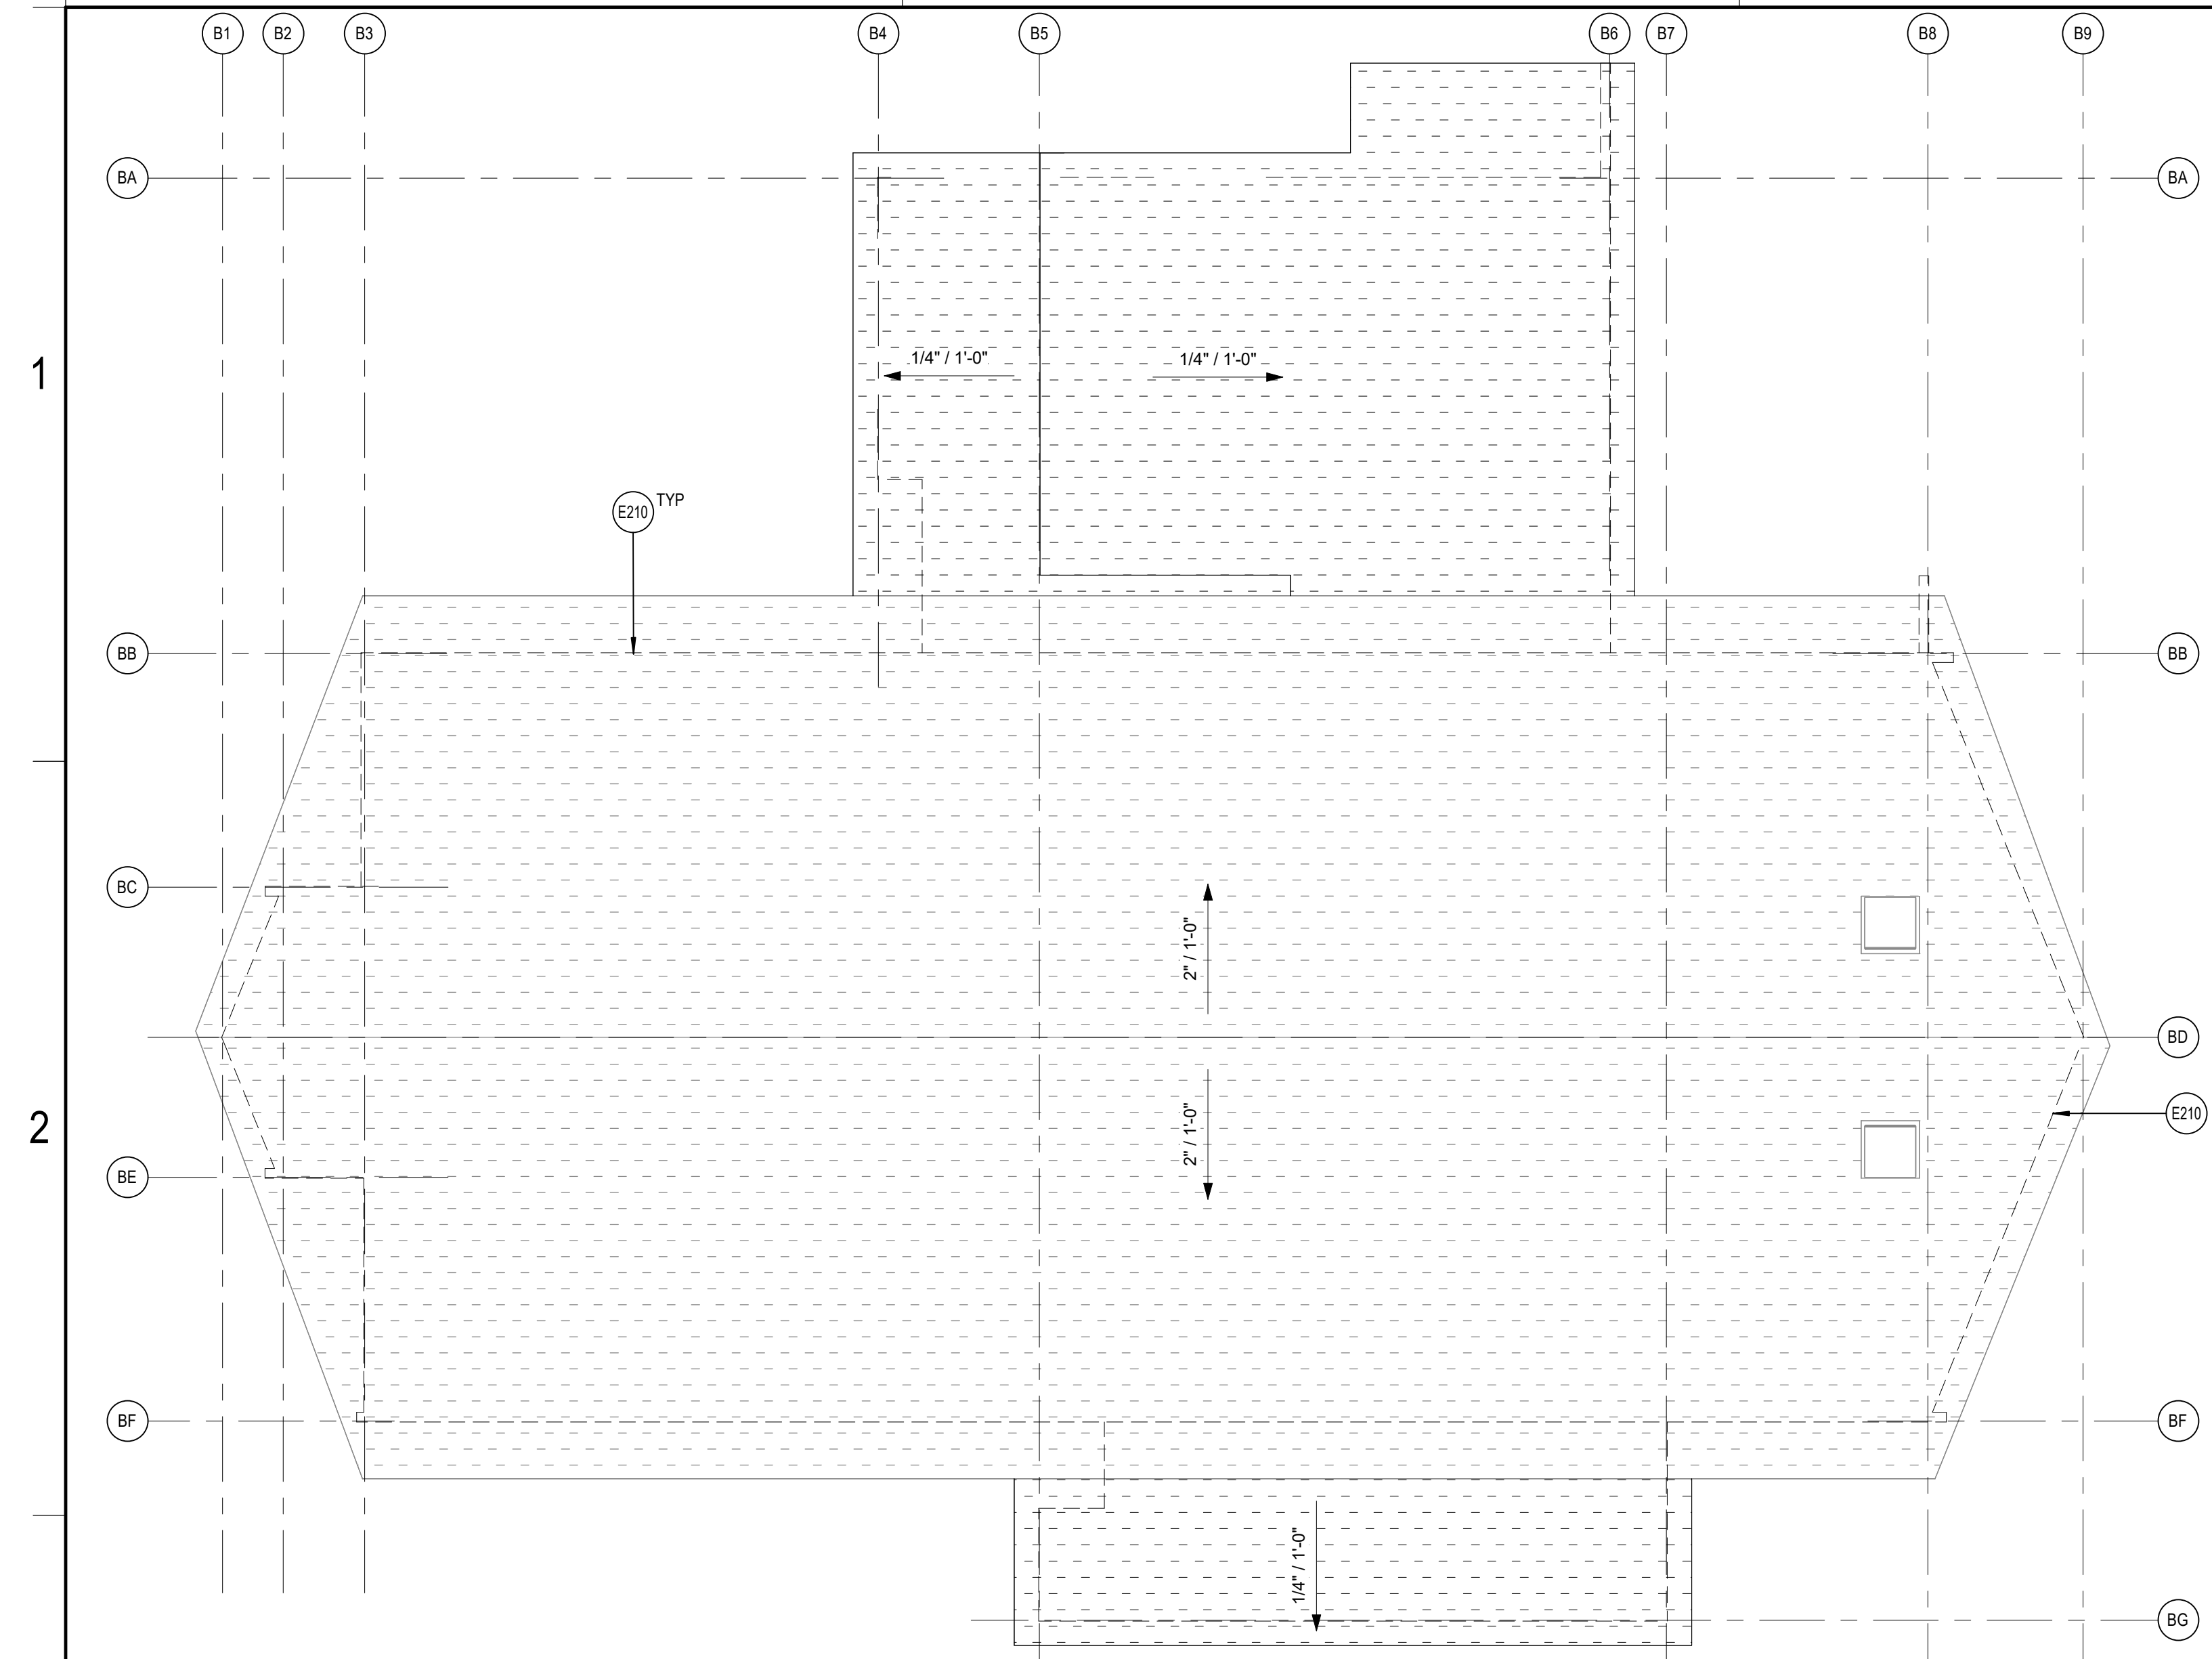


4 BUILDING B ROOF PLAN  
A1.3A / SCALE: 1/8" = 1'-0"

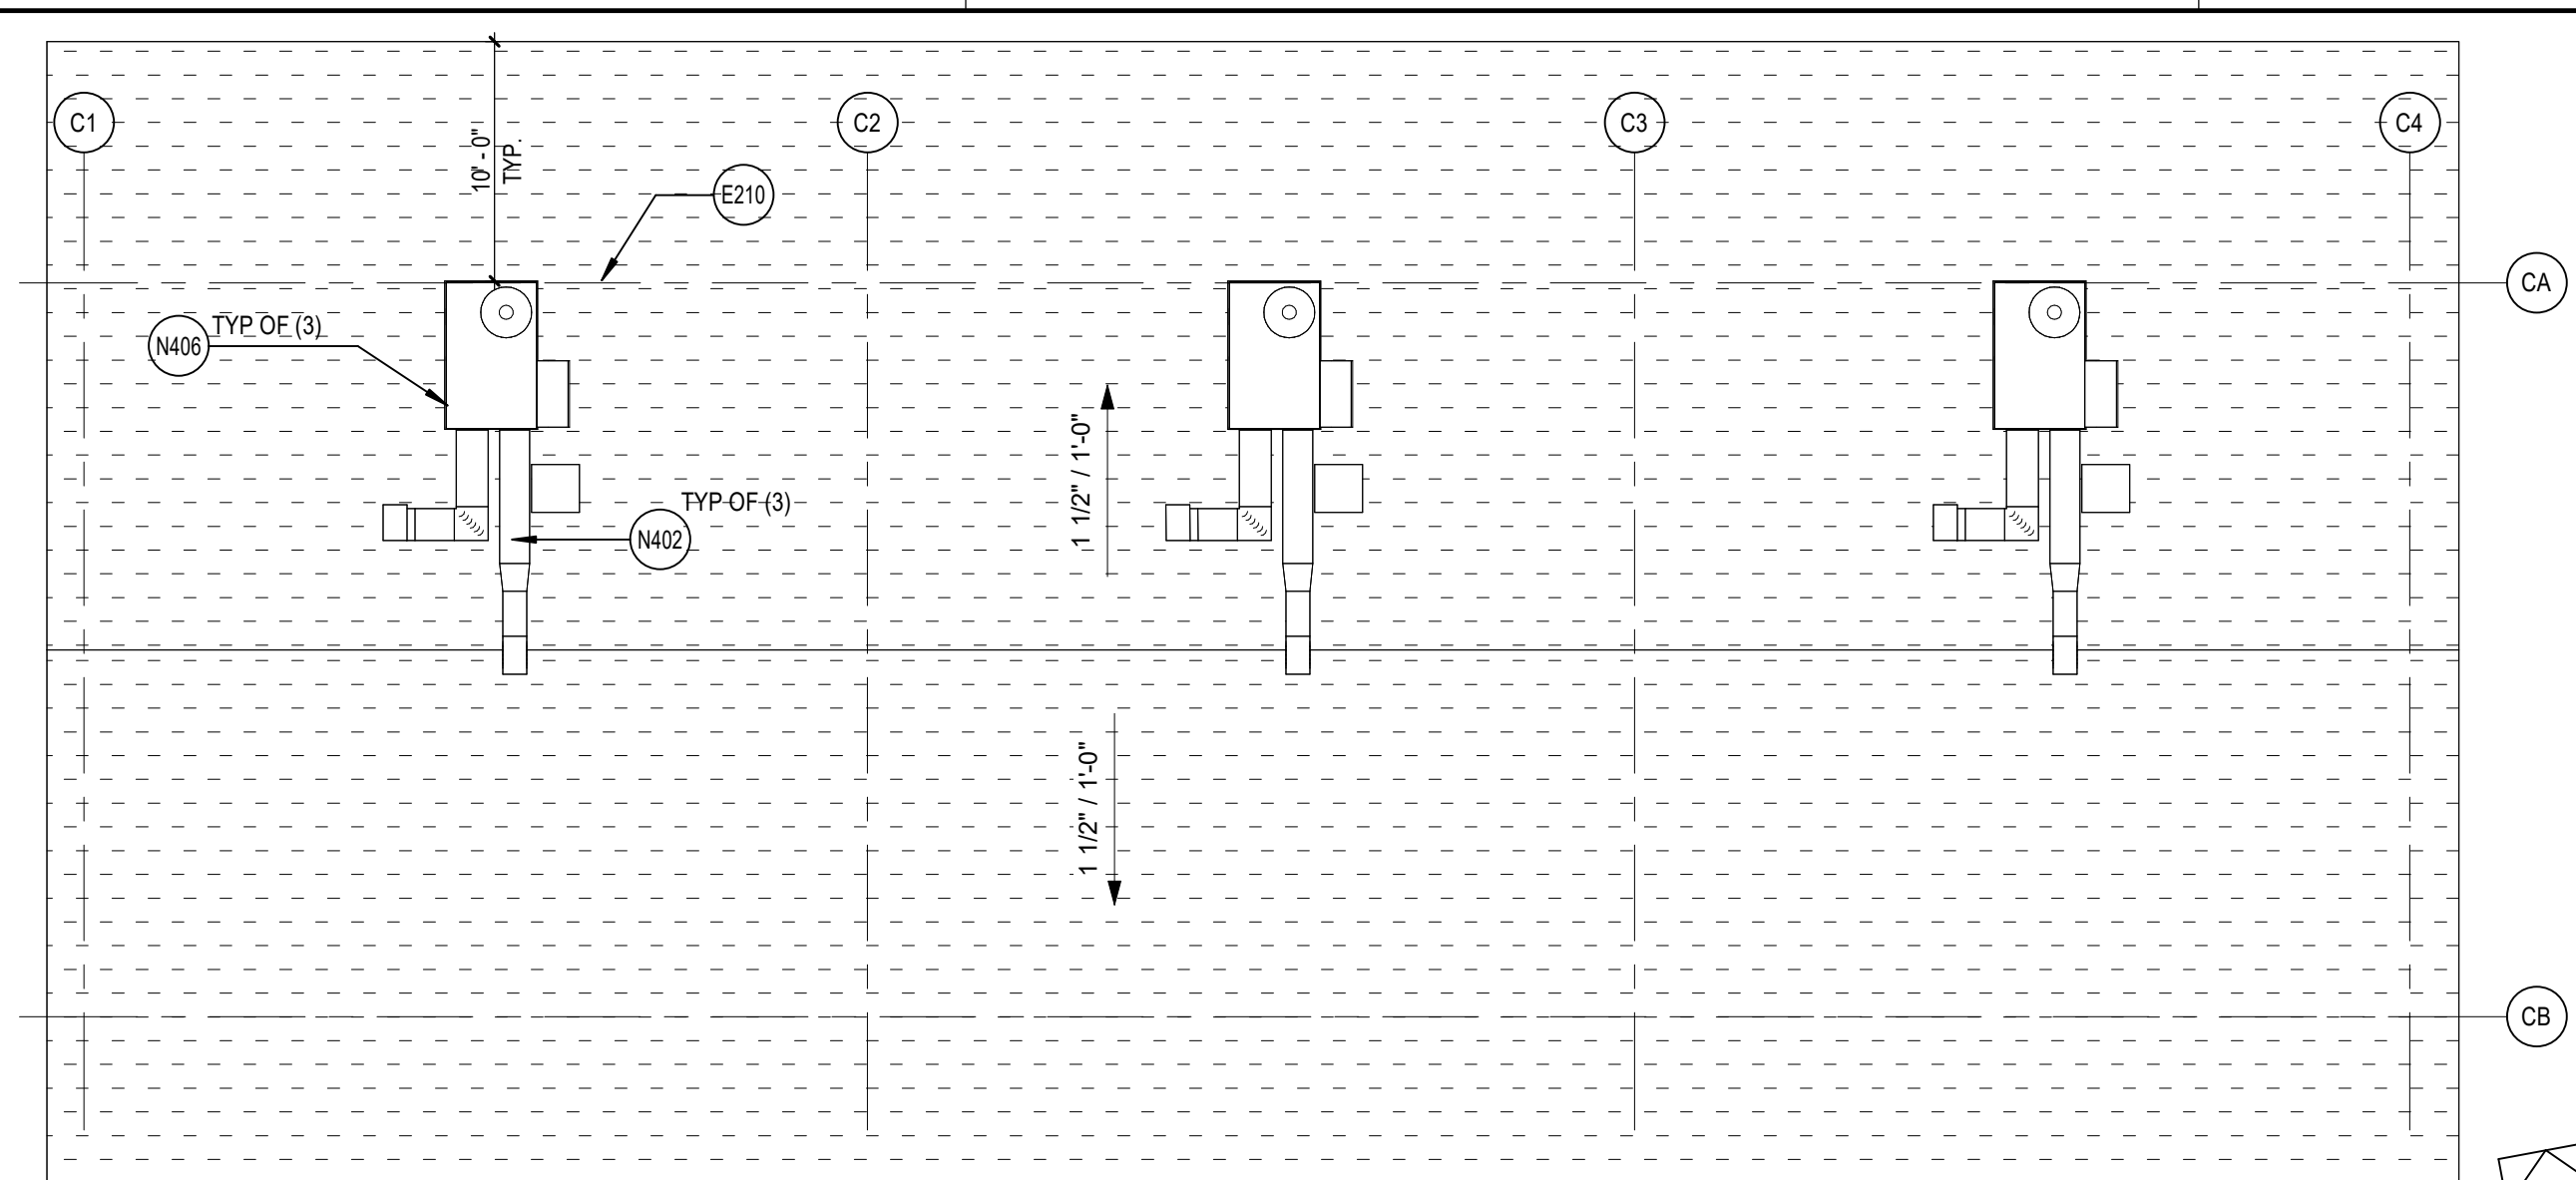


5 BUILDING D ROOF PLAN  
A1.3A / SCALE: 1/8" = 1'-0"

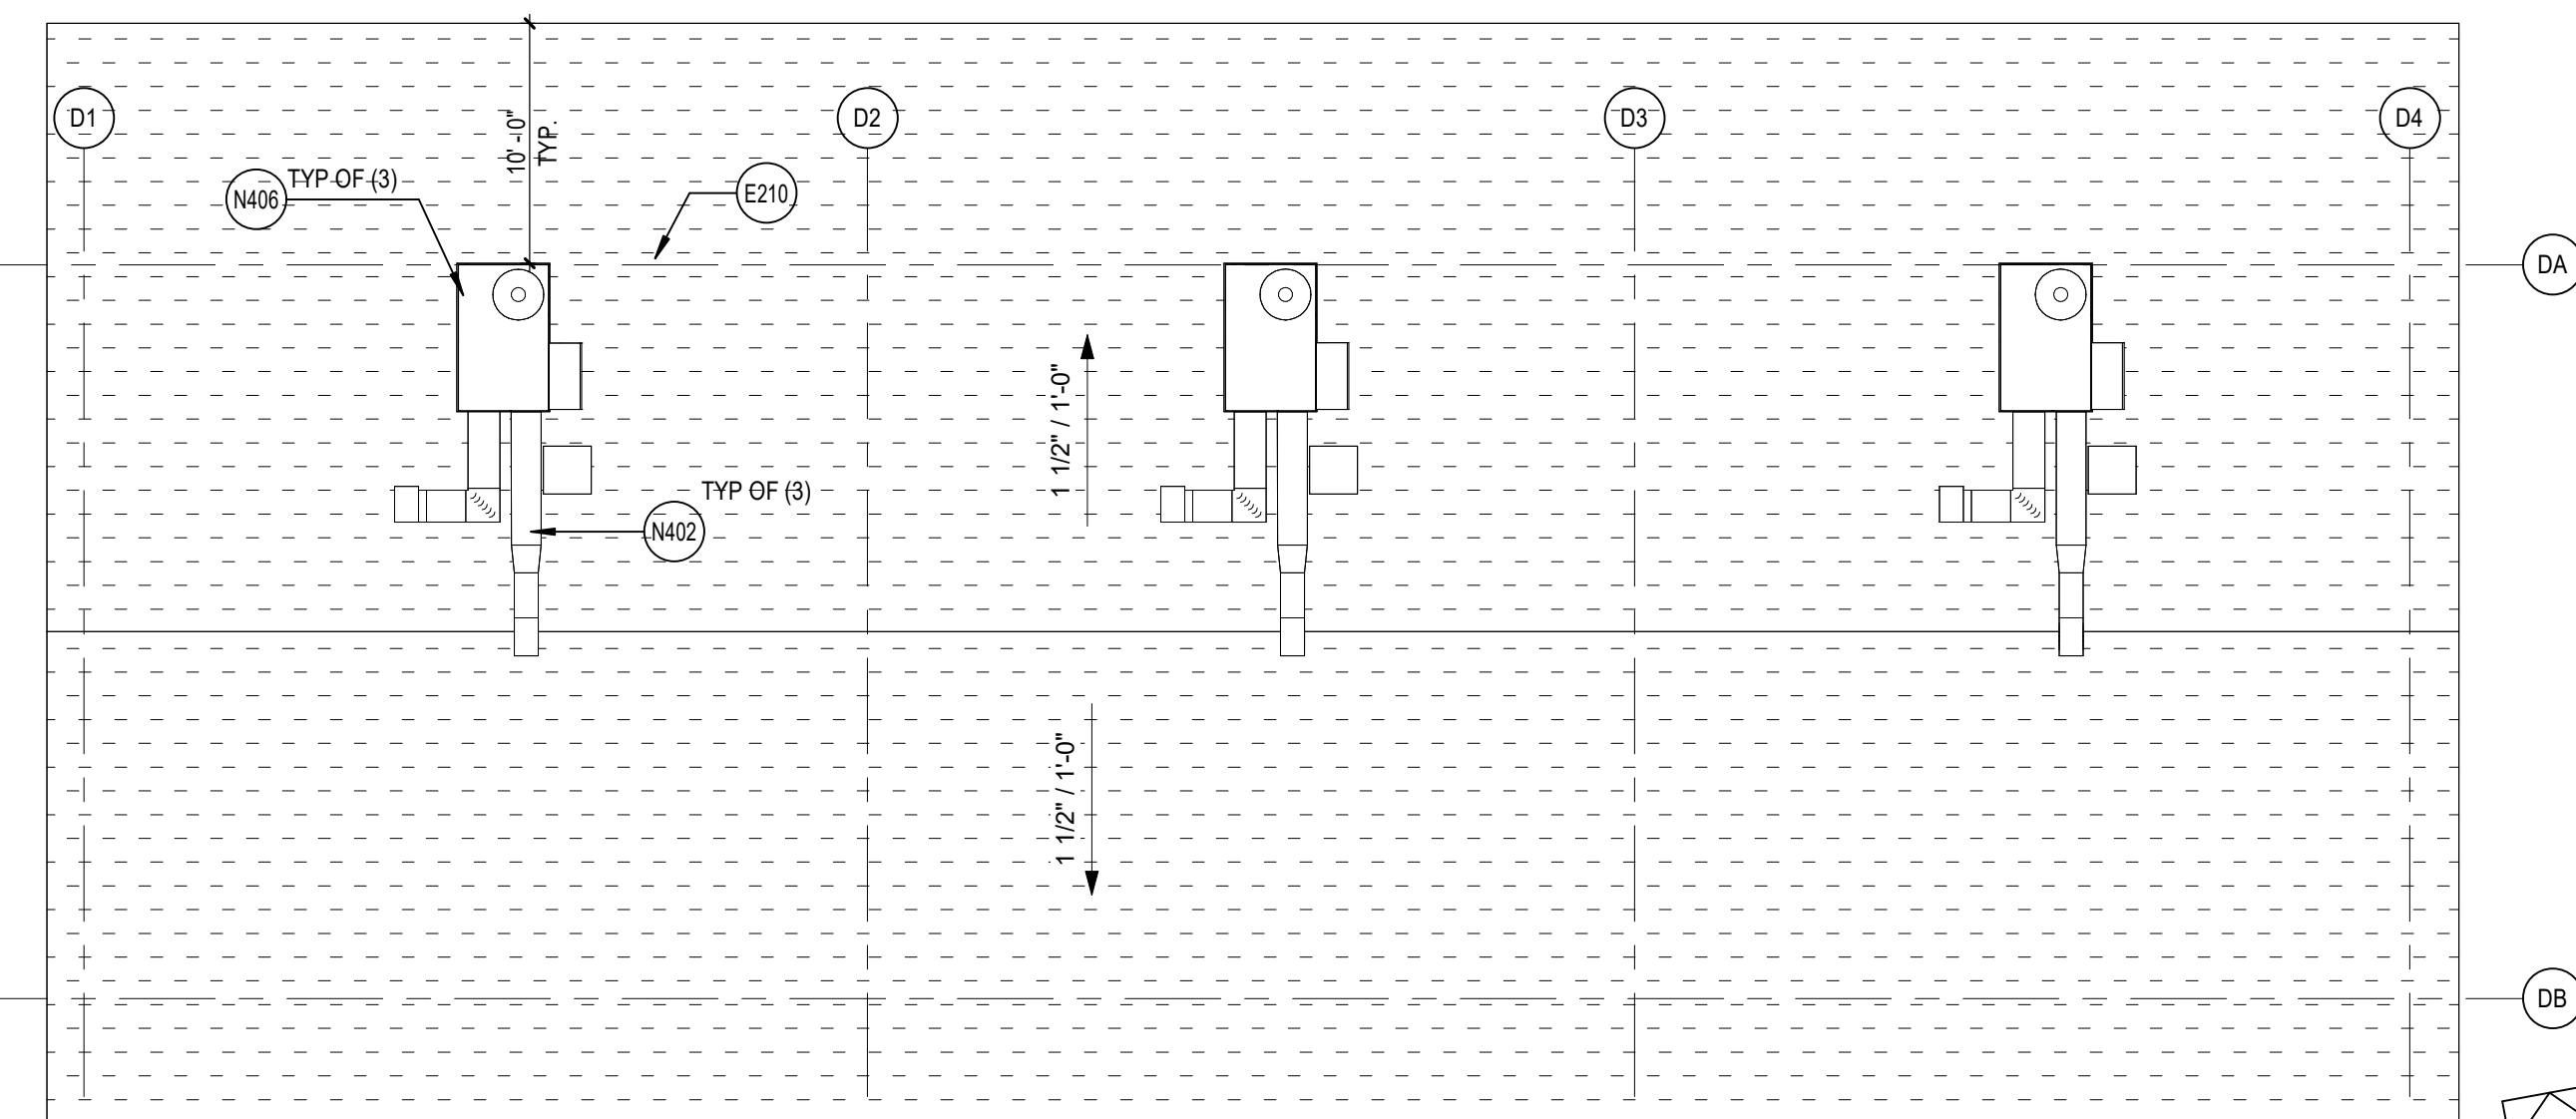


6 BUILDING F ROOF PLAN  
A1.3A / SCALE: 1/8" = 1'-0"

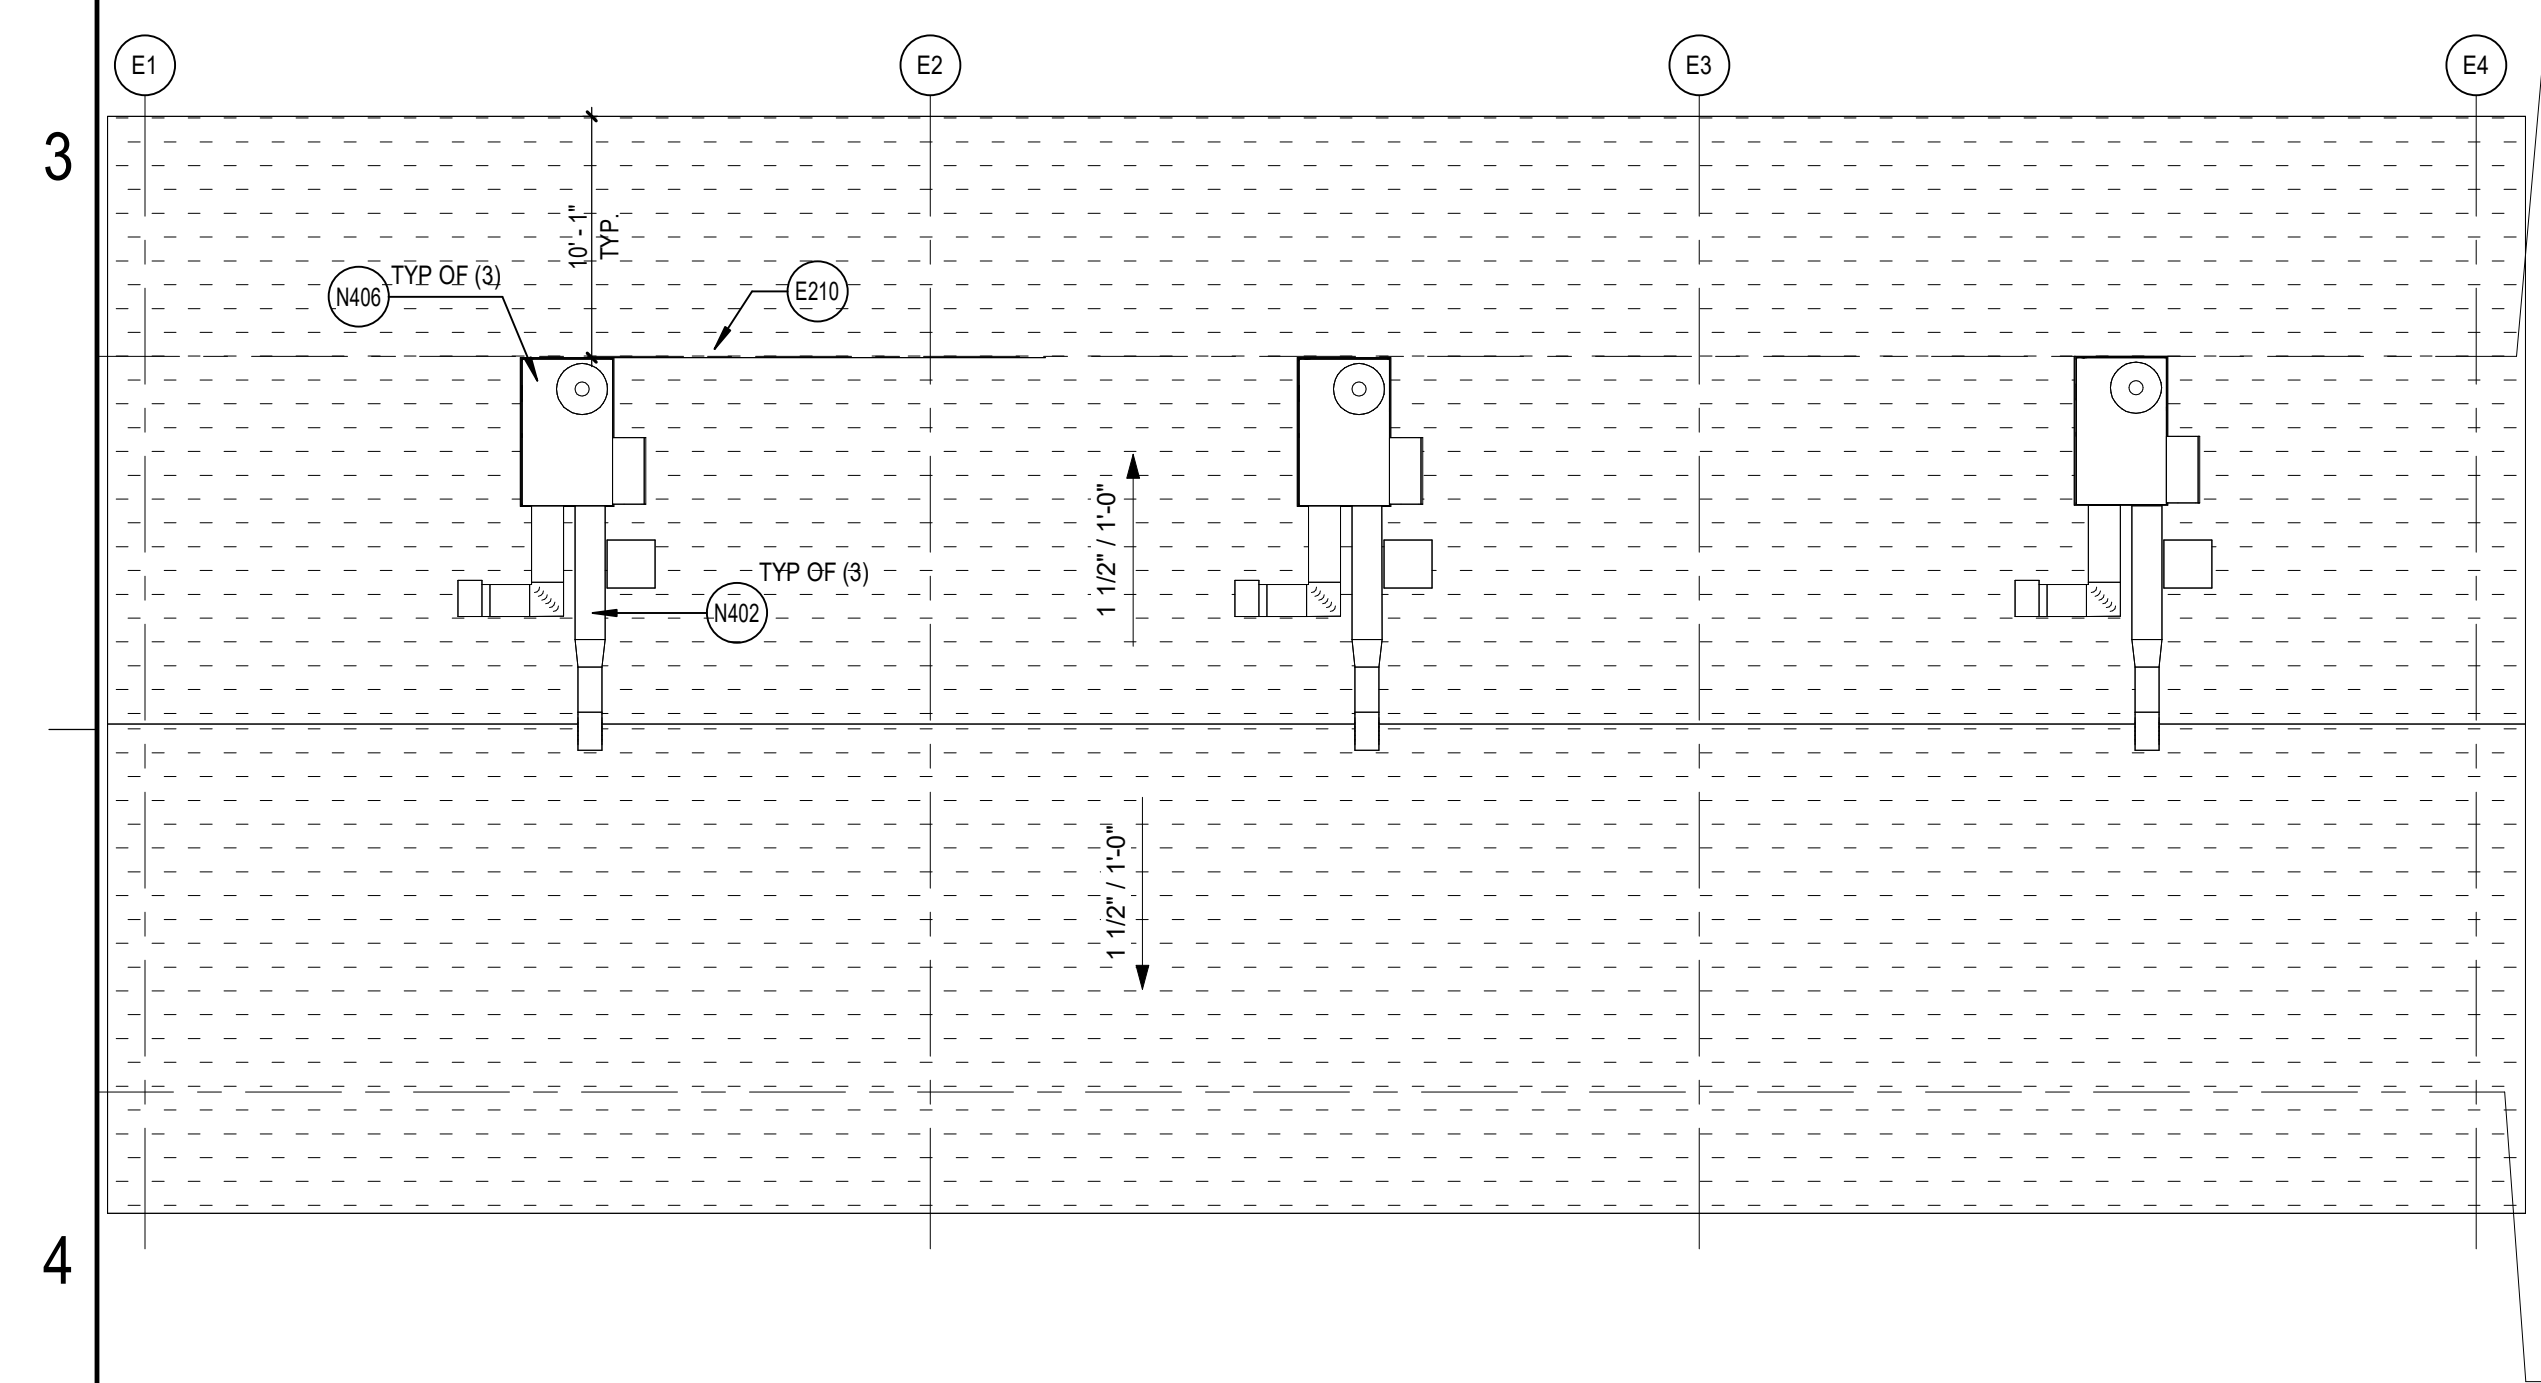


7 BUILDING H ROOF PLAN  
A1.3A / SCALE: 1/8" = 1'-0"

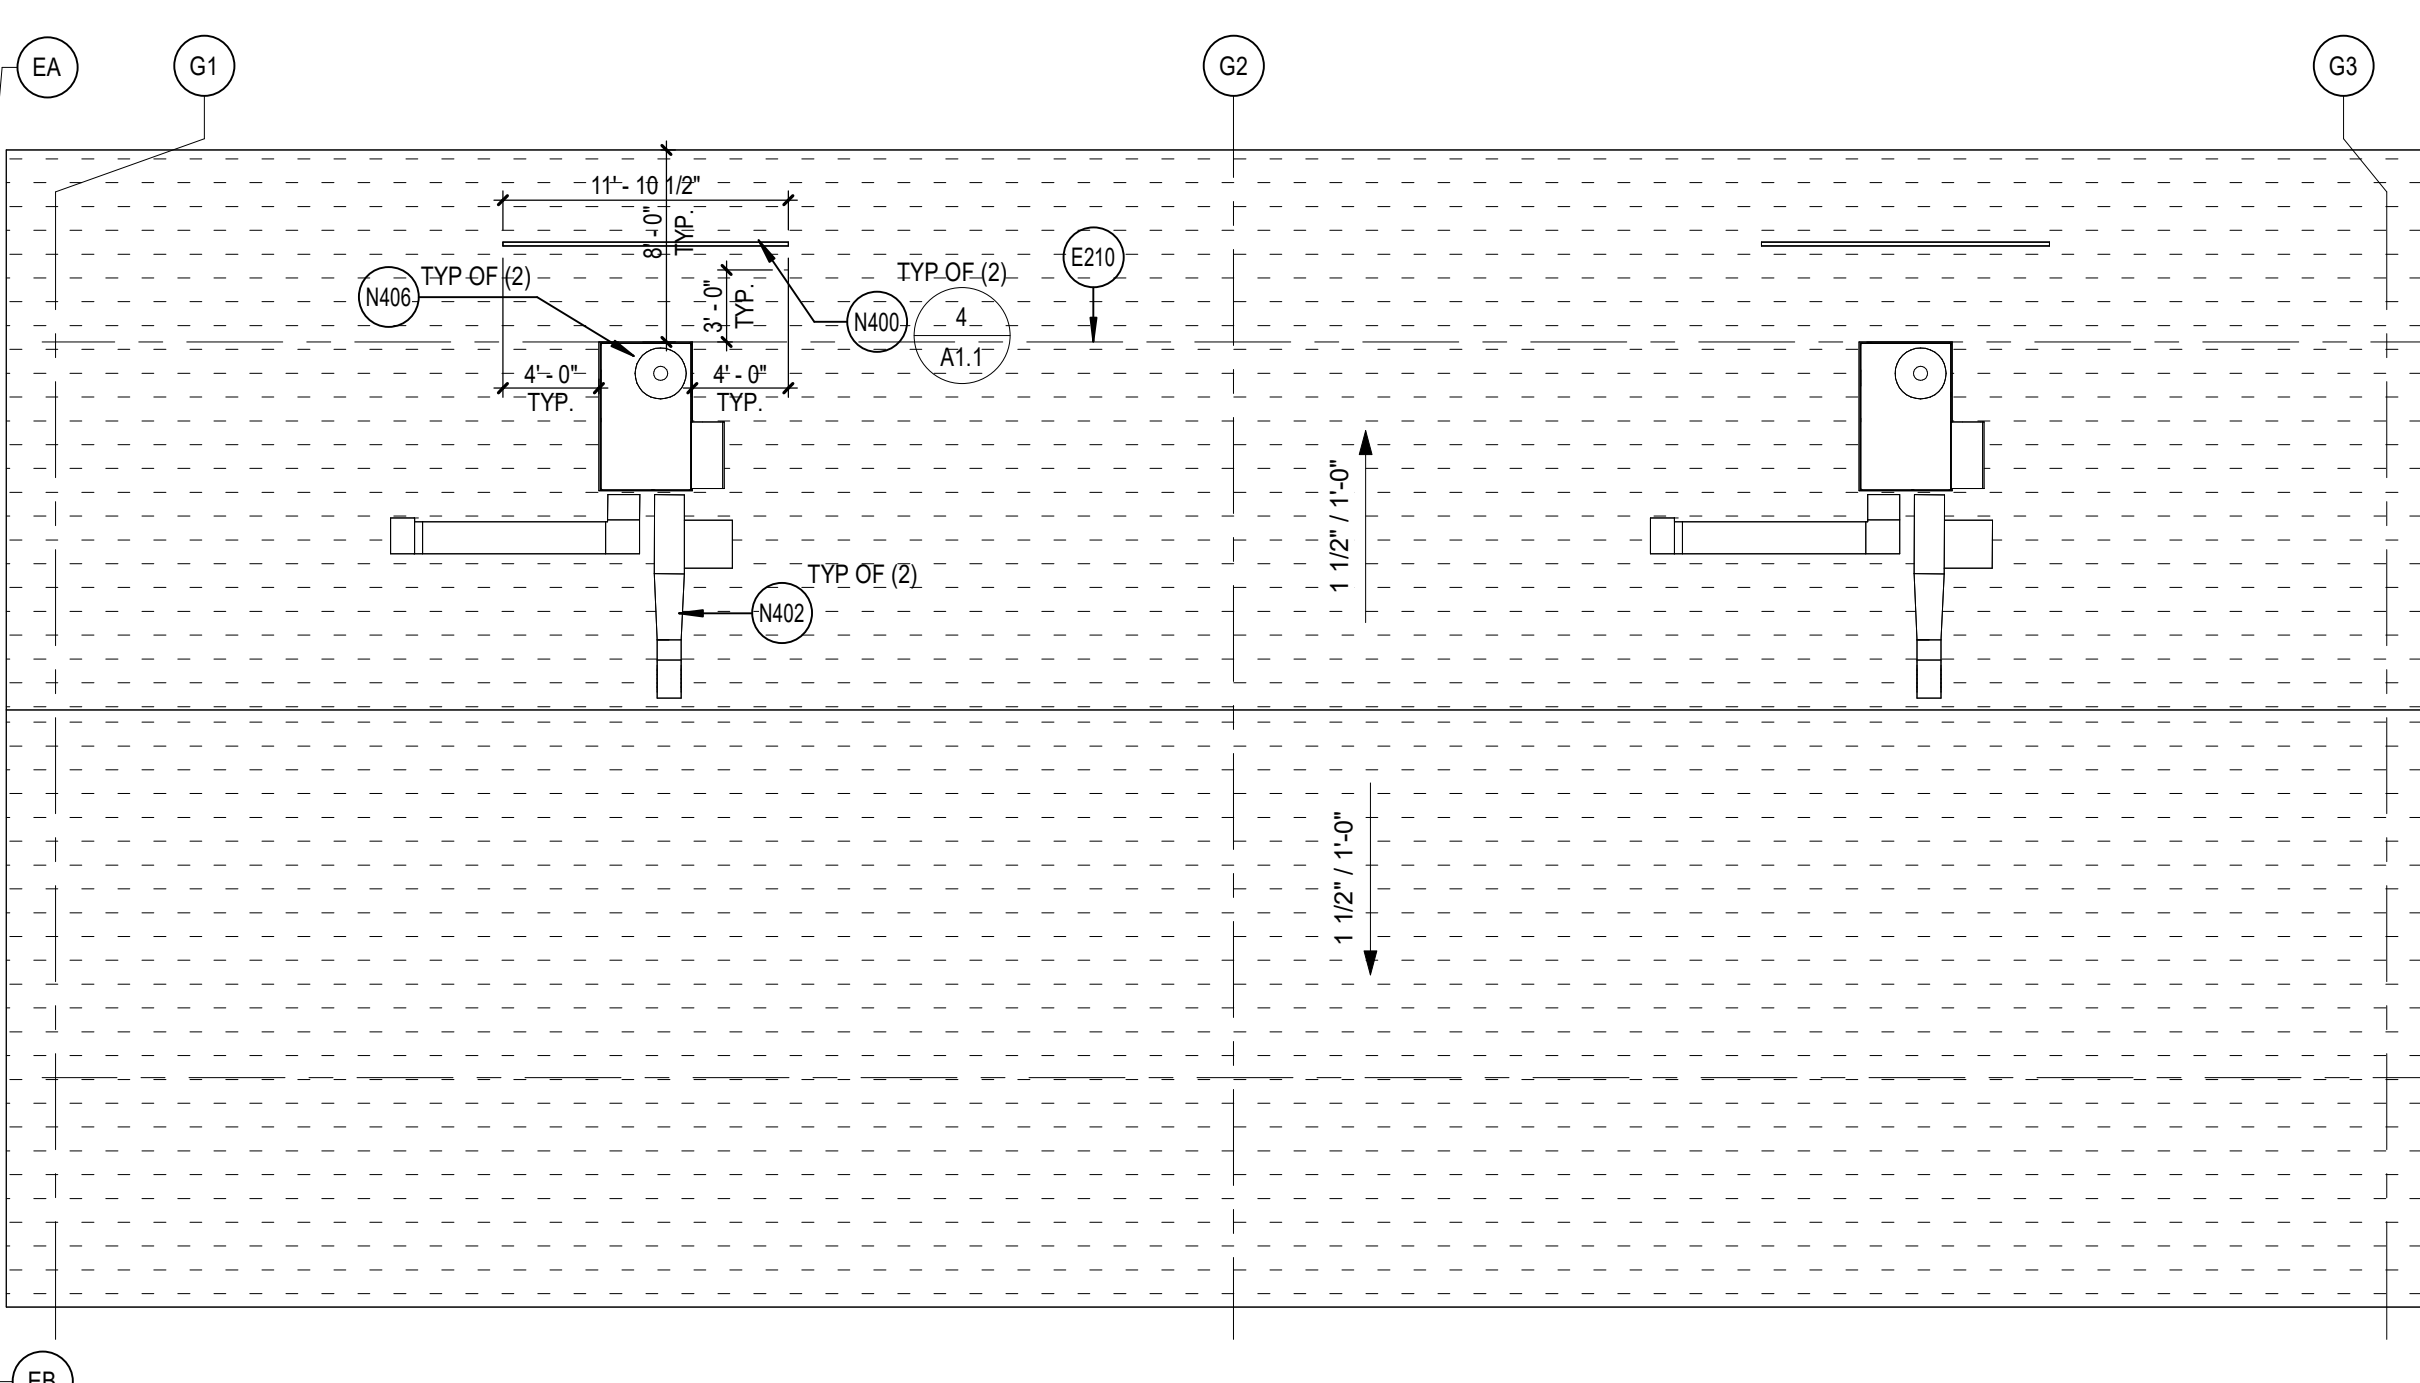


8 BUILDING C ROOF PLAN  
A1.3A / SCALE: 1/8" = 1'-0"

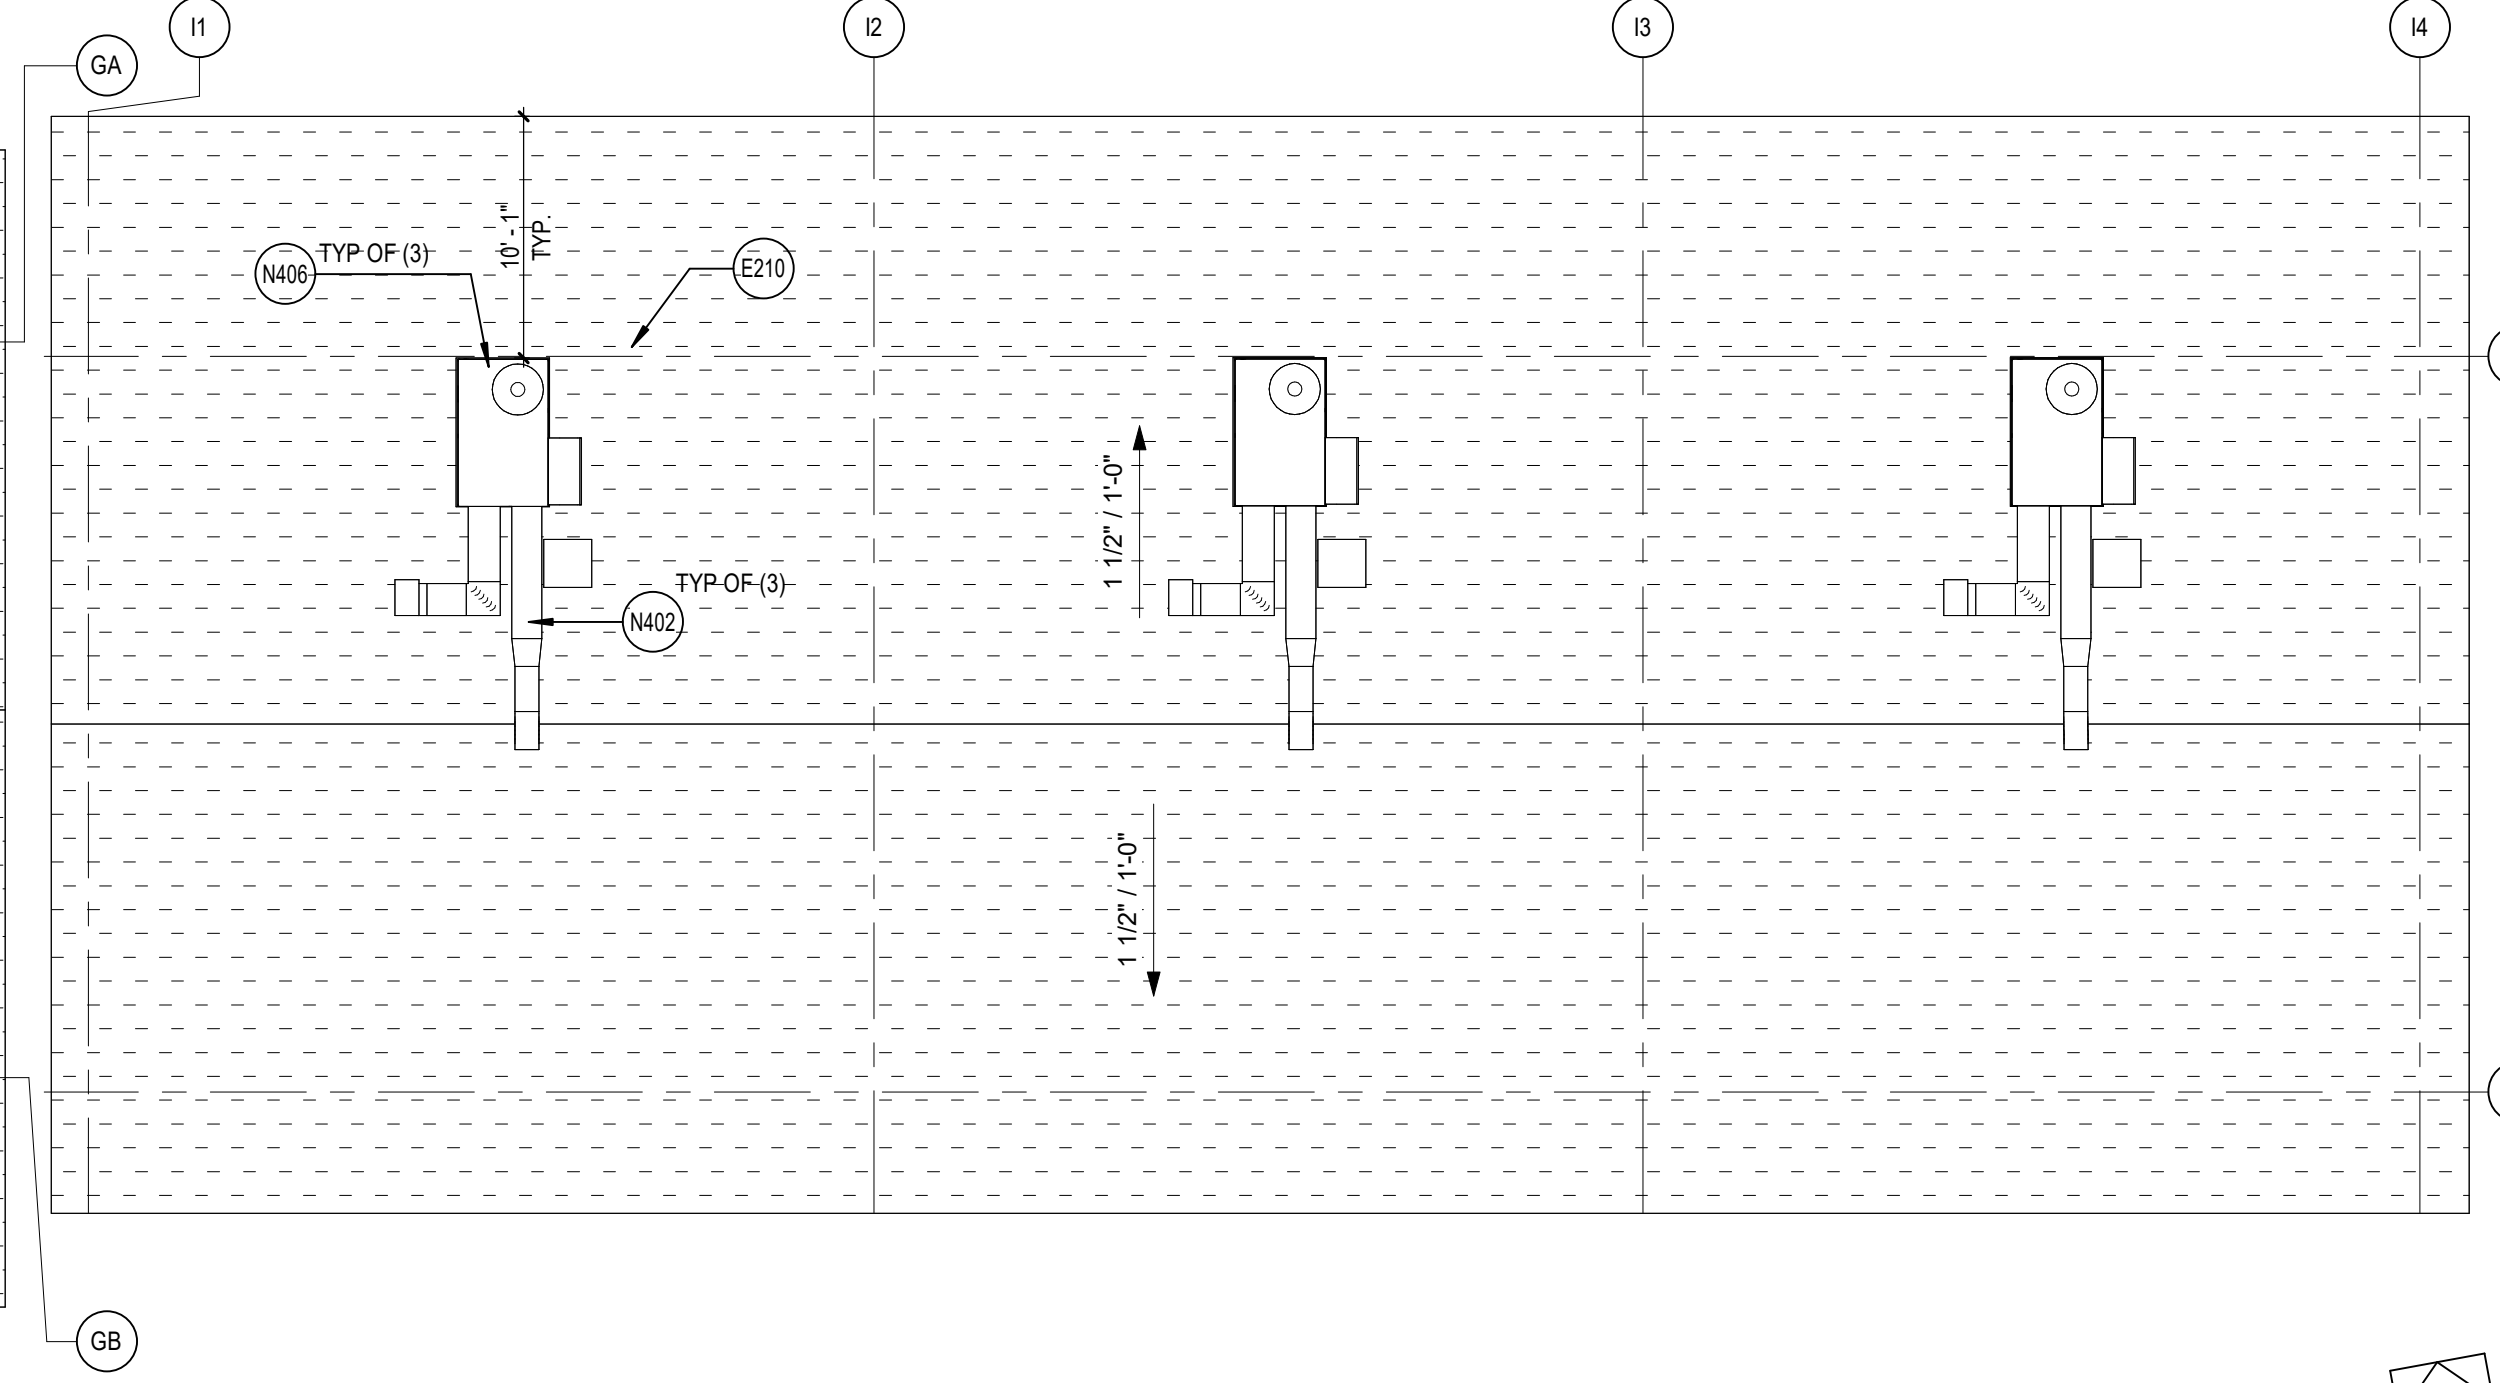

9 BUILDING I ROOF PLAN  
A1.3A / SCALE: 1/8" = 1'-0"

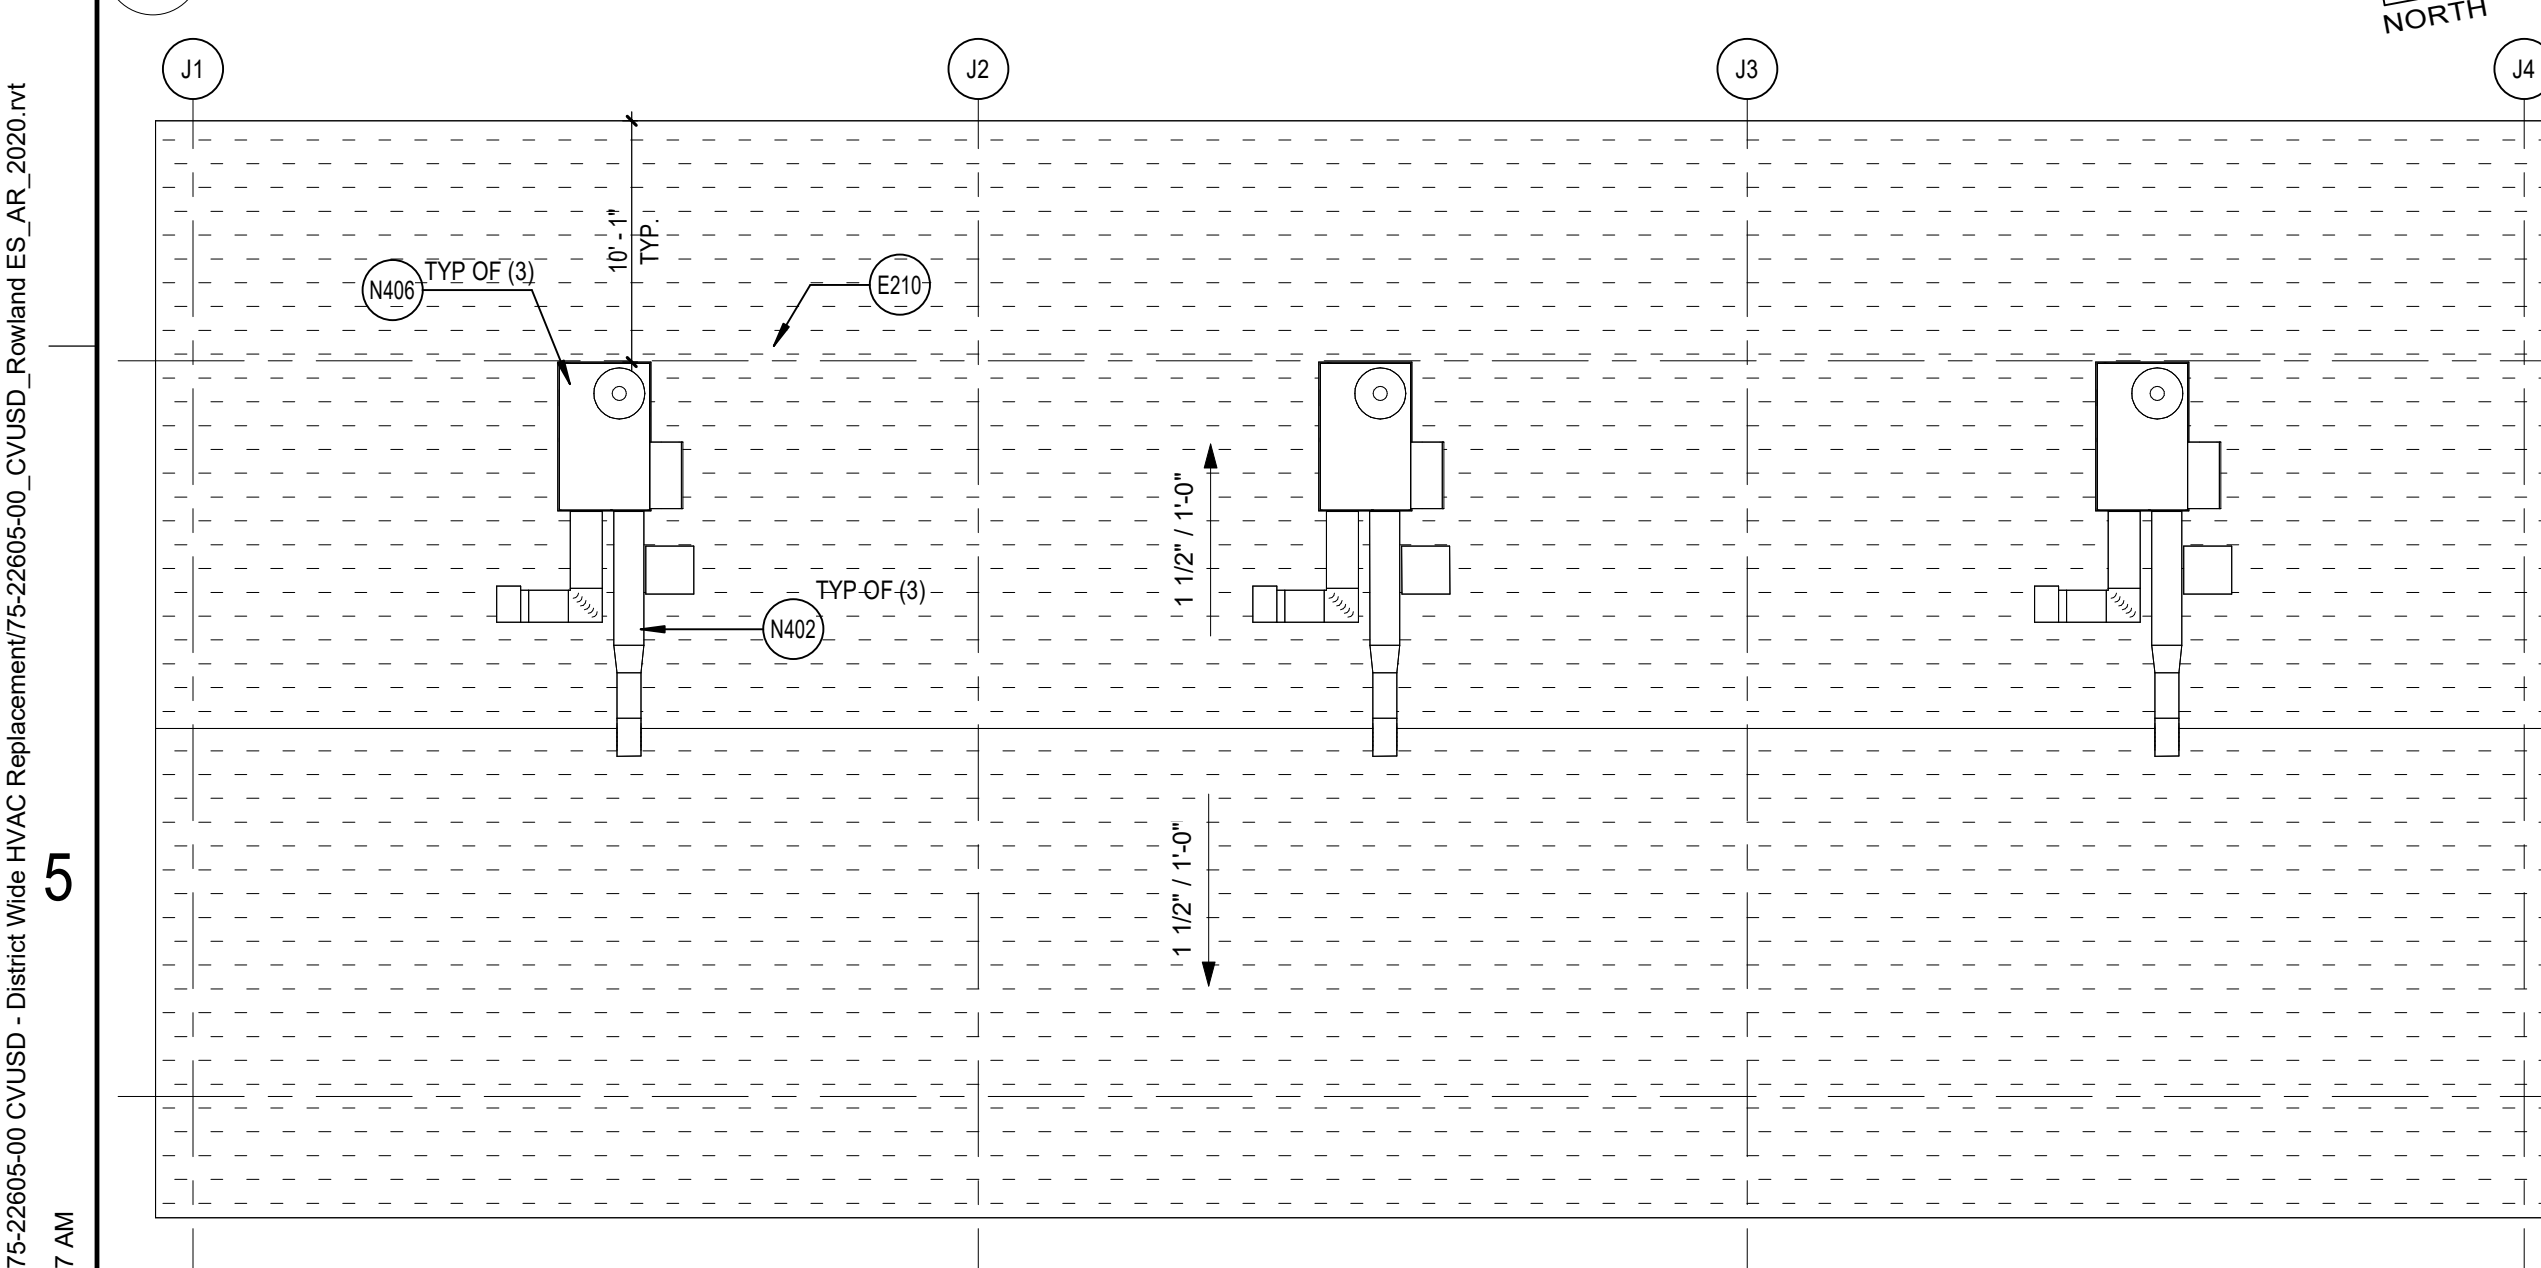

10 BUILDING J ROOF PLAN  
A1.3A / SCALE: 1/8" = 1'-0"

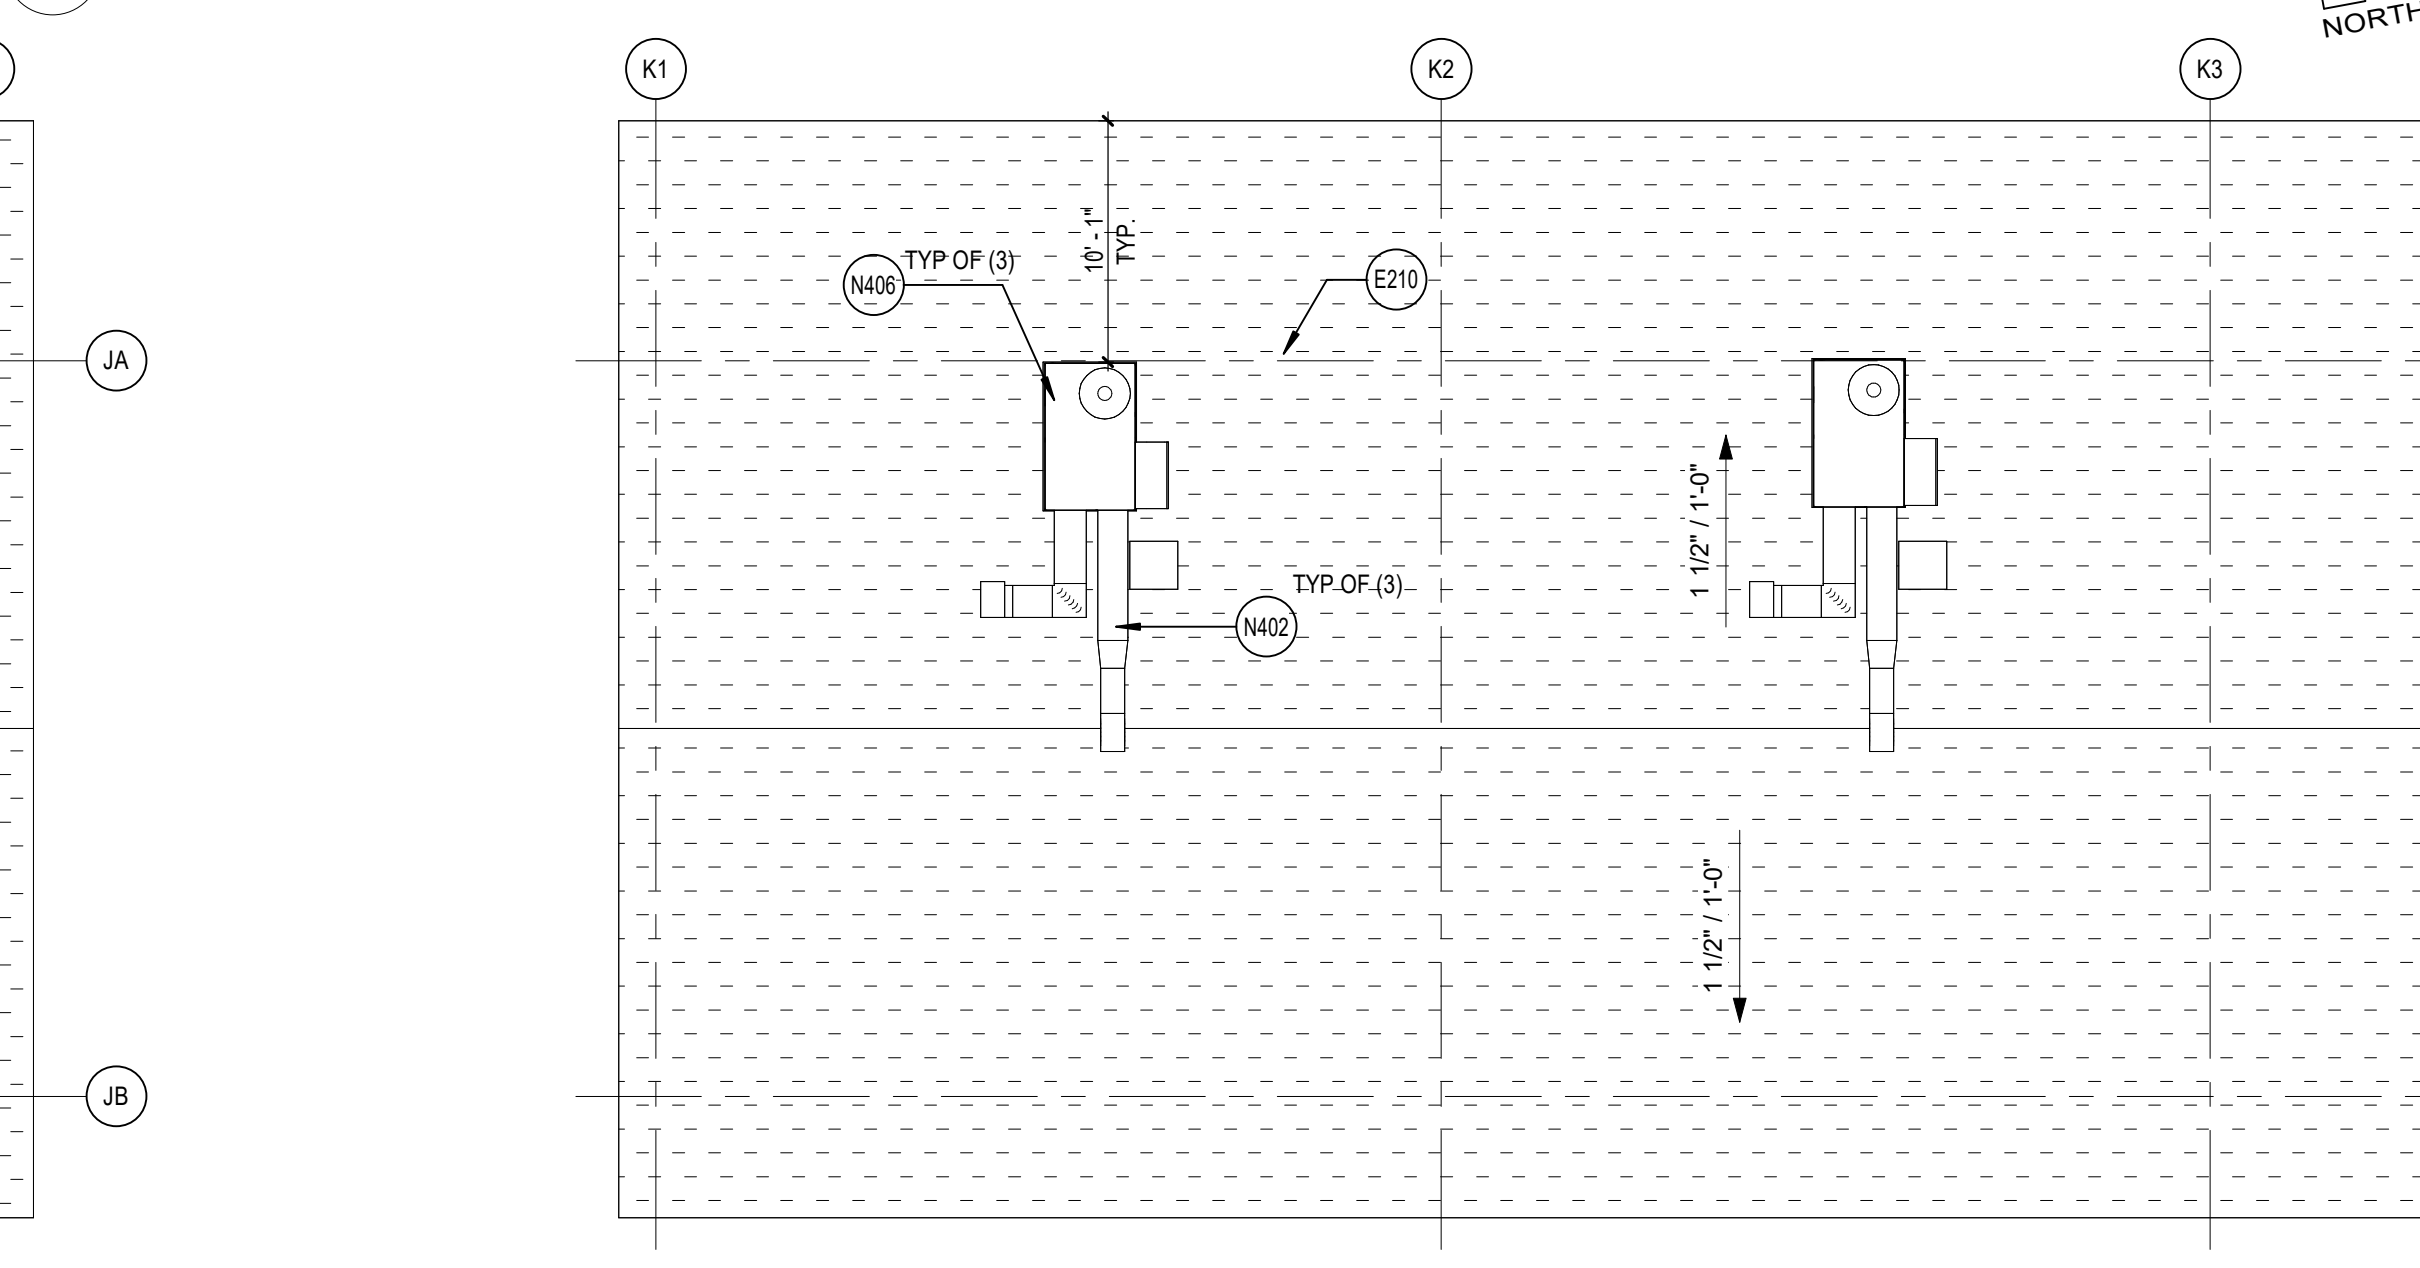

11 BUILDING K ROOF PLAN  
A1.3A / SCALE: 1/8" = 1'-0"

**DEMOLITION GENERAL NOTES**


- DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.
- THE CONTRACTOR SHALL:
- COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
  - COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
  - CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
  - MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
  - VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
  - REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
  - THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
  - PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
  - REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
  - EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
  - VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
  - PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
  - CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
  - SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
  - AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
  - WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
  - WHERE PLASTER/STUO WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

**REFERENCE KEYNOTES**

- E210 LINE OF (E) BLDG BELOW SHOWN DASHED
- N400 NEW FREESTANDING METAL GUARDRAIL SYSTEM, SEE SUPPLIER FOR ANCHORAGE AND SPEC SECTION 07 72 00
- N402 NEW DUCTWORK, SEE MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION
- N408 (N) MECHANICAL UNITS ATTACHED TO THE (E) UNIT CURB, SEE MECHANICAL DRAWING SHEET M1.38 & M1.39

**ROOF PLAN GENERAL NOTES**

- (E) ROOF CURBS TO REMAIN U.N.O., SEE MECHANICAL DRAWINGS SHEET M1.32 FOR ADDITIONAL INFORMATION
- COORDINATE THE SIZE AND LOCATION OF WALL PENETRATIONS FOR MECHANICAL AND ELECTRICAL EQUIPMENT. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR PENETRATIONS NOT SHOWN ON THIS DRAWING.
- (E) DRAINS, CURBS, VENTS AND STACKS TO REMAINS.

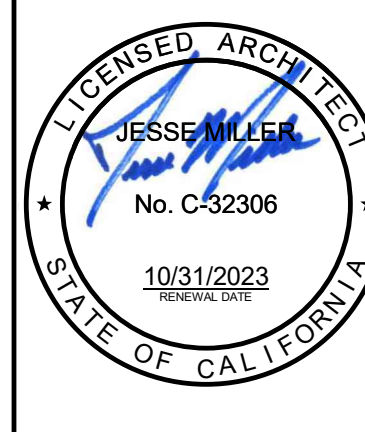

**ROWLAND ELEMENTARY SCHOOL**  
COVID 19 - COVINA VALLEY DISTRICT WIDE HVAC REPLACEMENT  
135E - ROWLAND AVE. WEST COVINA, CA 91790


100% CONSTRUCTION DOCUMENTS  
11/08/2022 REVISIONS

75-22605-00  
DSA A#03-12233  
DSA File #: 19-25  
ROOF PLANS


A1.3A

Autodesk Docs\75-22605-00 CVUSD - District Wide HVAC Replacement\75-22605-00 CVUSD\_Rowland ES\_AE\_2020.rvt  
 11/20/2022 8:52:17 AM




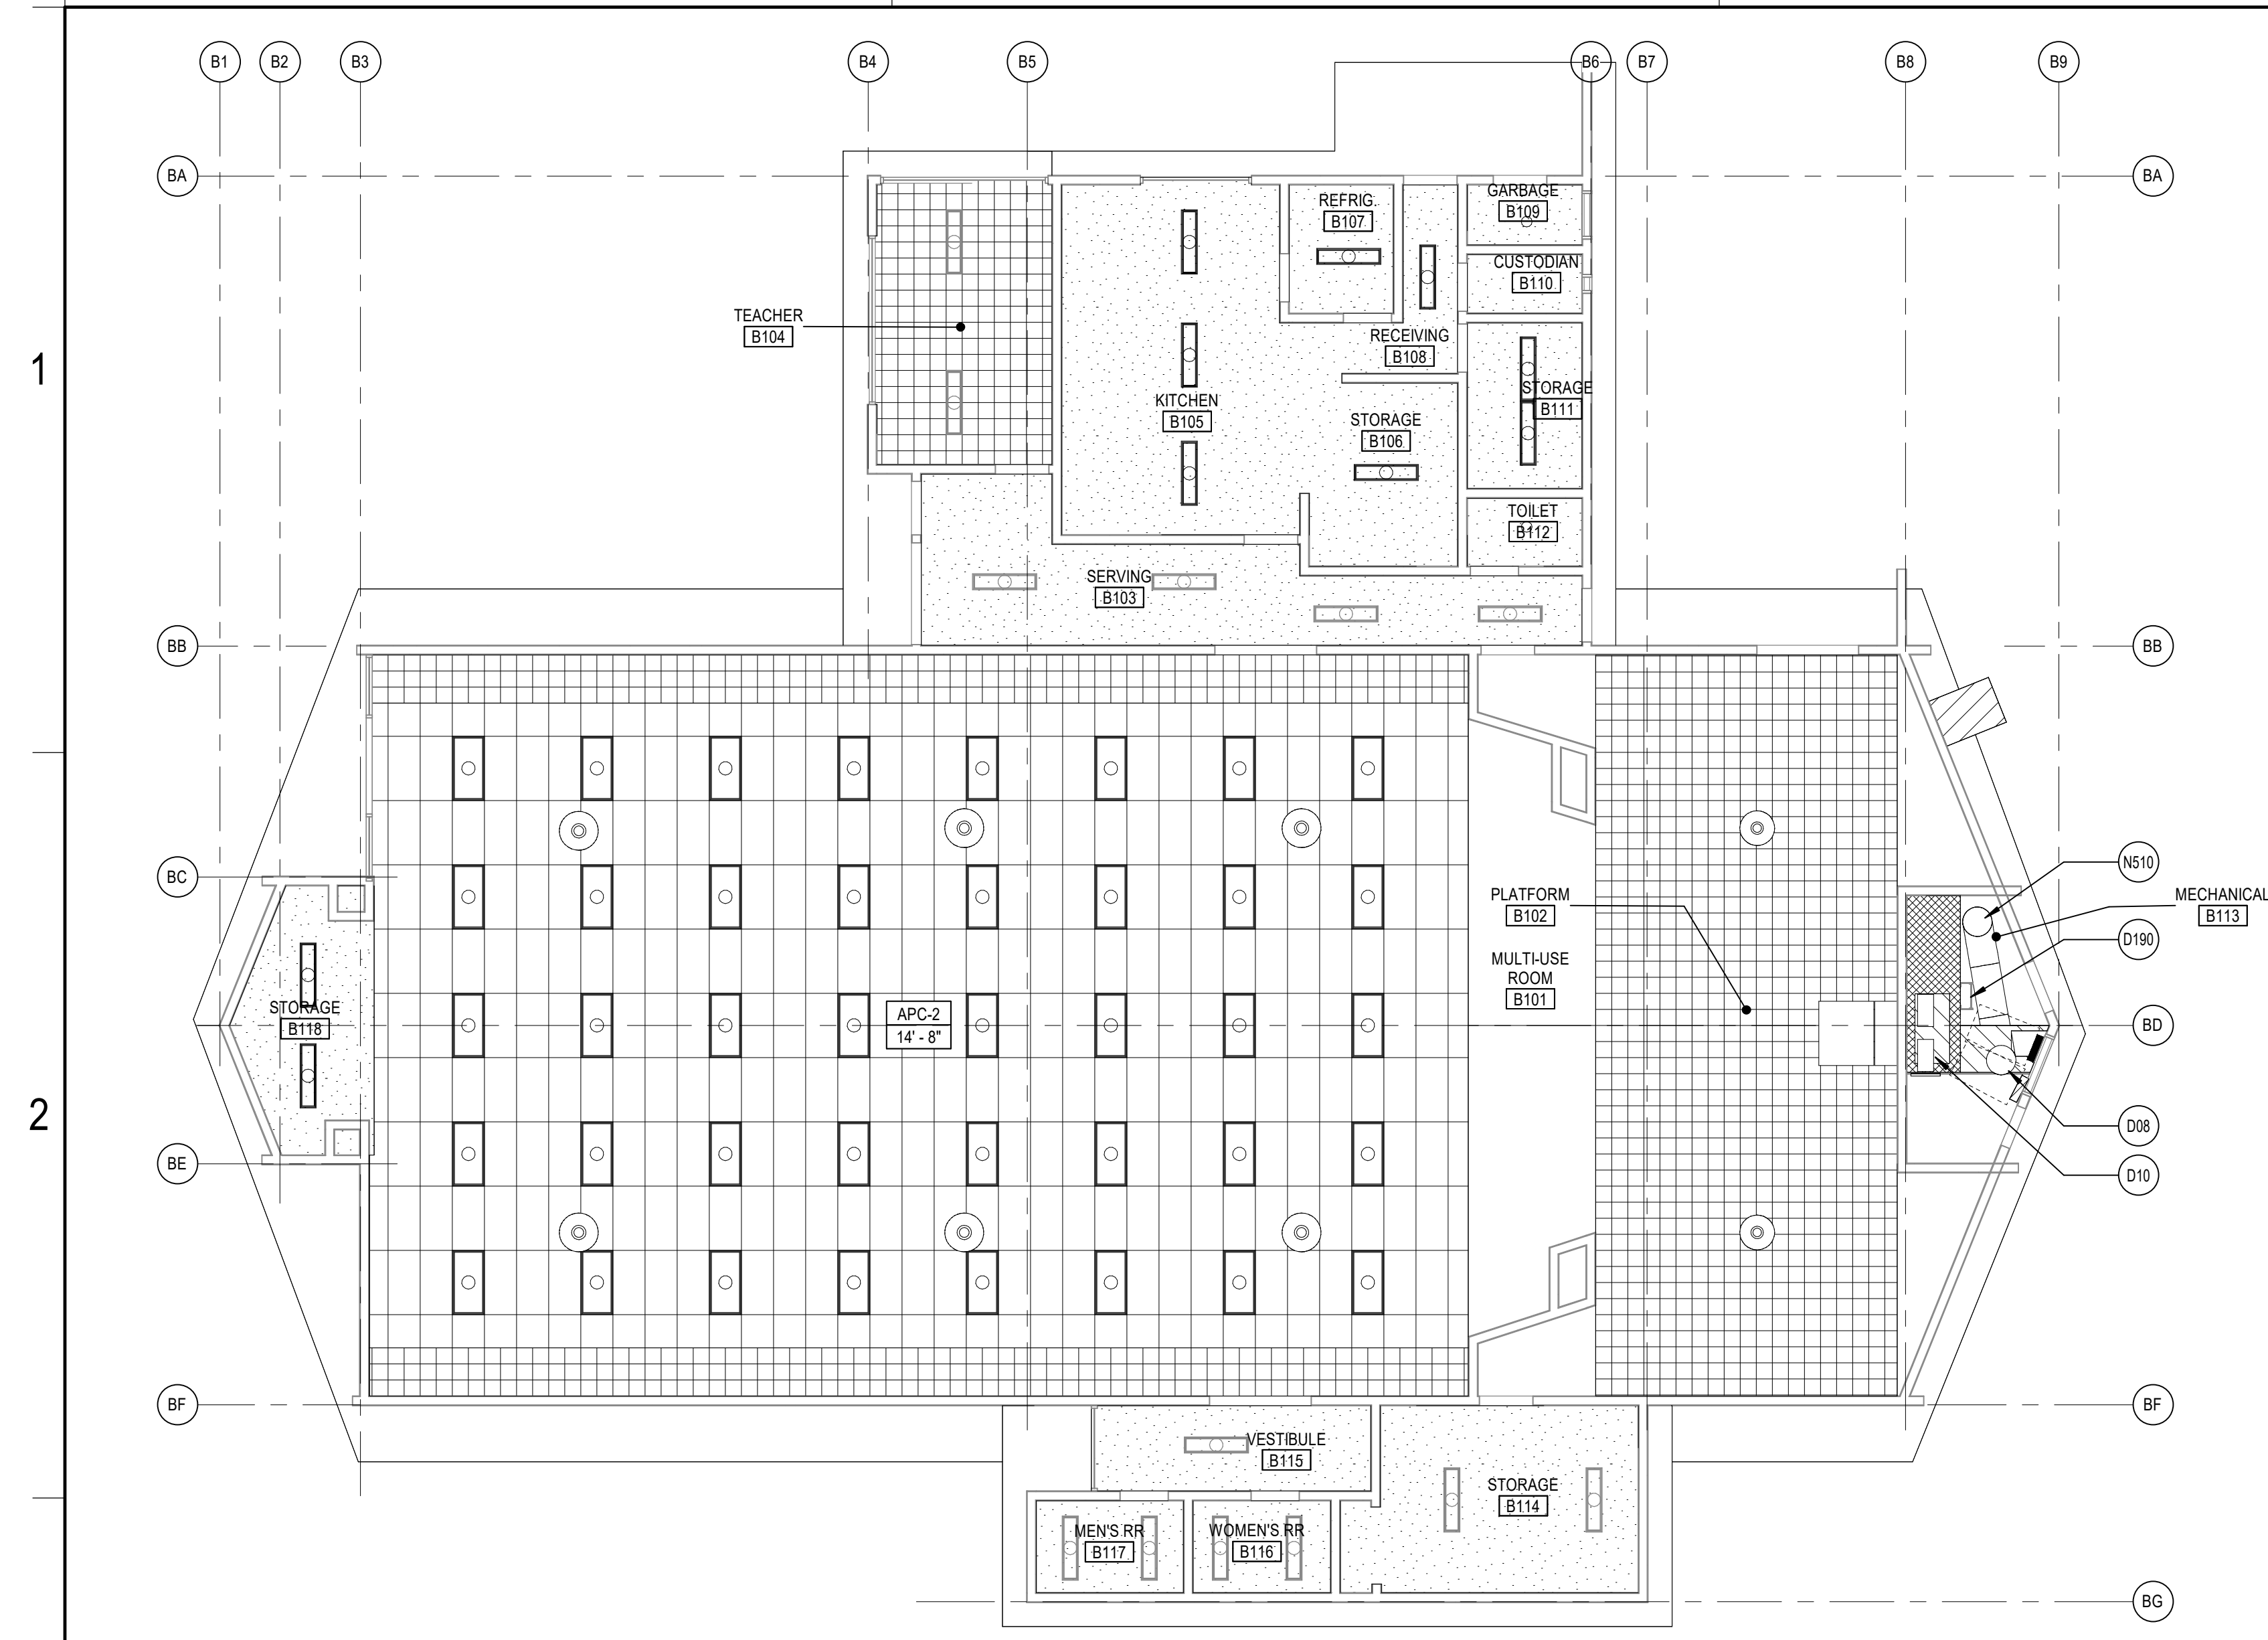


4 BUILDING B REFLECTED CEILING PLAN  
A3.1A SCALE: 1/8" = 1'-0"

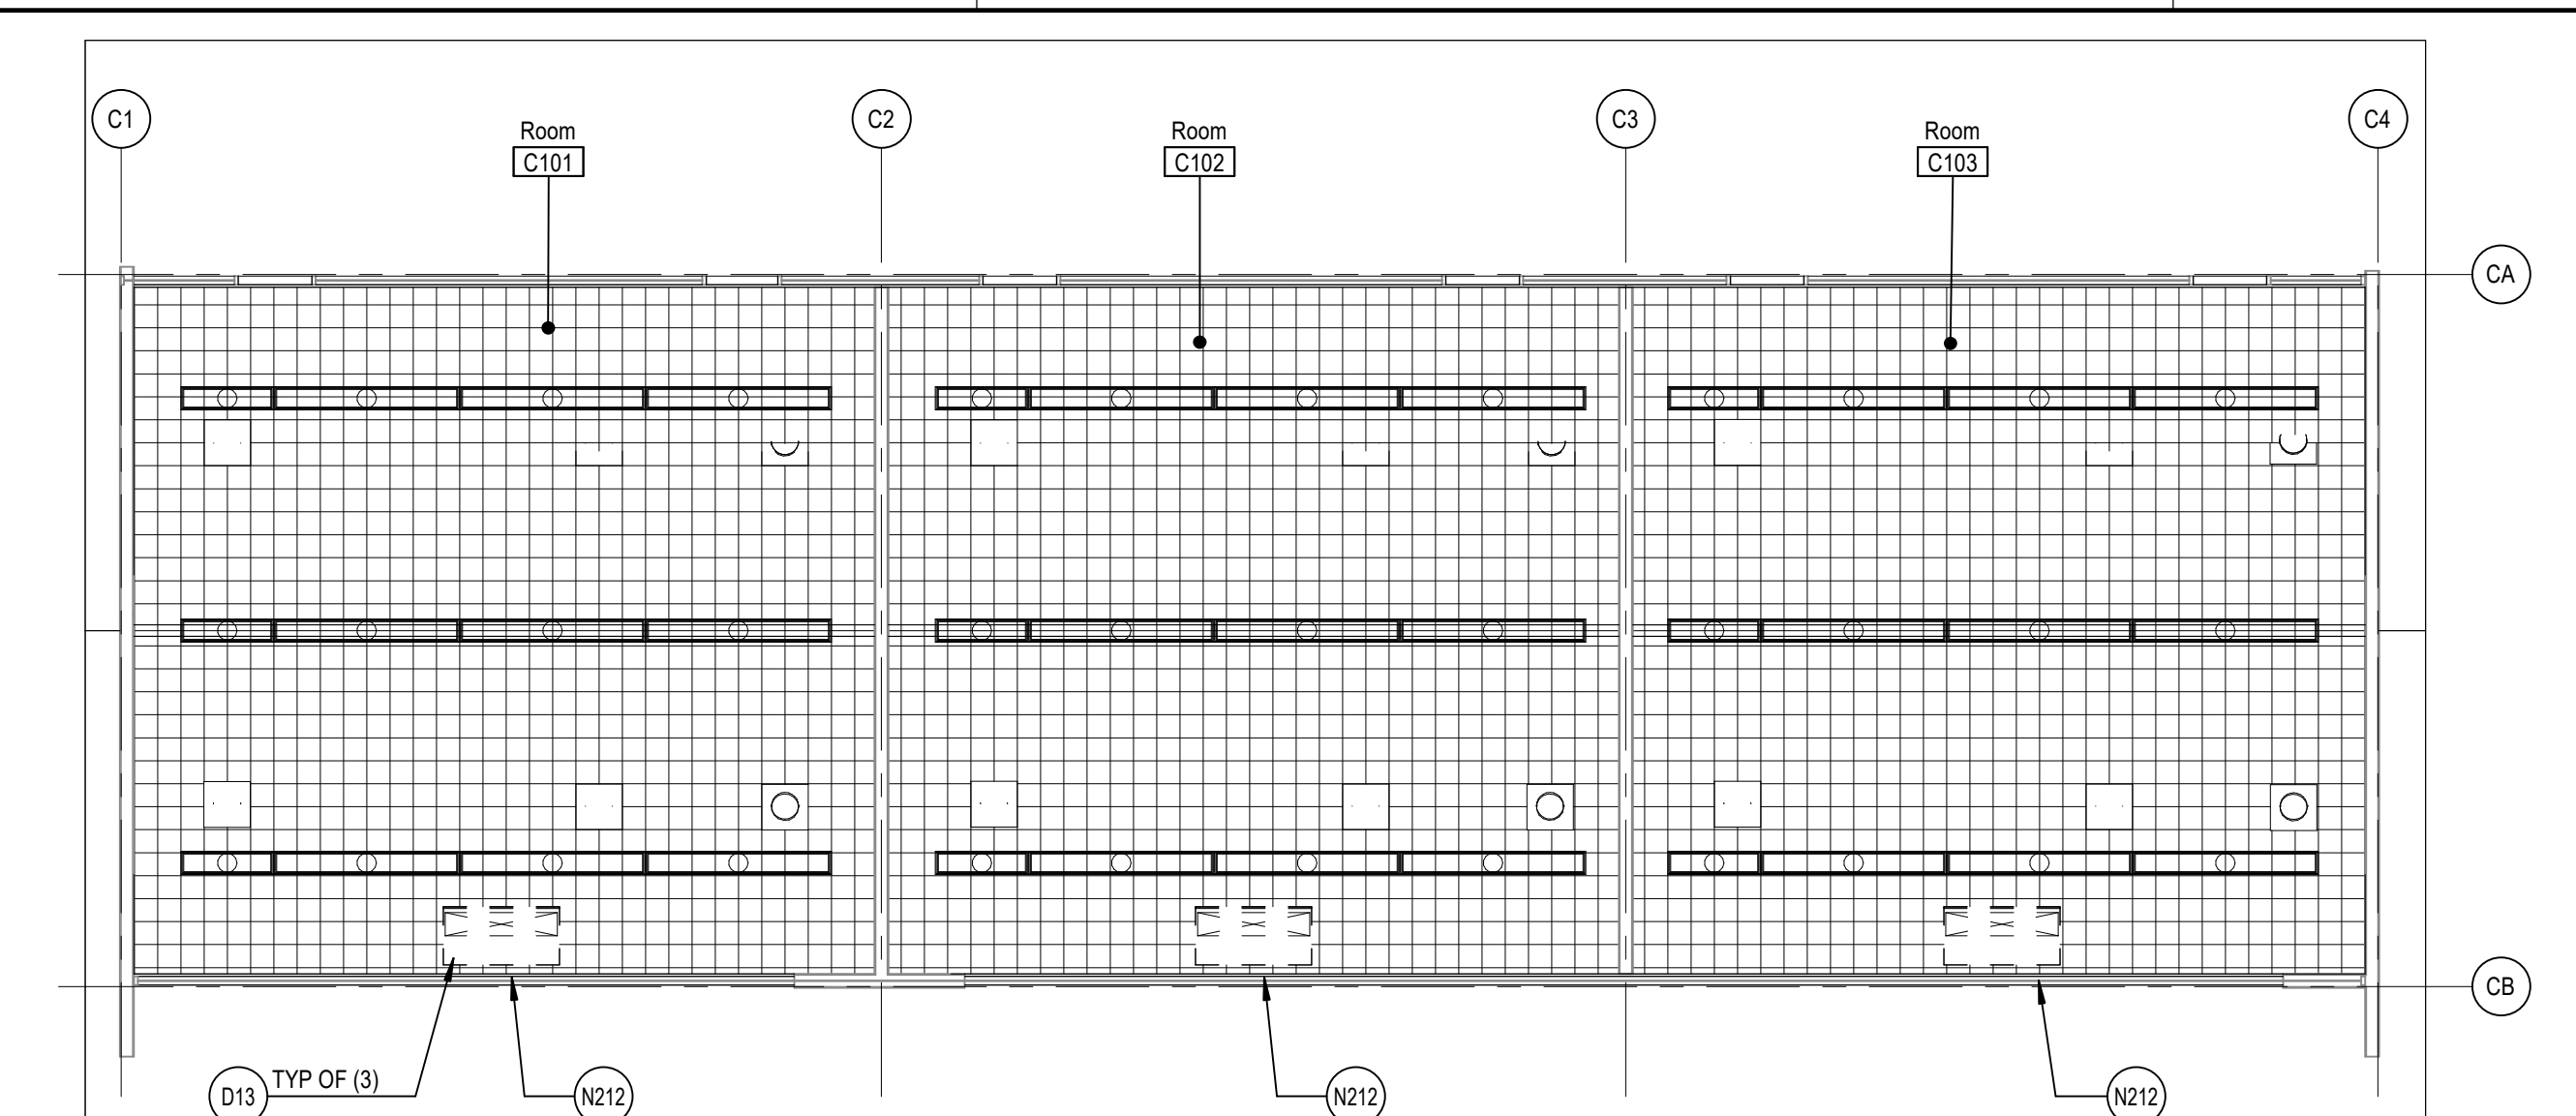


5 BUILDING C REFLECTED CEILING PLAN  
A3.1A SCALE: 1/8" = 1'-0"

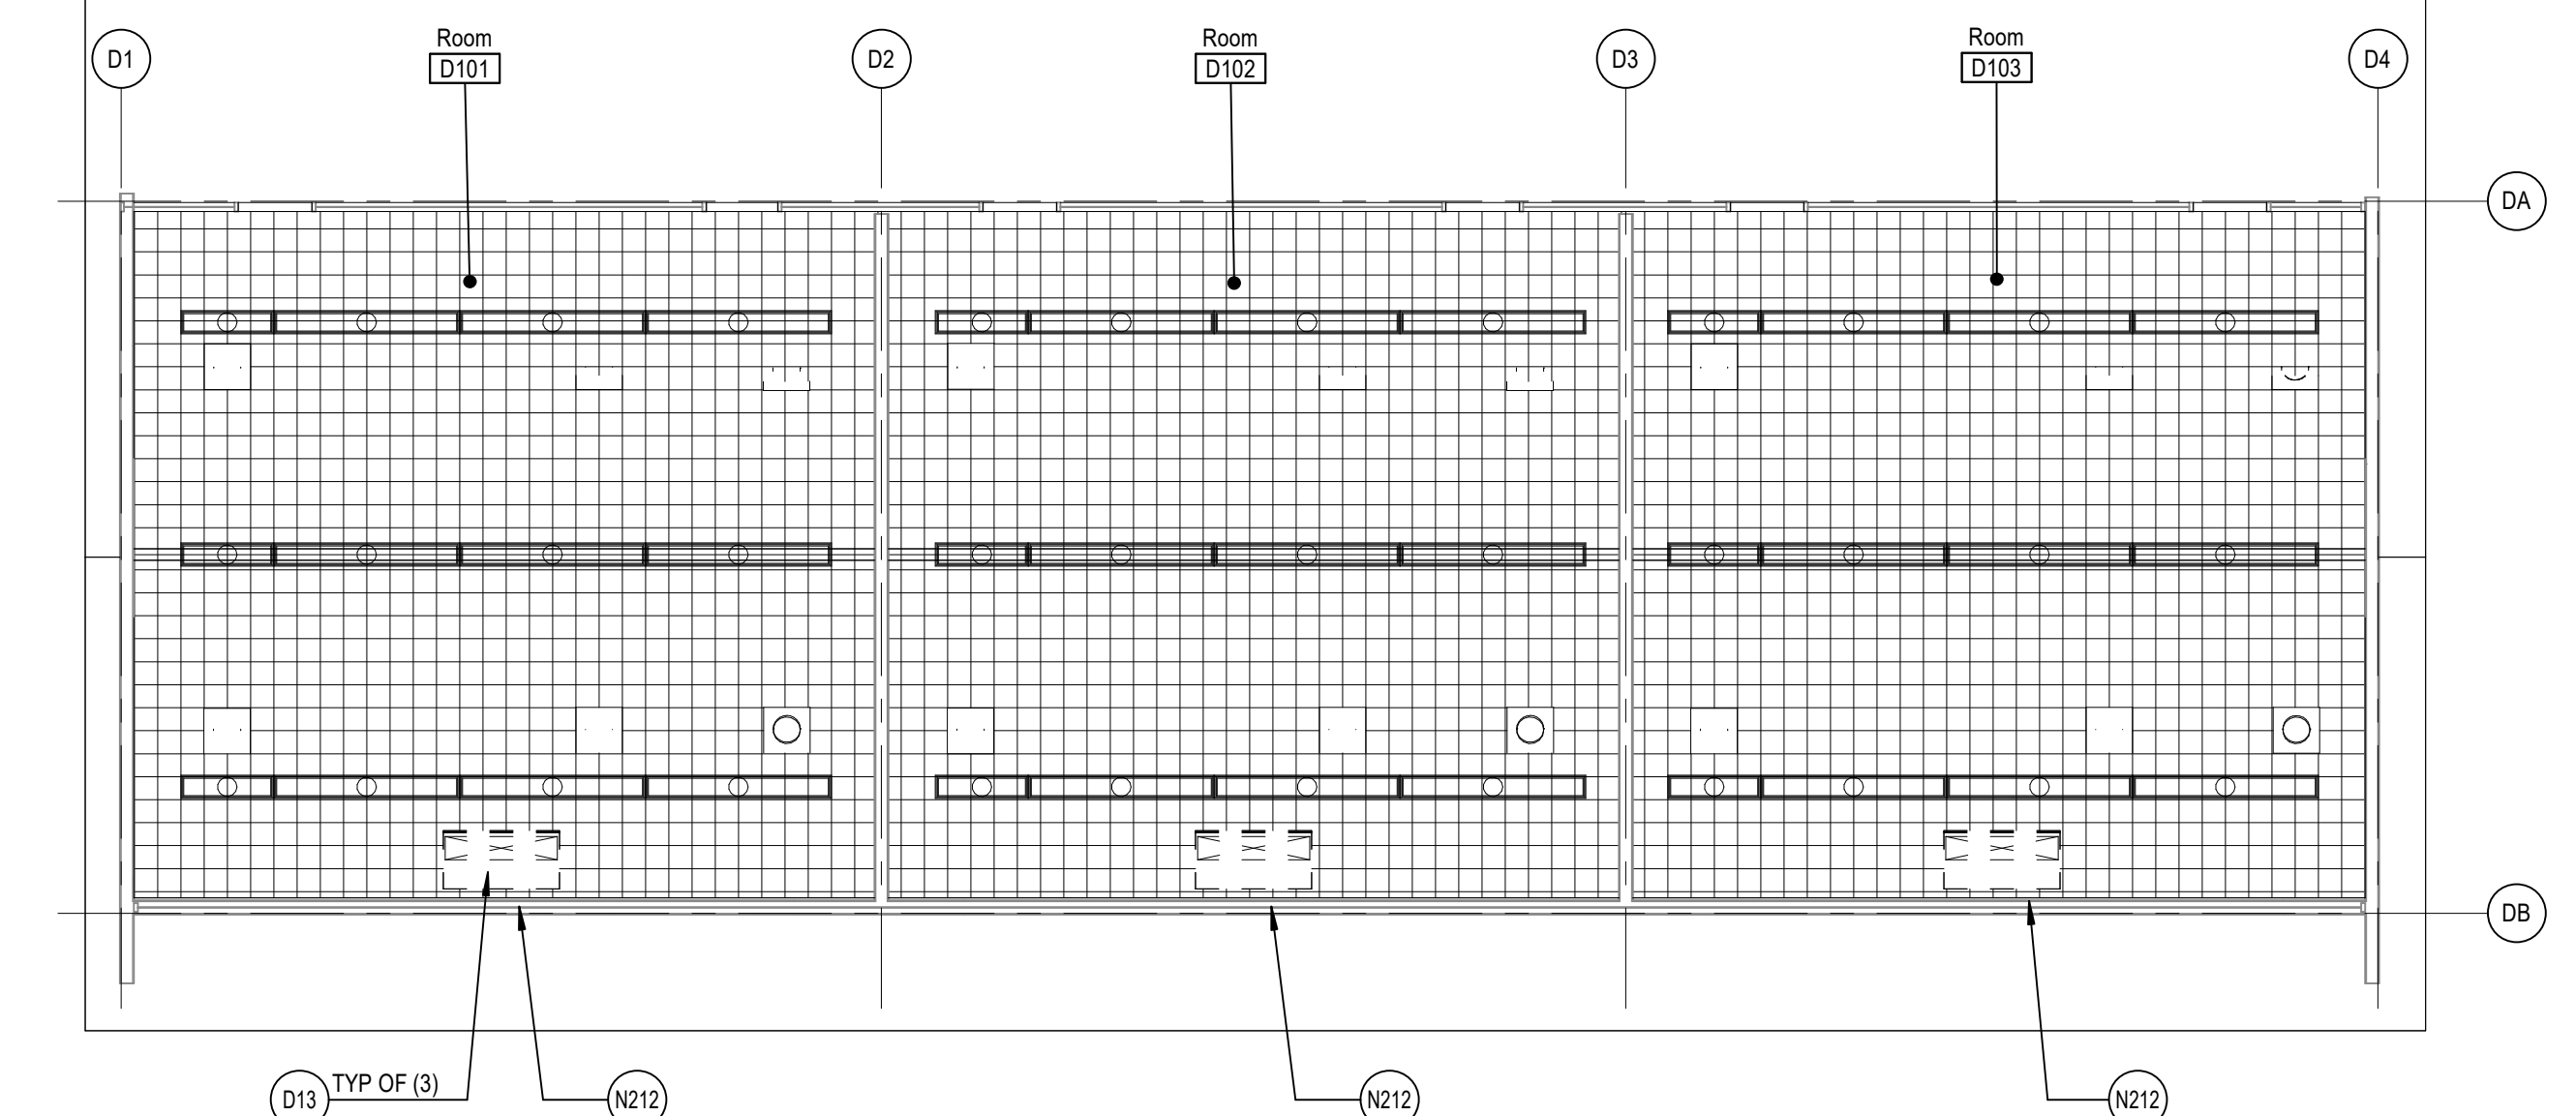


6 BUILDING D REFLECTED CEILING PLAN  
A3.1A SCALE: 1/8" = 1'-0"

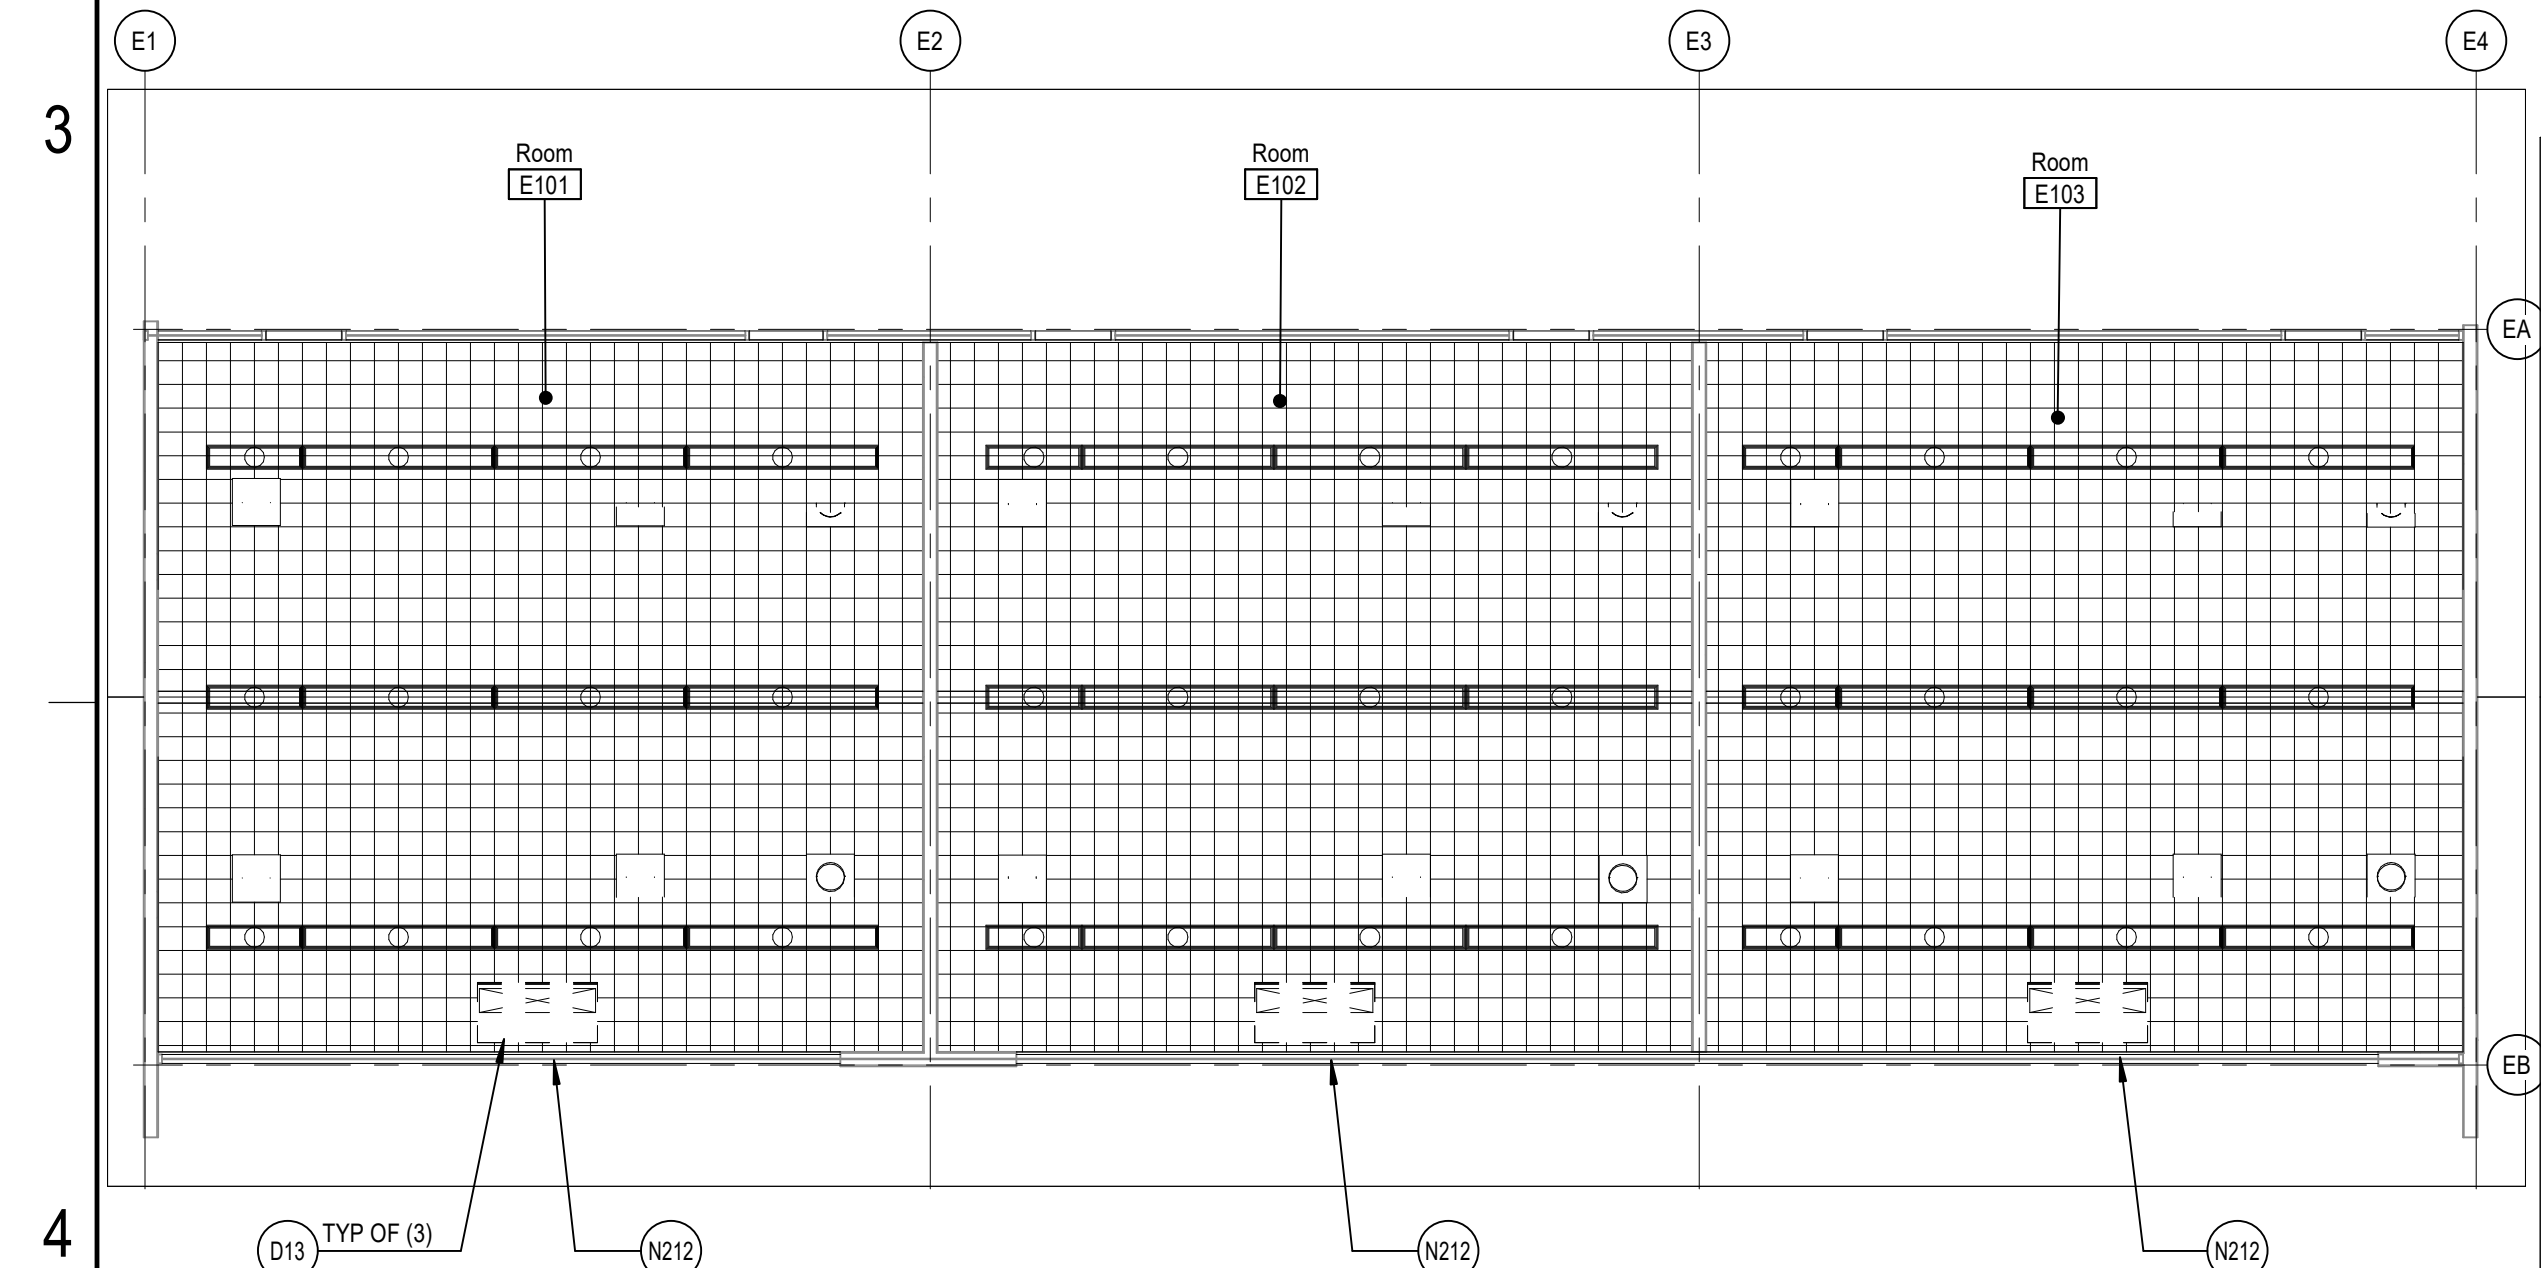


7 BUILDING E REFLECTED CEILING PLAN  
A3.1A SCALE: 1/8" = 1'-0"

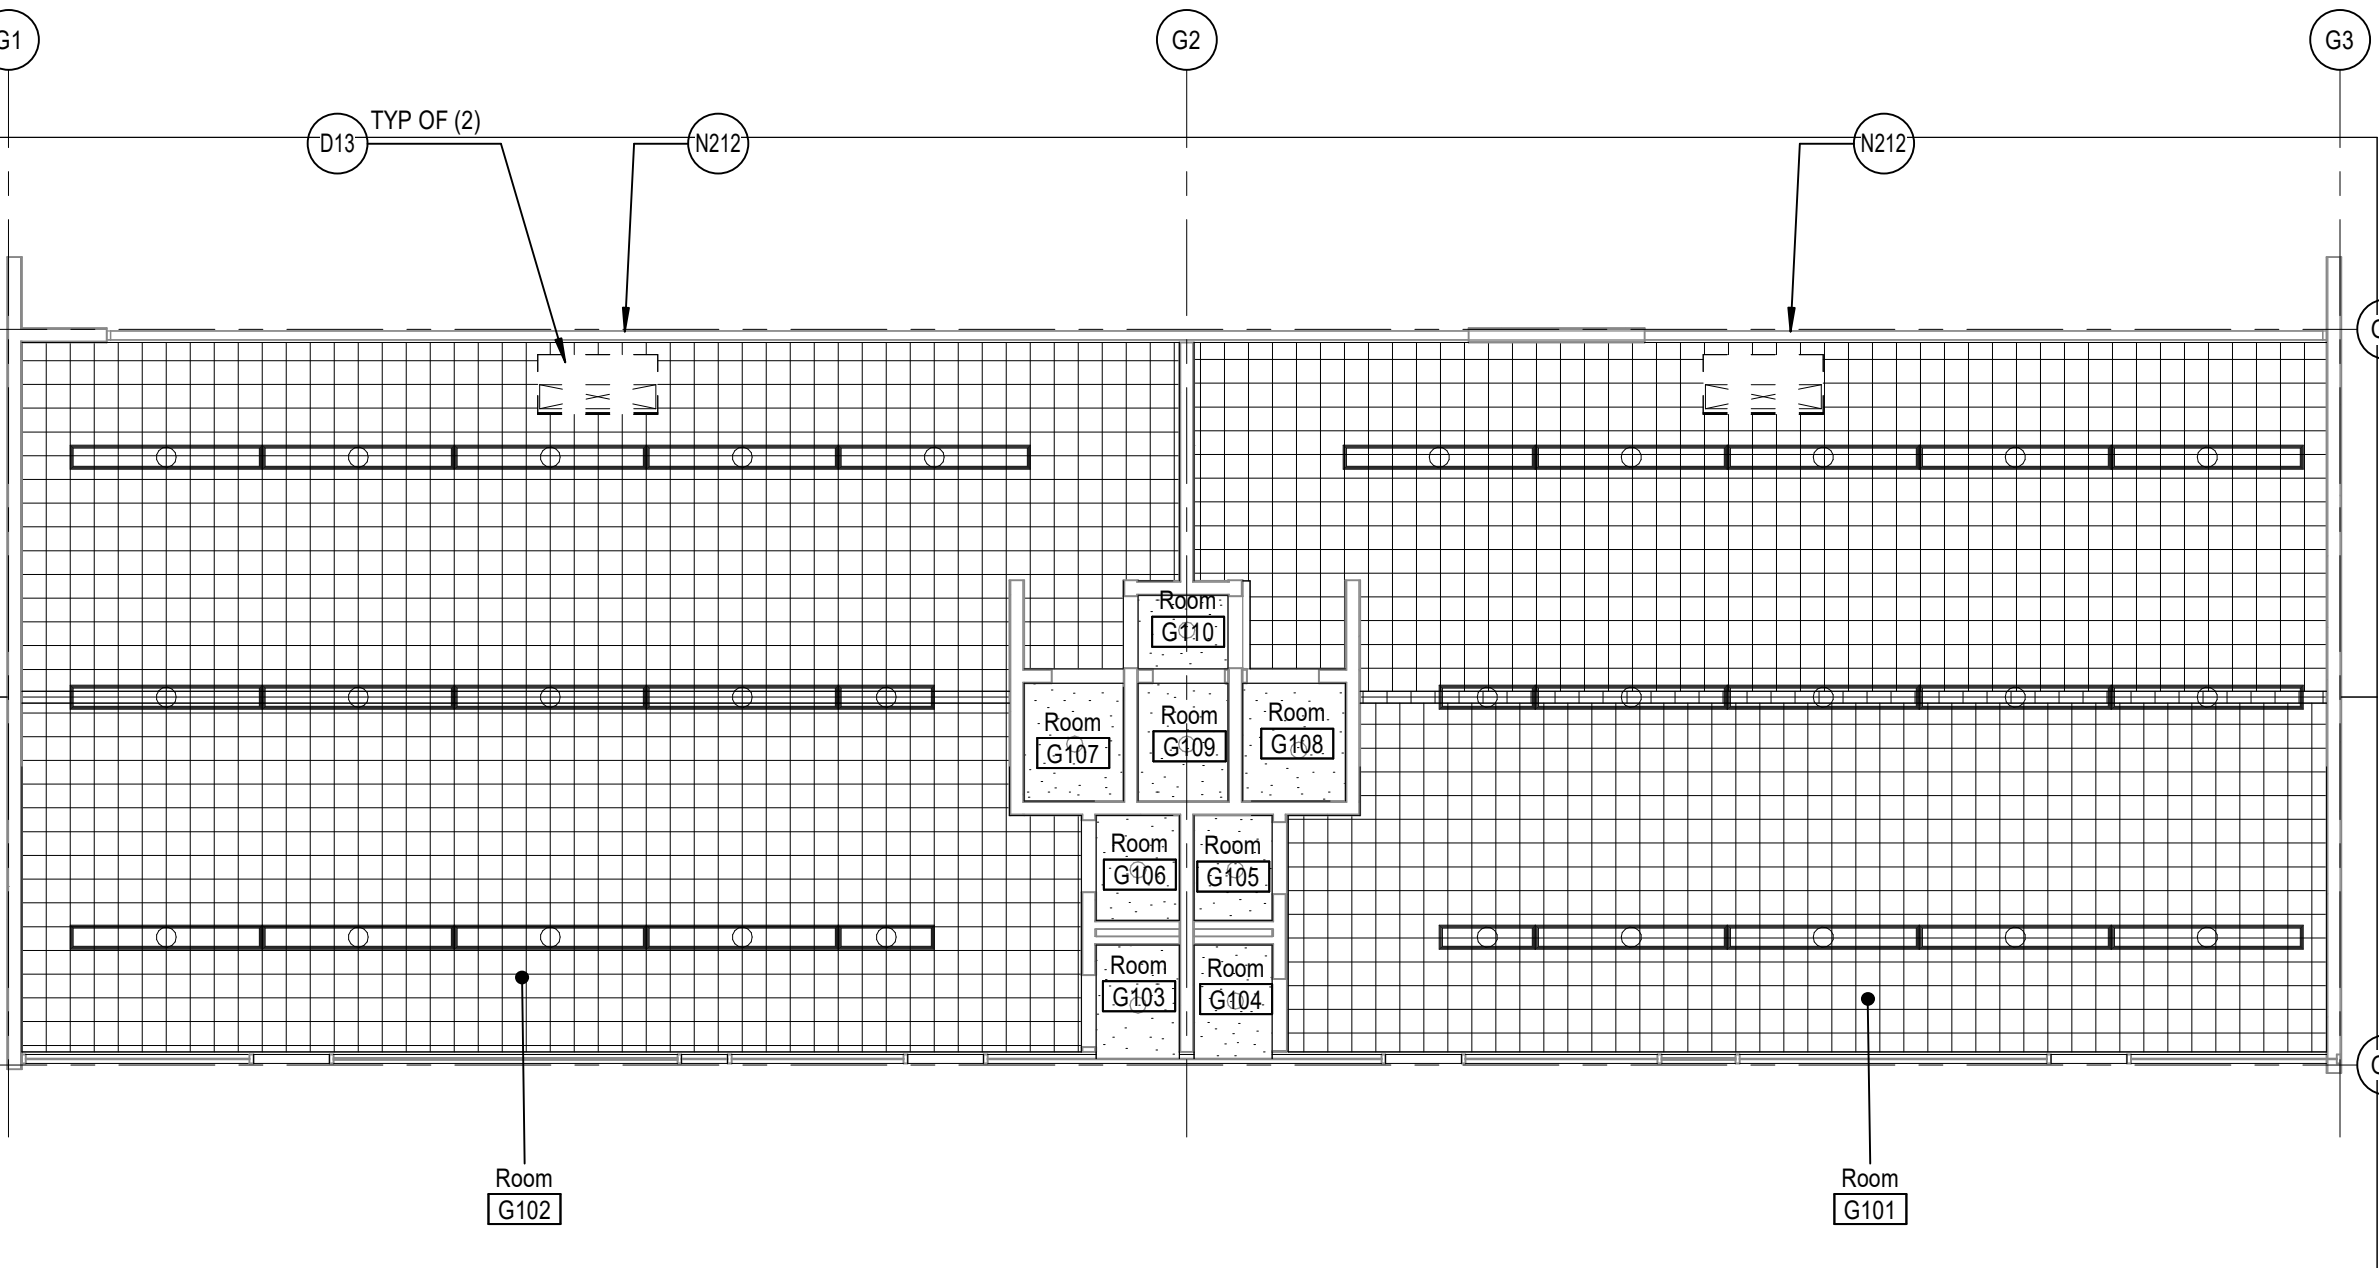


8 BUILDING G REFLECTED CEILING PLAN  
A3.1A SCALE: 1/8" = 1'-0"

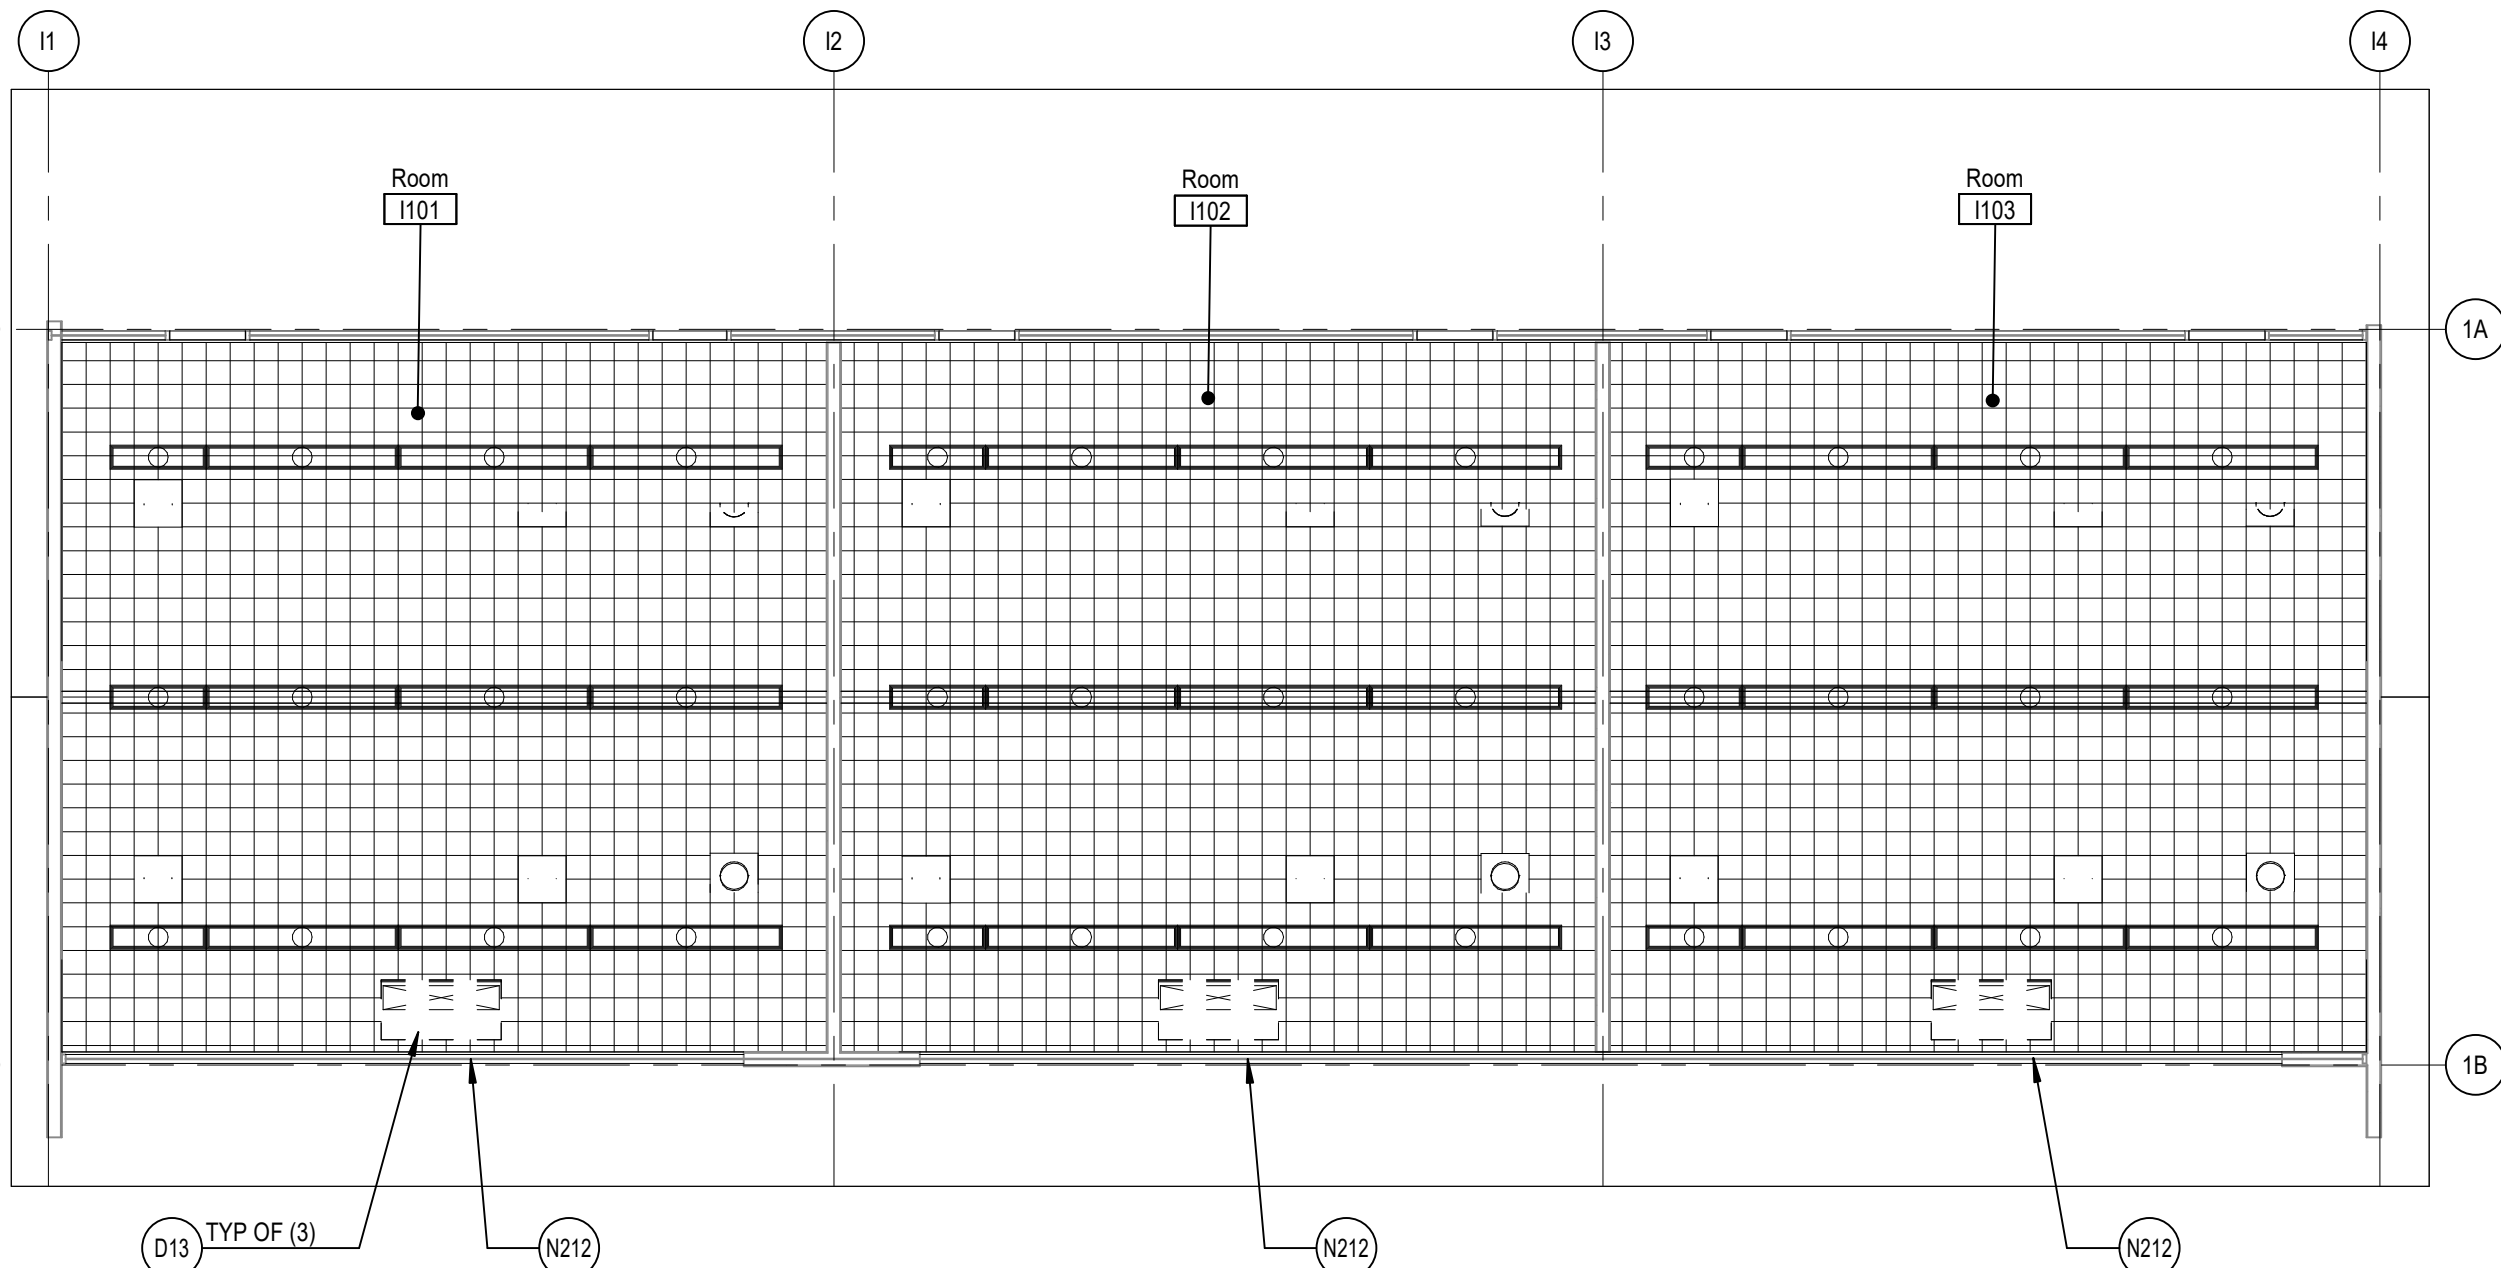

9 BUILDING I REFLECTED CEILING PLAN  
A3.1A SCALE: 1/8" = 1'-0"

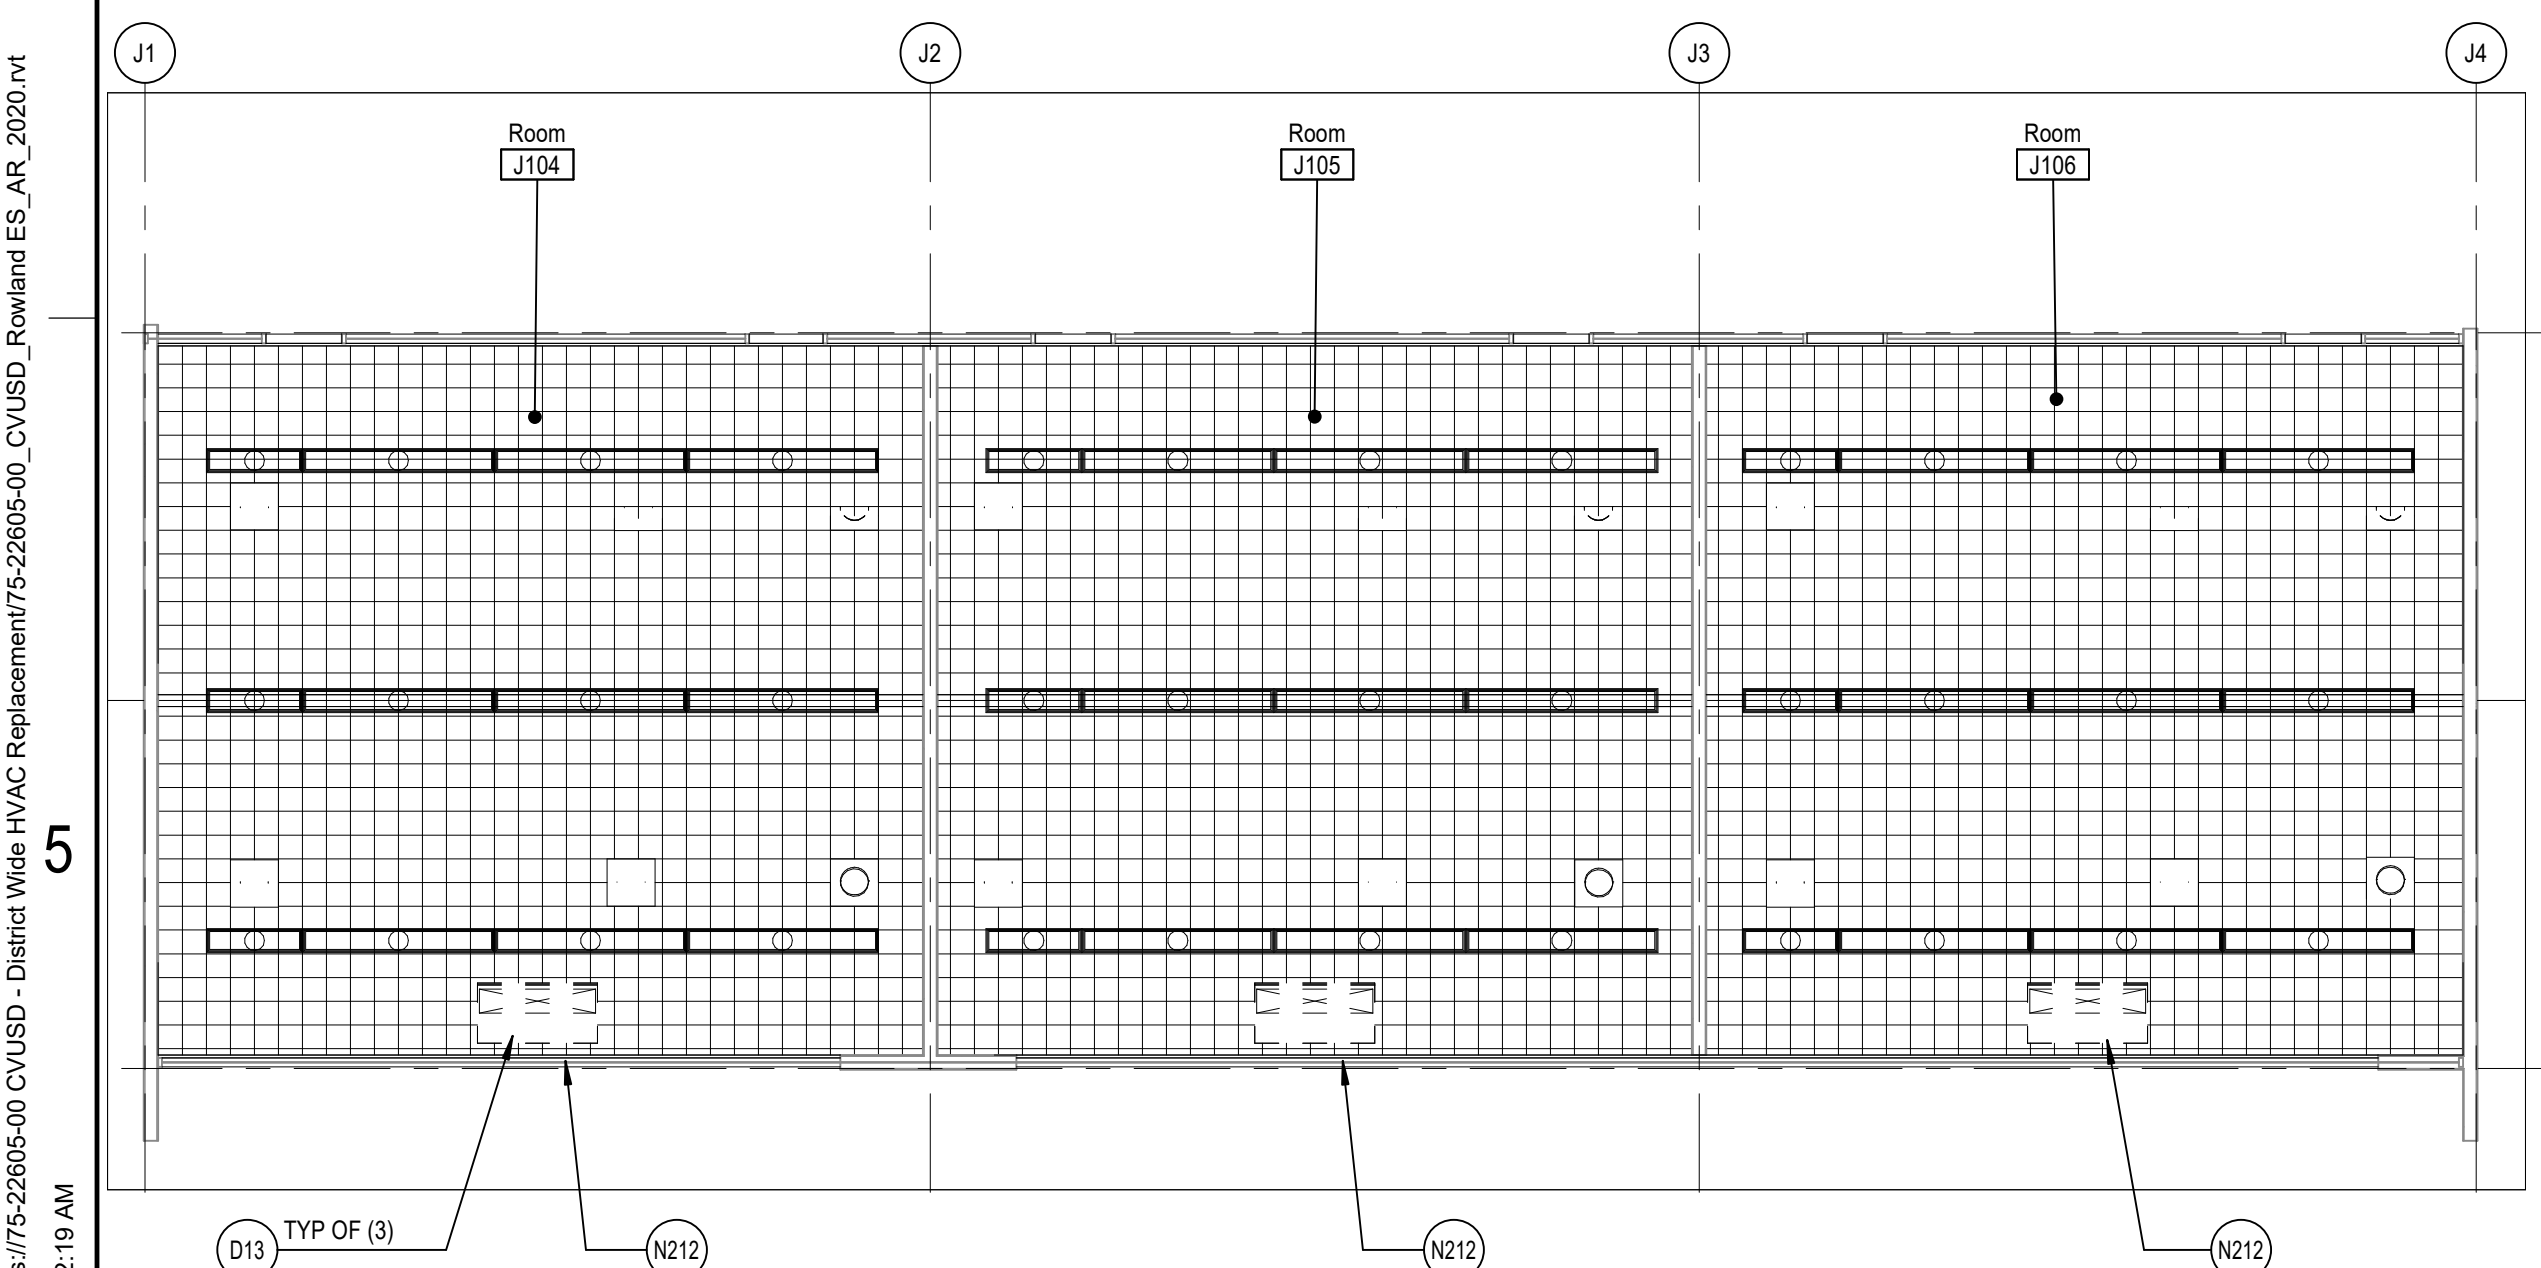

10 BUILDING J REFLECTED CEILING PLAN  
A3.1A SCALE: 1/8" = 1'-0"

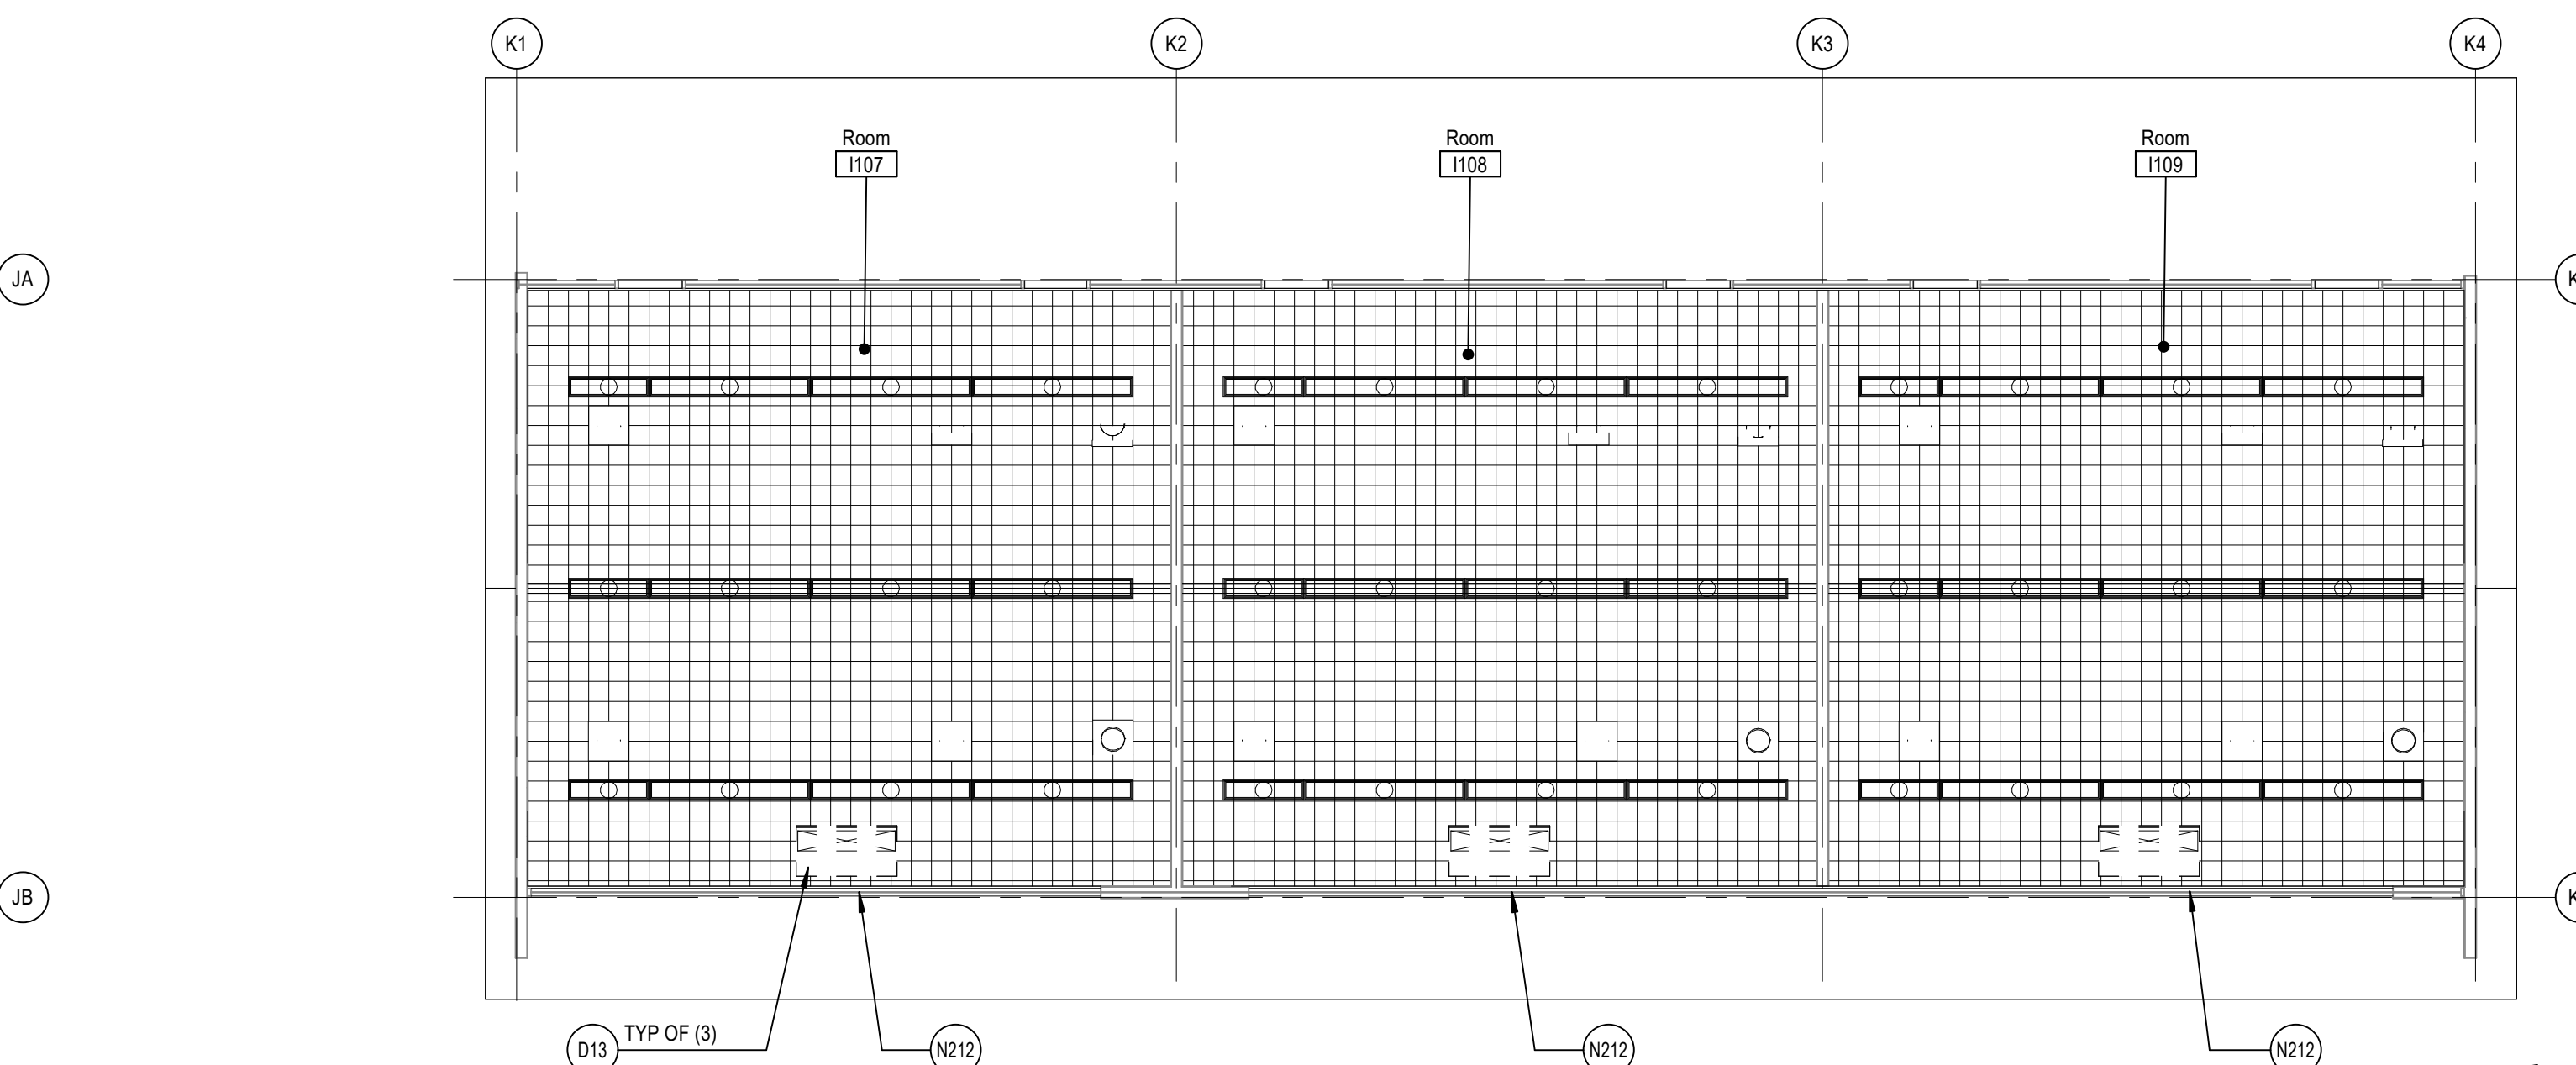

11 BUILDING K REFLECTED CEILING PLAN  
A3.1A SCALE: 1/8" = 1'-0"

DEMOLITION GENERAL NOTES

- DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.
- THE CONTRACTOR SHALL:
- COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
  - COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
  - CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
  - MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
  - VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
  - REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILING, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
  - THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
  - PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
  - REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
  - EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
  - VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
  - PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
  - CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
  - SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
  - AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
  - WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
  - WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

REFERENCE KEYNOTES

- D108 REMOVE (E) LADDER  
N212 REPLACE (E) INFL. PANEL AT CONDENSER UNIT PENETRATIONS WITH GLAZING TO MATCH ADJACENT ADJACENT. PAINT FRAME TO MATCH ADJACENT  
N510 NEW MECH. EQUIPMENT. SEE MECHANICAL DWGS.

REFLECTED CEILING PLAN GENERAL NOTES

- REFLECTED CEILING PLAN GENERAL NOTES APPLY TO ALL REFLECTED CEILING PLAN SHEETS.
- ALL CEILING GRID/PANELS SHALL BE CENTERED IN EACH ROOM UNLESS NOTED OTHERWISE.
- (E) CEILING HEIGHTS ARE TO REMAIN U.N.O. REFLECTED CEILING PLANS ARE MEASURED FROM THE FINISH FLOOR OF THE ROOM.
- IN ACOUSTICAL CEILING PANELS WITH SCORE IN THE CENTER, CENTER DEVICES IN ONE HALF OF THE TILE. DO NOT LOCATE ON THE SCORE. FOR ACP WITH MULTIPLE SCORED PATTERNS, COORDINATE LOCATION WITH THE ARCHITECT.
- PROVIDE SUSPENSION SYSTEM AROUND ELECTRICAL FIXTURES, MECHANICAL GRILLES, DIFFUSERS, AND OTHER CEILING MOUNTED DEVICES. AT ACOUSTICAL PANEL CEILINGS.
- ALL DIMENSIONS ON REFLECTED CEILING PLANS ARE ACTUAL AND ARE TO THE FOLLOWING UNLESS NOTED OTHERWISE:
  - FACE OF FINISHED WALL
  - FACE OF FINISHED BULKHEADS
  - CENTERLINE OF COLUMNS
  - CENTERLINE OF TEES
- IN AREAS WITH EXPOSED STRUCTURE CEILINGS, COORDINATE EXACT LOCATIONS OF MECHANICAL GRILLES, DIFFUSERS, DUCTWORK AND ELECTRICAL FIXTURES WITH EACH REPRESENTATIVE SUBCONTRACTOR.



ROWLAND ELEMENTARY SCHOOL  
COVID 19- COVINA VALLEY DISTRICT WIDE HVAC REPLACEMENT  
135E E. ROWLAND AVE. WEST COVINA, CA 91790

100% CONSTRUCTION DOCUMENTS  
11/08/2022 REVISIONS

75-22605-00  
DSA A#03-122233  
DSA File #: 19-25

REFLECTED CEILING PLANS

A3.1A

Autodesk Docu75-22605-00 CVUSD - District Web HVAC Replacement/75-22605-00 CVUSD - Rowland ES\_A3\_2020.rvt 11/22/2022 8:52:19 AM



ABBREVIATIONS


ABBREVIATIONS

SHEET INDEX

Table of abbreviations and their corresponding full names, organized in three columns.

Table of sheet index information, including sheet numbers and titles.

GENERAL SYMBOLS

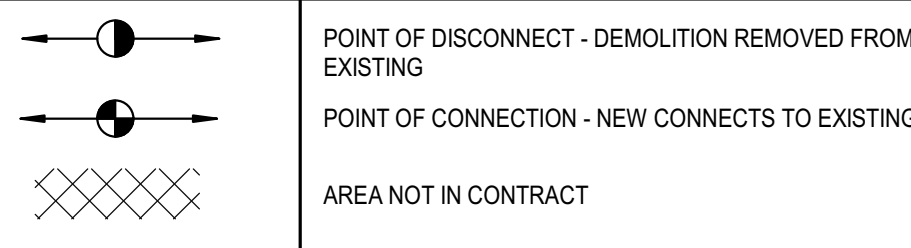

GENERAL NOTES

- List of general notes regarding mechanical contractor responsibilities, coordination, and equipment installation.

GENERAL HVAC NOTES

- List of general HVAC notes regarding condensate drains, supply and exhaust ductwork, and equipment anchorage.

HVAC SYMBOLS

Table of HVAC symbols with columns for Schematic, 3D, and Description, including various duct types, diffusers, and sensors.

PIPING VALVES AND FITTINGS

Table of piping valves and fittings with columns for Schematic, 3D, and Description, including pipe drops, tees, reducers, and various valves.

MECHANICAL MANDATORY MEASURES table containing sections on Equipment and Systems Efficiency, Controls, and Ventilation.

EQUIPMENT ANCHORAGE NOTE table detailing requirements for anchoring mechanical, electrical, and plumbing components.

ACCEPTANCE TESTING table detailing mandatory acceptance testing procedures and specific acceptance criteria for various systems.

NOTE: ALL NOTES ON THIS SHEET ARE APPLICABLE TO ALL OTHER SHEETS IN THIS SET.



Rowland Elementary School
COVINA VALLEY USD
1835 E ROWLAND AVE, WEST COVINA, CA 91790

100% CONSTRUCTION DOCUMENTS
11/08/2022
REVISIONS

75-22605-00

MECHANICAL SYMBOLS, ABBREVIATIONS & NOTES

MO.1



STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF COMPLIANCE** NRCC-MCH-E  
 Project Name: CVUSD Rowland Report Page: (Page 1 of 47)  
 Project Address: 1355 E Rowland Ave Date Prepared: 7/29/2022

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

**A. GENERAL INFORMATION**

01 Project Location (city)	West Covina	04 Total Conditioned Floor Area	23160
02 Climate Zone	10	05 Total Unconditioned Floor Area	0
03 Occupancy Types Within Project:		06 # of Stories (Habitable Above Grade)	1
<input type="checkbox"/> Office (B)	<input type="checkbox"/> Retail (M)	<input type="checkbox"/> Non-refrigerated Warehouse (S)	
<input type="checkbox"/> Hotel/ Motel Guest Rooms (R-1)	<input type="checkbox"/> School (E)	<input type="checkbox"/> Healthcare Facility (I)	
<input type="checkbox"/> High-Rise Residential (R-2/R-3)	<input type="checkbox"/> Relocatable Class Bldg (E)	<input type="checkbox"/> Other (write in)	See Table J

**B. PROJECT SCOPE**

This table includes mechanical systems or components that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

01 Air System(s)	02 Wet System Components	03 Dry System Components
<input checked="" type="checkbox"/> Heating Air System	<input type="checkbox"/> Water Economizer	<input checked="" type="checkbox"/> Air Economizer
<input checked="" type="checkbox"/> Cooling Air System	<input type="checkbox"/> Pumps	<input type="checkbox"/> Electric Resistance Heat
<input type="checkbox"/> Mechanical Controls	<input type="checkbox"/> System Piping	<input type="checkbox"/> Fan Systems
<input checked="" type="checkbox"/> Mechanical Controls (existing to remain, altered or new)	<input type="checkbox"/> Cooling Towers	<input checked="" type="checkbox"/> Ductwork (existing to remain, altered or new)
<input type="checkbox"/> Chillers	<input type="checkbox"/> Boilers	<input checked="" type="checkbox"/> Ventilation
<input type="checkbox"/> Zonal Systems/ Terminal Boxes		

Registration Number: Registration Date/Time: Registration Provider: Energysoft  
 CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance Report Version: 2019.1.003 Report Generated: 2022-07-29 10:57:02  
 Schema Version: rev 20200601

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF COMPLIANCE** NRCC-MCH-E  
 Project Name: CVUSD Rowland Report Page: (Page 4 of 47)  
 Project Address: 1355 E Rowland Ave Date Prepared: 7/29/2022

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

**F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)**

This table is used to demonstrate compliance for mechanical equipment with mandatory requirements found in §110.1 and §110.2(a), and prescriptive requirements found in §140.4(a), §140.4(b), and §140.4(c) or §141.0(b)2 for alterations.

01	02	03	04	05	06	07	08	09	10	11
RTU-H3	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	25.35	23	31.36	27.39
RTU-C1	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	15.36	26	0	30.54	30	35.91	34.15
RTU-C2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	15.36	26	0	30.54	28	35.91	33.7
RTU-I2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	26.59	24	31.36	27.84
RTU-I2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	12.4	21	0	25.33	23	29.39	26.53
RTU-I3	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	26.49	24	31.36	27.39
RTU-J1	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	26.59	24	31.36	27.84
RTU-J2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13	22	0	25.33	23	29.39	26.53
RTU-J3	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	26.49	24	31.36	27.39
RTU-K1	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	25.45	23	31.36	27.84
RTU-K2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13	22	0	25.33	23	29.39	26.53
RTU-K3	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	25.35	23	31.36	27.39

<sup>1</sup> FOOTNOTES: Equipment shall be the smallest size, within the available options of the desired equipment line, necessary to meet the design heating and cooling loads of the building per §140.4(a). Healthcare facilities are exempt.  
<sup>2</sup> It is common practice to show rated output capacity on the equipment schedule. Sensible cooling output comes from specification sheet tables.  
<sup>3</sup> If equipment is heating only, leave cooling output and load blank. If equipment is cooling only, leave heating output and load blank.

Registration Number: Registration Date/Time: Registration Provider: Energysoft  
 CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance Report Version: 2019.1.003 Report Generated: 2022-07-29 10:57:02  
 Schema Version: rev 20200601

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF COMPLIANCE** NRCC-MCH-E  
 Project Name: CVUSD Rowland Report Page: (Page 7 of 47)  
 Project Address: 1355 E Rowland Ave Date Prepared: 7/29/2022

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

**H. FAN SYSTEMS & AIR ECONOMIZERS**

This table is used to demonstrate compliance with prescriptive requirements found in §140.4(i), §140.4(j), and §140.4(m) for fan systems. Fan systems serving only process loads are exempt from these requirements and do not need to be included in Table H.

System Name:	RTU-D1	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(e) and (m)	System Fan Type:	Constant Volume
01	02	03	04	05	06	07	08
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B	Design Airflow through Device (CFM)
SF	Supply	1	1200	BHP	0.91		
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):		0.91	Maximum System Fan Power (BHP):
System Name:	RTU-D2	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(e) and (m)	System Fan Type:	Constant Volume
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B	Design Airflow through Device (CFM)
SF	Supply	1	1200	BHP	0.91		
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):		0.91	Maximum System Fan Power (BHP):
System Name:	RTU-D3	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(e) and (m)	System Fan Type:	Constant Volume
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B	Design Airflow through Device (CFM)
SF	Supply	1	1200	BHP	0.91		
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):		0.91	Maximum System Fan Power (BHP):

Registration Number: Registration Date/Time: Registration Provider: Energysoft  
 CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance Report Version: 2019.1.003 Report Generated: 2022-07-29 10:57:02  
 Schema Version: rev 20200601

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF COMPLIANCE** NRCC-MCH-E  
 Project Name: CVUSD Rowland Report Page: (Page 2 of 47)  
 Project Address: 1355 E Rowland Ave Date Prepared: 7/29/2022

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

**C. COMPLIANCE RESULTS**

Table C will indicate if the project data input into the compliance document is compliant with mechanical requirements. This table is not editable by the user. If this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D., or the table indicated as not compliant for guidance.

01	02	03	04	05	06	07	08	09
System Summary §110.1, §110.2, §140.4	AND Pumps §140.4(b)	AND Fans/Economizers §140.4(c), §140.4(e)	AND System Controls §110.2, §120.2, §140.4(f)	AND Ventilation §120.1	AND Terminal Box Controls §140.4(d)	AND Distribution §120.3, §140.4(i)	AND Cooling Towers §110.2(e), §140.4(j)	COMPLIES
(See Table F)	(See Table G)	(See Table H)	(See Table I)	(See Table J)	(See Table K)	(See Table L)	(See Table M)	COMPLIES
Yes	AND	AND	Yes	AND	Yes	AND	Yes	AND
Mandatory Measures Compliance (See Table Q for Details)								COMPLIES

**D. EXCEPTIONAL CONDITIONS**

This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

**E. ADDITIONAL REMARKS**

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Registration Number: Registration Date/Time: Registration Provider: Energysoft  
 CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance Report Version: 2019.1.003 Report Generated: 2022-07-29 10:57:02  
 Schema Version: rev 20200601

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF COMPLIANCE** NRCC-MCH-E  
 Project Name: CVUSD Rowland Report Page: (Page 5 of 47)  
 Project Address: 1355 E Rowland Ave Date Prepared: 7/29/2022

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

**F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)**

This table is used to demonstrate compliance for mechanical equipment with mandatory requirements found in §110.1 and §110.2(a), and prescriptive requirements found in §140.4(a), §140.4(b), and §140.4(c) or §141.0(b)2 for alterations.

01	02	03	04	05	06	07	08	09	10	11
FCU/CU-B1	Unitary Heat Pumps	Air-cooled, split (3 phase)	NA: Load Controls	94.51	160	0	172.98	160	225.32	182.98
RTU-D1	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13	22	0	27.29	23	31.36	27.84
RTU-D2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	12.4	21	0	21.93	22	29.39	26.53
RTU-D3	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13	22	0	26.49	24	31.36	27.39
RTU-F1	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	26.59	24	31.36	27.84
RTU-F2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	25.33	23	29.39	26.53
RTU-F3	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	25.35	23	31.36	27.39
RTU-H1	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	26.59	24	31.36	27.84
RTU-H2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	25.33	23	29.39	26.53

Registration Number: Registration Date/Time: Registration Provider: Energysoft  
 CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance Report Version: 2019.1.003 Report Generated: 2022-07-29 10:57:02  
 Schema Version: rev 20200601

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF COMPLIANCE** NRCC-MCH-E  
 Project Name: CVUSD Rowland Report Page: (Page 6 of 47)  
 Project Address: 1355 E Rowland Ave Date Prepared: 7/29/2022

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

**F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)**

This table is used to demonstrate compliance for mechanical equipment with mandatory requirements found in §110.1 and §110.2(a), and prescriptive requirements found in §140.4(a), §140.4(b), and §140.4(c) or §141.0(b)2 for alterations.

01	02	03	04	05	06	07	08	09
Name or Item Tag	Size Category (Btu/h)	Rating Condition (°F)	Efficiency Unit	Minimum Efficiency Required per Tables 110.2 / Title 20	Design Efficiency	Efficiency Unit	Minimum Efficiency Required per Tables 110.2 / Title 20	Design Efficiency
FCU/CU-B1	>=135,000 and <240,000		COP	3.2	3.5	EER	10.6	10.7
RTU-D1	<65,000		HSPF	7.7	13	SEER	11.6	12.5
RTU-D2	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-D3	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-F1	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-F2	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-F3	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-H1	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-H2	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-H3	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-C1	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-C2	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-I1	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-I2	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-I3	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-J1	<65,000		HSPF	7.7	13	SEER	13.0	14.3
RTU-J2	<65,000		HSPF	7.7	13	SEER	13.0	14.3

Registration Number: Registration Date/Time: Registration Provider: Energysoft  
 CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance Report Version: 2019.1.003 Report Generated: 2022-07-29 10:57:02  
 Schema Version: rev 20200601

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF COMPLIANCE** NRCC-MCH-E  
 Project Name: CVUSD Rowland Report Page: (Page 8 of 47)  
 Project Address: 1355 E Rowland Ave Date Prepared: 7/29/2022

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

**H. FAN SYSTEMS & AIR ECONOMIZERS**

This table is used to demonstrate compliance with prescriptive requirements found in §140.4(i), §140.4(j), and §140.4(m) for fan systems. Fan systems serving only process loads are exempt from these requirements and do not need to be included in Table H.

System Name:	RTU-F1	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(e) and (m)	System Fan Type:	Constant Volume
01	02	03	04	05	06	07	08
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B	Design Airflow through Device (CFM)
SF	Supply	1	1200	BHP	0.91		
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):		0.91	Maximum System Fan Power (BHP):
System Name:	RTU-F2	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(e) and (m)	System Fan Type:	Constant Volume
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B	Design Airflow through Device (CFM)
SF	Supply	1	1200	BHP	0.91		
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):		0.91	Maximum System Fan Power (BHP):
System Name:	RTU-F3	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(e) and (m)	System Fan Type:	Constant Volume
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B	Design Airflow through Device (CFM)
SF	Supply	1	1200	BHP	0.91		
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):		0.91	Maximum System Fan Power (BHP):

Registration Number: Registration Date/Time: Registration Provider: Energysoft  
 CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance Report Version: 2019.1.003 Report Generated: 2022-07-29 10:57:02  
 Schema Version: rev 20200601

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

**CERTIFICATE OF COMPLIANCE** NRCC-MCH-E  
 Project Name: CVUSD Rowland Report Page: (Page 3 of 47)  
 Project Address: 1355 E Rowland Ave Date Prepared: 7/29/2022

This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

**F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)**

This table is used to demonstrate compliance for mechanical equipment with mandatory requirements found in §110.1 and §110.2(a), and prescriptive requirements found in §140.4(a), §140.4(b), and §140.4(c) or §141.0(b)2 for alterations.

01	02	03	04	05	06	07	08	09	10	11
Name or Item Tag	Equipment Category per Tables 110.2	Equipment Type per Tables 110.2 / Title 20	Smallest Size Available <sup>1</sup> §140.4(a)	Equipment Sizing per Mechanical Schedule (kBtu/h)			Load Calculations <sup>4</sup>			
			Per Design (kBtu/h)	Rated (kBtu/h)	Supp. Heating Output (kBtu/h)	Sensible Per Design (kBtu/h)	Rated (kBtu/h)	Total Heating Load (kBtu/h)	Total Sensible Cooling Load (kBtu/h)	Total Cooling Load (kBtu/h)
FCU/CU-B1	Unitary Heat Pumps	Air-cooled, split (3 phase)	NA: Load Controls	94.51	160	0	172.98	160	225.32	182.98
RTU-D1	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13	22	0	27.29	23	31.36	27.84
RTU-D2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	12.4	21	0	21.93	22	29.39	26.53
RTU-D3	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13	22	0	26.49	24	31.36	27.39
RTU-F1	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	26.59	24	31.36	27.84
RTU-F2	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	25.33	23	29.39	26.53
RTU-F3	Unitary Heat Pumps	Air-cooled, pkg (3 phase)	NA: Load Controls	13.59	23	0	25.35	23	31.36	27.39
RTU-H1	Unitary Heat Pumps	Air-cooled, pkg								



















STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

<b>CERTIFICATE OF COMPLIANCE</b>	NRCC-MCH-E	
Project Name:	CVUSD Rowland	Report Page: (Page 46 of 47)
Project Address:	1355 E Rowland Ave	Date Prepared: 7/29/2022

**Q. MANDATORY MEASURES DOCUMENTATION LOCATION**  
 This table is used to indicate where mandatory measures are documented in the plan set or construction documentation.

	01	02
Compliance with Mandatory Measures documented through MCH	Yes	M-Sheets
Mandatory Measures Note Block		

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance  
 Registration Date/Time: Report Version: 2019.1.003  
 Registration Provider: Energysoft  
 Schema Version: rev 20200601  
 Report Generated: 2022-07-29 10:57:02

STATE OF CALIFORNIA  
**Mechanical Systems**  
 NRCC-MCH-E CALIFORNIA ENERGY COMMISSION

<b>CERTIFICATE OF COMPLIANCE</b>	NRCC-MCH-E	
Project Name:	CVUSD Rowland	Report Page: (Page 47 of 47)
Project Address:	1355 E Rowland Ave	Date Prepared: 7/29/2022

**DOCUMENTATION AUTHOR'S DECLARATION STATEMENT**  
 I certify that this Certificate of Compliance documentation is accurate and complete.


Documentation Author Name: Abhijit Rege	Documentation Author Signature: 
Company: DLR Group	Signature Date: 2022-07-29
Address: CEA/HERS Certification Identification (if applicable): 9F30-5A88-E6C4-7653-2F72-AS2E-9671-A2D4-7420-7AD7-DA3E-A59B-8F3B-18A3-B88E-17FE	City/State/Zip: Phone: (949)-701-8533

**RESPONSIBLE PERSON'S DECLARATION STATEMENT**  
 I certify the following under penalty of perjury, under the laws of the State of California:

- The information provided on this Certificate of Compliance is true and correct.
- I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
- The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
- I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: TONG FANG ZHAO	Responsible Designer Signature: 
Company: DLR GROUP	Date Signed: 2022-07-29
Address: 700 FLOWER STREET	License: M-34291
City/State/Zip: LOS ANGELES CA 90017	Phone:

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance  
 Registration Date/Time: Report Version: 2019.1.003  
 Registration Provider: Energysoft  
 Schema Version: rev 20200601  
 Report Generated: 2022-07-29 10:57:02

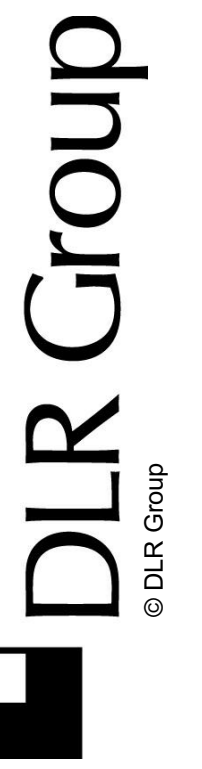

**Rowland Elementary School**  
 COVINA VALLEY USD  
 1355 E ROWLAND AVE, WEST COVINA, CA 91790

100%  
 CONSTRUCTION  
 DOCUMENTS  
 11/08/2022  
 REVISIONS

75-22605-00

TITLE 24  
 COMPLIANCE

M0.7



A

B

C

D

E

F

1

2

3

4

5







 **MECHANICAL SITE PLAN**  
SCALE: 1/32" = 1'-0"

**GENERAL NOTES**

A FOR SYMBOLS AND ABBREVIATIONS SEE DRAWING M0.1

**SITE LEGEND**

-  EXISTING BUILDING NOT IN SCOPE
-  EXISTING BUILDING - SCOPE OF WORK UNDER THIS DSA APPLICATION
-  (E) RESTROOMS - NOT IN SCOPE

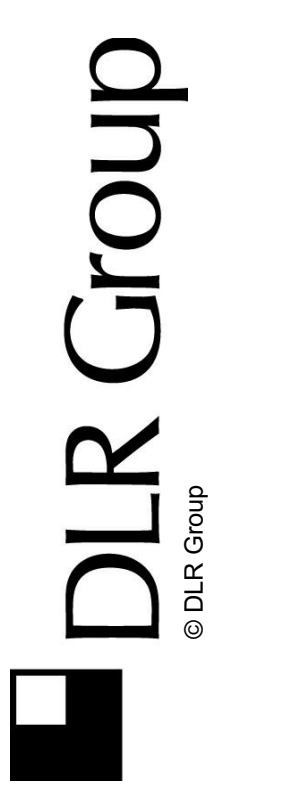

**Rowland Elementary School**  
COVINA VALLEY USD  
1855 E ROWLAND AVE. WEST COVINA, CA 91790

100%  
CONSTRUCTION  
DOCUMENTS  
11/08/2022  
REVISIONS

75-22605-00

MECHANICAL  
SITE PLAN


**M1.1**

Autodesk Docs/75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD\_Rowland ES MEP\_2022.rvt  
10/21/2022 4:42:51 PM









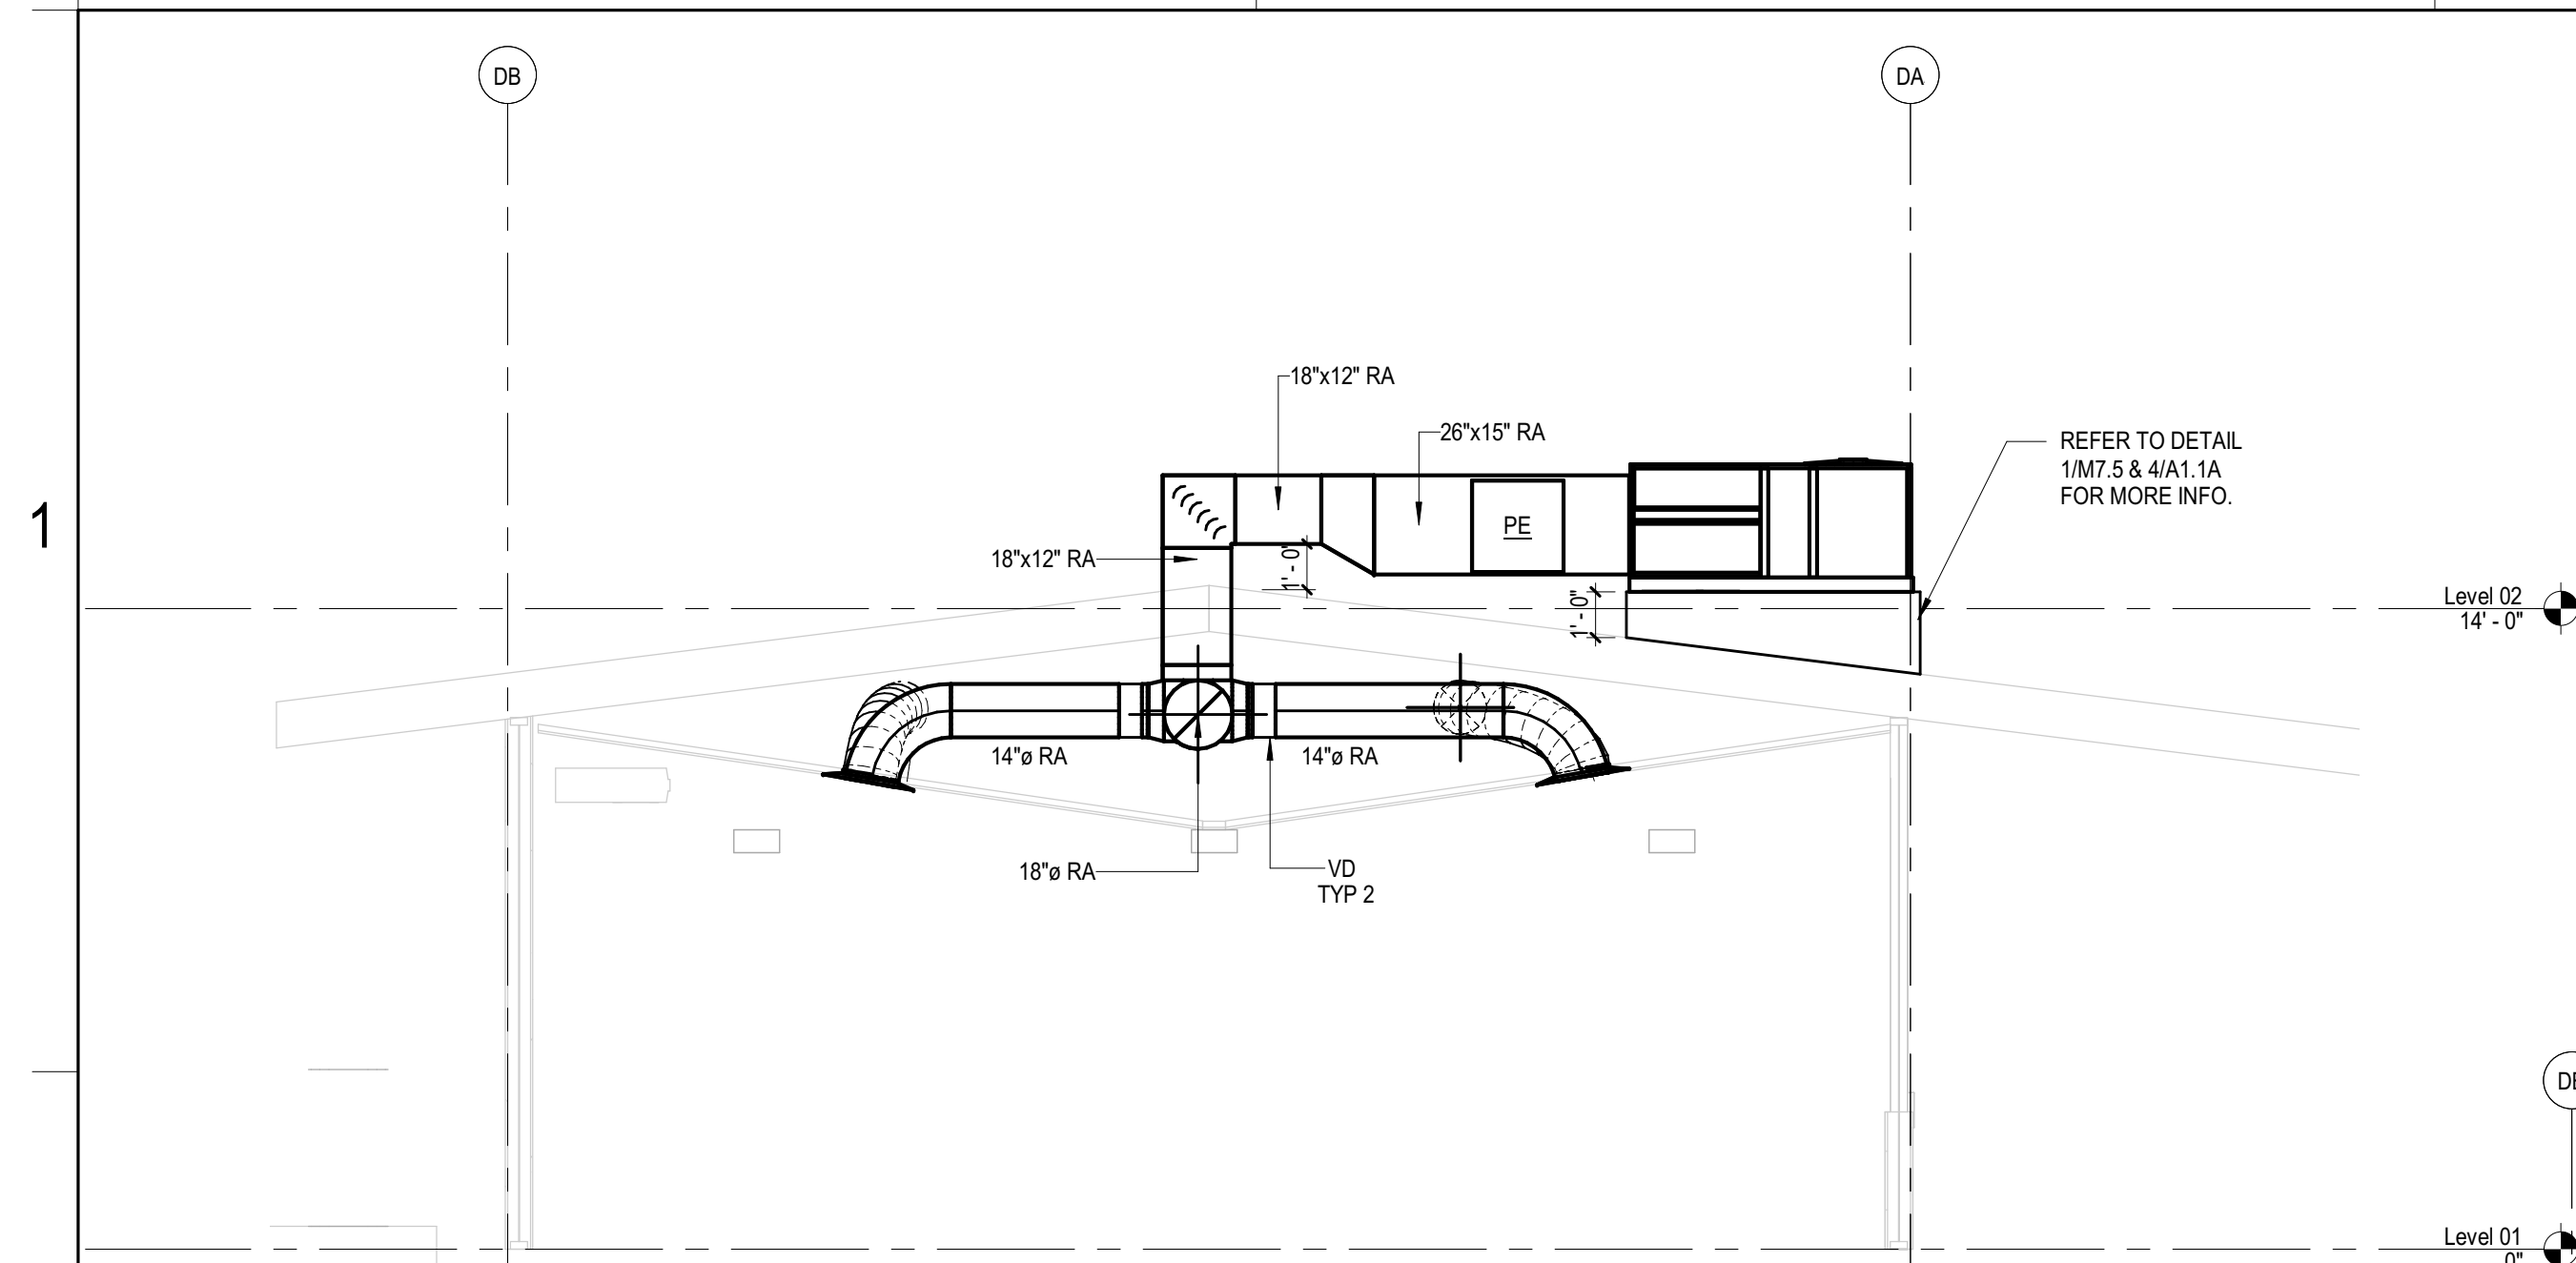


**BUILDING SECTION 2**  
SCALE: 1/4" = 1'-0"

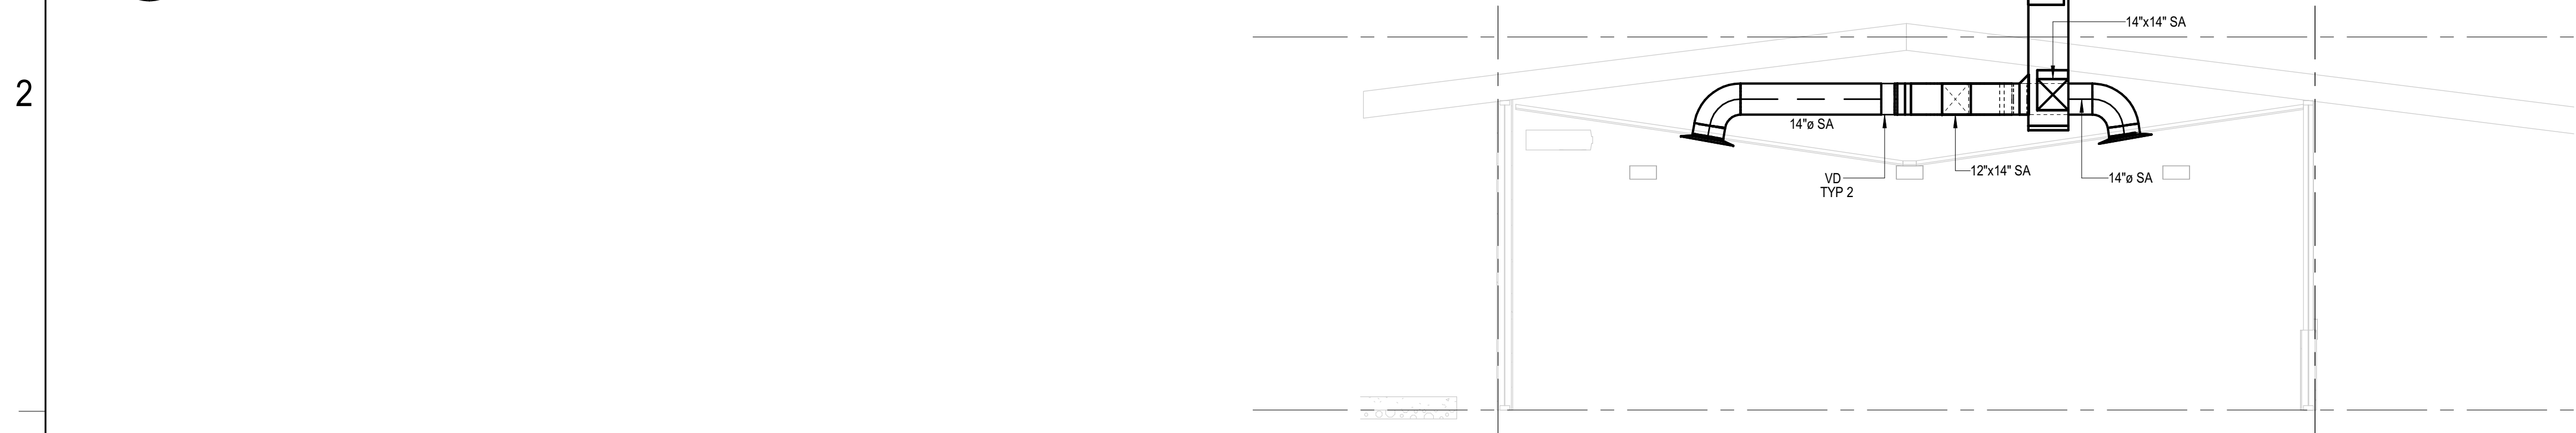


**BUILDING SECTION 1**  
SCALE: 1/4" = 1'-0"

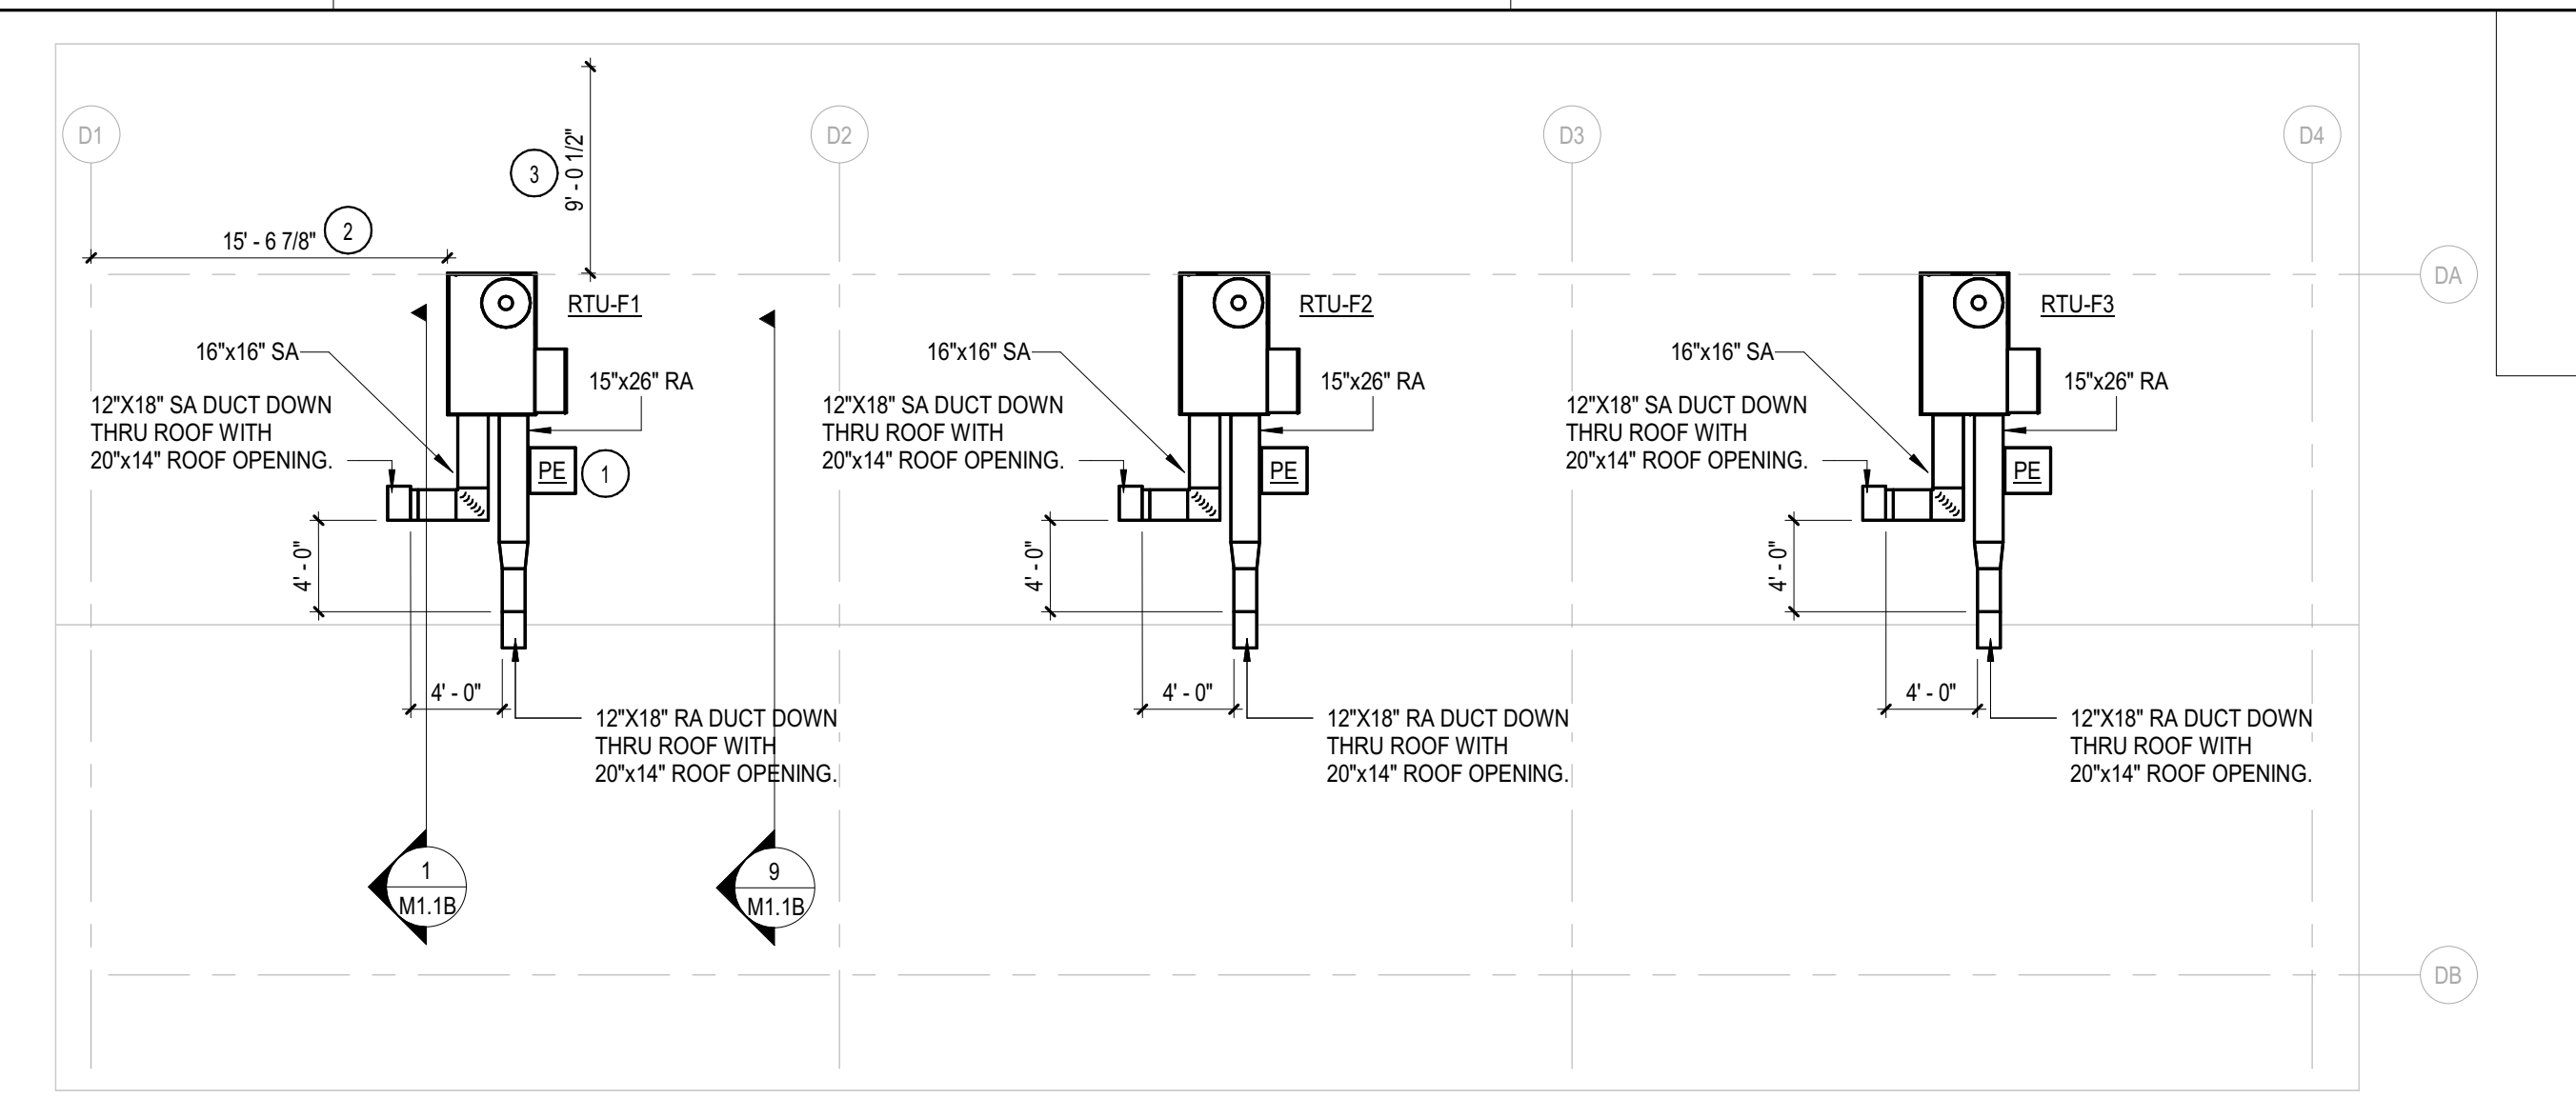


**BUILDING F MECHANICAL ROOF PLAN**  
SCALE: 1/8" = 1'-0"

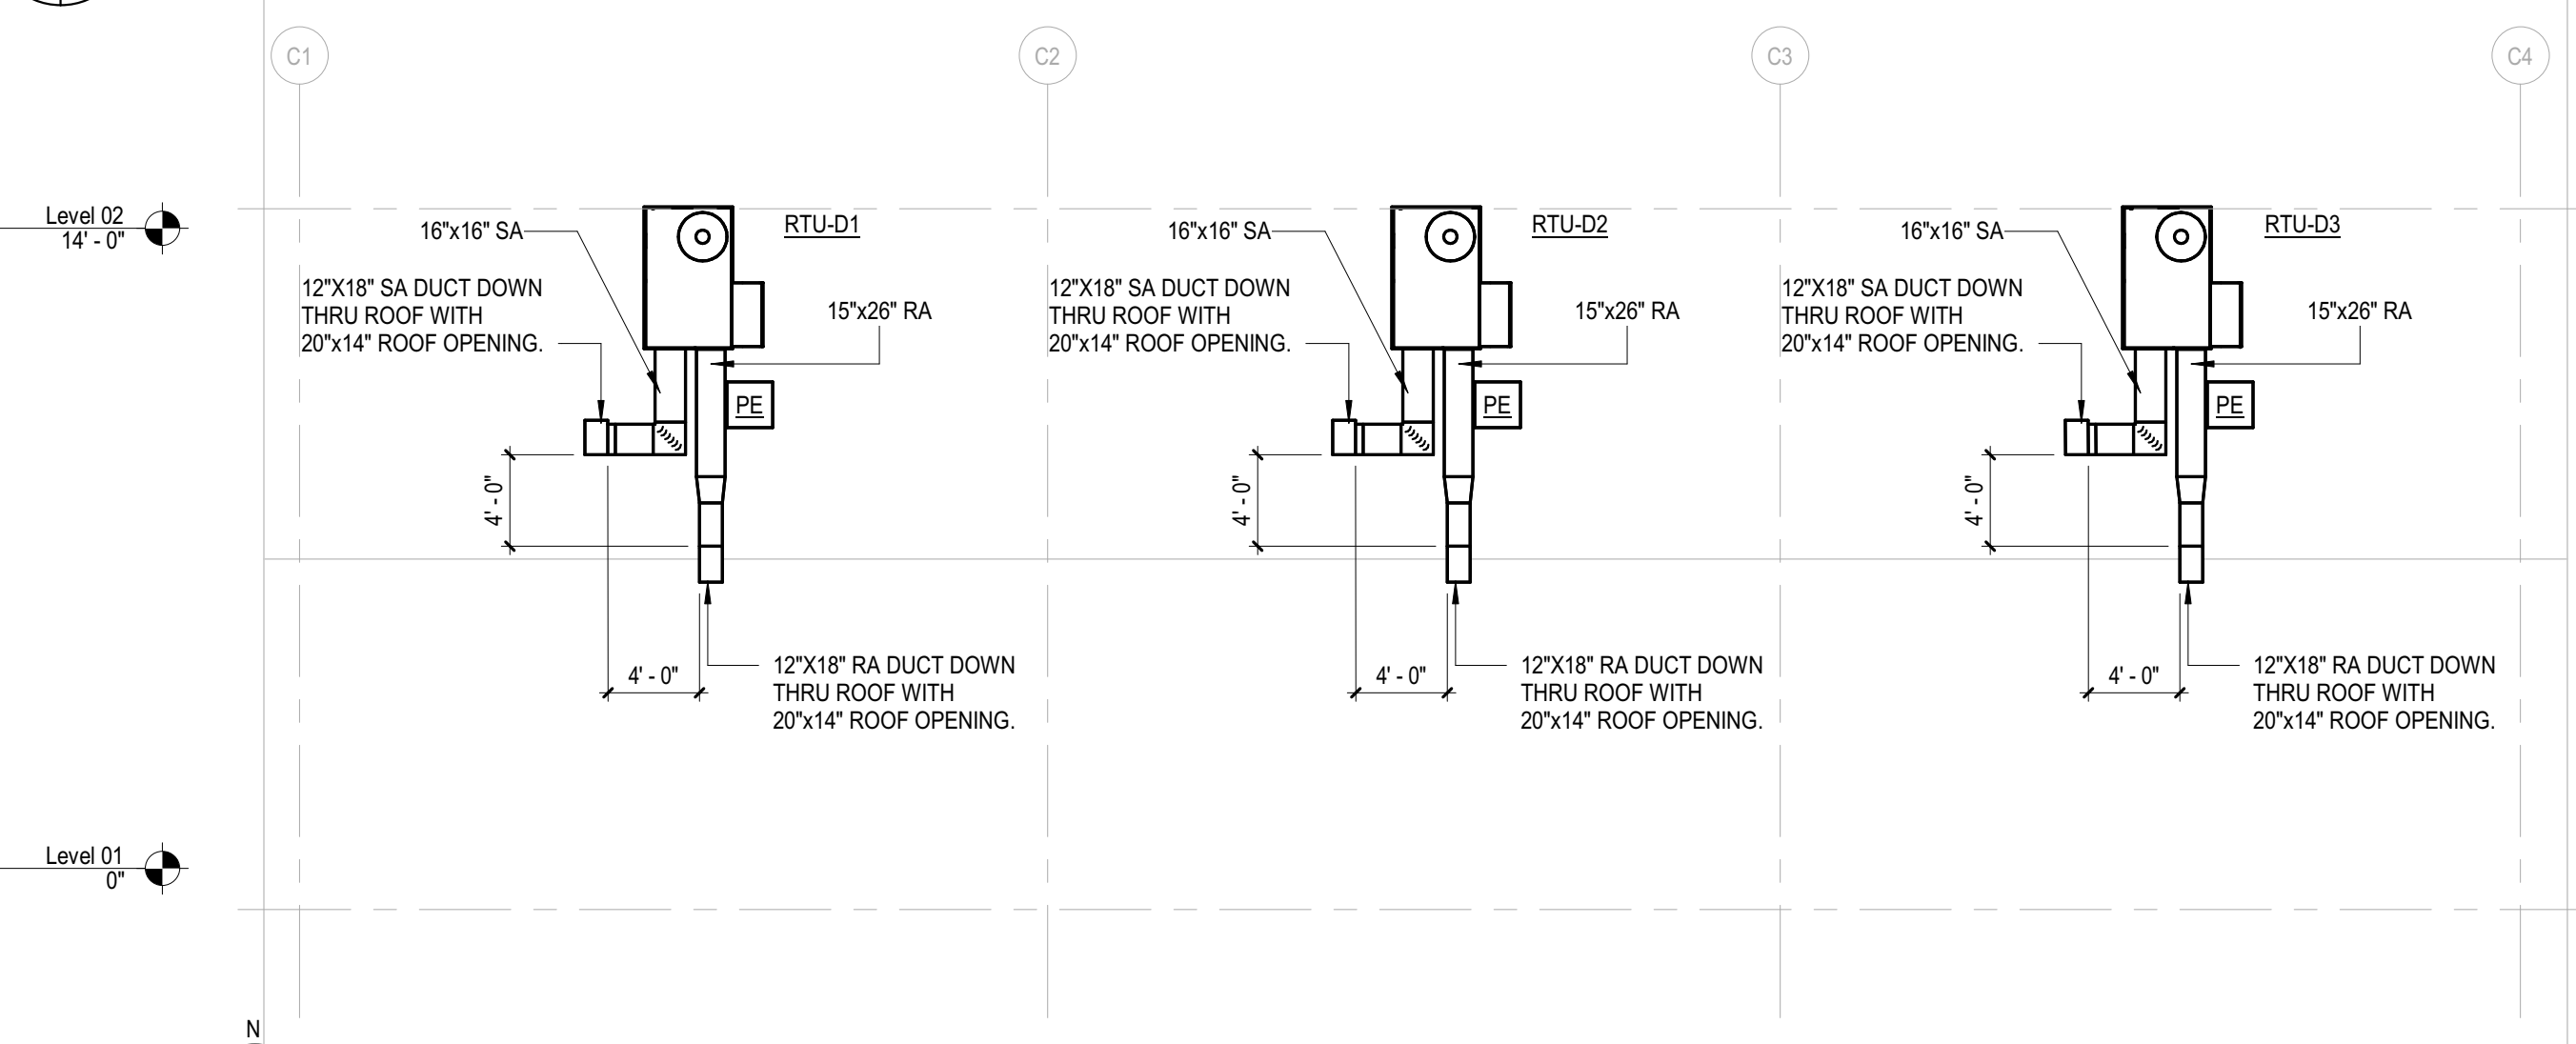


**BUILDING D MECHANICAL ROOF PLAN**  
SCALE: 1/8" = 1'-0"

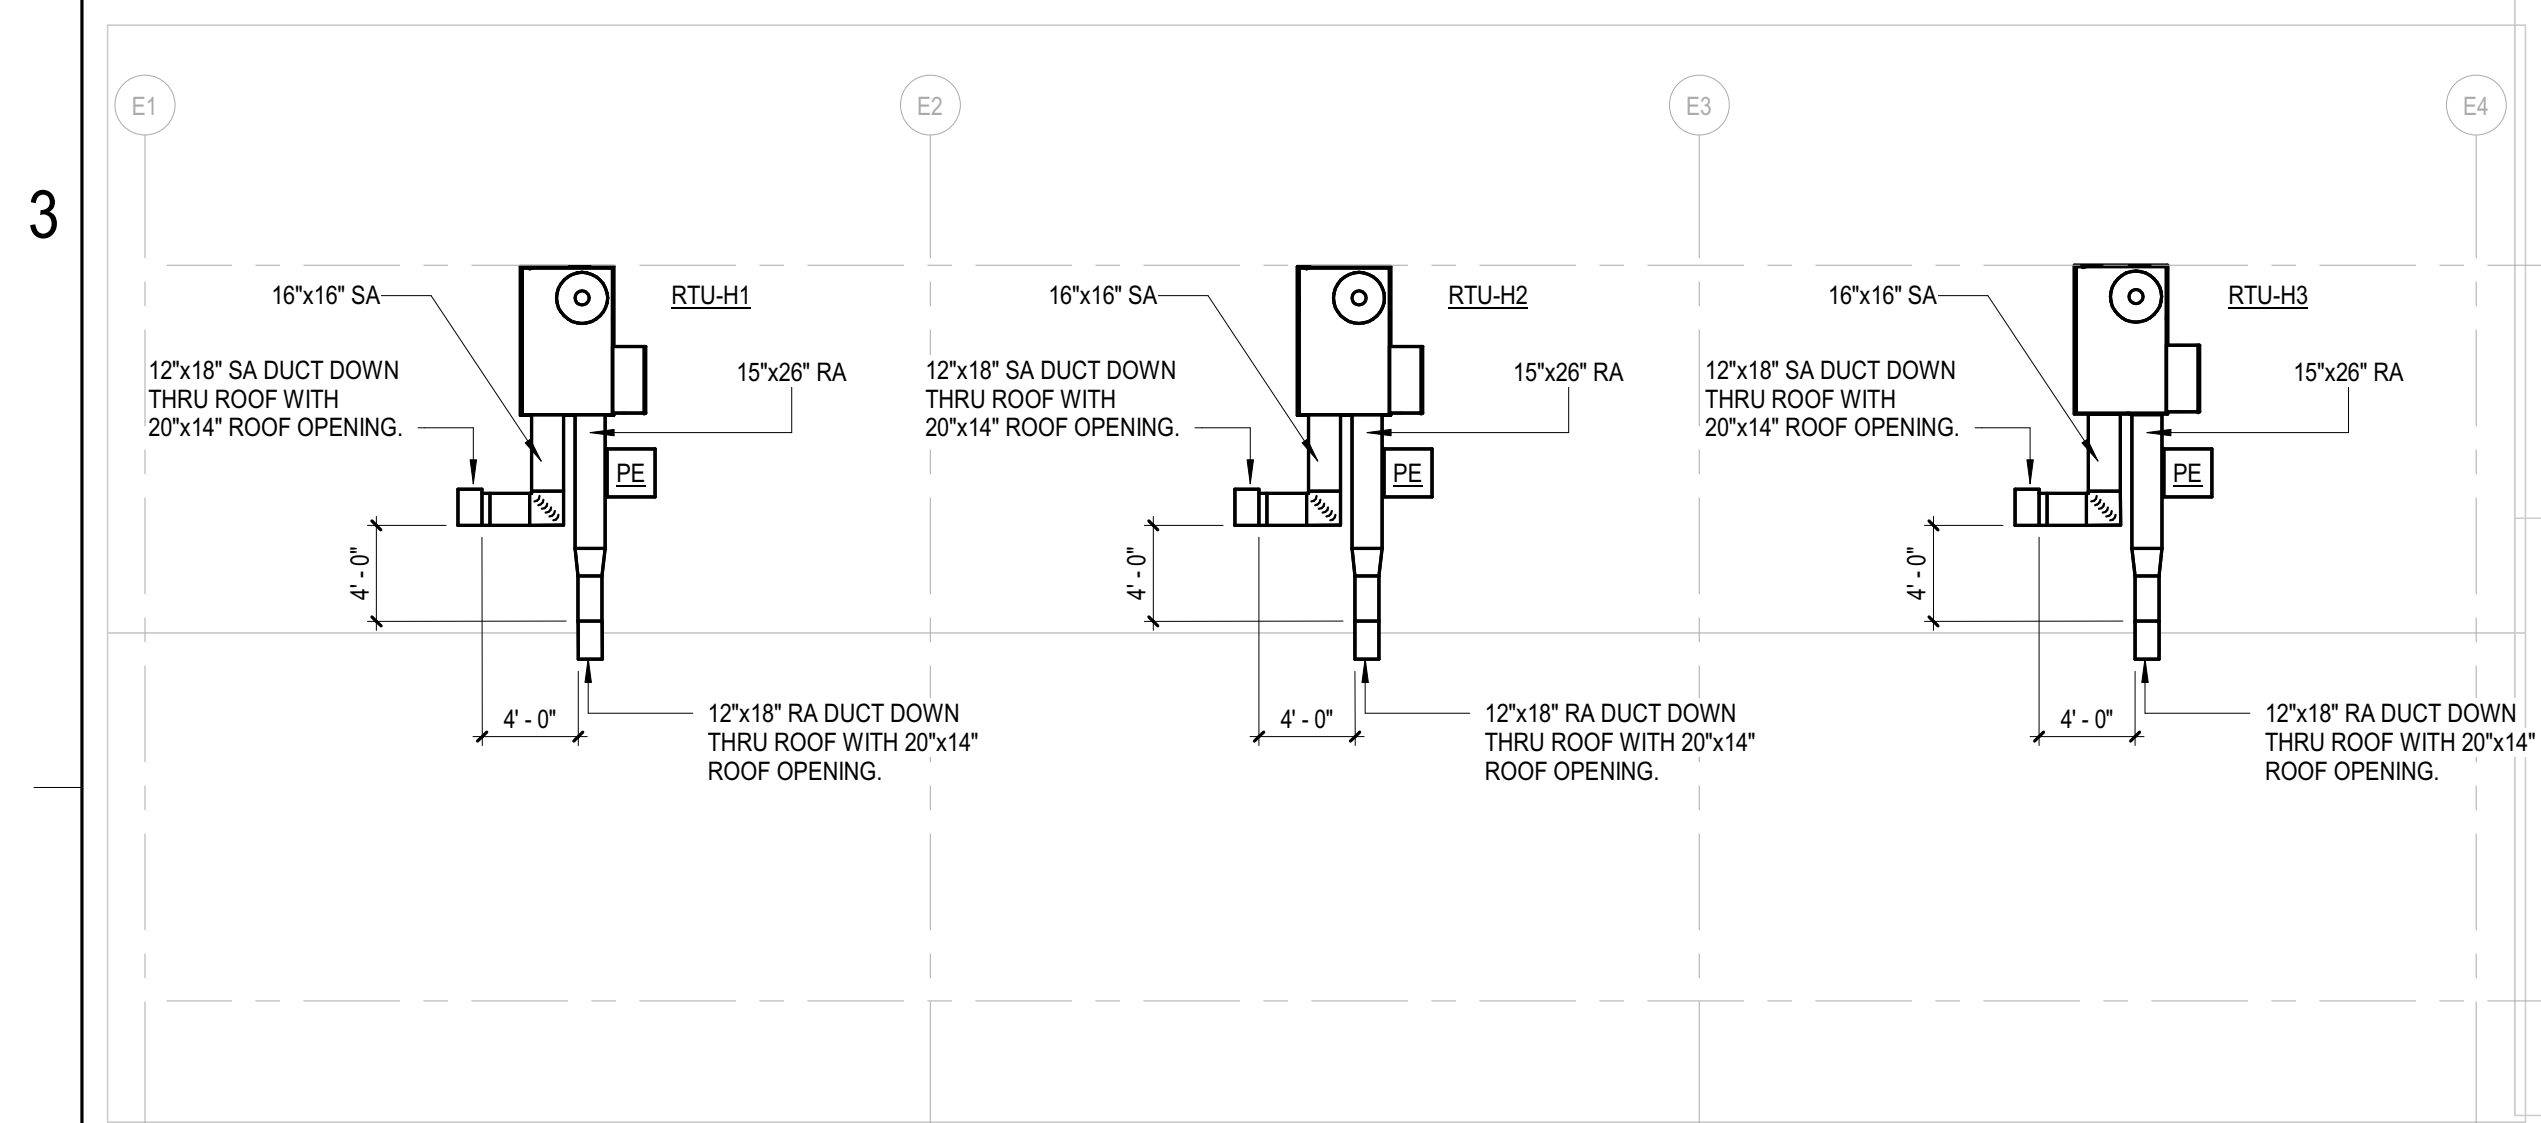


**BUILDING H MECHANICAL ROOF PLAN**  
SCALE: 1/8" = 1'-0"

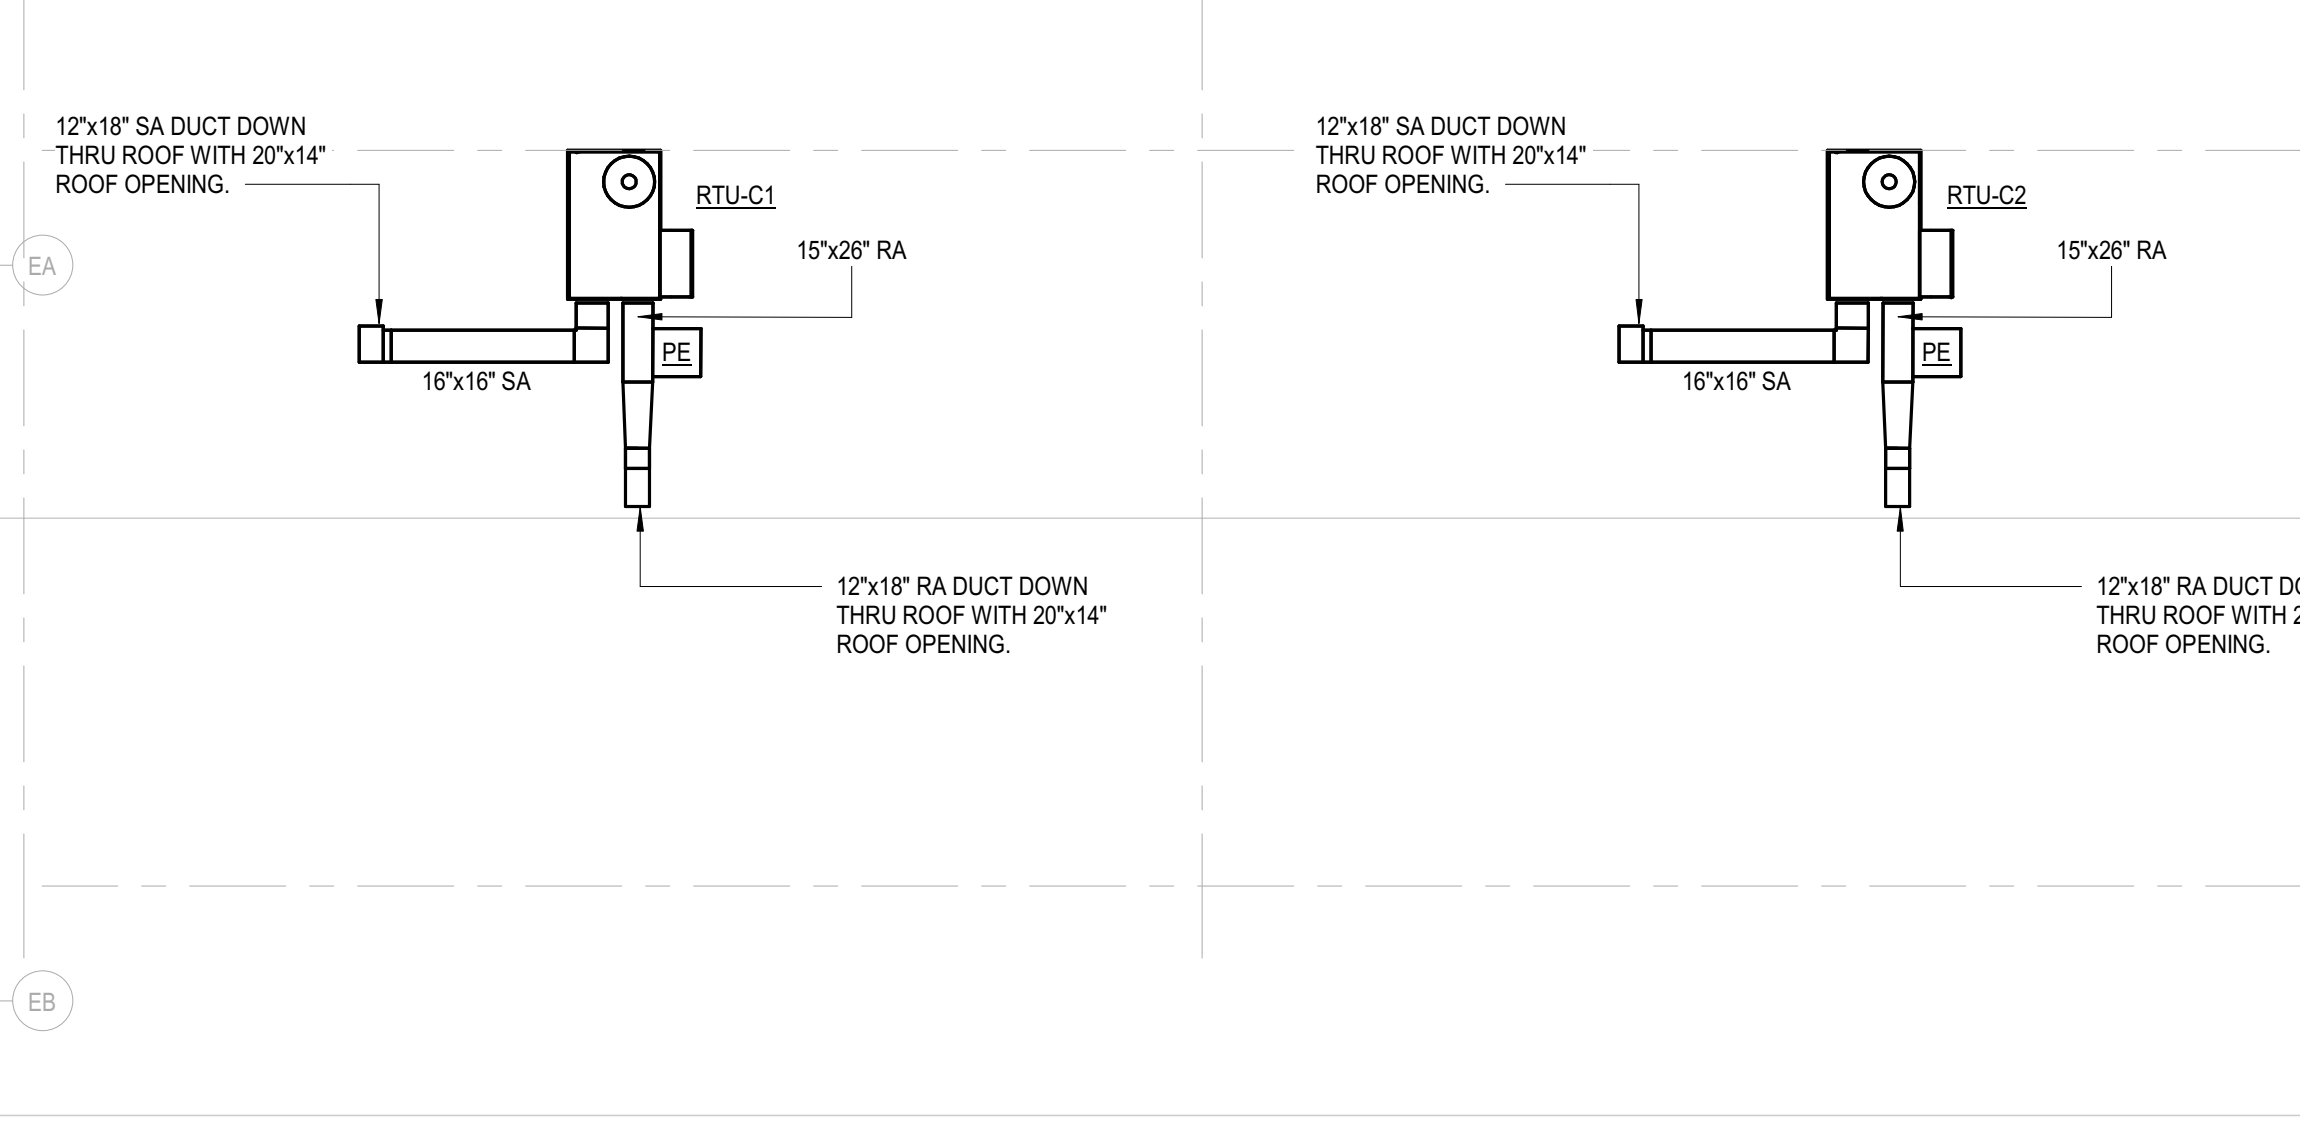

**BUILDING C MECHANICAL ROOF PLAN**  
SCALE: 1/8" = 1'-0"

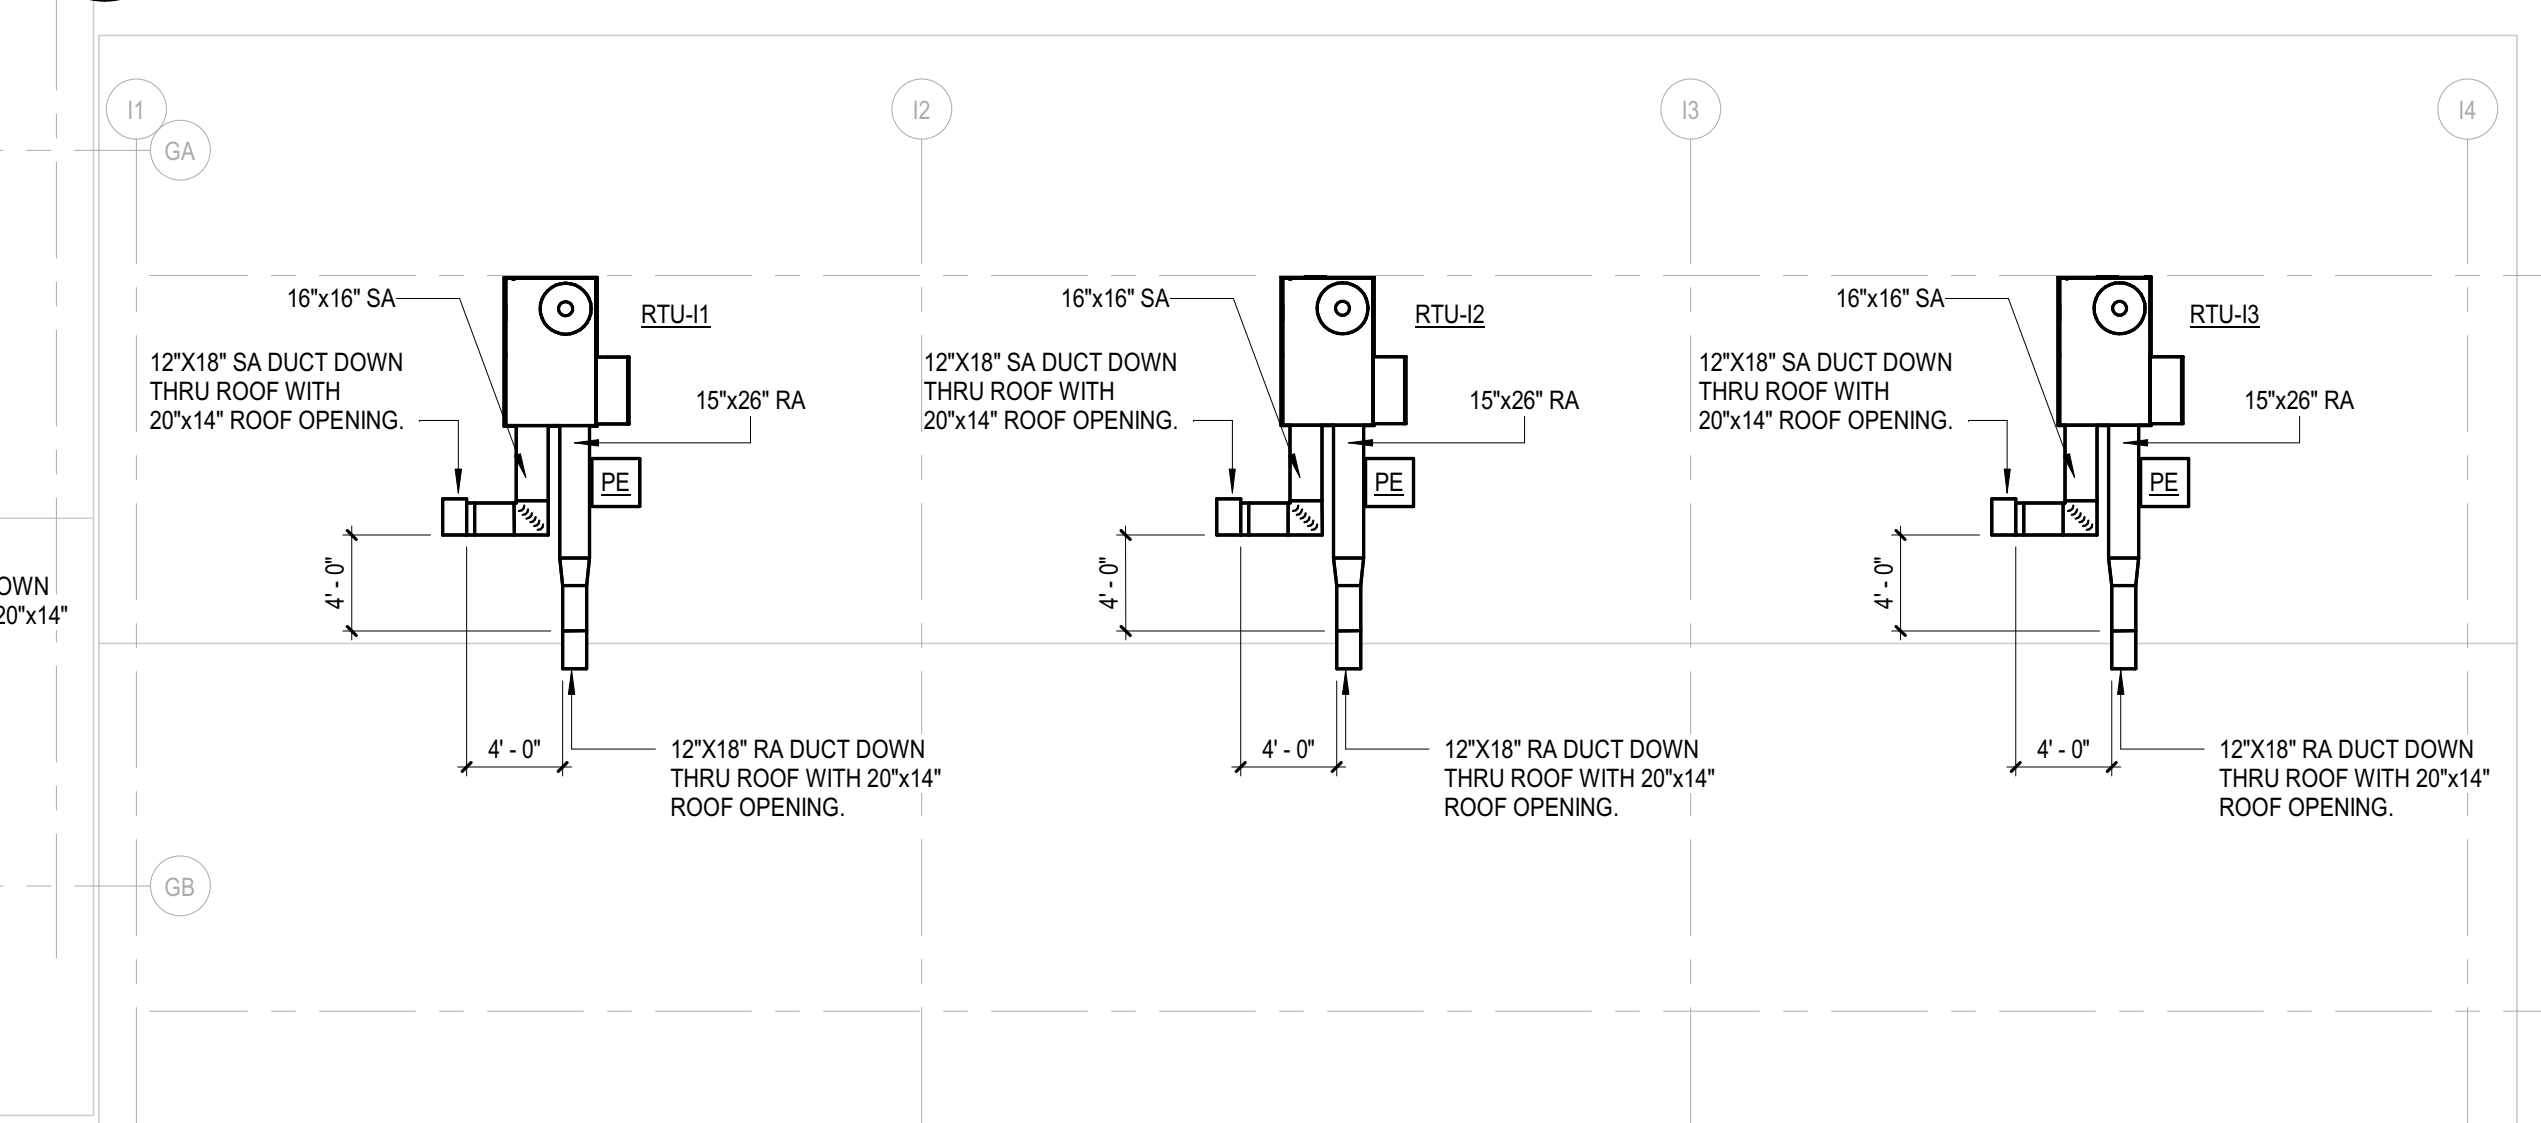

**BUILDING I MECHANICAL ROOF PLAN**  
SCALE: 1/8" = 1'-0"

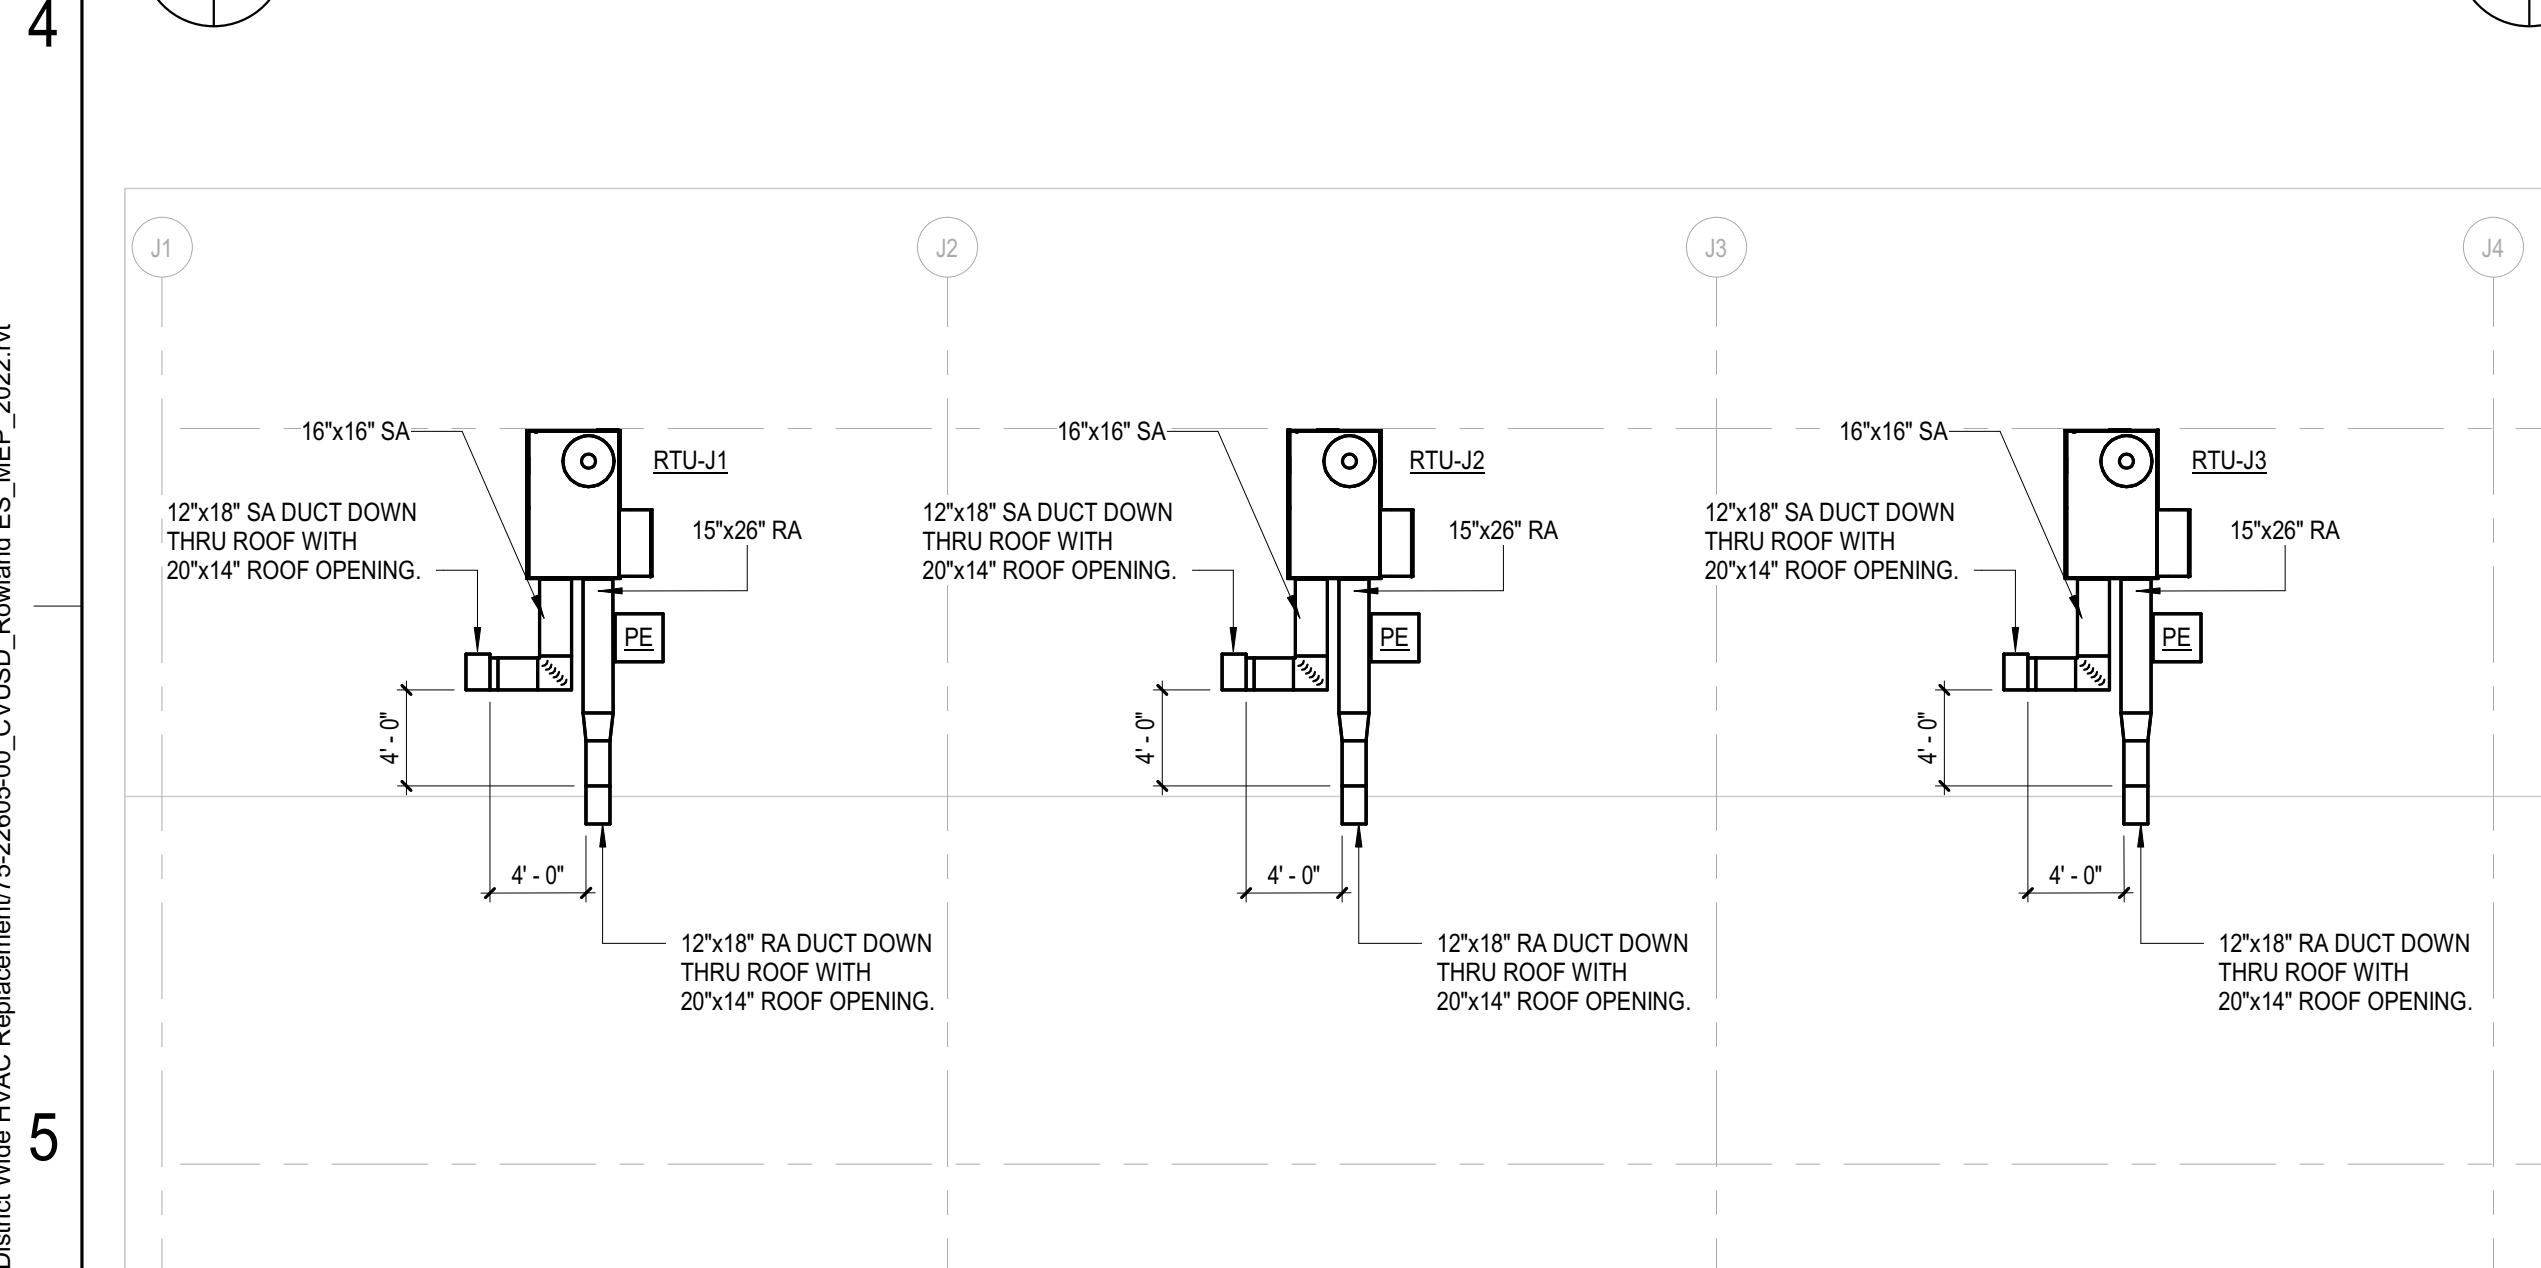


**BUILDING J MECHANICAL ROOF PLAN**  
SCALE: 1/8" = 1'-0"

**GENERAL NOTES**

- SCOPE OF WORK IS CLASSROOMS & MPR ONLY.
- PROVIDE LINER TO DUCTWORK FOR 10 FEET FROM RTU.
- NEW OPENINGS FOR SUPPLY AND RETURN DUCTS SHOULD BE MADE BETWEEN THE ROOF JOISTS. DO NOT CUT THE JOISTS.

**KEY NOTES**

- PROVIDE POWER EXHAUST ON RETURN DUCT WITH LEG LENGTH TO FIT THE ROOF SLOPE. CONTRACTOR TO VERIFY ON SITE. TYP.
- RTU TO BE 10'-0" MIN. FROM ROOF EDGE. CONTRACTOR TO VERIFY ON SITE. TYP.
- RTU IS LESS THAN 10'-0" FROM ROOF EDGE. ARCH TO PROVIDE PROTECTION GUARDS. TYP.

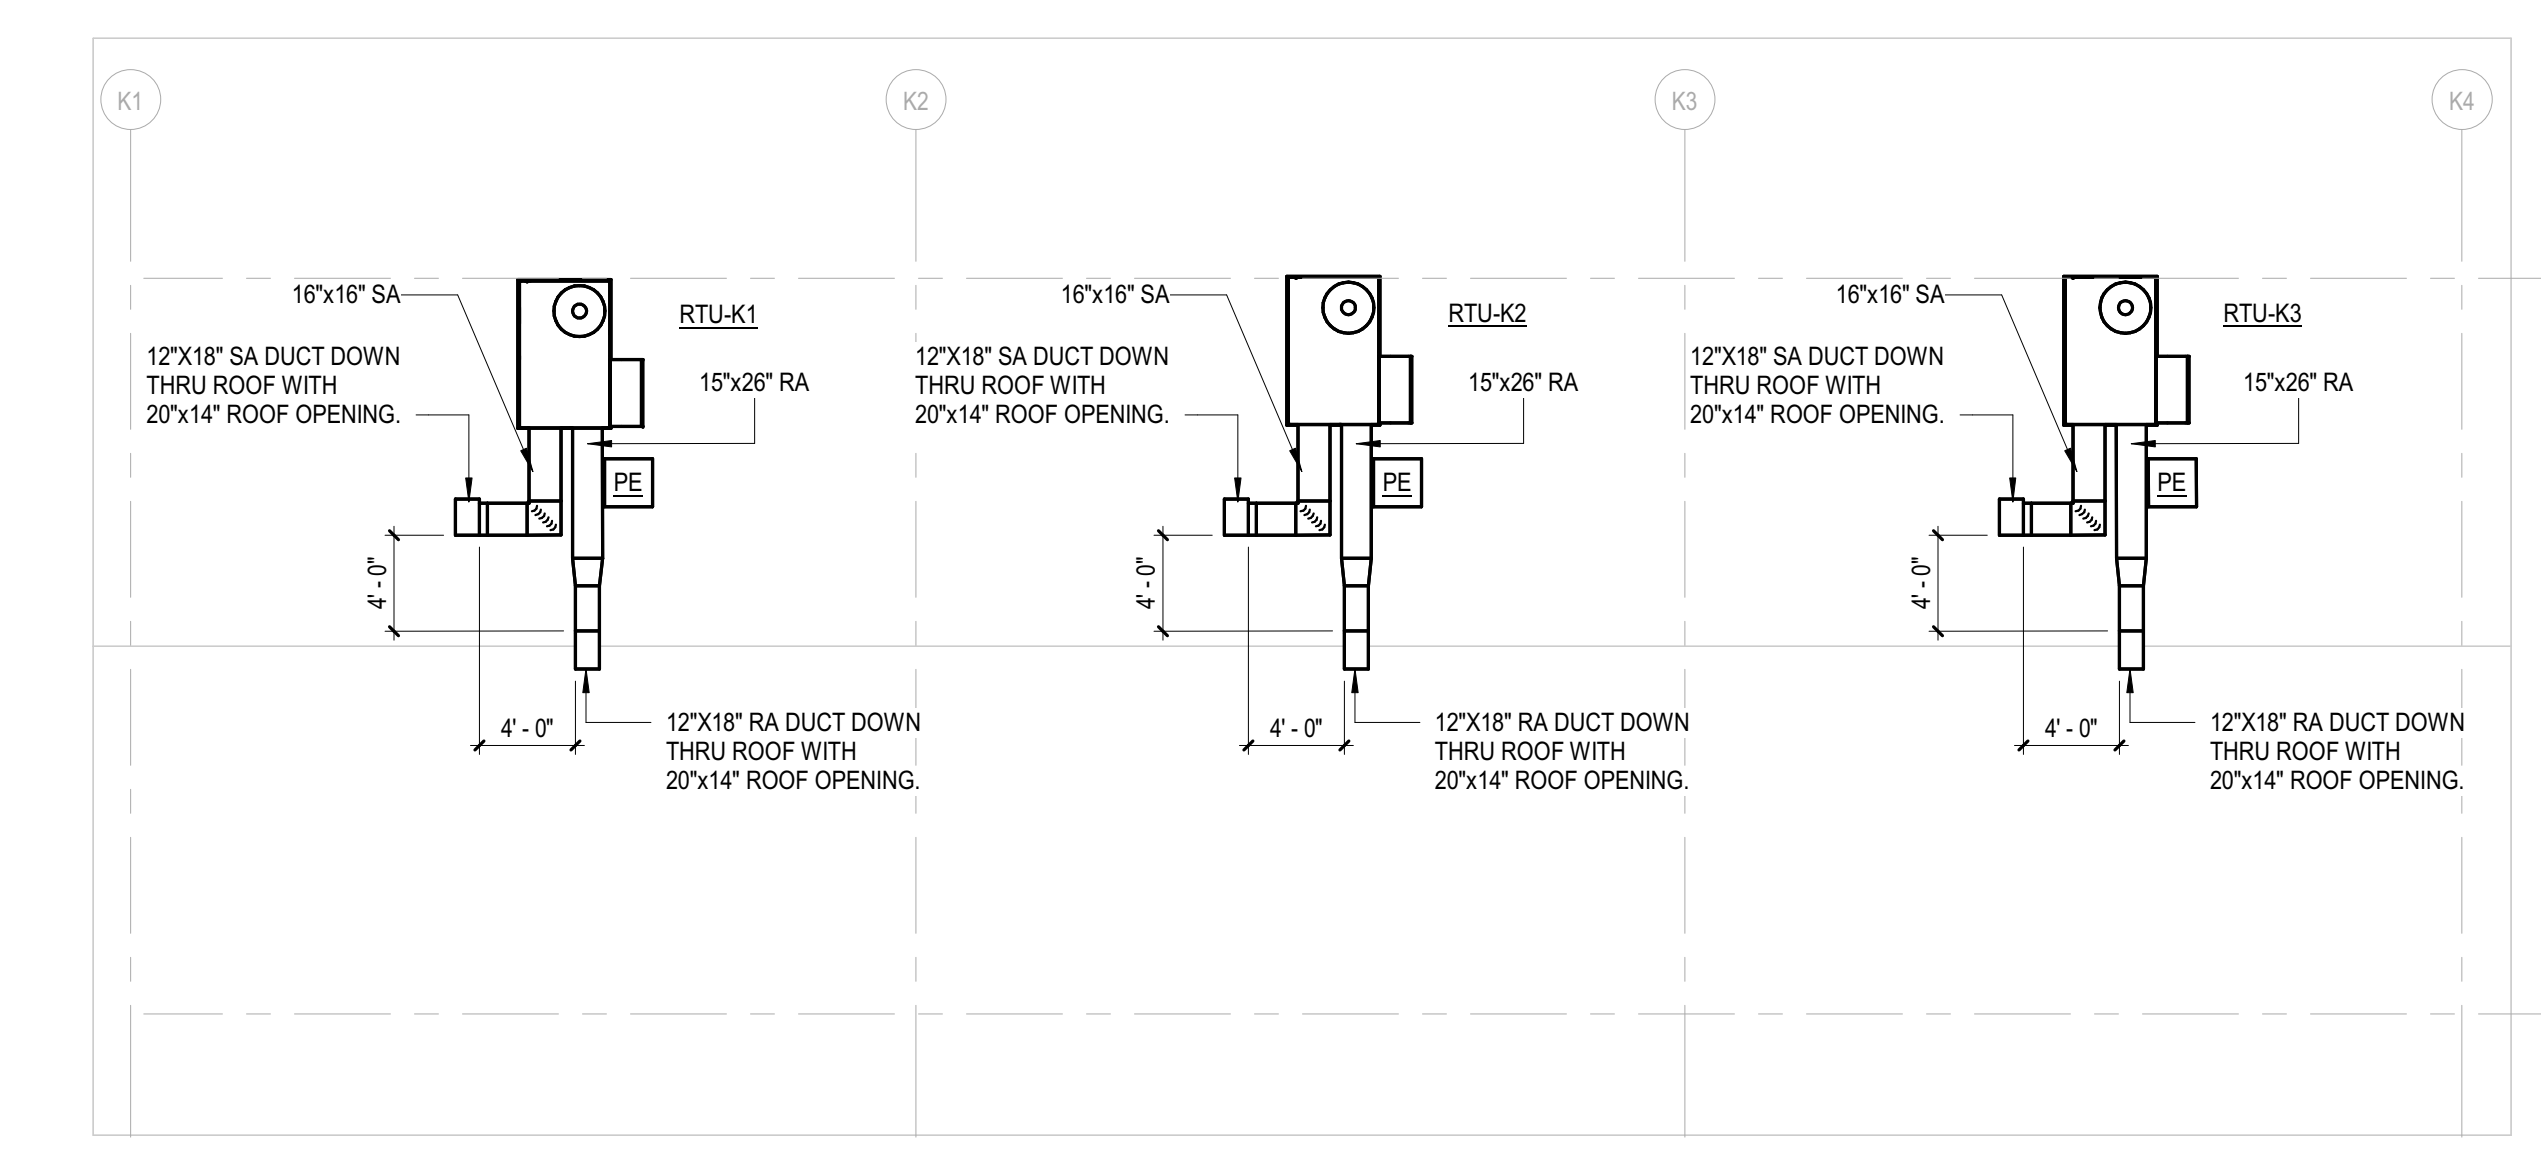

**BUILDING K MECHANICAL ROOF PLAN**  
SCALE: 1/8" = 1'-0"



1  
2  
3  
4  
5

A


B

C

D

E

F

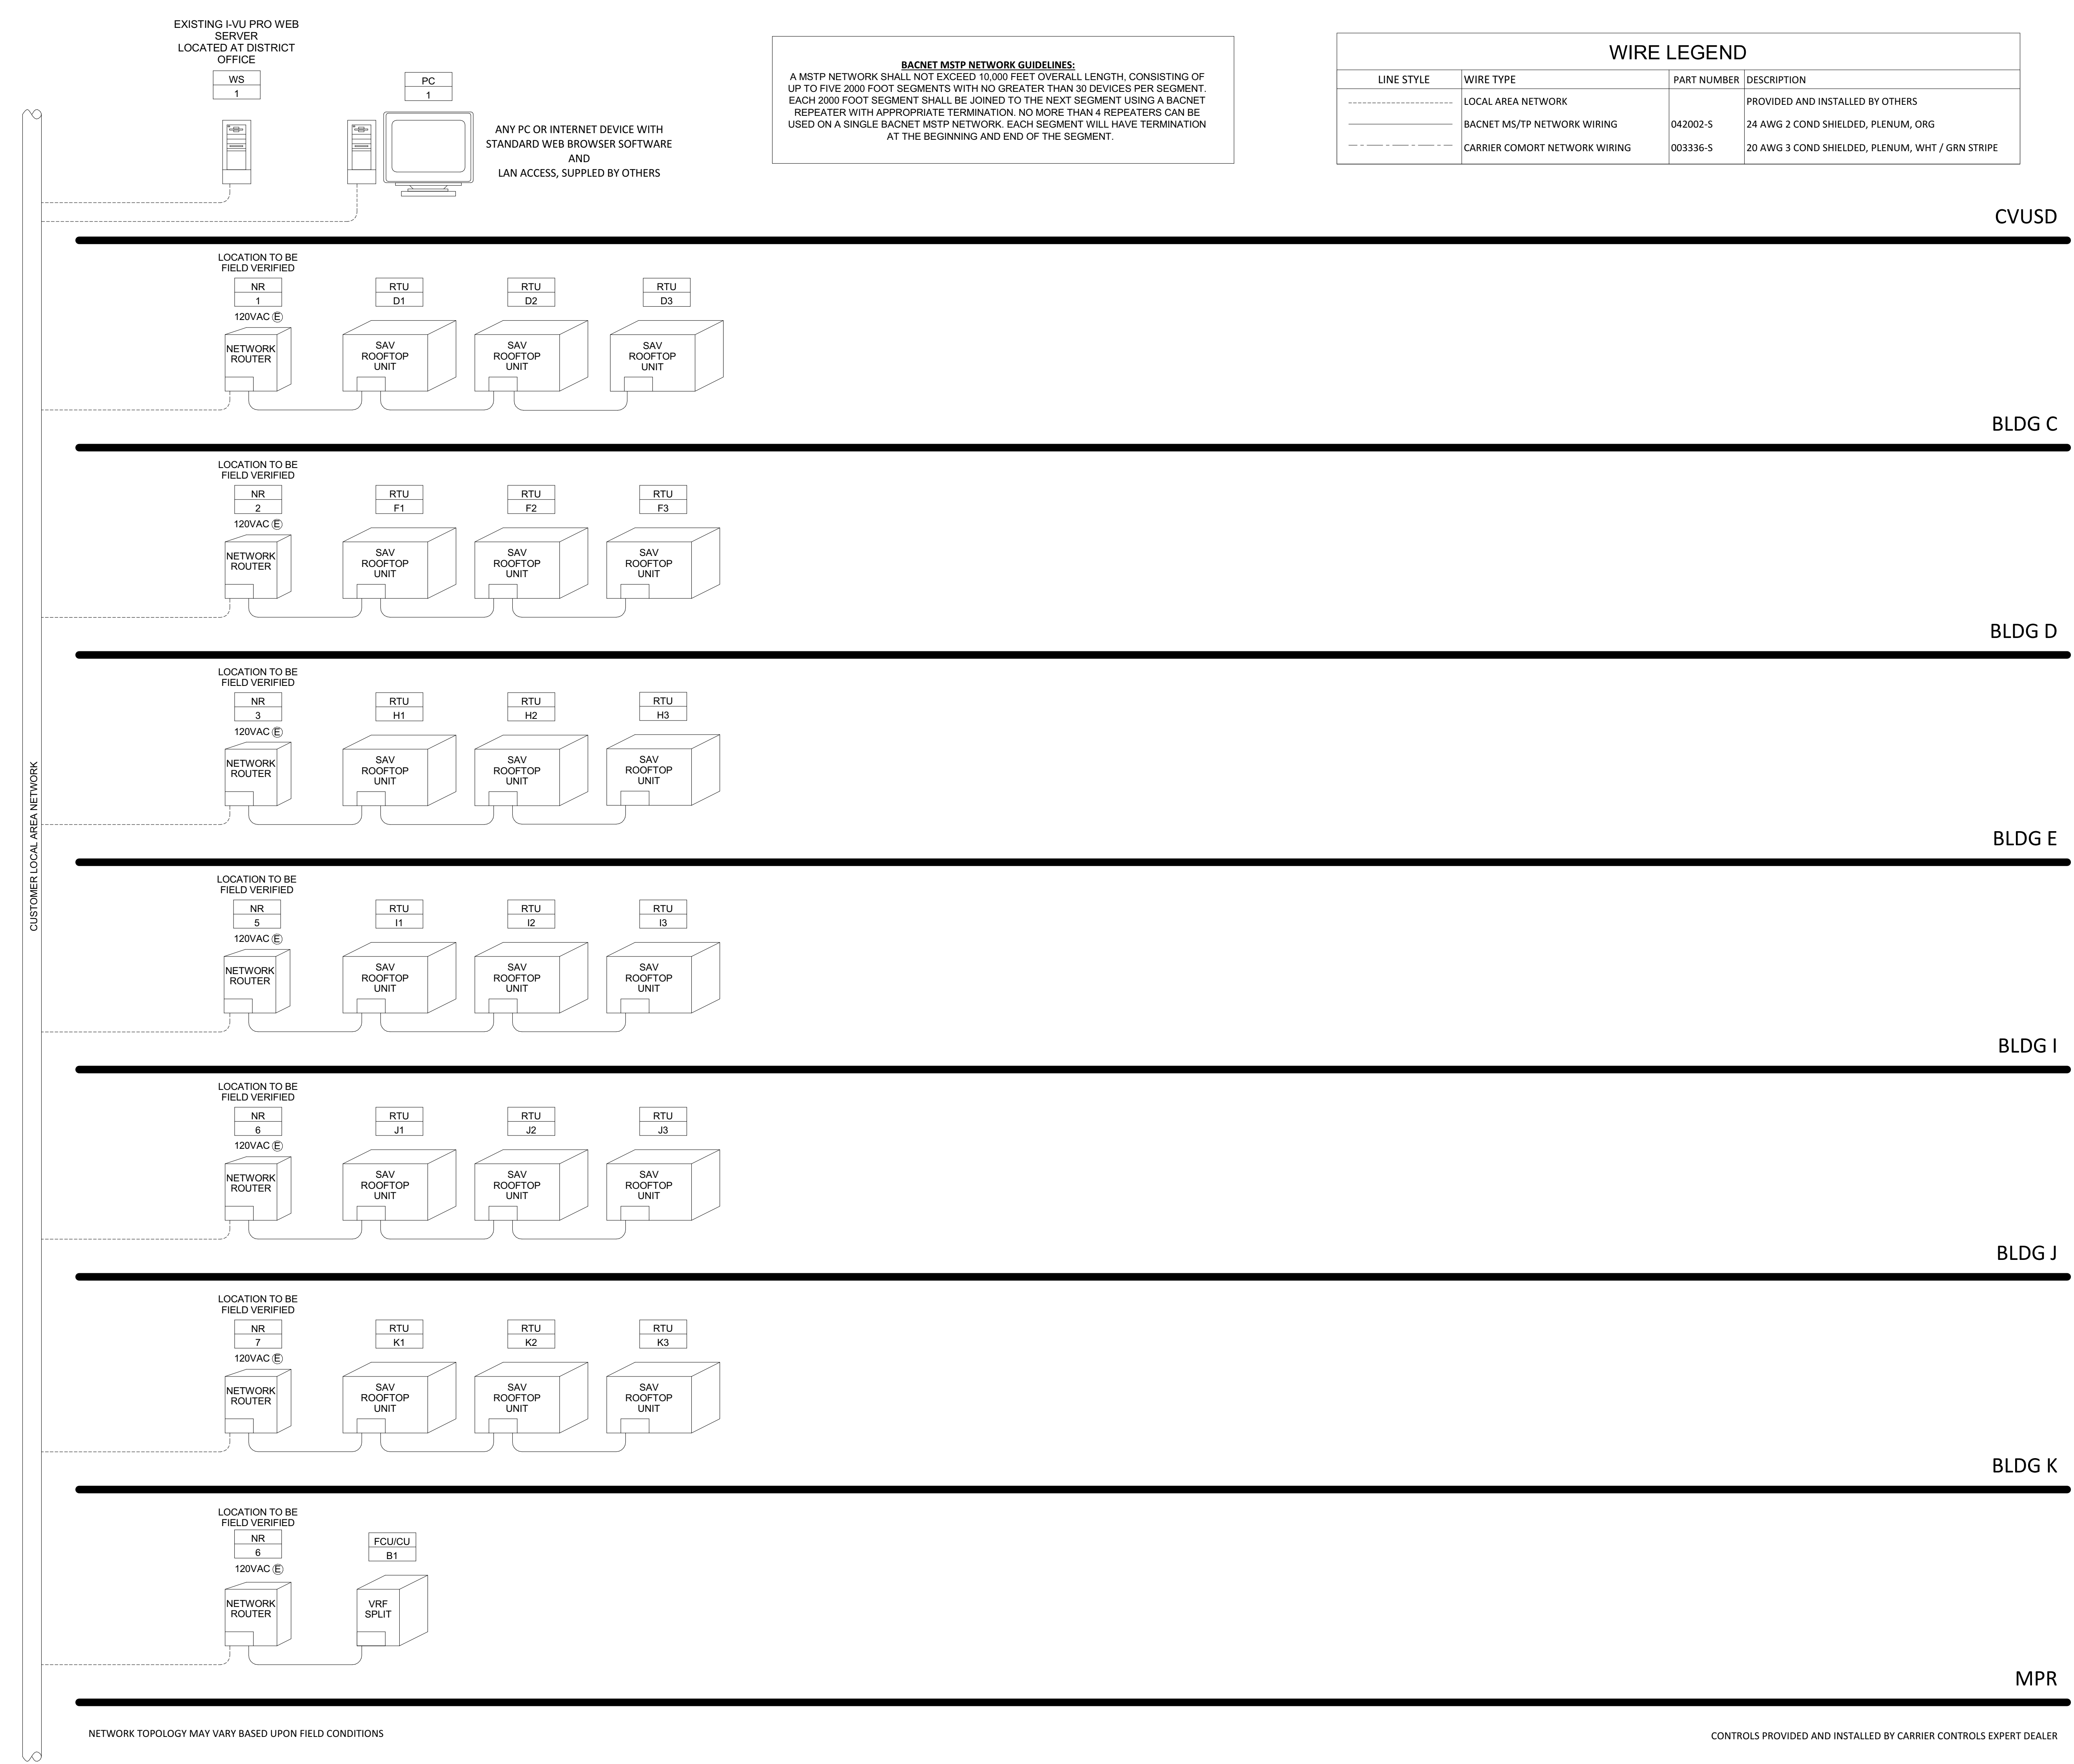

1 BACS RISER DIAGRAM  
M5.1 NO SCALE



Rowland Elementary School  
COVINA VALLEY USD  
1855 E ROWLAND AVE, WEST COVINA, CA 91790

100% CONSTRUCTION DOCUMENTS  
11/08/2022 REVISIONS

75-22605-00

CONTROLS DIAGRAMS

M5.1




1

2

3

4

5

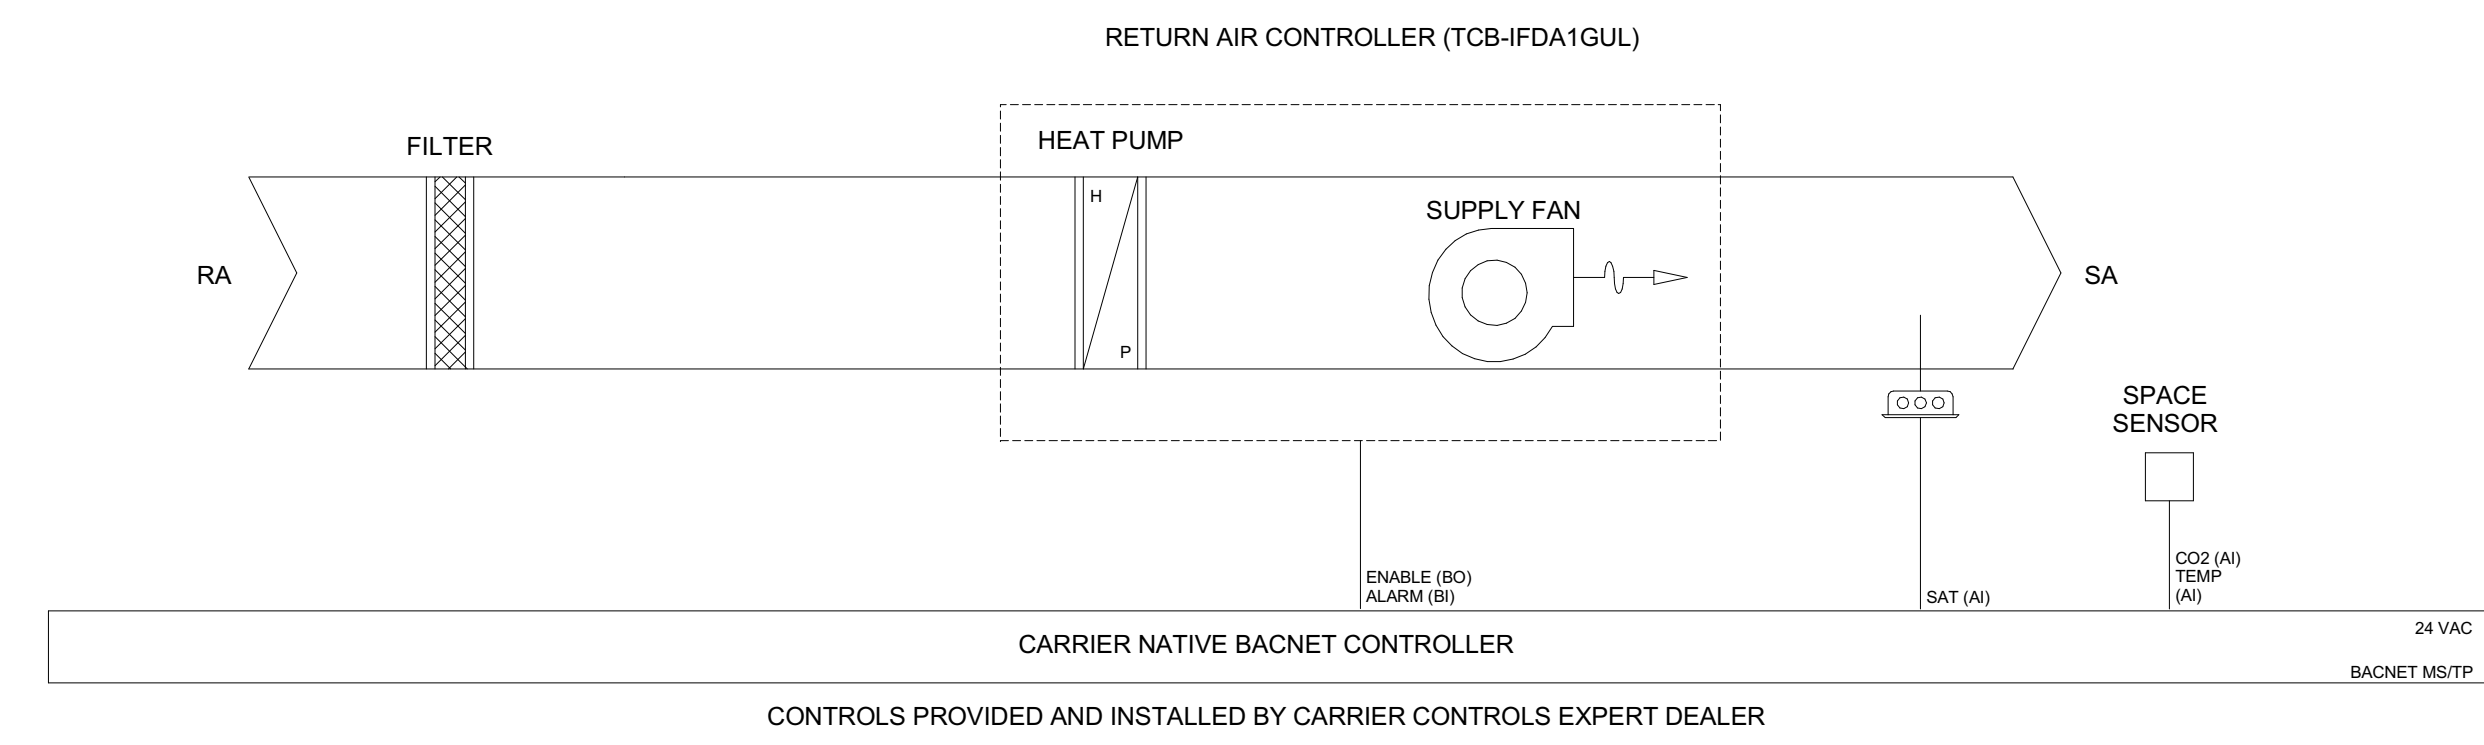

SPLIT SYSTEM DETAIL (FCU/CU-B1)

SCALE	1
NONE	

**SEQUENCE OF OPERATION FOR CVUSD ROWLAND ES**

**HEAT PUMP RTU CONTROLLER (RTU-C1 THRU C-3, RTU-D1 THRU D-3, RTU-E1 THRU E-3, RTU-H1 THRU I3, RTU-J1 THRU J3, RTU-K1 THRU K3, RTU-G1 AND G2)**


**Indoor Fan**  
The fan operates at a variable speed to meet the load conditions and SAT safety requirements to provide maximum energy savings by minimizing fan horsepower consumption. Fan speed is NOT controlled by static pressure.

**Heating Mode**  
When space temperature is below the occupied heating setpoint, unit shall operate in the heating mode. Unit shall stage available heat stages to satisfy demand in the occupied space.

**Cooling Mode**  
When space temperature is above occupied cooling setpoint, unit shall operate in the cooling mode. Unit shall enable available cooling stages to satisfy demand in the occupied space.

**CO2 Control**  
Unit shall monitor space CO2 when the supply fan is energized. When CO2 is above setpoint of 1000 PPM, an alarm shall be enabled through the EMS.

**Power Exhaust**  
The exhaust fan shall run when the unit is occupied

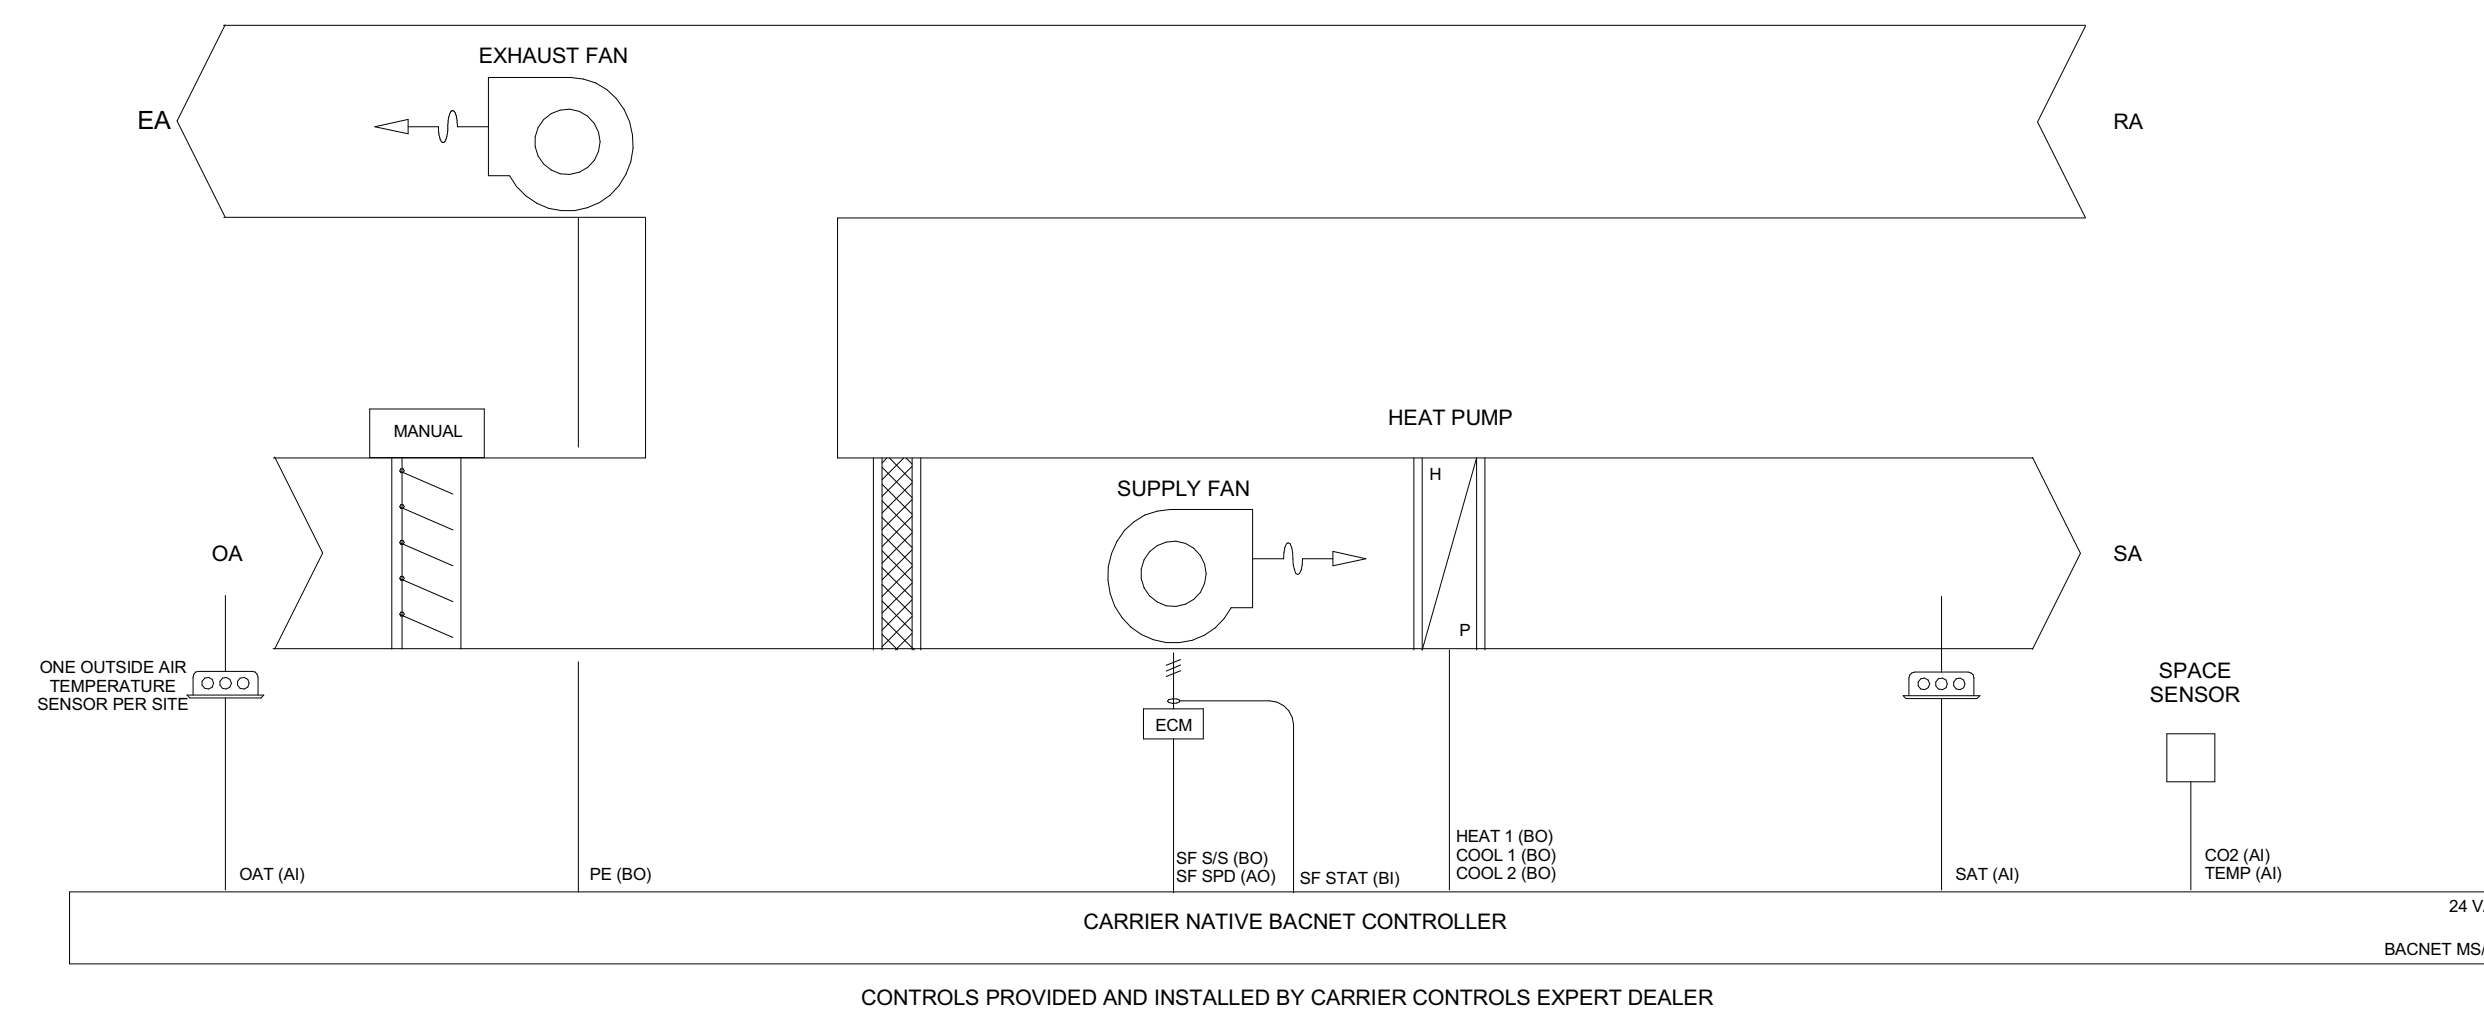


50FCQ HEAT PUMP RTU DETAIL (RTU-D1 THRU D-3, RTU-F1 THRU F3, RTU-I1 THRU I3, RTU-J1 THRU J3, RTU-K1 THRU K3, RTU-H1 AND H3)


SCALE	2
NONE	

1  
M5.2 / NO SCALE



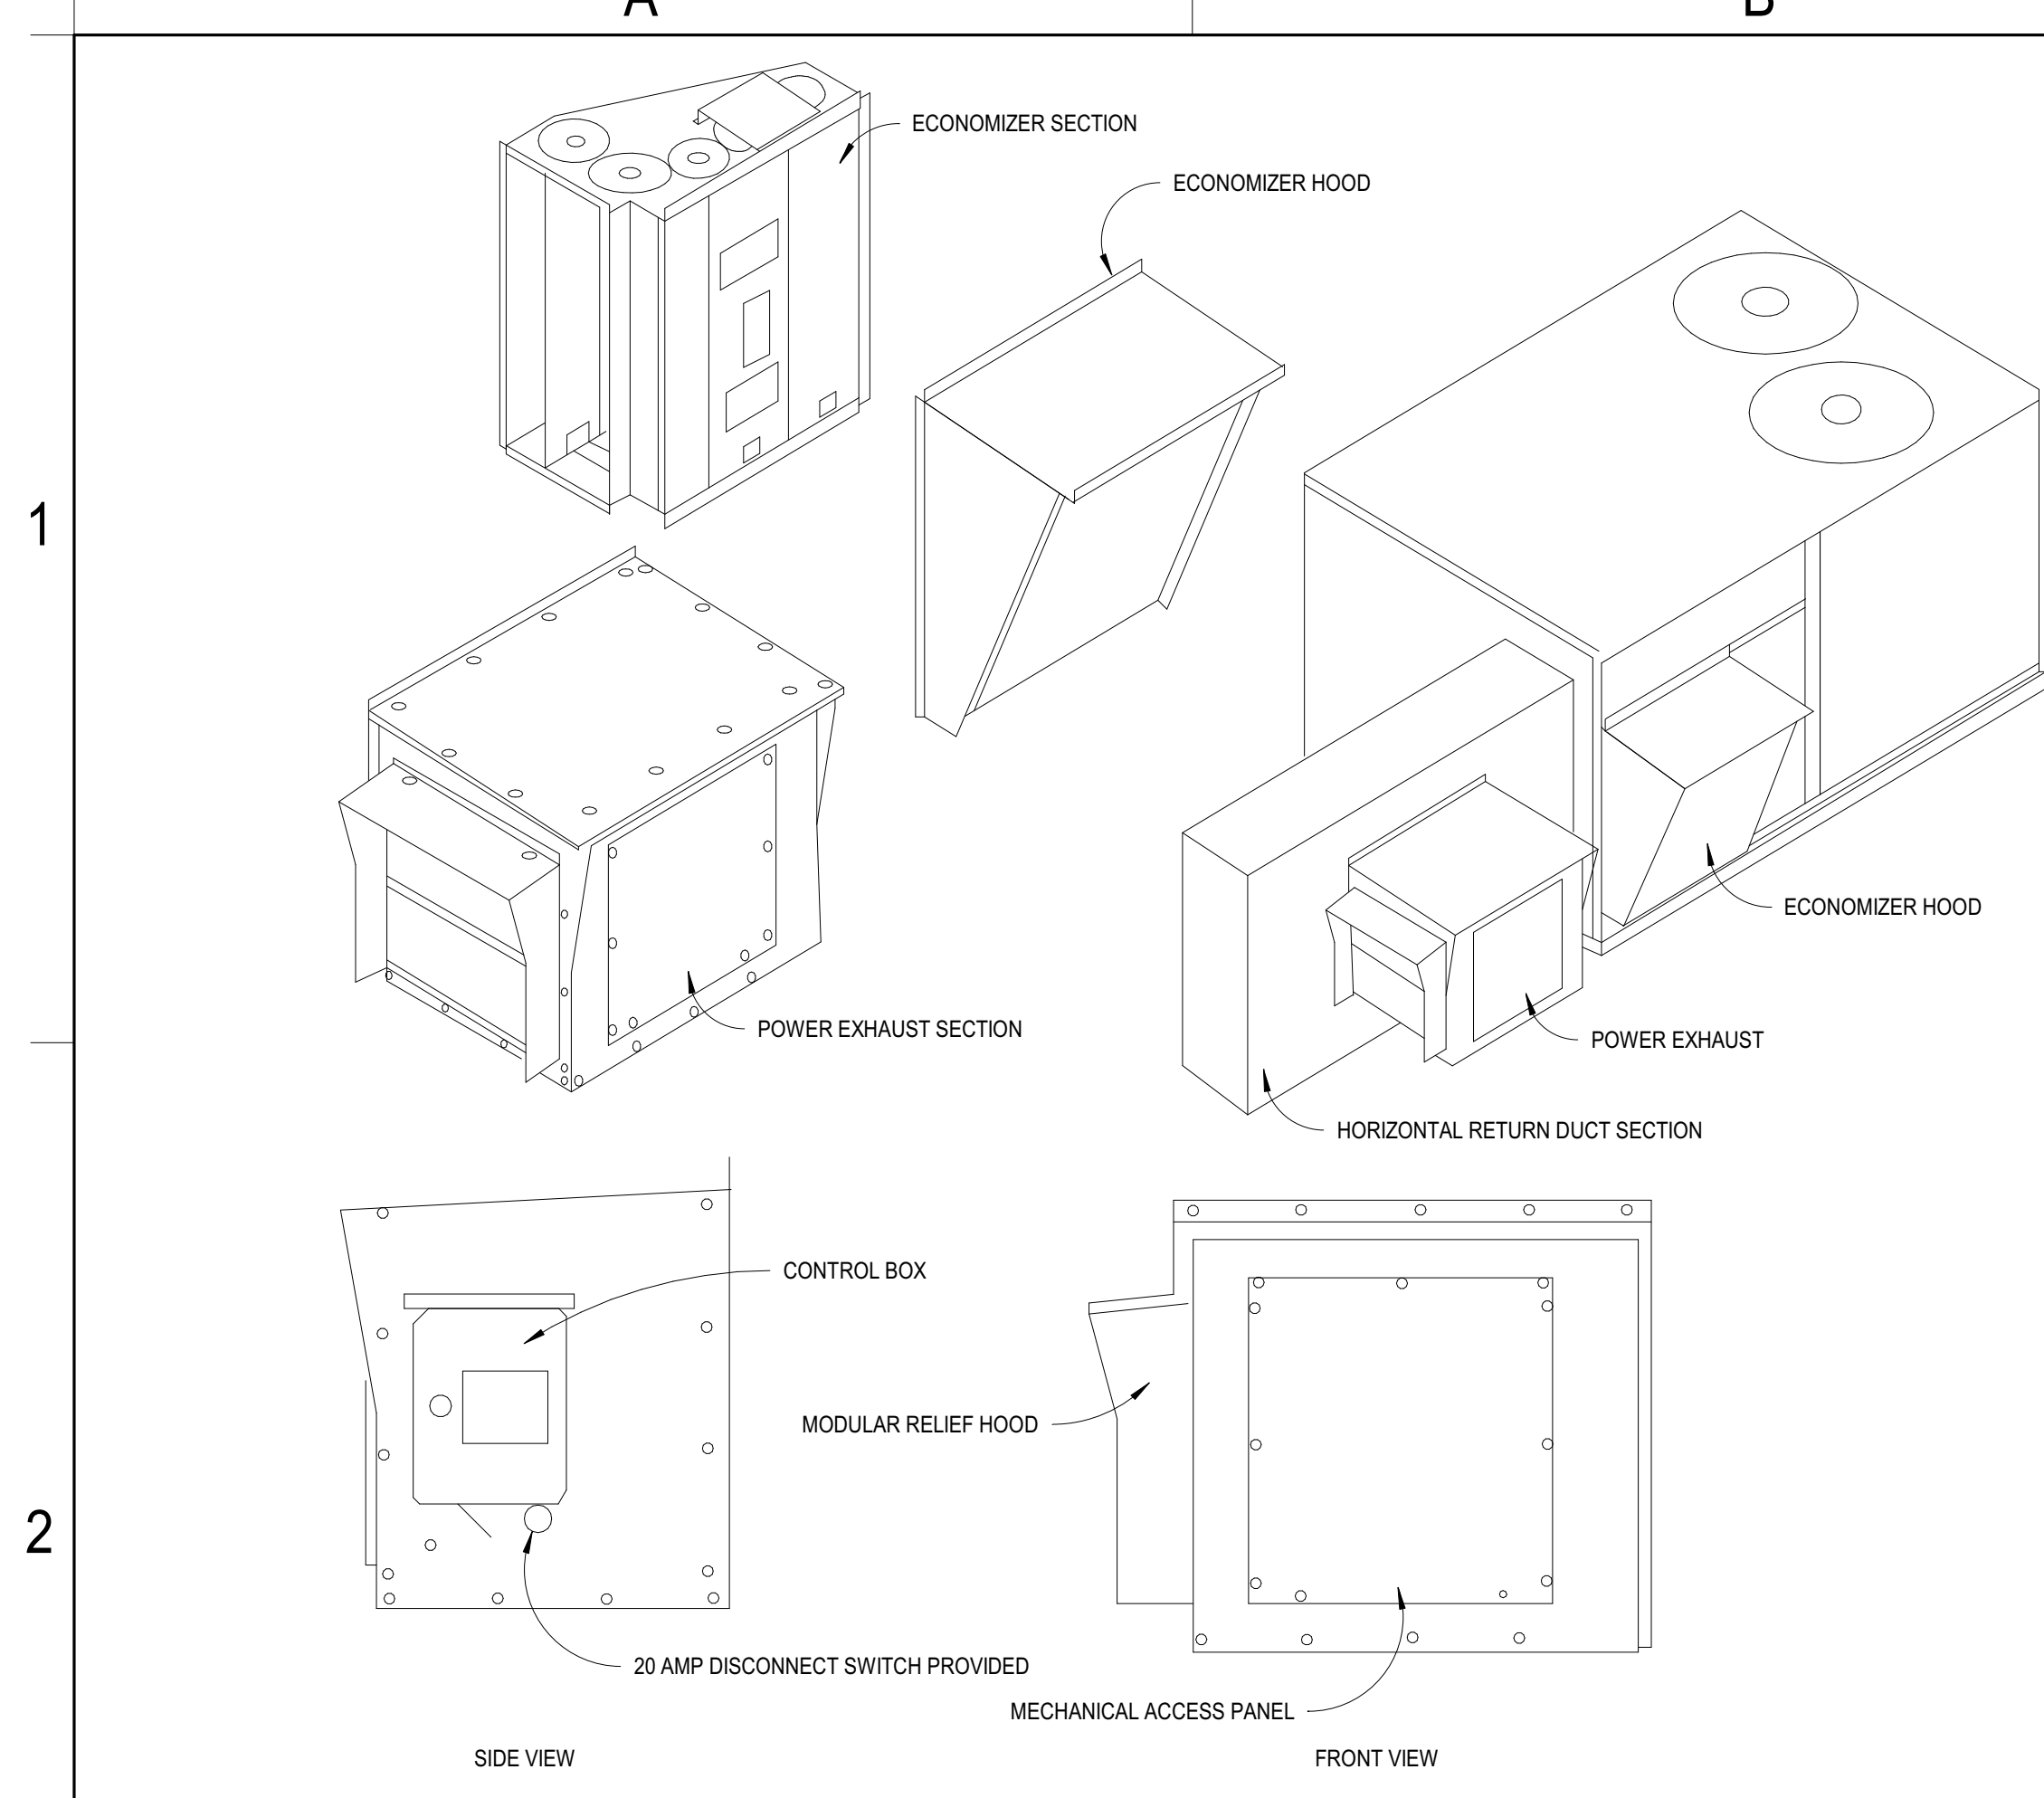


**1** ECONOMIZER AND POWER EXHAUST DETAIL - HORIZONTAL DISCHARGE RTU (LESS THAN 15 TONS)  
M7.1 NO SCALE

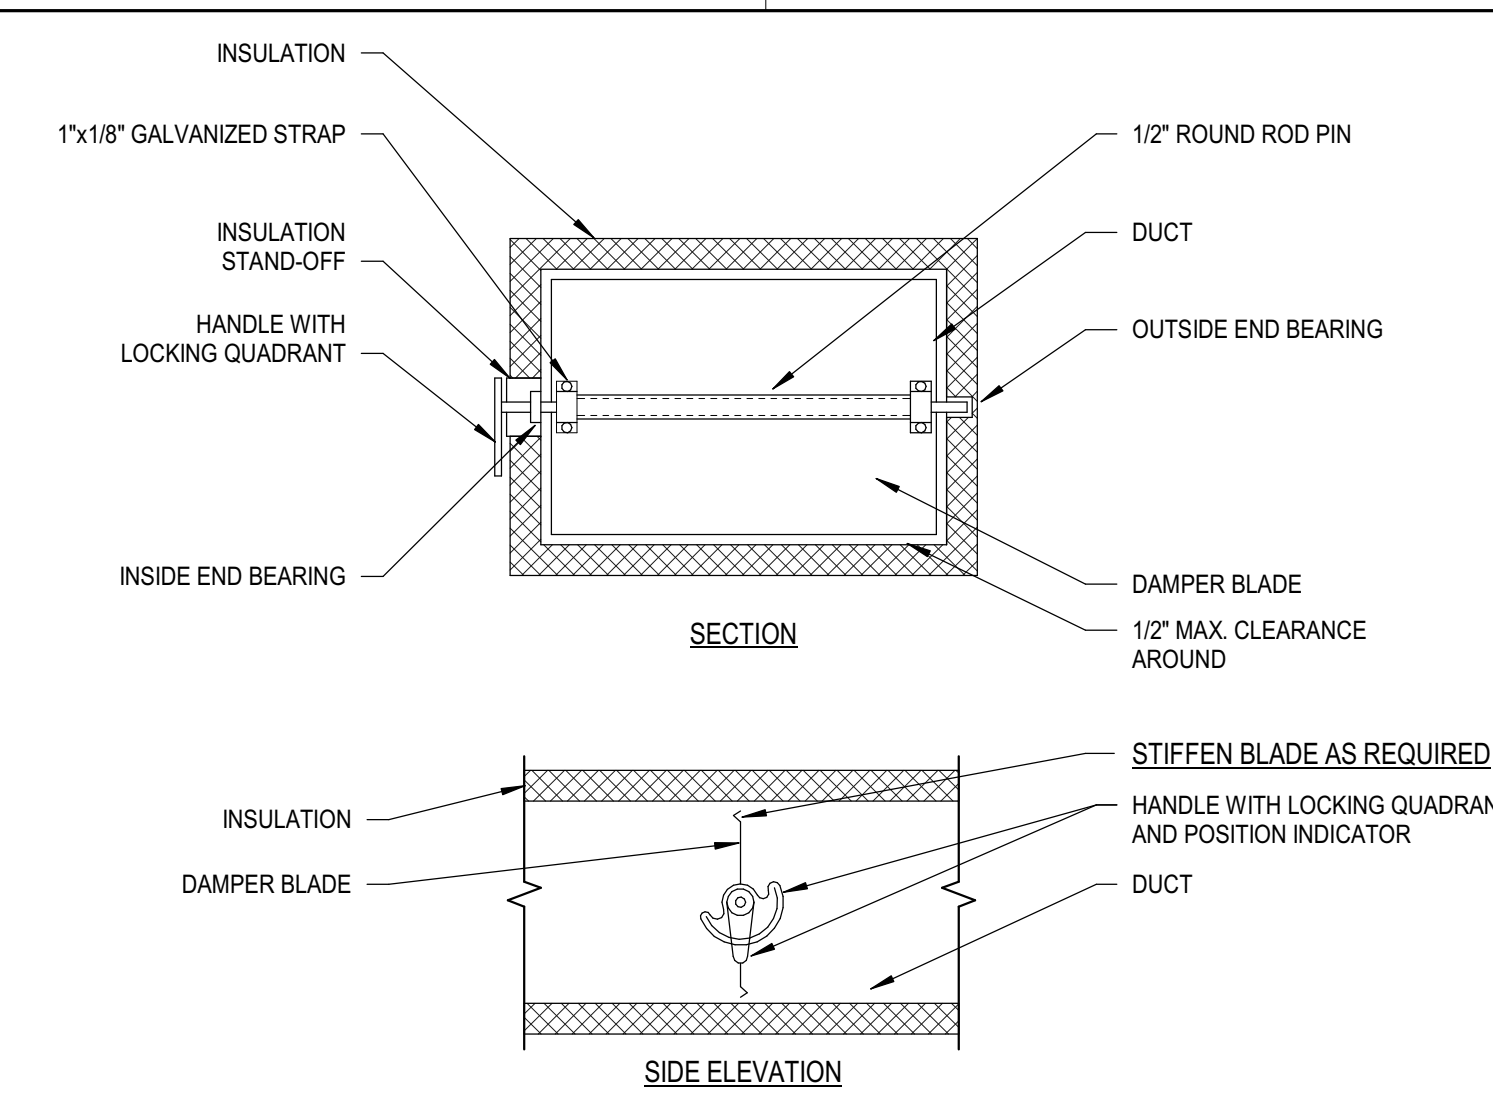


1. DELETE INSULATION STAND-OFF ON DUCTWORK WITHOUT EXTERIOR INSULATION.
2. DETAIL SHOWS SINGLE BLADE DAMPER. MULTI-BLADE DAMPERS INSTALLATIONS SHALL BE SIMILAR.
3. LOCK DAMPER DURING AIR BALANCE AND MARK QUADRANT TO RECORD AIR BALANCED DAMPER POSITION.
4. PROVIDE "HAT" SECTION AT QUADRANT FOR ALL EXTERNALLY INSULATED DUCTWORK.
5. PROVIDE FLUORESCENT COLORED MARKERS ON CEILING AT ALL VOLUME DAMPER LOCATIONS.


**2** RECTANGULAR VOLUME DAMPER DETAIL  
M7.1 NO SCALE

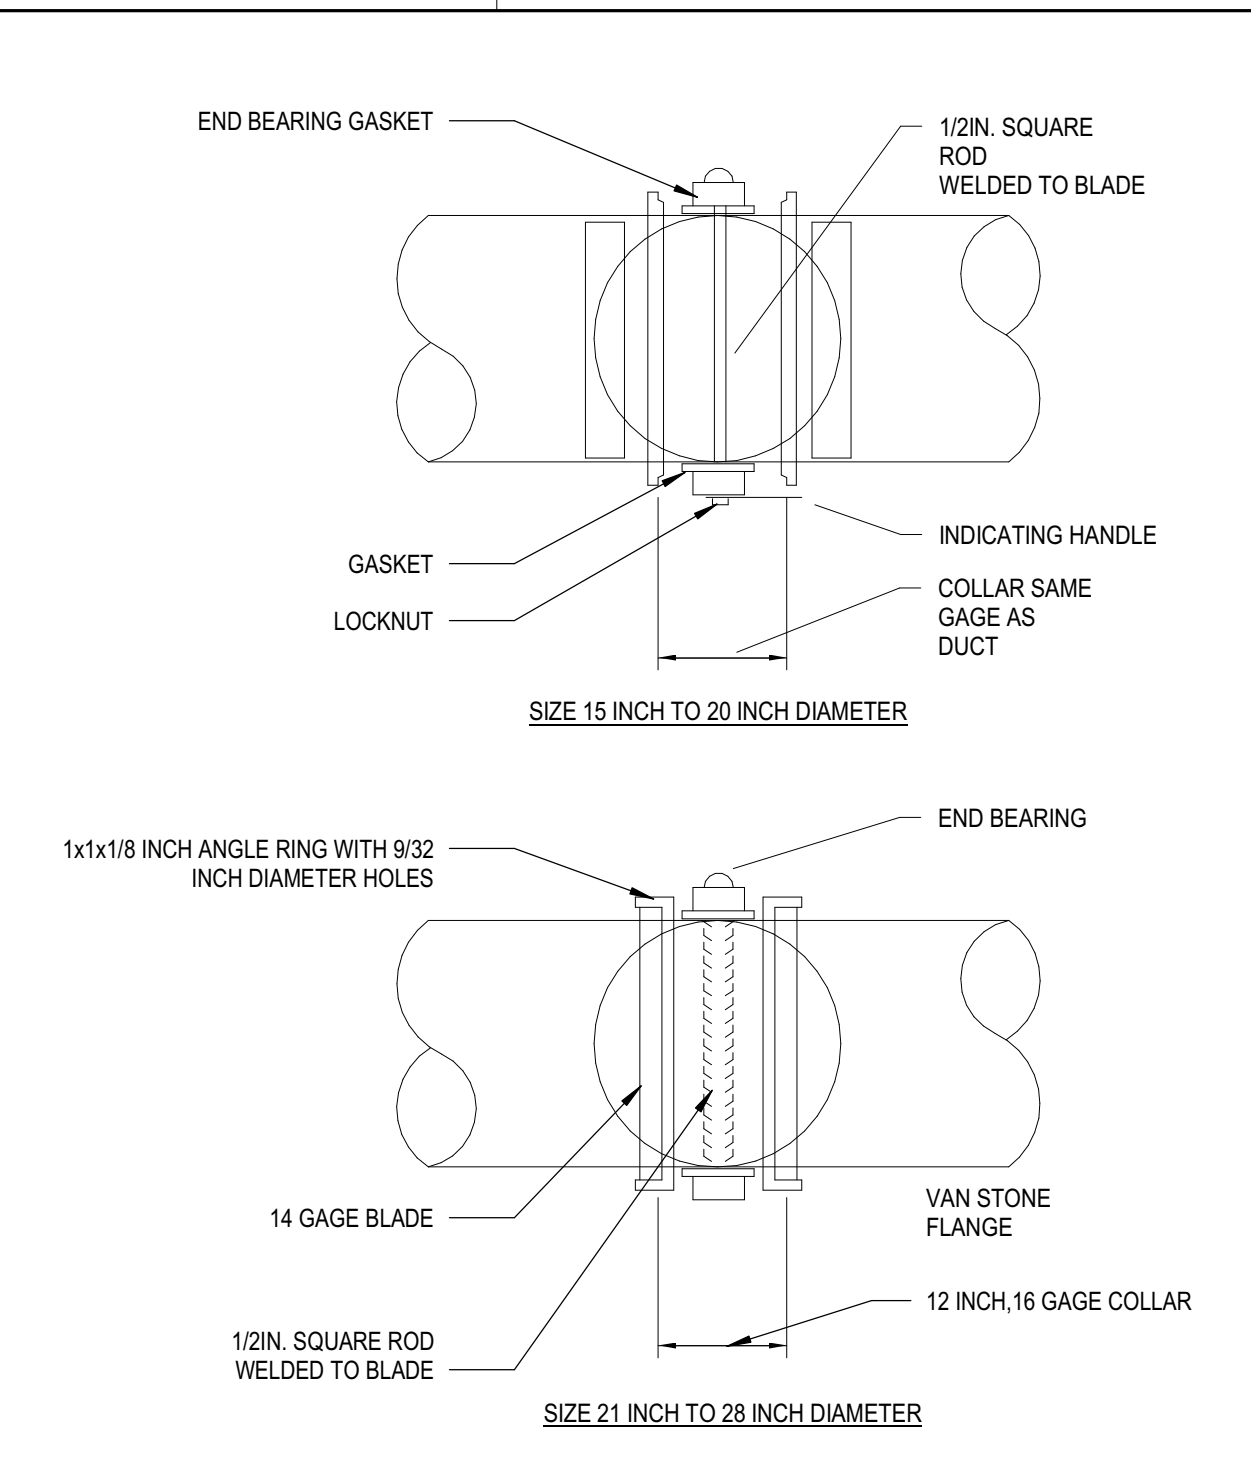


**3** ROUND VOLUME DAMPER (LARGER THAN 14" DIA.)  
M7.1 NO SCALE

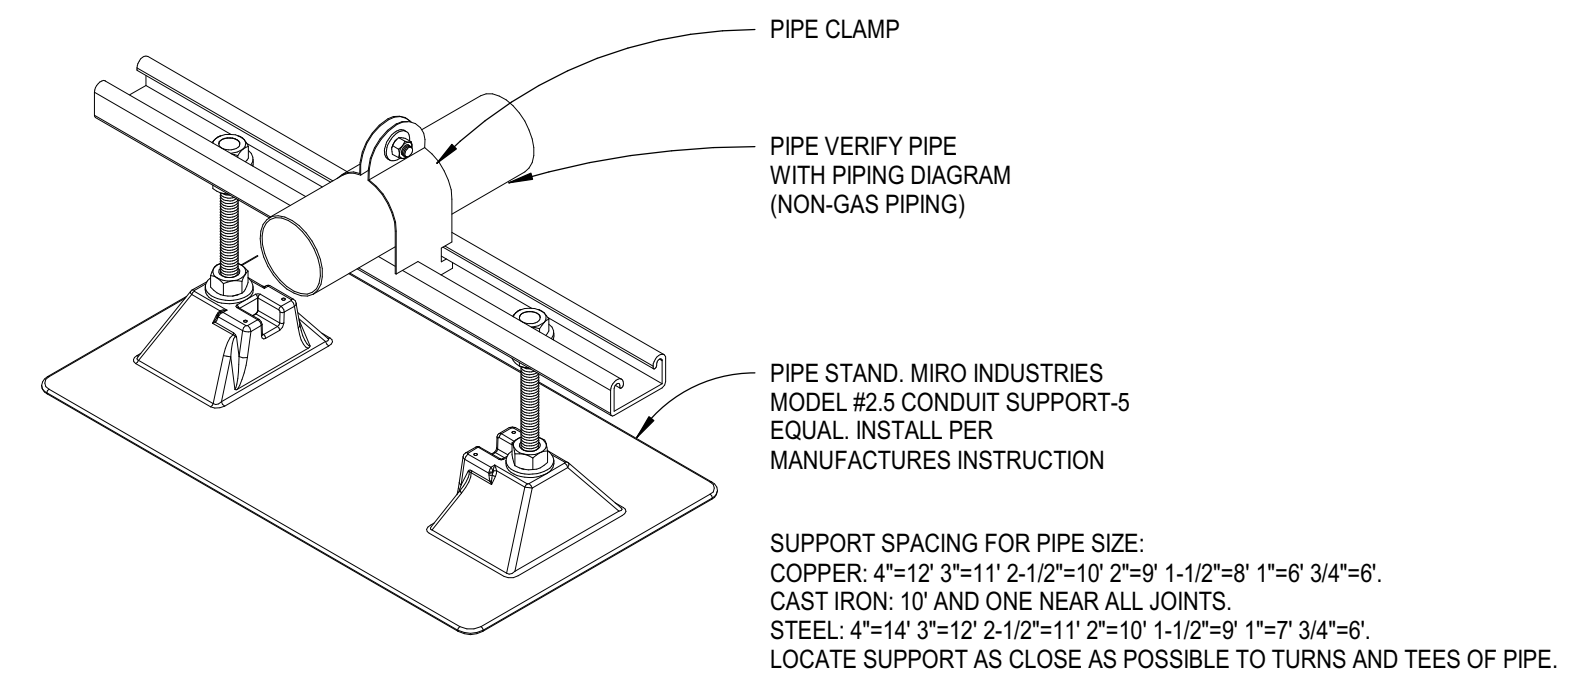


**5** PIPE SUPPORT ON ROOF DETAIL  
M7.1 NO SCALE

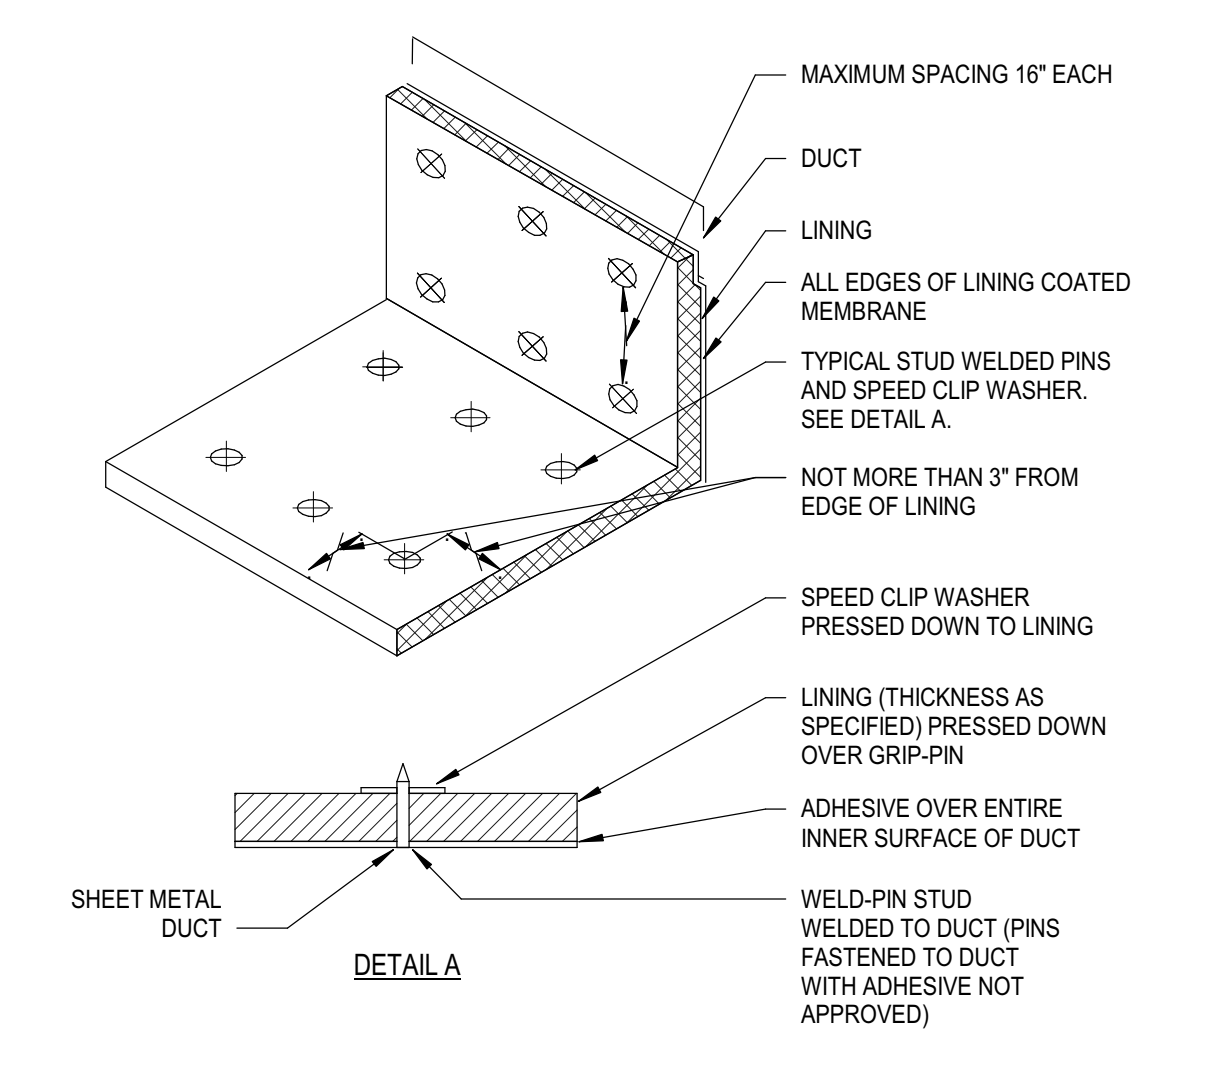


**6** ACOUSTICAL DUCT LINING INSTALLATION DETAIL  
M7.1 NO SCALE

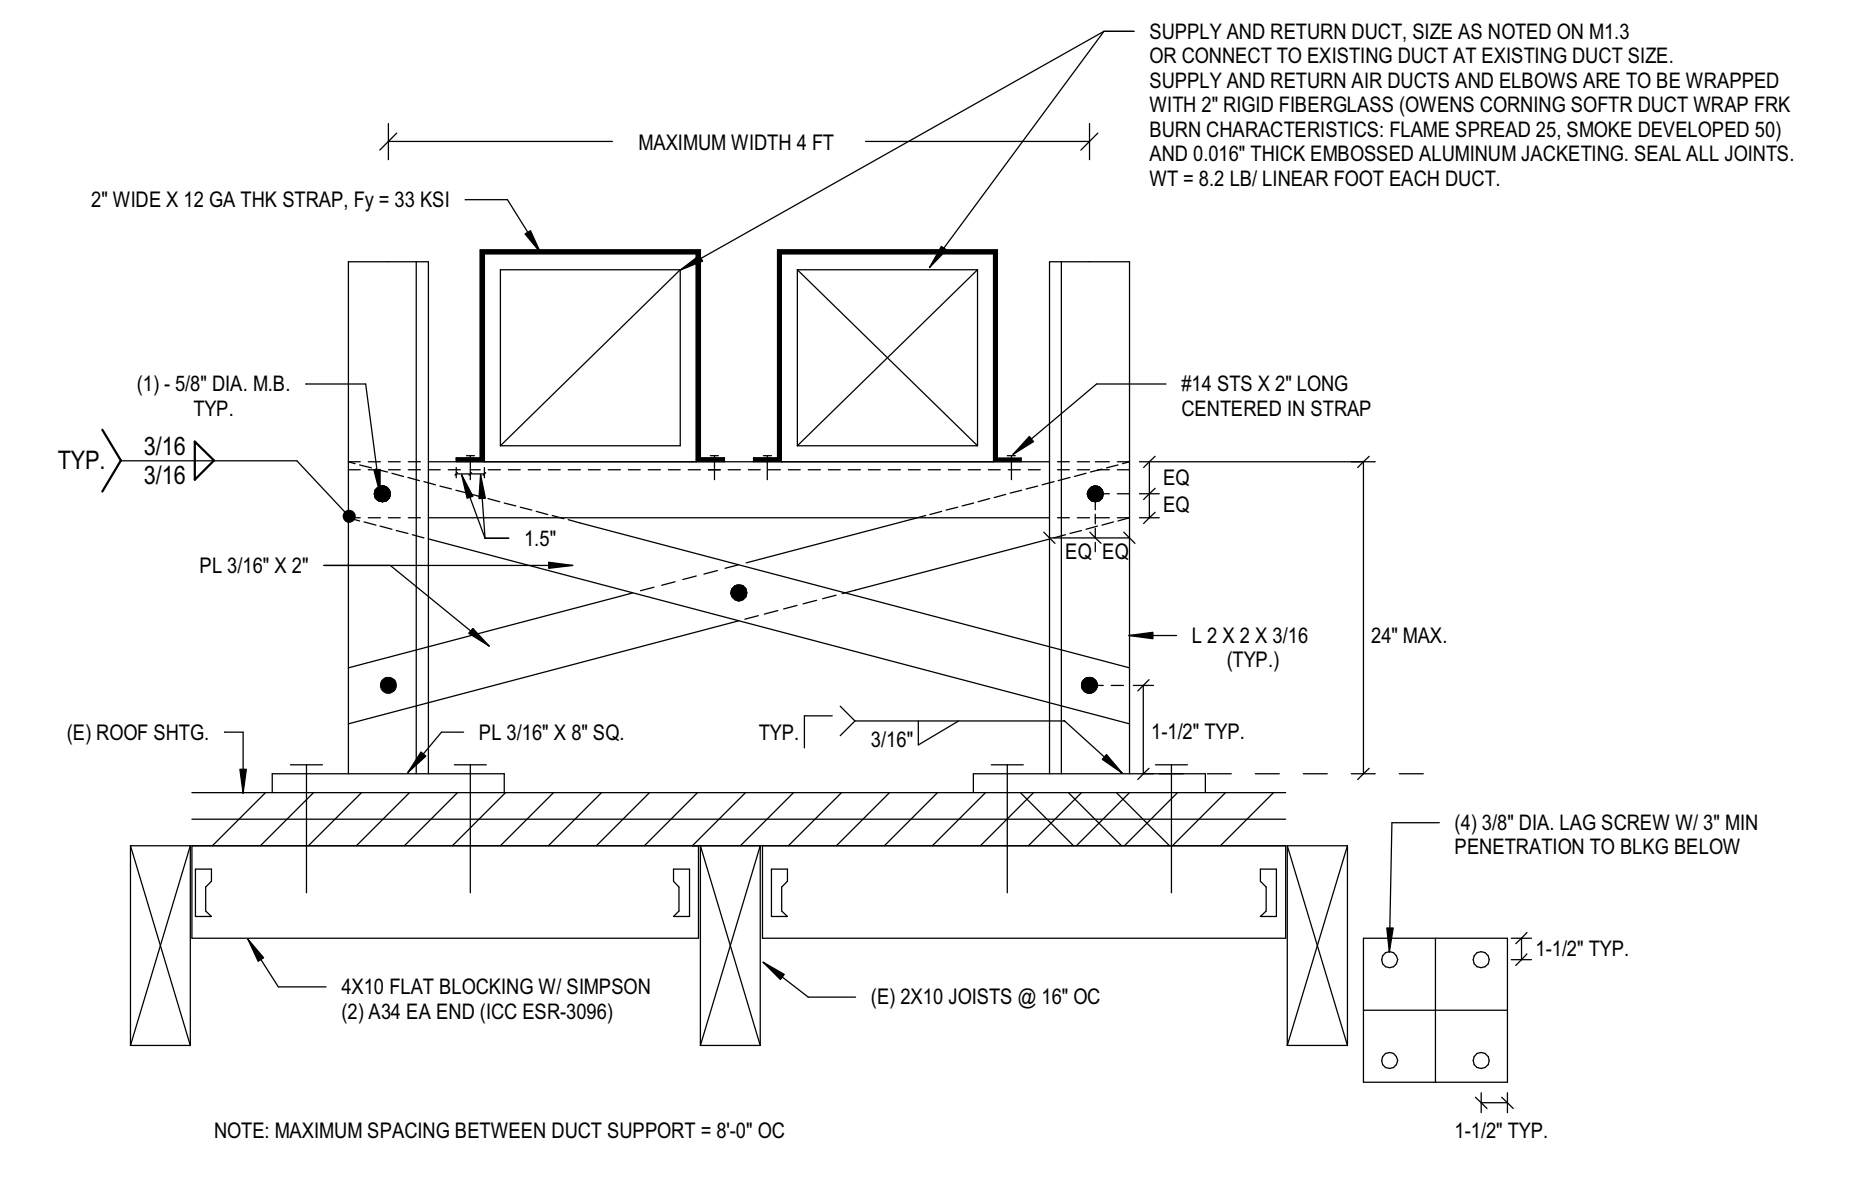


**4** DUCT SUPPORT ON ROOF DETAIL  
M7.1 NO SCALE

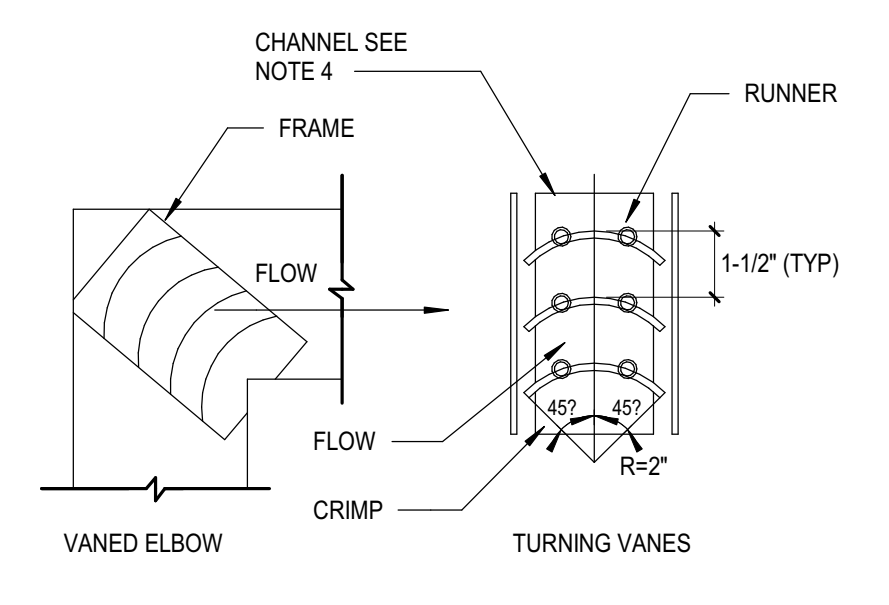


**7** RECTANGULAR ELBOW W/ TURNING VANES DETAIL  
M7.1 NO SCALE

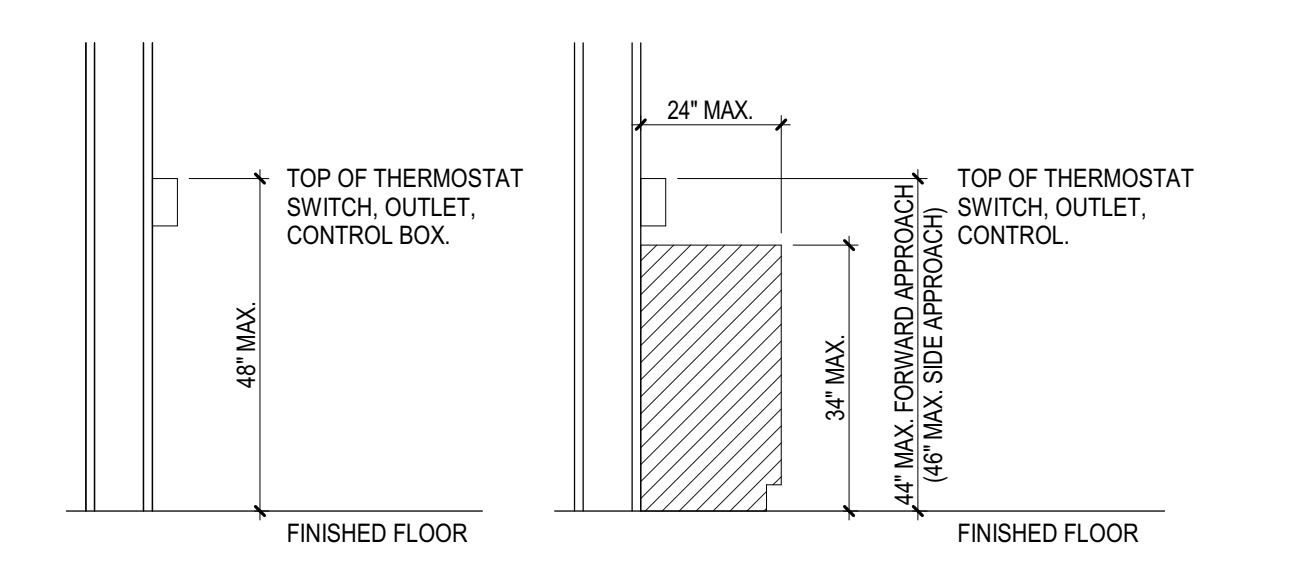


**8** THERMOSTAT MOUNTING  
M7.1 NO SCALE

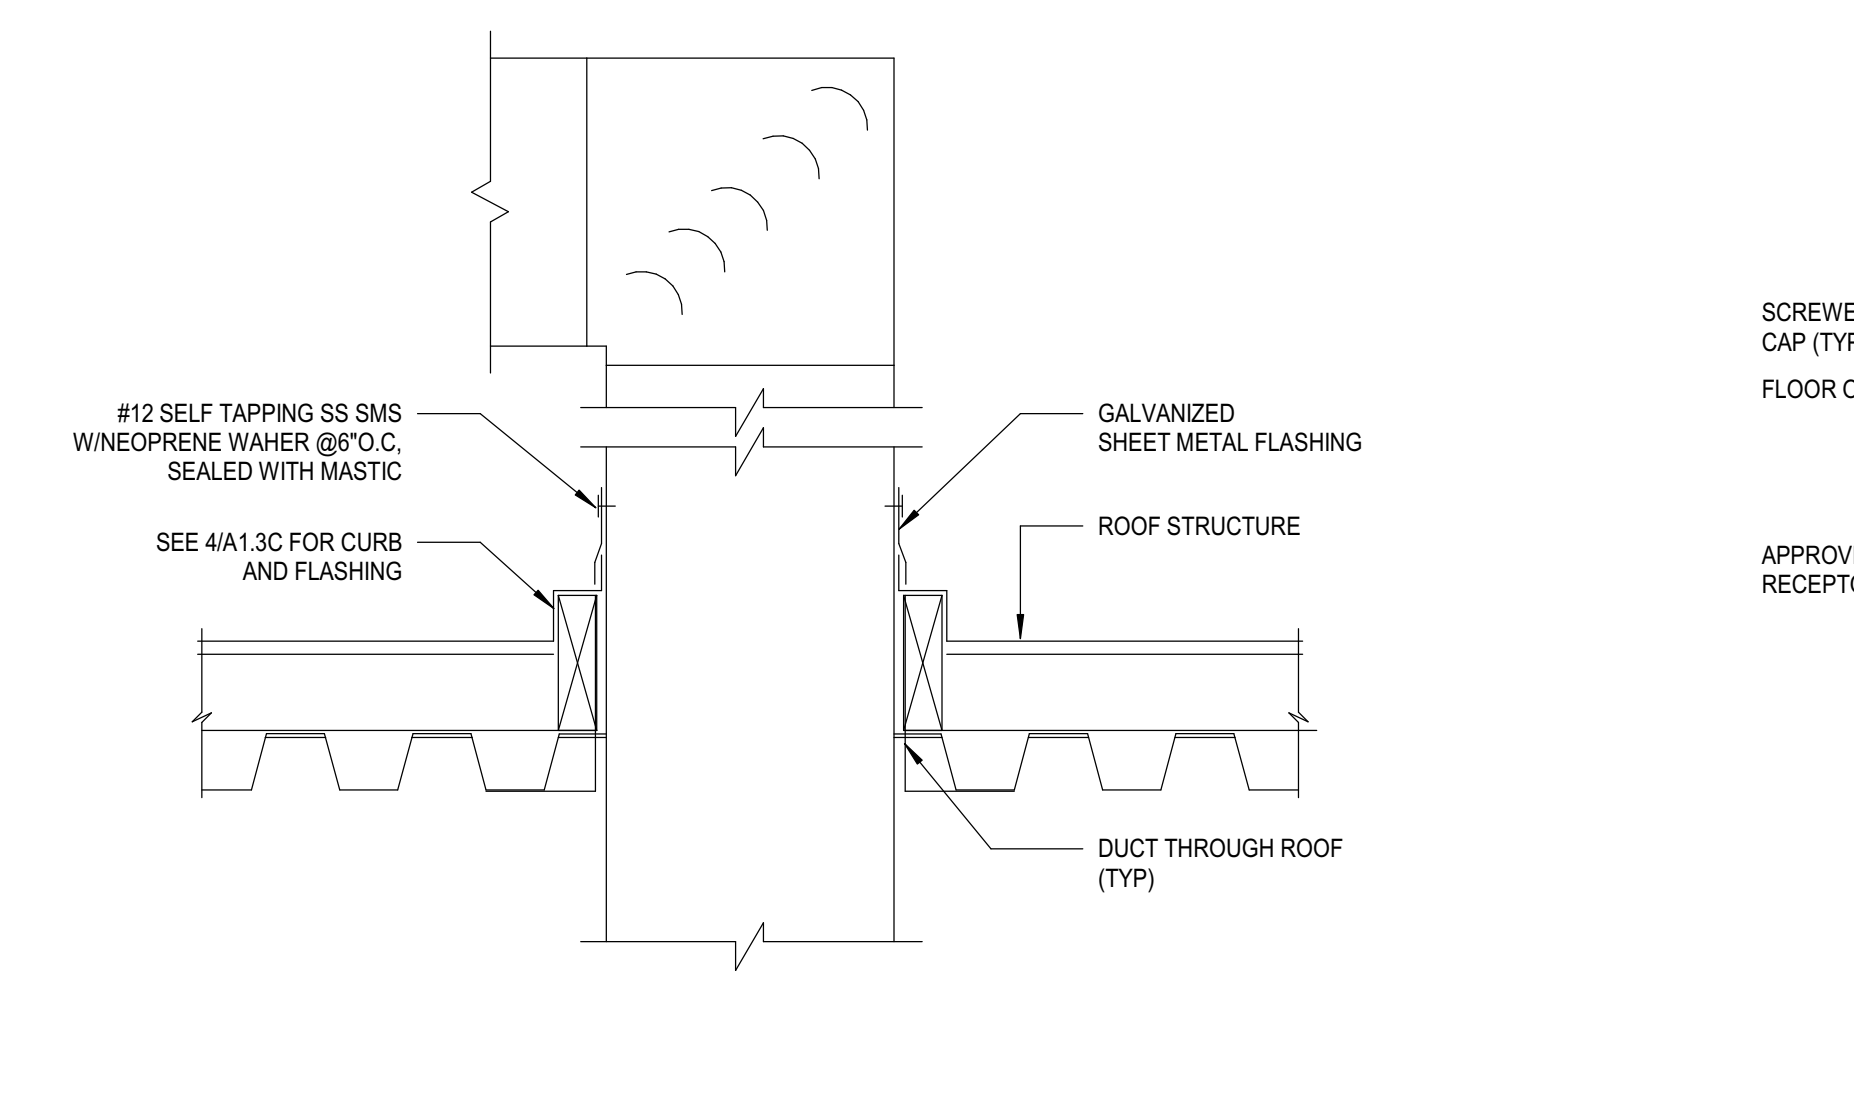


**9** DUCT THRU ROOF PENETRATION  
M7.1 NO SCALE

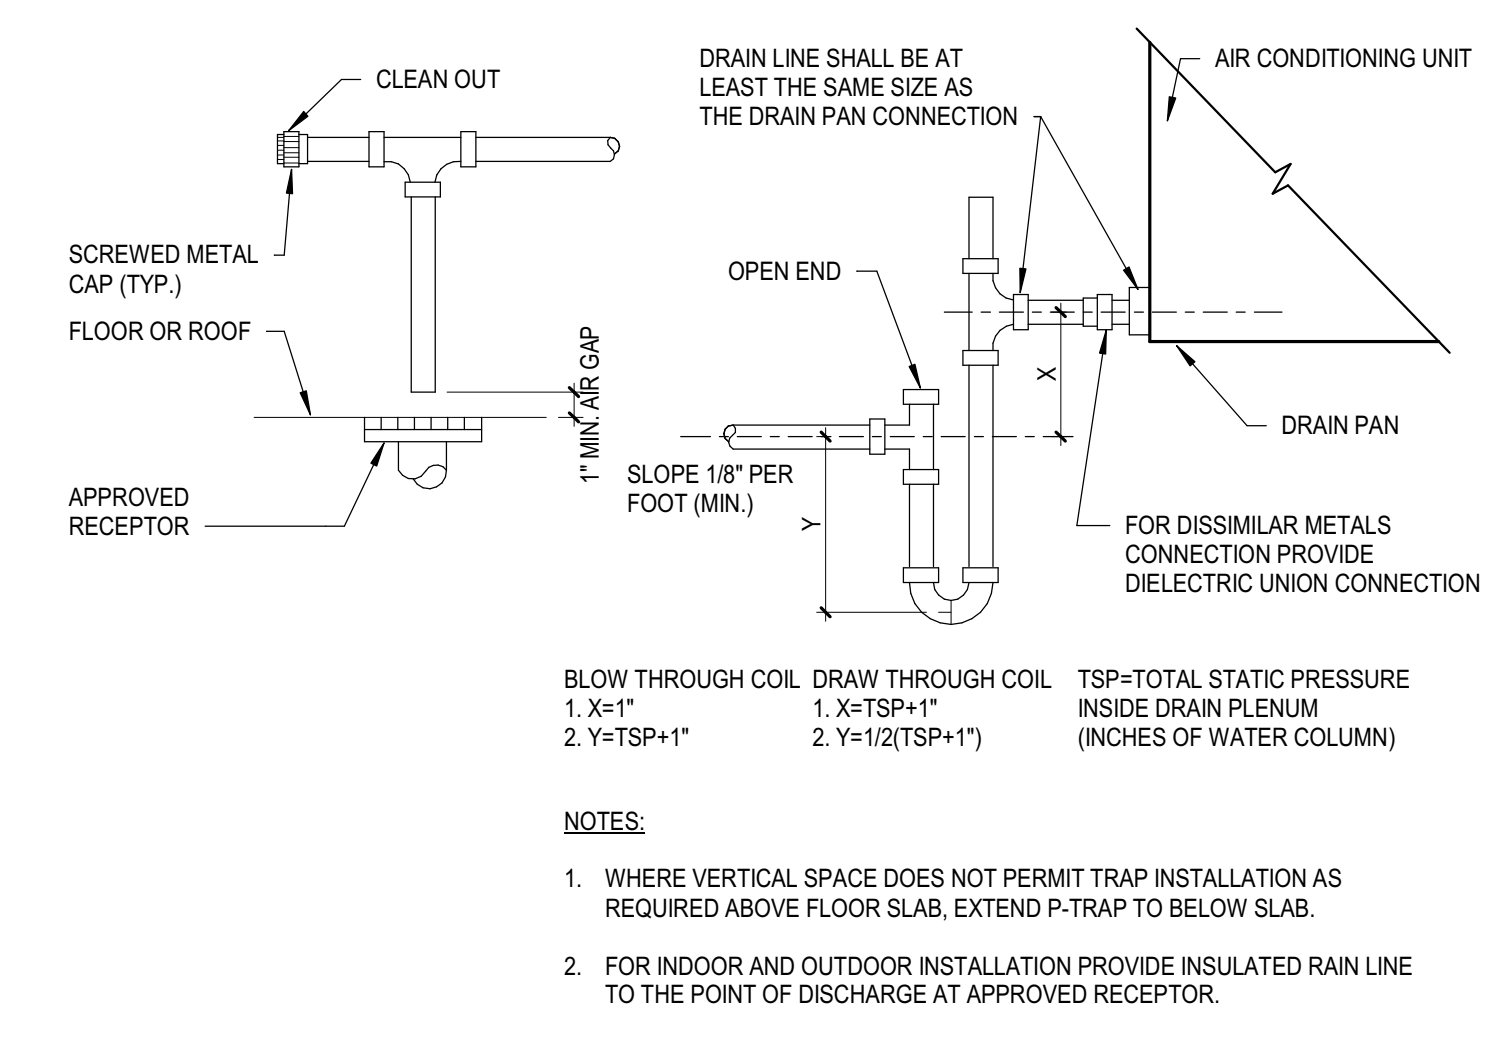

**10** CONDENSATE DRAIN CONNECTION DETAIL  
M7.1 NO SCALE

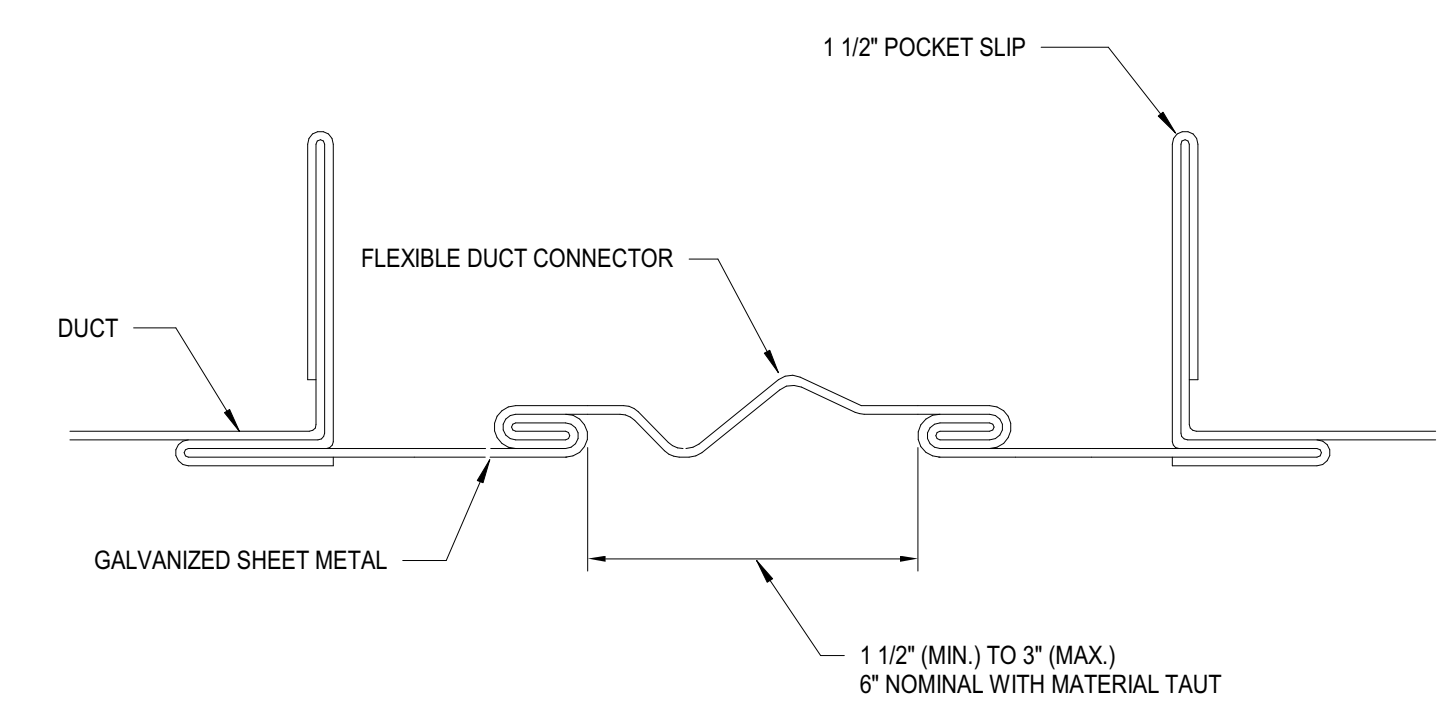


**11** FLEXIBLE DUCT CONNECTION  
M7.1 NO SCALE

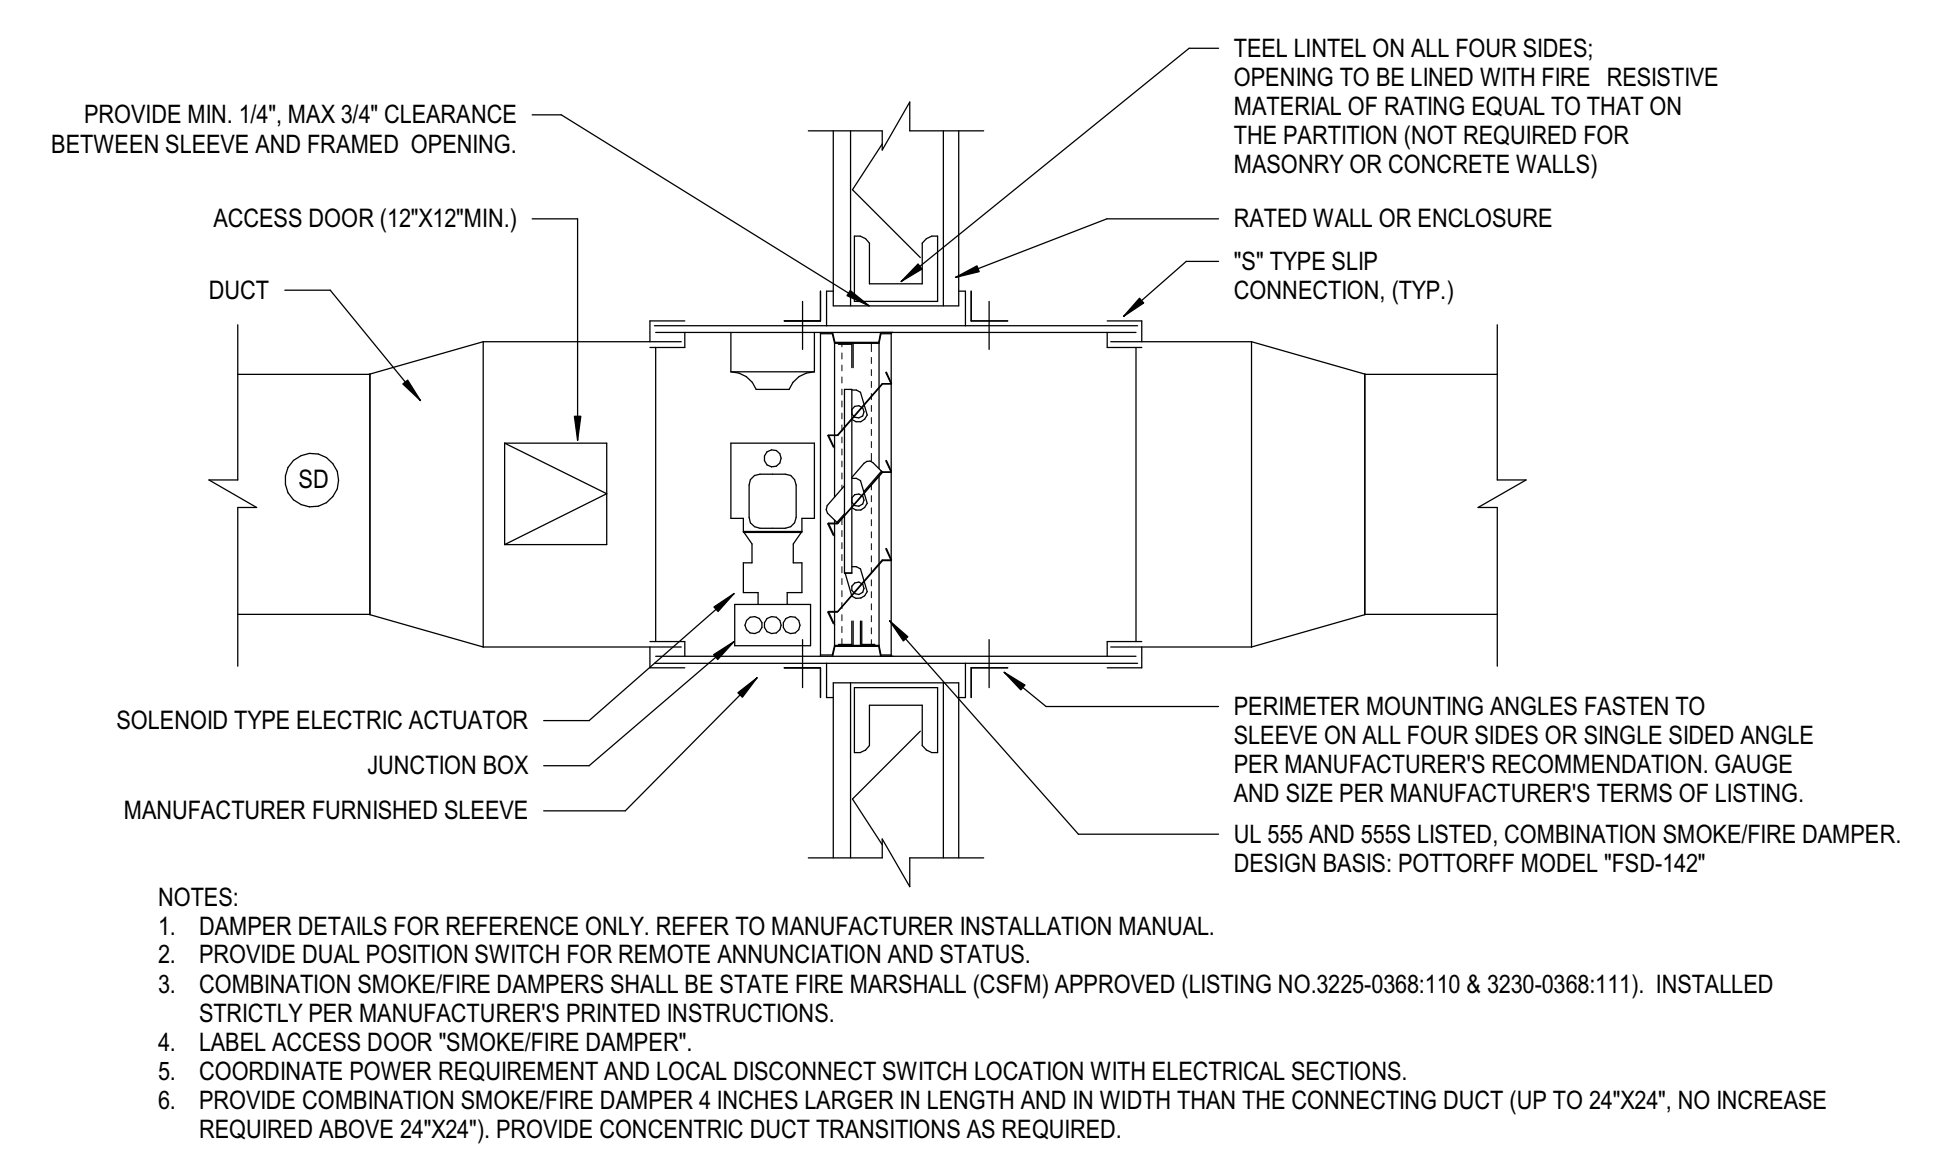


**12** COMBINATION FIRE/SMOKE DAMPER INSTALLATION  
M7.1 SCALE: 1/2" = 1'-0"

Autodesk Docs/175-22605-00\_CVUSD - District Wide HVAC Replacement/175-22605-00\_CVUSD\_Rowland ES MEP\_2022.rvt 10/21/2022 4:43:00 PM




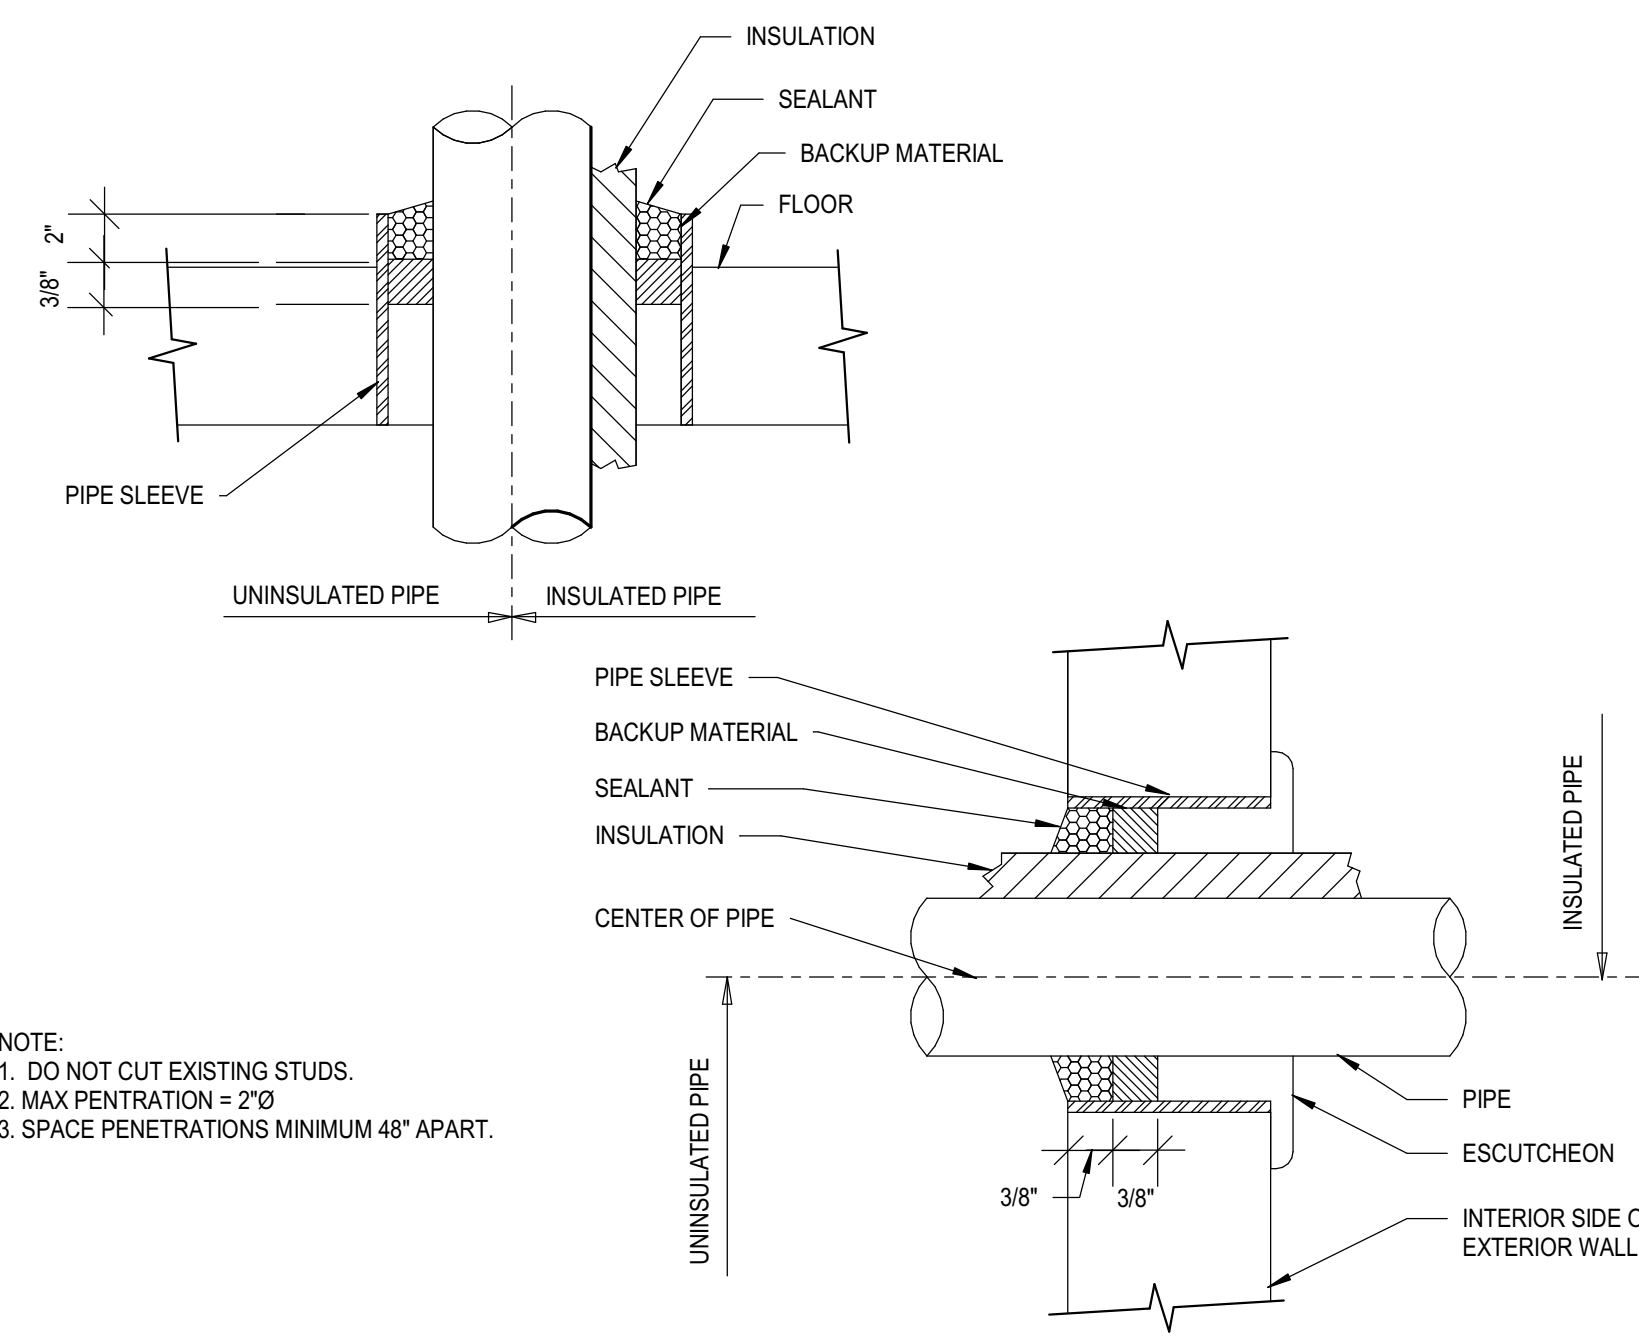


**1 PIPE PENETRATION DETAILS**  
M7.2 / NO SCALE

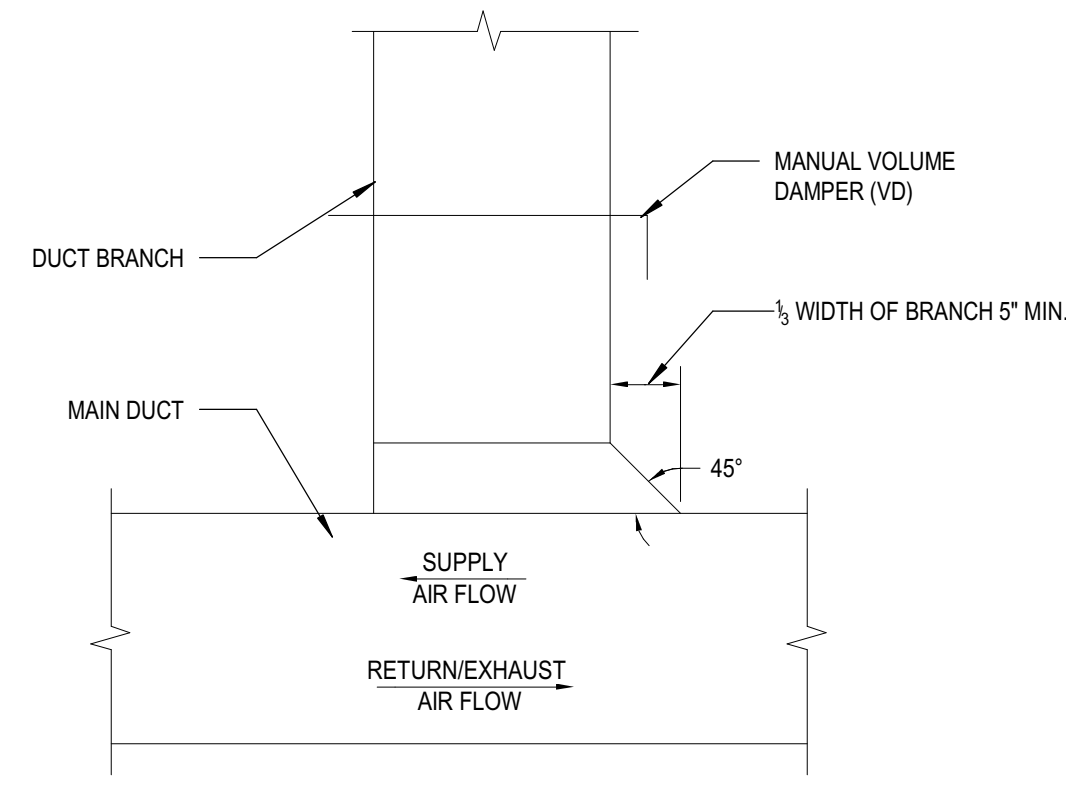


**2 RECTANGULAR DUCT BRANCH TO RECTANGULAR DUCT**  
M7.2 / NO SCALE

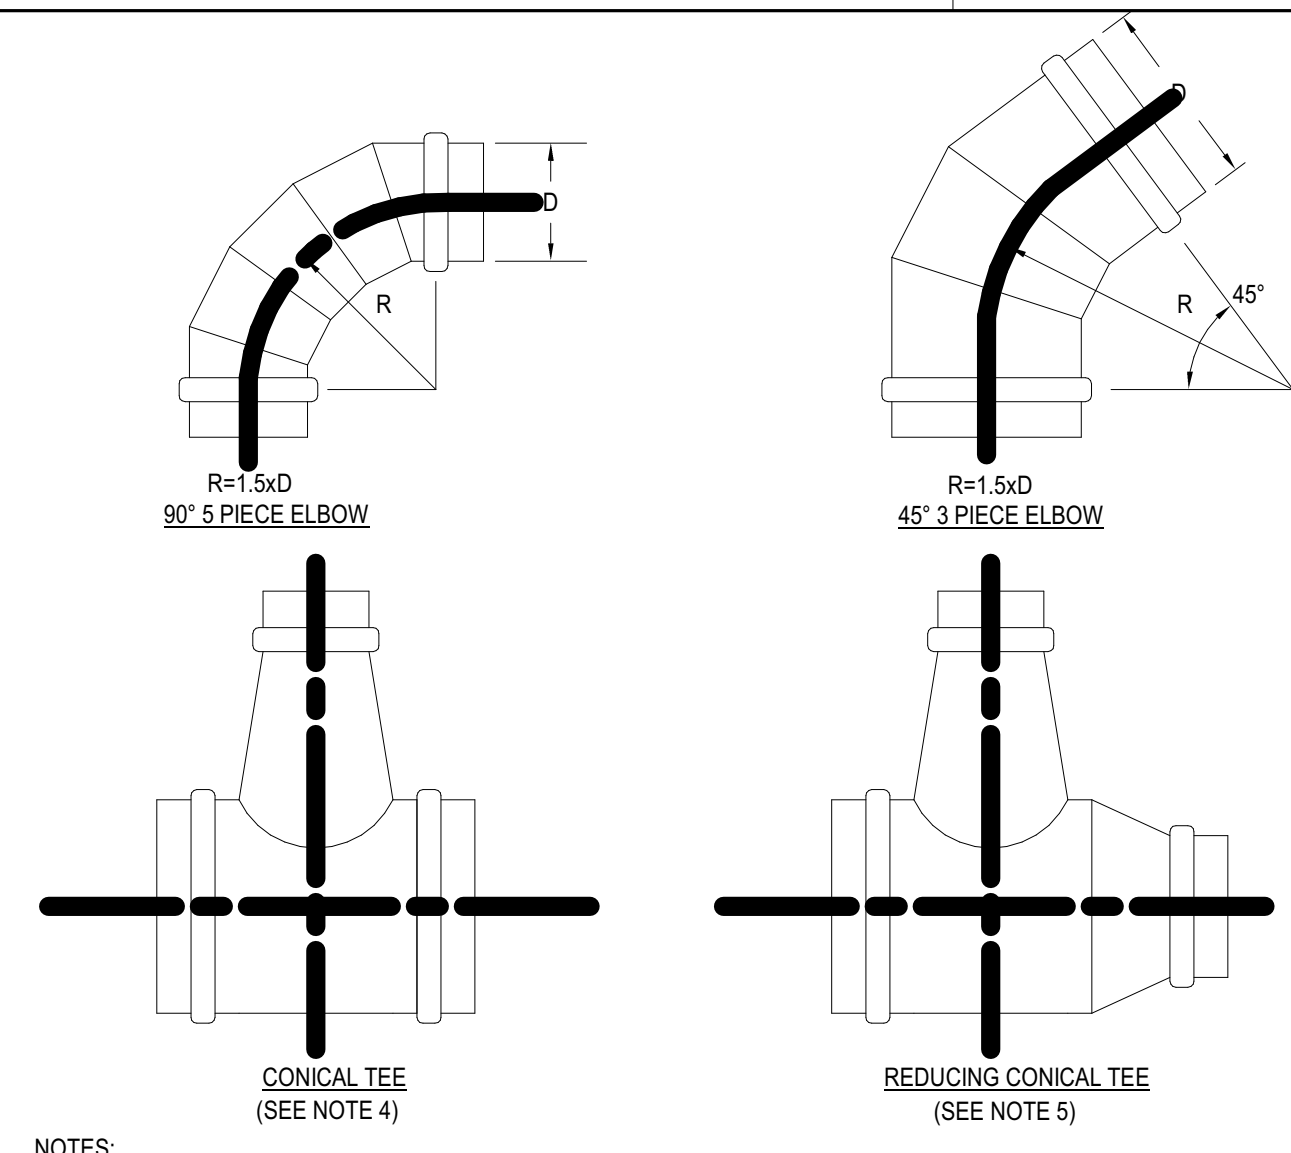


**3 ROUND DUCT FITTINGS**  
M7.2 / NO SCALE

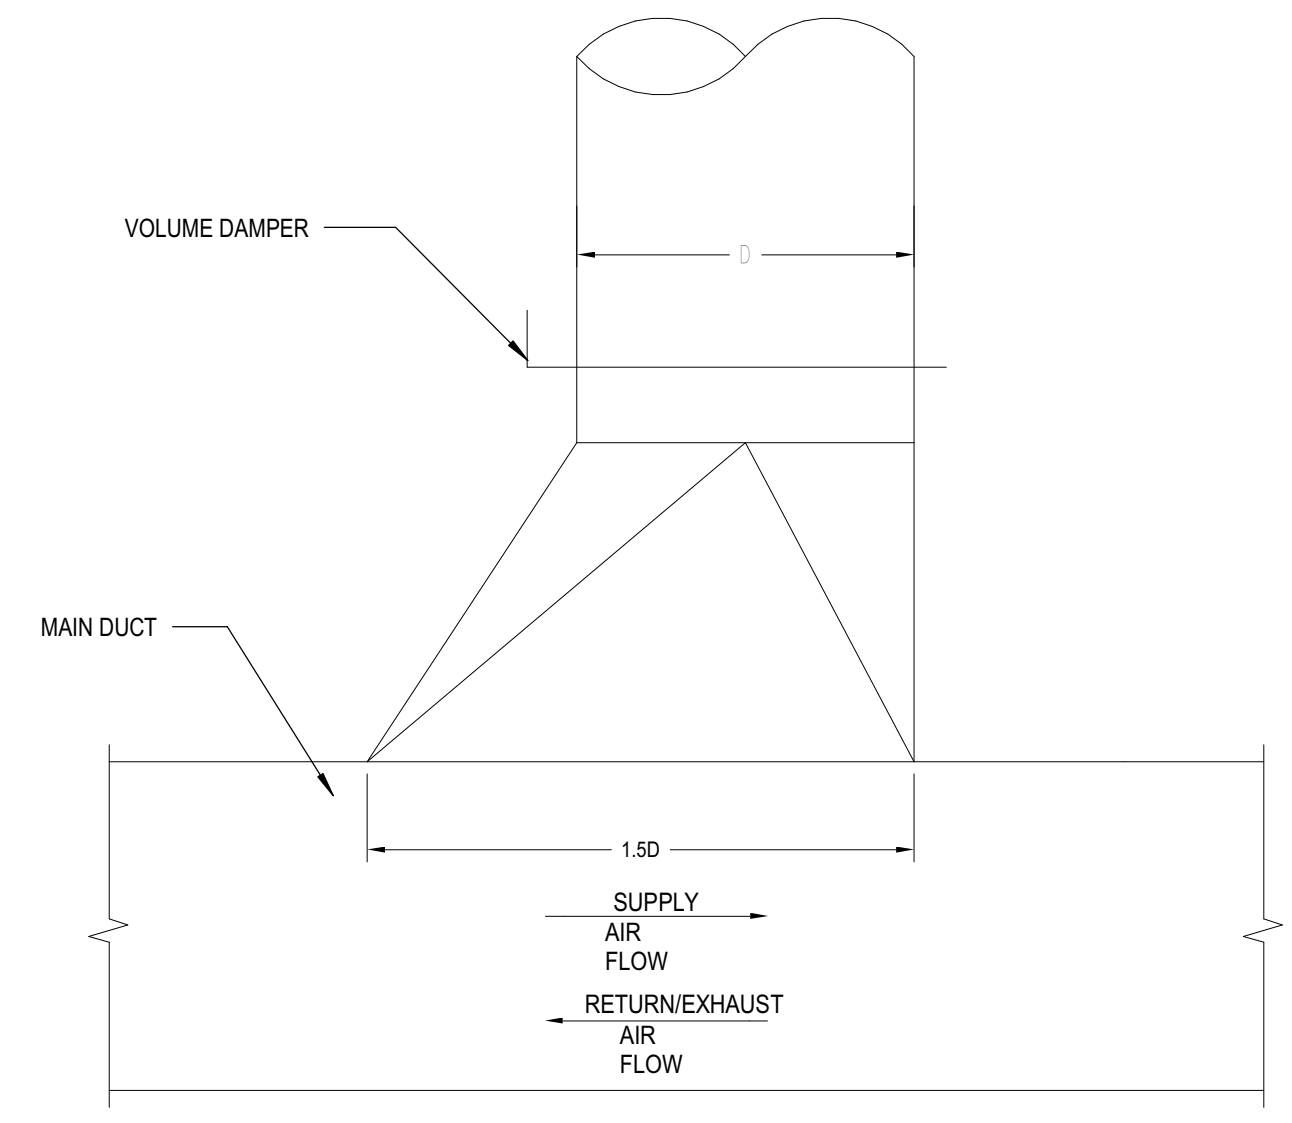


**4 ROUND DUCT BRANCH TO MAIN RECT. CONNECTION**  
M7.2 / NO SCALE

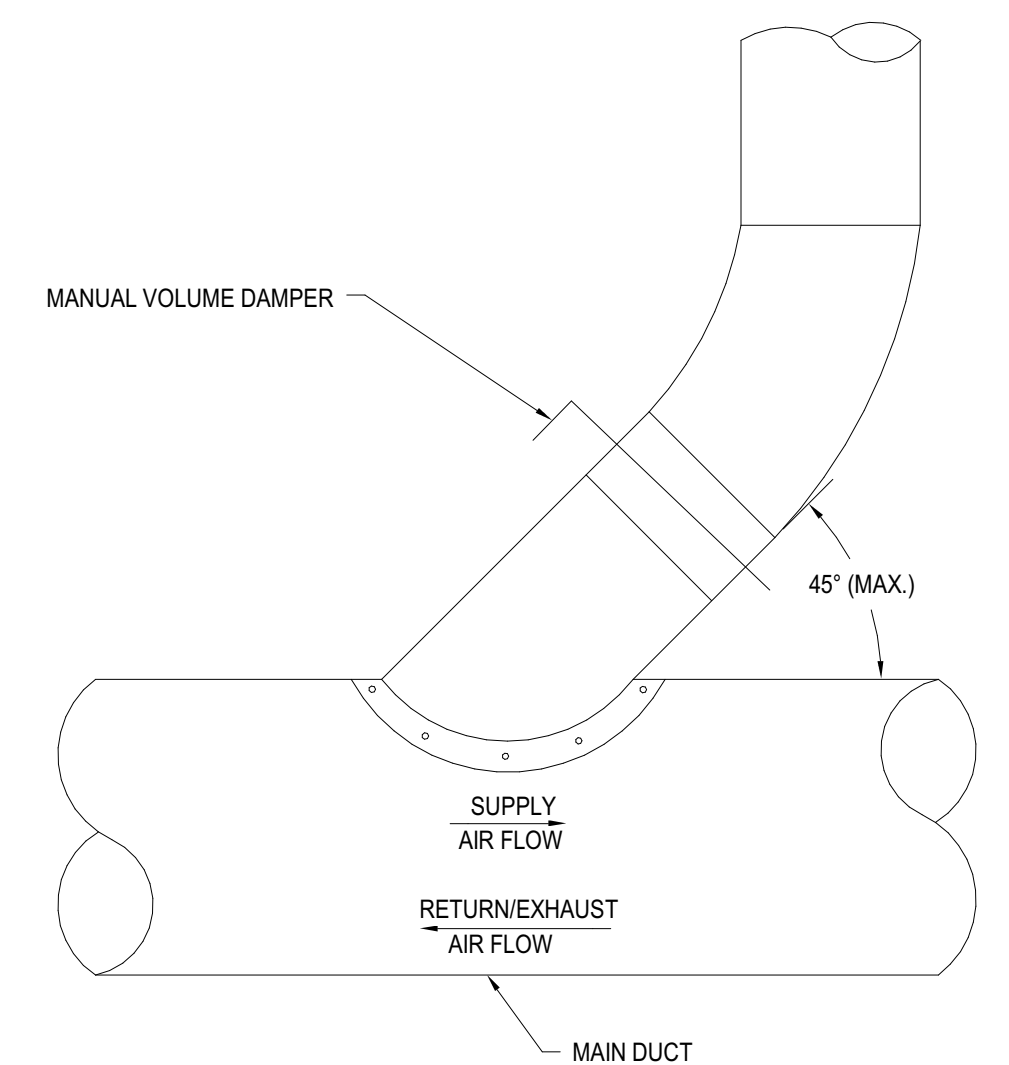


**5 ROUND DUCT BRANCH TO ROUND MAIN CONNECTION**  
M7.2 / NO SCALE

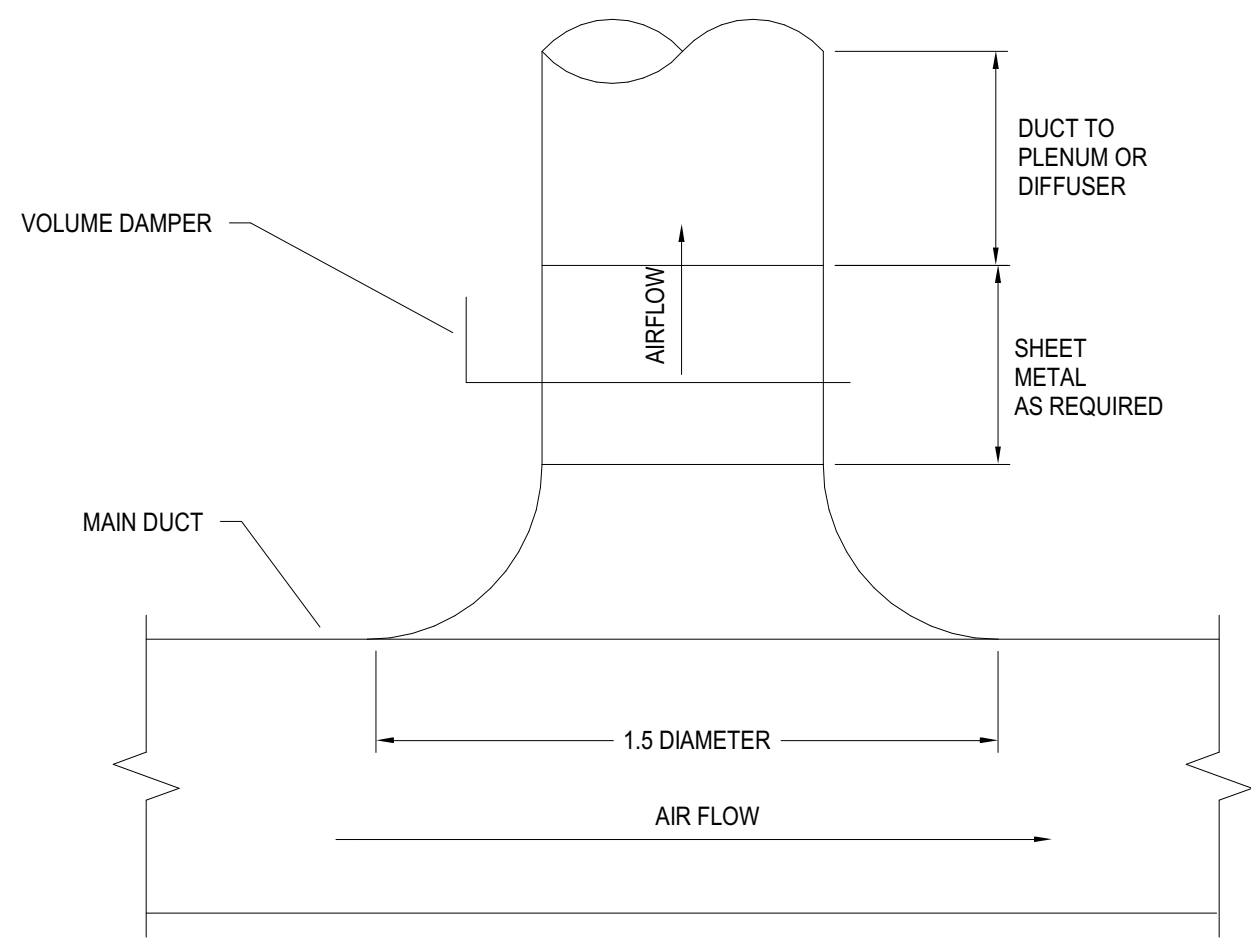


**6 ROUND SUPPLY DUCT BRANCH TO RECTANGULAR DUCT**  
M7.2 / NO SCALE

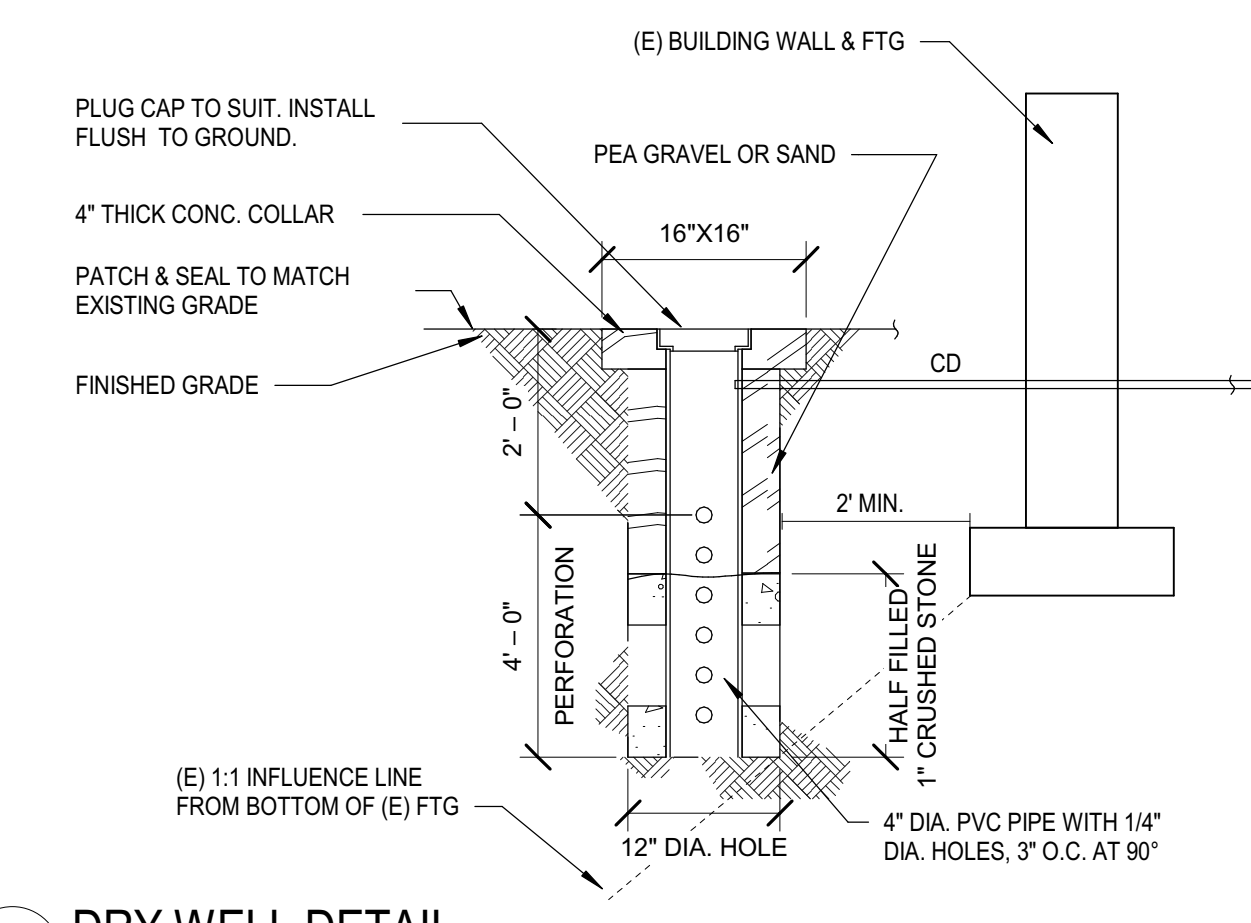


**7 DRY WELL DETAIL**  
M7.2 / NO SCALE

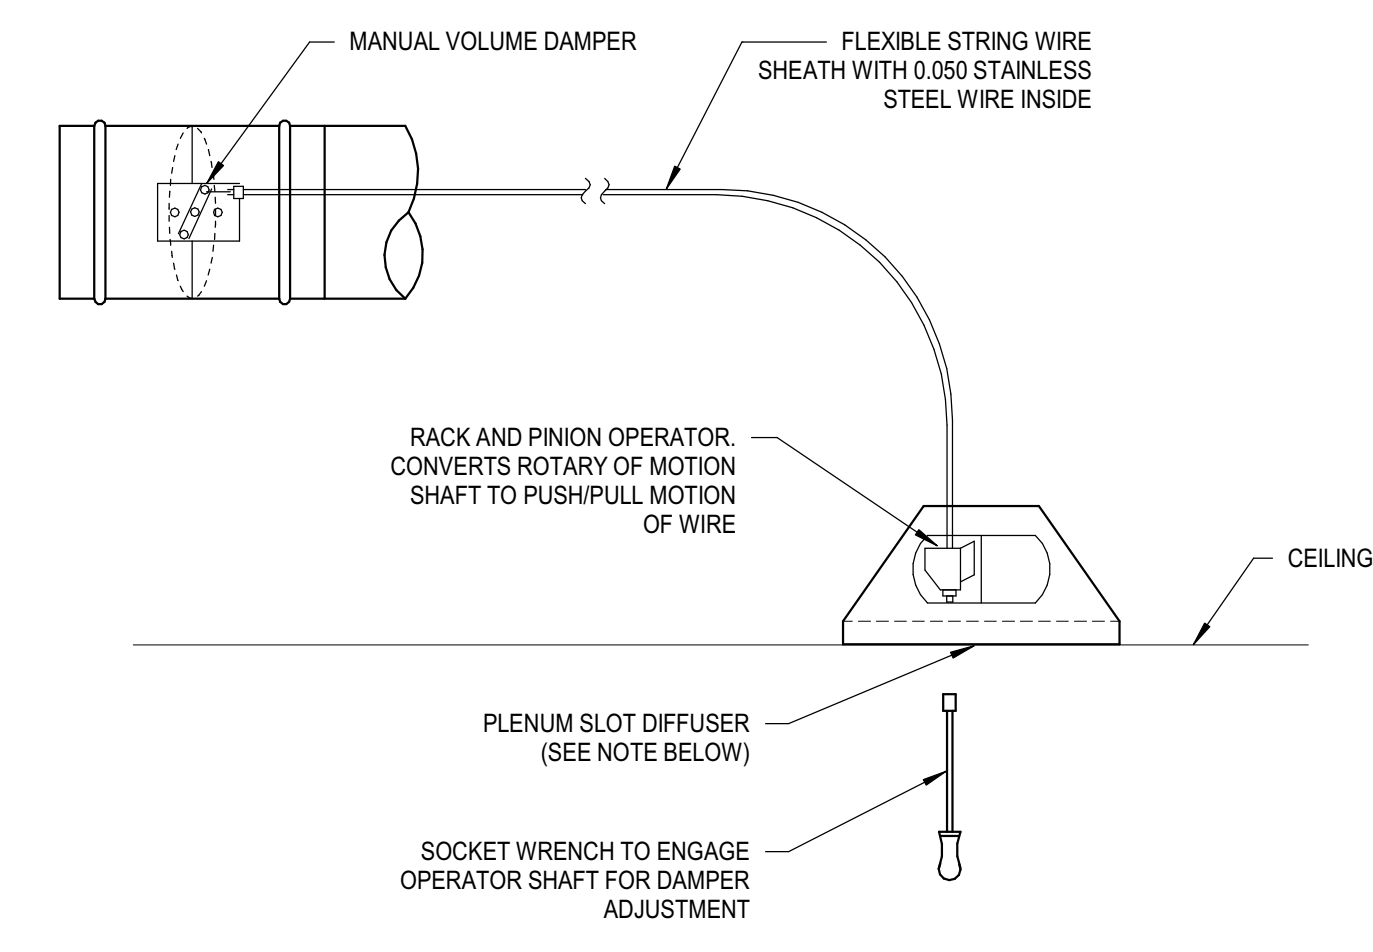


**8 BOWDEN TYPE CABLE CONTROL (YOUNG'S REGULATOR)**  
M7.2 / NO SCALE

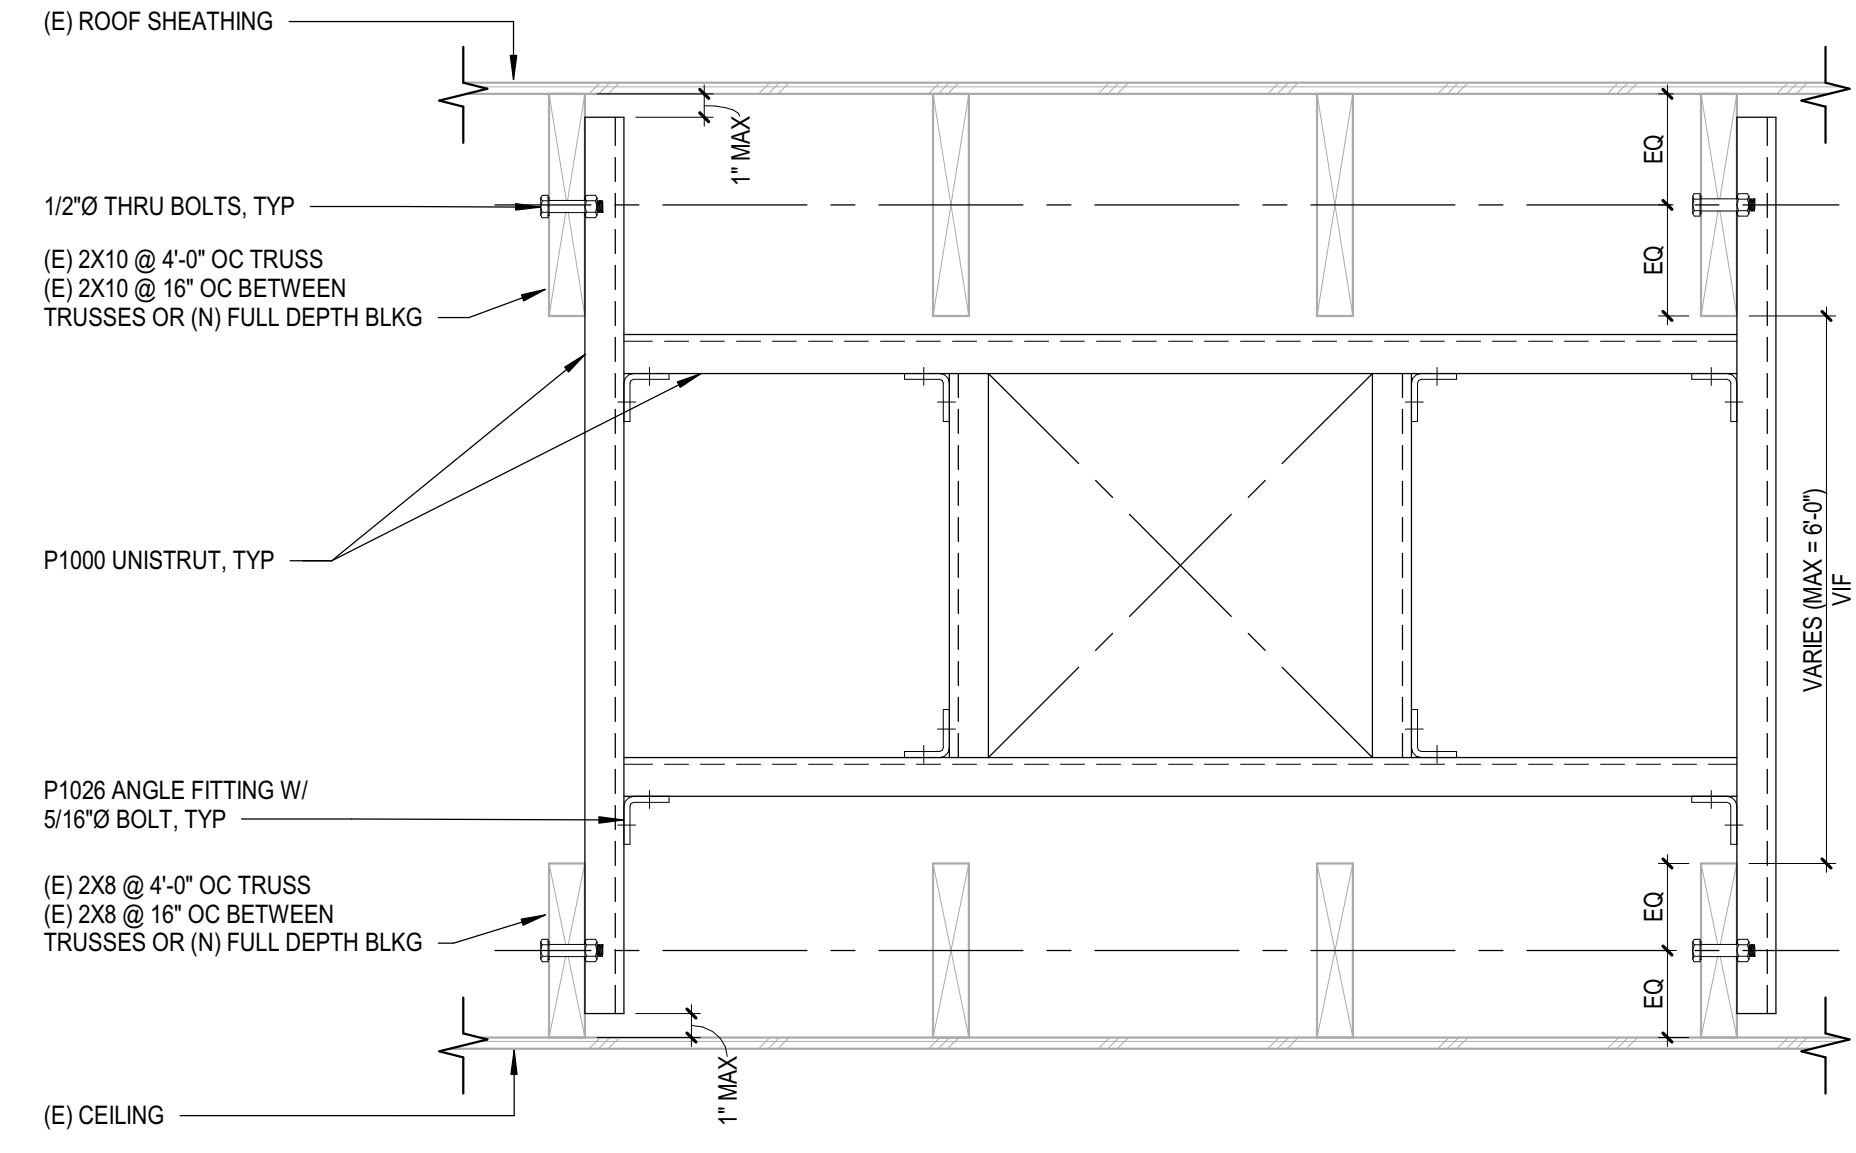

**9 DUCT SUPPORT IN CEILING SPACE**  
M7.2 / NO SCALE

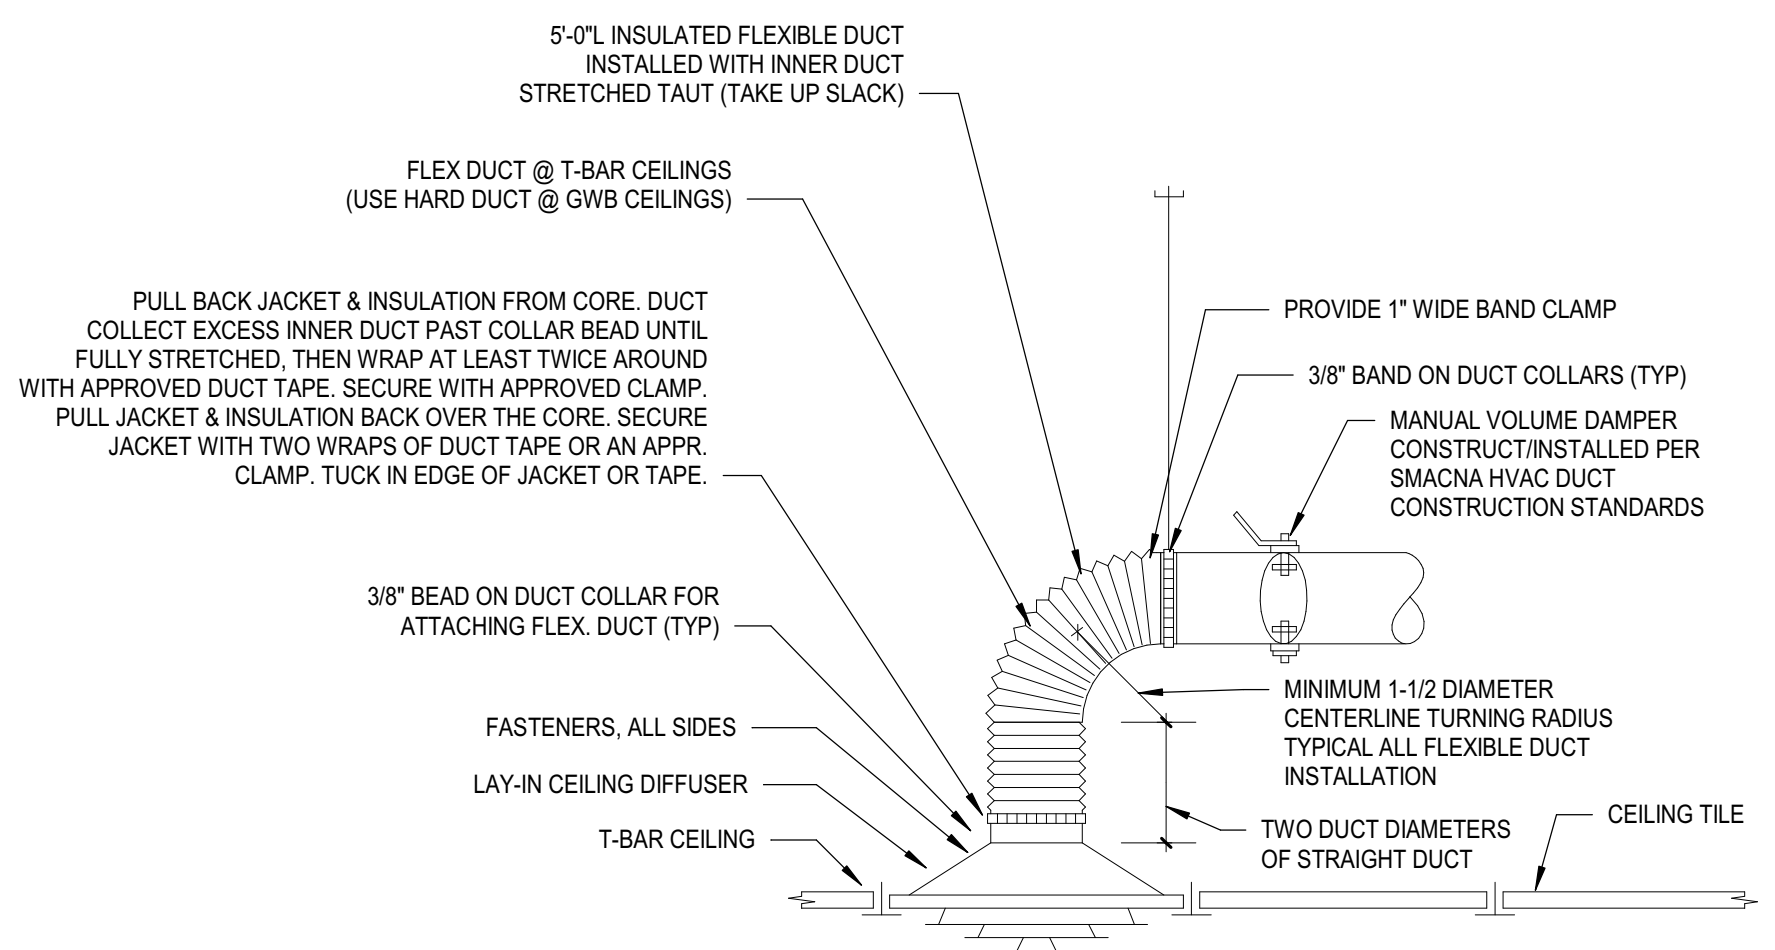

**10 CEILING SUPPLY DIFFUSER CONNECTION DETAIL**  
M7.2 / NO SCALE

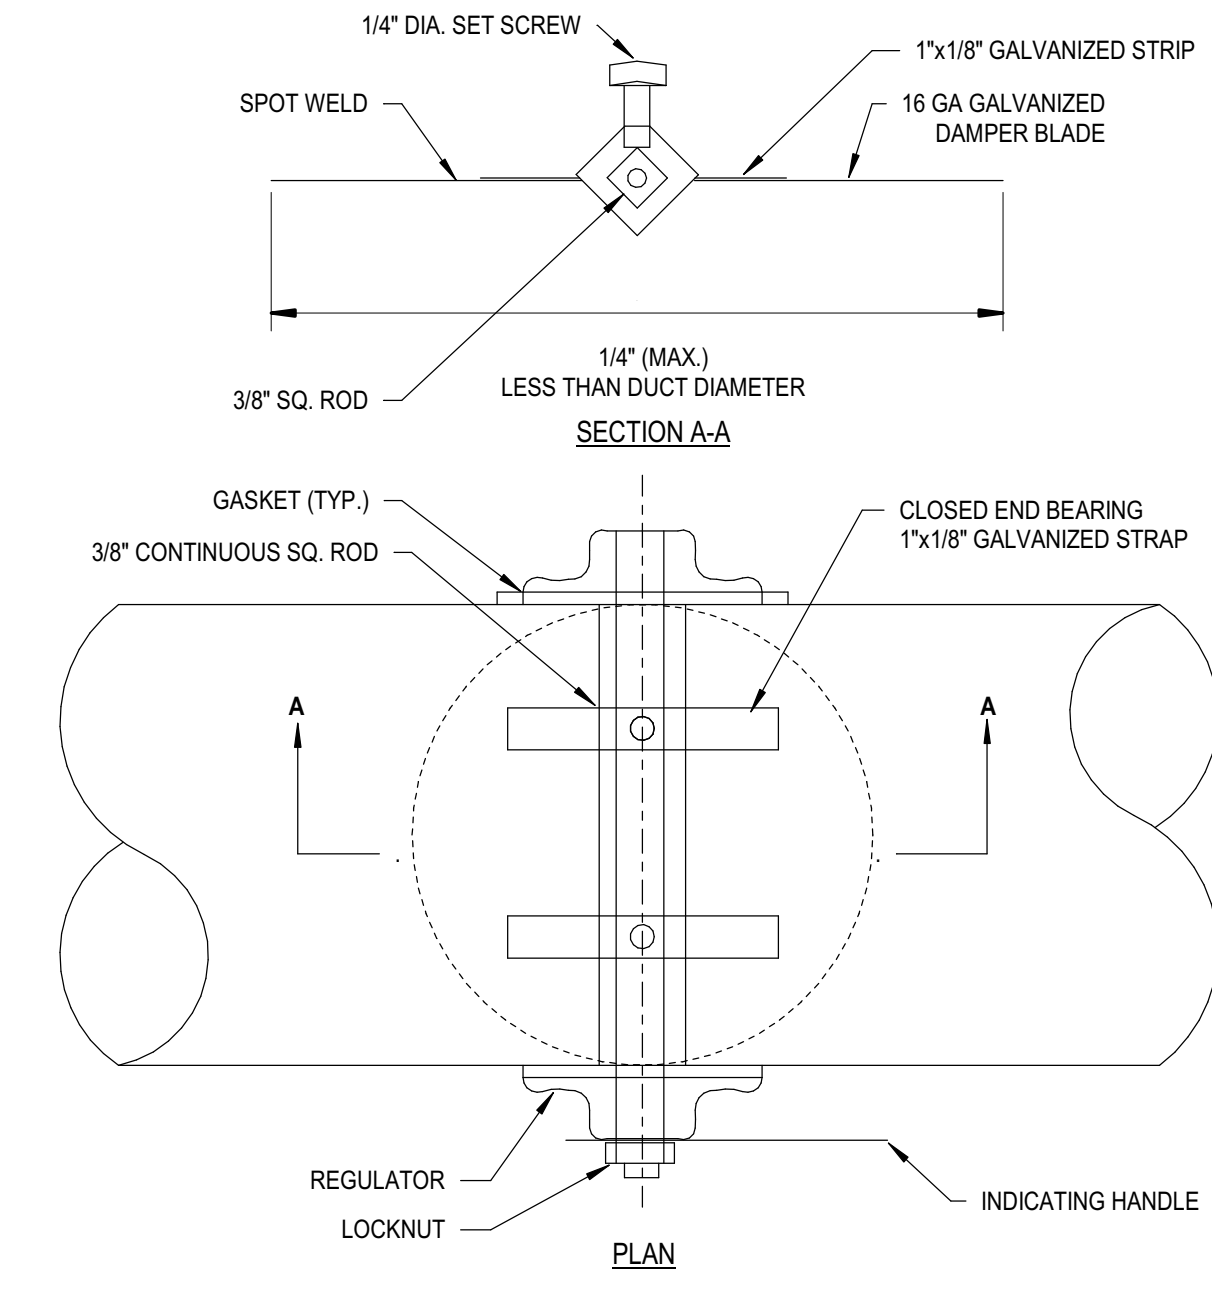

**11 ROUND VOLUME DAMPER (UP TO 14\")**  
M7.2 / NO SCALE

Autodesk Docs/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD\_Rowland\_ES MEP\_2022.rvt 10/21/2022 4:43:01 PM



1

2

3

4

5

MARK FCU-B1	MAKE CARRIER	MODEL 40RUQA25	STEEL FRAME ASTM A36, L 3 X 3 X 1/4	DETAIL-1	DETAIL-3	<table border="1" style="font-size: 8px;"> <tr> <td>MTG</td> <td>SPRING OD</td> <td>DEFL.</td> </tr> <tr> <td>1-6</td> <td>2"</td> <td>1"</td> </tr> </table>	MTG	SPRING OD	DEFL.	1-6	2"	1"
MTG	SPRING OD	DEFL.										
1-6	2"	1"										

**NOTES:**

- APPROX. STEEL WEIGHT INCLUDING ISOLATORS: 200 LBS.
- INDICATES TIE-DOWN STRAP, SEE DETAIL 3.
- ALL DIMENSIONS REQUIRE FINAL REVIEW AT COMMENCEMENT OF PROJECT.

**ATTACHMENT OF SPRING ISOLATORS TO CONCRETE PAD ON GRADE**

9/16" DIA. HOLE (2) PLACES  
 USE 1/2" DIA. HILTI KB T22 ANCHORS IN 3000 PSI HR CONCRETE, MIN  
 3" NORMAL EMBEDMENT, MIN 6" CONCRETE THICKNESS & MIN 6" EDGE DISTANCE.  
 INSTALL ANCHORS WITH SPECIAL INSPECTION PER ICC ESR-4266.

**MAX. ALLOW. LOADS:** HORIZ. 1100 lbs. VERT. (UP) 1400 lbs.

**TIE-DOWN STRAP DETAIL**

**ATTACHMENT OF UNIT TO STEEL BASE**


**DETAIL-2**

**VIEW A-A**

**VIEW B-B**

<b>M. W. SAUSSE &amp; CO., INC.</b> 28744 Whitherspoon Pkwy. Valencia, CA 91355 Phone: (661) 257-3311 Fax: (661) 257-7673 	<b>JOB NAME:</b> COVINA USD - ROWLAND <b>CUST.:</b> <b>CUST. P.O.:</b> <b>MECH. ENGR.:</b> DLRG <b>MARK:</b> FCU-B1 (HORIZONTAL)	<b>REVISIONS:</b> <b>A:</b> CALL OUT ALL ATTACHMENTS (9-2-22) <b>B:</b> SPECS ANGLE (9-20-22) <b>C:</b> <b>D:</b>	<b>DRN:</b> TDT <b>DATE:</b> 7-29-22 <b>DRAWING NO.:</b> <div style="border: 1px solid black; padding: 2px; text-align: center;">-2B</div>
---	--	---	---

1 FCU-B1  
M7.3 NO SCALE

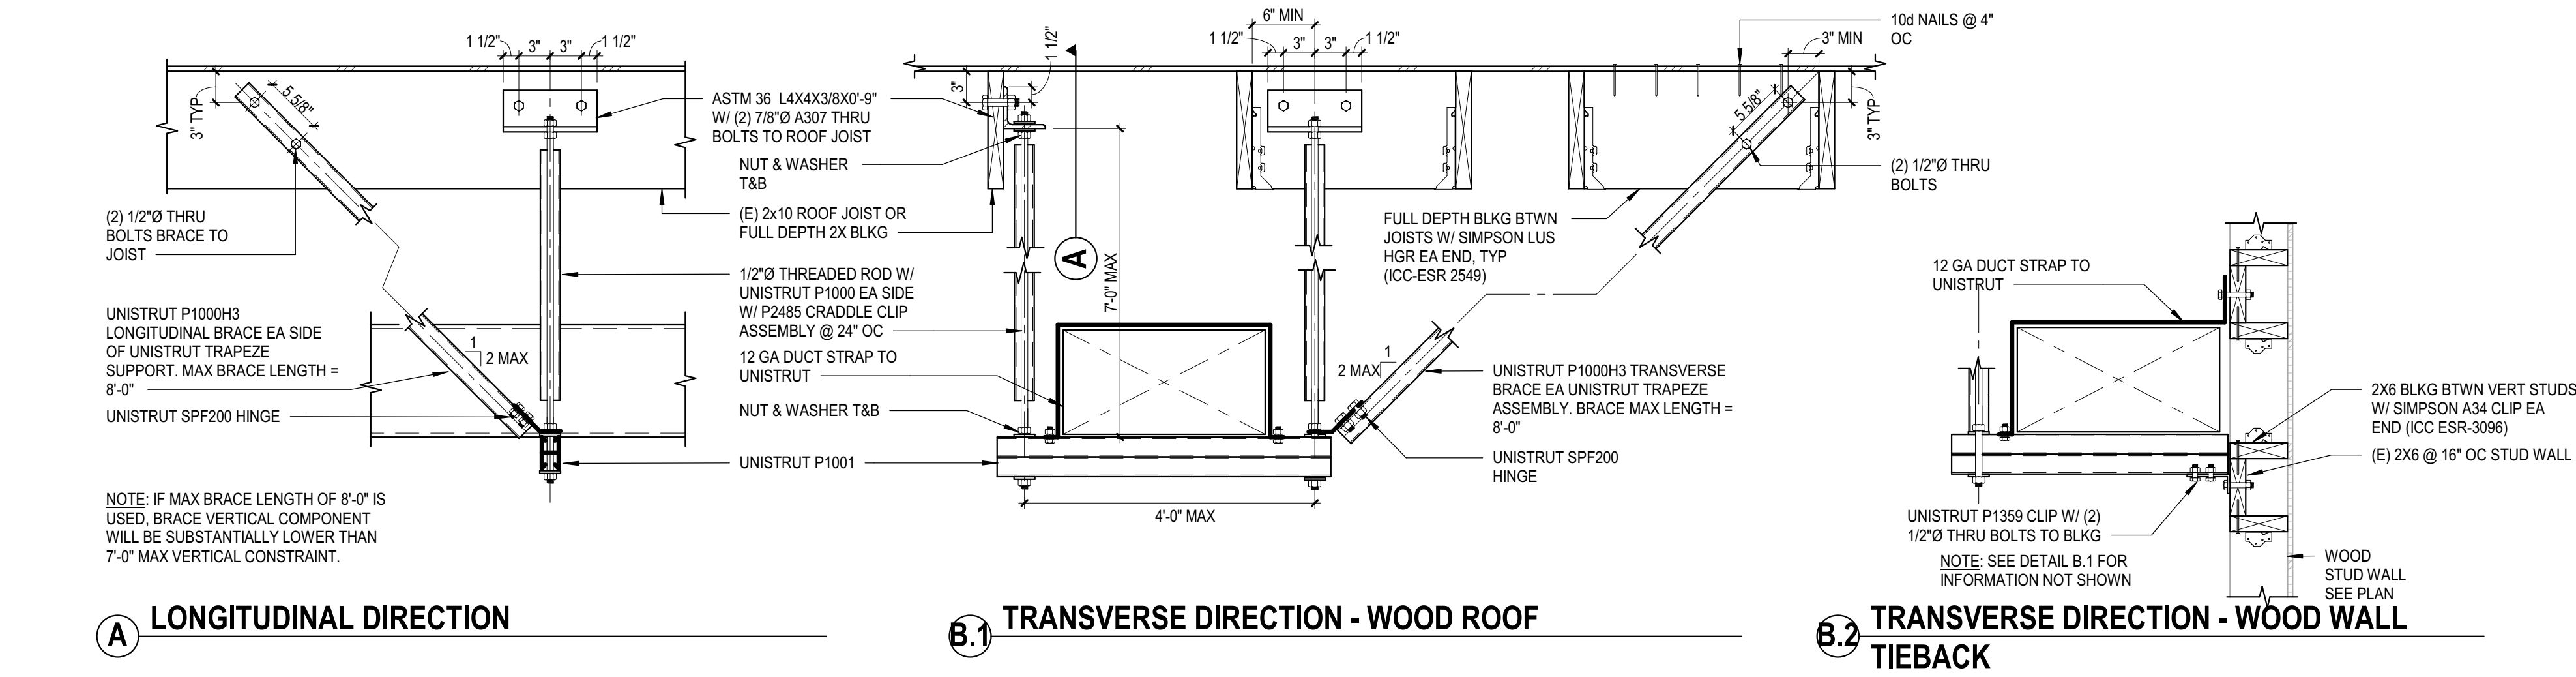

2 DUCT SUPPORTS  
M7.3 NO SCALE

Autodesk Docs/75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD\_Rowland\_ES\_MEP\_2022.rvt  
 10/21/2022 4:43:01 PM



<b>MARK</b> CU-B1	<b>MAKE</b> TOSHIBA	<b>MODEL</b> MNY-AP240	<b>STEEL FRAME</b> ASTM A36, L 4 X 3 X 1/4	<b>DETAIL-1</b>	<b>DETAIL-3</b>	<b>MTG</b> 1-6	<b>SPRING OD</b> 4"	<b>DEFL.</b> 2"
----------------------	------------------------	---------------------------	---	-----------------	-----------------	-------------------	------------------------	--------------------

**NOTES:**

- APPROX. STEEL WEIGHT INCLUDING ISOLATORS: 450 LBS.
- FOR ISOLATORS. SEE DETAIL 3.
- M.W. SAUSSE & CO. INC. IS NOT RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THE EQUIPMENT WHEN ANCHORED AS SHOWN.
- NOT FOR CONSTRUCTION, ALL DIMENSIONS REQUIRE FINAL REVIEW AT COMMENCEMENT OF PROJECT.

**ATTACHMENT OF SPRING ISOLATORS TO CONCRETE PAD ON GRADE**

1 1/16" DIA. HOLE (2) PLACES  
USE 5/8" DIA. STAINLESS HILTI KB T22 ANCHORS IN MIN 3000 PSI HR CONCRETE.  
MIN 3-3/4" NOMINAL EMBEDMENT, MIN 4" CONCRETE THICKNESS & MIN 6" EDGE DISTANCE. INSTALL ANCHORS WITH SPECIAL INSPECTION PER ICC ESR-4286.

CS X 8.7 X 4-1/2 LG  
L 4 X 3 X 1/4  
NEOPRENE GROMMET  
1/2" DIA. LEVELING BOLT  
1/2" DIA. TAP  
5/8" EARTHQUAKE STABILIZER BOLT  
1/4" PLATE  
1/4" RIBBED NEOPRENE PAD

APPROX. OPER. HT. 5-1/2"

**MAX. ALLOW. LOADS: HORIZ: 2200 LBS      VERT. (UP): 2820 LBS**

**DETAIL-2**

LEVELLING BOLT 1/2" DIA. & ATTACHMENT OF STEEL BASE TO SPRING ISOLATOR

9/16" DIA. HOLE

ASTM A36, L 4 X 3 X 1/4

5-7/8" OPER. HT.

**VIEW B-B**      **VIEW A-A**

<b>M. W. SAUSSE &amp; CO., INC.</b> 28744 Whitherspoon Pkwy, Valencia, CA 91355 Phone: (661) 257-3311 Fax: (661) 257-7673 <b>Vibrex</b> <b>RMUHAB</b>	<b>JOB NAME:</b> COVINA USD - RAWLAND ES <b>CUST.:</b> <b>CUST. P.O.:</b> <b>MECH. ENGR.:</b> DLR <b>MARK:</b> CU-B1	<b>REVISIONS:</b> A: CALL OUT ALL ATTACHMENT (9-2-22) B: CHANGED UNIT (9-6-22) C: SPECS ANGLE (9-20-22) D:	<b>DRN:</b> TDT <b>DATE:</b> 9-7-22 <b>DRAWING NO.:</b> -1C
--	--	--	--

1 CU-B1  
M7.4 NO SCALE



### DETAIL-1

**NOTES:**

- FOR ANCHOR REQUIREMENTS AND SEISMIC STRAPS, SEE DETAIL 2, 3.
- ROOF SLOPE TO BE VERIFIED BY CONTRACTOR BEFORE FABRICATION & ROOF CURB HEIGHT ARE APPROXIMATE.
- NOT FOR CONSTRUCTION, ALL DIMENSIONS REQUIRE FINAL REVIEW AT COMMENCEMENT OF PROJECT

### DETAIL-3

MARK	MAKE	TYPE	SIZE	CURB WT.
3 TON	CARRIER	50FC0A	04	275#

**SRC TOP VIEW**

A	B	C	D	E	F	G	H	I
36-15/16	67-1/8	40-7/16	70-5/8	20-1/4	13-11/16	13-7/8	15-3/16	32-1/16
						J	K	L
						42-15/16	73-1/8	71-1/8
								M
								40-15/16

**SRC FOOTPRINT**

**SECTION A-A**

**NOTES:**

- L & M DIMENSIONS ARE CENTERLINES OF ANCHOR HOLES IN CURB BOTTOM FLANGE.
- FOR ANCHORAGE, USE 3/8" DIA. LAG BOLT MIN. 3" LONG INTO MIN. 4 X 4 DOUGLAS FIR, MIN 1-1/2" EDGE DISTANCE, & MIN 2-5/8" END DISTANCE. (3) ON LONG SIDES & (2) ON SHORT SIDES.

### DETAIL-2

**SEISMIC STRAP**

**REGISTERED PROFESSIONAL ENGINEER**  
MAXIM D. TREMBLAY  
No. 66481  
Exp. 3/30/23  
STRUCTURAL  
STATE OF CALIFORNIA  
10/20/2022

<b>M. W. SAUSSÉ &amp; CO., INC.</b> 28744 Whitterspoon Pkwy, Valencia, CA 91355 Phone: (861) 257-3311 Fax: (861) 257-7873	<b>JOB NAME:</b> COVINA USD - ROWLAND ES <b>DATE:</b> 7-22-22 <b>CUST. P.O.:</b> <b>MECH. ENGR.:</b> DLR <b>MARK:</b> 3 TON	<b>REVISIONS:</b> <b>A:</b> SLOPE (7-25-22) <b>B:</b> <b>C:</b> <b>D:</b>	<b>DRN:</b> TDT <b>DATE:</b> 7-25-22 <b>DRAWING NO.:</b> -3A
---	---	---	---

1 RTU ANCHORAGE DETAIL  
M7.5 NO SCALE



1

ROWLAND AVE. E.S. AC UNIT REPLACEMENT

ROWLAND AVE. E.S. EXISTING UNIT

NEW UNIT

Table with columns for TAGS, MAKE, MODEL, GAS INPUT/OUTPUT, ELECTRICAL, WEIGHT, ECONOMIZER, POWER EXHAUST, OPERATING WEIGHT, DIRECT REPLACEMENT?, CARRIER MODEL #, NET COOLING CAPACITY, AIRFLOW (CFM), ESP (IN WG), SEER, EER, HEATING CAPACITY, NEW MERV RATING, FILTER QUANTITY & SIZE, ELECTRICAL, WEIGHT, OUTSIDE AIR HOOD WEIGHT, ECONOMIZER, POWER EXHAUST, ROOF CURB WEIGHT, TOTAL WEIGHT, UNIT DIMENSIONS, ANCHORAGE DETAIL REFERENCE.

2

- NOTES: 1. PROVIDE MECHANICAL UNIT WITH INTEGRAL CONVENIENCE RECEPTACLE. 2. ALL ROOFTOP UNITS SHALL BE PROVIDED WITH UNPOWERED CONVENIENCE OUTLET. 3. ALL ROOFTOP UNITS ARE HORIZONTALLY DISCHARGED CONFIGURATION. UNO. FIELD VERIFY PRIOR TO ORDERING. 4. PROVIDE HINGED ACCESS PANEL FOR ALL ROOFTOP UNITS. 5. FINAL WEIGHT (LBS) IS SUMMATION OF RTU WEIGHT, AND OUTSIDE AIR HOOD, AS APPLICABLE. 6. SCOR RATING OF UNITS SHALL BE MINIMUM OF 10KA FOR CLASSROOM RTU's & MPR FCU-B1 AND 25 KA FOR MPR CU-B1.

3

DIFFUSER AND GRILLE SCHEDULE

Table with columns: MARK NO., MANUFACTURER & MODEL NO., TYPE, OVERALL DIMENSIONS, NECK SIZE, CFM RANGE, MAX NC, MAX SP, NOTES.

- NOTES: 1. OBTAIN ARCHITECT'S APPROVAL FOR COLOR AND FINISH. 2. MATCH THE BORDER TYPE TO THE CEILING. 3. PROVIDE FLAT BLACK INTERNAL FINISH.

DUCT SIZING SCHEDULE \*\*\* FOR LOW VELOCITY SUPPLY, RETURN AND EXHAUST

Table with columns: CFM RANGE, ROUND DUCT DIAMETER OR EQUIVALENT RECTANGULAR DUCT, CFM RANGE, ROUND DUCT DIAMETER OR EQUIVALENT RECTANGULAR DUCT.

REMARKS: DUCT SIZES INDICATED ARE INSIDE DIMENSIONS WHICH MAY BE ALTERED BY CONTRACTOR TO OTHER DIMENSIONS TO AVOID INTERFERENCES AND CLEARANCE REQUIREMENTS. USE EQUAL FRICTION METHOD, 0.1" WG PER 100FT. OF DUCT TO DETERMINE DUCT SIZES. VERIFY ALL DIMENSIONS AT THE SITE. MAKE ALL FIELD MEASUREMENTS AND SHOP DRAWINGS NECESSARY FOR FABRICATION AND ERECTION OF SHEET METAL WORK. MAKE ALLOWANCES FOR BEAMS, PIPE OR OTHER OBSTRUCTION AND FOR WORK BY OTHER TRADES AND NOTIFY THE ARCHITECT IN THE EVENT OF ANY POTENTIAL INTERFERENCE. MAKE AN INITIAL VERIFICATION OF BEAM PENETRATIONS SHOWN ON STRUCTURAL DRAWINGS AND ADVISE OF ANY POTENTIAL INTERFERENCES.

Table with columns: LOCATION, AIR VELOCITY GUIDELINES (FPM), NOISE CRITERIA (NC) (40, 35, 30, 25, 20, 15).

DUCT SIZING \*\*\* MEDIUM PRESSURE DUCTWORK

Table with columns: CFM, ROUND DUCT (IN), RECTANGULAR DUCT (IN) (W X H), W X 4, W X 6, W X 8, W X 10, W X 12.

REMARKS: DUCT SIZES INDICATED ARE INSIDE DIMENSIONS WHICH MAY BE ALTERED BY CONTRACTOR TO OTHER DIMENSIONS TO AVOID INTERFERENCES AND CLEARANCE REQUIREMENTS. USE EQUAL FRICTION METHOD, 0.1" WG PER 100FT. OF DUCT TO DETERMINE DUCT SIZES. VERIFY ALL DIMENSIONS AT THE SITE. MAKE ALL FIELD MEASUREMENTS AND SHOP DRAWINGS NECESSARY FOR FABRICATION AND ERECTION OF SHEET METAL WORK. MAKE ALLOWANCES FOR BEAMS, PIPE OR OTHER OBSTRUCTION AND FOR WORK BY OTHER TRADES AND NOTIFY THE ARCHITECT IN THE EVENT OF ANY POTENTIAL INTERFERENCE. MAKE AN INITIAL VERIFICATION OF BEAM PENETRATIONS SHOWN ON STRUCTURAL DRAWINGS AND ADVISE OF ANY POTENTIAL INTERFERENCES.

4

5

Autodesk Docs/75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD\_Rowland ES MEP\_2022.rvt 10/21/2022 4:43:03 PM



Rowland Elementary School COVINA VALLEY USD 1355 E ROWLAND AVE. WEST COVINA, CA 91790


100% CONSTRUCTION DOCUMENTS 11/08/2022 REVISIONS

75-22605-00

MECHANICAL SCHEDULES


M8.1



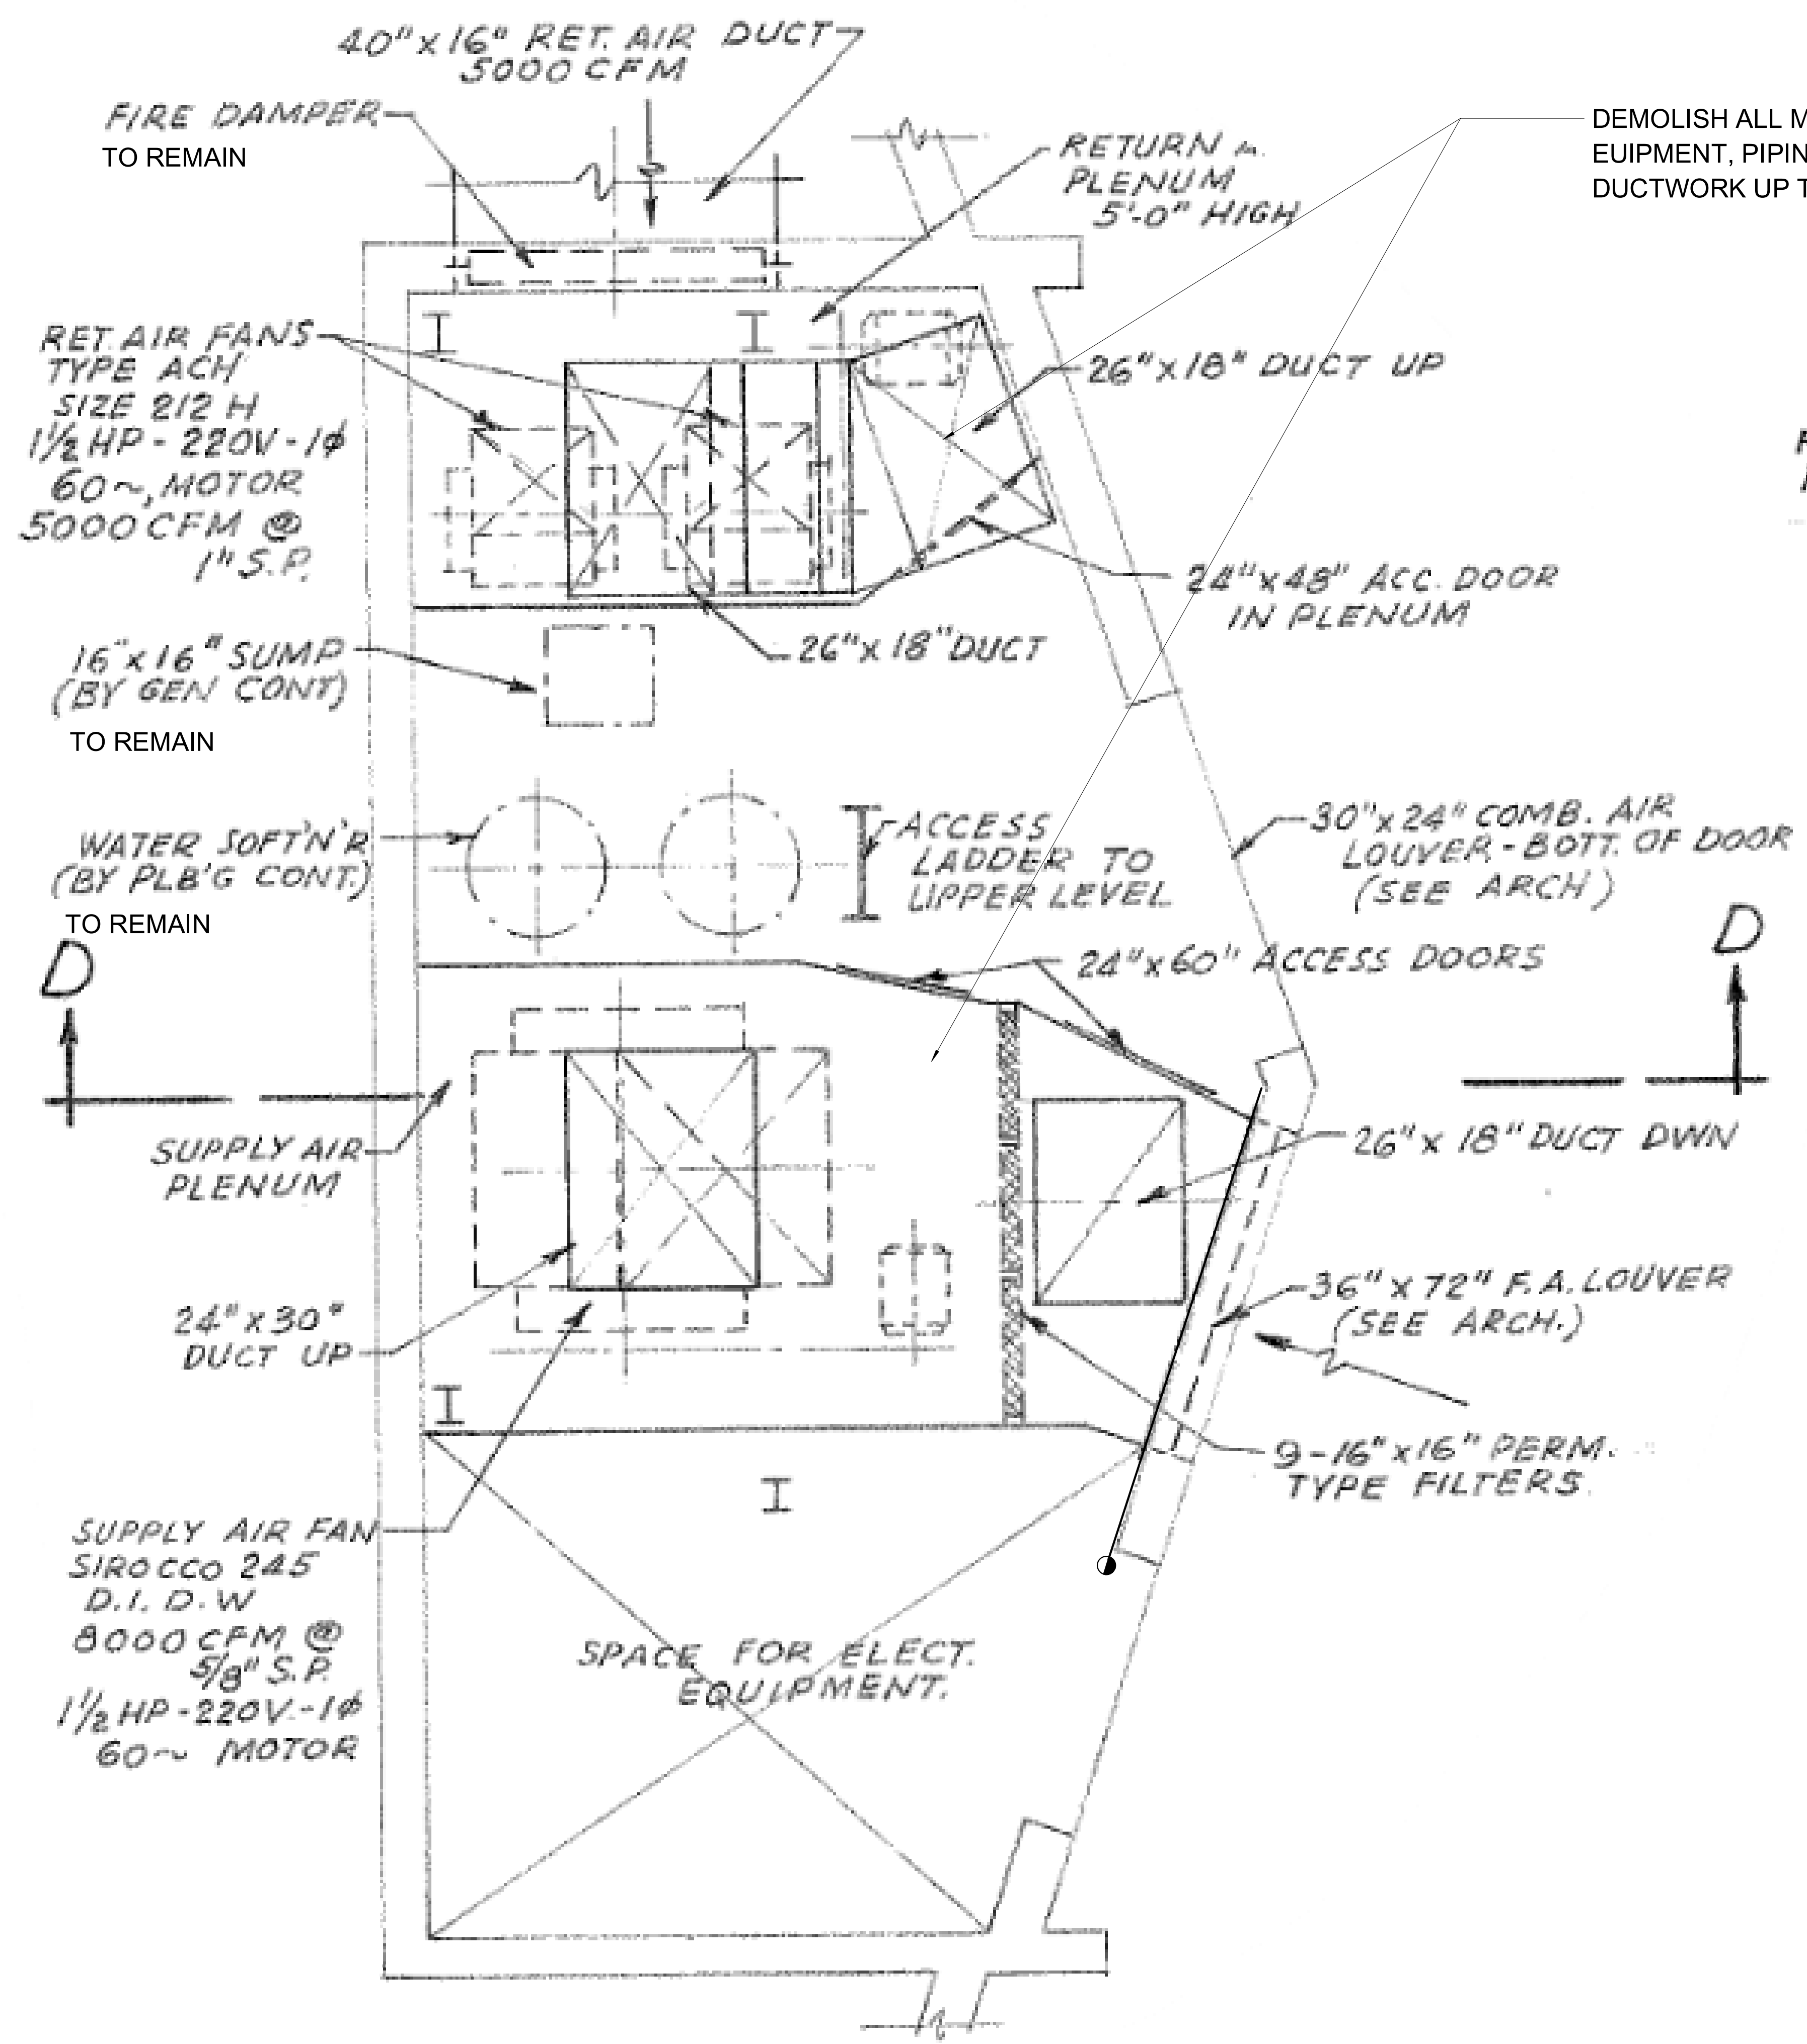

DEMOLISH ALL MECHANICAL EQUIPMENT, PIPING, AND DUCTWORK UP TO POD.


1 HEATER ROOM LOWER LEVEL  
MD1.1 SCALE: 1/4" = 1'-0"

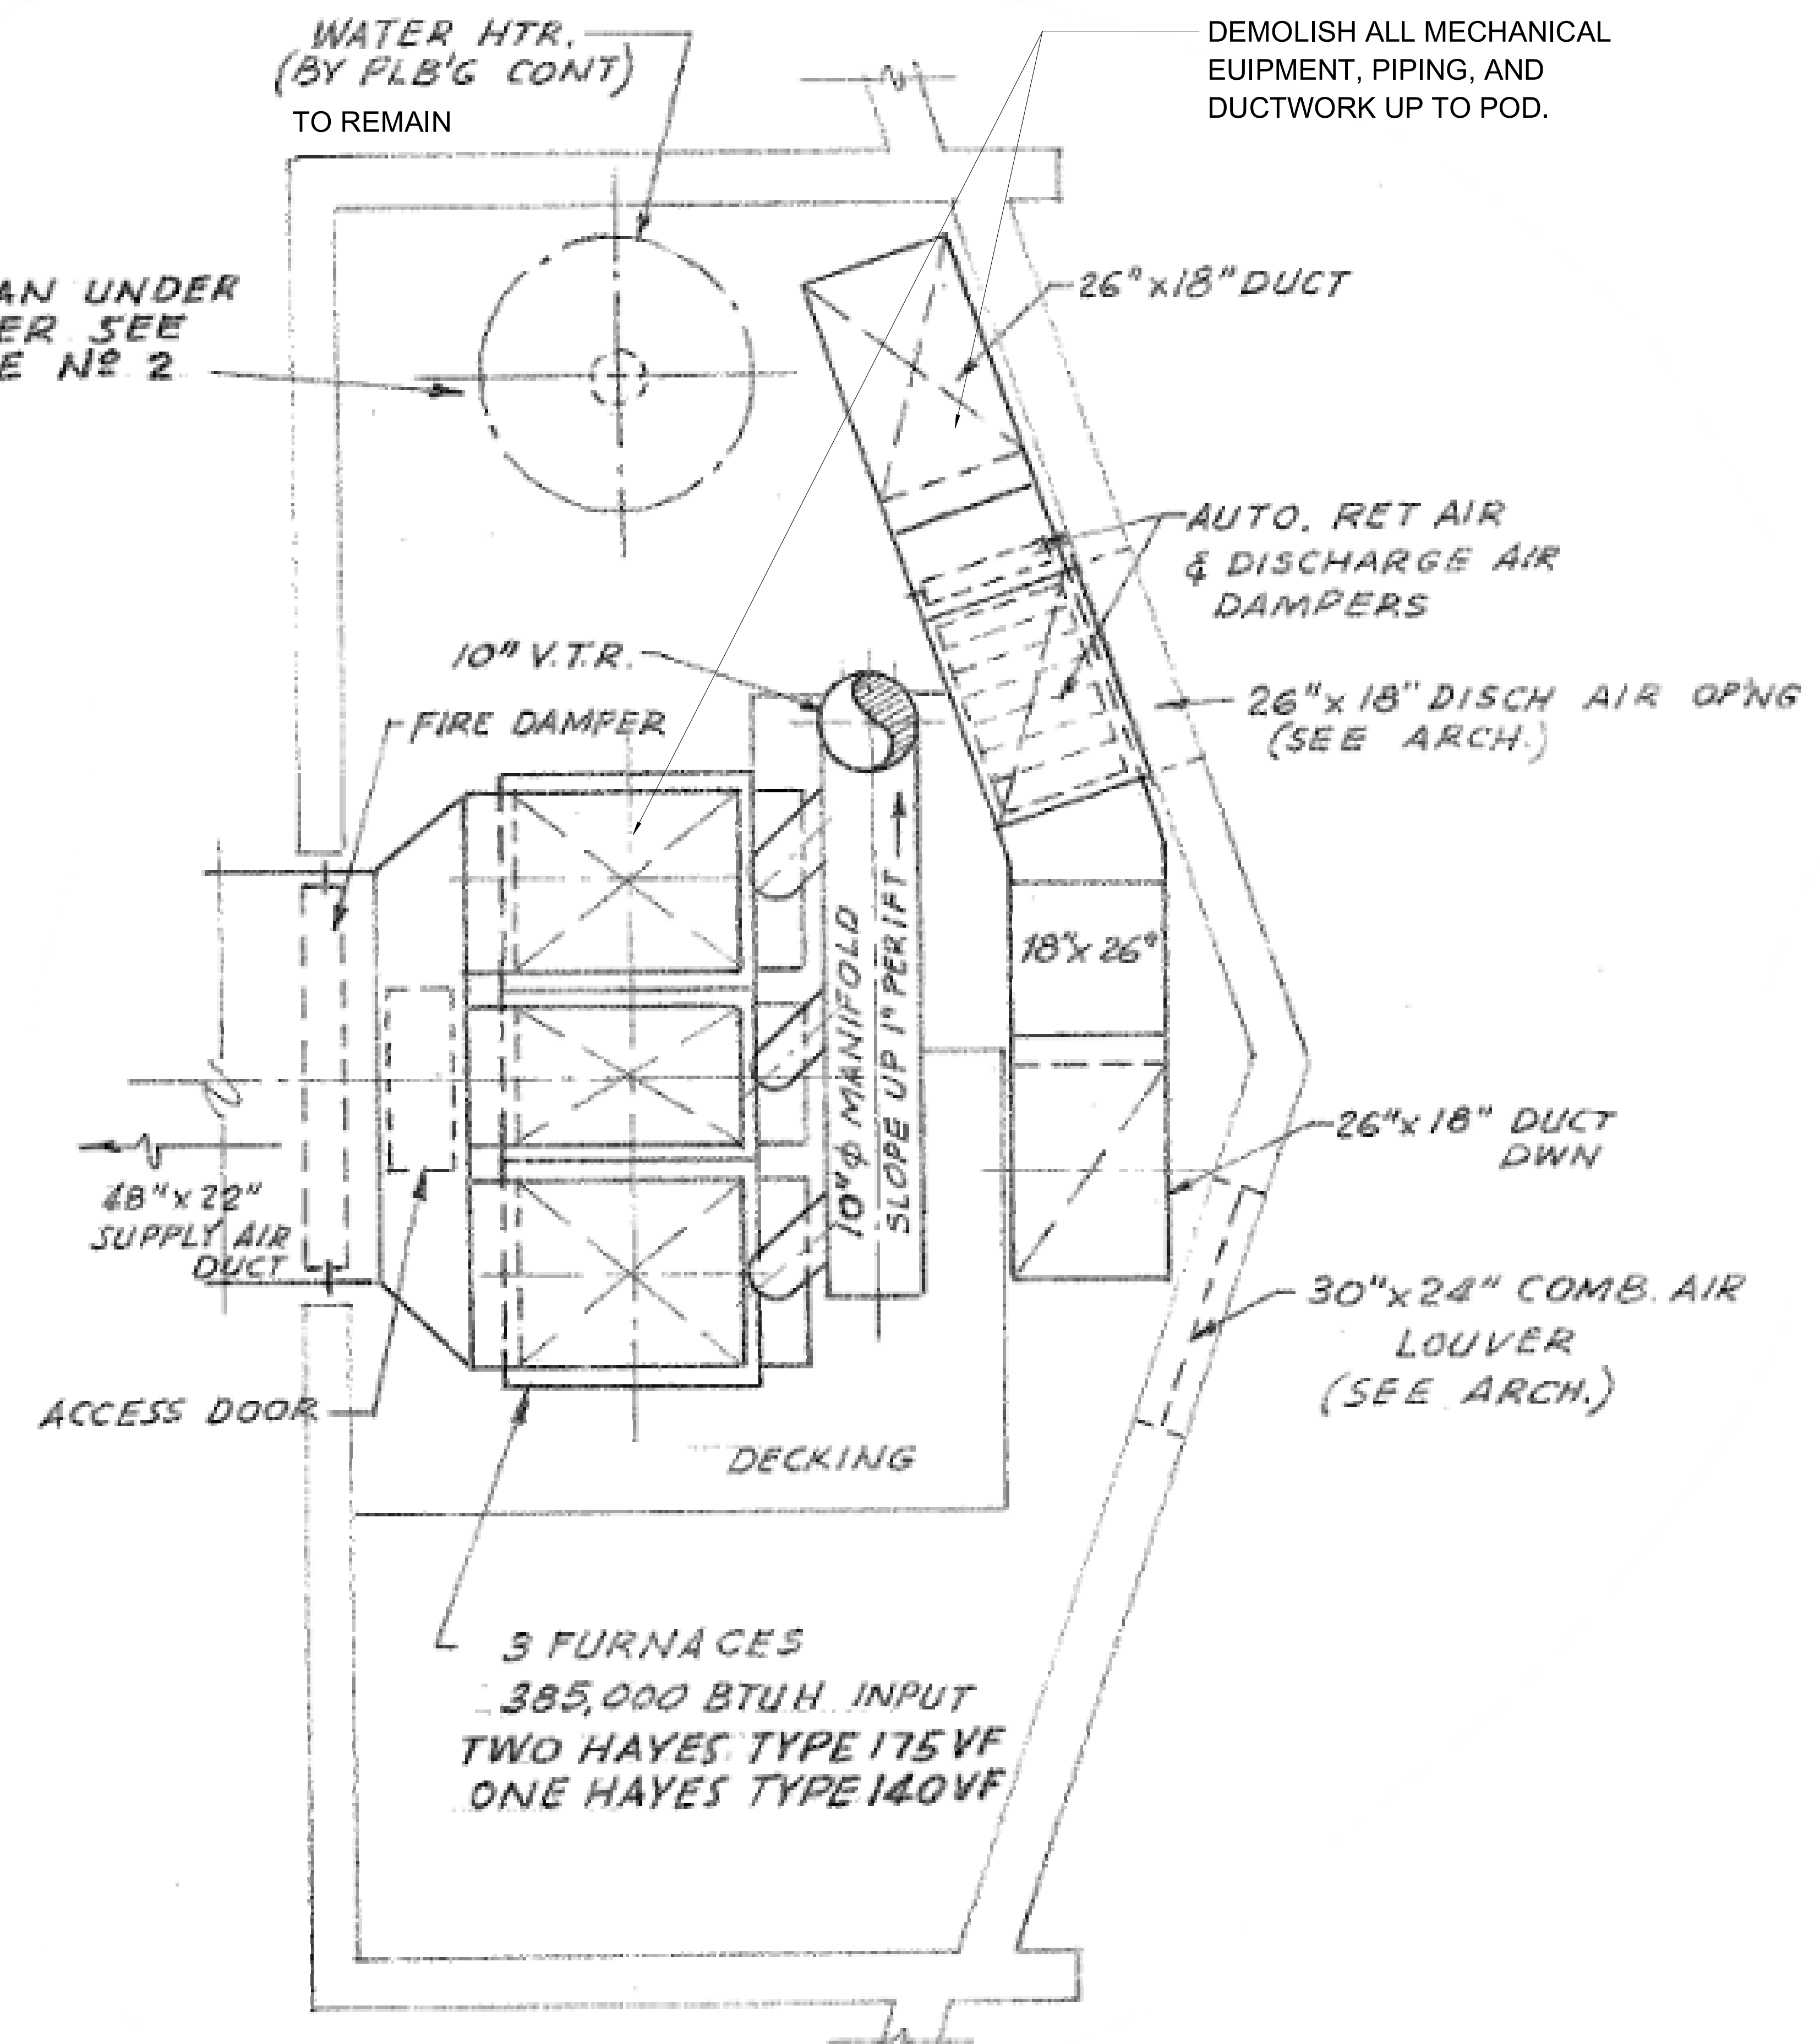

DEMOLISH ALL MECHANICAL EQUIPMENT, PIPING, AND DUCTWORK UP TO POD.

2 HEATER ROOM UPPER LEVEL  
MD1.1 SCALE: 1/4" = 1'-0"



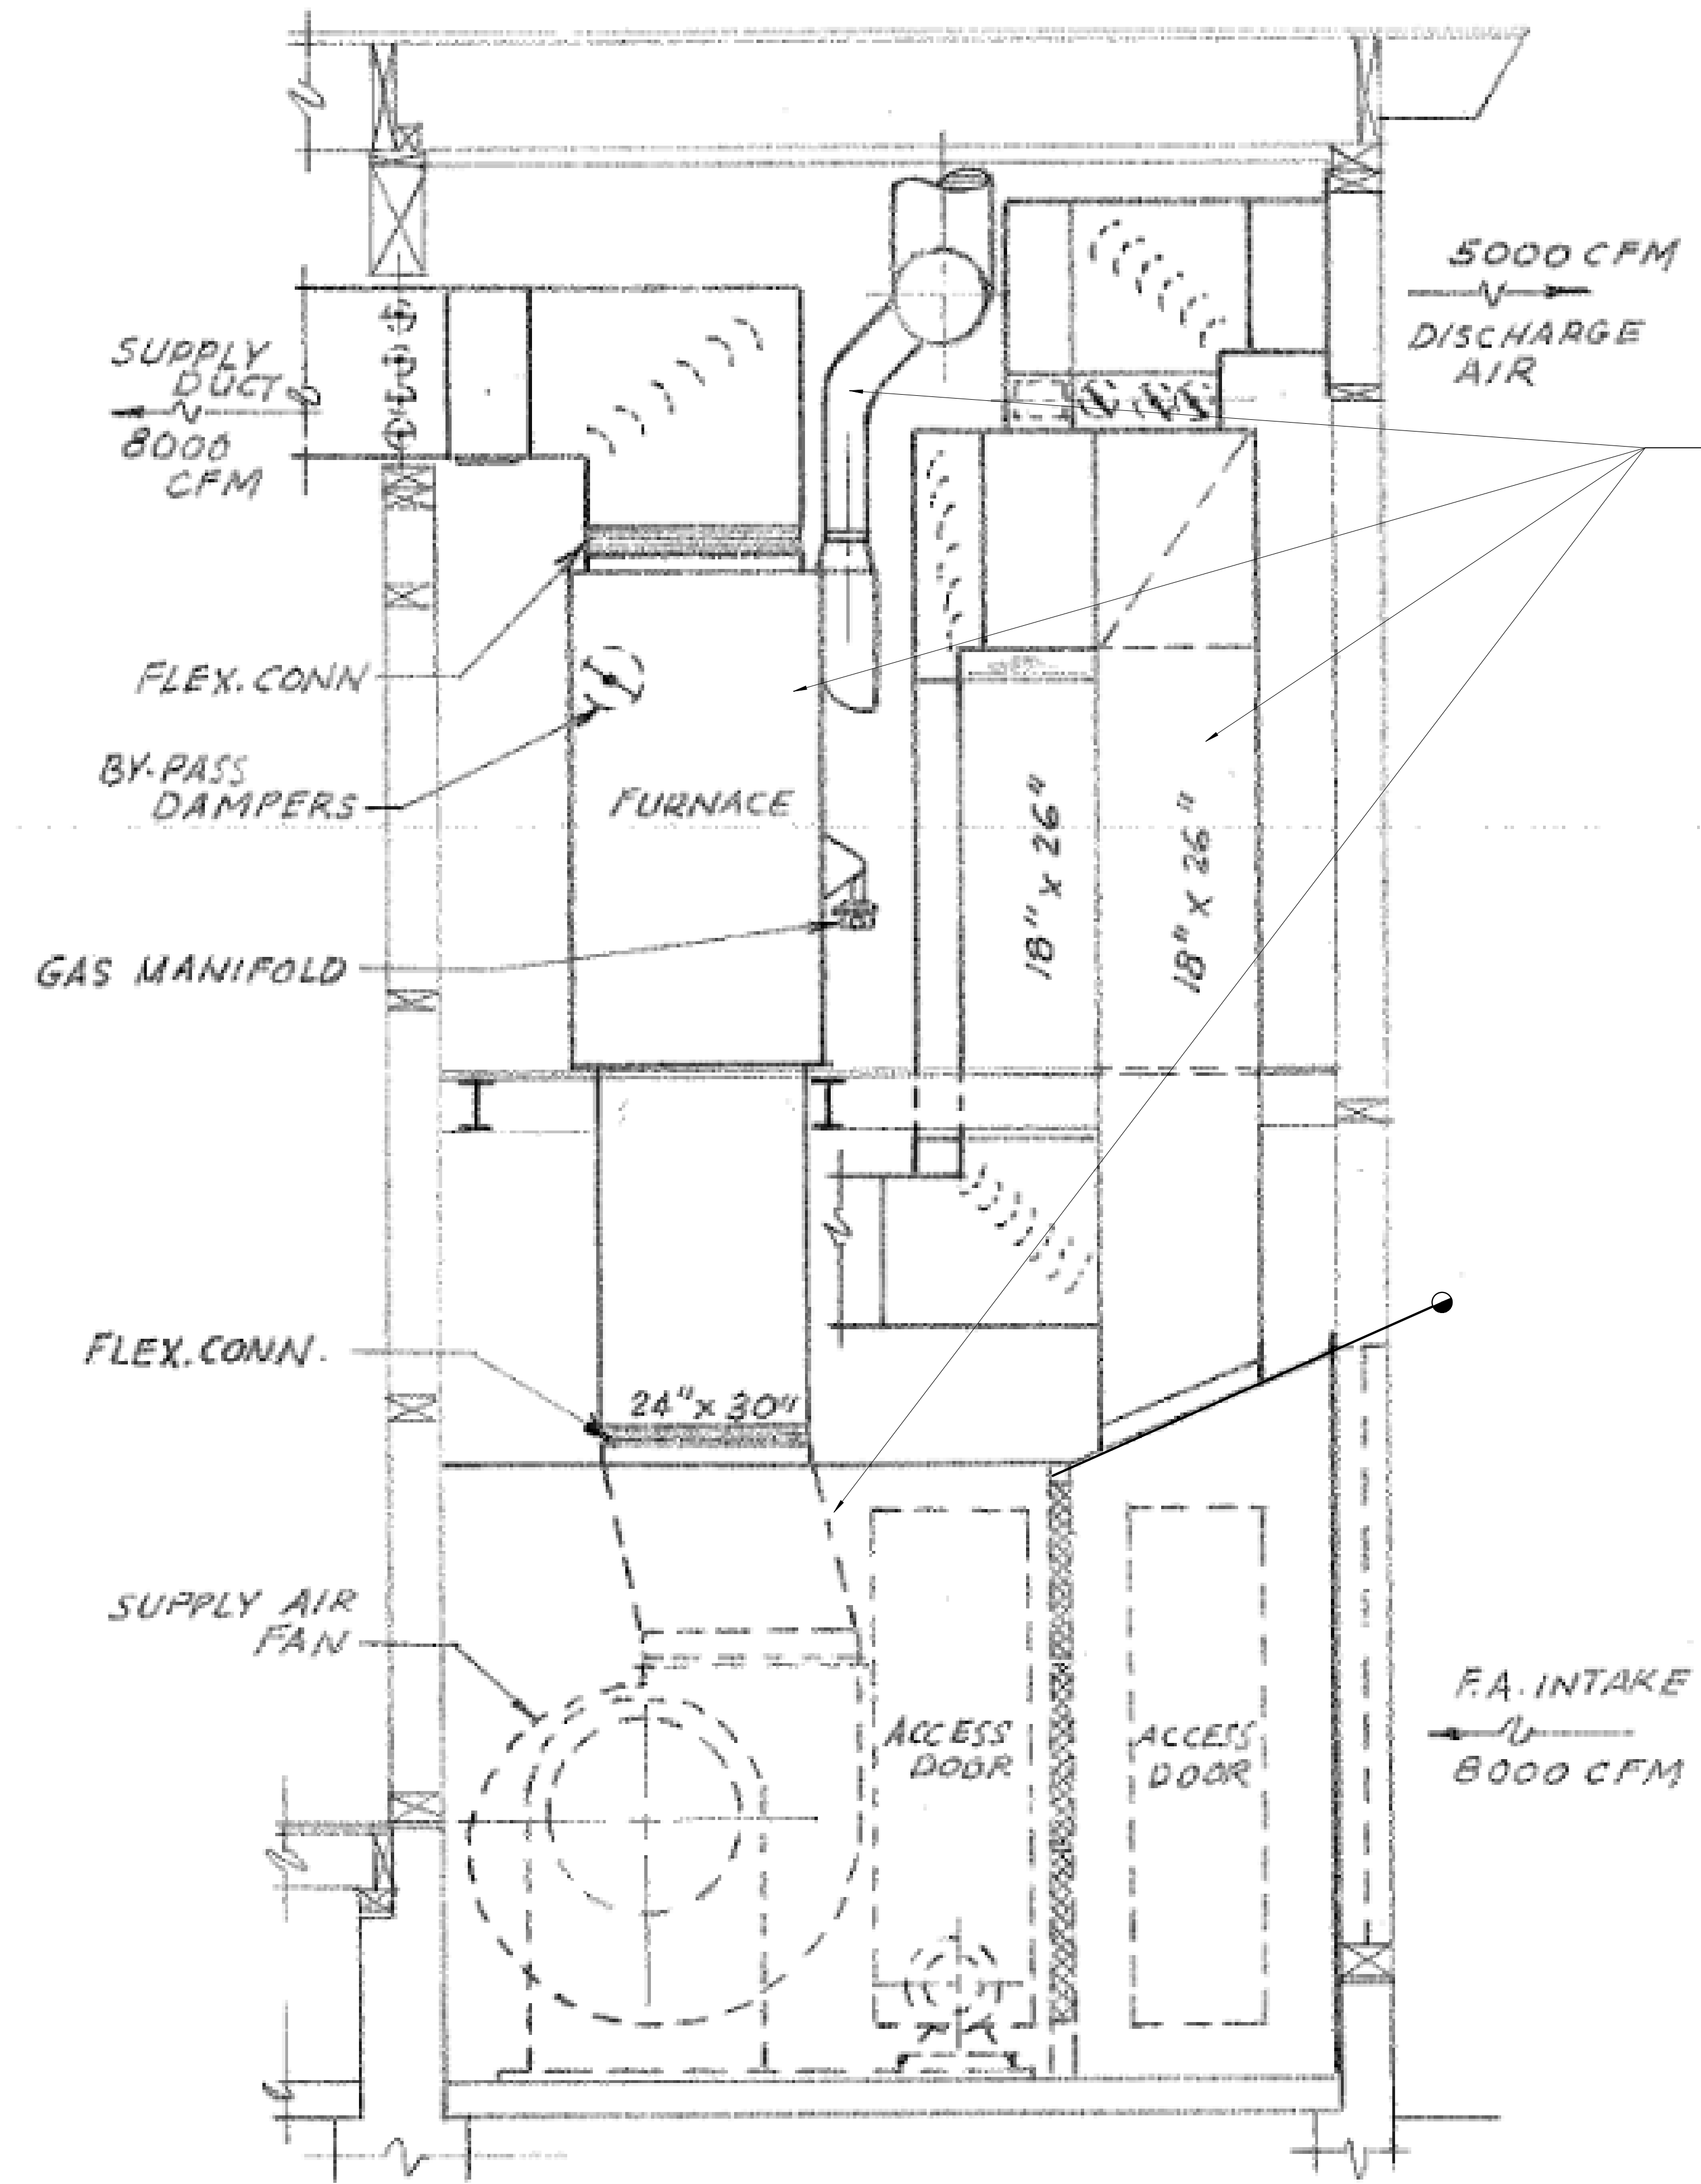


DEMOLISH ALL MECHANICAL  
EQUIPMENT, PIPING, AND  
DUCTWORK UP TO POD.

1 HEATER ROOM SECTION "D-D"  
MD1.2 SCALE: 1/4" = 1'-0"







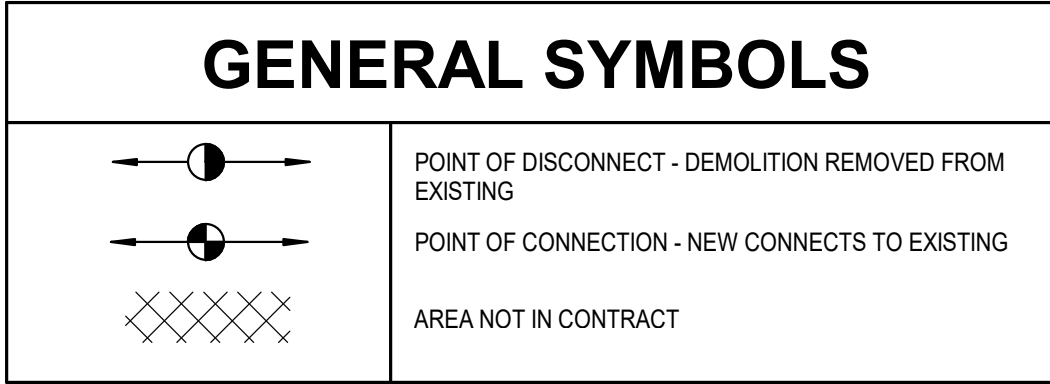

#### GENERAL NOTES

- PENETRATIONS IN WALLS REQUIRING PROTECTED OPENINGS MUST BE FIRESTOPPED WITH AN APPROVED MATERIAL.
- UNLESS SPECIFICALLY SHOWN ON THESE DRAWINGS, NO STRUCTURAL MEMBER SHALL BE CUT, DRILLED, OR NOTCHED WITHOUT PRIOR AUTHORIZATION IN WRITING BY THE STRUCTURAL ENGINEER OF RECORD AND DSA.

#### SHEET INDEX

E0.1	ELECTRICAL SYMBOLS, ABBREVIATIONS & NOTES
E2.1	ROOF ELECTRICAL PLAN
E2.2	REFERENCE DRAWING
E5.1	ELECTRICAL DIAGRAMS AND SCHEDULE
E6.1	ELECTRICAL DETAILS

APPLICABLE CODE: 2019 CBC 02/02/2020 REVISED: 02/14/2020

#### MEP COMPONENT ANCHORAGE NOTE

- ALL MECHANICAL, PLUMBING, AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE DSA-APPROVED CONSTRUCTION DOCUMENTS. THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACED TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2019 CBC SECTIONS 1617A.1.18 THROUGH 1617A.1.26 AND ASCE 7-16 CHAPTERS 13, 26, AND 30:
- ALL PERMANENT EQUIPMENT AND COMPONENTS.
  - TEMPORARY, MOVABLE OR MOBILE EQUIPMENT THAT IS PERMANENTLY ATTACHED (E.G. HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER. "PERMANENTLY ATTACHED" SHALL INCLUDE ALL ELECTRICAL CONNECTIONS EXCEPT PLUGS FOR 110V/220 VOLT RECEPTACLES HAVING A FLEXIBLE CABLE.
  - TEMPORARY, MOVABLE OR MOBILE EQUIPMENT WHICH IS HEAVIER THAN 400 POUNDS OR HAS A CENTER OF MASS LOCATED 4 FEET OR MORE ABOVE THE ADJACENT FLOOR OR ROOF LEVEL, THAT DIRECTLY SUPPORT THE COMPONENT IS REQUIRED TO BE RESTRAINED IN A MANNER APPROVED BY DSA.

THE FOLLOWING MECHANICAL AND ELECTRICAL COMPONENTS SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE BUT NEED NOT DEMONSTRATE DESIGN COMPLIANCE WITH THE REFERENCES NOTED ABOVE. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING, AND CONDUIT. FLEXIBLE CONNECTIONS MUST ALLOW MOVEMENT IN BOTH TRANSVERSE AND LONGITUDINAL DIRECTIONS:

- COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVING A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.
- COMPONENTS WEIGHING LESS THAN 20 POUNDS, OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

THE ANCHORAGE OF ALL MECHANICAL, ELECTRICAL AND PLUMBING COMPONENTS SHALL BE SUBJECT TO THE APPROVAL OF THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR STRUCTURAL ENGINEER DELEGATED RESPONSIBILITY AND ACCEPTANCE BY DSA. THE PROJECT INSPECTOR WILL VERIFY THAT ALL COMPONENTS AND EQUIPMENT HAVE BEEN ANCHORED IN ACCORDANCE WITH THE ABOVE REQUIREMENTS.

#### PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE BRACED TO COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-16 SECTION 13.3 AS DEFINED IN ASCE 7-16 SECTIONS 13.6.5, 13.6.6, 13.6.7, 13.6.8, AND 2019 CBC, SECTIONS 1617A.1.24, 1617A.1.25 AND 1617A.1.26.

THE METHOD OF SHOWING BRACING AND ATTACHMENTS TO THE STRUCTURE FOR THE IDENTIFIED DISTRIBUTION SYSTEM ARE AS NOTED BELOW. WHEN BRACING AND ATTACHMENTS ARE BASED ON A PREAPPROVED INSTALLATION GUIDE (E.G., OSHPD OPM FOR 2013 CBC OR LATER), COPIES OF THE BRACING SYSTEM INSTALLATION GUIDE OR MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO THE START OF AND DURING THE HANGING AND BRACING OF THE DISTRIBUTION SYSTEMS. THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

MECHANICAL PIPING (MP), MECHANICAL DUCTS (MD), PLUMBING PIPING (PP), ELECTRICAL DISTRIBUTION SYSTEMS (E):

MP	MD	PP	E	OPTION 1: DETAILED ON THE APPROVED DRAWINGS WITH PROJECT SPECIFIC NOTES AND DETAILS.
MP	MD	PP	(E)	OPTION 2: SHALL COMPLY WITH THE APPLICABLE OSHPD PRE-APPROVAL (OPMM) # 00043-13

#### POWER


- CIRCUIT HOME RUN
- CONDUIT TURNING UP
- CONDUIT TURNING DOWN
- CONDUIT STUB-UP
- CONDUIT SLEEVE
- CONDUIT SEAL
- CONDUIT CONCEALED IN CEILING OR WALLS, POWER
- CONDUIT CONCEALED IN CEILING OR WALLS, OTHER (\*) = SEE ABBREVIATIONS)
- CONDUIT CONCEALED IN FLOOR OR UNDERGROUND, POWER
- CONDUIT CONCEALED IN FLOOR OR UNDERGROUND, OTHER (\*) = SEE ABBREVIATIONS)
- EXPOSED CONDUIT, POWER
- EXPOSED CONDUIT, OTHER (\*) = SEE ABBREVIATIONS)
- FIRE RATED SLEEVE
- TRANSFORMER
- BRANCH CIRCUIT PANELBOARD MOUNT 72-INCHES TO TOP
- DISTRIBUTION PANELBOARD MOUNT 72-INCHES TO TOP
- EQUIPMENT CABINET, AS NOTED
- SWITCHBOARD
- MOTOR STARTER OR DRIVE
- DISCONNECT SWITCH
- COMBINATION STARTER / DISCONNECT SWITCH
- CURRENT TRANSFORMER ENCLOSURE
- METER
- GENERATOR
- AUTOMATIC TRANSFER SWITCH
- SYSTEM GROUND ELECTRODE
- THERMOSTAT
- MUSHROOM SWITCH
- ELECTRICAL MANHOLE
- ELECTRICAL HAND HOLE
- MOTOR CONNECTION, HORSEPOWER AS INDICATED
- FUSE AND SWITCH ASSEMBLY
- MANUAL CONTROLLER WITH THERMAL OVERLOAD
- MANUAL CONTROLLER W/O THERMAL OVERLOAD
- CIRCUIT BREAKER ENCLOSURE
- PULL BOX
- EQUIPMENT CONNECTION
- CABLE TRAY, LADDER TYPE OR RUNWAY
- CABLE TRAY
- MULTI-OUTLET ASSEMBLIES MOUNT 18-INCHES AFF, UNO WHERE DENOTED 'AC', MOUNT ABOVE COUNTER
- DIVIDED SURFACE RACEWAY MOUNT 18-INCHES AFF, UNO WHERE DENOTED 'AC', MOUNT ABOVE COUNTER
- PUSHBUTTON STATION: MOUNT 42-INCHES AFF UNO
  - SWITCH, PUSH BUTTON, SINGLE
  - SWITCH, PUSH BUTTON, DOUBLE
  - SWITCH, PUSH BUTTON, TRIPLE

- RECEPTACLES: MOUNT 18-INCHES AFF, UNO
- DIAGONAL LINE THROUGH SYMBOL OR DENOTED 'AC' INDICATES MOUNT DEVICE ABOVE COUNTER. WHERE INDICATED AS 'MOUNT ABOVE COUNTER' MOUNT BOTTOM OF BOX 2-INCHES ABOVE TOP OF BACKSPLASH OR 6-INCHES ABOVE COUNTERTOP IF NO BACKSPLASH EXISTS.
- LABELS SHALL BE MACHINE PRINTED, UNO
- SIMPLEX RECEPTACLE
- DUPLEX RECEPTACLE
- DUPLEX RECEPTACLE, GFI TYPE
- DUPLEX RECEPTACLE, MOUNT ABOVE COUNTER
- DUPLEX RECEPTACLE, GFI TYPE, MOUNT ABOVE COUNTER
- FOURPLEX RECEPTACLE
- FOURPLEX RECEPTACLE, GFI TYPE
- FOURPLEX RECEPTACLE, MOUNT ABOVE COUNTER
- FOURPLEX RECEPTACLE, GFI TYPE, MOUNT ABOVE COUNTER
- DUPLEX RECEPTACLE, FLUSH IN CEILING
- FOURPLEX RECEPTACLE, FLUSH IN CEILING
- DUPLEX RECEPTACLE, HORIZONTALLY MOUNTED
- DUPLEX RECEPTACLE, HORIZ. MTD. GFI TYPE
- DUPLEX RECEPTACLE, HORIZ. MTD. ABOVE COUNTER
- DUPLEX RECEPTACLE, HORIZ. MTD. GFI TYPE, MOUNT ABOVE COUNTER
- WEATHER RESISTANT GFI DUPLEX RECEPTACLE, ROOF MOUNT 18-INCHES ABOVE ADJACENT STRUCTURE WITH A WEATHERPROOF, IN-USE COVER
- WEATHER RESISTANT GFI DUPLEX RECEPTACLE, MOUNT 18-INCHES AFF WITH A WEATHERPROOF, IN-USE COVER
- STD DUPLEX RECEPTACLE TO SERVE ELECTRIC WATER COOLER, MOUNT AT HEIGHT PER EWC EQUIPMENT MANUFACTURER'S INSTALLATION GUIDELINES. WIRE TO GFCI BREAKER IN PANELBOARD.
- DUPLEX RECEPTACLE TO SERVE TELEVISION, MOUNT AT SAME HEIGHT AND WITHIN 8-INCHES OF ADJACENT TV OUTLET
- DUPLEX RECEPTACLE, EMERGENCY
- FOURPLEX RECEPTACLE, EMERGENCY
- DUPLEX RECEPTACLE, LOWER SWITCH
- DUPLEX RECEPTACLE, SWITCHED
- RANGE RECEPTACLE, MOUNT 8-INCHES AFF
- SPECIAL RECEPTACLE, DEEP WELL BOX
- FLUSH FLOOR OUTLET BOX UNO
- FLUSH FLOOR BOX WITH DUPLEX RECEPTACLE UNO
- MULTI-DEVICE FLOOR BOX WITH DUPLEX RECEPTACLE AND TELECOMMUNICATIONS OUTLETS
- USB ONLY RECEPTACLE RECEPTACLE WITH USB PORTS
- FLUSH JUNCTION BOX, CEILING MOUNTED
- JUNCTION BOX FOR FUTURE PROJECTOR POWER MOUNT 24-INCHES ABOVE SUSPENDED CEILING MOUNT TIGHT TO CEILING AT EXPOSED STRUCTURE LABEL BOX COVER 'PROJECTOR POWER'
- JUNCTION BOX ABOVE SUSPENDED CEILING WITH FLEX CONNECTION
- FLUSH JUNCTION BOX, WALL MOUNTED
- SURFACE JUNCTION BOX, WALL MOUNTED
- SURFACE JUNCTION BOX, CEILING MOUNTED
- HAND DRYER, INSTALL HAND DRYER SPECIFIED IN DIV. 11

#### ABBREVIATIONS

(D)	DEMOLISHED
(E)	EXISTING
(R)	RELOCATED
Ø	PHASE
A	AMPERE
AC	ABOVE COUNTER
AF	AMP FRAME (CIRCUIT BREAKER)
AC	AMPERE INTERRUPTING CAPACITY
AL	ALUMINUM
AMP	AMPERE
AP	WIRELESS ACCESS POINT
AT	AMP TRIP (CIRCUIT BREAKER OR FUSE)
ATS	AUTOMATIC TRANSFER SWITCH
AV	AUDIO-VISUAL
AWG	AMERICAN WIRE GAUGE
BAS	BUILDING AUTOMATION SYSTEM
BJ	BONDING JUMPER
BKR	BREAKER
BMS	BUILDING MANAGEMENT SYSTEM
C	CONDUIT
CATV	CABLE TELEVISION
CB	CIRCUIT BREAKER
CCTV	CLOSED CIRCUIT TELEVISION
CFCI	CONTRACTOR FURNISHED CONTRACTOR INSTALLED
CKT	CIRCUIT
CTL	CONTROL
CU	COPPER
DB	DECIBEL
DC	DIRECT CURRENT
DISC	DISCONNECT
DP	DISTRIBUTION PANELBOARD
DW	DISHWASHER
EC5	EMERGENCY COMMUNICATION SYSTEM
EGS	ELECTRICAL GROUNDING BUSBAR
EMD	ESTIMATED MAXIMUM DEMAND
EMGB	ELECTRICAL MAIN GROUNDING BUSBAR
EP	EXPLOSION PROOF
ER	EXISTING TO BE RELOCATED
ERMS	ENERGY REDUCTION MAINTENANCE SWITCH
EWC	ELECTRIC WATER COOLER
FA	FIRE ALARM
FAA	FIRE ALARM ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
FC	FOOT CANDLE
FLA	FULL LOAD AMPS
FS	FLOW SWITCH
FSD	FIRE SMOKE DAMPER
G	EQUIPMENT GROUNDING CONDUCTOR
GEN	GENERATOR
GFI, GFCI	GROUND FAULT CIRCUIT INTERRUPTER
GFFE	GROUND FAULT PROTECTION OF EQUIPMENT
GND	EQUIPMENT GROUNDING CONDUCTOR
HH	HANDHOLE
HDA	HAND-OFF-AUTOMATIC
HP	HORSE POWER
IC	INTERCOM
IG	ISOLATED GROUND
JB	JUNCTION BOX
KAIC	THOUSAND AMPERE INTERRUPTING CIRCUIT
KV	KILOVOLT
KVA	KILOVOLT AMPERES
KW	KILOWATT
LT	LIGHT
LTG	LIGHTING
MCA	MINIMUM CIRCUIT AMPACITY
MCB	MAIN CIRCUIT BREAKER
MCC	MOTOR CONTROL CENTER
MH	MANHOLE
MLO	MAIN LUGS ONLY
MOCP	MAXIMUM OVERCURRENT PROTECTION
MRTS	MOTOR RATED TOGGLE SWITCH
MSB	MAIN SWITCHBOARD
MTD	MOUNTED
MTG	MOUNTING
MTS	MAIN TRANSFER SWITCH
N	NEUTRAL
N.C.	NORMALLY CLOSED
N.O.	NORMALLY OPEN
NF	NON-FUSED
NL	NIGHT LIGHT
OFCI	OWNER FURNISHED CONTRACTOR INSTALLED
OSAY	OUTSIDE SCREW AND YOKE
P	POLE(S)
PA	PUBLIC ADDRESS
PB	PULL BOX
PH	PHASE
PV	POST INDICATOR VALVE
PNL	PANEL
PWR	POWER
RCP	REFLECTED CEILING PLAN
RECP	RECEPTACLE
REF	REFERENCE
RESP	RESPONSIVE
SCCR	SHORT CIRCUIT CURRENT RATING
SD	SMOKE DAMPER
SEC	SECONDARY
SFD	SURGE PROTECTION DEVICE
SWBD	SWITCHBOARD
TBB	TELECOMMUNICATIONS BONDING BACKBONE
TD	TIME CLOCK
TGB	TELECOMMUNICATIONS GROUNDING BUSBAR
TMGB	TELECOMMUNICATIONS MAIN GROUNDING BUSBAR
TO	TELECOMMUNICATIONS OUTLET
TR	TELECOMMUNICATIONS ROOM
TS	TAMPER SWITCH
TV	TELEVISION
UG	UNDERGROUND
UPS	UNINTERRUPTABLE POWER SUPPLY
V	VOLT
VA	VOLT-AMPERE
VFD	VARIABLE FREQUENCY DRIVE
W	WIRE
WA	TELECOMMUNICATIONS WORK AREA
WG	WIRE GUARD
WP	WEATHER-PROOF (NEMA 3R)
XFMR	TRANSFORMER

\*NOTE:  
ALL NOTES ON THIS SHEET ARE APPLICABLE TO ALL OTHER SHEETS IN THIS SET.  
THE SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE APPLICABLE IN THIS SET OF DRAWINGS.

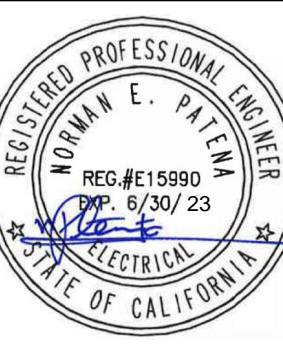

Rowland Elementary School  
COVINA VALLEY USD  
1855 E ROWLAND AVE, WEST COVINA, CA 91790

100% CONSTRUCTION DOCUMENTS  
11/08/2022 REVISIONS

75-22605-00

ELECTRICAL SYMBOLS, ABBREVIATIONS & NOTES


E0.1



**GENERAL NOTES**

- A WORK TO INCLUDE REMOVAL OF EXISTING FEEDER TO EXISTING HVAC EQUIPMENT THAT ARE TO BE REMOVED AND REPLACED. FEEDER TO EXISTING INDOOR FAN COIL UNIT TO BE REMOVED IN ITS ENTIRETY.
- B DISCONNECTING MEANS TO BE NEMA 3R RATED, FURNISHED AND INSTALLED BY DIVISION 26.
- C CARBON MONOXIDE DETECTION SYSTEM NOT REQUIRED. ELECTRIC HEATING IS BEING PROVIDED.
- D SEE SCHEDULE ON SHEET ES.1 FOR ADDITIONAL INFORMATION.
- E FUSES SHALL BE PROVIDED PER EQUIPMENT NAMEPLATE RATING.
- F ELECTRICAL PANELS LOCATED AT GRADE LEVEL DIRECTLY BELOW WHERE SHOWN.
- G ENERGY MANAGEMENT SYSTEM (EMS) / BUILDING AUTOMATION SYSTEM (BAS) IS A DELEGATED DESIGN SCOPE BY CONTRACTOR. CONTRACTOR TO FIELD COORDINATE WITH SCHOOL DISTRICT FOR LOCATIONS OF EMS ROUTER AND EMS PANEL AS WELL AS CONDUIT ROUTING.
- H CARBON MONOXIDE DETECTION SYSTEM WILL NOT BE PROVIDED AT THIS TIME UNDER CSBC 903.15.1. EXCEPTION 2: THE GROUP BUILDING WAS CONSTRUCTED BEFORE THE ADOPTION OF THE 2016 CALIFORNIA BUILDING STANDARDS CODE. EXISTING HVAC UNITS ARE BEING REPLACED IN KIND THROUGHOUT.
- J CONTRACTOR TO PROVIDE CONNECTION FROM LOAD SIDE OF HVAC EQUIPMENT DISCONNECT SWITCH TO FEED POWER EXHAUST DISCONNECT SWITCH. PROVIDE SAME SIZE FEEDER. PROVIDE FUSES PER EQUIPMENT NAMEPLATE RATING.

KEYNOTES	
No.	DESCRIPTION
1	EXISTING HVAC EQUIPMENT AT GRADE TO BE DISCONNECTED AND REPLACED AS PART OF THIS SCOPE OF WORK WITH ROOF TOP EQUIPMENT. EXTEND EXISTING FEEDER AS REQUIRED. SEE TABLE ON SHEET ES.1 FOR OTHER INFORMATION. PROVIDE ALL REQUIRED CONNECTION.
2	EXISTING HVAC EQUIPMENT AT GRADE TO BE DISCONNECTED AND REPLACED AS PART OF THIS SCOPE OF WORK. PROVIDE NEW FEEDER PER TABLE ON SHEET ES.1. PROVIDE ALL REQUIRED CONNECTION.
3	NEW HVAC EQUIPMENT AT GRADE. PROVIDE NEW FEEDER PER TABLE ON SHEET ES.1. PROVIDE ALL REQUIRED CONNECTION.
4	DUCT SMOKE DETECTOR FOR COMPLIANCE TO CALIFORNIA MECHANICAL CODE SECTION 608 IS NOT REQUIRED PER CODE EXCEPTION NO.2. ROOM HAVE DIRECT EXIT TO EXTERIOR AND TRAVEL DISTANCE DOES NOT EXCEED 100 FEET.
5	EXISTING ELECTRICAL EQUIPMENT TO REMAIN AND TO BE PROTECTED IN PLACE.
6	PROVIDE GFCI OUTLET WITH WEATHERPROOF-IN USE COVER
7	(N) PANELBOARD B, 277/480 VOLTS, 3-PHASE, W-WIRE, 225 AMP BUS AT GRADE LEVEL.
8	GFCI TYPE RECEPTACLE PROVIDED BY HVAC EQUIPMENT MANUFACTURER. SEE TABLE PROVIDED ON SHEET ES.1. GENERAL NOTE NO.2 FOR CIRCUITING OF OUTLETS. PROVIDE WEATHERPROOF COVER.
9	FUSED DISCONNECT SIZE PER TABLE SHOWN ON ES.1.
10	PROVIDE 120V CIRCUIT FOR EMS ROUTER AND EMS PANEL. FIELD VERIFY EXACT LOCATION OF EMS ROUTER AND EMS PANEL.
11	JUNCTION BOX WITH TOGGLE TYPE DISCONNECT SWITCH FOR COMBINATION FIRE SMOKE DAMPER. PROVIDE REQUIRED CONNECTION TO EXISTING FIRE ALARM SYSTEM FOR CONTROL. SEE SHEET E2.2 FOR REFERENCE. PROVIDE ALL REQUIRED PARTS AND LABOR FOR A FULLY OPERATIONAL SYSTEM.

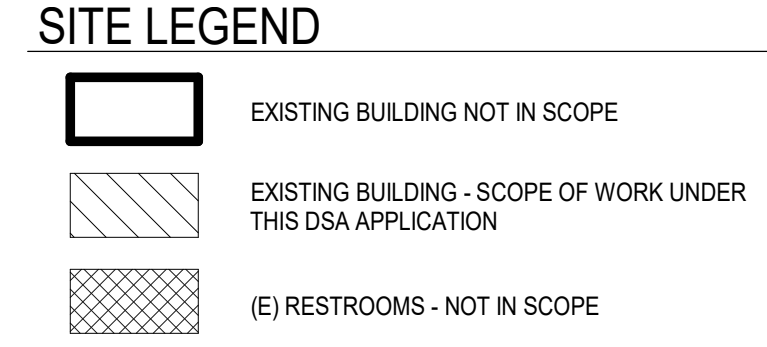

**OVERALL ELECTRICAL POWER PLAN**  
SCALE: 1/16" = 1'-0"



**Rowland Elementary School**  
COVINA VALLEY USD  
1855 E ROWLAND AVE, WEST COVINA, CA 91790

100% CONSTRUCTION DOCUMENTS  
11/08/2022 REVISIONS


75-22605-00  
ROOF ELECTRICAL PLAN

E2.1

Autodesk Docs/75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD\_Rowland ES MEP\_2022.rvt 8/29/2022 12:57:22 PM



PANEL: B														
LOCATION: MECHANICAL B113 BUS RATING: 225.0 A MAIN BREAKER: 225						VOLTS: 480Y/277 PHASES: 3 WIRES: 4 SCCR:			MOUNTING: SURFACE FED FROM: INTEGRAL SPD: Type 1 LUG ACCESSORIES: SEE ONE-LINE					
CKT	CIRCUIT DESCRIPTION	BKR TRIP	P	BKR TYPE	LOAD TYPE	PHASE A (VA)	PHASE B (VA)	PHASE C (VA)	LOAD TYPE	BKR TYPE	P	BKR TRIP	CIRCUIT DESCRIPTION	CKT
1	CU-B1A	30	3		M	6,374	6,374							2
3														4
5														6
7	CU-B1B	30	3		M	6,374	6,374							8
9														10
13														12
15	FCU-B1	30	3		M	5,265	5,265	6,374						14
17														16
19	PNL BP (MINI LOAD CTR)	15	2		R, M	100	0							18
21														20
23														22
25														24
27														26
29														28
30														30
TOTAL LOAD:						1813 VA	18013 VA	18013 VA						
TOTAL AMPS:						65.4 A	65.0 A	65.0 A						
LOAD TYPE	LOAD DESCRIPTION	CONNECTED LOAD (VA)	DEMAND (VA)	ESTIMATED DEMAND (VA)	DEMAND FACTOR NOTES	BKR TYPE		PANEL TOTALS						
L	LIGHTING	0 VA	0.00%	0 VA	CONTINUOUS LOAD @ 125%	G = GFCI (5mA)		CONNECTED LOAD: 54 KVA						
R	RECEPTACLES	0 VA	0.00%	0 VA	FIRST 10KVA @ 100%, REMAINDER @ 50%	GP = GFCI (30mA)		ESTIMATED DEMAND: 59 KVA						
K	KITCHEN	0 VA	0.00%	0 VA	NON-DWELLING KITCHEN LOADS, NEC ART. 220	ST = SHUNT TRIP		CONNECTED CURRENT: 65.1 A						
LM	LARGEST MOTOR	0 VA	0.00%	0 VA	LARGEST MOTOR, NEC ART. 430	LO = LOCK OUT		EMD CURRENT: 70.9 A						
M	MOTOR	54140 VA	108.63%	58921 VA										
C	COOLING	0 VA	0.00%	0 VA										
H	HEATING	0 VA	0.00%	0 VA										
O	OTHER	0 VA	0.00%	0 VA										
Spare	SPARE	0 VA	0.00%	0 VA										

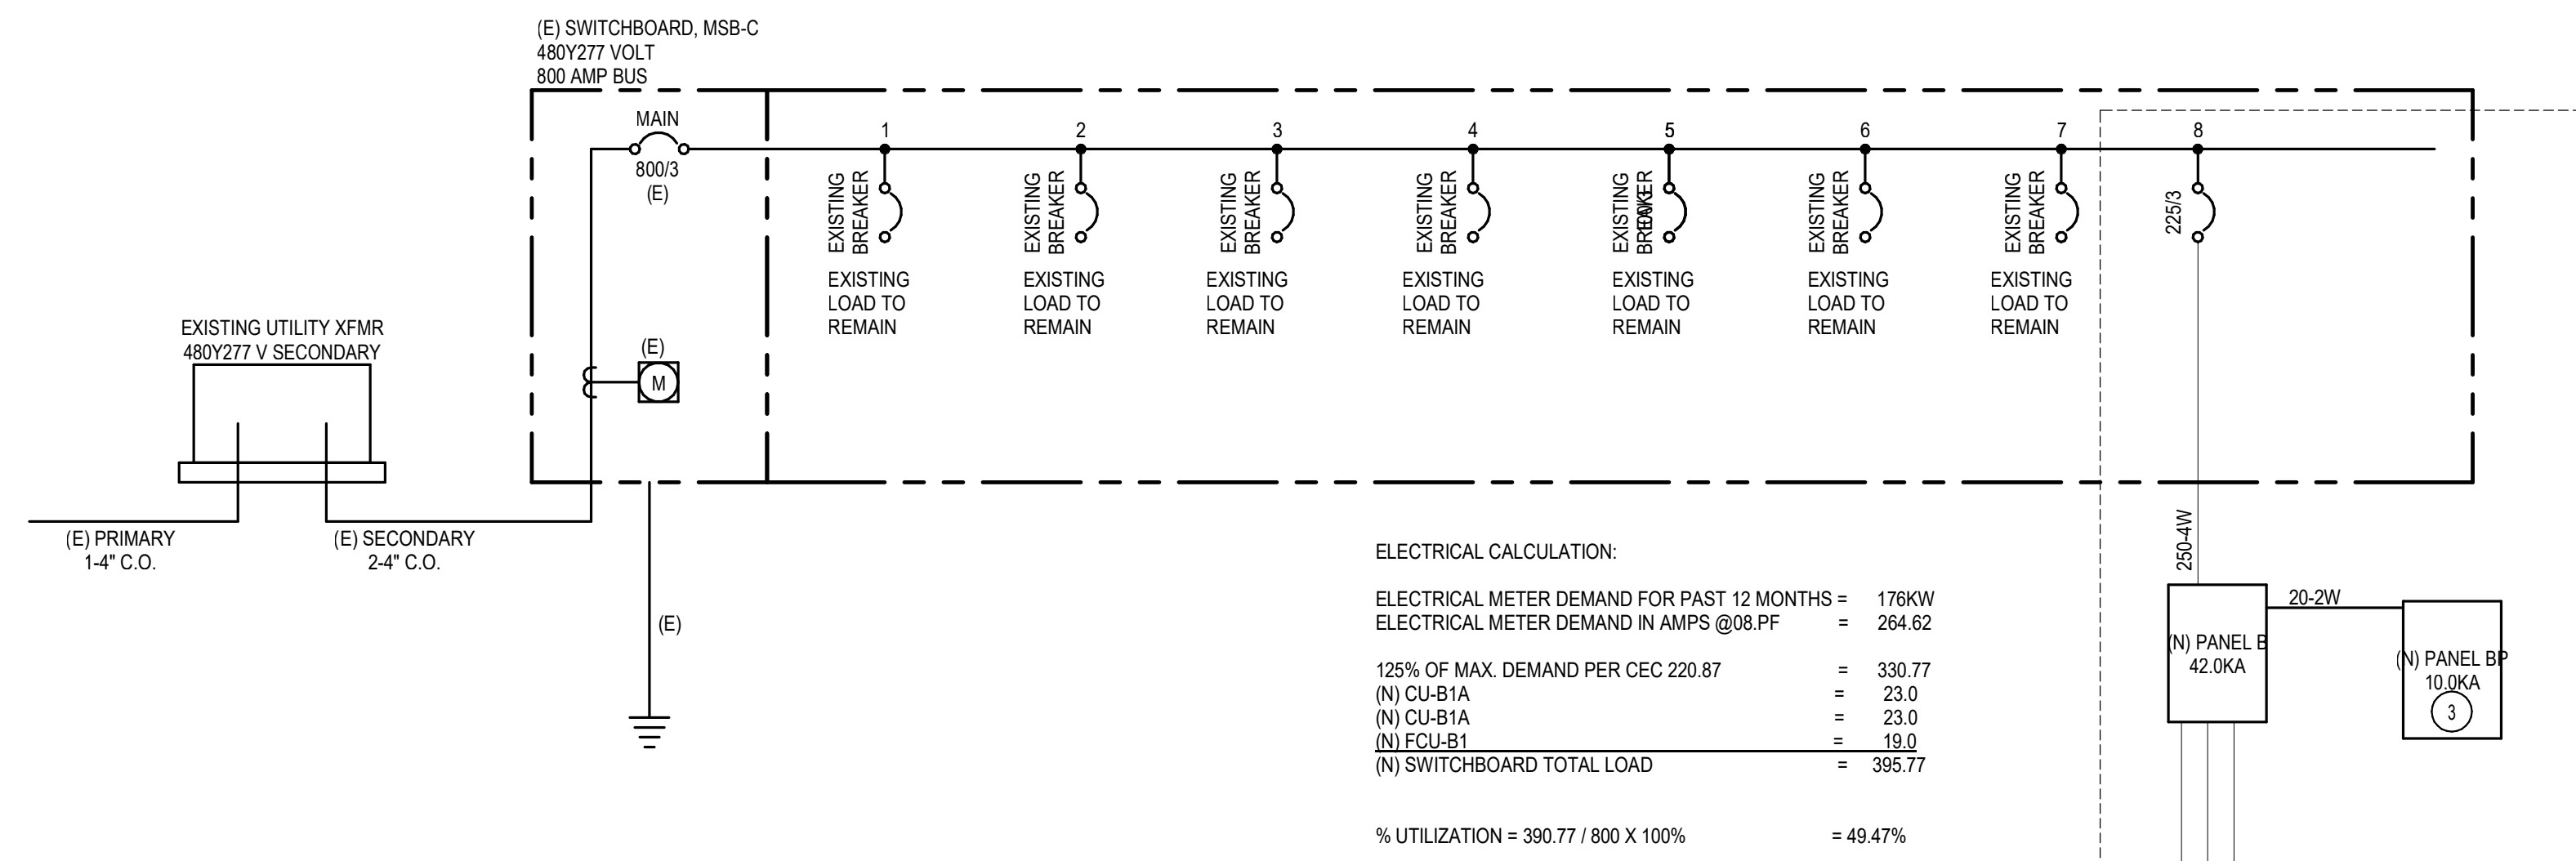

**GENERAL SINGLE LINE NOTES**

- OVERCURRENT DEVICES OF ENTIRE DISTRIBUTION SYSTEM SHALL MEET STATED FAULT CURRENT VALUES WITH FULLY RATED EQUIPMENT.
- CONDUCTOR LENGTHS INDICATED ON THE SINGLE LINE DIAGRAM ARE FOR FAULT CURRENT CALCULATIONS ONLY. ACTUAL LENGTHS SHALL BE DETERMINED BY FIELD CONDITIONS AND ACTUAL ROUTES OF FEEDERS.
- REFER TO SWITCHBOARD SCHEDULES AND DISTRIBUTION PANEL SCHEDULES FOR ADDITIONAL REQUIREMENTS. WHERE A DISCREPANCY EXISTS BETWEEN EQUIPMENT ON THE SINGLE LINE DIAGRAM AND THE DETAILED SCHEDULES, THE ITEM OR ARRANGEMENT WITH BETTER QUALITY, GREATER QUANTITY, OR HIGHER COST SHALL BE USED.
- ALL DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
- REFER TO THE MOTOR AND SPECIAL CONNECTION SCHEDULE FOR ALL FEEDERS DESIGNATED 'EQ'.
- GROUNDING ELECTRODE CONDUCTORS SIZES ARE NOT INDICATED ON THE SINGLE LINE DIAGRAM ARE. REFER TO THE GROUNDING RISER DIAGRAM FOR CONNECTIONS AND CONDUCTOR SIZES.

**KEYNOTES**

- | No. | DESCRIPTION  |
|-----|--|
| 1   | FUSED DISCONNECT AND FUSES TO BE PROVIDED UNDER DIVISION 26.   |
| 2   | VARIABLE FREQUENCY DRIVE WITH ON/OFF SWITCH TO BE PROVIDED UNDER DIVISION 23.                        |
| 3   | MINI LOAD CENTER PANELBOARD WITH 5KVA TRANSFORMER, EQUAL TO EATON P48G11501518CUB OR APPROVED EQUAL. |

**FEEDER SCHEDULE - COPPER**

MARK (AMPS)	# SETS	Ø & N	GND	CONDUIT SIZE		
				-4W	-3W	-2W
15	1	12	12	3/4"	3/4"	3/4"
20	1	12	12	3/4"	3/4"	3/4"
25	1	10	10	3/4"	3/4"	3/4"
30	1	10	10	3/4"	3/4"	3/4"
35	1	8	10	3/4"	3/4"	3/4"
40	1	8	10	3/4"	3/4"	3/4"
45	1	6	10	1"	3/4"	3/4"
50	1	6	10	1"	3/4"	3/4"
60	1	4	10	1-1/4"	1"	3/4"
70	1	4	8	1-1/4"	1"	3/4"
80	1	3	8	1-1/4"	1-1/4"	1"
90	1	2	8	1-1/4"	1-1/4"	1"
100	1	1	8	1-1/2"	1-1/2"	1-1/4"
110	1	1	6	1-1/2"	1-1/2"	1-1/4"
125	1	1	6	1-1/2"	1-1/2"	1-1/4"
150	1	1/0	6	2"	1-1/2"	1-1/4"
175	1	2/0	6	2"	1-1/2"	1-1/4"
200	1	3/0	6	2"	2"	1-1/2"
225	1	4/0	4	2-1/2"	2"	1-1/2"
250	1	250	4	2-1/2"	2"	1-1/2"
300	1	350	4	3"	2-1/2"	2"
350	1	500	3	3-1/2"	3"	2-1/2"
400	1	600	3	3-1/2"	3"	2-1/2"
400	2	3/0	3	2"	2"	1-1/2"
450	2	4/0	2	2-1/2"	2"	1-1/2"
500	2	250	2	2-1/2"	2-1/2"	2"
600	2	350	1	3"	2-1/2"	2"
700	2	500	1/0	3-1/2"	3"	2-1/2"
800	2	600	1/0	3-1/2"	3"	2-1/2"
1000	3	400	2/0	3"	3"	2-1/2"
1200	3	600	3/0	3-1/2"	3-1/2"	3"
1800	4	600	4/0	3-1/2"	3-1/2"	3"
2000	5	600	250	4"	3-1/2"	3"
2500	6	600	350	4"	3-1/2"	3"
3000	8	500	400	3-1/2"	3"	2-1/2"
4000	10	600	500	4"	3-1/2"	3"

One-Line Diagram

DISTRIBUTION PANEL: BP						
LOCATION: MECHANICAL B113 MAIN DEVICE: 40.0 A BUS AMPS:			VOLTAGE: 120/240V, 103W. AIC RATING: SPECIAL: 40			
MAIN DEVICE						
FRAME	POLES	FUSE	SPECIAL	DESCRIPTION/NAMEPLATE		
		40.0 A				
SECTION NO. 1						
CKT	FRAME	POLES	FUSE	LOAD	DESCRIPTION/NAMEPLATE	NOTES
1	10.0 A	1	10.0 A	100 VA	FIRE SMOKE DAMPER	
2	400.0 A	1	20.0 A	0 VA		
3						
4						
5						
6						
7						
8						
9						
10						

ROWLAND AVE. E.S. AC UNIT REPLACEMENT																					
EXISTING UNIT										NEW UNIT											
TAGS	VIPH	MCA	FLA	MOCF	ELECTRICAL	PANEL/ CKT#	FEEDER SIZE	DISCONNECT	TAGS	DIRECT REPLACEMENT? Y/N	CFM	V-PH	MCA	MOCF	ELECTRICAL	DISCONNECT	REQUIRED?	Model#	POWER EXHAUST	NOTES	
NA	NA	NA	NA	NA	NA	NA	NA	NA	CU-B1A (BLDG. B)	N		460/3	23	30	B-1,3,5	30A (30A FUSE)	NO		NA		
NA	NA	NA	NA	NA	NA	NA	NA	NA	CU-B1B (BLDG. B)	N		460/3	23	30	B-7,9,11	30A (30A FUSE)	NO		NA		
NA	NA	NA	NA	NA	NA	NA	NA	NA	FCU-B1 (BLDG. B)	N	8,000	460/3	19	30	B-13,15,17	30A (30A FUSE)	NO		NA		
CU/FCU-C1 (BLDG C)	240/1	22.875	18.3	30	LH-14,16	2#10, 1#10GND-0.75°C	30	RTU-C1 (BLDG C)	Y	1,200	240/1	26	30	LH-14,16	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-C2 (BLDG C)	240/1	22.875	18.3	30	LH-18,20	2#10, 1#10GND-0.75°C	30	RTU-C2 (BLDG C)	Y	1,200	240/1	26	30	LH-18,20	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-D1 (BLDG D)	240/1	22.875	18.3	30	LH-2,4	2#10, 1#10GND-0.75°C	30	RTU-D1 (BLDG D)	Y	1,200	240/1	26	30	LH-2,4	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-D2 (BLDG D)	240/1	22.875	18.3	30	LH-6,8	2#10, 1#10GND-0.75°C	30	RTU-D2 (BLDG D)	Y	1,200	240/1	26	30	LH-6,8	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-D3 (BLDG D)	240/1	22.875	18.3	30	LH-10,12	2#10, 1#10GND-0.75°C	30	RTU-D3 (BLDG D)	Y	1,200	240/1	26	30	LH-10,12	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-F1 (BLDG F)	240/1	22.875	18.3	30	LH-13,15	2#10, 1#10GND-0.75°C	30	RTU-F1 (BLDG F)	Y	1,200	240/1	26	30	LH-13,15	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-F2 (BLDG F)	240/1	22.875	18.3	30	LH-17,19	2#10, 1#10GND-0.75°C	30	RTU-F2 (BLDG F)	Y	1,200	240/1	26	30	LH-17,19	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-F3 (BLDG F)	240/1	22.875	18.3	30	LH-21,23	2#10, 1#10GND-0.75°C	30	RTU-F3 (BLDG F)	Y	1,200	240/1	26	30	LH-21,23	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-H1 (BLDG H)	240/1	22.875	18.3	30	LH-1,3	2#10, 1#10GND-0.75°C	30	RTU-H1 (BLDG H)	Y	1,200	240/1	26	30	LH-1,3	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-H2 (BLDG H)	240/1	22.875	18.3	30	LH-5,7	2#10, 1#10GND-0.75°C	30	RTU-H2 (BLDG H)	Y	1,200	240/1	26	30	LH-5,7	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-H3 (BLDG H)	240/1	22.875	18.3	30	LH-9,11	2#10, 1#10GND-0.75°C	30	RTU-H3 (BLDG H)	Y	1,200	240/1	26	30	LH-9,11	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-I1 (BLDG I)	240/1	22.875	18.3	30	LF-1,3	2#10, 1#10GND-0.75°C	30	RTU-I1 (BLDG I)	Y	1,200	240/1	26	30	LF-1,3	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-I2 (BLDG I)	240/1	22.875	18.3	30	LF-5,7	2#10, 1#10GND-0.75°C	30	RTU-I2 (BLDG I)	Y	1,200	240/1	26	30	LF-5,7	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-I3 (BLDG I)	240/1	22.875	18.3	30	LF-9,11	2#10, 1#10GND-0.75°C	30	RTU-I3 (BLDG I)	Y	1,200	240/1	26	30	LF-9,11	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-J1 (BLDG J)	240/1	22.875	18.3	30	LF-13,15	2#10, 1#10GND-0.75°C	30	RTU-J1 (BLDG J)	Y	1,200	240/1	26	30	LF-13,15	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-J2 (BLDG J)	240/1	22.875	18.3	30	LF-17,19	2#10, 1#10GND-0.75°C	30	RTU-J2 (BLDG J)	Y	1,200	240/1	26	30	LF-17,19	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-J3 (BLDG J)	240/1	22.875	18.3	30	LF-21,23	2#10, 1#10GND-0.75°C	30	RTU-J3 (BLDG J)	Y	1,200	240/1	26	30	LF-21,23	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-K1 (BLDG K)	240/1	22.875	18.3	30	LF-2,4	2#10, 1#10GND-0.75°C	30	RTU-K1 (BLDG K)	Y	1,200	240/1	26	30	LF-2,4	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-K2 (BLDG K)	240/1	22.875	18.3	30	LF-6,8	2#10, 1#10GND-0.75°C	30	RTU-K2 (BLDG K)	Y	1,200	240/1	26	30	LF-6,8	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)
CU/FCU-K3 (BLDG K)	208/1	22.875	18.3	30	LF-10,12	2#10, 1#10GND-0.75°C	30	RTU-K3 (BLDG K)	Y	1,200	240/1	26	30	LF-10,12	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)

- GENERAL NOTES



