

# WORKMAN ELEMENTARY SCHOOL

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT

100% CONSTRUCTION DOCUMENTS

11/04/2022

DLR GROUP PROJECT NUMBER: 75-22605-00

DSA APPLICATION #  
A# 03-122234

## SHEET INDEX

GENERAL  
G0.1 COVER SHEET  
G1.1 GENERAL NOTES, SYMBOLS AND ABBREVIATIONS  
ARCHITECTURAL

A1.0 ARCHITECTURAL SITE PLAN  
A1.1 OVERALL FLOOR PLAN  
A1.1A AREA A - FLOOR PLAN  
A1.1B AREA B - FLOOR PLAN  
A1.1E AREA E - FLOOR PLAN  
A1.1F AREA F - FLOOR PLAN

A1.3 OVERALL ROOF PLAN  
A1.3A AREA A - ROOF PLAN  
A1.3B AREA B - ROOF PLAN  
A1.3E AREA E - ROOF PLAN  
A1.3F AREA F - ROOF PLAN

A3.1 OVERALL REFLECTED CEILING PLAN  
A3.1A AREA A - REFLECTED CEILING PLAN  
A3.1B AREA B - REFLECTED CEILING PLAN  
A3.1E AREA E - REFLECTED CEILING PLAN  
A3.1F AREA F - REFLECTED CEILING PLAN

MECHANICAL  
M0.1 MECHANICAL SYMBOLS, ABBREVIATIONS & NOTES  
M0.2 TITLE 24 COMPLIANCE  
M0.3 TITLE 24 COMPLIANCE  
M0.4 TITLE 24 COMPLIANCE  
M0.5 TITLE 24 COMPLIANCE

M1.0 OVERALL MECHANICAL SITE PLAN  
M1.1A AREA A - MECHANICAL FLOOR PLAN  
M1.1B AREA B - MECHANICAL FLOOR PLAN  
M1.1E AREA E - MECHANICAL FLOOR PLAN  
M1.1F AREA F - MECHANICAL FLOOR PLAN  
M1.3A AREA A - MECHANICAL ROOF PLAN  
M1.3B AREA B - MECHANICAL ROOF PLAN  
M1.3F AREA F - MECHANICAL ROOF PLAN

M5.1 CONTROLS DIAGRAMS

M7.1 MECHANICAL DETAILS  
M7.2 MECHANICAL DETAILS  
M7.3 MECHANICAL DETAILS  
M7.4 MECHANICAL DETAILS  
M7.5 MECHANICAL DETAILS

M8.1 MECHANICAL SCHEDULES

MP1.1 MECHANICAL PLUMBING SITE PLAN

## VICINITY MAP



## PROJECT DIRECTORY

**OWNER**  
COVINA VALLEY UNIFIED SCHOOL DISTRICT  
519 E. BADILLO ST.  
COVINA, CA 91723  
CONTACT: BRIAN JOHNSON  
PH: 626.974.7000  
BJOHNSON@CVUSD.ORG

**STRUCTURAL ENGINEER**  
DLR GROUP  
700 FLOWER ST 22ND FLOOR  
LOS ANGELES, CA 90017  
CONTACT: NORMAN PATENA  
PH: 213.800.9400  
NPATENA@DLRGROUP.COM

**ARCHITECT**  
DLR GROUP  
700 S. FLOWER ST.  
LOS ANGELES, CA 90017  
CONTACT: JESSE MILLER  
PH: 213.800.9400  
JMILLER@DLRGROUP.COM

**ELECTRICAL ENGINEER**  
DLR GROUP  
700 FLOWER ST 22ND FLOOR  
LOS ANGELES, CA 90017  
CONTACT: TONG FANG (DONNA) ZHAO  
PH: 213.444.0610  
DZHAO@DLRGROUP.COM

**MECHANICAL ENGINEER**  
DLR GROUP  
700 FLOWER ST 22ND FLOOR  
LOS ANGELES, CA 90017  
CONTACT: TONG FANG (DONNA) ZHAO  
PH: 213.444.0610  
DZHAO@DLRGROUP.COM

## Statement of General Conformance

FOR ARCHITECTS/ENGINEERS WHO UTILIZE PLANS,  
INCLUDING BUT NOT LIMITED TO SHOP DRAWINGS, PREPARED BY OTHER  
LICENSED DESIGN PROFESSIONALS AND/OR CONSULTANTS

(Application No. 03-122234 File No. 19-25)

HAVE BEEN PREPARED BY OTHER DESIGN PROFESSIONALS OR CONSULTANTS  
WHO ARE LICENSED AND/OR AUTHORIZED TO PREPARE SUCH DRAWINGS IN THIS  
STATE. IT HAS BEEN EXAMINED BY ME FOR:

1) DESIGN INTENT AND APPEARS TO MEET THE APPROPRIATE REQUIREMENTS OF  
TITLE 24, CALIFORNIA CODE OF REGULATIONS, AND THE PROJECT  
SPECIFICATIONS PREPARED BY ME, AND

2) COORDINATION WITH MY PLANS AND SPECIFICATIONS, AND IS ACCEPTABLE  
FOR INCORPORATION INTO THE CONSTRUCTION OF THIS PROJECT.

THE STATEMENT OF GENERAL CONFORMANCE "SHALL NOT BE CONSTRUED AS  
RELIEVING ME OF MY RIGHTS, DUTIES, AND RESPONSIBILITIES UNDER SECTIONS  
17302 AND 81136 OF THE EDUCATION CODE AND SECTIONS 4-336, 4-341 AND 4-344"  
OF TITLE 24, PART 1, (TITLE 24, PART 1, SECTION 4-317(b))

I FIND THAT: ☒ ALL DRAWINGS OR SHEETS LISTED ON THE COVER OR INDEX SHEET  
FOR EACH DISCIPLINE (SEE SHEET INDEX FOR LIST OF DISCIPLINES)  
☐ THIS DRAWING OR PAGE

☒ ARE IN GENERAL CONFORMANCE WITH  
THE PROJECT DESIGN,  
AND  
☒ HAVE BEEN COORDINATED WITH THE  
PROJECT PLANS AND SPECIFICATIONS.

SIGNATURE DATE  
05/05/2022

ARCHITECT OR ENGINEER DESIGNATED TO BE IN  
GENERAL RESPONSIBLE CHARGE

JESSE MILLER

PRINT NAME

C-32306 10/31/2023

LICENSE NUMBER EXPIRATION DATE

ARE IN GENERAL CONFORMANCE WITH  
THE PROJECT DESIGN INTENT,  
AND  
HAVE BEEN COORDINATED WITH THE  
PROJECT PLANS AND SPECIFICATIONS.

SIGNATURE DATE

ARCHITECT OR ENGINEER DELEGATED  
RESPONSIBILITY FOR THIS PORTION OF THE  
WORK

PRINT NAME

LICENSE NUMBER EXPIRATION DATE

## DESIGN ANALYSIS DATA

1. WIND DESIGN CRITERIA (CBC 1603A.1.4) - STRUCTURAL DESIGN PARAMETERS

- RISK CATEGORY: III  
- WIND DESIGN SPEED: V=115 MPH  
- WIND EXPOSURE CATEGORY: B (PER ASCE 7-16)

2. EARTHQUAKE DESIGN CRITERIA (CBC 1603A1.5)

- SEISMIC DESIGN CATEGORY: D  
- SITE CLASS: D  
-  $S_{SI} = 1.661$   
-  $S_{SI} = 0.609$   
-  $S_{SI} = 1.963$   
-  $S_{SI} = 1.039$   
-  $S_{SI} = 1.328$   
-  $S_{SI} = 0.692$   
-  $I_p$  (IMPORTANCE FACTOR) = 1.00  
-  $F_a$  (CONTROLLING HOR. SEISMIC FORCE) = 1.815/26 LBS

3. DESIGN LOAD BEARING VALUES OF SOILS (CBC 1603A1.6)

- ALLOWABLE SOIL BEARING PRESSURE: 1,300 PSF  
- ALLOWABLE LATERAL BEARING PRESSURE: 100 PSF MIN.

## SCOPE OF WORK

SCOPE OF WORK SHALL BE AS FOLLOWS:

EXISTING HVAC SYSTEM REPLACEMENT TO BUILDINGS B, C, D, E, G, H, I, J, AND K

## APPLICABLE CODES

2019 CALIFORNIA ADMINISTRATIVE CODE (CAC), PART 1, TITLE 24 CCR  
2019 CALIFORNIA BUILDING CODE (CBC), PART 2, TITLE 24 CCR  
(2018 INTERNATIONAL BUILDING CODE, VOL. 1 & 2, AND 2019 CALIFORNIA AMENDMENTS)  
2019 CALIFORNIA ELECTRICAL CODE (CEC), PART 3, TITLE 24 CCR  
(2017 NATIONAL ELECTRICAL CODE AND 2019 CALIFORNIA AMENDMENTS)  
2019 CALIFORNIA MECHANICAL CODE (CMC), PART 4, TITLE 24 CCR  
(2018 APMO UNIFORM MECHANICAL CODE AND 2019 CALIFORNIA AMENDMENTS)  
2019 CALIFORNIA PLUMBING CODE (CPC), PART 5, TITLE 24 CCR  
(2018 APMO UNIFORM PLUMBING CODE AND 2019 CALIFORNIA AMENDMENTS)  
2019 CALIFORNIA ENERGY CODE (CEC), PART 6, TITLE 24 CCR  
2019 CALIFORNIA FIRE CODE (CFC), PART 8, TITLE 24 CCR  
(2018 INTERNATIONAL FIRE CODE AND 2019 CALIFORNIA AMENDMENTS)  
2019 CALIFORNIA EXISTING BUILDING CODE (CEBC), PART 10, TITLE 24 CCR  
(2019 INTERNATIONAL EXISTING BUILDING CODE AND 2019 CALIFORNIA AMENDMENTS)  
2019 CALIFORNIA GREEN BUILDING STANDARDS CODE (CAL GREEN), PART 11, TITLE 24 CCR  
2019 CALIFORNIA REFERENCED STANDARDS CODE (CEBC), PART 12, TITLE 24 CCR  
TITLE 19 CCR, PUBLIC SAFETY, STATE FIRE MARSHAL REGULATIONS  
2016 ASME A17.1/CSA B44-13 SAFETY CODE FOR ELEVATORS AND ESCALATORS  
PER 2019 CBC PART 7 CH 35  
NOTE: CALIFORNIA ELEVATOR UNIT ENFORCES CCR TITLE 8 AND USES THE 2004 ASME A17.1 BY  
ADOPTION  
2010 ADA STANDARDS FOR ACCESSIBLE DESIGN

NFPA 13 - STANDARD FOR INSTALLATION OF SPRINKLERS SYSTEMS (CA AMENDED) 2016 ADDITION  
NFPA 14 - STANDARD FOR INSTALLATION OF SAND PIPE AND HOSE SYSTEMS (CA AMENDED) 2013 ADDITION  
NFPA 17 - STANDARD FOR DRY CHEMICAL EXTINGUISHING SYSTEMS 2016 ADDITION  
NFPA 17A - STANDARD FOR WET CHEMICAL EXTINGUISHING SYSTEMS 2017 ADDITION  
NFPA 20 - STANDARD FOR INSTALLATION OF STATIONARY PUMPS FOR FIRE PROTECTION 2017 ADDITION  
NFPA 22 - STANDARD FOR WATER TANKS FOR PRIVATE FIRE PROTECTION 2013 ADDITION  
NFPA 24 - STANDARD FOR THE INSTALLATION OF PRIVATE FIRE SERVICE MAINS AND THEIR APPURTENANCES (CA AMENDED) 2016 ADDITION  
NFPA 72 - NATIONAL FIRE ALARM AND SIGNALING CODE (CA AMENDED) 2016 ADDITION  
NFPA 80 - STANDARD FOR FIRE DOORS AND OTHER OPENINGS PROTECTIVE 2016 ADDITION  
NFPA 80B - STANDARD ON CLEAN AGENT FIRE EXTINGUISHING SYSTEMS (CA AMENDED) 2015 ADDITION  
NFPA 2001 - STANDARD FOR FIRE TESTING OF FIRE EXTINGUISHING SYSTEMS FOR PROTECTION OF COMMERCIAL COOKING EQUIPMENT 2015 ADDITION  
UL 300 - STANDARD FOR FIRE TESTING OF FIRE EXTINGUISHING SYSTEMS FOR PROTECTION OF COMMERCIAL COOKING EQUIPMENT 2005 (R2010)  
UL 464 - AUDIBLE SIGNALING DEVICES FOR FIRE ALARM AND SIGNALING SYSTEMS, INCLUDING ACCESSORIES 2005 (R2010)  
UL 521 - STANDARD FOR HEAT DETECTORS FOR FIRE PROTECTIVE SIGNALING SYSTEMS 2003 ADDITION  
UL 1971 - STANDARD FOR SIGNALING DEVICES FOR THE HEARING IMPAIRED 1999 ADDITION  
ICC 300 - STANDARD FOR BLEACHERS, FOLDING AND TELESCOPIC SEATING, AND GRANDSTANDS 2002 (R2010) 2017 ADDITION

## DSA GENERAL NOTES

- CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY AN ADDENDUM OR A CONSTRUCTION CHANGE DOCUMENT APPROVED BY THE DIVISION OF THE STATE ARCHITECT (DSA) AS REQUIRED BY SECTION 4-338(b), PART 1, TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR), NOT WITHSTANDING OTHER PROVISIONS OF THE PROJECT SPECIFICATIONS, COMPLY WITH ALL PROVISIONS OF THE CALIFORNIA BUILDING STANDARDS ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR), SECTION 4-338, FOR ALL ADDENDUM AND CONSTRUCTION CHANGE DOCUMENTS.
- CONSTRUCTION CHANGE DOCUMENTS MUST BE SIGNED BY ALL THE FOLLOWING: ARCHITECT OR ENGINEER HAVING GENERAL RESPONSIBLE CHARGE OF THE PROJECT, AND STRUCTURAL ENGINEER OF RECORD OR DELEGATED PROFESSIONAL ENGINEER (WHEN APPLICABLE).
- SUBSTITUTIONS AFFECTING DSA-REGULATED ITEMS: ACCESSIBILITY, STRUCTURAL ENGINEER, AND FIRE/SAFETY SHALL BE CONSIDERED AS A CONSTRUCTION CHANGE DOCUMENT, AND SHALL BE APPROVED BY DSA PRIOR TO FABRICATION AND INSTALLATION IN ACCORDANCE WITH DSA IR A.6 AND SECTION 4-338(b), PART 1, TITLE 24, CCR. SUBSTITUTIONS SHALL BE FOR ANY MATERIALS, SYSTEMS OR PRODUCT THAT WOULD OTHERWISE BE REGULATED BY DSA.
- A DSA-CERTIFIED PROJECT INSPECTOR WITH CLASS 3 CERTIFICATION, EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE ARCHITECT AND BY THE DIVISION OF THE STATE ARCHITECT, SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE PROJECT INSPECTOR ARE DEFINED IN SECTION 4-342, CALIFORNIA BUILDING ADMINISTRATIVE CODE (PART 1, TITLE 24, CCR).
- A DSA-ACCEPTED TESTING LAB, EMPLOYED BY THE DISTRICT (OWNER), SHALL CONDUCT ALL REQUIRED TESTS AND INSPECTIONS OF THE WORK.
- THE DSA-CERTIFIED PROJECT INSPECTOR AND DSA-ACCEPTED TESTING LAB SHALL BE EMPLOYED AND PAID BY THE OWNER (DISTRICT) AND APPROVED BY ALL OF THE FOLLOWING: ARCHITECT OR ENGINEER HAVING GENERAL RESPONSIBLE CHARGE OF THE PROJECT, STRUCTURAL ENGINEER OF RECORD, AND DIVISION OF THE STATE ARCHITECT (DSA). THE INSPECTOR OF RECORD FOR THIS PROJECT SHALL BE CLASS 3 OR BETTER.
- ALL WORK SHALL CONFORM TO 2019 TITLE 24, CALIFORNIA CODE OF REGULATIONS (CCR).
- A DSA-ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE DISTRICT (OWNER) SHALL CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.
- THE INTENT OF THESE DRAWINGS AND SPECIFICATIONS IS THAT THE WORK OF THE ALTERATION, REHABILITATION OR RECONSTRUCTION IS TO BE IN ACCORDANCE WITH TITLE 24, CCR. SHOULD ANY EXISTING CONDITIONS SUCH AS DETERIORATION OR NON-COMPLYING CONSTRUCTION BE DISCOVERED WHICH IS NOT COVERED BY THE CONTRACT DOCUMENTS WHEREIN THE FINISHED WORK WILL NOT COMPLY WITH TITLE 24, CCR, A CONSTRUCTION CHANGE DOCUMENT (CCD), OR A SEPARATE SET OF PLANS AND SPECIFICATIONS, DETAILING AND SPECIFYING THE REQUIRED WORK SHALL BE SUBMITTED TO AND APPROVED BY DSA BEFORE PROCEEDING WITH THE WORK. (SECTION 4-317(c), PART 1, TITLE 24, CCR).
- FABRICATION AND INSTALLATION OF DEFERRED SUBMITTAL ITEMS SHALL NOT BE STARTED UNTIL CONTRACTOR'S DRAWINGS, SPECIFICATIONS, AND ENGINEERING CALCULATIONS FOR THE ACTUAL SYSTEMS TO BE INSTALLED HAVE ACCEPTED AND SIGNED BY THE ARCHITECT OR STRUCTURAL ENGINEER AND APPROVED BY DSA. LIST DEFERRED SUBMITTAL ITEMS FOR THIS PROJECT. (IF THIS PROJECT HAS NO DEFERRED SUBMITTAL ITEMS, PLEASE INDICATE AS SUCH).
- GRADING PLANS, DRAINAGE IMPROVEMENTS, ROAD AND ACCESS REQUIREMENTS AND ENVIRONMENTAL HEALTH CONSIDERATIONS SHALL COMPLY WITH ALL LOCAL ORDINANCES.
- THE CALIFORNIA ENERGY CODE SECTION 10-103 REQUIRES ACCEPTANCE TESTING ON ALL NEWLY INSTALLED LIGHTING CONTROLS, MECHANICAL SYSTEMS, ENVELOPES, AND PROCESS EQUIPMENT AFTER INSTALLATION AND BEFORE PROJECT COMPLETION. AN ACCEPTANCE TEST IS A FUNCTIONAL PERFORMANCE TEST TO HELP ENSURE THAT NEWLY INSTALLED EQUIPMENT IS OPERATING AND IN COMPLIANCE WITH THE ENERGY CODE.
- LIGHTING CONTROLS ACCEPTANCE TESTS MUST BE PERFORMED BY CERTIFIED LIGHTING CONTROLS ACCEPTANCE TEST TECHNICIAN (ATT).
- MECHANICAL SYSTEM ACCEPTANCE TEST MUST BE PERFORMED BY A CERTIFIED MECHANICAL ATT FOR PROJECTS SUBMITTED ON OR AFTER OCTOBER 1, 2021.
- ENVELOPE AND PROCESS EQUIPMENT ACCEPTANCE TESTS SHALL BE PERFORMED BY THE INSTALLING CONTRACTOR, ENGINEER/ARCHITECT OR RECORD OR THE OWNER'S AGENT.
- A LISTING OF CERTIFIED ATT CAN BE FOUND AT [HTTPS://WWW.ENERGY.CA.GOV/PROGRAMS-AND-TOPICS/PROGRAMS/ACCEPTANCE-TESTING-TECHNICIAN-CERTIFICATION-PROVIDER-PROGRAM/ACCEPTANCE.COM](https://www.energy.ca.gov/programs-and-topics/programs/acceptance-testing-technician-certification-provider-program/acceptance.com)
- THE ACCEPTANCE TESTING PROCEDURES MUST BE REPEATED, AND DEFICIENCIES MUST BE CORRECTED BY THE BUILDER OR INSTALLING CONTRACTOR UNTIL THE CONSTRUCTION/INSTALLATION OF THE SPECIFIED SYSTEMS CONFORM AND PASS THE REQUIRED ACCEPTANCE CRITERIA.
- PROJECT INSPECTORS WILL COLLECT THE FORMS TO CONFIRM THAT THE REQUIRED ACCEPTANCE TESTS HAVE BEEN COMPLETED.

DLR Group  
© DLR Group



WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

COVER SHEET

G0.1



## GENERAL ABBREVIATIONS

# & @	NUMBER AND AT
ADA	AMERICANS WITH DISABILITY ACT
ADDN	ADDITION OR ADDITIONAL
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
ALT	ALTERNATE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
APPROX	APPROXIMATE
ARCH	ARCHITECTURAL
BLDG	BUILDING
BSMT	BASEMENT
CL	CENTER LINE
CLG	CEILING
CM	CENTIMETER
CONC	CONCRETE
CONN(S)	CONNECTION(S)
CONST	CONSTRUCTION
CONT	CONTINUOUS
CONTR	CONTRACTOR(OR)
CTR	CENTER
D	DEPTH
DEG	DEGREE
DEMO	DEMOLISH OR DEMOLITION
DIA	DIAMETER
DIM	DIMENSION
DIV	SPECIFICATION DIVISION
DN	DOWN
DTL	DETAIL
DWG(S)	DRAWING(S)
E	EAST
EA	EACH
EC	ELECTRICAL CONTRACTOR
EL	ELEVATION
ELEC	ELECTRICAL
ENG	ENGINEER
EQ	EQUAL
EQUIP	EQUIPMENT
EQUIV	EQUIVALENT
EXST	EXISTING
EXT	EXTERIOR
FIN	FINISHED
FL	FLOOR
FT	FEET
FUT	FUTURE
GC	GENERAL CONTRACTOR
GOVT	GOVERNMENT
H	HEIGHT
HORIZ	HORIZONTAL
HT	HEIGHT
i.e.	THAT IS
IBC	INTERNATIONAL BUILDING CODE
IN	INCH
INT	INTERIOR
LB(S)	POUND(S)
M	THOUSAND
M	METER
MAX	MAXIMUM
MC	MECHANICAL CONTRACTOR
MECH	MECHANICAL
MEZZ	MEZZANINE
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MM	MILLIMETER
N	NORTH
N/A	NOT APPLICABLE
NIC	NOT IN CONTRACT
NTS	NOT TO SCALE
OC	ON CENTER
OPP	OPPOSITE
OVHD	OVERHEAD
PAR	PARALLEL
PENT	PENTHOUSE
PLYWD	PLYWOOD
QTY	QUANTITY
REQ(D)	REQUIRE(D)
REV	REVISION(S)
RM	ROOM
RND	ROUND
S	SOUTH
SCHED	SCHEDULE
SECT	SECTION
SHT	SHEET
SIM	SIMILAR
SPEC	SPECIFICATION(S)
STD	STANDARD
STL	STEEL
STOR	STORAGE
STRUCT	STRUCTURAL
SYM	SYMMETRICAL
TEMP	TEMPORARY
TYP	TYPICAL
UNEX	UNEXCAVATED
UNFIN	UNFINISHED
UNO	UNLESS NOTED OTHERWISE
VERT	VERTICAL
VEST	VESTIBULE
VIF	VERIFY IN FIELD
W	WEST
W/	WITH
W/O	WITHOUT

## ARCHITECTURAL ABBREVIATIONS

A/E	ARCHITECT/ENGINEER	AE	ARCHITECT/ENGINEER	GL	GLUE LAMINATED
AB	AIR BARRIER	AB	AIR BARRIER	GL	GLASS
ABS	ASBESTOS	AB	AIR BARRIER	GMP	GUARANTEED MAXIMUM PRICE
ACC	ADA ACCESSIBLE	GR	GUARD RAIL	GR	GRADE
ACFT	ACROFINISHED FLOOR	GRS	GALVANIZED RIGID STEEL	GR	GRADE
ACT	ACUSTIC CEILING TILE	GWB	GYPSUM WALL BOARD	SH	SHOWER
AD	ACCESS DOOR	GYP	GYPSUM	SH	SECURITY HOLLOW METAL
ADJ	ADJUSTABLE	HC	HOLLOW CORE	SLNT	SLANT
ADJT	ADJACENT	HD	HAND DRYER	SM	SHEET METAL
ADMIN	ADMINISTRATION	HDR	HIGH DENSITY FIBERBOARD	SND	SANITARY NAPKIN DISPOSAL
AEC	AUTOMATED EXTERNAL DEFIBRILLATORS	HDR	HEADER	SNV	SANITARY NAPKIN VENDOR
AL	ALUMINUM	HDWR	HARDWOOD	SPR	SOUND PRESSURE LEVEL
ALUM	ALUMINUM	HM	HOLLOW METAL	SQ	SQUARE
APC	ACCESS PANEL	HR	HOUR	SS	SOLID SURFACE
ASPH	ACUSTIC PANEL CEILING	HR	HANDRAIL	SSA	STORM SHELTER AREA
AUTO	AUTOMATIC	HS	HARDWARE SET	SSS	STAINLESS STEEL SHELF
AVG	AVERAGE	HSS	HOLLOW STRUCTURAL SHAPE	SST	STAINLESS STEEL
AWP	ACOUSTIC WALL PANEL	HVAC	HEATING VENTILATING AND AIR CONDITIONING	ST	STONE
B.O.	BOTTOM OF	I/W	IN ACCORDANCE WITH	STAGD	STAGGERED
BCS	BABY CHANGING STATION	ID	INSIDE DIAMETER	STC	SOUND TRANSMISSION CLASS
BD	BOARD	IF	INSIDE FACE	STR	STRINGER
BK	BLOCK	IG	INSULATED INFILL PANEL GLASS	SUBFL	SUBFLOOR
BLKG	BLOCKING	IJ	ISOLATION JOINT	SURF	SURFACE
BLKHD	BULKHEAD	IS	IN JOIST SPACE	SUSP	SUSPENDED
BM(S)	BEAM(S)	INC	INCLUDE(ING)	SVF	SHEET VINYL FLOORING
BOT	BOTTOM	INSUL	INSULATION	T	TREAD
BRG	BRIDGING	JAN	JANITOR	T&G	TONGUE AND GROOVE
BRKT	BRACKET	JBE	JOIST BEARING ELEVATION	T.O.	TOP OF
BTHUB	BATHUB	JCT	JUNCTION	TAN	TANGENT
BTWN	BETWEEN	JFB	JOINT FILLER BOARD	TB	TOWEL BAR
CAB	CABINET	JST	JOIST	TBD	TACK BOARD
CBD	CHALKBOARD	JT	JOINT	TOP	TOILET COMPARTMENT PARTITION
CER	CERAMIC	KCJ	KEYED CONSTRUCTION JOINT	TERR	TERRAZZO
CF	CUBIC FEET	KD	KNOCKDOWN	TRG	TINTED FLOAT GLASS
CFCI	CONTRACTOR FURNISHED CONTRACTOR INSTALLED	KG	KITCHEN HOOD	TH	TEMPERED GLASS
CFMF	COLD-FORMED METAL FRAMING	KIT	KITCHEN	THK	THRESHOLD
CG	CLEAR FLOAT GLASS	L	ANGLE	TI	THICKNESS
CI	CAST IRON	LAB	LABORATORY	TT	TENANT IMPROVEMENT
CIG	CLEAR INSULATING GLASS	LAM	LABORATORY	TTG	TINTED GLASS
CP	CAST IN PLACE	LAV	LAVATORY	TTM	TINTED MIRROR UNIT
CJ	CONTROL JOINT	LBR	LUMBER	TTG	TINTED TEMPERED FLOAT GLASS
CJA	CONTROL JOINT ABOVE	LDG	LOADING	TTIG	TINTED TEMPERED INSULATING GLASS
CLO	CLOSET	LF	LINEAR FOOT	TW	TACK WALL
CLR	CLEAR	LG	LENGTH (LONG)	UL	UNDERWRITERS LABORATORIES
COL	COLUMN	LG	LAMINATED GLASS	UR	URINAL
COM	COMMON	LIN	LINEAR	US	UTILITY SHELF
COB	COMBINATION	LNO	LINOLEUM	UTIL	UTILITY
COMM	COMMUNICATIONS	LNR	LOCKER	VB	VAPOR BARRIER
COMPR	COMPRESSIBLE	LOC	LOCATION	VB	VINYL BASE
CONF	CONFERENCE	LONG	LONGITUDINAL	VCB	VENTED COVE BASE
CONFIG	CONFIGURATION	LSC	LIFE SAFETY CODE	VCB	VINYL FLOOR
CORR	CORRIDOR	LTS	LIGHTING	VOC	VOLATILE ORGANIC COMPOUND
CP	COVER PLATE	LTV	LUXURY VINYL TILE	VOL	VOLUME
CPT	CARPET	LVT	LUXURY VINYL TILE	VP	VENEEER PLASTER
CR	CHAIR RAIL	MAG	MAGNETIC	VT	VINYL TILE
CS	COUNTERSINK	MAN	MAINTENANCE	VWC	VINYL WALL COVERING
CSTJ	CONSTRUCTION JOINT	MAN	MANUAL	W	WIDE
CSWK	CASEWORK	MAS	MASONRY	WB	WALL BASE
CT	CERAMIC TILE	MATL	MATERIAL	WC	WATER CLOSET
CTG	CLEAR TEMPERED FLOAT GLASS	MB	MOP BASIN	WC	WALL COVERING
CTIG	CLEAR TEMPERED INSULATING GLASS	MB	MOP BASIN	WCL	WATER CLOSET/LAVATORY COMBINATION
CU	COPPER	MBH	MOP/BROOM HOLDER	WDF	WOOD FLOORING
CJ	COMBINATION UNIT	MC	MEDICINE CABINET	WDF	WOOD FLOORING
CV	CONDOM VENDOR	MEMB	MEMBRANE	WDF	WOOD FLOORING
CY	CUBIC YARD	MH	MANHOLE	WDF	WOOD FLOORING
CYL	CYLINDER	MIR	MIRROR WITH SHELF	WDF	WOOD FLOORING
DB	DECIBEL	MTD	MOUNTED	WDF	WOOD FLOORING
DBL	DOUBLE	MTG	MOUNTING	WDF	WOOD FLOORING
DC	DUST COLLECTOR	MUL	MULLION	WDF	WOOD FLOORING
DEPR	DEPRESSION(ED)	NC	NOISE CRITERIA	WDF	WOOD FLOORING
DEPT	DEPARTMENT	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION	WDF	WOOD FLOORING
DET	DETENTION	NOM	NOMINAL	WDF	WOOD FLOORING
DF	DRINKING FOUNTAIN	O to O	OUT TO OUT	WDF	WOOD FLOORING
DG	DOOR GRILLE	OA	OVERALL	WDF	WOOD FLOORING
DAG	DIAGONAL	OFCD	OWNER FURNISHED CONTRACTOR INSTALLED	WDF	WOOD FLOORING
DPRG	DAMPPOOFING	OFF	OFFICE	WDF	WOOD FLOORING
DR	DOOR	OFCD	OWNER FURNISHED CONTRACTOR INSTALLED	WDF	WOOD FLOORING
DSN	DOWNSPOUT NOZZLE	OH	OWNER FURNISHED OWNER INSTALLED	WDF	WOOD FLOORING
DW	DISHWASHER	OH	OWNER FURNISHED OWNER INSTALLED	WDF	WOOD FLOORING
DWL(S)	DOWEL(S)	OPG(S)	OPENING(S)	WDF	WOOD FLOORING
DWR	DRAWER	OSHA	OPERATIONAL SAFETY AND HEALTH ADMINISTRATION	WDF	WOOD FLOORING
EB	EXPANSION BOLT	OTB	OPEN TO BELOW	WDF	WOOD FLOORING
EE	EACH END	OVFL	OVERFLOW	WDF	WOOD FLOORING
EEW	EMERGENCY EYE WASH	P	PAINT	WDF	WOOD FLOORING
EEWS	EMERGENCY EYE WASH SHOWER	PAN B	PANIC BOLT	WDF	WOOD FLOORING
EFF	EFFICIENCY	PB	PARTICLE BOARD	WDF	WOOD FLOORING
EJ	EXPANSION JOINT	PC	PRECAST CONCRETE	WDF	WOOD FLOORING
ELAS	ELASTOMERIC	PCD	PAPER CUP DISPENSER	WDF	WOOD FLOORING
ELV	ELEVATOR	PCT	PORCELAIN CERAMIC TILE	WDF	WOOD FLOORING
EMER	EMERGENCY	PD	PANIC DEVICE	WDF	WOOD FLOORING
ENCL	ENCLOSURE	PERF	PERFORATED	WDF	WOOD FLOORING
ENTR	ENTRANCE	PERP	PERPENDICULAR	WDF	WOOD FLOORING
ERF	EPOXY RESIN FLOORING	PS	PATTERN GLASS	WDF	WOOD FLOORING
EUI	ENERGY USE INTENSITY	PC	PORCELAIN CERAMIC TILE	WDF	WOOD FLOORING
EW	EACH WAY	PC	PORCELAIN CERAMIC TILE	WDF	WOOD FLOORING
EWC	ELECTRIC WATER COOLER	PIG	PATTERN INSULATING GLASS	WDF	WOOD FLOORING
EXP	EXPANSION	PL	PLATE	WDF	WOOD FLOORING
EXP	EXPOSED	PL	PROPERTY LINE	WDF	WOOD FLOORING
F	FABRIC	PLAM	PLASTIC LAMINATE	WDF	WOOD FLOORING
F.O.	FACE OF	PLBG	PLUMBING	WDF	WOOD FLOORING
FAB	FABRICATED(D)	PR	PAIR	WDF	WOOD FLOORING
FB	FACE BRICK	PREFAB	PREFABRICATED	WDF	WOOD FLOORING
FD	FLOOR DRAIN	PROJ	PROJECTION SCREEN	WDF	WOOD FLOORING
FDN	FOUNDATION	PS	PROJECTION SCREEN	WDF	WOOD FLOORING
FE	FIRE EXTINGUISHER	PT	POINT	WDF	WOOD FLOORING
FEC	FIRE EXTINGUISHER CABINET	PT	POINT OF TANGENCY	WDF	WOOD FLOORING
FF	FIRE FLOOR	PTD	PAPER TOWEL DISPENSER	WDF	WOOD FLOORING
FH	FIRE HYDRANT	PTDR	COMBINATION TOWEL DISPENSER/RECEPTACLE	WDF	WOOD FLOORING
FHC	FIRE HOSE CABINET	PTN	PARTITION	WDF	WOOD FLOORING
FIG	FIGURE	PVC	POLYVINYL CHLORIDE	WDF	WOOD FLOORING
FIX	FIGURE	PWL	SOUND POWER LEVEL	WDF	WOOD FLOORING
FLASH	FLASHING	QTR RND	QUARTER ROUND	WDF	WOOD FLOORING
FLEX	FLEXIBLE	R	RISER	WDF	WOOD FLOORING
FLG	FLOORING	RAD	RADIUS	WDF	WOOD FLOORING
FLM	FULL LENGTH MIRROR	RB	RUBBER BASE	WDF	WOOD FLOORING
FLUOR	FLUORESCENT	RC	REMOTE CONTROL	WDF	WOOD FLOORING
FO	FINISH OPENING	RCP	REFLECTED CEILING PLAN	WDF	WOOD FLOORING
FOC	FACE OF CONCRETE	RD	ROOF DRAIN	WDF	WOOD FLOORING
FOF	FACE OF FINISH	REF	REFERENCE	WDF	WOOD FLOORING
FOM	FACE OF MASONRY	REFL	REFLECTED	WDF	WOOD FLOORING
FOS	FACE OF STUD	REM	REMOVABLE	WDF	WOOD FLOORING
FOW	FACE OF WALL	RESIL	RESILIENT	WDF	WOOD FLOORING
FP	FIREPROOFING	RF	RUBBER FLOOR	WDF	WOOD FLOORING
FR	FIRE RESISTANT	RFM	RECESSED FLOOR MAT	WDF	WOOD FLOORING
FRP	FIBERGLASS REINFORCED PANEL	RH	ROBE HOOK	WDF	WOOD FLOORING
FRT	FIRE RESISTANCE TREATED	R&C	ROUGH IN AND CONNECT	WDF	WOOD FLOORING
FS	FLOOR SINK	S	SINK	WDF	WOOD FLOORING
FSS	FOLDING SHOWER SEAT	SAT	SPRAYED ACOUSTIC TREATMENT	WDF	WOOD FLOORING
FTG	FOOTING	SAW	SOUND ABSORBING WALL UNITS	WDF	WOOD FLOORING
FVC	FIRE VALVE CABINET	SB	SPLASH BLOCK	WDF	WOOD FLOORING
FWC	FABRIC WALL COVERING	SC	SOLID CORE	WDF	WOOD FLOORING
G	GROUT	SC	SHOWER CURTAIN	WDF	WOOD FLOORING
GA	GAUGE	SCD	SEAT COVER DISPENSER	WDF	WOOD FLOORING
GAL	GALLON	SOH	SHOWER CURTAIN HOOK	WDF	WOOD FLOORING
GALV	GALVANIZED	SCR	SHOWER CURTAIN ROD	WDF	WOOD FLOORING
GB	GRAB BAR	STC	STRUCTURAL CLAY TILE	WDF	WOOD FLOORING
GD	GARBAGE DISPOSAL			WDF	WOOD FLOORING
GEN	GENERAL			WDF	WOOD FLOORING
GFA	GROSS FLOOR AREA			WDF	WOOD FLOORING

## GENERAL SYMBOLS

	DETAIL NUMBER		EARTH
	CROSS REFERENCE		GRAVEL
	SHEET NUMBER		SAND
	BUILDING ELEVATION		CONCRETE
	INTERIOR ELEVATION		PRECAST CONCRETE
	SIMILAR OR TYPICAL REFERENCE		STEEL
	WALL SECTION		STONE
	DETAIL REFERENCE		CONCRETE MASONRY UNIT
	BUILDING SECTION		BRICK VENEER
	SHEET NOTE		STEEL (LARGE SCALE)
	REFERENCE KEYNOTE		GYM FLOOR
	ROOM NAME		WOOD (CONTINUOUS BLOCKING)
	ROOM NUMBER/NAME		WOOD (NON-CONTINUOUS BLOCKING)
	LEVEL ELEVATION		WOOD (TRIM/FINISH)
	REVISION NUMBER		GLASS
	LEVEL ELEVATION		SHINGLES
	SPOT ELEVATION		PLYWOOD (LARGE SCALE)
	FINISH FLOOR ELEVATION		GYPSUM WALL BOARD
	PROTECTION BOARD		BLANKET INSULATION
	CARPET (LARGE SCALE)		RIGID INSULATION
	ACOUSTIC TILE (LARGE SCALE)		SPRAY FOAM INSULATION
	TILE (LARGE SCALE)		MINERAL WOOL INSULATION

## SITE SYMBOLS


	PROPERTY LINE		AREA INLET
	LOT LINE		CURB INLET
	EASEMENT LINE		MANHOLE
	BUILDING LINE, EXISTING		HEAD WALL
	BUILDING LINE, NEW w/DOOR OPENING AND STRUCTURAL STOOP		FLARED END
	PRIMARY CONTOUR, EXISTING		CLEAN OUT
	PRIMARY CONTOUR, NEW		CAP
	SECONDARY CONTOUR, EXISTING		THRUST BLOCK
	SECONDARY CONTOUR, NEW		VALVE
	SLOPE, PAVEMENT		POST INDICATOR VALVE
	DRAINAGE DITCH OR SWALE		REDUCER
	STREET CENTERLINE		FIRE HYDRANT
	CURB, THICKENED EDGE		POWER POLE
	CURB, EXISTING		LIGHT POLE
	CURB, NEW		TELEPHONE MANHOLE
	PAVING CONTRACTION JOINT		TELEPHONE BOX
	PAVING KEYED CONSTRUCTION JOINT		SPRINKLER HEAD, 360°
	PAVING TIED CONSTRUCTION JOINT		SPRINKLER HEAD, 270°
	PAVING EXPANSION JOINT		SPRINKLER HEAD, 180°
	FENCE, SECURITY		SPRINKLER HEAD, 90°
	FENCE, BARBED WIRE		QUICK COUPLING
	FENCE, CHAIN LINK		TREE, EXISTING DECIDUOUS
	FENCE, WOOD		TREE, EXISTING CONIFER
	SEED LIMIT		SHADE TREE
	SOD LIMIT		ORNAMENTAL TREE
	FOUNDATION DRAIN, NON-PERFORATED		DECIDUOUS TREE
	FOUNDATION DRAIN, PERFORATED		SHRUB
	SUBDRAIN, PERFORATED		CLIPPED SHRUB
	SANITARY SEWER		
	FORCE MAIN		
	WATER		
	FIRE		
	GAS		
	HIGH PRESSURE STEAM		
	MEDIUM PRESSURE STEAM		
	LOW PRESSURE STEAM		
	UNDERGROUND ELEC/TELEPHONE		
	OVERHEAD POWER		
	LAWN SPRINKLER HOT LINE		
	LAWN SPRINKLER LATERAL		

## ARCHITECTURAL SYMBOLS

	CASEWORK ELEVATION
	DOOR NUMBER
	INTERIOR WINDOW NUMBER
	EXTERIOR WINDOW / CURTAIN WALL NUMBER
	WALL TYPE
	CEILING TYPE




Autodesk Docu/75-22605-40 CVUSD - District Wide HVAC Replacement/75-22605-40 CVUSD - Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:23 AM



# SITE PLAN

SCALE: 1" = 30'-0"

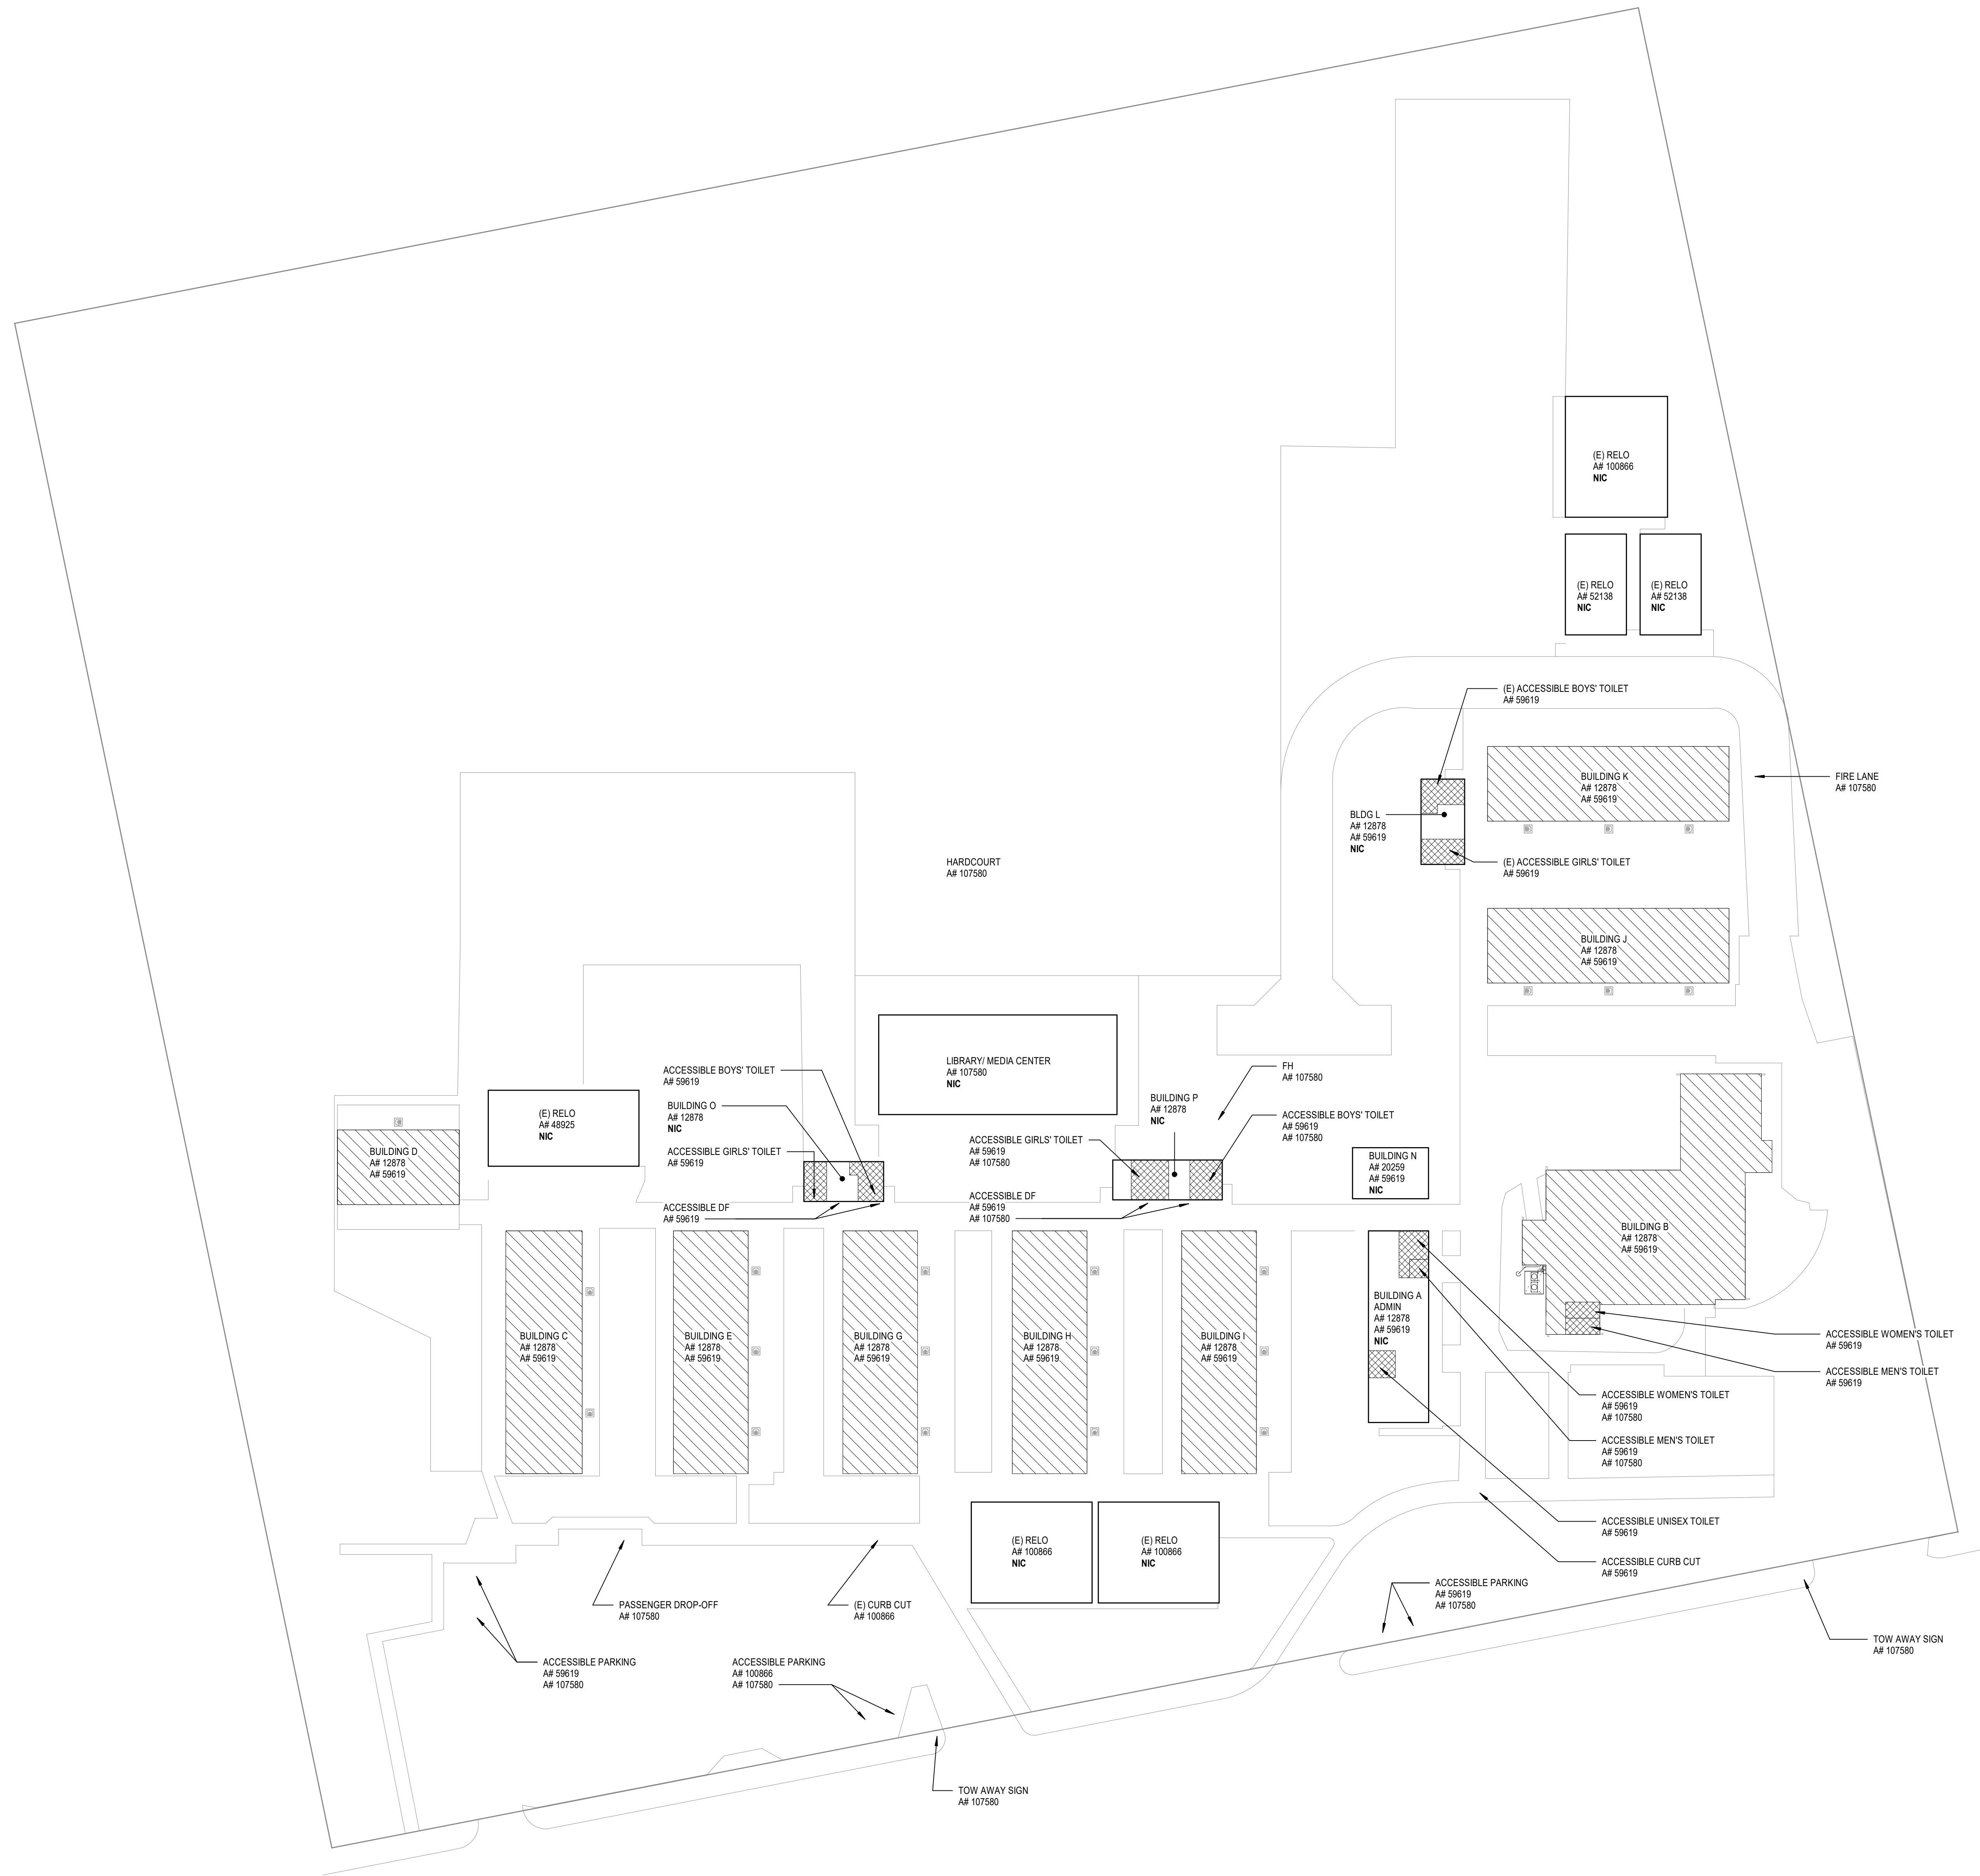

## SITE LEGEND

- EXISTING BUILDING NOT IN SCOPE
- EXISTING BUILDING - SCOPE OF WORK UNDER THIS DSA APPLICATION
- (E) RESTROOMS - NOT IN SCOPE



## WORKMAN ELEMENTARY SCHOOL

COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT


1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25  
ARCHITECTURAL  
SITE PLAN

A1.0

1. ALL INTERIOR CMU WALLS SHALL ARE TO REMAIN U.N.O.
2. SCRIBE (E) GYPSUM WALL BOARD OF WALLS AND PARTITIONS TO IRREGULARITIES OF DECK ABOVE. SEAL TIGHTLY AROUND ALL PENETRATIONS.

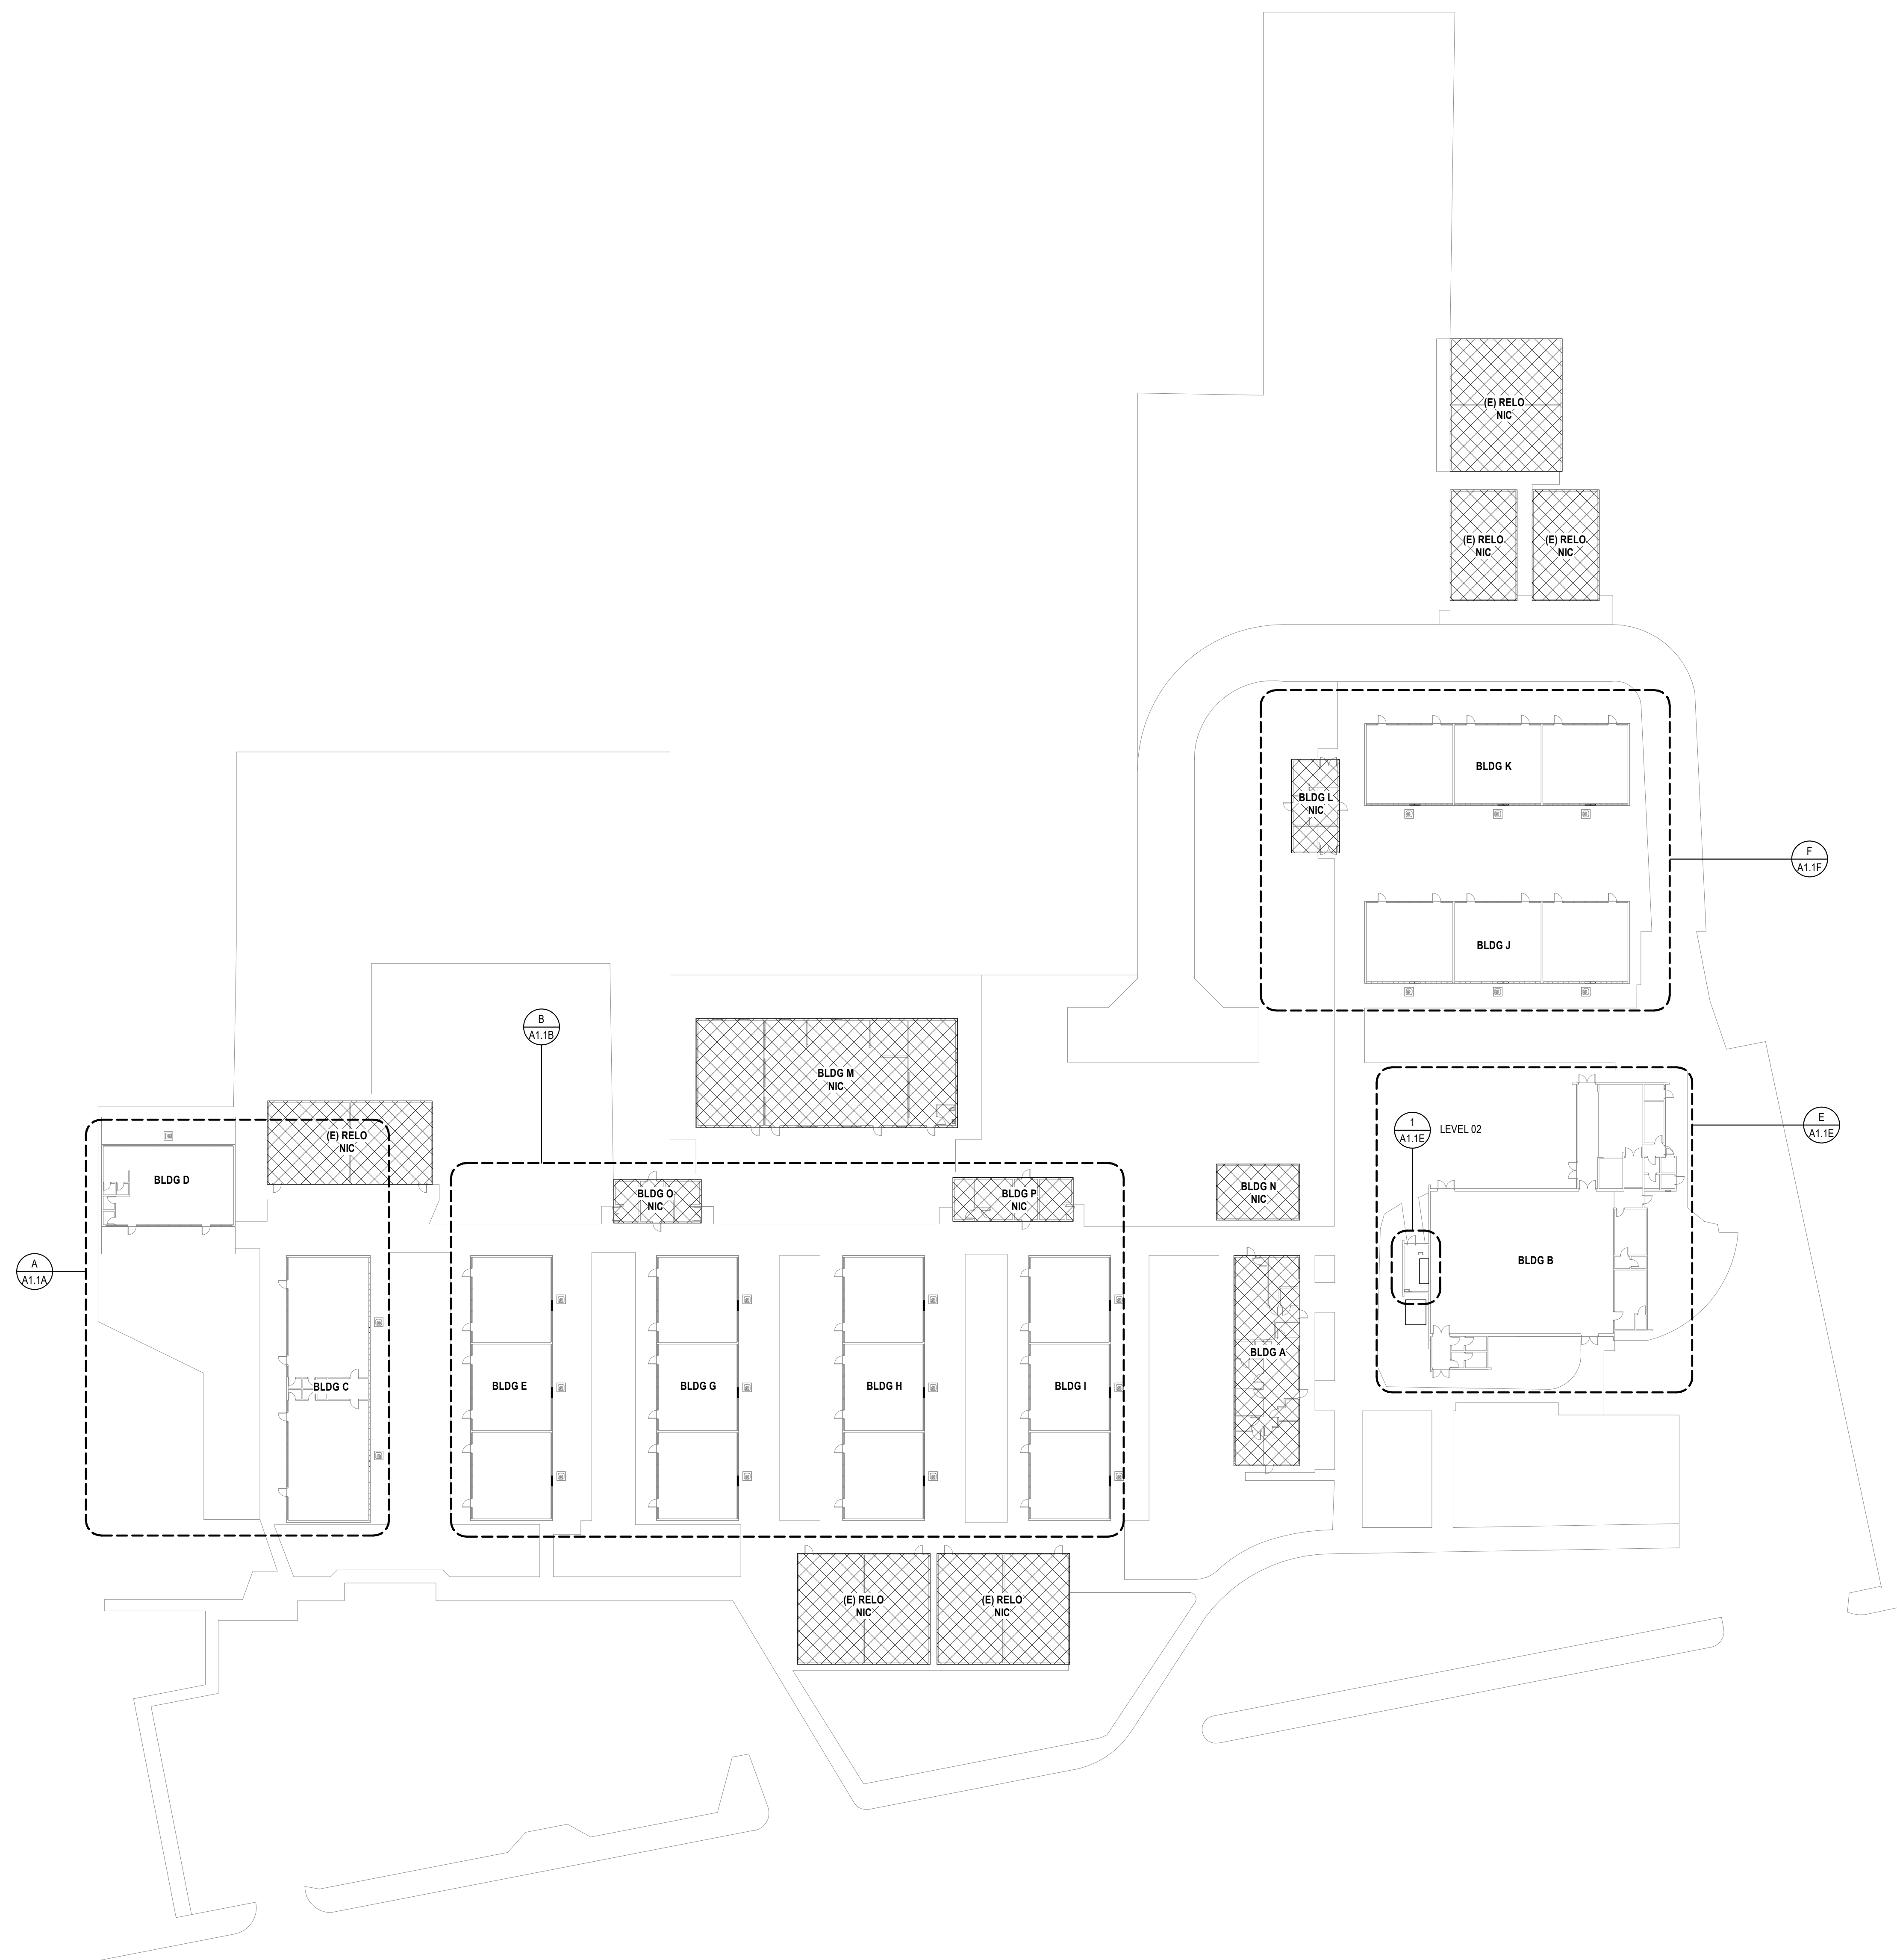

# ARCHITECTURAL SITE PLAN



Autodesk Docu/75-22605-40 CVUSD - District W&A/VC Replacement/75-22605-40 CVUSD - Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:24 AM


1

2


3

4


5

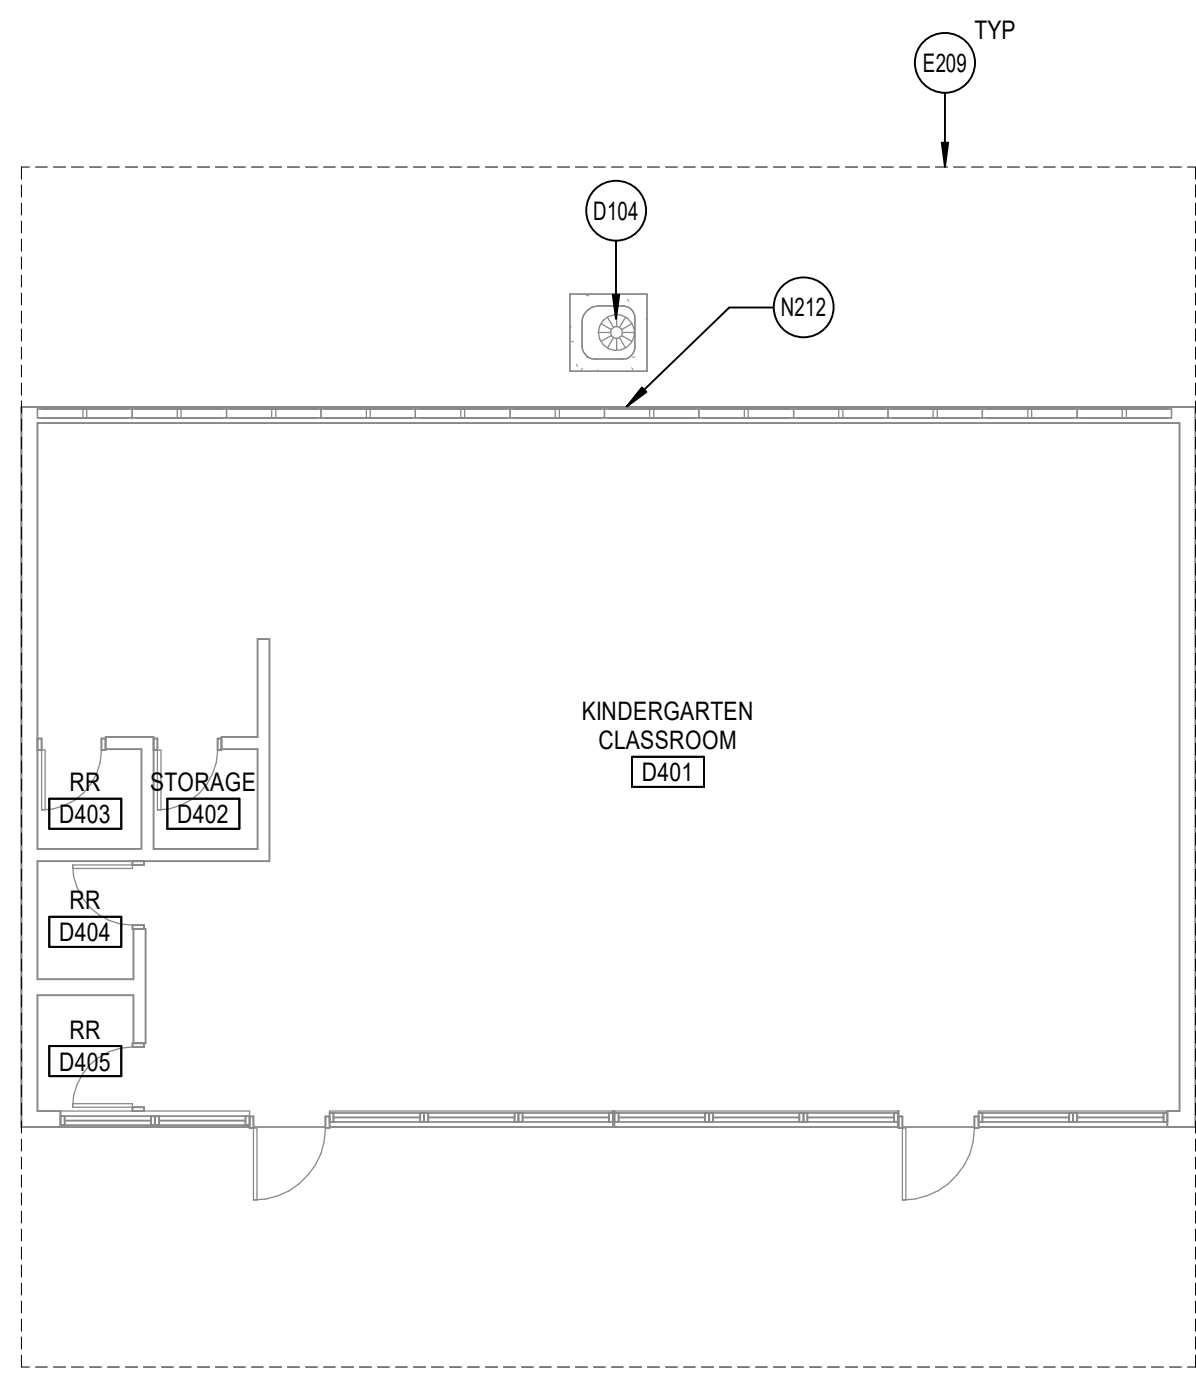

**BLDG. D**

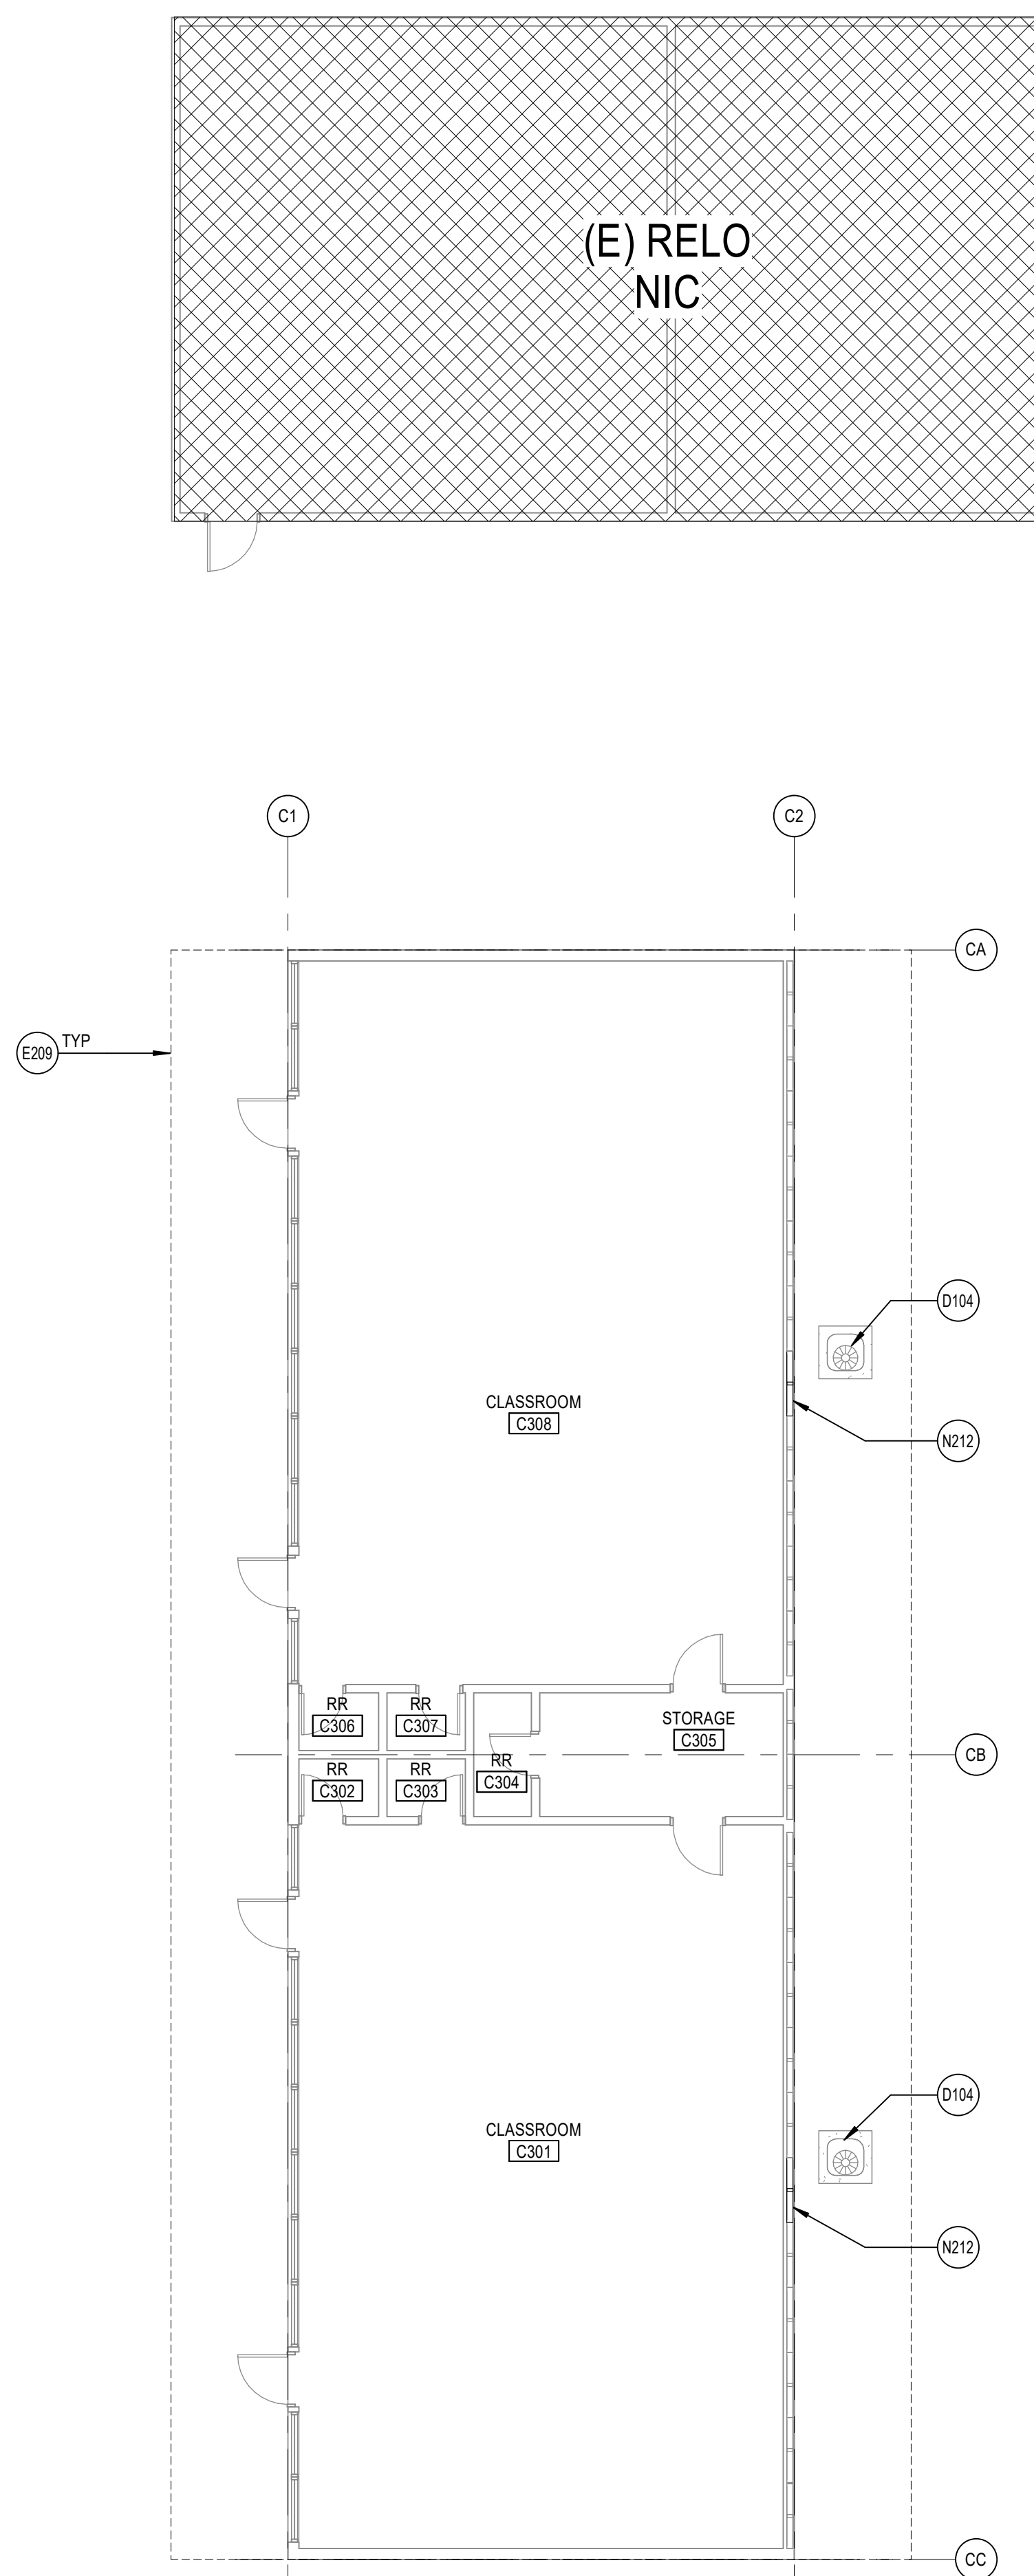

**BLDG. C**



**AREA A - FLOOR PLAN**

SCALE: 1/8" = 1'-0"

(E) RELO  
NIC

**REFERENCE KEYNOTES**

- D104 REMOVE (E) MECHANICAL EQUIP., EQUIP. CONC. PAD, & ITS ASSOCIATED PARTS. SEE MECHANICAL & PLUMBING DWG.
- E209 LINE OF (E) ROOF ABOVE SHOWN DASHED
- N212 REPLACE (E) INFILL PANEL AT CONDENSER UNIT PENETRATIONS WITH GLAZING TO MATCH ADJACENT. PAINT FRAME TO MATCH ADJACENT

**GENERAL ARCHITECTURAL NOTES**


1. ALL INTERIOR CMU WALLS SHALL ARE TO REMAIN U.N.O.
2. SCRIBE (E) GYPSUM WALL BOARD OF WALLS AND PARTITIONS TO IRREGULARITIES OF DECK ABOVE. SEAL TIGHTLY AROUND ALL PENETRATIONS.

**DEMOLITION GENERAL NOTES**

DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.

THE CONTRACTOR SHALL:

- A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
- B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
- C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
- D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
- E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
- G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
- H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
- I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
- J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
- K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
- L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
- M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
- N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
- O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
- P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
- Q. WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

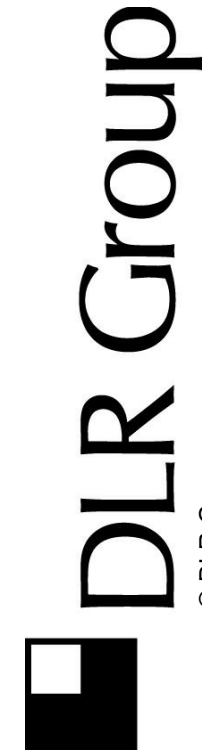

**WORKMAN ELEMENTARY SCHOOL**  
COVID 19 - COVINA VALLEY USD DISTRIC WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

**100% CONSTRUCTION DOCUMENTS**  
11/04/2022  
REVISIONS


75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

**AREA A - FLOOR PLAN**

**A1.1A**




Autodesk Docu/75-22605-40 CVUSD - District Widespread/15-22605-40 CVUSD - Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:26 AM



AREA B - FLOOR PLAN

SCALE: 1/8" = 1'-0"

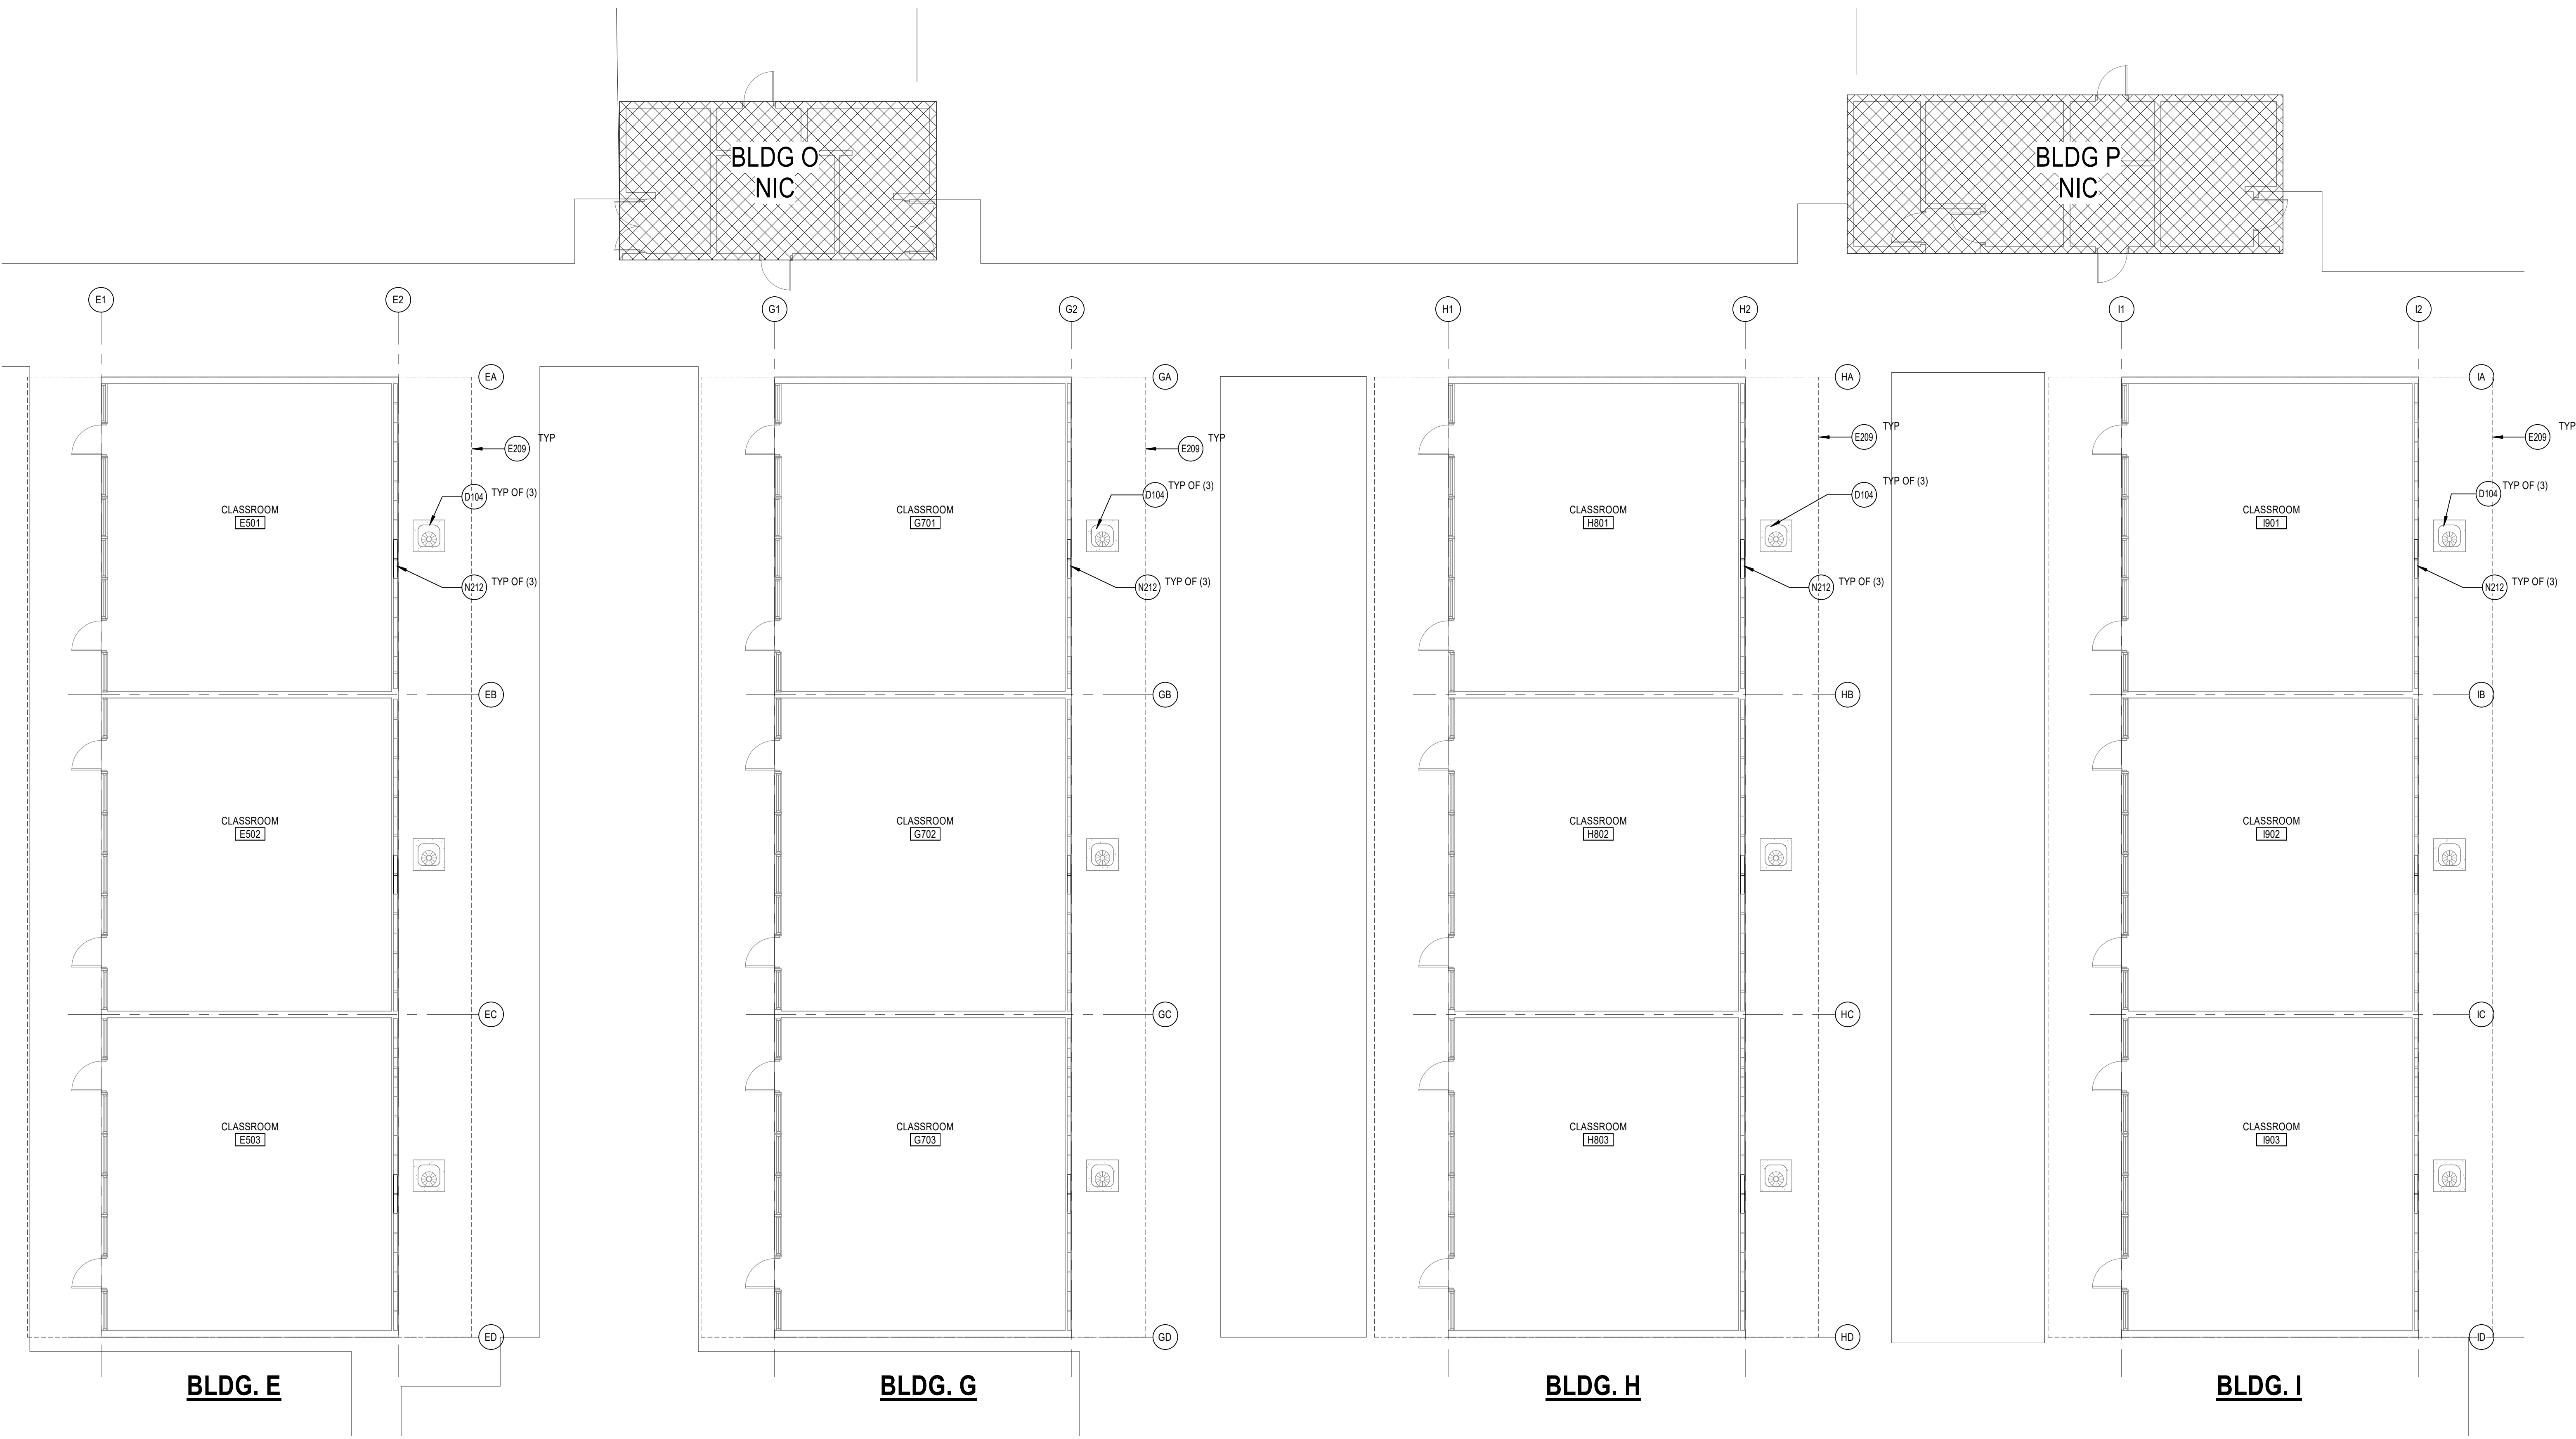

REFERENCE KEYNOTES


- D104 REMOVE (E) MECHANICAL EQUIP., EQUIP. CONC. PAD, & ITS ASSOCIATED PARTS. SEE MECHANICAL & PLUMBING DWG.  
N212 REPLACE (E) INFILL PANEL AT CONDENSER UNIT PENETRATIONS WITH GLAZING TO MATCH ADJACENT. PAINT FRAME TO MATCH ADJACENT.

GENERAL ARCHITECTURAL NOTES

1. ALL INTERIOR CMU WALLS SHALL BE TO REMAIN U.N.O.  
2. SCRIBE (E) GYPSUM WALL BOARD OF WALLS AND PARTITIONS TO IRREGULARITIES OF DECK ABOVE. SEAL TIGHTLY AROUND ALL PENETRATIONS.

DEMOLITION GENERAL NOTES

- DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.
- THE CONTRACTOR SHALL:
- A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
- B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
- C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
- D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
- E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
- G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
- H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
- I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
- J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
- K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
- L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
- M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
- N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
- O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
- P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
- Q. WHERE PLASTER/STUCCO WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

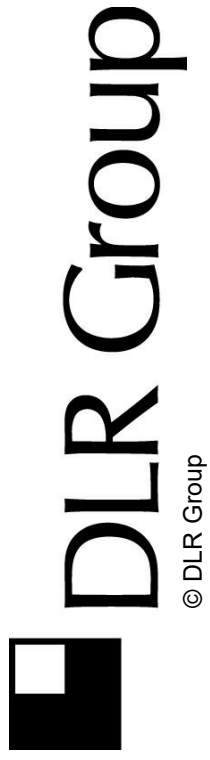

WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

AREA B - FLOOR  
PLAN

A1.1B



Autodesk Docu/75-22605-40 CVUSD - District W&S n/A/C Replacement/75-22605-40 CVUSD Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:26 AM


1

2


3

4


5

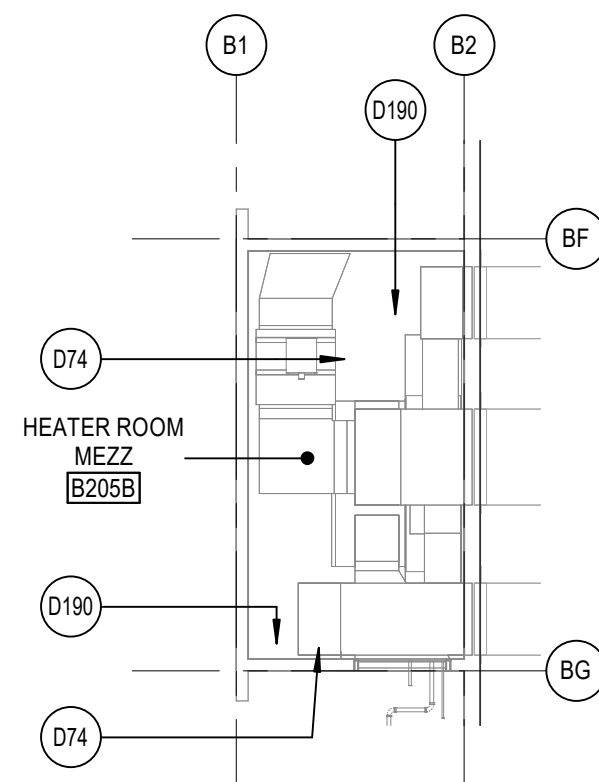


1 BUILDING B - LEVEL 02  
SCALE: 1/8" = 1'-0"




AREA E - FLOOR PLAN  
SCALE: 1/8" = 1'-0"

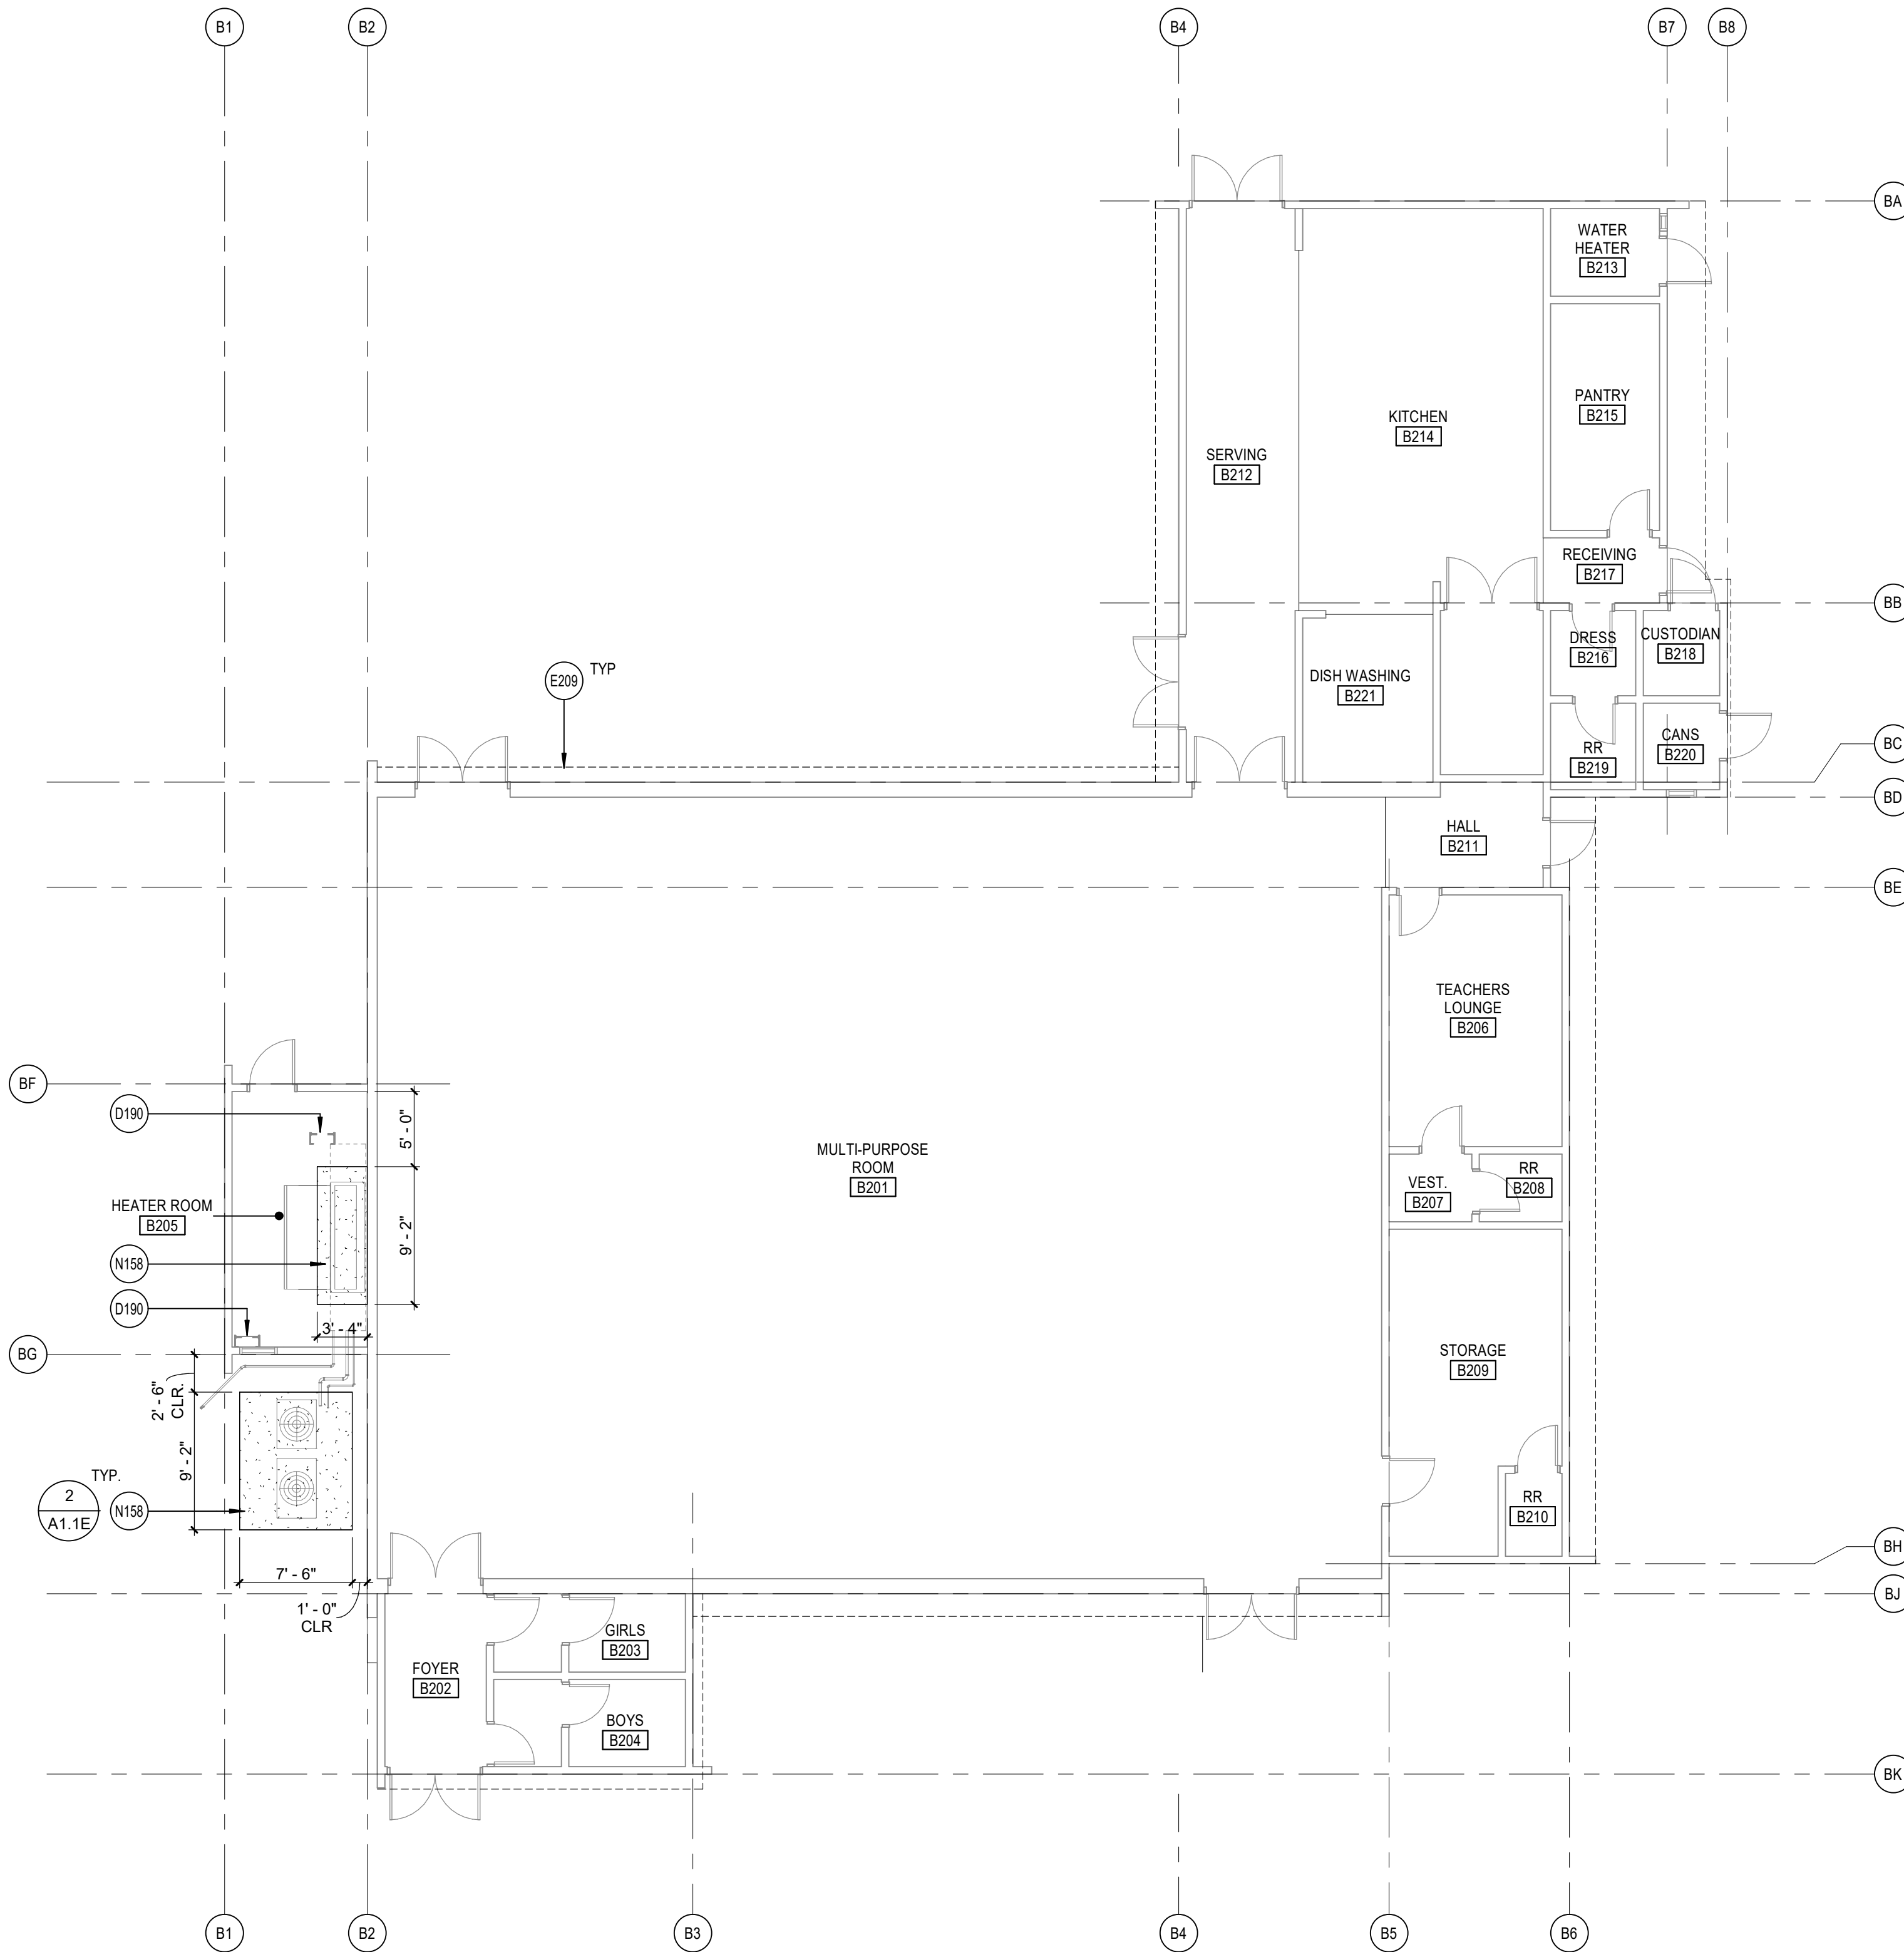

BLDG. B

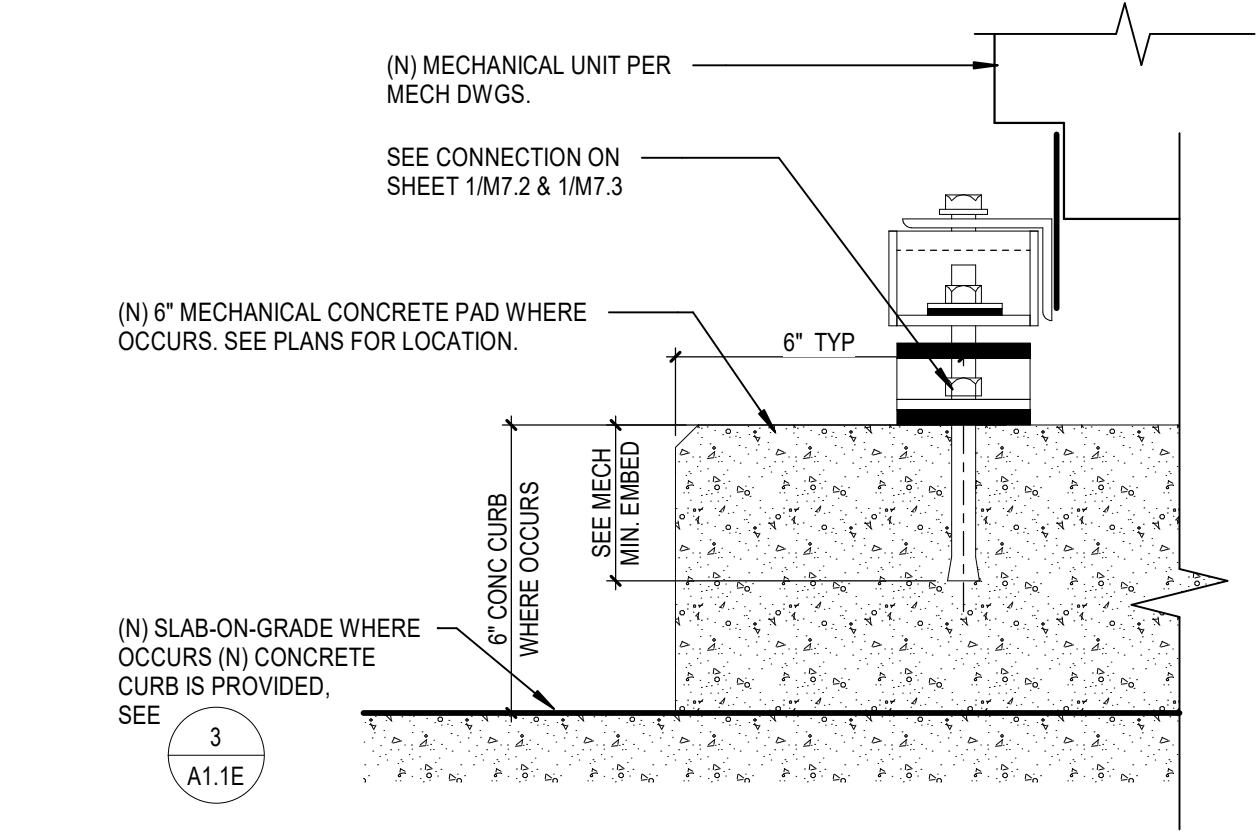

2 MECH. ANCHORAGE AT CONC. CURB  
SCALE: 3" = 1'-0"

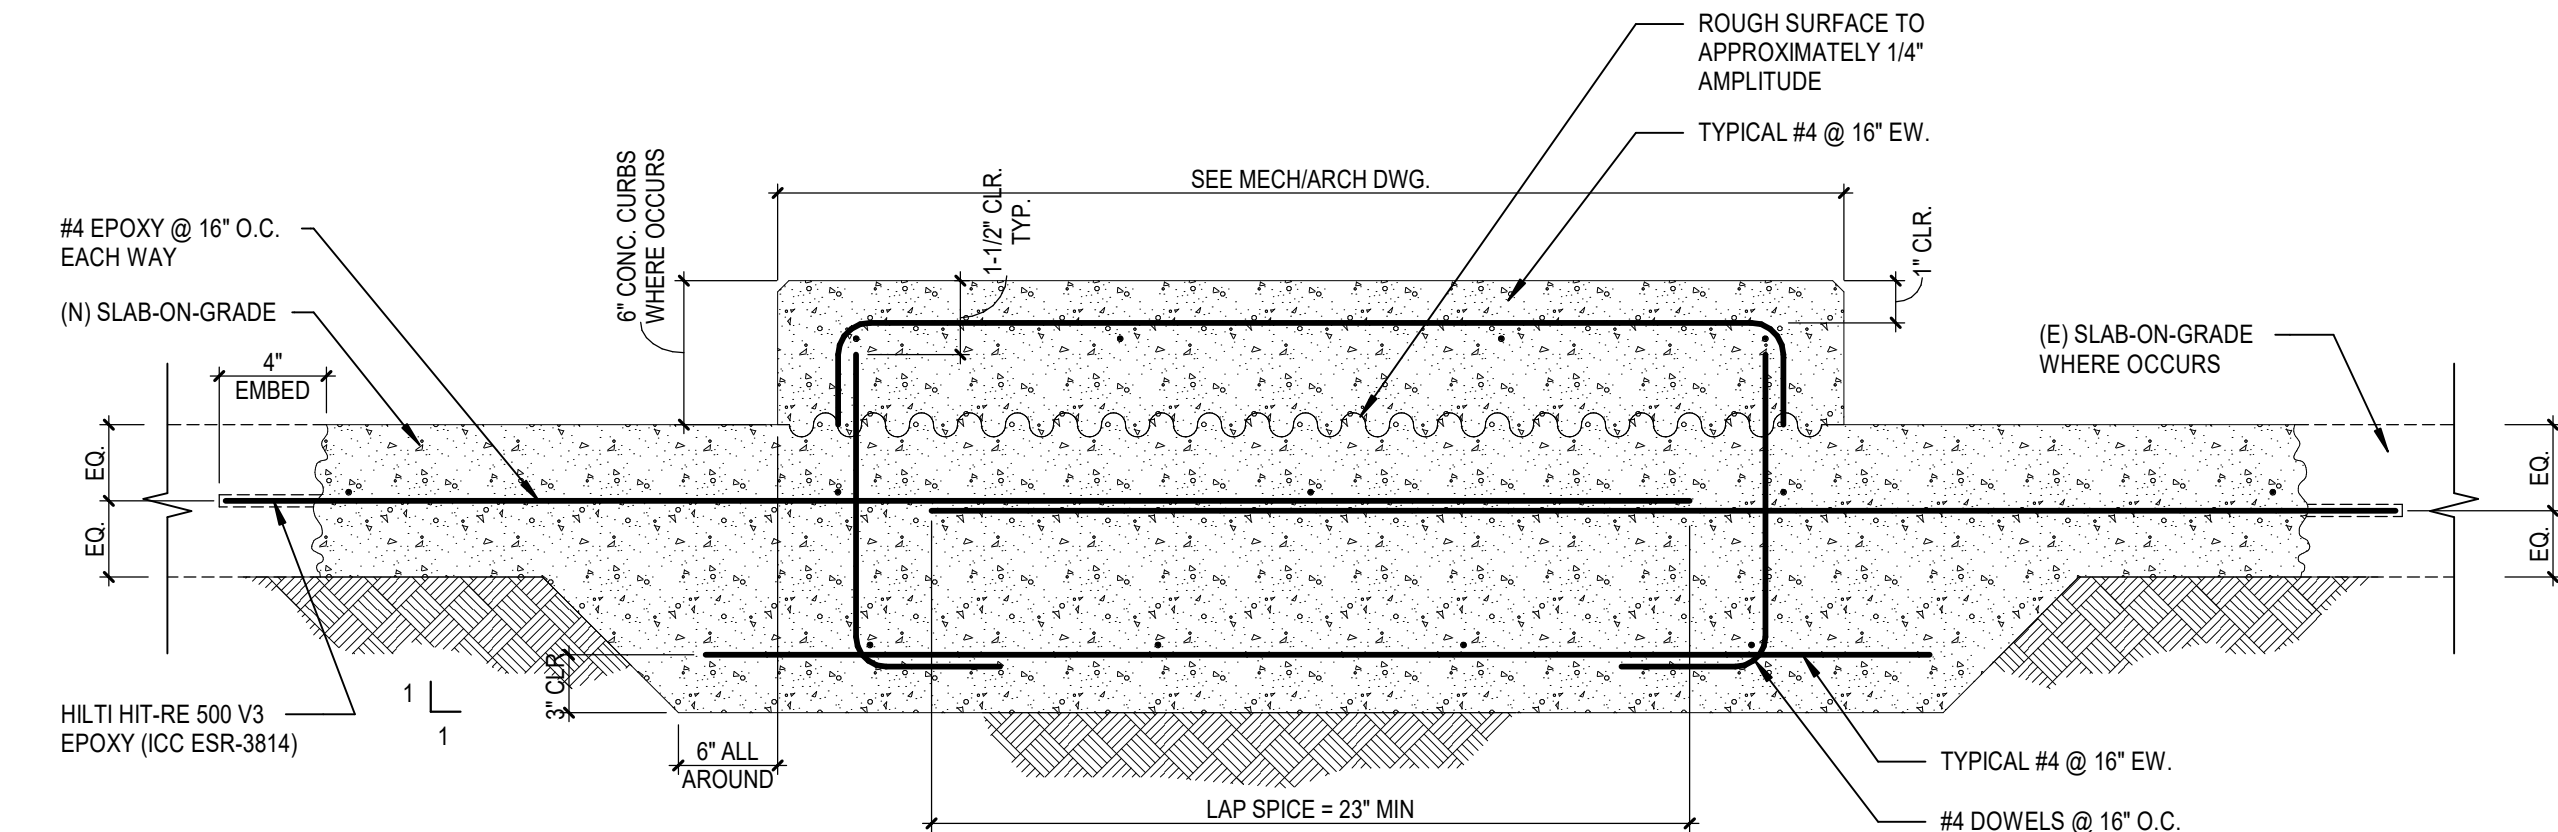

3 TYPICAL MECH. EQUIPMENT CONCRETE PAD AT (E) SLAB-ON-GRADE  
SCALE: 1 1/2" = 1'-0"

## REFERENCE KEYNOTES

- D74 DEMO (E) MEZZANINE PLATFORM IN ITS ENTIRETY. PATCH AND REPAIR ADJACENT WALL AS REQUIRED.  
D190 REMOVE (E) LADDER  
E209 LINE OF (E) ROOF ABOVE SHOWN DASHED  
N158 NEW MECHANICAL EQUIPMENT ON NEW 6" THK. TOP LEVELED CONCRETE PAD & PLACED 6" FROM EDGE OF PAD. SEE MECH DWGS.

## GENERAL ARCHITECTURAL NOTES

1. ALL INTERIOR CMU WALLS SHALL BE TO REMAIN U.N.O.  
2. SCRIBE (E) GYPSUM WALL BOARD OF WALLS AND PARTITIONS TO IRREGULARITIES OF DECK ABOVE. SEAL TIGHTLY AROUND ALL PENETRATIONS.

## DEMOLITION GENERAL NOTES

DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.


- THE CONTRACTOR SHALL:
- A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
- B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
- C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
- D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
- E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
- G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
- H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
- I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
- J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
- K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
- L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
- M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
- N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
- O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
- P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
- Q. WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25  
AREA E - FLOOR  
PLAN

A1.1E

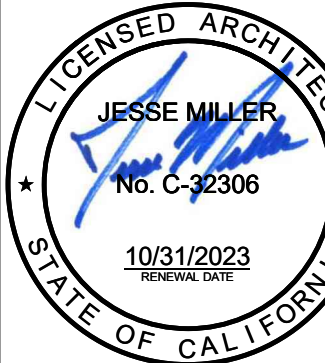


DLR Group  
© DLR Group

1941 E. WORKMAN AVE. WEST COVINA, CA 91791





Autodesk Docu/75-22605-00 CVUSD - District W&S n\VC\Replacement\75-22605-00\_CVUSD\_Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:27 AM




AREA F - FLOOR PLAN

SCALE: 1/8" = 1'-0"

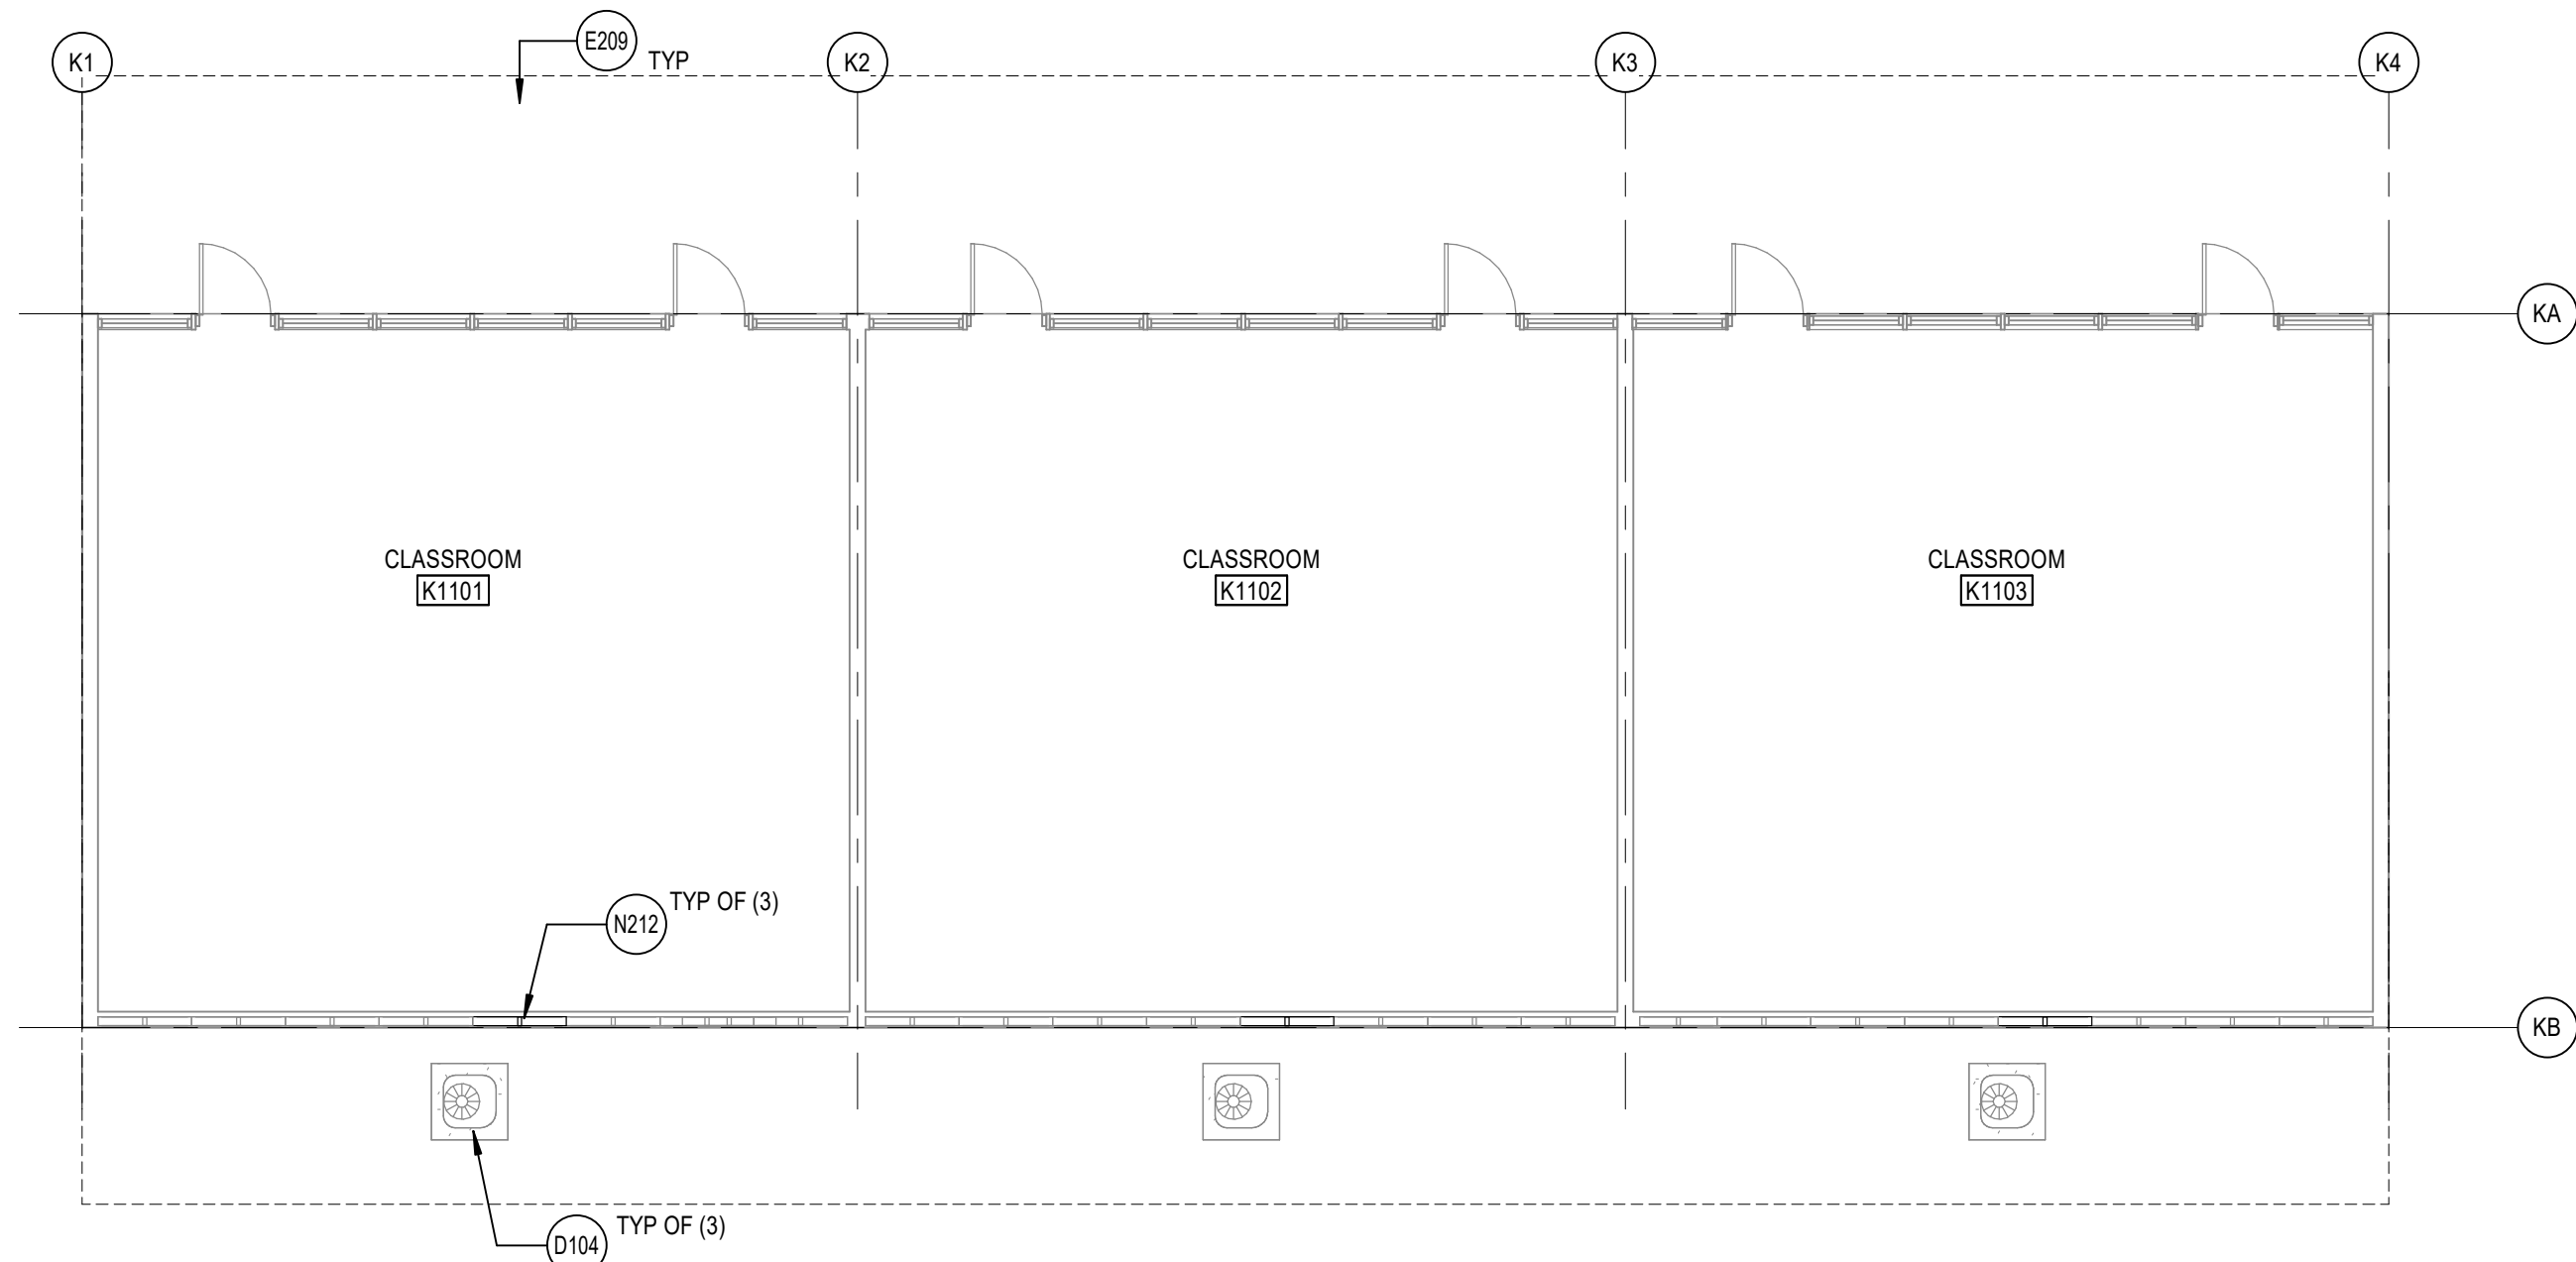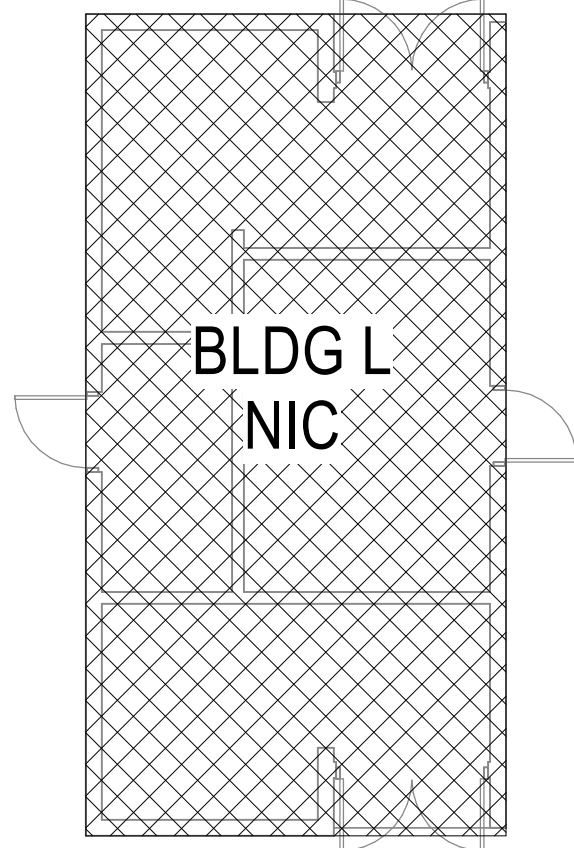

**BLDG. K**

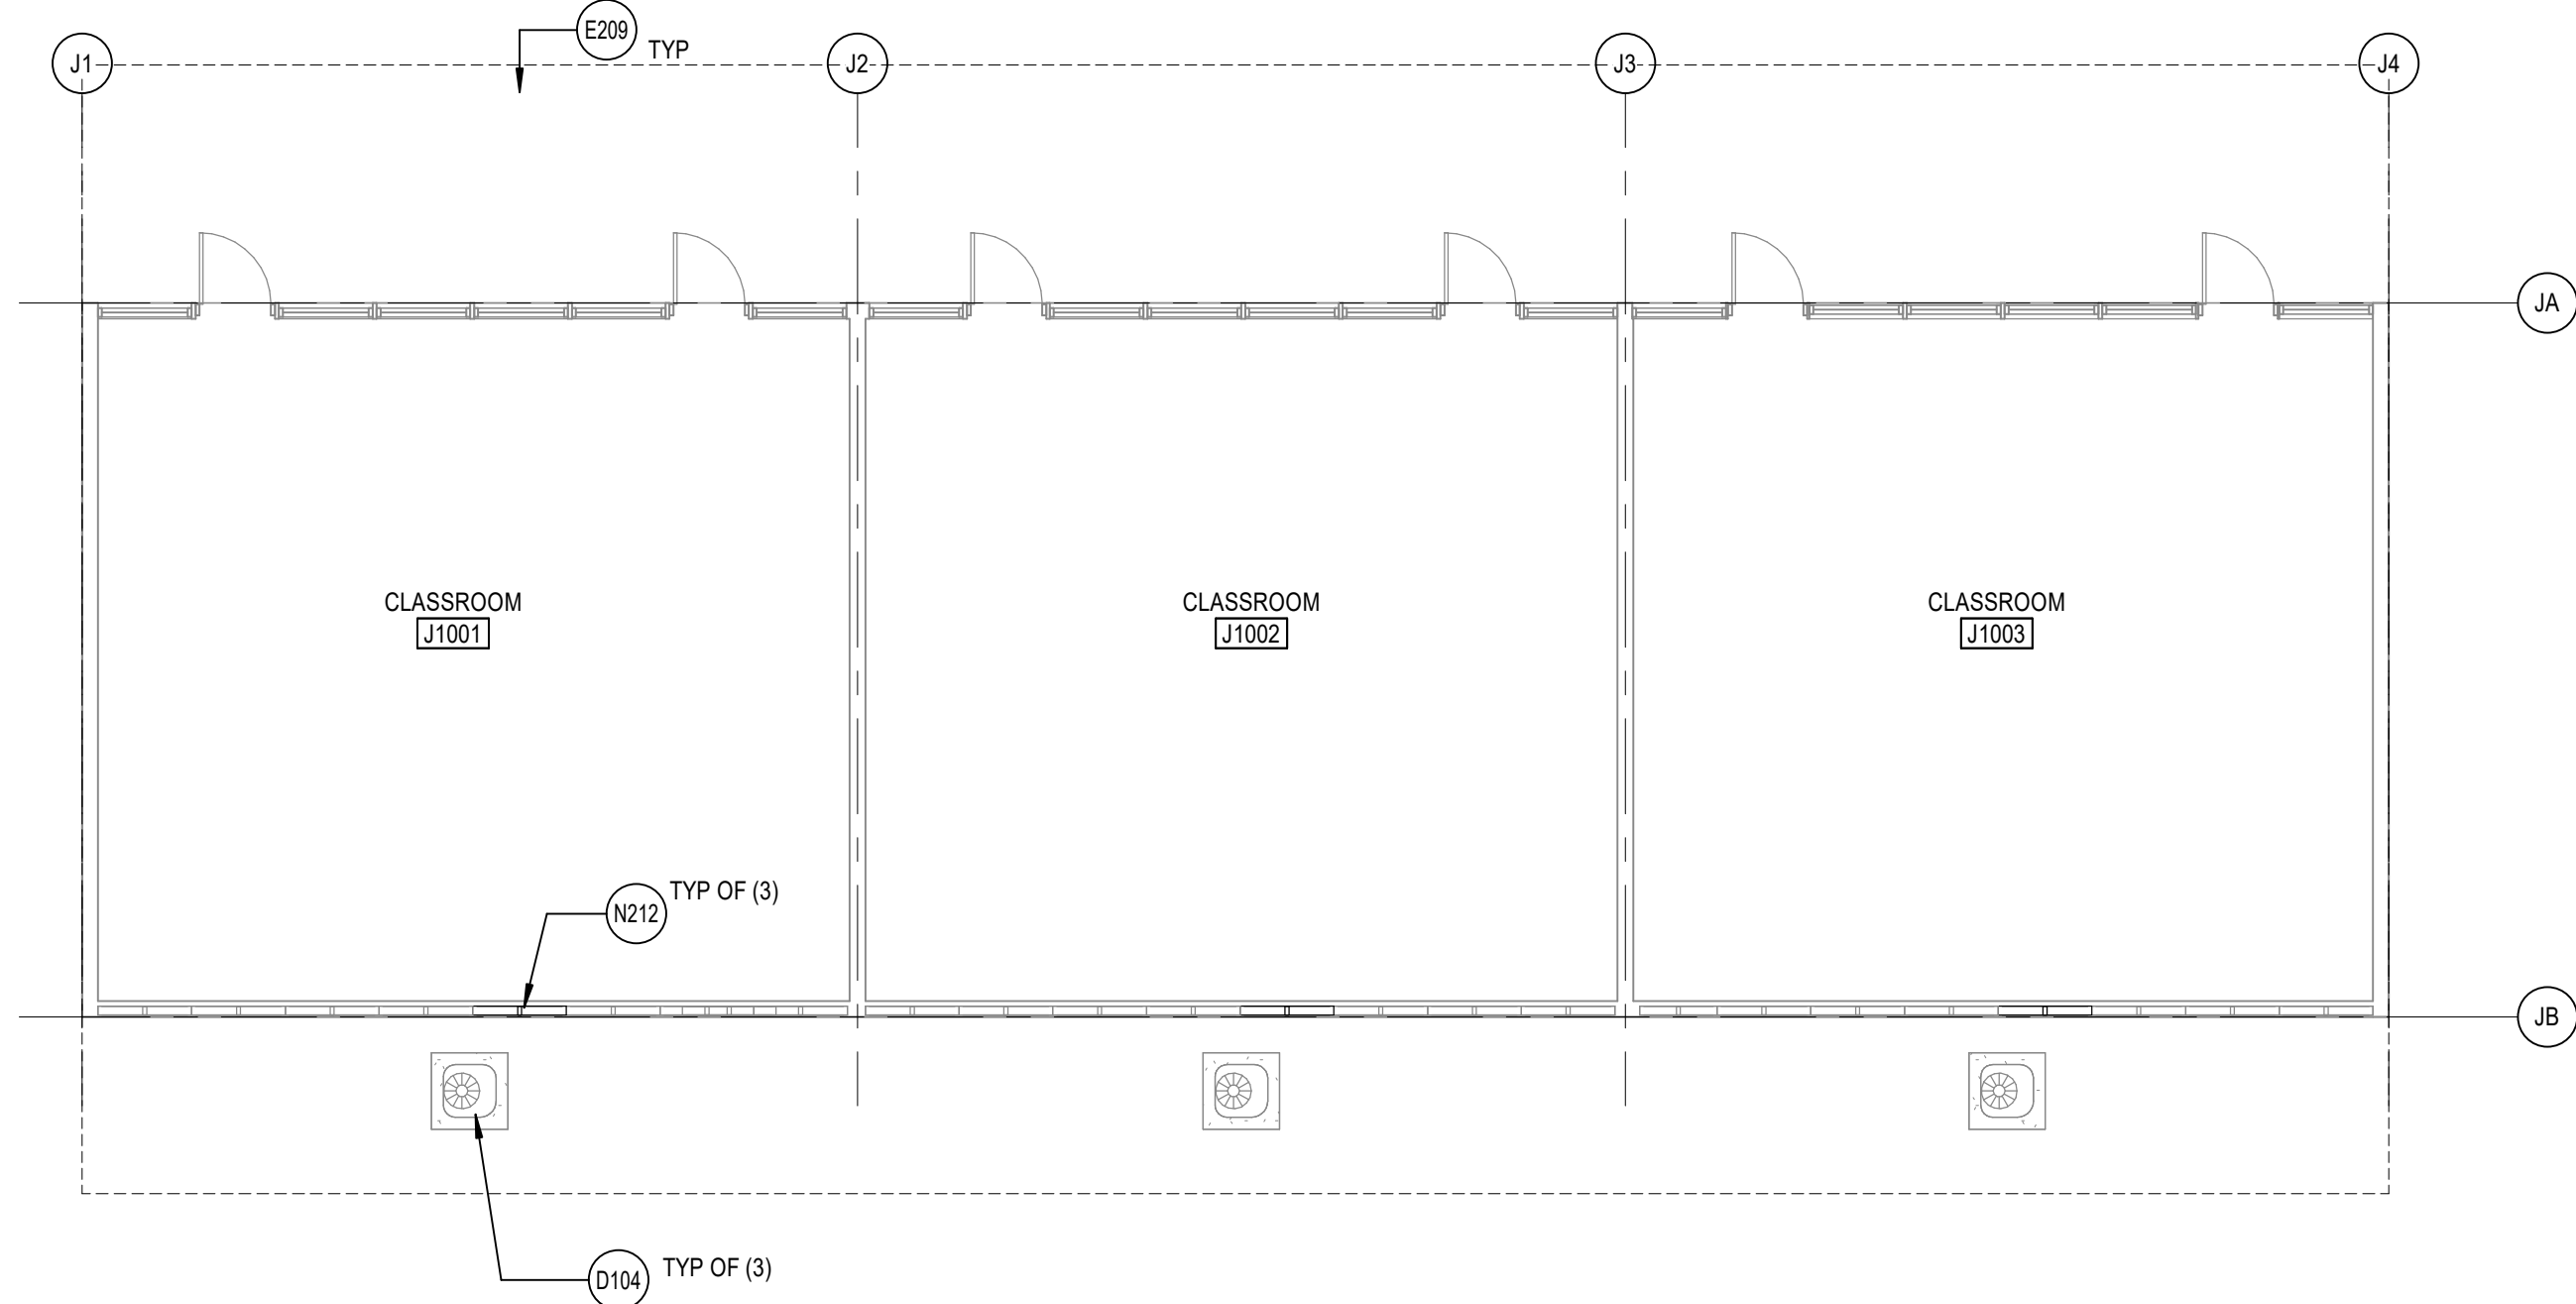

**BLDG. J**

REFERENCE KEYNOTES

- D104 REMOVE (E) MECHANICAL EQUIP., EQUIP. CONC. PAD, & ITS ASSOCIATED PARTS. SEE MECHANICAL & PLUMBING DWG.
- N212 REPLACE (E) INFILL PANEL AT CONDENSER UNIT PENETRATIONS WITH GLAZING TO MATCH ADJACENT. PAINT FRAME TO MATCH ADJACENT

GENERAL ARCHITECTURAL NOTES

1. ALL INTERIOR CMU WALLS SHALL ARE TO REMAIN U.N.O.
2. SCRIBE (E) GYPSUM WALL BOARD OF WALLS AND PARTITIONS TO IRREGULARITIES OF DECK ABOVE. SEAL TIGHTLY AROUND ALL PENETRATIONS.

DEMOLITION GENERAL NOTES

DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.

THE CONTRACTOR SHALL:

- A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
- B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
- C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
- D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
- E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
- G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
- H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
- I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
- J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
- K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
- L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
- M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
- N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
- O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
- P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
- Q. WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.



WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRIC WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS


75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

AREA F - FLOOR  
PLAN

A1.1F




Autodesk Docu/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD\_Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:27 AM




OVERALL ROOF PLAN

SCALE: 3/64" = 1'-0"

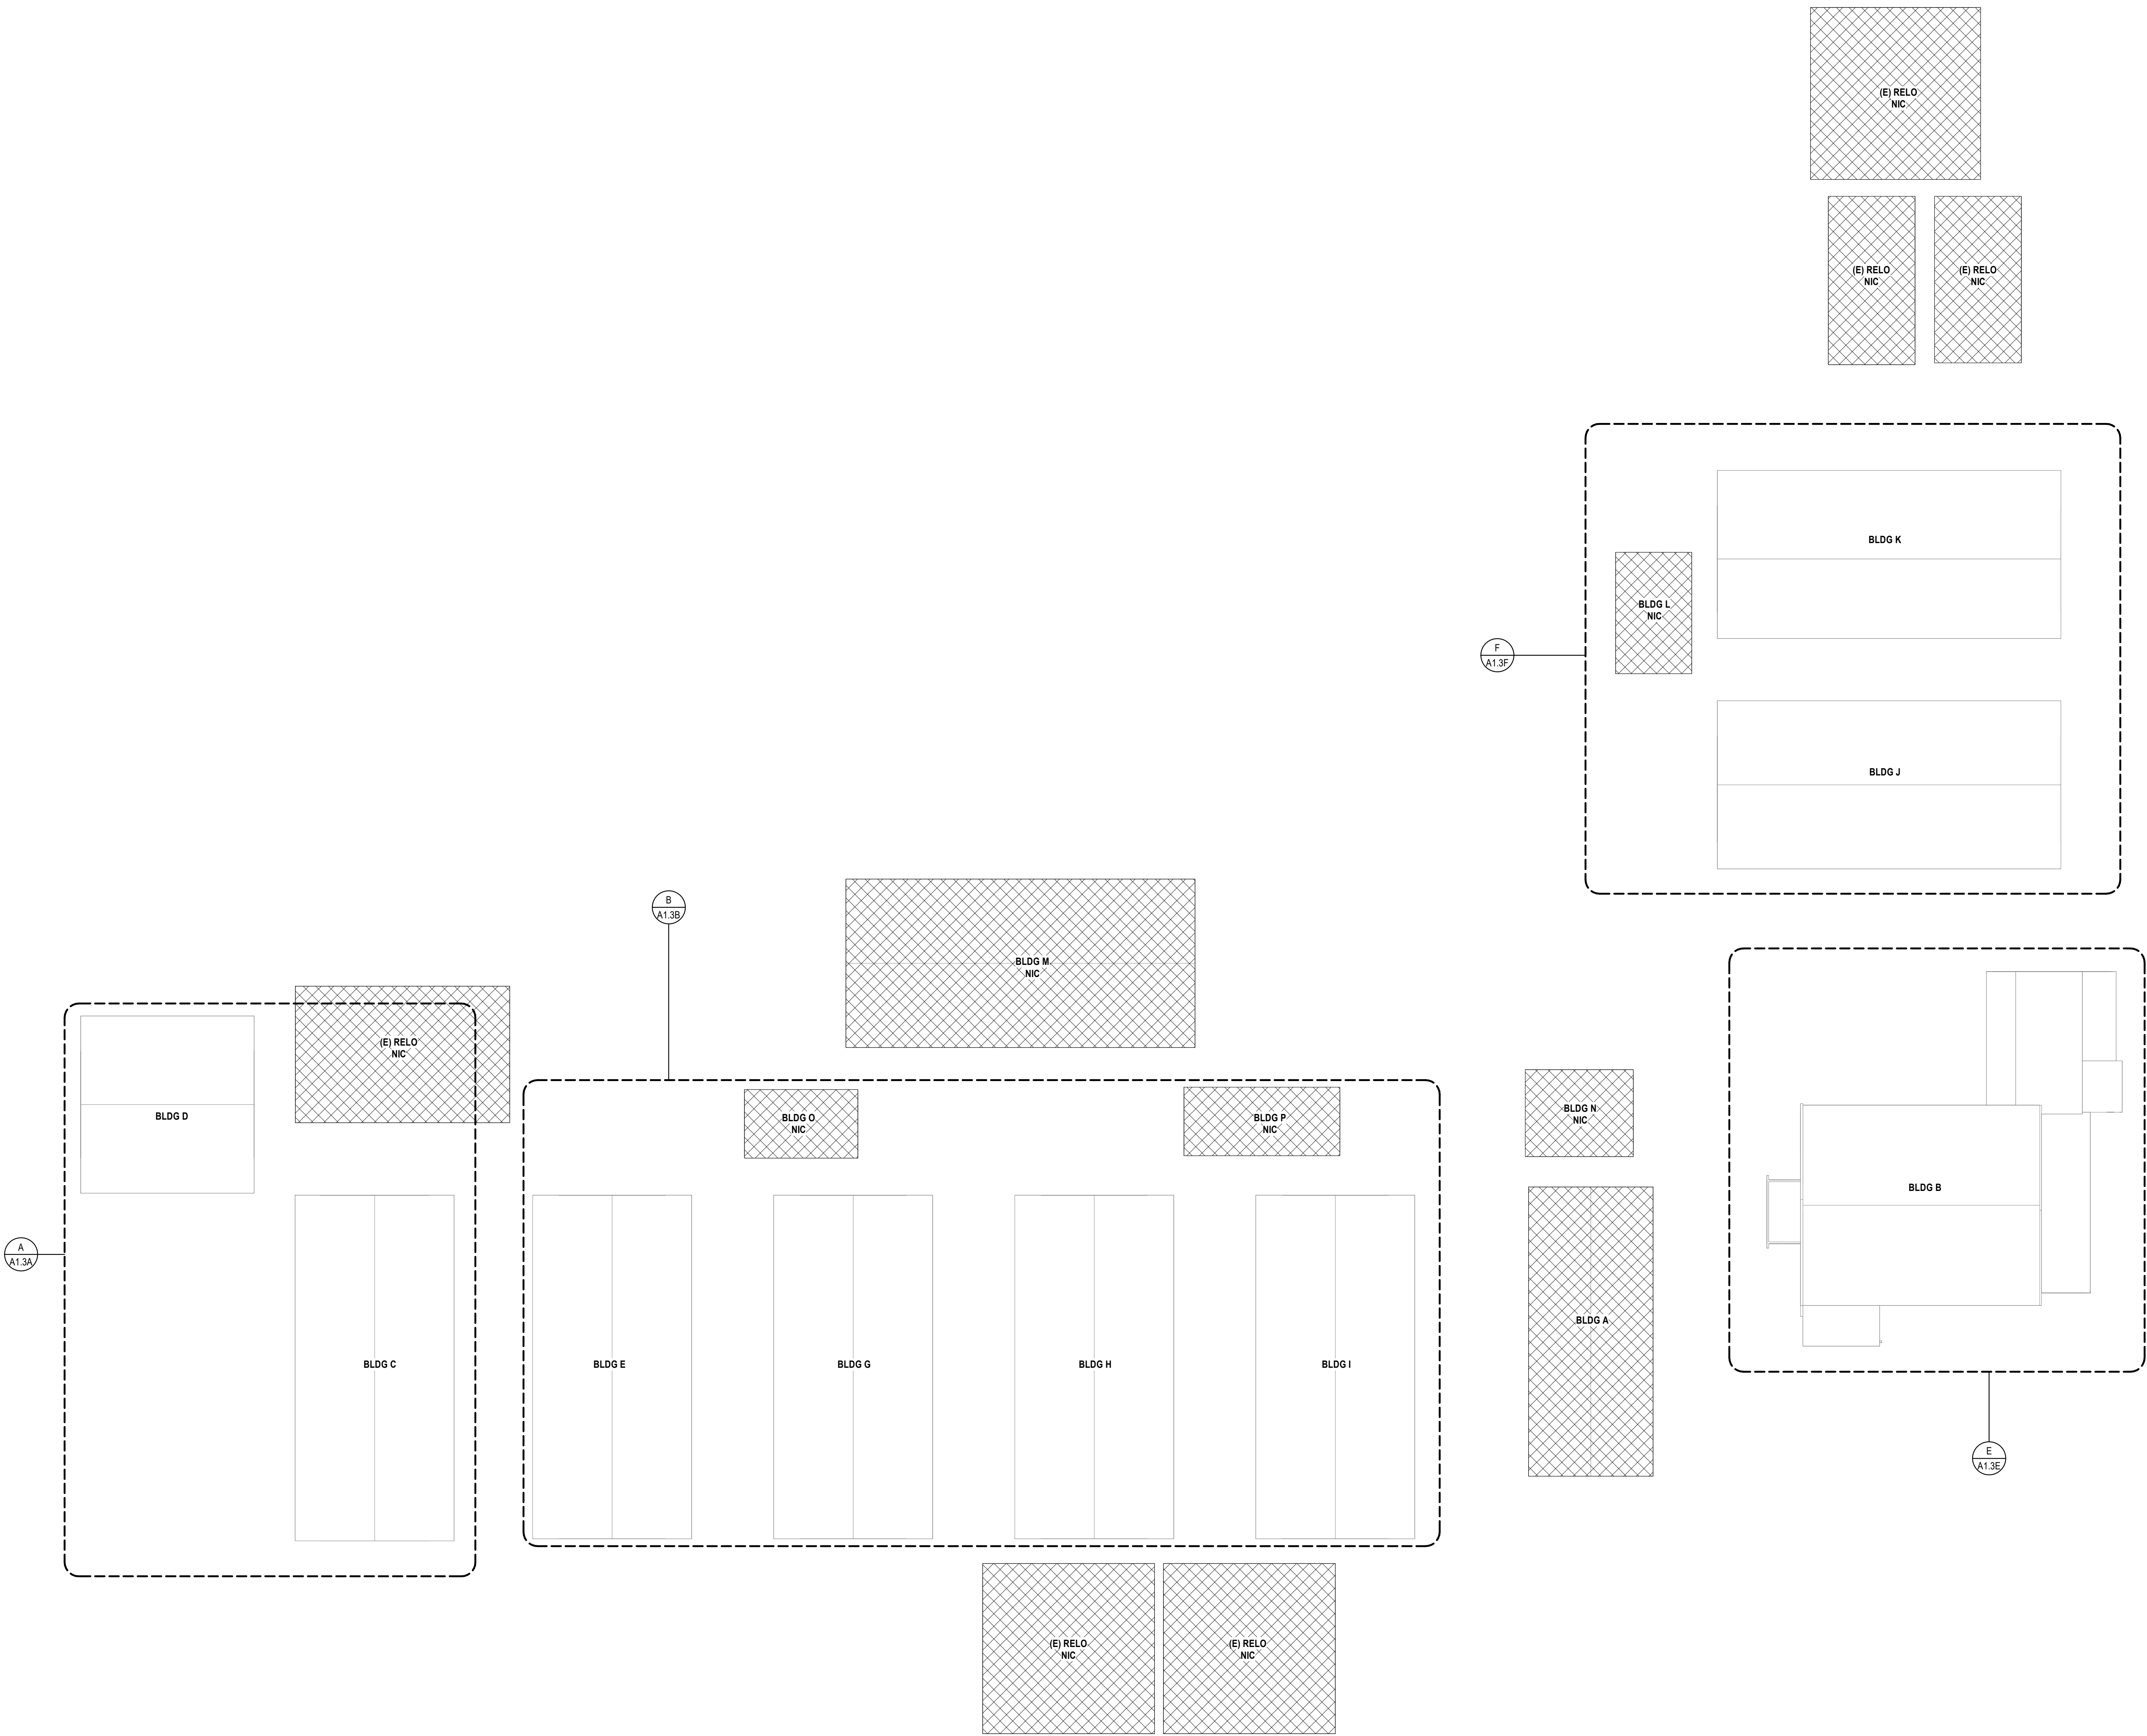

ROOF PLAN GENERAL NOTES

- A. (E) ROOF CURBS TO REMAIN U.N.O. SEE MECHANICAL DRAWINGS SHEET M1.3B AND M1.3D FOR ADDITIONAL INFORMATION.  
B. COORDINATE THE SIZE AND LOCATION OF WALL PENETRATIONS FOR MECHANICAL AND ELECTRICAL EQUIPMENT. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR PENETRATIONS NOT SHOWN ON THIS DRAWING.  
C. (E) DRAINS, CURBS, VENTS AND STACKS TO REMAINS.

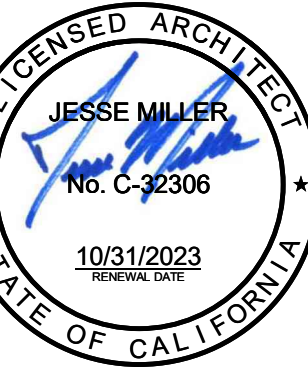

WORKMAN ELEMENTARY SCHOOL

COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25  
OVERALL ROOF  
PLAN

A1.3



A


B

C


D

E

F

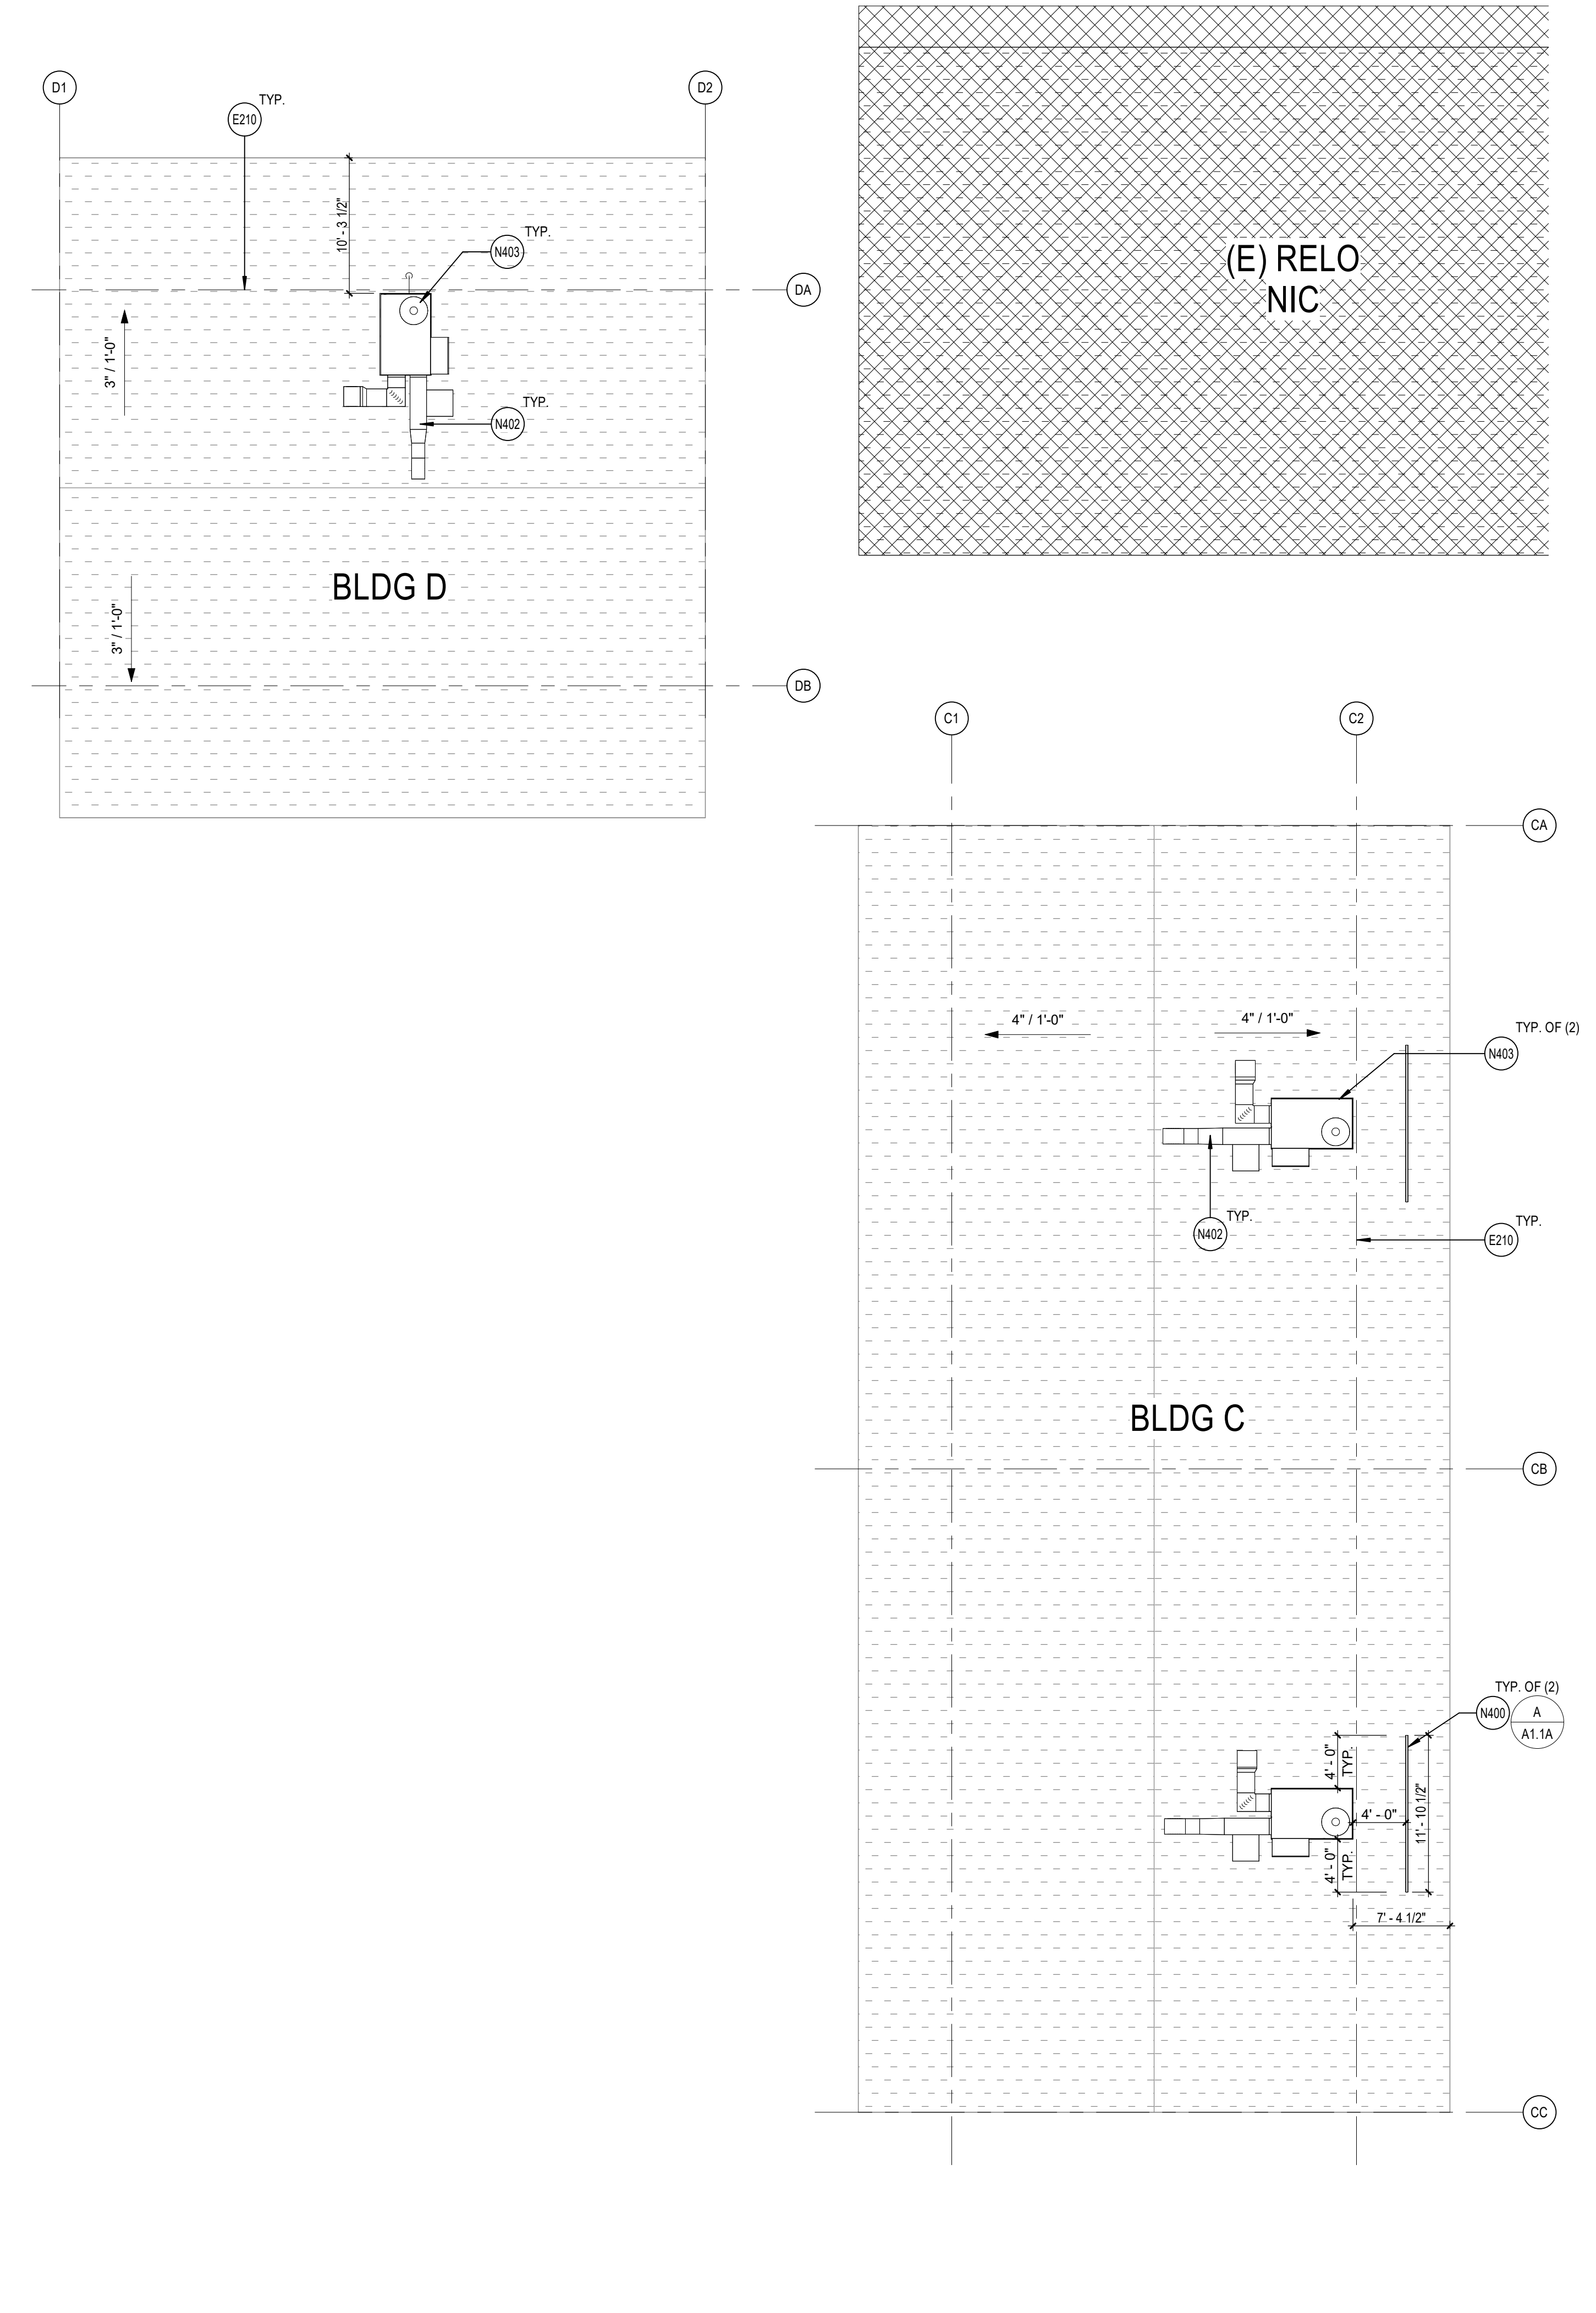

 **AREA A - ROOF PLAN**  
SCALE: 1/8" = 1'-0"

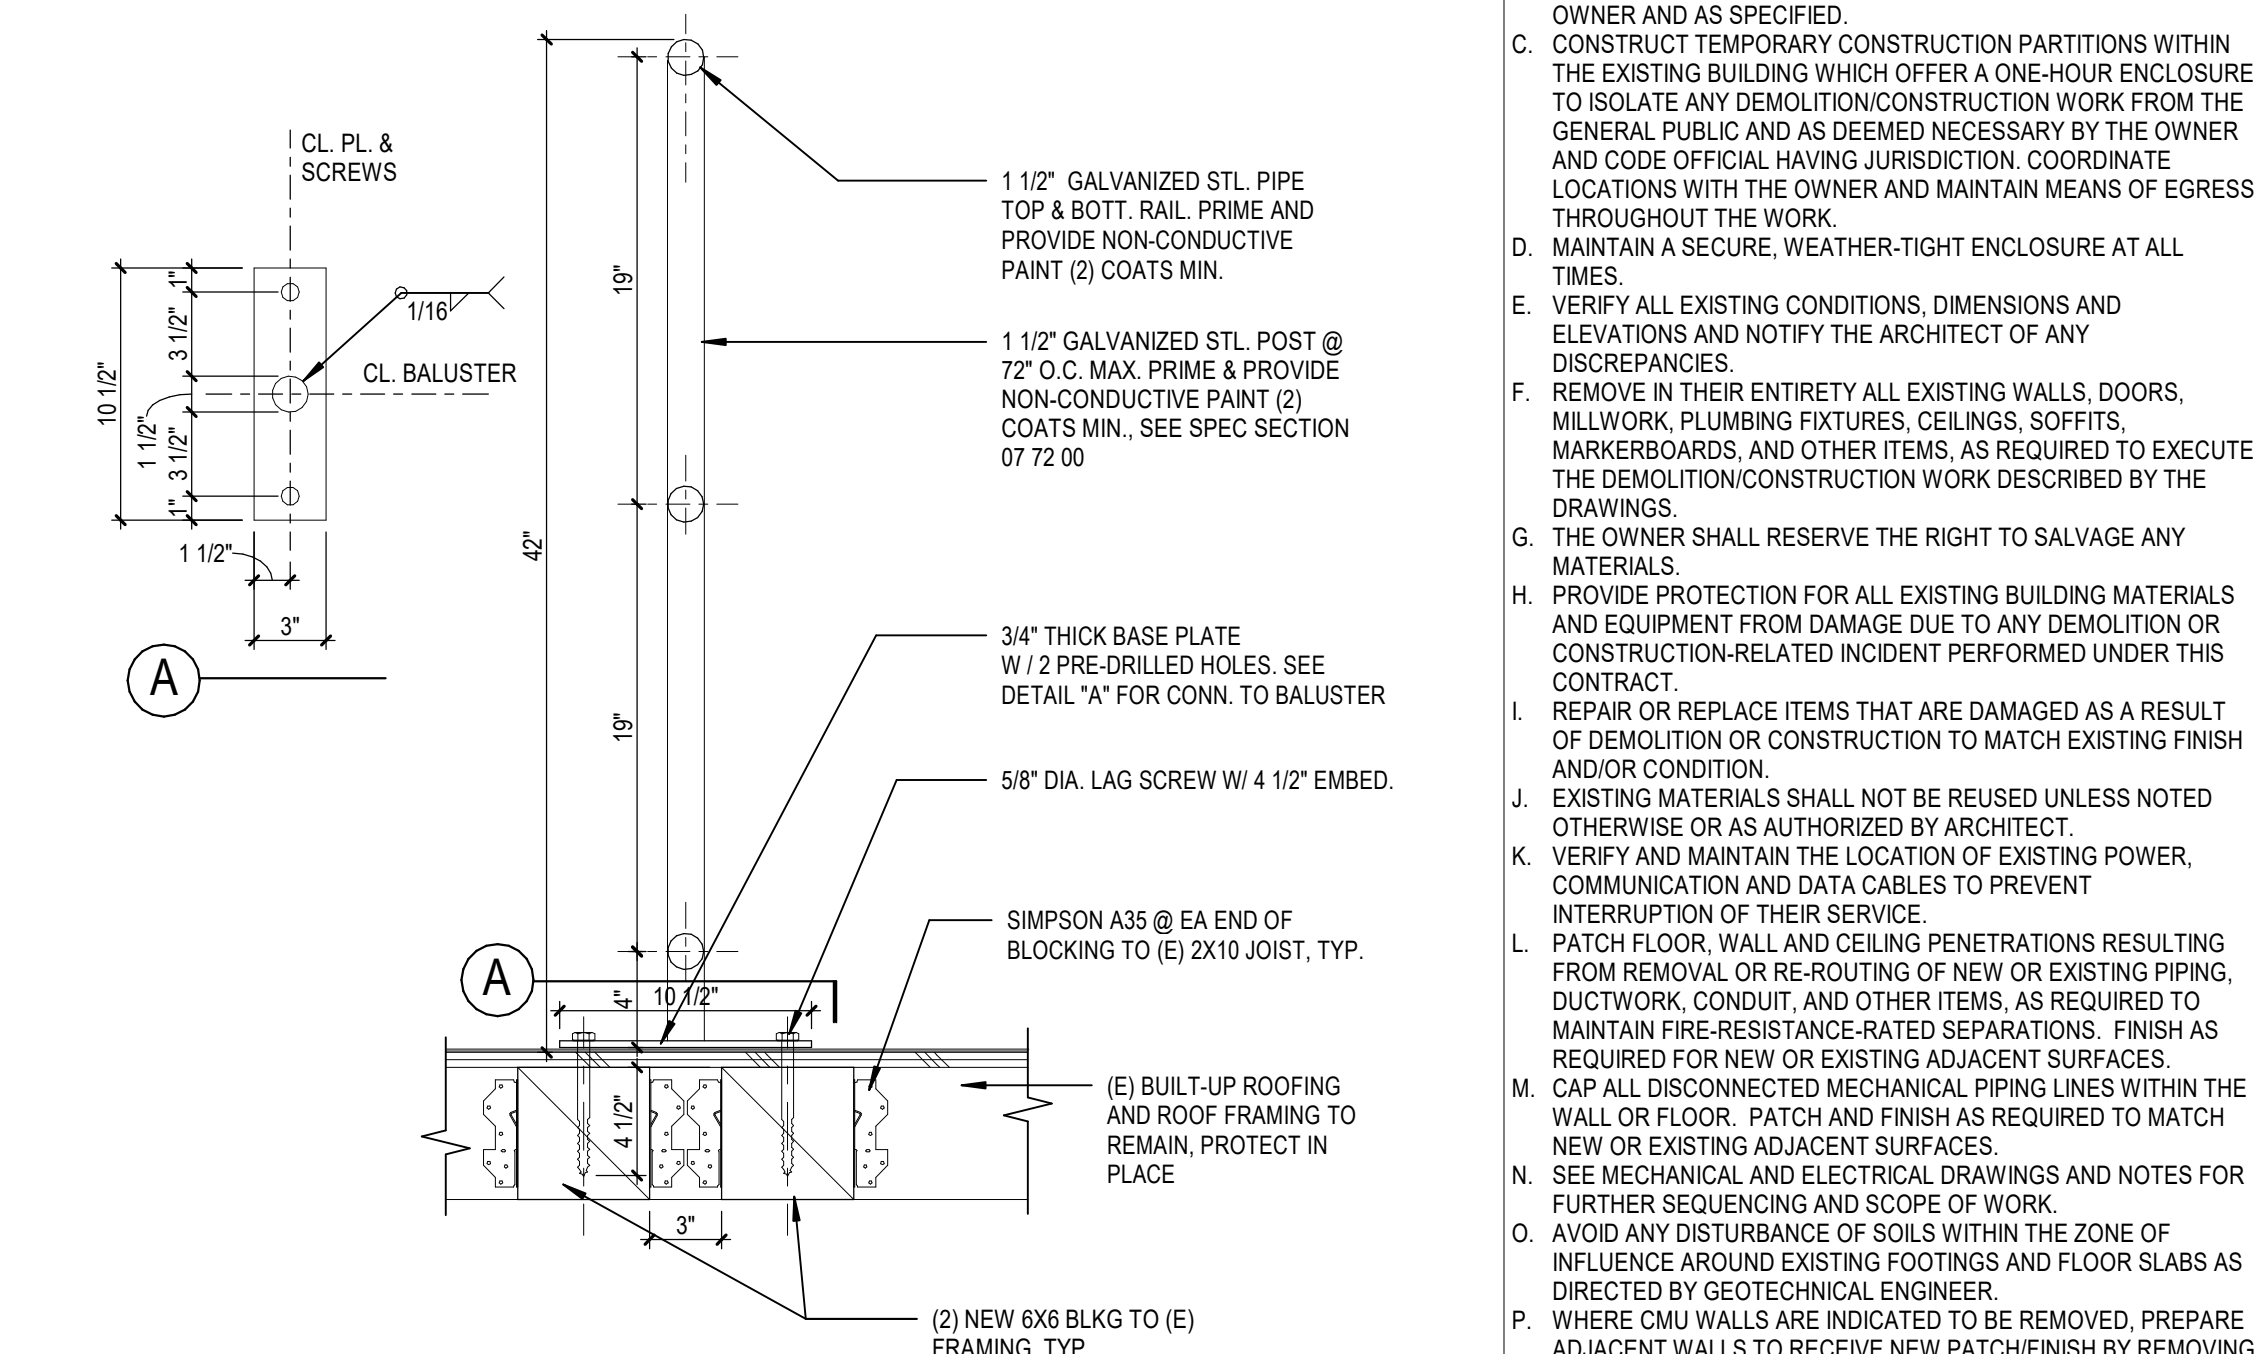

 **HVAC ROOF GUARDRAIL - WD FRAMING**  
SCALE: 1 1/2" = 1'-0"

REFERENCE KEYNOTES

- E210 LINE OF (E) BLDG BELOW SHOWN DASHED  
N400 NEW FREESTANDING METAL GUARDRAIL SYSTEM, SEE SUPPLIER FOR ANCHORAGE AND SPEC SECTION 07 72 00  
N402 NEW DUCTWORK, SEE MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION  
N403 (N) MECHANICAL UNITS ATTACHED TO THE (E) UNIT CURB, SEE MECHANICAL DRAWING SHEET M1.36 & M1.3D

ROOF PLAN GENERAL NOTES

- A. (E) ROOF CURBS TO REMAIN U.N.O., SEE MECHANICAL DRAWINGS SHEET M1.36 AND M1.3D FOR ADDITIONAL INFORMATION.  
B. COORDINATE THE SIZE AND LOCATION OF WALL PENETRATIONS FOR MECHANICAL AND ELECTRICAL EQUIPMENT. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR PENETRATIONS NOT SHOWN ON THIS DRAWING.  
C. (E) DRAINS, CURBS, VENTS AND STACKS TO REMAINS.

DEMOLITION GENERAL NOTES

- DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.
- THE CONTRACTOR SHALL:
- A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
- B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
- C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL, HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
- D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
- E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
- G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
- H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
- I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
- J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
- K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
- L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
- M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
- N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
- O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
- P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
- Q. WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.



**WORKMAN ELEMENTARY SCHOOL**  
COVID 19 - COVINA VALLEY USD DISTRIC WIDE HVAC REPLACEMENT  
1941 E. WORKMAN AVE. WEST COVINA, CA 91791


100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25  
**AREA A - ROOF  
PLAN**

**A1.3A**




Autodesk Docu/75-22605-40 CVUSD - District Wide HVAC Replacement/75-22605-40 CVUSD - Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:28 AM



AREA B - ROOF PLAN

SCALE: 1/8" = 1'-0"

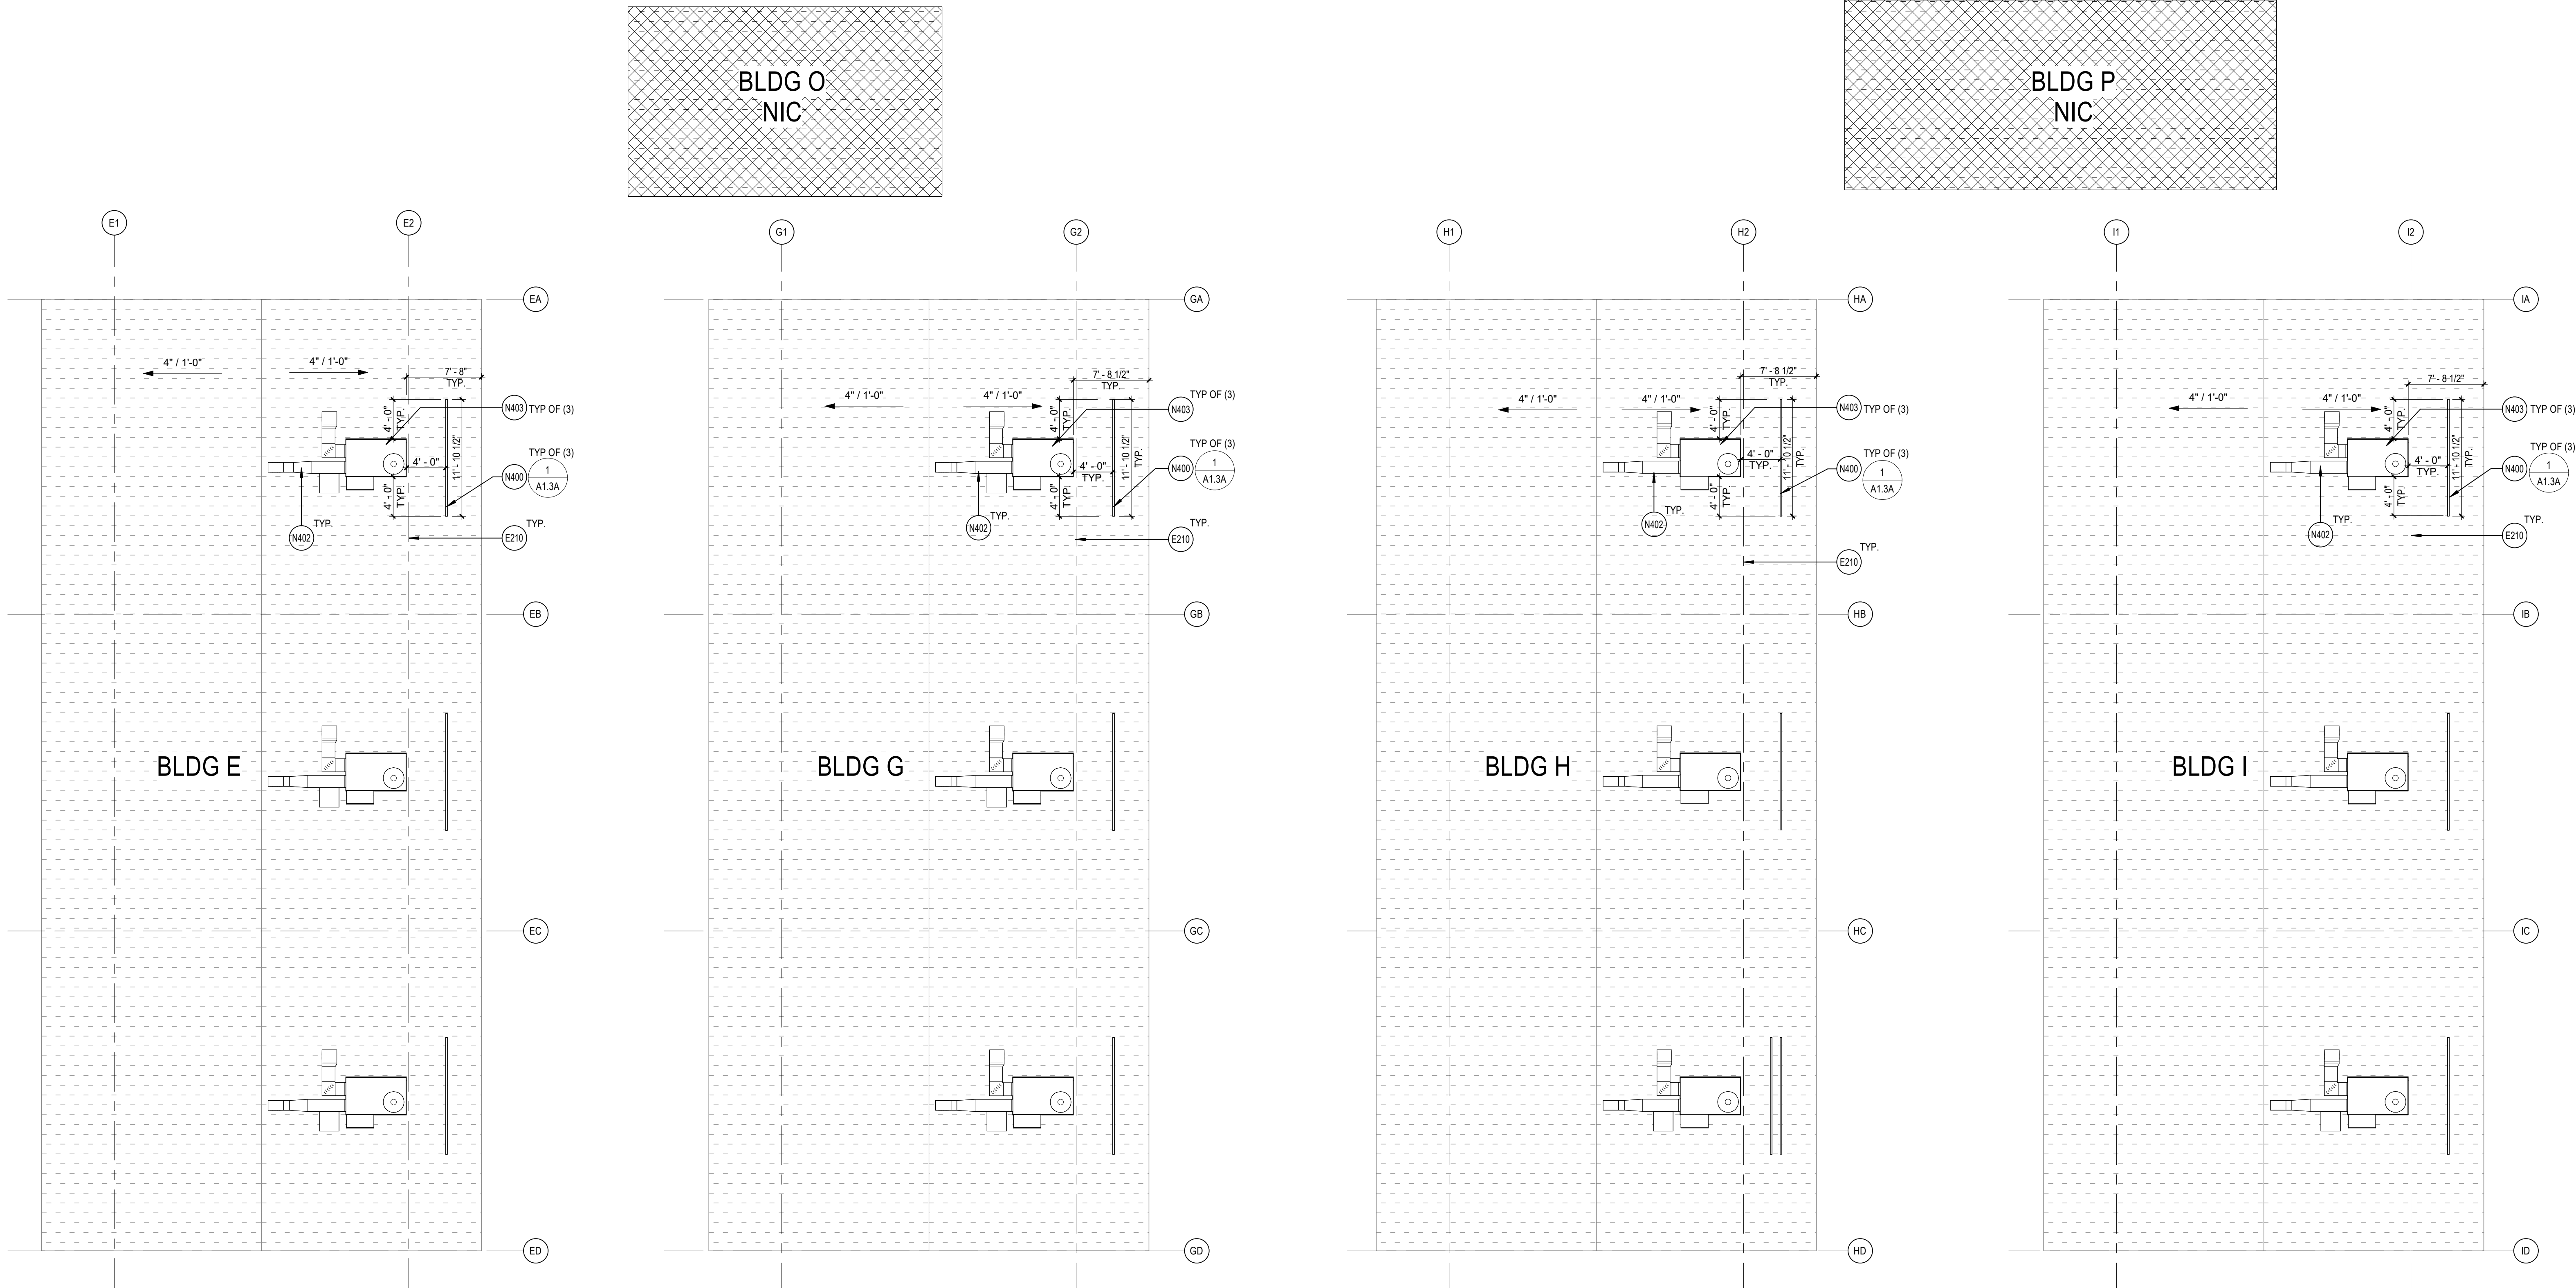

REFERENCE KEYNOTES

- E210 LINE OF (E) BLDG BELOW SHOWN DASHED  
N400 NEW FREESTANDING METAL GUARDRAIL SYSTEM, SEE SUPPLIER FOR ANCHORAGE AND SPEC SECTION 07 12 30  
N402 NEW DUCTWORK, SEE MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION  
N403 (N) MECHANICAL UNITS ATTACHED TO THE (E) UNIT CURB, SEE MECHANICAL DRAWING SHEET M1.3B & M1.3D

ROOF PLAN GENERAL NOTES

- A. (E) ROOF CURBS TO REMAIN U.N.O., SEE MECHANICAL DRAWINGS SHEET M1.3B AND M1.3D FOR ADDITIONAL INFORMATION.  
B. COORDINATE THE SIZE AND LOCATION OF WALL PENETRATIONS FOR MECHANICAL AND ELECTRICAL EQUIPMENT. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR PENETRATIONS NOT SHOWN ON THIS DRAWING.  
C. (E) DRAINS, CURBS, VENTS AND STACKS TO REMAINS.

DEMOLITION GENERAL NOTES

- DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.
- THE CONTRACTOR SHALL:
- A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
- B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
- C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL. HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
- D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
- E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
- F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILING, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
- G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
- H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
- I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
- J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
- K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
- L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
- M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
- N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
- O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
- P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
- Q. WHERE PLASTER/STUO WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.



WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRIC WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25  
AREA B - ROOF  
PLAN

A1.3B



Autodesk Docu/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD - Workman ESS\_AR\_2020.rvt  
11/2/2022 9:51:28 AM


1

2

3

4

5

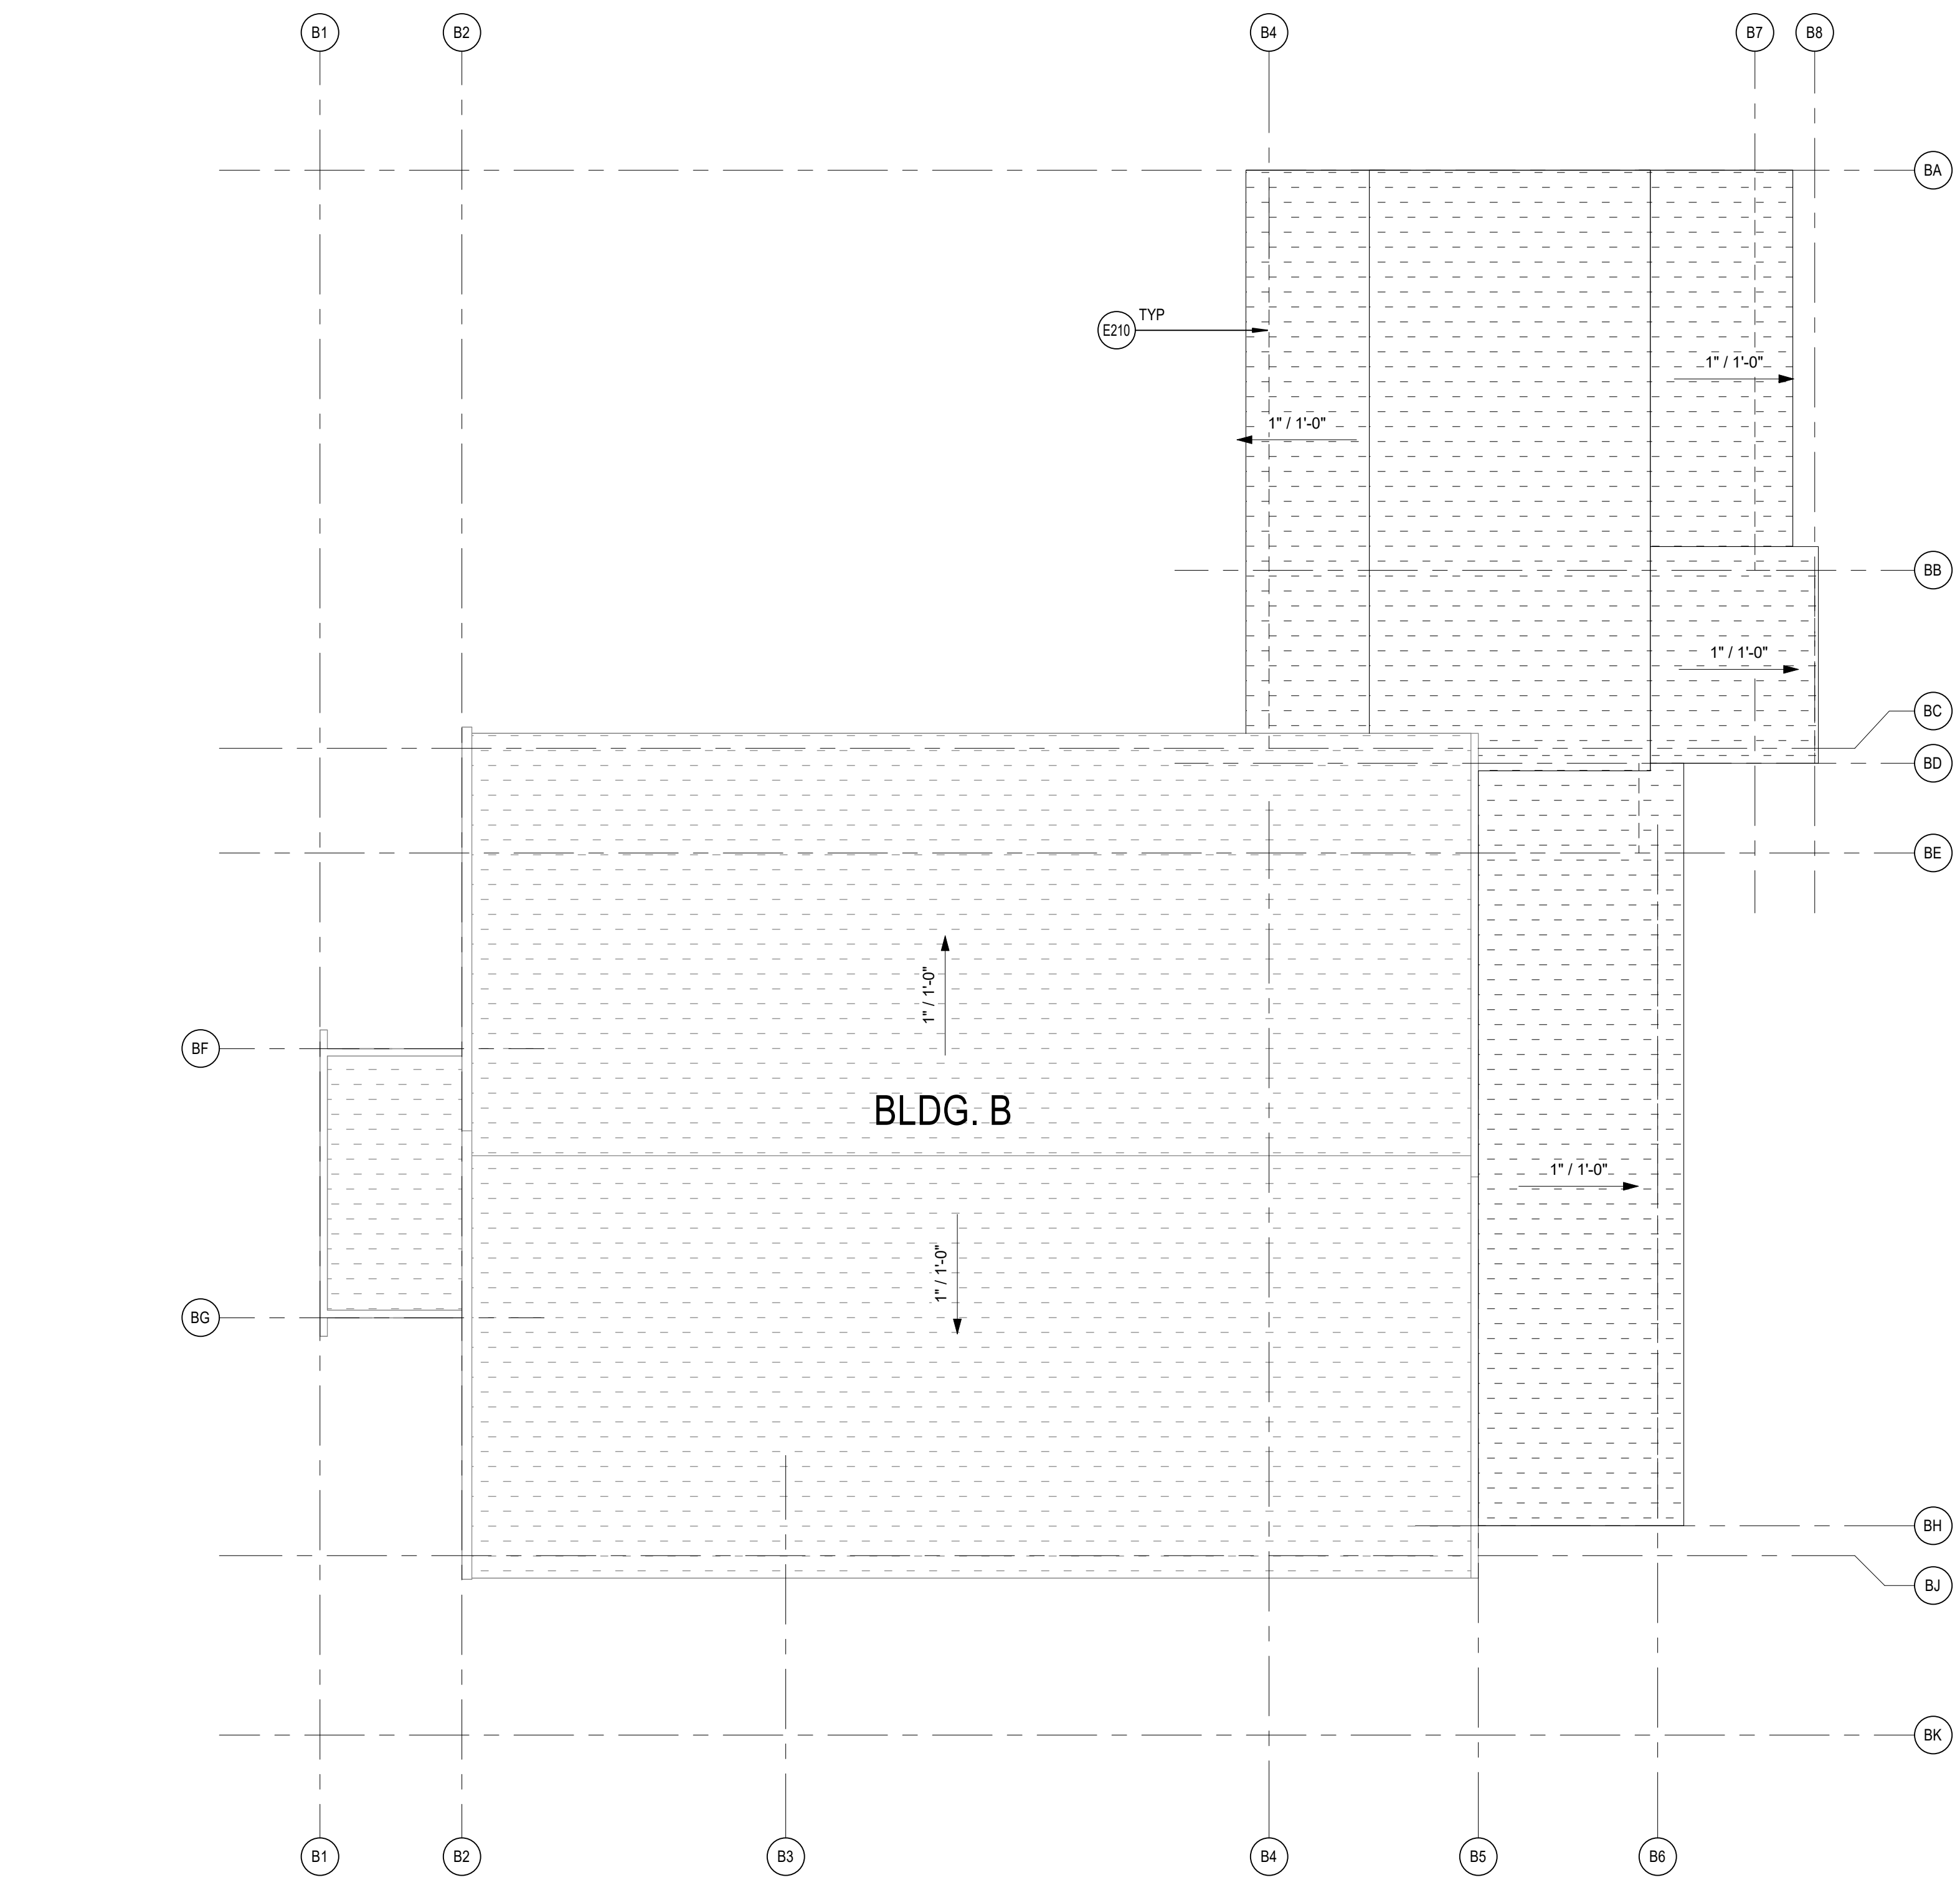

 **AREA E - ROOF PLAN**  
SCALE: 1/8" = 1'-0"

## REFERENCE KEYNOTES

E210 LINE OF (E) BLDG BELOW SHOWN DASHED

## ROOF PLAN GENERAL NOTES

- (E) ROOF CURBS TO REMAIN U.N.O., SEE MECHANICAL DRAWINGS SHEET M1.3B AND M1.3D FOR ADDITIONAL INFORMATION.
- COORDINATE THE SIZE AND LOCATION OF WALL PENETRATIONS FOR MECHANICAL AND ELECTRICAL EQUIPMENT. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR PENETRATIONS NOT SHOWN ON THIS DRAWING.
- (E) DRAINS, CURBS, VENTS AND STACKS TO REMAINS.

## DEMOLITION GENERAL NOTES

- DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.
- THE CONTRACTOR SHALL:
- COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
  - COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
  - CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL. HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
  - MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
  - VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
  - REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
  - THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
  - PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
  - REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
  - EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
  - VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
  - PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
  - CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
  - SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
  - AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
  - WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
  - WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.



**WORKMAN ELEMENTARY SCHOOL**  
COVID 19 - COVINA VALLEY USD DISTRIC WIDE HVAC REPLACEMENT  
1941 E. WORKMAN AVE. WEST COVINA, CA 91791

**100% CONSTRUCTION DOCUMENTS**  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25  
**AREA E - ROOF PLAN**

**A1.3E**



Autodesk Docu/75-22605-40 CVUSD - District Wide HVAC Replacement/75-22605-40 CVUSD - Workman ESS\_AR\_2020.rvt  
11/2/2022 9:51:28 AM


1

2

3


4

5





## AREA F - ROOF PLAN

SCALE: 1/8" = 1'-0"

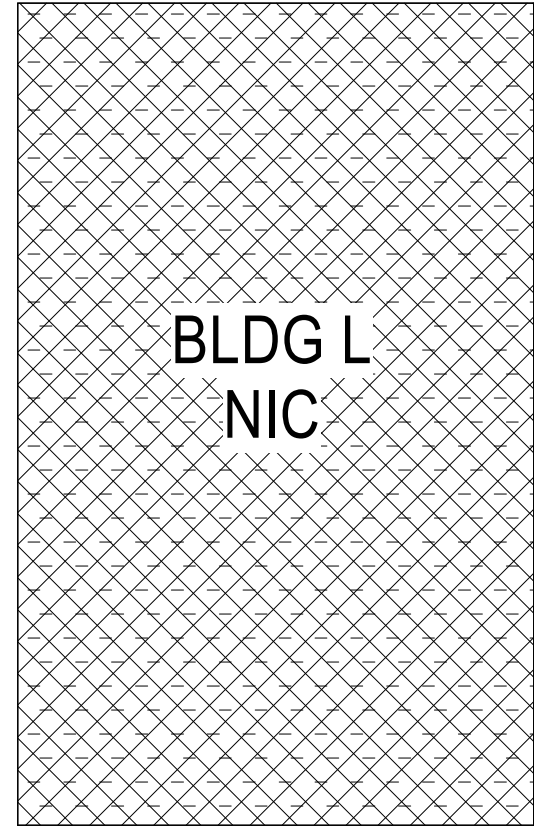

BLDG L  
NIC

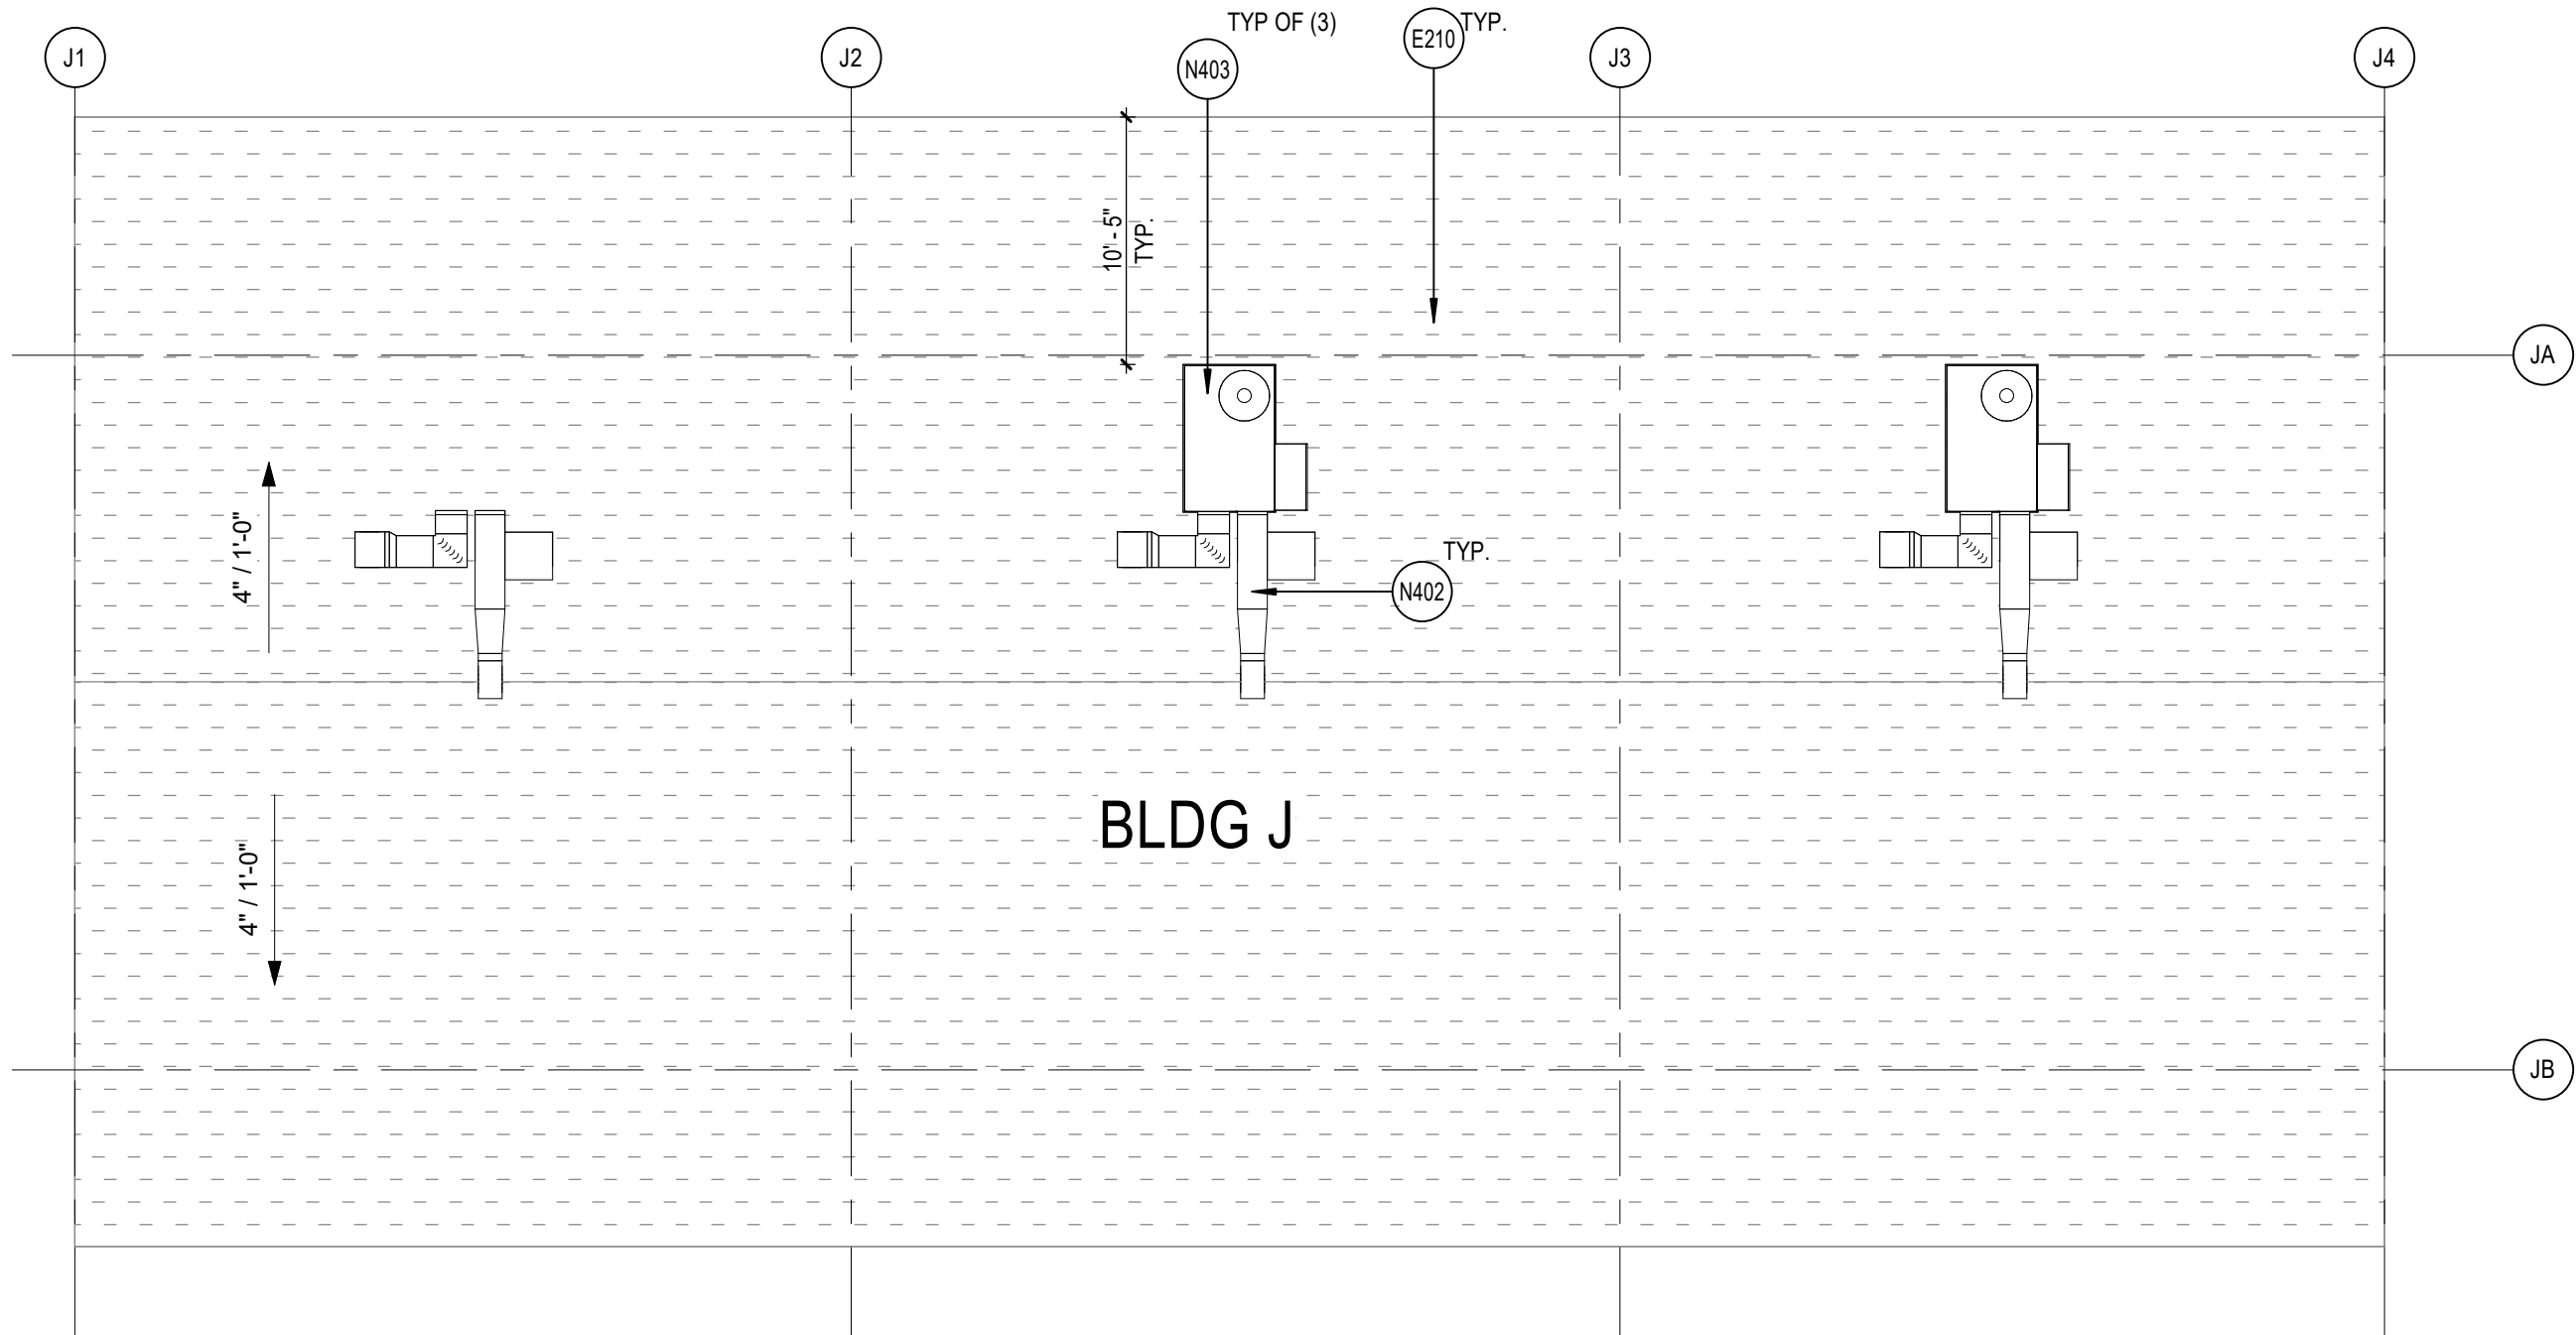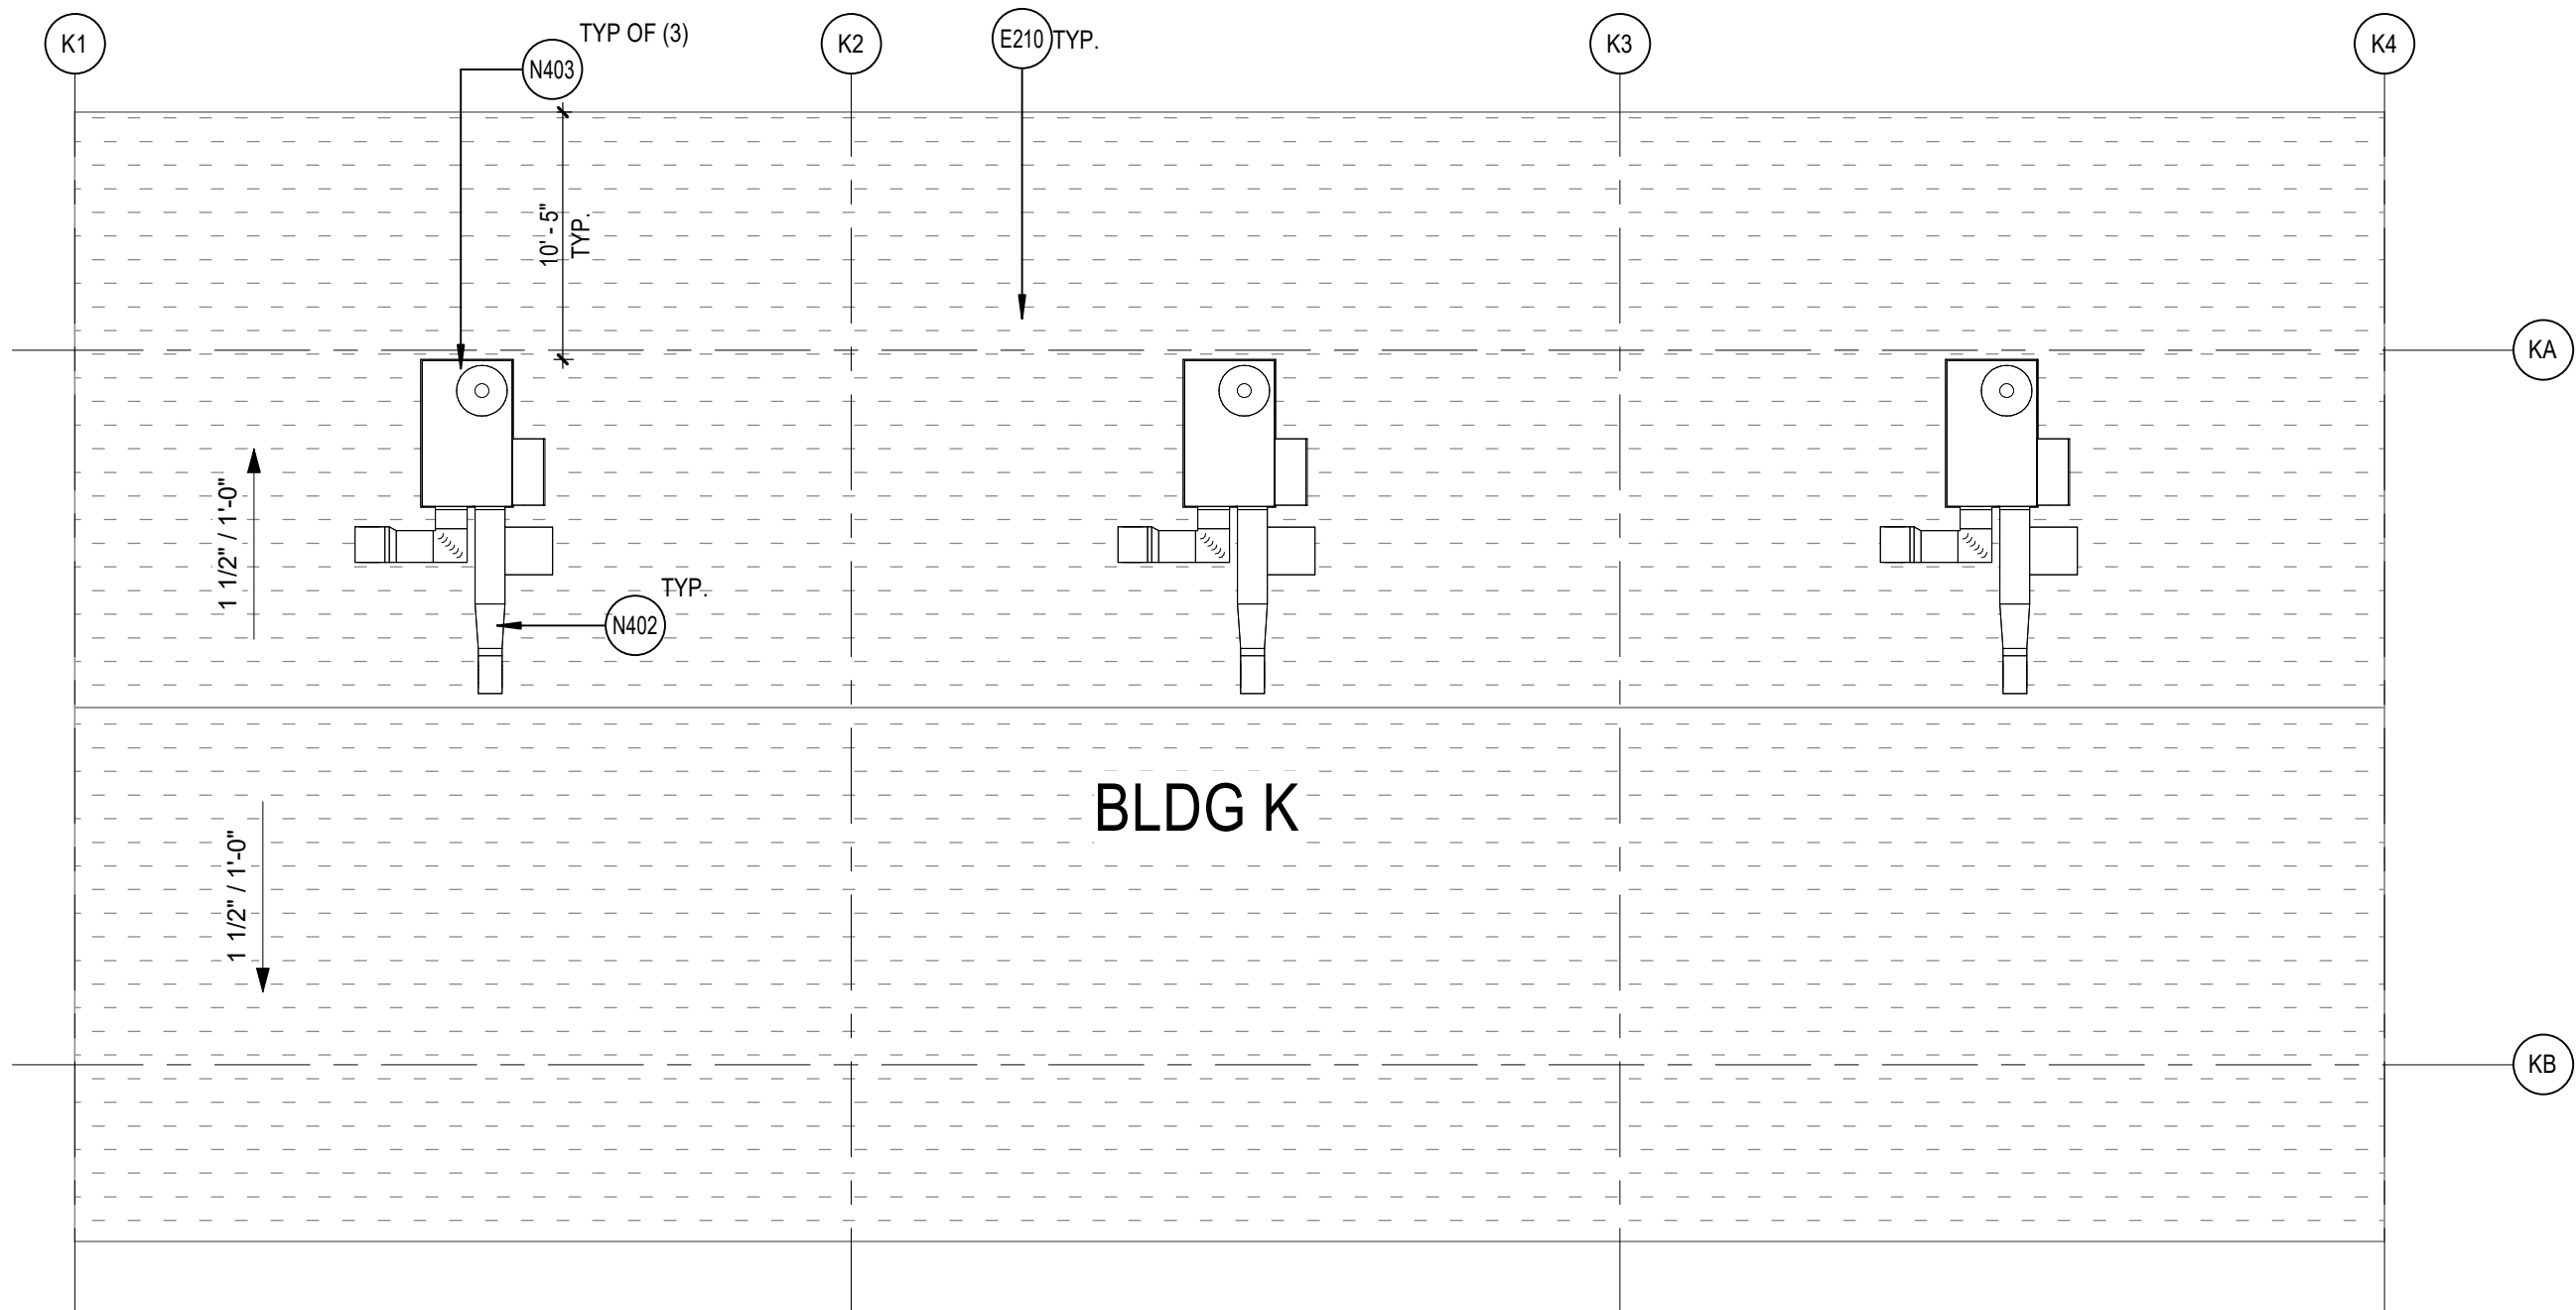

### REFERENCE KEYNOTES

- E210 LINE OF (E) BLDG BELOW SHOWN DASHED  
N402 NEW DUCTWORK, SEE MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION  
N403 (N) MECHANICAL UNITS ATTACHED TO THE (E) UNIT CURB, SEE MECHANICAL DRAWING SHEET M1.3B & M1.3D

### ROOF PLAN GENERAL NOTES


- A. (E) ROOF CURBS TO REMAIN U.N.O., SEE MECHANICAL DRAWINGS SHEET M1.3B AND M1.3D FOR ADDITIONAL INFORMATION.  
B. COORDINATE THE SIZE AND LOCATION OF WALL PENETRATIONS FOR MECHANICAL AND ELECTRICAL EQUIPMENT. REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR PENETRATIONS NOT SHOWN ON THIS DRAWING.  
C. (E) DRAINS, CURBS, VENTS AND STACKS TO REMAINS.

### DEMOLITION GENERAL NOTES

DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.

THE CONTRACTOR SHALL:

- A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.  
B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.  
C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL. HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.  
D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.  
E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.  
F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.  
G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.  
H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.  
I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.  
J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.  
K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.  
L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.  
M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.  
N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.  
O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.  
P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.  
Q. WHERE PLASTER/STUO WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

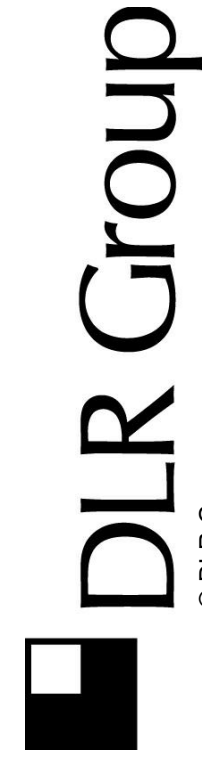

WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRIC WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791


100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25  
AREA F - ROOF  
PLAN

A1.3F




Autodesk Docu/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD\_Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:30 AM





## OVERALL REFLECTED CEILING PLAN

SCALE: 3/64" = 1'-0"

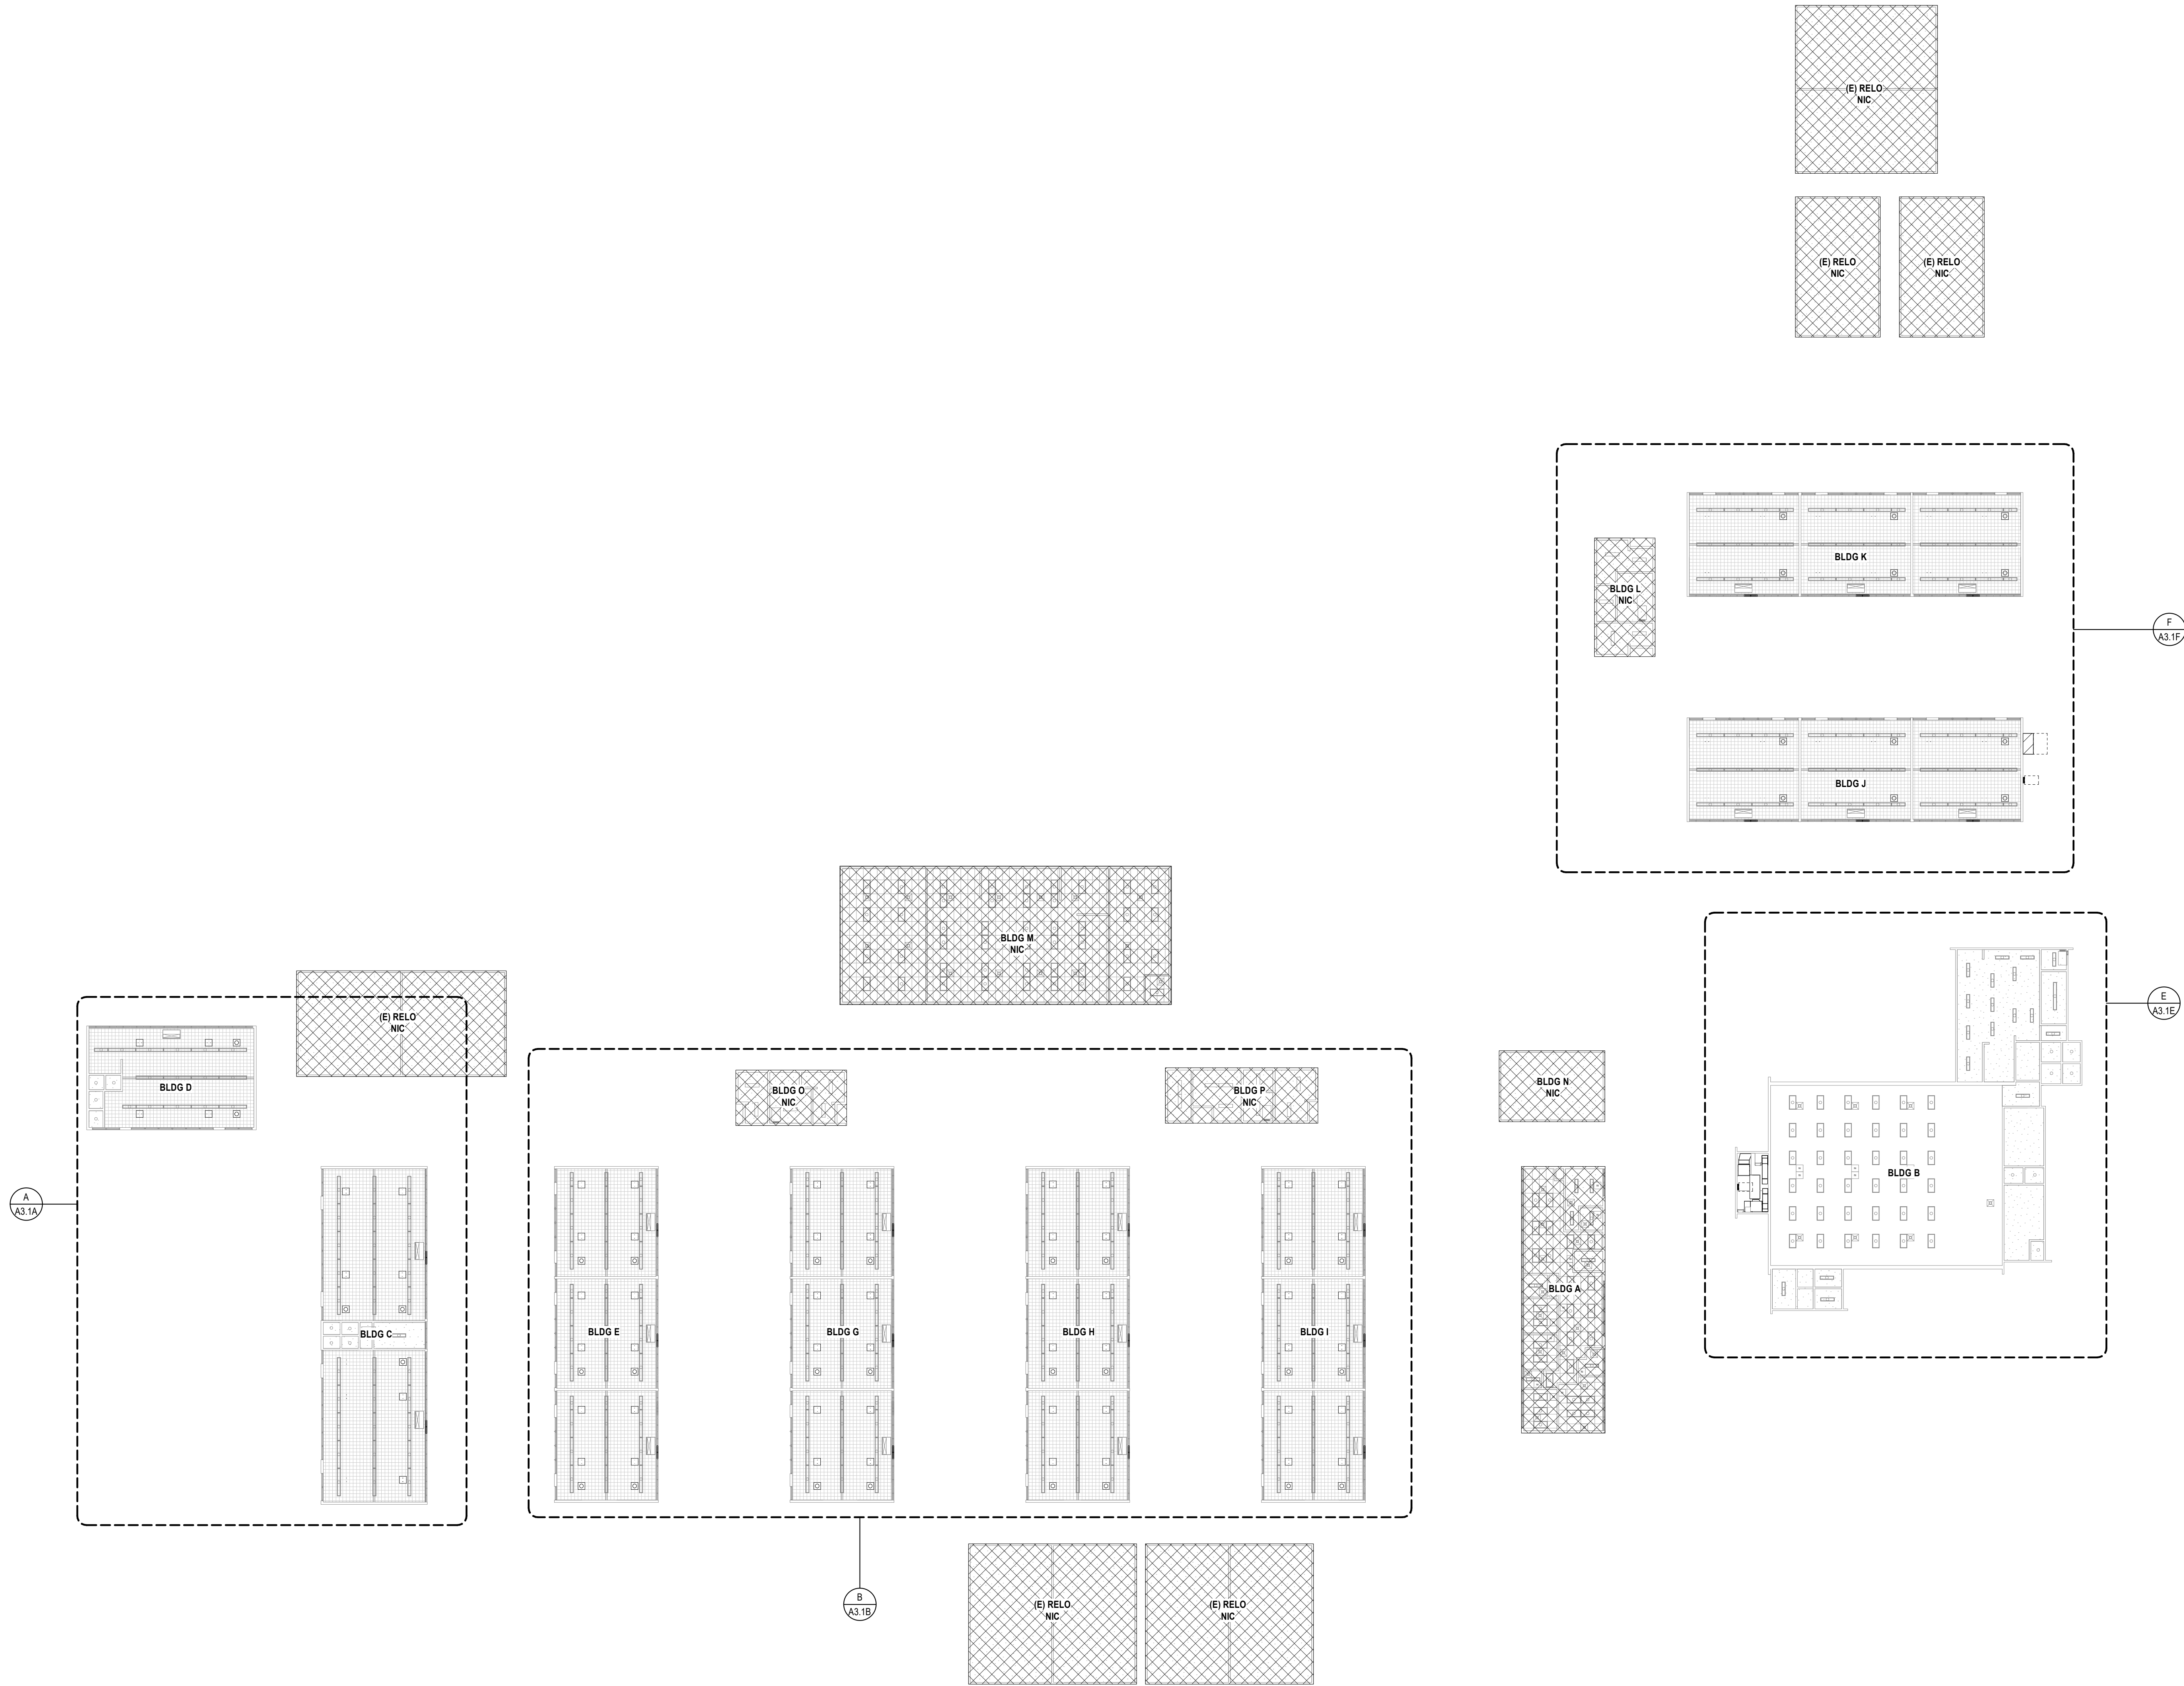

### REFLECTED CEILING PLAN GENERAL NOTES

- REFLECTED CEILING PLAN GENERAL NOTES APPLY TO ALL REFLECTED CEILING PLAN SHEETS.
- ALL CEILING GRID/PANELS SHALL BE CENTERED IN EACH ROOM UNLESS NOTED OTHERWISE.
- (E) CEILING HEIGHTS ARE TO REMAIN U.N.O. REFLECTED CEILING PLANS ARE MEASURED FROM THE FINISH FLOOR OF THE ROOM.
- IN ACOUSTICAL CEILING PANELS WITH SCORE IN THE CENTER, CENTER DEVICES IN ONE HALF OF THE TILE. DO NOT LOCATE ON THE SCORE. FOR AGR WITH MULTIPLE SCORED PATTERNS, COORDINATE LOCATION WITH THE ARCHITECT.
- PROVIDE SUSPENSION SYSTEM AROUND ELECTRICAL FIXTURES, MECHANICAL GRILLES, DIFFUSERS, AND OTHER CEILING MOUNTED DEVICES. AT ACOUSTICAL PANEL CEILINGS.
- ALL DIMENSIONS ON REFLECTED CEILING PLANS ARE ACTUAL AND ARE TO THE FOLLOWING UNLESS NOTED OTHERWISE:
  - FACE OF FINISHED WALL
  - FACE OF FINISHED BULKHEADS
  - CENTERLINE OF COLUMNING
  - CENTERLINE OF TEES
- IN AREAS WITH EXPOSED STRUCTURE CEILINGS, COORDINATE EXACT LOCATIONS OF MECHANICAL GRILLES, DIFFUSERS, DUCTWORK AND ELECTRICAL FIXTURES WITH EACH REPRESENTATIVE SUBCONTRACTOR.

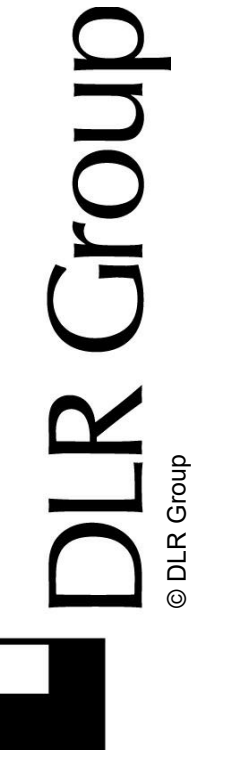

**WORKMAN ELEMENTARY SCHOOL**  
COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT  
1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

OVERALL  
REFLECTED  
CEILING PLAN

A3.1



Autodesk Docu/75-22605-40 CVUSD - District Widespread Replacement/75-22605-40 CVUSD - Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:30 AM



1

2

3

4

5

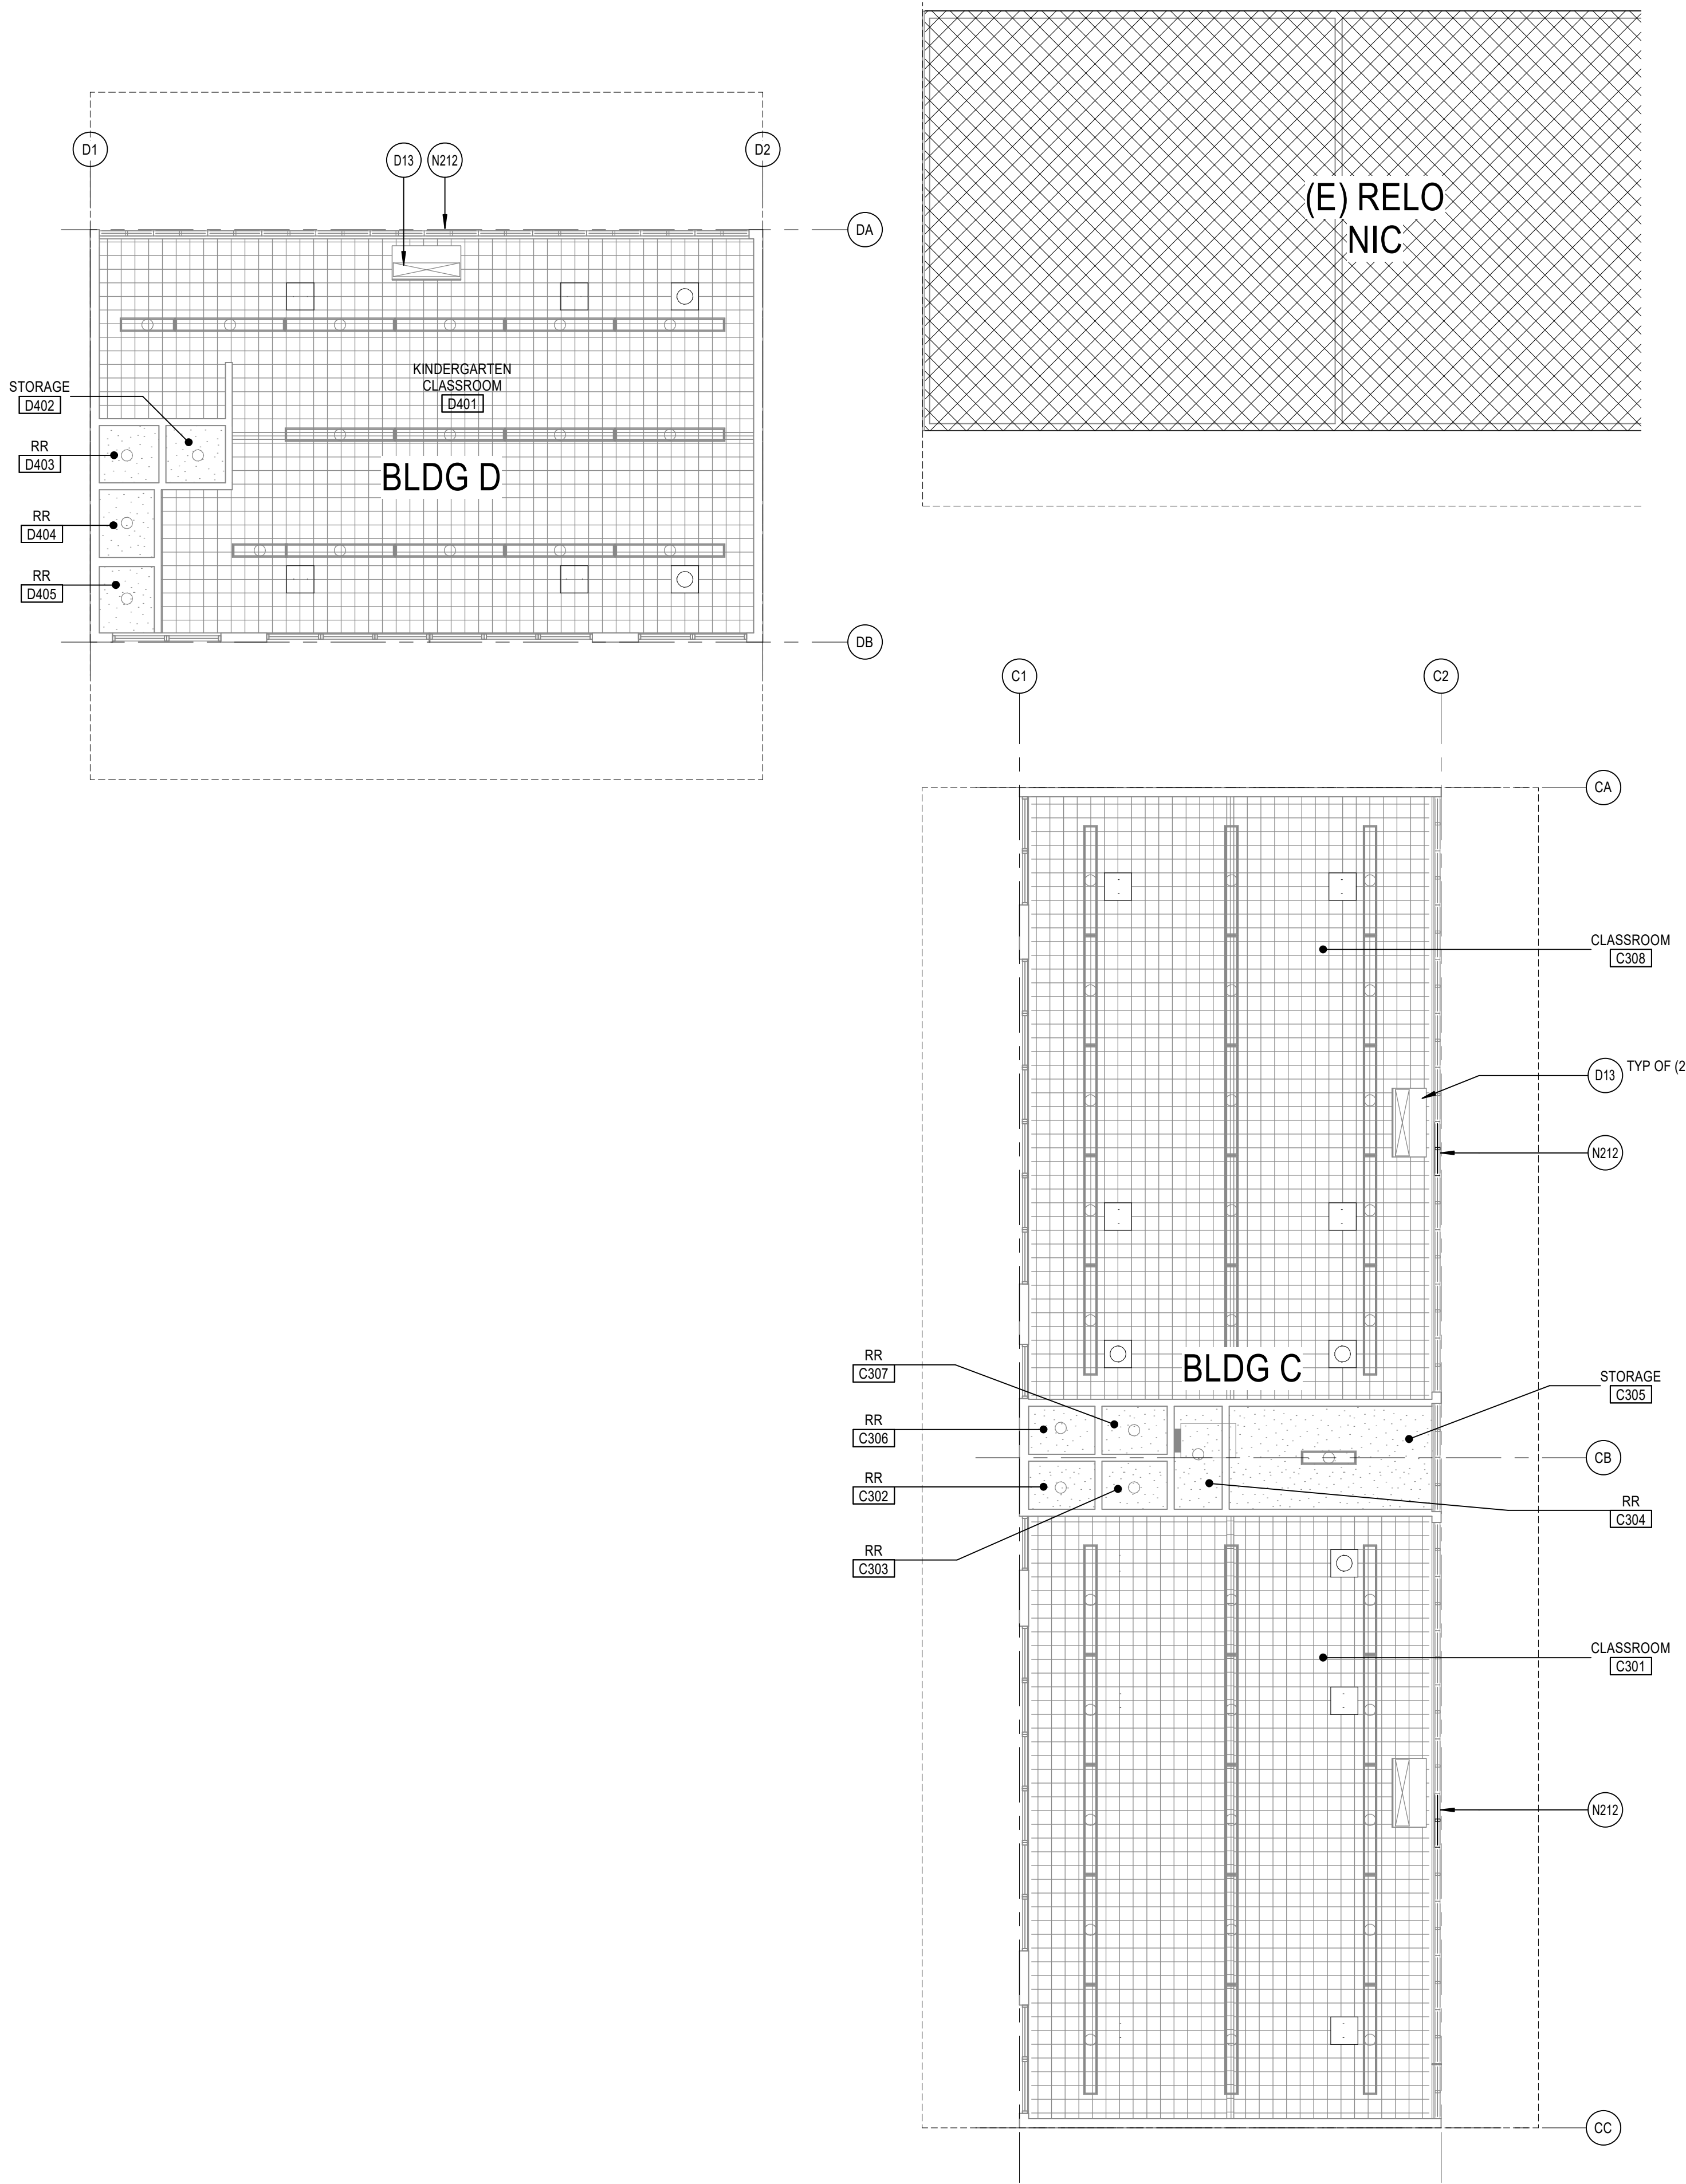

## AREA A - REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"

### REFERENCE KEYNOTES

- D13 REMOVE (E) CEILING MOUNTED FAN COIL UNIT - SEE MECHANICAL DRAWINGS  
N212 REPLACE (E) INFILL PANEL AT CONDENSER UNIT PENETRATIONS WITH GLAZING TO MATCH ADJACENT PAINT FRAME TO MATCH ADJACENT

### REFLECTED CEILING PLAN GENERAL NOTES

- A. REFLECTED CEILING PLAN GENERAL NOTES APPLY TO ALL REFLECTED CEILING PLAN SHEETS.  
B. ALL CEILING GRID/PANELS SHALL BE CENTERED IN EACH ROOM UNLESS NOTED OTHERWISE.  
C. (E) CEILING HEIGHTS ARE TO REMAIN U.N.O. REFLECTED CEILING PLANS ARE MEASURED FROM THE FINISH FLOOR OF THE ROOM.  
D. IN ACOUSTICAL CEILING PANELS WITH SCORE IN THE CENTER, CENTER DEVICES IN ONE HALF OF THE TILE. DO NOT LOCATE ON THE SCORE. FOR ACP WITH MULTIPLE SCORED PATTERNS, COORDINATE LOCATION WITH THE ARCHITECT.  
E. PROVIDE SUSPENSION SYSTEM AROUND ELECTRICAL FIXTURES, MECHANICAL GRILLES, DIFFUSERS, AND OTHER CEILING MOUNTED DEVICES. AT ACOUSTICAL PANEL CEILINGS.  
F. ALL DIMENSIONS ON REFLECTED CEILING PLANS ARE ACTUAL AND ARE TO THE FOLLOWING UNLESS NOTED OTHERWISE:  
a. FACE OF FINISHED WALL  
b. FACE OF FINISHED BULKHEADS  
c. CENTERLINE OF COLUMNS  
d. CENTERLINE OF TEES  
G. IN AREAS WITH EXPOSED STRUCTURE CEILINGS, COORDINATE EXACT LOCATIONS OF MECHANICAL GRILLES, DIFFUSERS, DUCTWORK AND ELECTRICAL FIXTURES WITH EACH REPRESENTATIVE SUBCONTRACTOR.

### DEMOLITION GENERAL NOTES

DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.

- THE CONTRACTOR SHALL:  
A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.  
B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.  
C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.  
D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.  
E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.  
F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.  
G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.  
H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.  
I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.  
J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.  
K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.  
L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.  
M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.  
N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.  
O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.  
P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.  
Q. WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.



WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS


75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

AREA A -  
REFLECTED  
CEILING PLAN

A3.1A






Autodesk Docu/75-22605-00 CVUSD - District Widespread Replacement/75-22605-00 CVUSD - Workman ES\_AR\_2020.rvt  
11/2/2022 9:51:32 AM



AREA B - REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"

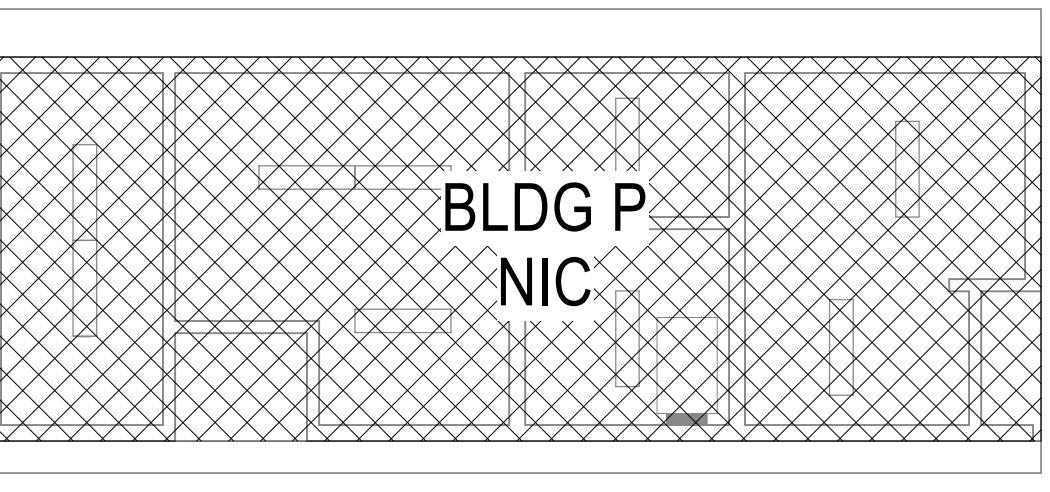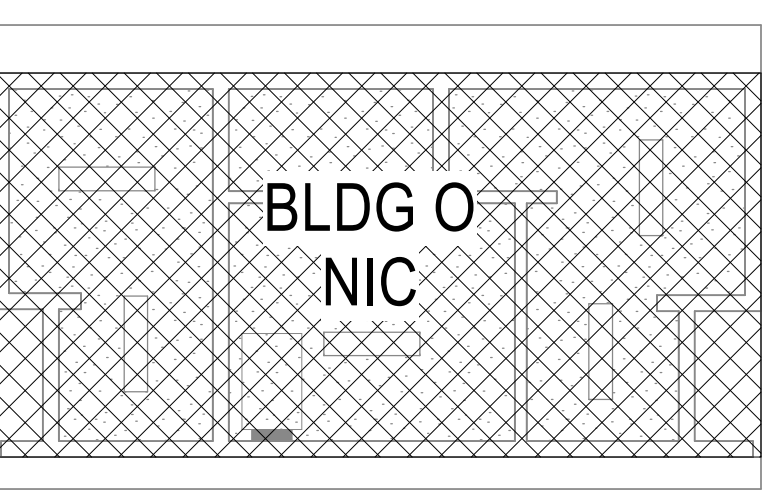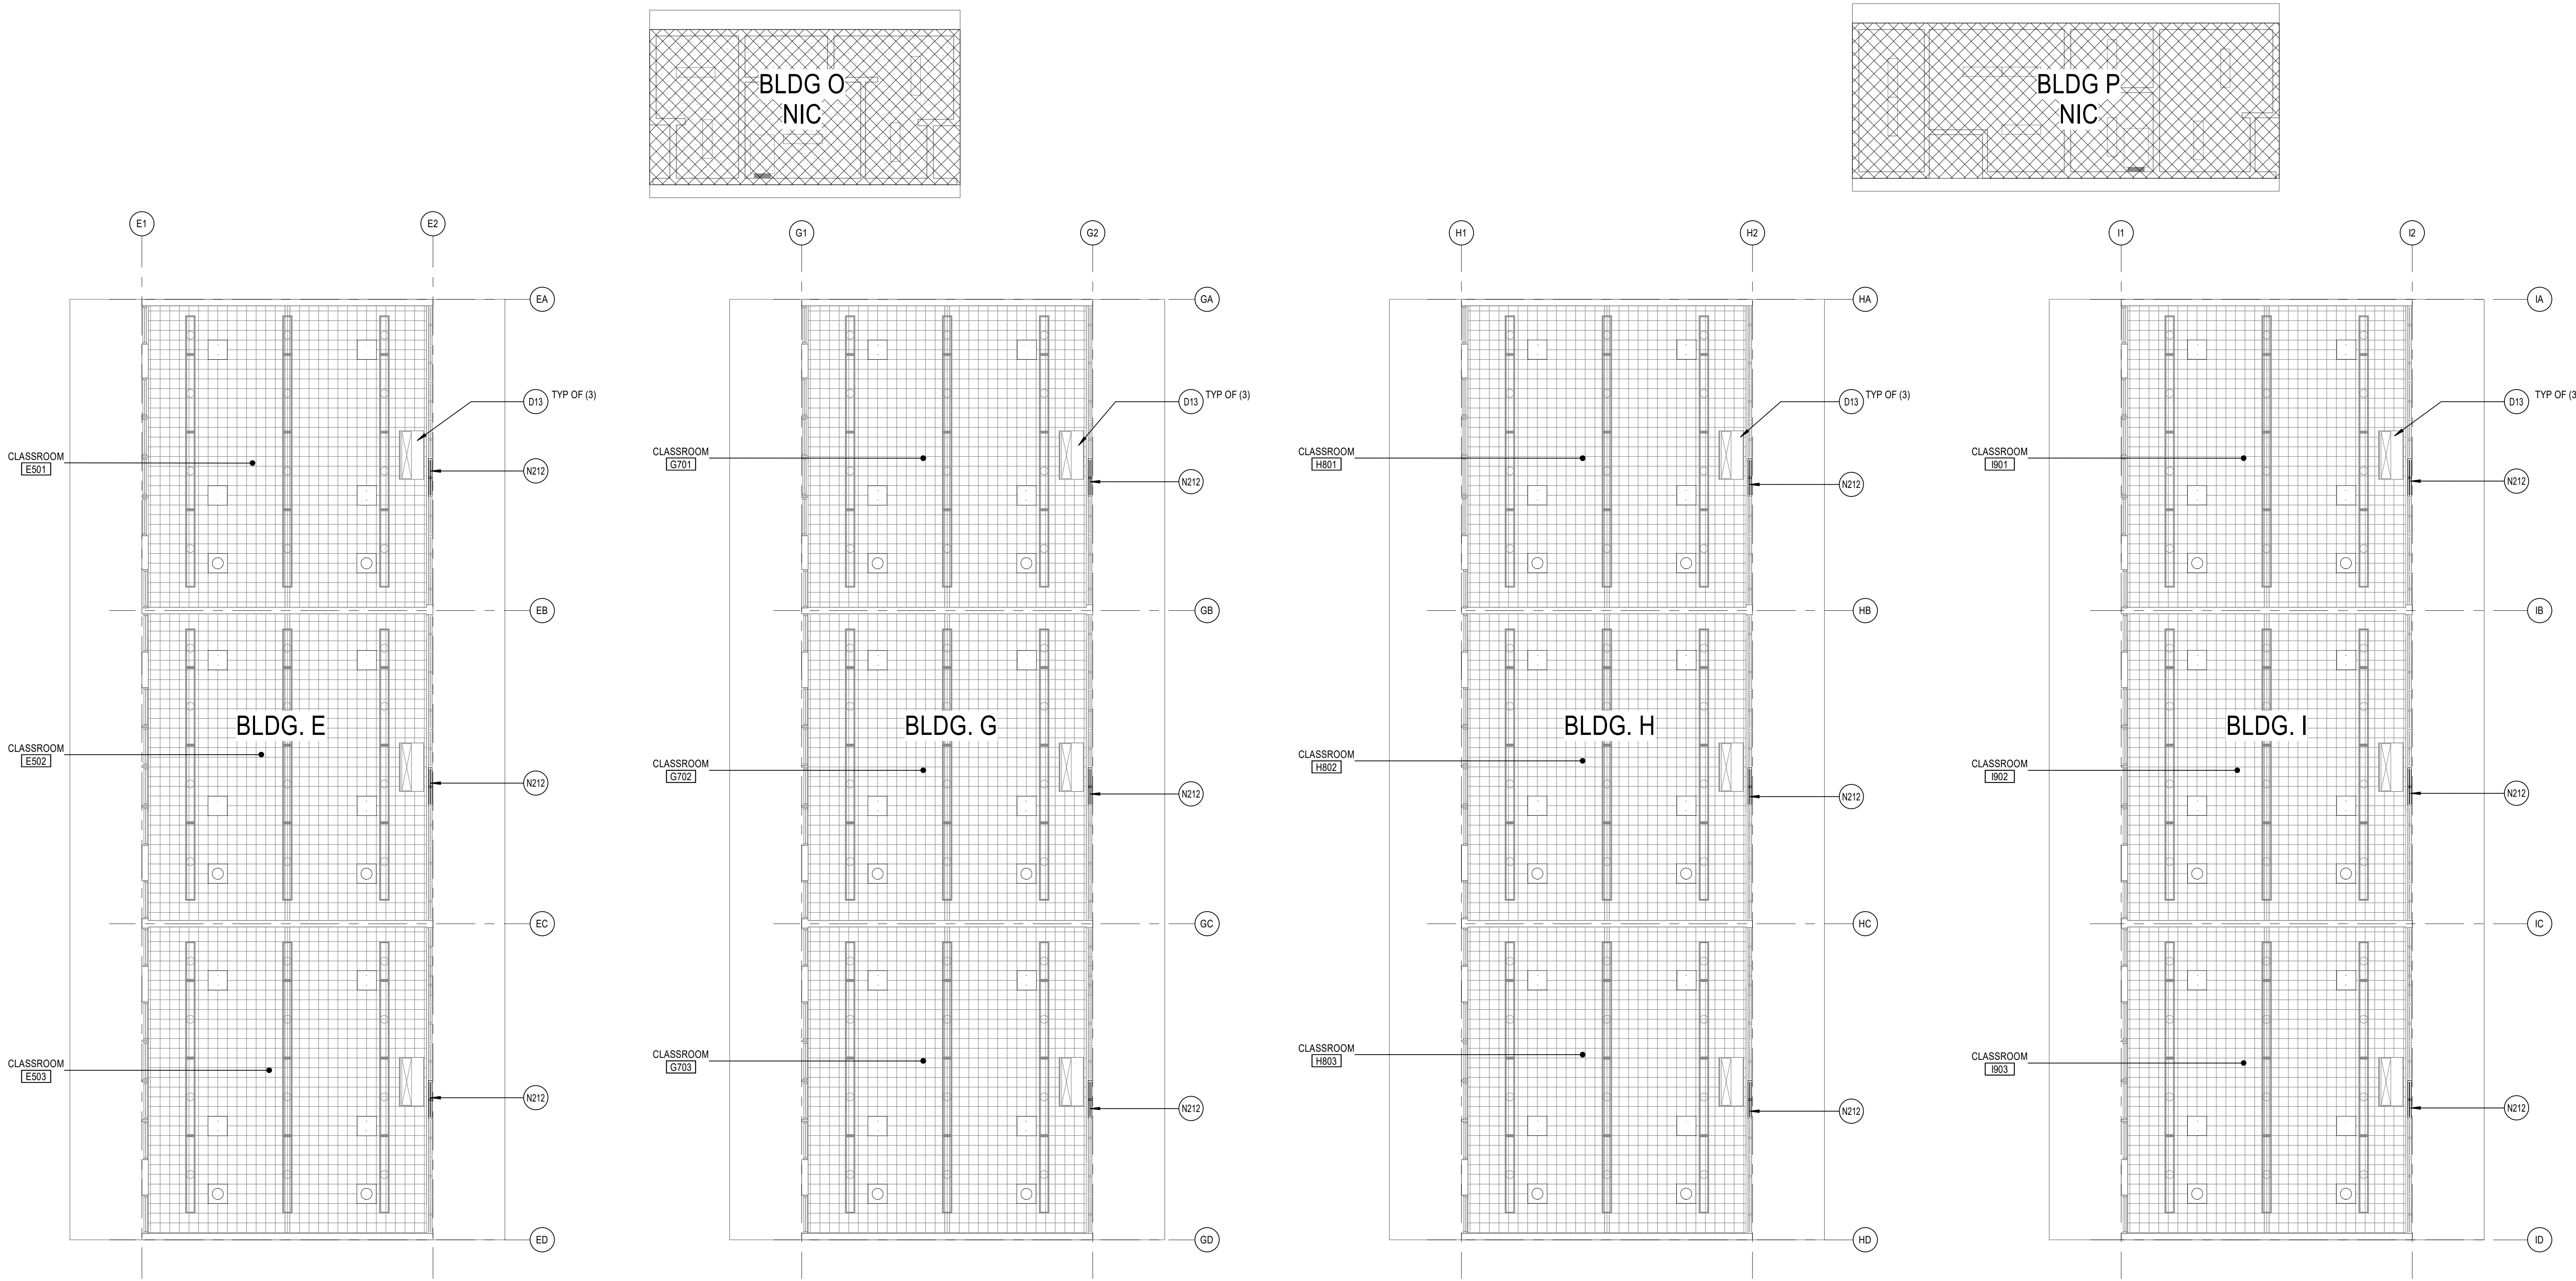

REFERENCE KEYNOTES


- D13 REMOVE (E) CEILING MOUNTED FAN COIL UNIT - SEE MECHANICAL DRAWINGS
- N212 REPLACE (E) INFILL PANEL AT CONDENSER UNIT PENETRATIONS WITH GLAZING TO MATCH ADJACENT. PAINT FRAME TO MATCH ADJACENT

REFLECTED CEILING PLAN  
GENERAL NOTES

- A. REFLECTED CEILING PLAN GENERAL NOTES APPLY TO ALL REFLECTED CEILING PLAN SHEETS.
- B. ALL CEILING GRID/PANELS SHALL BE CENTERED IN EACH ROOM UNLESS NOTED OTHERWISE.
- C. (E) CEILING HEIGHTS ARE TO REMAIN U.N.O. REFLECTED CEILING PLANS ARE MEASURED FROM THE FINISH FLOOR OF THE ROOM.
- D. IN ACOUSTICAL CEILING PANELS WITH SCORE IN THE CENTER, CENTER DEVICES IN ONE HALF OF THE TILE. DO NOT LOCATE ON THE SCORE. FOR ACP WITH MULTIPLE SCORED PATTERNS, COORDINATE LOCATION WITH THE ARCHITECT.
- E. PROVIDE SUSPENSION SYSTEM AROUND ELECTRICAL FIXTURES, MECHANICAL GRILLES, DIFFUSERS, AND OTHER CEILING MOUNTED DEVICES. AT ACOUSTICAL PANEL CEILINGS, ALL DIMENSIONS ON REFLECTED CEILING PLANS ARE ACTUAL, AND ARE TO THE FOLLOWING UNLESS NOTED OTHERWISE:
  - a. FACE OF FINISHED WALL
  - b. FACE OF FINISHED BULKHEADS
  - c. CENTERLINE OF COLUMNS
  - d. CENTERLINE OF TEES
- G. IN AREAS WITH EXPOSED STRUCTURE CEILINGS, COORDINATE EXACT LOCATIONS OF MECHANICAL GRILLES, DIFFUSERS, DUCTWORK AND ELECTRICAL FIXTURES WITH EACH REPRESENTATIVE SUBCONTRACTOR.

DEMOLITION GENERAL NOTES

- DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.
- THE CONTRACTOR SHALL:
- A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
  - B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
  - C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
  - D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
  - E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
  - F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
  - G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
  - H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
  - I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
  - J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
  - K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
  - L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
  - M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
  - N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
  - O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
  - P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
  - Q. WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

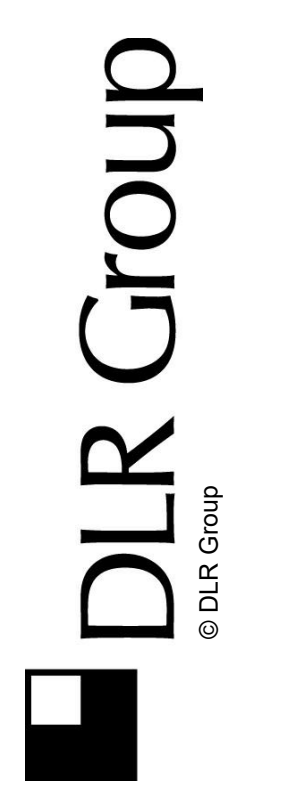

WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRICT WIDE HVAC REPLACEMENT  
1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS


75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

AREA B -  
REFLECTED  
CEILING PLAN

A3.1B




Autodesk Docu/75-22605-40 CVUSD - District Ws - HVAC Replacement/75-22605-40 CVUSD - Workman ES - AR - 2/20/21.rvt  
11/2/2022 9:51:32 AM



AREA E - REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"

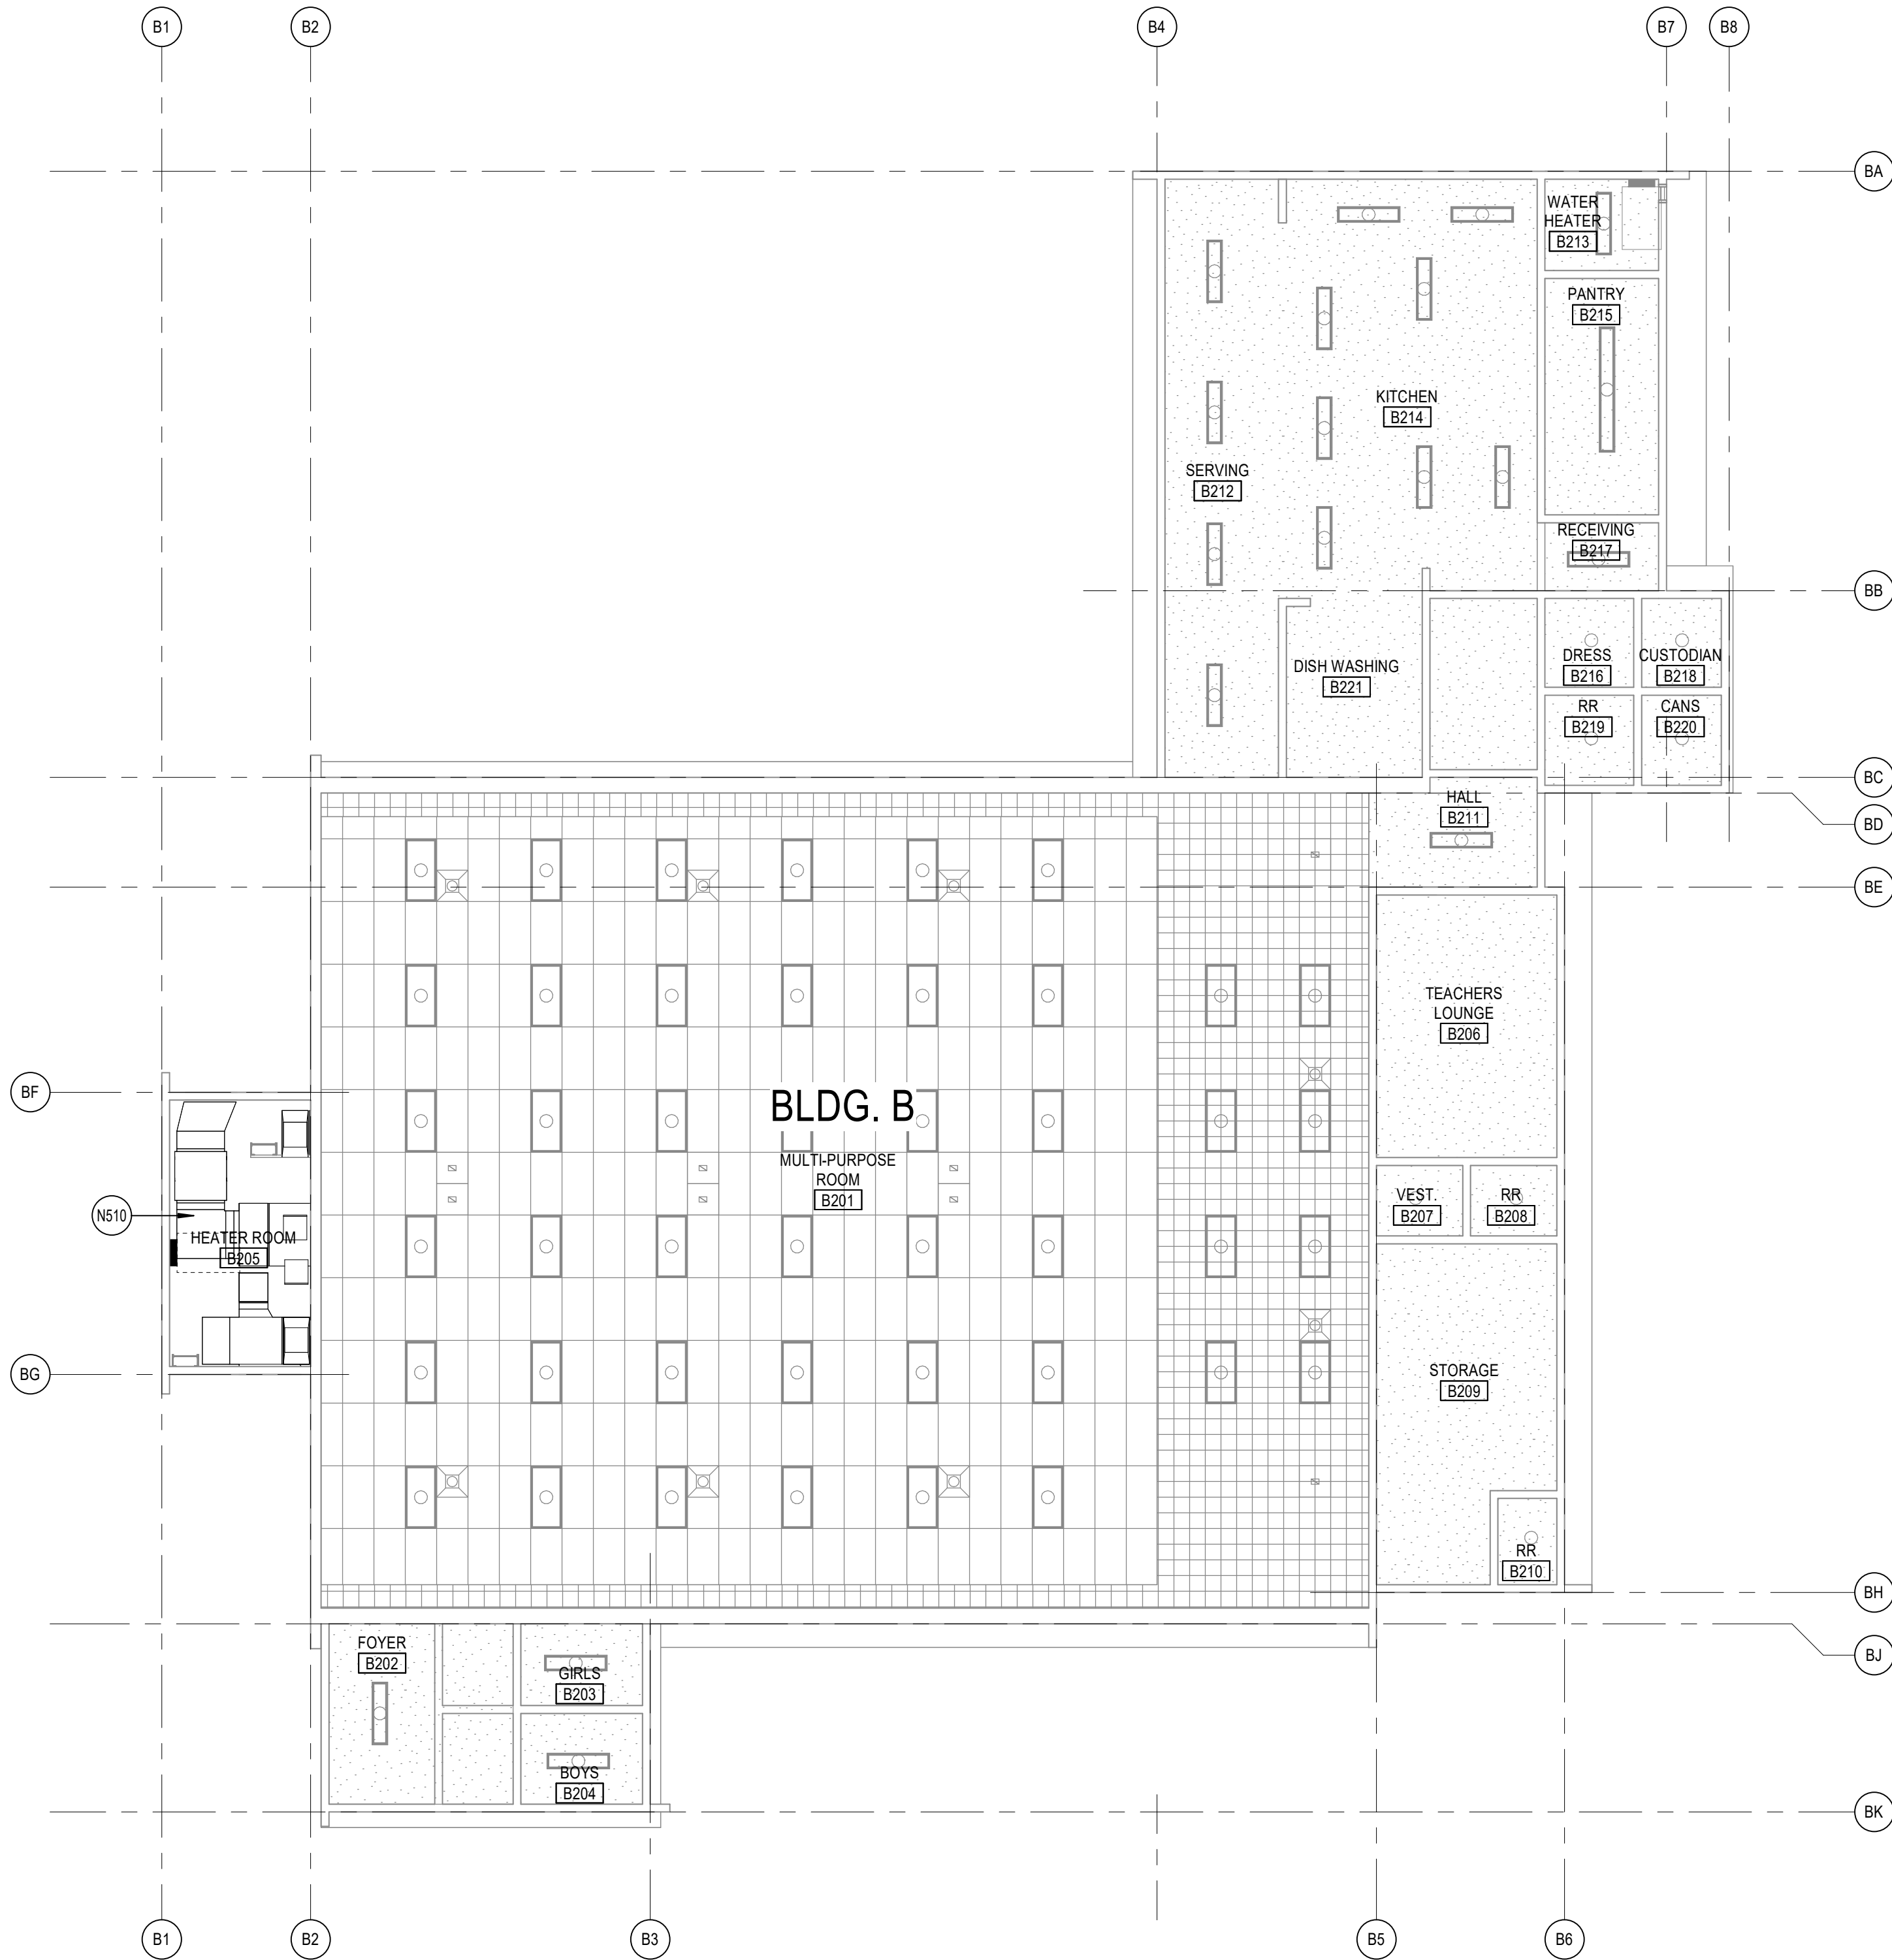

REFERENCE KEYNOTES

N510 NEW MECH. EQUIPMENT. SEE MECHANICAL DWGS.


REFLECTED CEILING PLAN  
GENERAL NOTES

- REFLECTED CEILING PLAN GENERAL NOTES APPLY TO ALL REFLECTED CEILING PLAN SHEETS.
- ALL CEILING GRID/PANELS SHALL BE CENTERED IN EACH ROOM UNLESS NOTED OTHERWISE.
- (E) CEILING HEIGHTS ARE TO REMAIN U.N.O. REFLECTED CEILING PLANS ARE MEASURED FROM THE FINISH FLOOR OF THE ROOM.
- IN ACOUSTICAL CEILING PANELS WITH SCORE IN THE CENTER, CENTER DEVICES IN ONE HALF OF THE TILE. DO NOT LOCATE ON THE SCORE. FOR ACP WITH MULTIPLE SCORED PATTERNS, COORDINATE LOCATION WITH THE ARCHITECT.
- PROVIDE SUSPENSION SYSTEM AROUND ELECTRICAL FIXTURES, MECHANICAL GRILLES, DIFFUSERS, AND OTHER CEILING MOUNTED DEVICES. AT ACOUSTICAL PANEL CEILINGS.
- ALL DIMENSIONS ON REFLECTED CEILING PLANS ARE ACTUAL AND ARE TO THE FOLLOWING UNLESS NOTED OTHERWISE:
  - FACE OF FINISHED WALL
  - FACE OF FINISHED BULKHEADS
  - CENTERLINE OF COLUMNS
  - CENTERLINE OF TEES
- IN AREAS WITH EXPOSED STRUCTURE CEILINGS, COORDINATE EXACT LOCATIONS OF MECHANICAL GRILLES, DIFFUSERS, DUCTWORK AND ELECTRICAL FIXTURES WITH EACH REPRESENTATIVE SUBCONTRACTOR.

DEMOLITION GENERAL NOTES

DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.

- THE CONTRACTOR SHALL:
- COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.
  - COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.
  - CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.
  - MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.
  - VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.
  - REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.
  - THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
  - PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.
  - REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.
  - EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.
  - VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.
  - PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.
  - CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.
  - SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.
  - AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.
  - WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.
  - WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.

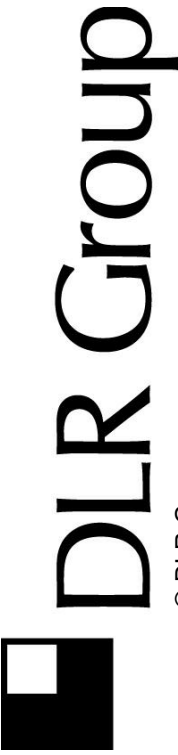

WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRIC WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS


75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

AREA E -  
REFLECTED  
CEILING PLAN

A3.1E




Autodesk Docu/75-22605-40 CVUSD - District Wide HVAC Replacement/75-22605-40 CVUSD - Workman ESS\_AR\_2020.rvt  
11/2/2022 9:51:33 AM



AREA F - REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"

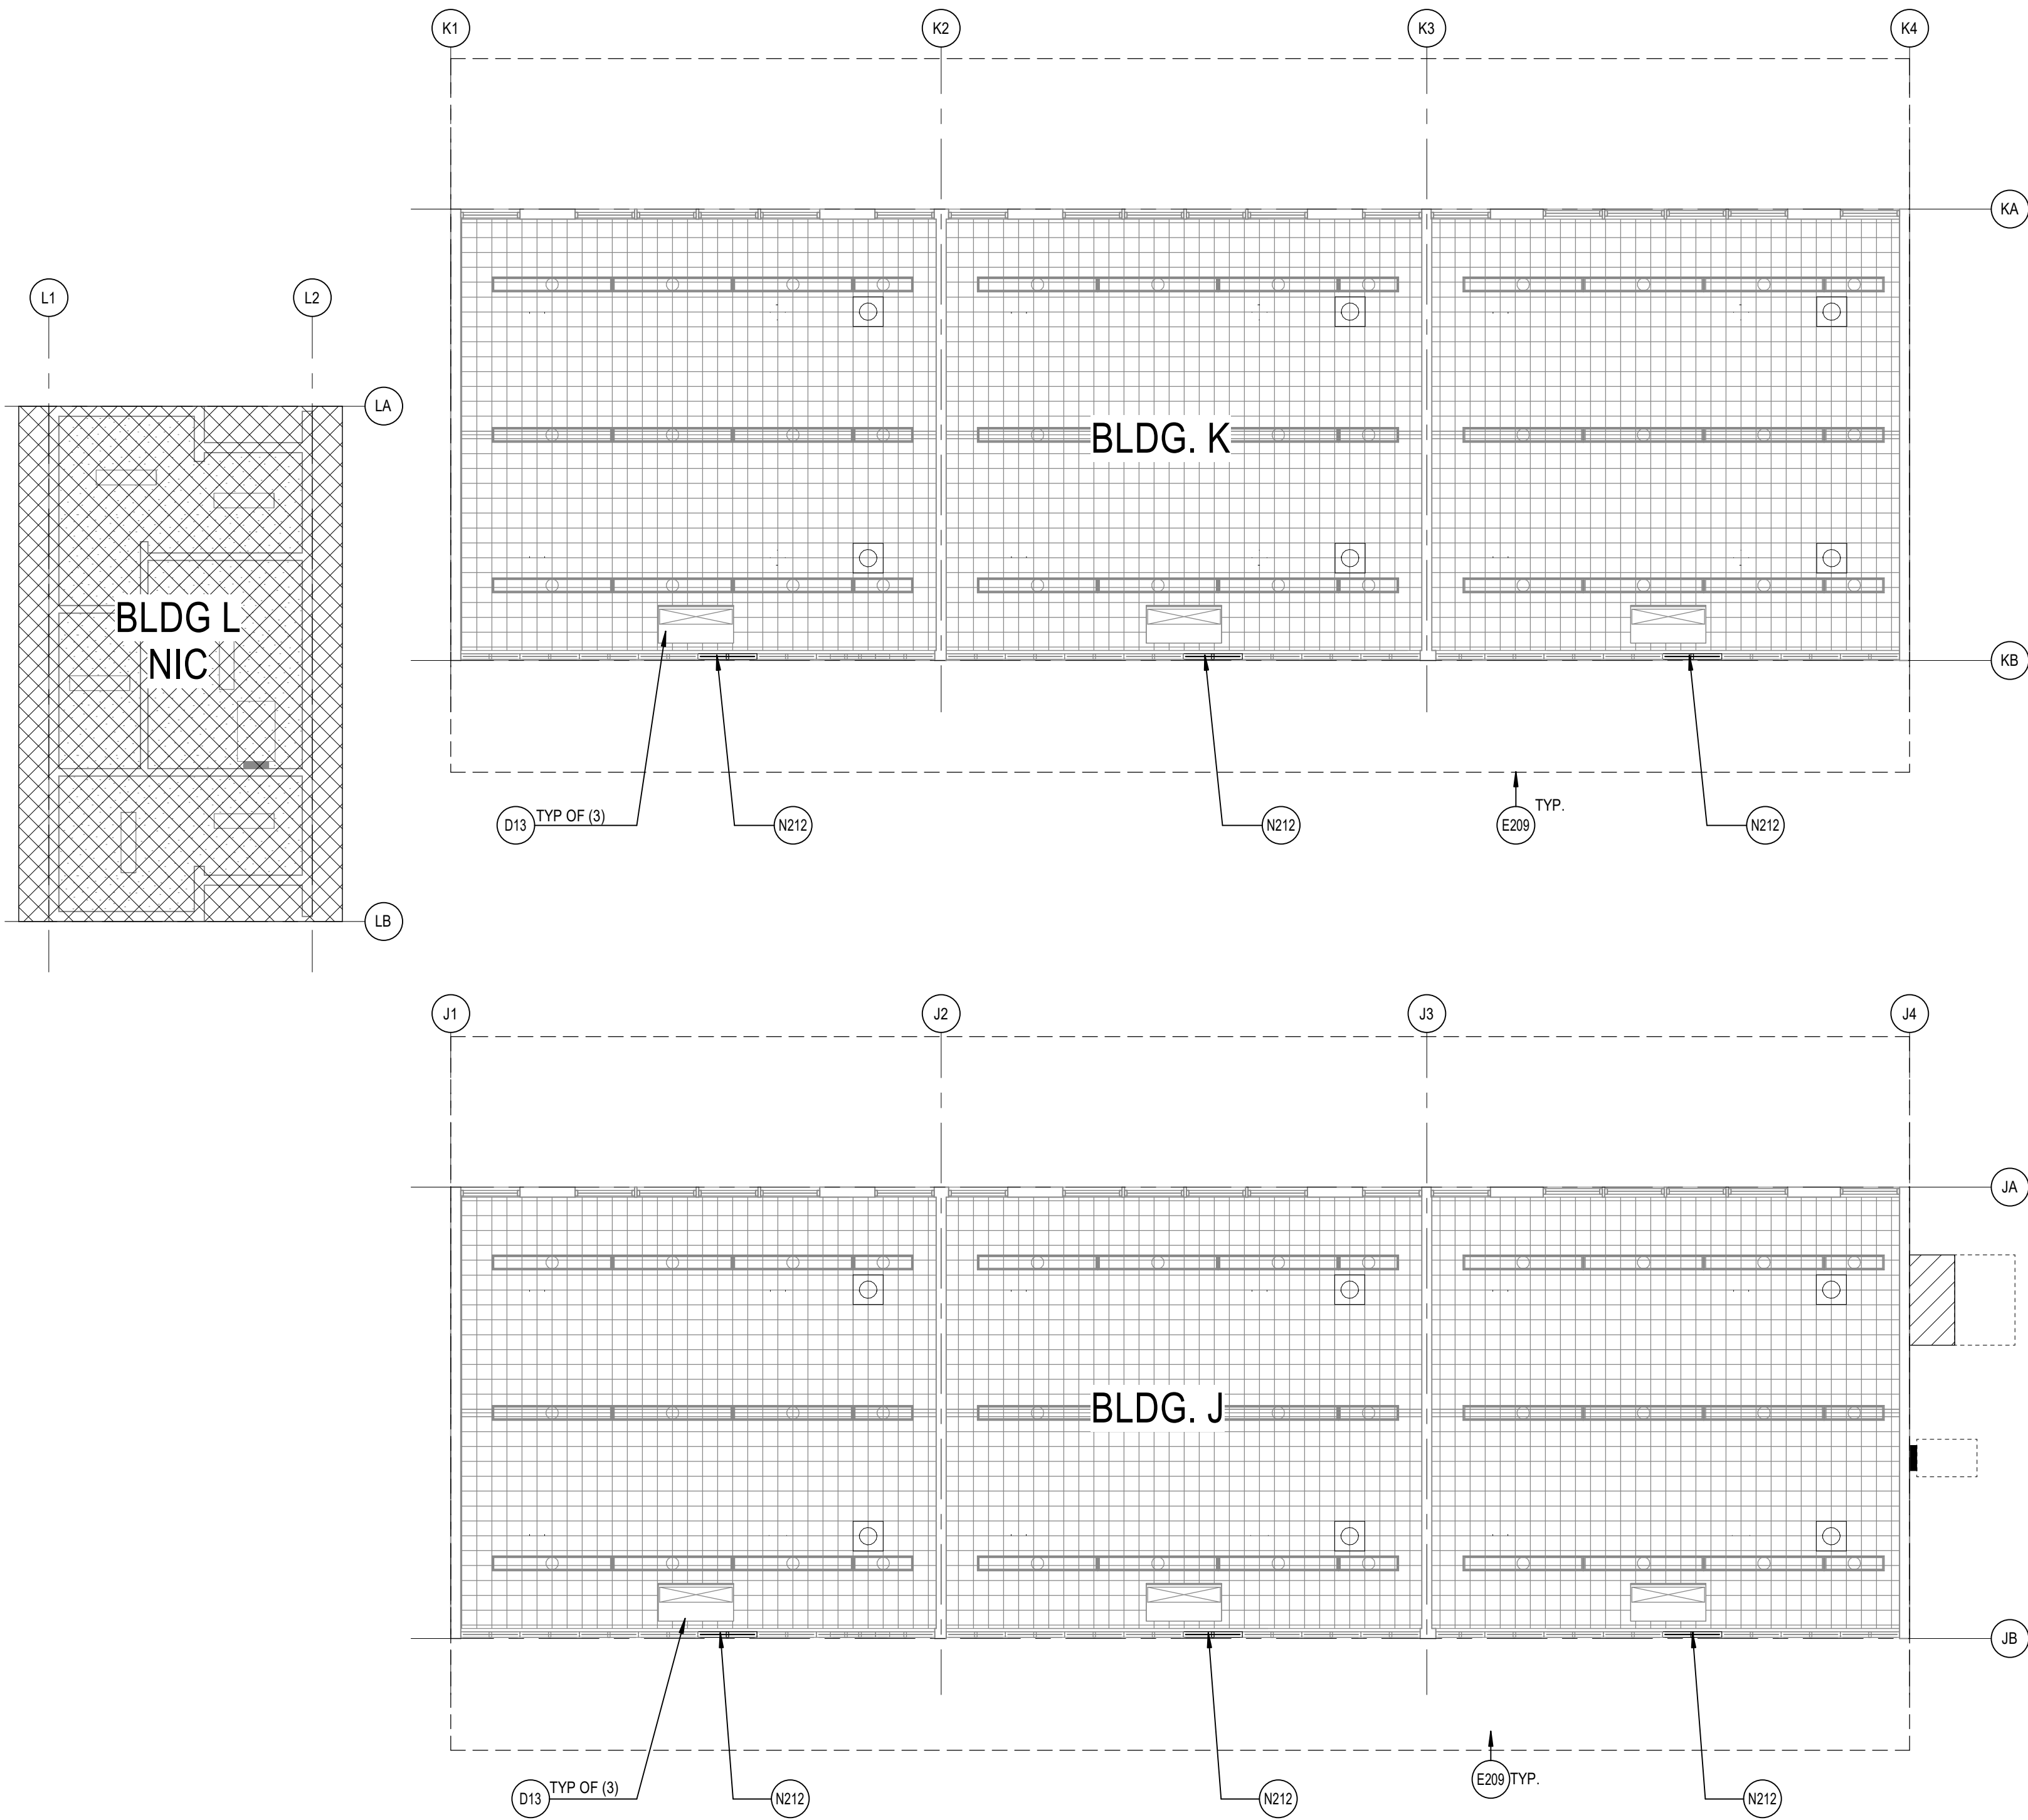

REFERENCE KEYNOTES

- D13 REMOVE (E) CEILING MOUNTED FAN COIL UNIT - SEE MECHANICAL DRAWINGS  
E209 LINE OF (E) ROOF ABOVE SHOWN DASHED  
N212 REPLACE (E) INFILL PANEL AT CONDENSER UNIT PENETRATIONS WITH GLAZING TO MATCH ADJACENT. PAINT FRAME TO MATCH ADJACENT

REFLECTED CEILING PLAN  
GENERAL NOTES

- A. REFLECTED CEILING PLAN GENERAL NOTES APPLY TO ALL REFLECTED CEILING PLAN SHEETS.  
B. ALL CEILING GRID/PANELS SHALL BE CENTERED IN EACH ROOM UNLESS NOTED OTHERWISE.  
C. (E) CEILING HEIGHTS ARE TO REMAIN U.N.O. REFLECTED CEILING PLANS ARE MEASURED FROM THE FINISH FLOOR OF THE ROOM.  
D. IN ACOUSTICAL CEILING PANELS WITH SCORE IN THE CENTER, CENTER DEVICES IN ONE HALF OF THE TILE. DO NOT LOCATE ON THE SCORE. FOR ACP WITH MULTIPLE SCORED PATTERNS, COORDINATE LOCATION WITH THE ARCHITECT.  
E. PROVIDE SUSPENSION SYSTEM AROUND ELECTRICAL FIXTURES, MECHANICAL GRILLES, DIFFUSERS, AND OTHER CEILING MOUNTED DEVICES. AT ACOUSTICAL PANEL CEILINGS.  
F. ALL DIMENSIONS ON REFLECTED CEILING PLANS ARE ACTUAL, AND ARE TO THE FOLLOWING UNLESS NOTED OTHERWISE:  
a. FACE OF FINISHED WALL  
b. FACE OF FINISHED BULKHEADS  
c. CENTERLINE OF COLUMNS  
d. CENTERLINE OF TEES  
G. IN AREAS WITH EXPOSED STRUCTURE CEILINGS, COORDINATE EXACT LOCATIONS OF MECHANICAL GRILLES, DIFFUSERS, DUCTWORK AND ELECTRICAL FIXTURES WITH EACH REPRESENTATIVE SUBCONTRACTOR.

DEMOLITION GENERAL NOTES

DEMOLITION NOTES APPLY TO ALL DEMOLITION SHEETS.

- THE CONTRACTOR SHALL:  
A. COORDINATE ALL DEMOLITION AND PHASING EFFORTS WITH THE ARCHITECT AND OWNER'S REPRESENTATIVE. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF OWNER'S OPERATIONS. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH THE OWNER'S REPRESENTATIVE. IN ALL CASES, PROVISIONS SHALL BE MADE FOR USER'S SAFETY.  
B. COORDINATE ANY DISRUPTION OF UTILITY SERVICES WITH THE OWNER AND AS SPECIFIED.  
C. CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN THE EXISTING BUILDING WHICH OFFER A ONE-HOUR ENCLOSURE TO ISOLATE ANY DEMOLITION/CONSTRUCTION WORK FROM THE GENERAL PUBLIC AND AS DEEMED NECESSARY BY THE OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH THE OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK.  
D. MAINTAIN A SECURE, WEATHER-TIGHT ENCLOSURE AT ALL TIMES.  
E. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND ELEVATIONS AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.  
F. REMOVE IN THEIR ENTIRETY ALL EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, AND OTHER ITEMS, AS REQUIRED TO EXECUTE THE DEMOLITION/CONSTRUCTION WORK DESCRIBED BY THE DRAWINGS.  
G. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.  
H. PROVIDE PROTECTION FOR ALL EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO ANY DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT.  
I. REPAIR OR REPLACE ITEMS THAT ARE DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND/OR CONDITION.  
J. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY ARCHITECT.  
K. VERIFY AND MAINTAIN THE LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF THEIR SERVICE.  
L. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR RE-ROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, AND OTHER ITEMS, AS REQUIRED TO MAINTAIN FIRE-RESISTANCE-RATED SEPARATIONS. FINISH AS REQUIRED FOR NEW OR EXISTING ADJACENT SURFACES.  
M. CAP ALL DISCONNECTED MECHANICAL PIPING LINES WITHIN THE WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES.  
N. SEE MECHANICAL AND ELECTRICAL DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF WORK.  
O. AVOID ANY DISTURBANCE OF SOILS WITHIN THE ZONE OF INFLUENCE AROUND EXISTING FOOTINGS AND FLOOR SLABS AS DIRECTED BY GEOTECHNICAL ENGINEER.  
P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH-IN NEW CMU PATCHES.  
Q. WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED, PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 1'-0" BEYOND DEMOLITION.



WORKMAN ELEMENTARY SCHOOL  
COVID 19 - COVINA VALLEY USD DISTRIC WIDE HVAC REPLACEMENT

1941 E. WORKMAN AVE. WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
DSA A#03-122234  
DSA File #: 19-25

AREA F -  
REFLECTED  
CEILING PLAN

A3.1F











1

STATE OF CALIFORNIA

Mechanical Systems

CERTIFICATE OF COMPLIANCE

Project Name: CVUSD Workman

Report Page: NRCC-MCH-E

Project Address: 1941 E Workman Ave

Date Prepared: 5/4/2022

H. FAN SYSTEMS & AIR ECONOMIZERS									
System Name:	RTU-11	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(a) and (m)	System Fan Type:	Constant Volume		
01	02	03	04	05	06	07	08		
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B Device	Design Airflow through Device (CFM)		
SF	Supply	1	1200	BHP	0.91				
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):	0.91	Maximum System Fan Power (BHP):			
System Name:	RTU-12	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(a) and (m)	System Fan Type:	Constant Volume		
01	02	03	04	05	06	07	08		
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B Device	Design Airflow through Device (CFM)		
SF	Supply	1	1200	BHP	0.91				
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):	0.91	Maximum System Fan Power (BHP):			
System Name:	RTU-13	Economizer <sup>1</sup>	NA: <=54 kBtu/h cooling	Economizer Controls:	Designed per §140.4(a) and (m)	System Fan Type:	Constant Volume		
01	02	03	04	05	06	07	08		
Fan Name or Item Tag	Fan Function	Qty	Maximum Design Supply Airflow (CFM)	HP Unit <sup>2</sup>	Design HP	Fan Power Pressure Drop Adjustment - Table 140.4-B Device	Design Airflow through Device (CFM)		
SF	Supply	1	1200	BHP	0.91				
Total System Design Supply Airflow (CFM):			1200	Total System Design (BHP):	0.91	Maximum System Fan Power (BHP):			

<sup>1</sup> FOOTNOTES: Computer room economizers must meet requirements of §140.9(a) and will be documented on the NRCC-PRC-E document.

<sup>2</sup> The unit used for HP must be consistent for all fans within a system.

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003

Report Generated: 2022-05-04 08:40:41

Schema Version: rev 20200601

3

STATE OF CALIFORNIA

Mechanical Systems

CERTIFICATE OF COMPLIANCE

Project Name: CVUSD Workman

Report Page: NRCC-MCH-E

Project Address: 1941 E Workman Ave

Date Prepared: 5/4/2022

J. VENTILATION AND INDOOR AIR QUALITY									
Classroom	Lecture/ postsecondary classroom	1285		30	450	0	0	DCV	Provided per §120.1(d)(4)
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
04		05			06			07	
System Name	RTU-C2	System Design OA CFM Airflow <sup>1</sup>		450	System Design Transfer Air CFM		0	Air Filtration per §120.1(c) and §141.0(b)(2) <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))	
08	09		10	11	12	13	14	15	16
Mechanical Ventilation Required per §120.1(c)(3) <sup>3</sup>						Exh. Vent per §120.1(c)(4)			
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)(3), §120.1(d)(5), and §120.1(e)(3) <sup>6</sup>	
Classroom	Lecture/ postsecondary classroom	1285		30	450	0	0	DCV	Provided per §120.1(d)(4)
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
04		05			06			07	
System Name	RTU-D1	System Design OA CFM Airflow <sup>1</sup>		450	System Design Transfer Air CFM		0	Air Filtration per §120.1(c) and §141.0(b)(2) <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))	
08	09		10	11	12	13	14	15	16
Mechanical Ventilation Required per §120.1(c)(3) <sup>3</sup>						Exh. Vent per §120.1(c)(4)			
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)(3), §120.1(d)(5), and §120.1(e)(3) <sup>6</sup>	

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003

Report Generated: 2022-05-04 08:40:41

Schema Version: rev 20200601

4

STATE OF CALIFORNIA

Mechanical Systems

CERTIFICATE OF COMPLIANCE

Project Name: CVUSD Workman

Report Page: NRCC-MCH-E

Project Address: 1941 E Workman Ave

Date Prepared: 5/4/2022

J. VENTILATION AND INDOOR AIR QUALITY										
Classroom	Lecture/ postsecondary classroom	895		30	450	0	0	DCV	Provided per §120.1(d)(4)	
								Occ Sensor	NA: Not required space type	
17	Total System Required Min OA CFM						450	18	Ventilation for this System Complies?	Yes
04		05			06			07		
System Name	RTU-G2	System Design OA CFM Airflow <sup>1</sup>			450	System Design Transfer Air CFM		0	Air Filtration per §120.1(c) and §141.0(b)(2) <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))	
08	09	10	11	12	13	14	15	16		
Mechanical Ventilation Required per §120.1(c)(3) <sup>3</sup>						Exh. Vent per §120.1(c)(4)				
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)(3), §120.1(d)(5), and §120.1(e)(3) <sup>6</sup>		
Classroom	Lecture/ postsecondary classroom	895		30	450	0	0	DCV	Provided per §120.1(d)(4)	
								Occ Sensor	NA: Not required space type	
17	Total System Required Min OA CFM						450	18	Ventilation for this System Complies?	Yes
04		05			06			07		
System Name	RTU-G3	System Design OA CFM Airflow <sup>1</sup>			450	System Design Transfer Air CFM		0	Air Filtration per §120.1(c) and §141.0(b)(2) <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))	
08	09	10	11	12	13	14	15	16		
Mechanical Ventilation Required per §120.1(c)(3) <sup>3</sup>						Exh. Vent per §120.1(c)(4)				
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)(3), §120.1(d)(5), and §120.1(e)(3) <sup>6</sup>		

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003

Report Generated: 2022-05-04 08:40:41

Schema Version: rev 20200601

Autodesk Docs/75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD - Workman ES MEP\_2022.rvt  
11/02/2022 5:09:54 PM

5

STATE OF CALIFORNIA

Mechanical Systems

CERTIFICATE OF COMPLIANCE

Project Name: CVUSD Workman

Report Page: NRCC-MCH-E

Project Address: 1941 E Workman Ave

Date Prepared: 5/4/2022

I. SYSTEM CONTROLS								
This table is used to demonstrate compliance with mandatory controls in §110.2 and §120.2 and prescriptive controls in §140.4(f) and (n) or requirements in §141.0(b)(2)E for altered space conditioning systems.								
01	02	03	04	05	06	07	08	09
System Name	System Zoning	Conditioned Floor Area Being Served (ft <sup>2</sup> )	Thermostats §110.2(b) & (c) <sup>1</sup> , §120.2(a) or §141.0(b)(2)E	Shut-Off Controls §120.2(c)	Isolation Zone Controls §120.2(a)	Demand Response §110.12 and §120.2(b)	Supply Air Temp. Reset §140.4(f)	Window Interlocks per §140.4(n)
RTU-C1	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-C2	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-D1	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-E1	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-E2	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-E3	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-G1	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-G2	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-G3	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-H1	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-H2	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided
RTU-H3	Single zone	<= 25,000 ft <sup>2</sup>	Setback	Auto Timer Switch	4 Hour Timer	EMCS	Included	Provided

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003

Report Generated: 2022-05-04 08:40:41

Schema Version: rev 20200601

STATE OF CALIFORNIA

Mechanical Systems

CERTIFICATE OF COMPLIANCE

Project Name: CVUSD Workman

Report Page: NRCC-MCH-E

Project Address: 1941 E Workman Ave

Date Prepared: 5/4/2022

J. VENTILATION AND INDOOR AIR QUALITY									
Classroom	Lecture/ postsecondary classroom	1270		30	450	0	0	DCV	Provided per §120.1(d)(4)
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
04		05			06			07	
System Name	RTU-E1	System Design OA CFM Airflow <sup>1</sup>		450	System Design Transfer Air CFM		0	Air Filtration per §120.1(c) and §141.0(b)(2) <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))	
08	09	10	11	12	13	14	15	16	
Mechanical Ventilation Required per §120.1(c)(3) <sup>3</sup>						Exh. Vent per §120.1(c)(4)			
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)(3), §120.1(d)(5), and §120.1(e)(3) <sup>6</sup>	
Classroom	Lecture/ postsecondary classroom	895		30	450	0	0	DCV	Provided per §120.1(d)(4)
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
04		05			06			07	
System Name	RTU-E2	System Design OA CFM Airflow <sup>1</sup>		450	System Design Transfer Air CFM		0	Air Filtration per §120.1(c) and §141.0(b)(2) <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))	
08	09	10	11	12	13	14	15	16	
Mechanical Ventilation Required per §120.1(c)(3) <sup>3</sup>						Exh. Vent per §120.1(c)(4)			
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)(3), §120.1(d)(5), and §120.1(e)(3) <sup>6</sup>	

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003

Report Generated: 2022-05-04 08:40:41

Schema Version: rev 20200601

STATE OF CALIFORNIA

Mechanical Systems

CERTIFICATE OF COMPLIANCE

Project Name: CVUSD Workman

Report Page: NRCC-MCH-E

Project Address: 1941 E Workman Ave

Date Prepared: 5/4/2022

VENTILATION AND INDOOR AIR QUALITY									
Classroom	Lecture/ postsecondary classroom	895		30	450	0	0	DCV	Provided per §120.1(d)(4)
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
04		05			06			07	
System Name	RTU-H1	System Design OA CFM Airflow <sup>1</sup>		450	System Design Transfer Air CFM		0	Air Filtration per §120.1(c) and §141.0(b)(2) <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))	
08	09	10	11	12	13	14	15	16	
Mechanical Ventilation Required per §120.1(c)(3) <sup>3</sup>						Exh. Vent per §120.1(c)(4)			
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)(3), §120.1(d)(5), and §120.1(e)(3) <sup>6</sup>	
Classroom	Lecture/ postsecondary classroom	895		30	450	0	0	DCV	Provided per §120.1(d)(4)
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
04		05			06			07	
System Name	RTU-H2	System Design OA CFM Airflow <sup>1</sup>		450	System Design Transfer Air CFM		0	Air Filtration per §120.1(c) and §141.0(b)(2) <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))	
08	09	10	11	12	13	14	15	16	
Mechanical Ventilation Required per §120.1(c)(3) <sup>3</sup>						Exh. Vent per §120.1(c)(4)			
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)(3), §120.1(d)(5), and §120.1(e)(3) <sup>6</sup>	

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003

Report Generated: 2022-05-04 08:40:41

Schema Version: rev 20200601

STATE OF CALIFORNIA

Mechanical Systems

CERTIFICATE OF COMPLIANCE

Project Name: CVUSD Workman

Report Page: NRCC-MCH-E

Project Address: 1941 E Workman Ave

Date Prepared: 5/4/2022

I. SYSTEM CONTROLS	
--------------------	--



1  
2  
3  
4  
5

Autodesk Docs/175-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD\_Workman ES\_MEP\_2022.rvt  
1/02/2022 5:02:59 PM

STATE OF CALIFORNIA

Mechanical Systems

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-MCH-E

NRCC-MCH-E

Project Name:

CVUSD Workman

Report Page:

(Page 19 of 36)

Project Address:

1941 E Workman Ave

Date Prepared:

5/4/2022

J. VENTILATION AND INDOOR AIR QUALITY									
Classroom	Lecture/ postsecondary classroom	895		30	450	0	0	DCV	Provided per §120.1(d)4
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
04		05			06		07		
System Name	RTU-I2	System Design OA CFM Airflow <sup>1</sup>		450	System Design Transfer Air CFM	0	Air Filtration per §120.1(c) and §141.0(b)2 <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))		
08	09			10	11	12	13	14	15
Mechanical Ventilation Required per §120.1(c)3 <sup>3</sup>					Exh. Vent per §120.1(c)4				
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)3, §120.1(d)5, and §120.1(e)3 <sup>6</sup>	
Classroom	Lecture/ postsecondary classroom	895		30	450	0	0	DCV	Provided per §120.1(d)4
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
04		05			06		07		
System Name	RTU-I3	System Design OA CFM Airflow <sup>1</sup>		450	System Design Transfer Air CFM	0	Air Filtration per §120.1(c) and §141.0(b)2 <sup>2</sup> Provided per §120.1(c) (NR and Hotel/Motel))		
08	09			10	11	12	13	14	15
Mechanical Ventilation Required per §120.1(c)3 <sup>3</sup>					Exh. Vent per §120.1(c)4				
Space Name or Item Tag	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM	DCV or Sensor Controls per §120.1(d)3, §120.1(d)5, and §120.1(e)3 <sup>6</sup>	

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003  
Schema Version: rev 20200601

Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA

Mechanical Systems

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-MCH-E

NRCC-MCH-E

Project Name:

CVUSD Workman

Report Page:

(Page 22 of 36)

Project Address:

1941 E Workman Ave

Date Prepared:

5/4/2022

L. DISTRIBUTION (DUCTWORK AND PIPING)									
		<input type="checkbox"/>	In a space directly under a roof that has a U-factor greater than the u-factor of the ceiling, or if the roof does not meet the requirements of §140.3(a)18 or if the roof has fixed vents or openings to the outside/ unconditioned spaces						
		<input type="checkbox"/>	In an unconditioned crawl space						
		<input type="checkbox"/>	In other unconditioned spaces						
15		The scope of the project includes extending an existing duct system, which is constructed, insulated or sealed with asbestos.							
16		The scope of the project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and diagnostic testing in accordance with procedures in the Reference Nonresidential Appendix NA2.							
17	Yes	Duct system shall be sealed in accordance with the California Mechanical Code							
The answers to the questions below apply to the following duct systems:		RTU-E1	Duct leakage testing triggered for these systems?					No	
11	No	The scope of the project includes only duct systems serving healthcare facilities							
12	Yes	Duct system provides conditioned air to an occupiable space for a constant volume, single zone, space-conditioning system.							
13	Yes	The space conditioning system serves less than 5,000 ft² of conditioned floor area.							
14	No	The combined surface area of the ducts in the following locations is more than 25% of the total surface area of the entire duct system:							
		<input type="checkbox"/>	Outdoors						
		<input type="checkbox"/>	In a space directly under a roof that has a U-factor greater than the u-factor of the ceiling, or if the roof does not meet the requirements of §140.3(a)18 or if the roof has fixed vents or openings to the outside/ unconditioned spaces						
		<input type="checkbox"/>	In an unconditioned crawl space						
		<input type="checkbox"/>	In other unconditioned spaces						
15		The scope of the project includes extending an existing duct system, which is constructed, insulated or sealed with asbestos.							
16		The scope of the project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and diagnostic testing in accordance with procedures in the Reference Nonresidential Appendix NA2.							
17	Yes	Duct system shall be sealed in accordance with the California Mechanical Code							
The answers to the questions below apply to the following duct systems:		RTU-E2	Duct leakage testing triggered for these systems?					No	
11	No	The scope of the project includes only duct systems serving healthcare facilities							
12	Yes	Duct system provides conditioned air to an occupiable space for a constant volume, single zone, space-conditioning system.							
13	Yes	The space conditioning system serves less than 5,000 ft² of conditioned floor area.							
14	No	The combined surface area of the ducts in the following locations is more than 25% of the total surface area of the entire duct system:							
		<input type="checkbox"/>	Outdoors						

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003  
Schema Version: rev 20200601

Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA

Mechanical Systems

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-MCH-E

NRCC-MCH-E

Project Name:

CVUSD Workman

Report Page:

(Page 25 of 36)

Project Address:

1941 E Workman Ave

Date Prepared:

5/4/2022

L. DISTRIBUTION (DUCTWORK AND PIPING)									
		<input type="checkbox"/>	In a space directly under a roof that has a U-factor greater than the u-factor of the ceiling, or if the roof does not meet the requirements of §140.3(a)18 or if the roof has fixed vents or openings to the outside/ unconditioned spaces						
		<input type="checkbox"/>	In an unconditioned crawl space						
		<input type="checkbox"/>	In other unconditioned spaces						
15		The scope of the project includes extending an existing duct system, which is constructed, insulated or sealed with asbestos.							
16		The scope of the project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and diagnostic testing in accordance with procedures in the Reference Nonresidential Appendix NA2.							
17	Yes	Duct system shall be sealed in accordance with the California Mechanical Code							
The answers to the questions below apply to the following duct systems:		RTU-H1	Duct leakage testing triggered for these systems?		No				
11	No	The scope of the project includes only duct systems serving healthcare facilities							
12	Yes	Duct system provides conditioned air to an occupiable space for a constant volume, single zone, space-conditioning system.							
13	Yes	The space conditioning system serves less than 5,000 ft² of conditioned floor area.							
14	No	The combined surface area of the ducts in the following locations is more than 25% of the total surface area of the entire duct system:							
		<input type="checkbox"/>	Outdoors						
		<input type="checkbox"/>	In a space directly under a roof that has a U-factor greater than the u-factor of the ceiling, or if the roof does not meet the requirements of §140.3(a)18 or if the roof has fixed vents or openings to the outside/ unconditioned spaces						
		<input type="checkbox"/>	In an unconditioned crawl space						
		<input type="checkbox"/>	In other unconditioned spaces						
15		The scope of the project includes extending an existing duct system, which is constructed, insulated or sealed with asbestos.							
16		The scope of the project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and diagnostic testing in accordance with procedures in the Reference Nonresidential Appendix NA2.							
17	Yes	Duct system shall be sealed in accordance with the California Mechanical Code							
The answers to the questions below apply to the following duct systems:		RTU-H2	Duct leakage testing triggered for these systems?		No				
11	No	The scope of the project includes only duct systems serving healthcare facilities							
12	Yes	Duct system provides conditioned air to an occupiable space for a constant volume, single zone, space-conditioning system.							
13	Yes	The space conditioning system serves less than 5,000 ft² of conditioned floor area.							
14	No	The combined surface area of the ducts in the following locations is more than 25% of the total surface area of the entire duct system:							
		<input type="checkbox"/>	Outdoors						

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003  
Schema Version: rev 20200601

Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA

Mechanical Systems

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-MCH-E

NRCC-MCH-E

Project Name:

CVUSD Workman

Report Page:

(Page 26 of 36)

Project Address:

1941 E Workman Ave

Date Prepared:

5/4/2022

J. VENTILATION AND INDOOR AIR QUALITY									
Classroom	Lecture/ postsecondary classroom	895		30	450	0	0	DCV	Provided per §120.1(d)4
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				450	18	Ventilation for this System Complies?		Yes
<sup>1</sup> FOOTNOTES: System CFM should include both mechanical and natural ventilation for the zone/system									
<sup>2</sup> Air filtration requirements apply to the following three system types per §120.1(c)1A: space conditioning systems utilizing ducts to supply air to occupiable space; supply-only ventilation systems providing outside air to occupiable space; supply side of balanced ventilation systems including heat recovery and energy recovery ventilation systems providing outside air to occupiable space.									
<sup>3</sup> Uniform Mechanical Code may have more stringent ventilation requirements; the most stringent code requirement takes precedence.									
<sup>5</sup> See Standards Tables 120.1-A and 120.1-B.									
<sup>6</sup> For lecture halls with fixed seating, the expected number of occupants shall be determined in accordance with the California Building Code.									
<sup>6</sup> §120.2(e)3 requires systems serving rooms that are required by §130.1(c) to have lighting occupancy sensing controls to also have occupancy sensing zone controls for ventilation. Examples of spaces which require lighting occupancy sensors include offices 250ft <sup>2</sup> or smaller, multipurpose rooms less than 1,000 ft <sup>2</sup> , classrooms, conference rooms, restrooms, aisles and open areas in warehouses, library book stack aisles, corridors, stairwells, parking garages, and loading and unloading zones, unless excepted by §130.1(c).									
K. TERMINAL BOX CONTROLS									
This section does not apply to this project.									
L. DISTRIBUTION (DUCTWORK AND PIPING)									
This table is used to show compliance with mandatory pipe insulation requirements found in §120.3 and prescriptive requirements found in §140.4(f) for duct leakage testing.									
Duct Leakage Sealing									
The answers to the questions below apply to the following duct systems:				RTU-C1		Duct leakage testing triggered for these systems?		No	
11	No	The scope of the project includes only duct systems serving healthcare facilities							
12	Yes	Duct system provides conditioned air to an occupiable space for a constant volume, single zone, space-conditioning system.							
13	Yes	The space conditioning system serves less than 5,000 ft <sup>2</sup> of conditioned floor area.							
14	No	The combined surface area of the ducts in the following locations is more than 25% of the total surface area of the entire duct system: <div><input type="checkbox"/> Outdoors</div>							

Registration Number:

Registration Date/Time:

Registration Provider: Energysoft

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Report Version: 2019.1.003  
Schema Version: rev 20200601

Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA

Mechanical Systems

CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE

NRCC-MCH-E

NRCC-MCH-E

Project Name:

CVUSD Workman

Report Page:

(Page 23 of 36)

Project Address:

1941 E Workman Ave

Date Prepared:

5/4/2022

L. DISTRIBUTION (DUCTWORK AND PIPING)									
		<input type="checkbox"/>	In a space directly under a roof that has a U-factor greater than the u-factor of the ceiling, or if the roof does not meet the requirements of §140.3(a)18 or if the roof has fixed vents or openings to the outside/ unconditioned spaces						
		<input type="checkbox"/>	In an unconditioned crawl space						
		<input type="checkbox"/>	In other unconditioned spaces						
15		The scope of the project includes extending an existing duct system, which is constructed, insulated or sealed with asbestos.							
16		The scope of the project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and diagnostic testing in accordance with procedures in the Reference Nonresidential Appendix NA2.							
17	Yes	Duct system shall be sealed in accordance with the California Mechanical Code							
The answers to the questions below apply to the following duct systems:		RTU-E3	Duct leakage testing triggered for these systems?		No				
11	No	The scope of the project includes only duct systems serving healthcare facilities							
12	Yes	Duct system provides conditioned air to an occupiable space for a constant volume, single zone, space-conditioning system.							
13	Yes	The space conditioning system serves less than 5,000 ft <sup>2</sup> of conditioned floor area.							
14	No	The combined surface area of the ducts in the following locations is more than 25% of the total surface area of the entire duct system:							
		<input type="checkbox"/>	Outdoors						
		<input type="checkbox"/>	In a space directly under a roof that has a U-factor greater than the u-factor of the ceiling, or if the roof does not meet the requirements of §140.3(a)18 or if the roof has fixed vents or openings to the outside/ unconditioned spaces						
		<input type="checkbox"/>	In an unconditioned crawl space						
		<input type="checkbox"/>	In other unconditioned spaces						
15		The scope of the project includes extending an existing duct system, which is constructed, insulated or sealed with asbestos.							
16		The scope of the project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and diagnostic testing in accordance with procedures in the Reference Nonresidential Appendix NA2.							
17	Yes	Duct system shall be sealed in accordance with the California Mechanical Code							
The answers to the questions below apply to the following duct systems:		RTU-E3	Duct leakage testing triggered for these systems?		No				
11	No	The scope of the project includes only duct systems serving healthcare facilities							
12	Yes	Duct system provides conditioned air to an occupiable space for a constant volume, single zone, space-conditioning system.							
13	Yes	The space conditioning system serves less than 5,000 ft <sup>2</sup> of conditioned floor area.							
14	No	The combined surface area of the ducts in the following locations is more than 25% of the total surface area of the entire duct system:							
		<input type="checkbox"/>	Outdoors						



1

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 28 of 36  
Date Prepared: 5/4/2022

L DISTRIBUTION (DUCTWORK AND PIPING)

☐ In a space directly under a roof that has a U-factor greater than the u-factor of the ceiling, or if the roof does not meet the requirements of §140.3(a)(1)B or if the roof has fixed vents or openings to the outside/ unconditioned spaces

☐ In an unconditioned crawl space

☐ In other unconditioned spaces

15

The scope of the project includes extending an existing duct system, which is constructed, insulated or sealed with asbestos.

16

The scope of the project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and diagnostic testing in accordance with procedures in the Reference Nonresidential Appendix NA2.

17

Yes

Duct system shall be sealed in accordance with the California Mechanical Code

M. COOLING TOWERS

This section does not apply to this project.

N. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/title24/2019standards/2019\_compliance\_documents/Nonresidential\_Documents/NRCA/

Form/Title

Field Inspector

Pass

Fail

NRCI-MCH-01-E - Must be submitted for all buildings

2

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Registration Date/Time: Report Version: 2019.1.003  
Schema Version: rev 20200601

Registration Provider: Energysoft  
Report Generated: 2022-05-04 08:40:41

3

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 31 of 36  
Date Prepared: 5/4/2022

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/title24/2019standards/2019\_compliance\_documents/Nonresidential\_Documents/NRCA/

Form/Title

Systems/Spaces To Be Field Verified

Field Inspector

Pass

Fail

NRCA-MCH-05-A - Air Economizer Controls

RTU-C1 CARRIER 3-TON;  
RTU-C2 CARRIER 3-TON;  
RTU-D1 CARRIER 3-TON;  
RTU-E1 CARRIER 3-TON;  
RTU-E2 CARRIER 3-TON;  
RTU-E3 CARRIER 3-TON;  
RTU-G1 CARRIER 3-TON;  
RTU-G2 CARRIER 3-TON;  
RTU-G3 CARRIER 3-TON;  
RTU-H1 CARRIER 3-TON;  
RTU-H2 CARRIER 3-TON;  
RTU-H3 CARRIER 3-TON;  
RTU-I1 CARRIER 3-TON;  
RTU-I2 CARRIER 3-TON;  
RTU-I3 CARRIER 3-TON;

4

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 36 of 36  
Date Prepared: 5/4/2022

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/title24/2019standards/2019\_compliance\_documents/Nonresidential\_Documents/NRCA/

Form/Title

Systems/Spaces To Be Field Verified

Field Inspector

Pass

Fail

NRCA-MCH-16-A Supply Air Temperature Reset Controls

RTU-C1 CARRIER 3-TON;  
RTU-C2 CARRIER 3-TON;  
RTU-D1 CARRIER 3-TON;  
RTU-E1 CARRIER 3-TON;  
RTU-E2 CARRIER 3-TON;  
RTU-E3 CARRIER 3-TON;  
RTU-G1 CARRIER 3-TON;  
RTU-G2 CARRIER 3-TON;  
RTU-G3 CARRIER 3-TON;  
RTU-H1 CARRIER 3-TON;  
RTU-H2 CARRIER 3-TON;  
RTU-H3 CARRIER 3-TON;  
RTU-I1 CARRIER 3-TON;  
RTU-I2 CARRIER 3-TON;  
RTU-I3 CARRIER 3-TON;

5

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Registration Date/Time: Report Version: 2019.1.003  
Schema Version: rev 20200601

Registration Provider: Energysoft  
Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 29 of 36  
Date Prepared: 5/4/2022

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/title24/2019standards/2019\_compliance\_documents/Nonresidential\_Documents/NRCA/

Form/Title

Systems/Spaces To Be Field Verified

Field Inspector

Pass

Fail

NRCA-MCH-02-A - Outdoor Air must be submitted for all newly installed HVAC units. Note: MCH-02-A can be performed in conjunction with MCH-07-A Supply Fan VFD Acceptance (if applicable) since testing activities overlap.

RTU-C1 CARRIER 3-TON;  
RTU-C2 CARRIER 3-TON;  
RTU-D1 CARRIER 3-TON;  
RTU-E1 CARRIER 3-TON;  
RTU-E2 CARRIER 3-TON;  
RTU-E3 CARRIER 3-TON;  
RTU-G1 CARRIER 3-TON;  
RTU-G2 CARRIER 3-TON;  
RTU-G3 CARRIER 3-TON;  
RTU-H1 CARRIER 3-TON;  
RTU-H2 CARRIER 3-TON;  
RTU-H3 CARRIER 3-TON;  
RTU-I1 CARRIER 3-TON;  
RTU-I2 CARRIER 3-TON;  
RTU-I3 CARRIER 3-TON;

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Registration Date/Time: Report Version: 2019.1.003  
Schema Version: rev 20200601

Registration Provider: Energysoft  
Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 32 of 36  
Date Prepared: 5/4/2022

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/title24/2019standards/2019\_compliance\_documents/Nonresidential\_Documents/NRCA/

Form/Title

Systems/Spaces To Be Field Verified

Field Inspector

Pass

Fail

NRCA-MCH-06-A Demand Control Ventilation Systems must be submitted for all systems required to employ demand controlled ventilation (refer to §120.1(c)(3) ) can vary outside ventilation flow rates based on maintaining interior carbon dioxide (CO<sub>2</sub>) concentration setpoints.

RTU-C1 CARRIER 3-TON;  
RTU-C2 CARRIER 3-TON;  
RTU-D1 CARRIER 3-TON;  
RTU-E1 CARRIER 3-TON;  
RTU-E2 CARRIER 3-TON;  
RTU-E3 CARRIER 3-TON;  
RTU-G1 CARRIER 3-TON;  
RTU-G2 CARRIER 3-TON;  
RTU-G3 CARRIER 3-TON;  
RTU-H1 CARRIER 3-TON;  
RTU-H2 CARRIER 3-TON;  
RTU-H3 CARRIER 3-TON;  
RTU-I1 CARRIER 3-TON;  
RTU-I2 CARRIER 3-TON;  
RTU-I3 CARRIER 3-TON;

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Registration Date/Time: Report Version: 2019.1.003  
Schema Version: rev 20200601

Registration Provider: Energysoft  
Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 35 of 36  
Date Prepared: 5/4/2022

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/title24/2019standards/2019\_compliance\_documents/Nonresidential\_Documents/NRCA/

Form/Title

Systems/Spaces To Be Field Verified

Field Inspector

Pass

Fail

NRCA-MCH-18-A Energy Management Control Systems

RTU-C1 CARRIER 3-TON;  
RTU-C2 CARRIER 3-TON;  
RTU-D1 CARRIER 3-TON;  
RTU-E1 CARRIER 3-TON;  
RTU-E2 CARRIER 3-TON;  
RTU-E3 CARRIER 3-TON;  
RTU-G1 CARRIER 3-TON;  
RTU-G2 CARRIER 3-TON;  
RTU-G3 CARRIER 3-TON;  
RTU-H1 CARRIER 3-TON;  
RTU-H2 CARRIER 3-TON;  
RTU-H3 CARRIER 3-TON;  
RTU-I1 CARRIER 3-TON;  
RTU-I2 CARRIER 3-TON;  
RTU-I3 CARRIER 3-TON;

P. DECLARATION OF REQUIRED CERTIFICATES OF VERIFICATION

There are no NRCV forms required for this project.

Q. MANDATORY MEASURES DOCUMENTATION LOCATION

This table is used to indicate where mandatory measures are documented in the plan set or construction documentation.

01

02

Compliance with Mandatory Measures documented through MCH

Yes

M-Sheets

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Registration Date/Time: Report Version: 2019.1.003  
Schema Version: rev 20200601

Registration Provider: Energysoft  
Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 30 of 36  
Date Prepared: 5/4/2022

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/title24/2019standards/2019\_compliance\_documents/Nonresidential\_Documents/NRCA/

Form/Title

Systems/Spaces To Be Field Verified

Field Inspector

Pass

Fail

NRCA-MCH-03-A - Constant Volume Single Zone HVAC NOTE: This form does not automatically move to "Yes". If Constant Volume Single Zone HVAC Systems are included in the scope, permit applicant should move this form to "Yes".

RTU-C1 CARRIER 3-TON;  
RTU-C2 CARRIER 3-TON;  
RTU-D1 CARRIER 3-TON;  
RTU-E1 CARRIER 3-TON;  
RTU-E2 CARRIER 3-TON;  
RTU-E3 CARRIER 3-TON;  
RTU-G1 CARRIER 3-TON;  
RTU-G2 CARRIER 3-TON;  
RTU-G3 CARRIER 3-TON;  
RTU-H1 CARRIER 3-TON;  
RTU-H2 CARRIER 3-TON;  
RTU-H3 CARRIER 3-TON;  
RTU-I1 CARRIER 3-TON;  
RTU-I2 CARRIER 3-TON;  
RTU-I3 CARRIER 3-TON;

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Registration Date/Time: Report Version: 2019.1.003  
Schema Version: rev 20200601

Registration Provider: Energysoft  
Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 33 of 36  
Date Prepared: 5/4/2022

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/title24/2019standards/2019\_compliance\_documents/Nonresidential\_Documents/NRCA/

Form/Title

Systems/Spaces To Be Field Verified

Field Inspector

Pass

Fail

NRCA-MCH-11-A Automatic Demand Shed Controls

RTU-C1 CARRIER 3-TON;  
RTU-C2 CARRIER 3-TON;  
RTU-D1 CARRIER 3-TON;  
RTU-E1 CARRIER 3-TON;  
RTU-E2 CARRIER 3-TON;  
RTU-E3 CARRIER 3-TON;  
RTU-G1 CARRIER 3-TON;  
RTU-G2 CARRIER 3-TON;  
RTU-G3 CARRIER 3-TON;  
RTU-H1 CARRIER 3-TON;  
RTU-H2 CARRIER 3-TON;  
RTU-H3 CARRIER 3-TON;  
RTU-I1 CARRIER 3-TON;  
RTU-I2 CARRIER 3-TON;  
RTU-I3 CARRIER 3-TON;

Registration Number: CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance

Registration Date/Time: Report Version: 2019.1.003  
Schema Version: rev 20200601

Registration Provider: Energysoft  
Report Generated: 2022-05-04 08:40:41

STATE OF CALIFORNIA  
**Mechanical Systems**  
NRC-MCH-E  
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE  
Project Name: CVUSD Workman  
Project Address: 1941 E Workman Ave

Report Page: 36 of 36  
Date Prepared: 5/4/2022

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: TONG FANG ZHAO

Signature Date: 2022-05-04

Address: 700 FLOWER STREET  
City/State/Zip: LOS ANGELES CA 90017

Phone: 213-444-0610

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. The information provided on this Certificate of Compliance is true and correct.

2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)

3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.

4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: TONG FANG ZHAO

Signature Date: 2022-05-04

Address: 700 FLOWER STREET  
City/State/Zip: LOS ANGELES CA 90017

Phone: 213-444-0610

Autodesk Docs/775-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD Workman ES MEP\_2022.rvt  
11/02/2022 5:02:45 PM

Workman Elementary School  
COVINA VALLEY USD  
1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS


75-22605-00

TITLE 24  
COMPLIANCE

M0.5




Autodesk Docs/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD Workman ES MEP\_2022.rvt  
1/02/2022 5:02:46 PM



# OVERALL MECHANICAL FLOOR PLAN

SCALE: 1" = 30'-0"


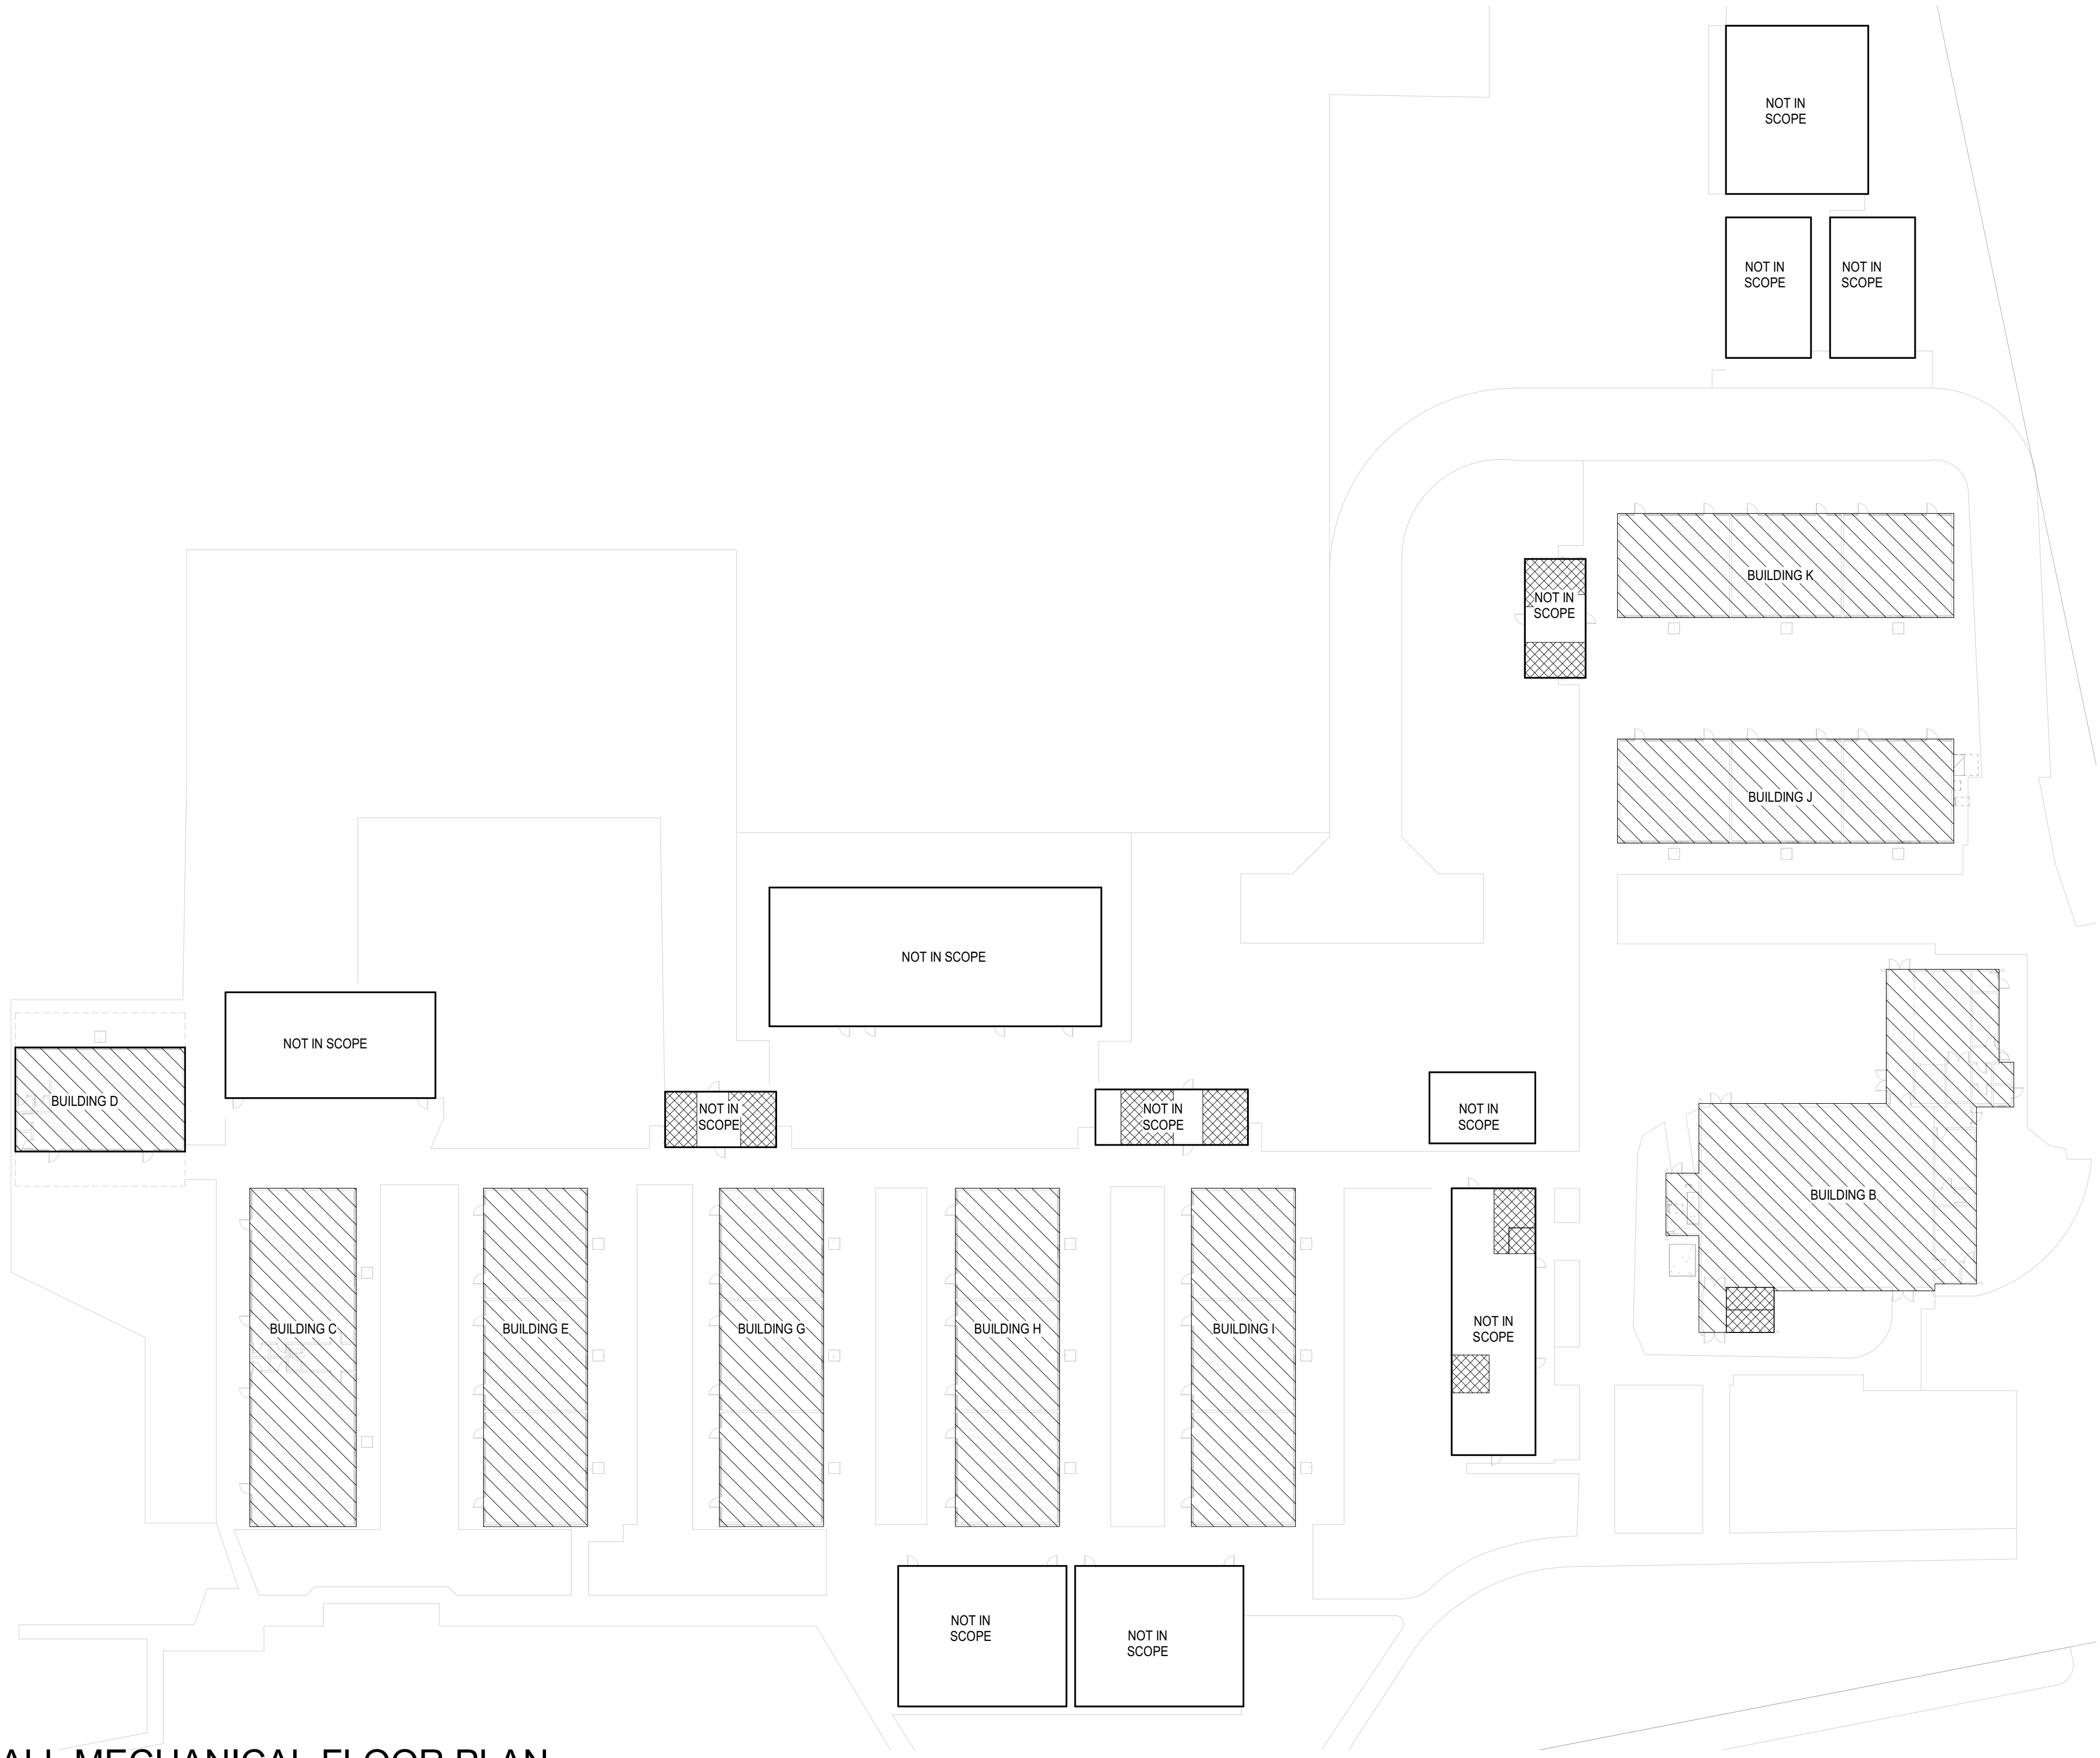


## GENERAL NOTES

A FOR SYMBOLS AND ABBREVIATIONS SEE DRAWING M0.1

## SITE LEGEND

- EXISTING BUILDING NOT IN SCOPE
- EXISTING BUILDING - SCOPE OF WORK UNDER THIS DSA APPLICATION
- (E) RESTROOMS - NOT IN SCOPE

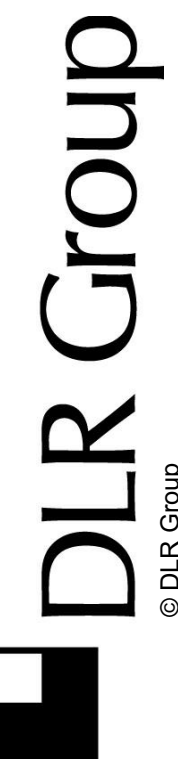

Workman Elementary School

COVINA VALLEY USD

1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00

OVERALL  
MECHANICAL  
SITE PLAN

M1.0



Autodesk Docs/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD - Workman ES MEP\_2022.rvt  
1/02/2022 5:02:57 PM


1

2

3



4

5



AREA A - MECHANICAL FLOOR PLAN

SCALE: 1/8" = 1'-0"

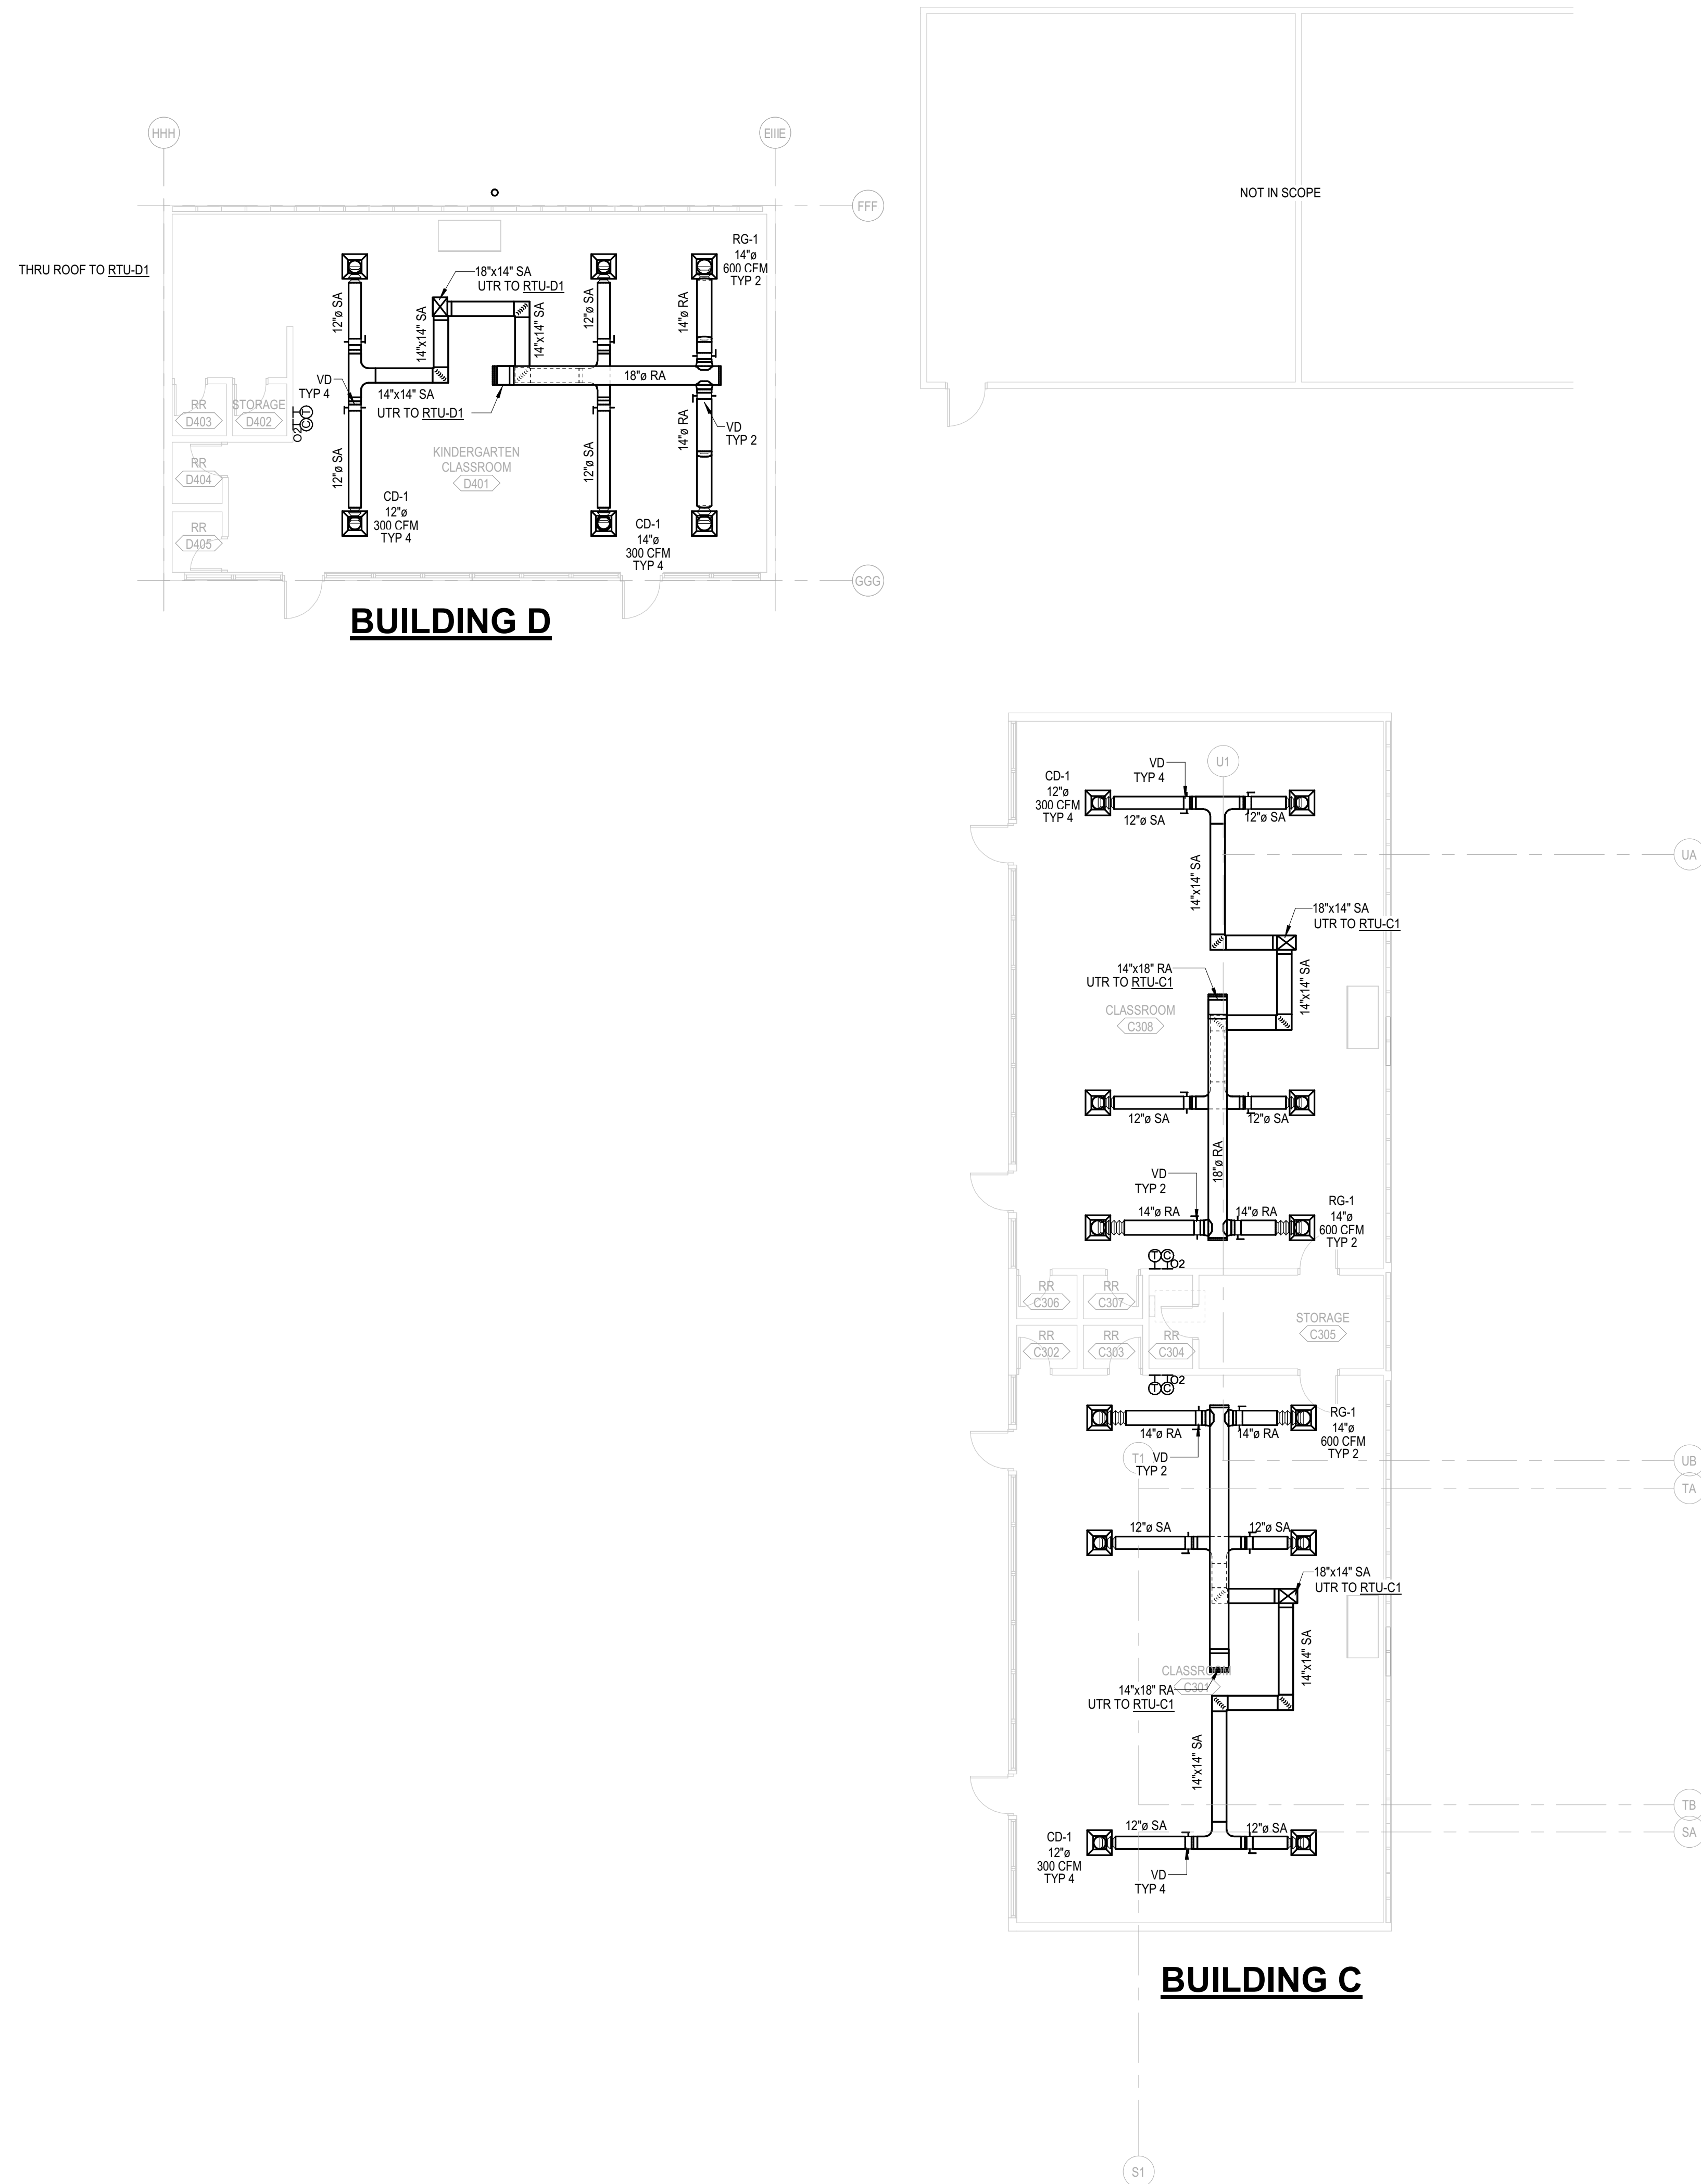


AREA A -  
MECHANICAL  
FLOOR PLAN

M1.1A

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS


Workman Elementary School  
COVINA VALLEY USD  
1941 E WORKMAN AVE, WEST COVINA, CA 91791

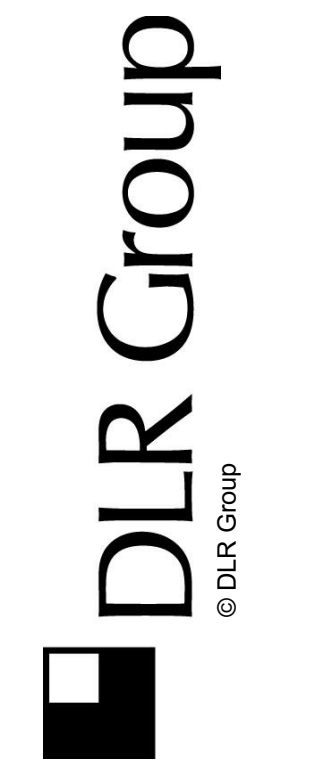




1  
2  
3  
4  
5


Autodesk Docs/75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD\_Workman ES MEP\_2022.rvt  
1/02/2022 5:02:59 PM

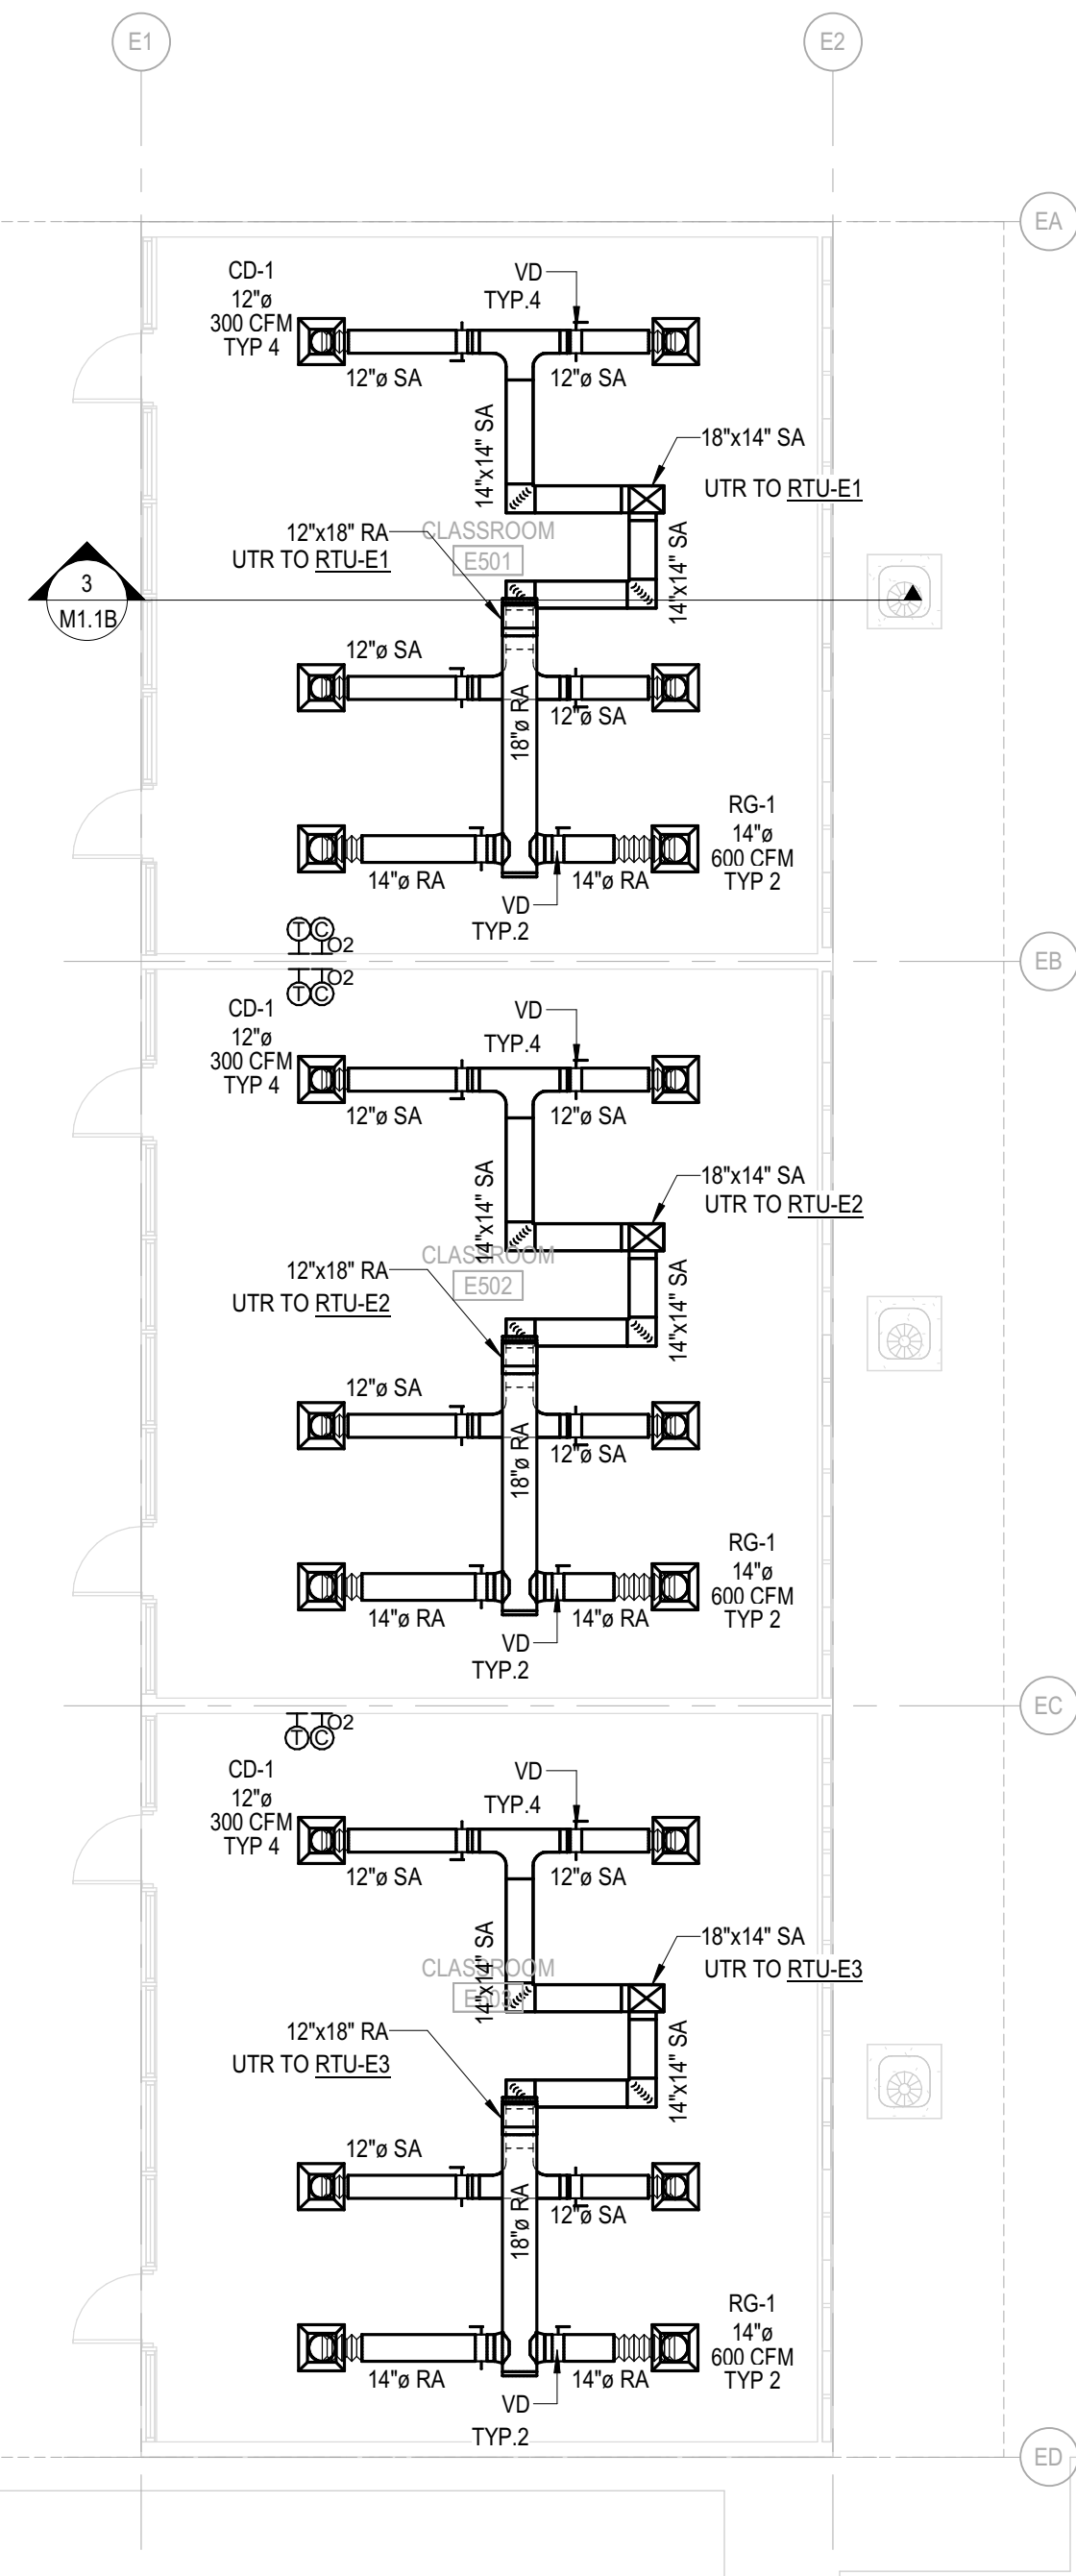


**BUILDING E**

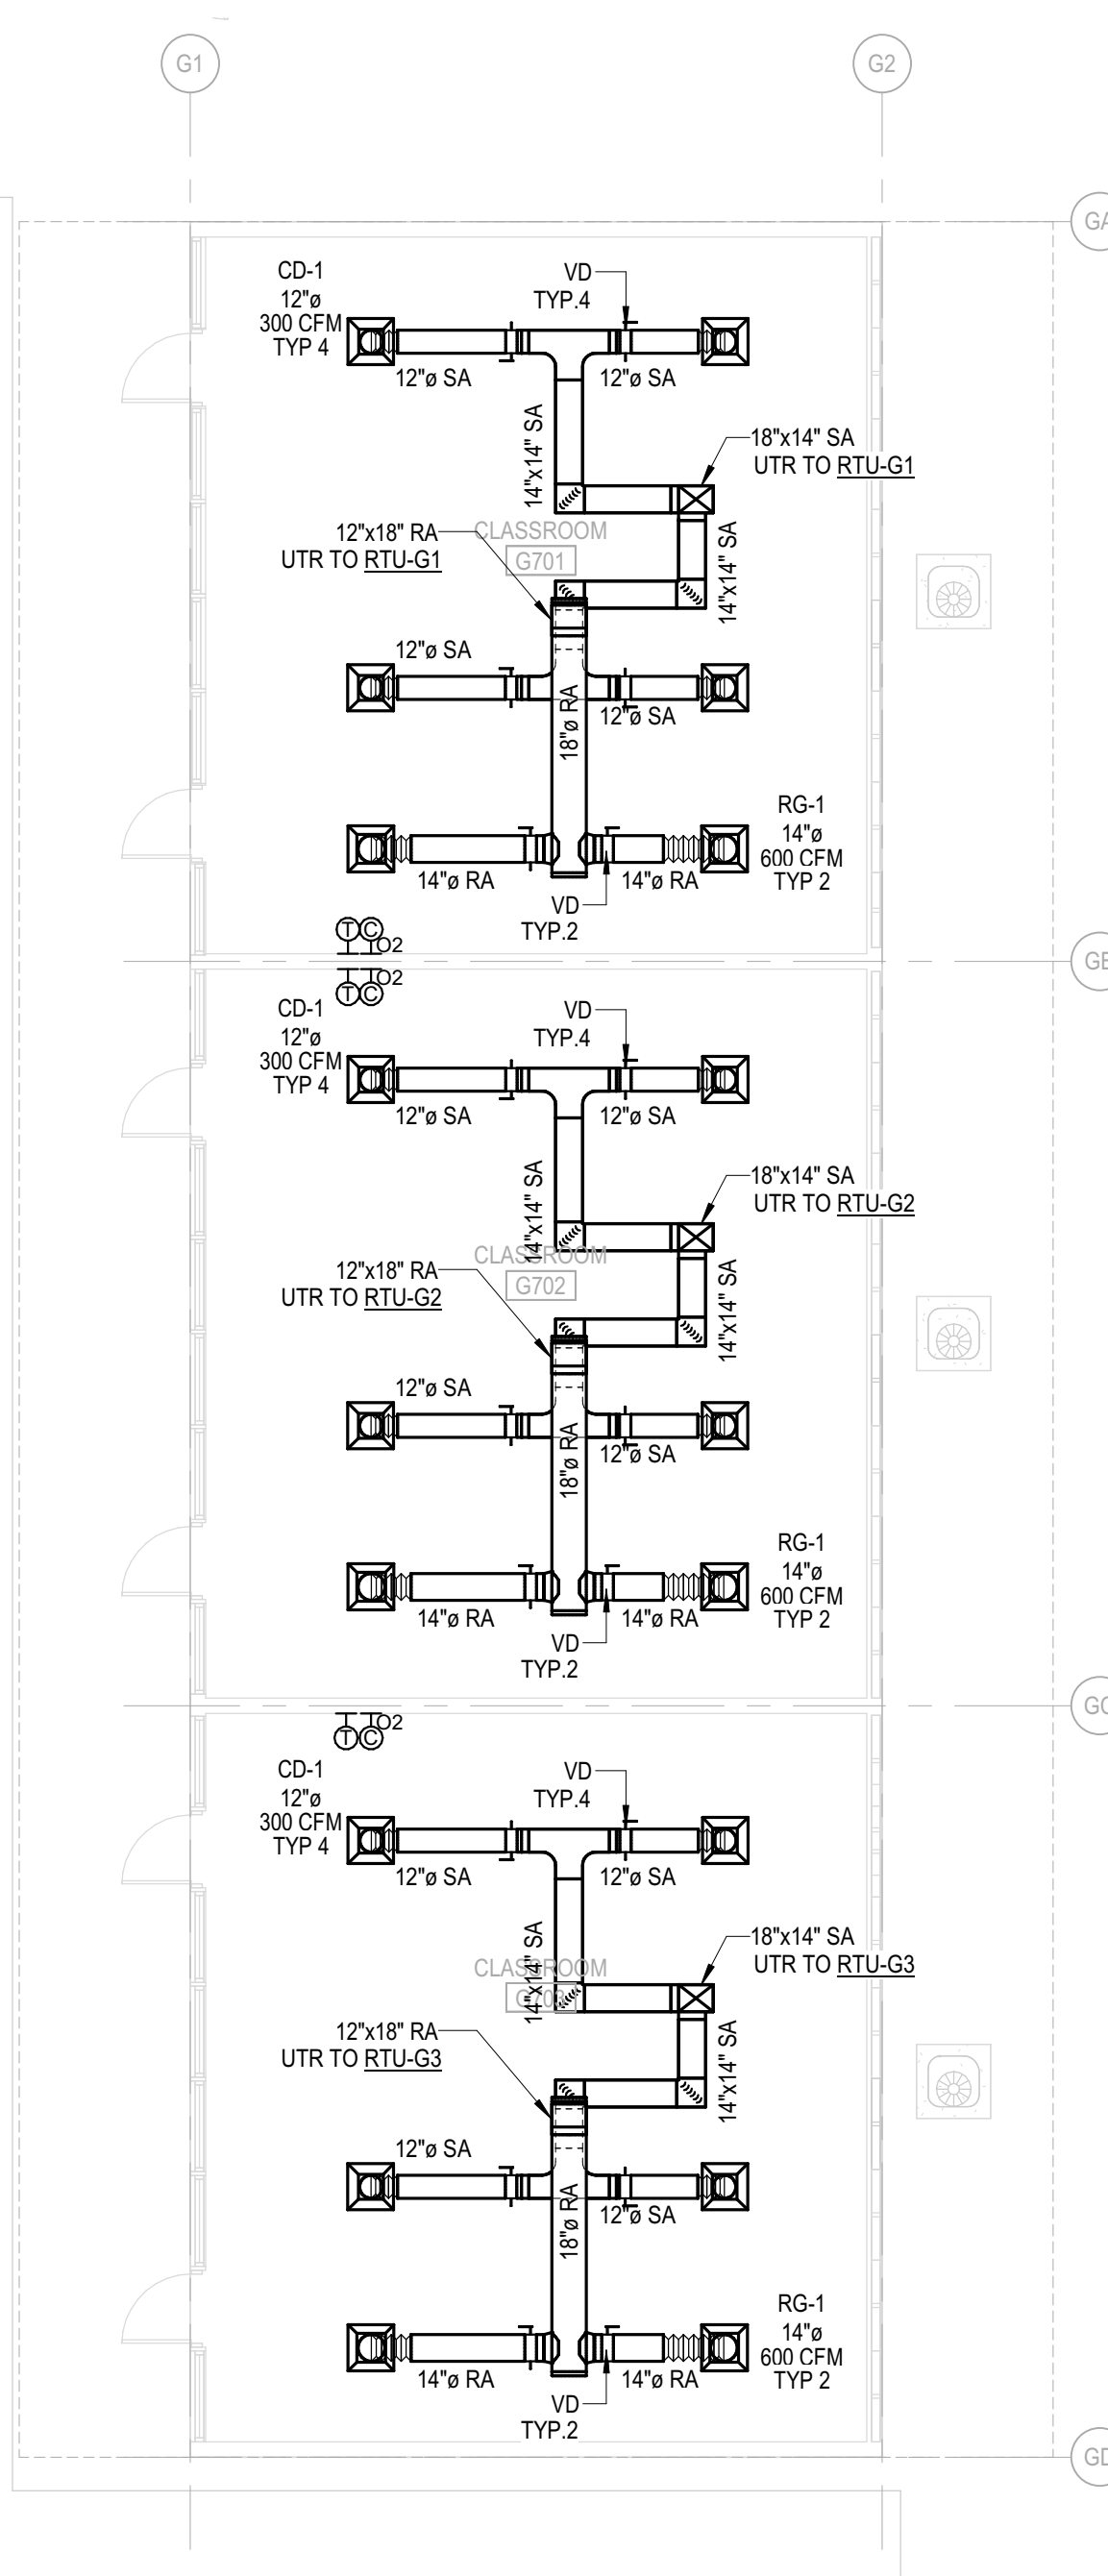


**BUILDING G**

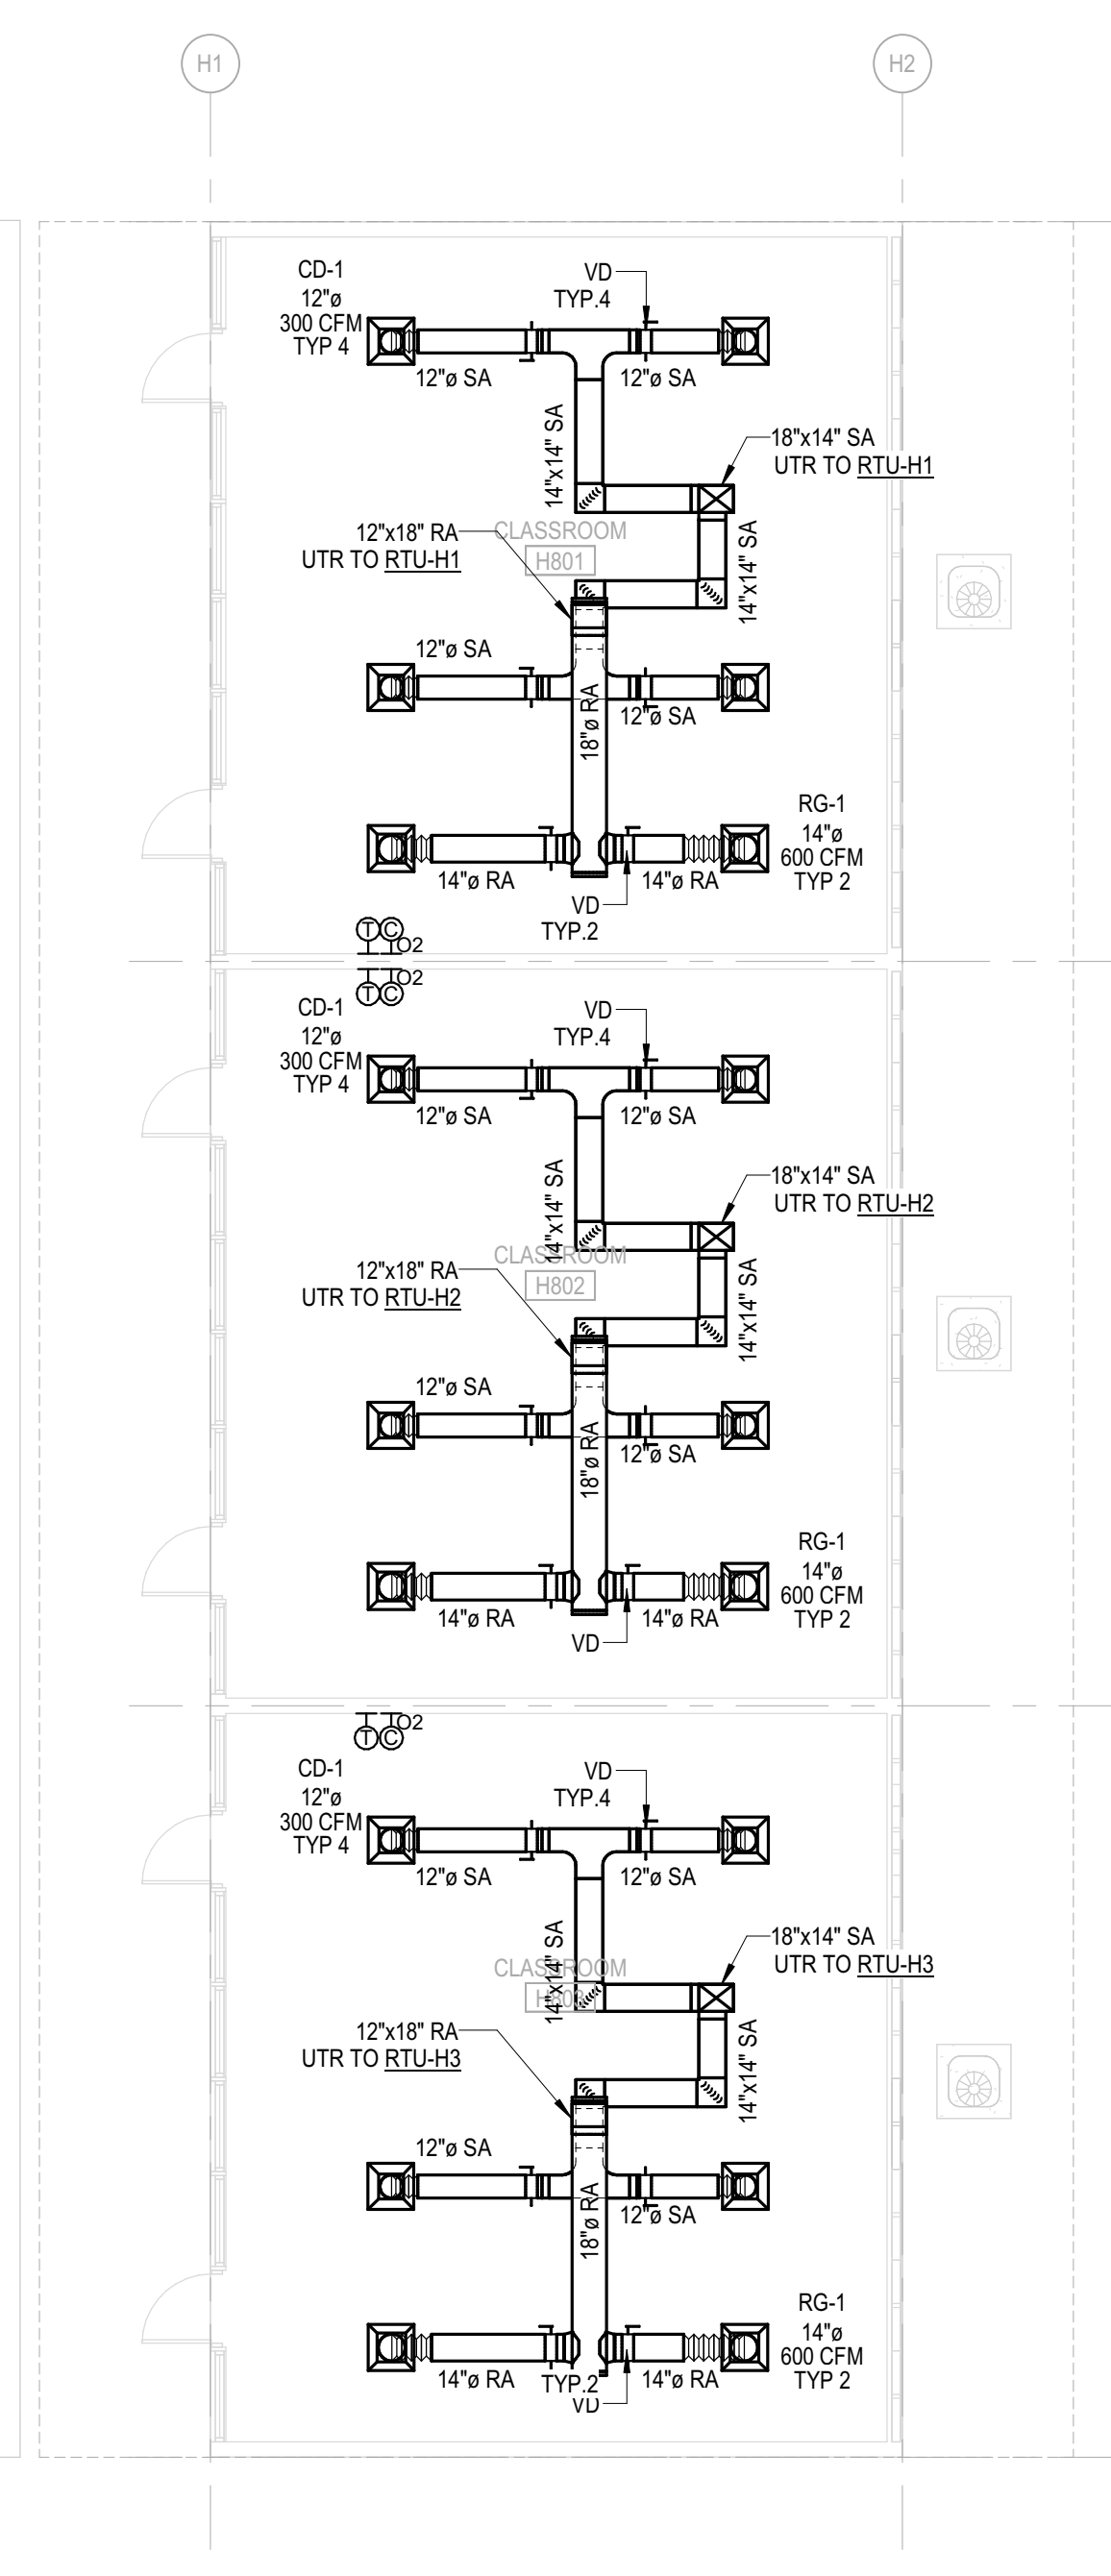

**BUILDING H**

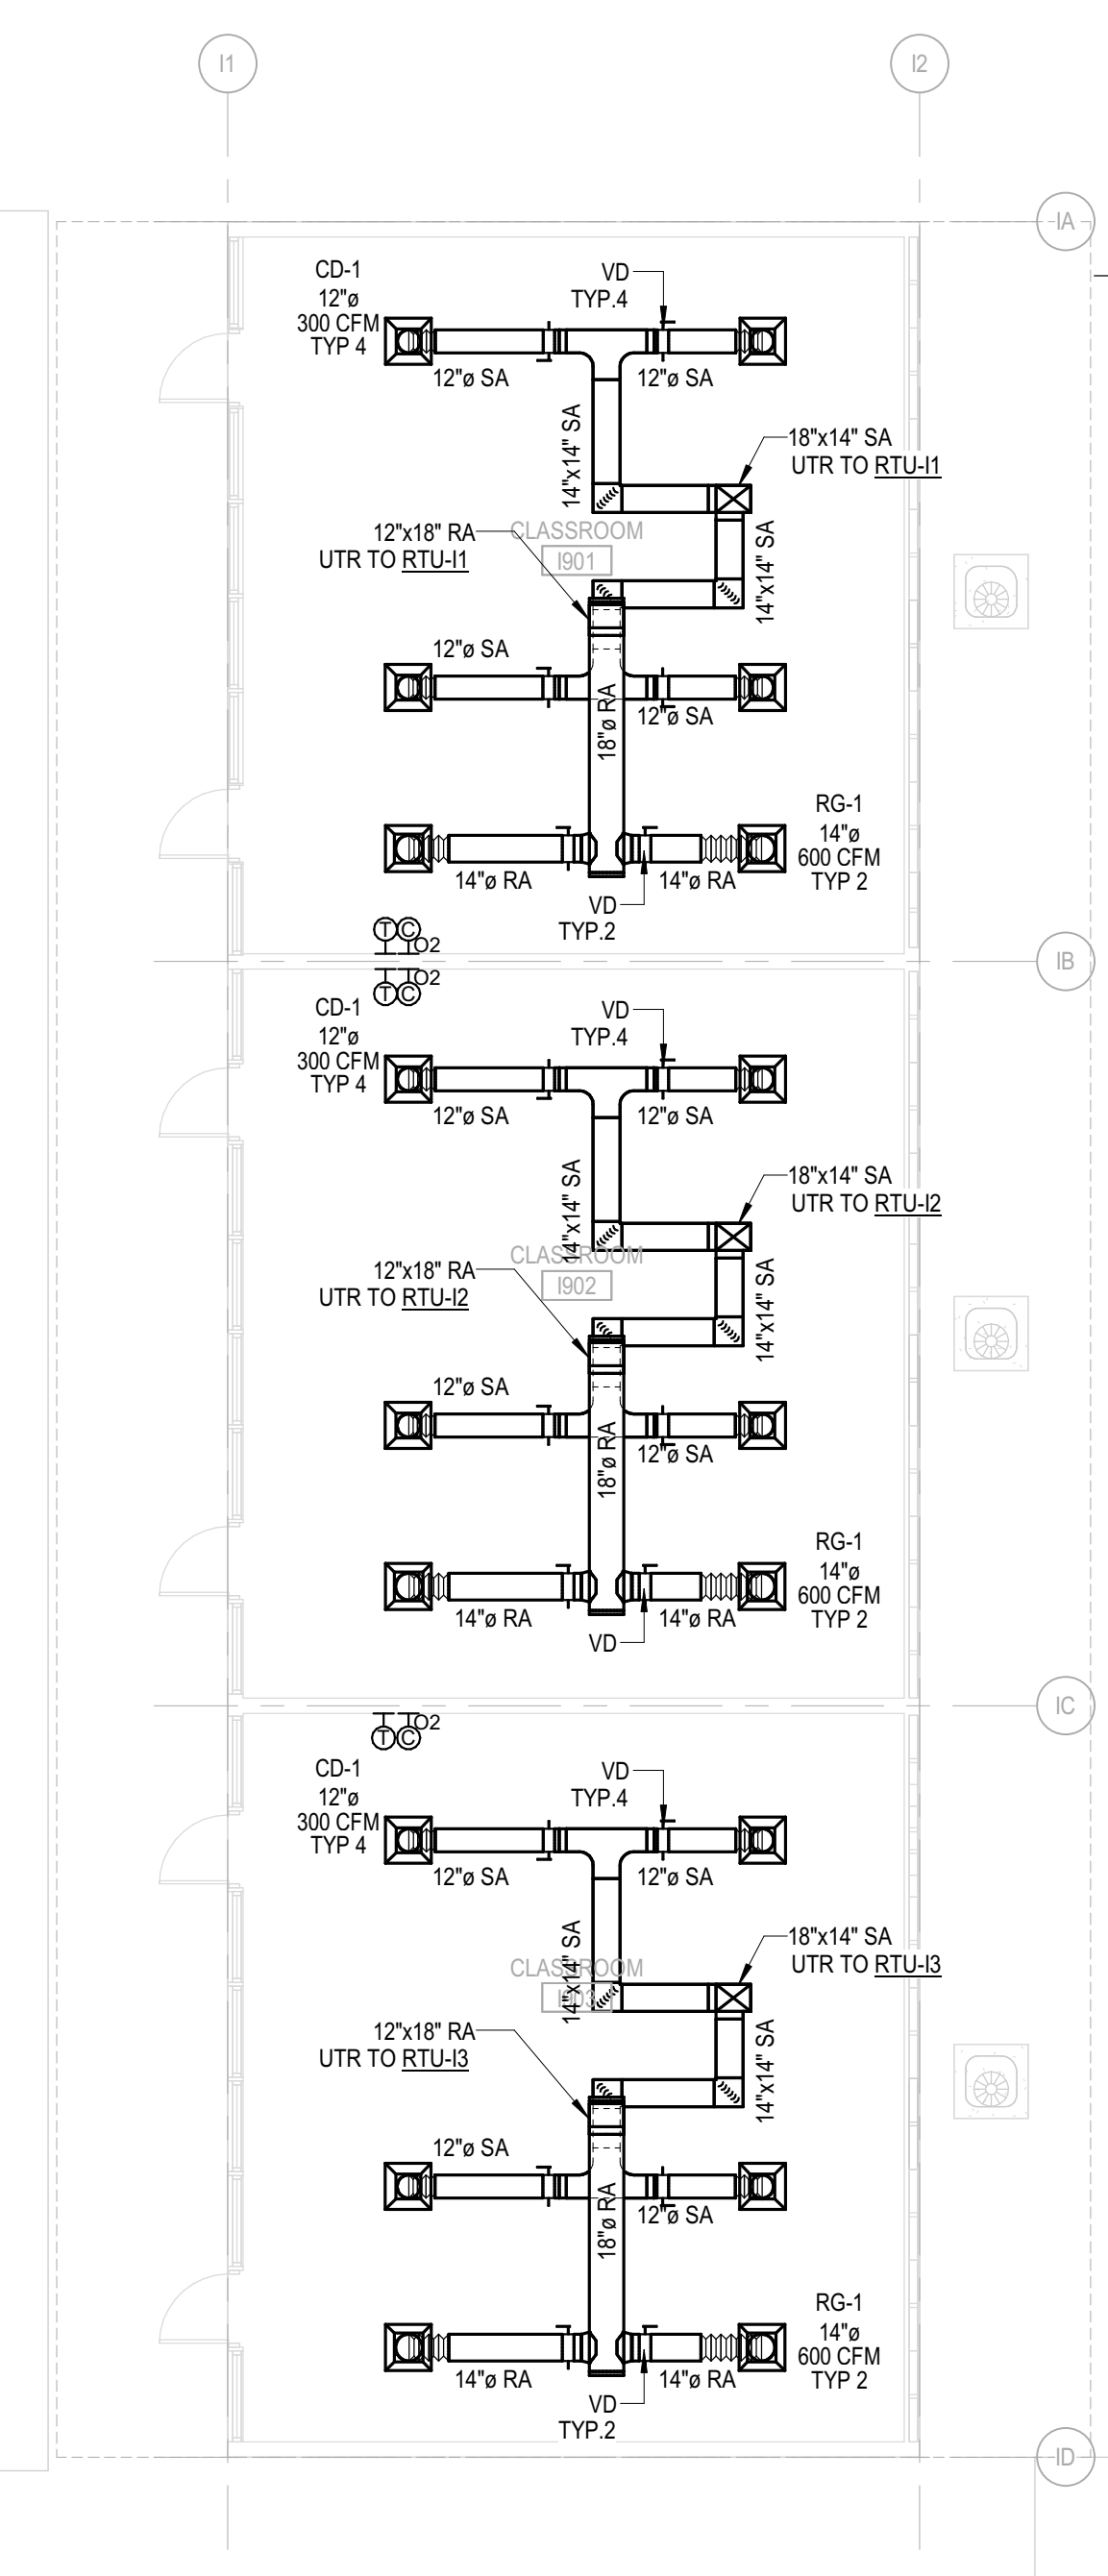


**BUILDING I**




**AREA B - MECHANICAL FLOOR PLAN**

SCALE: 1/8" = 1'-0"

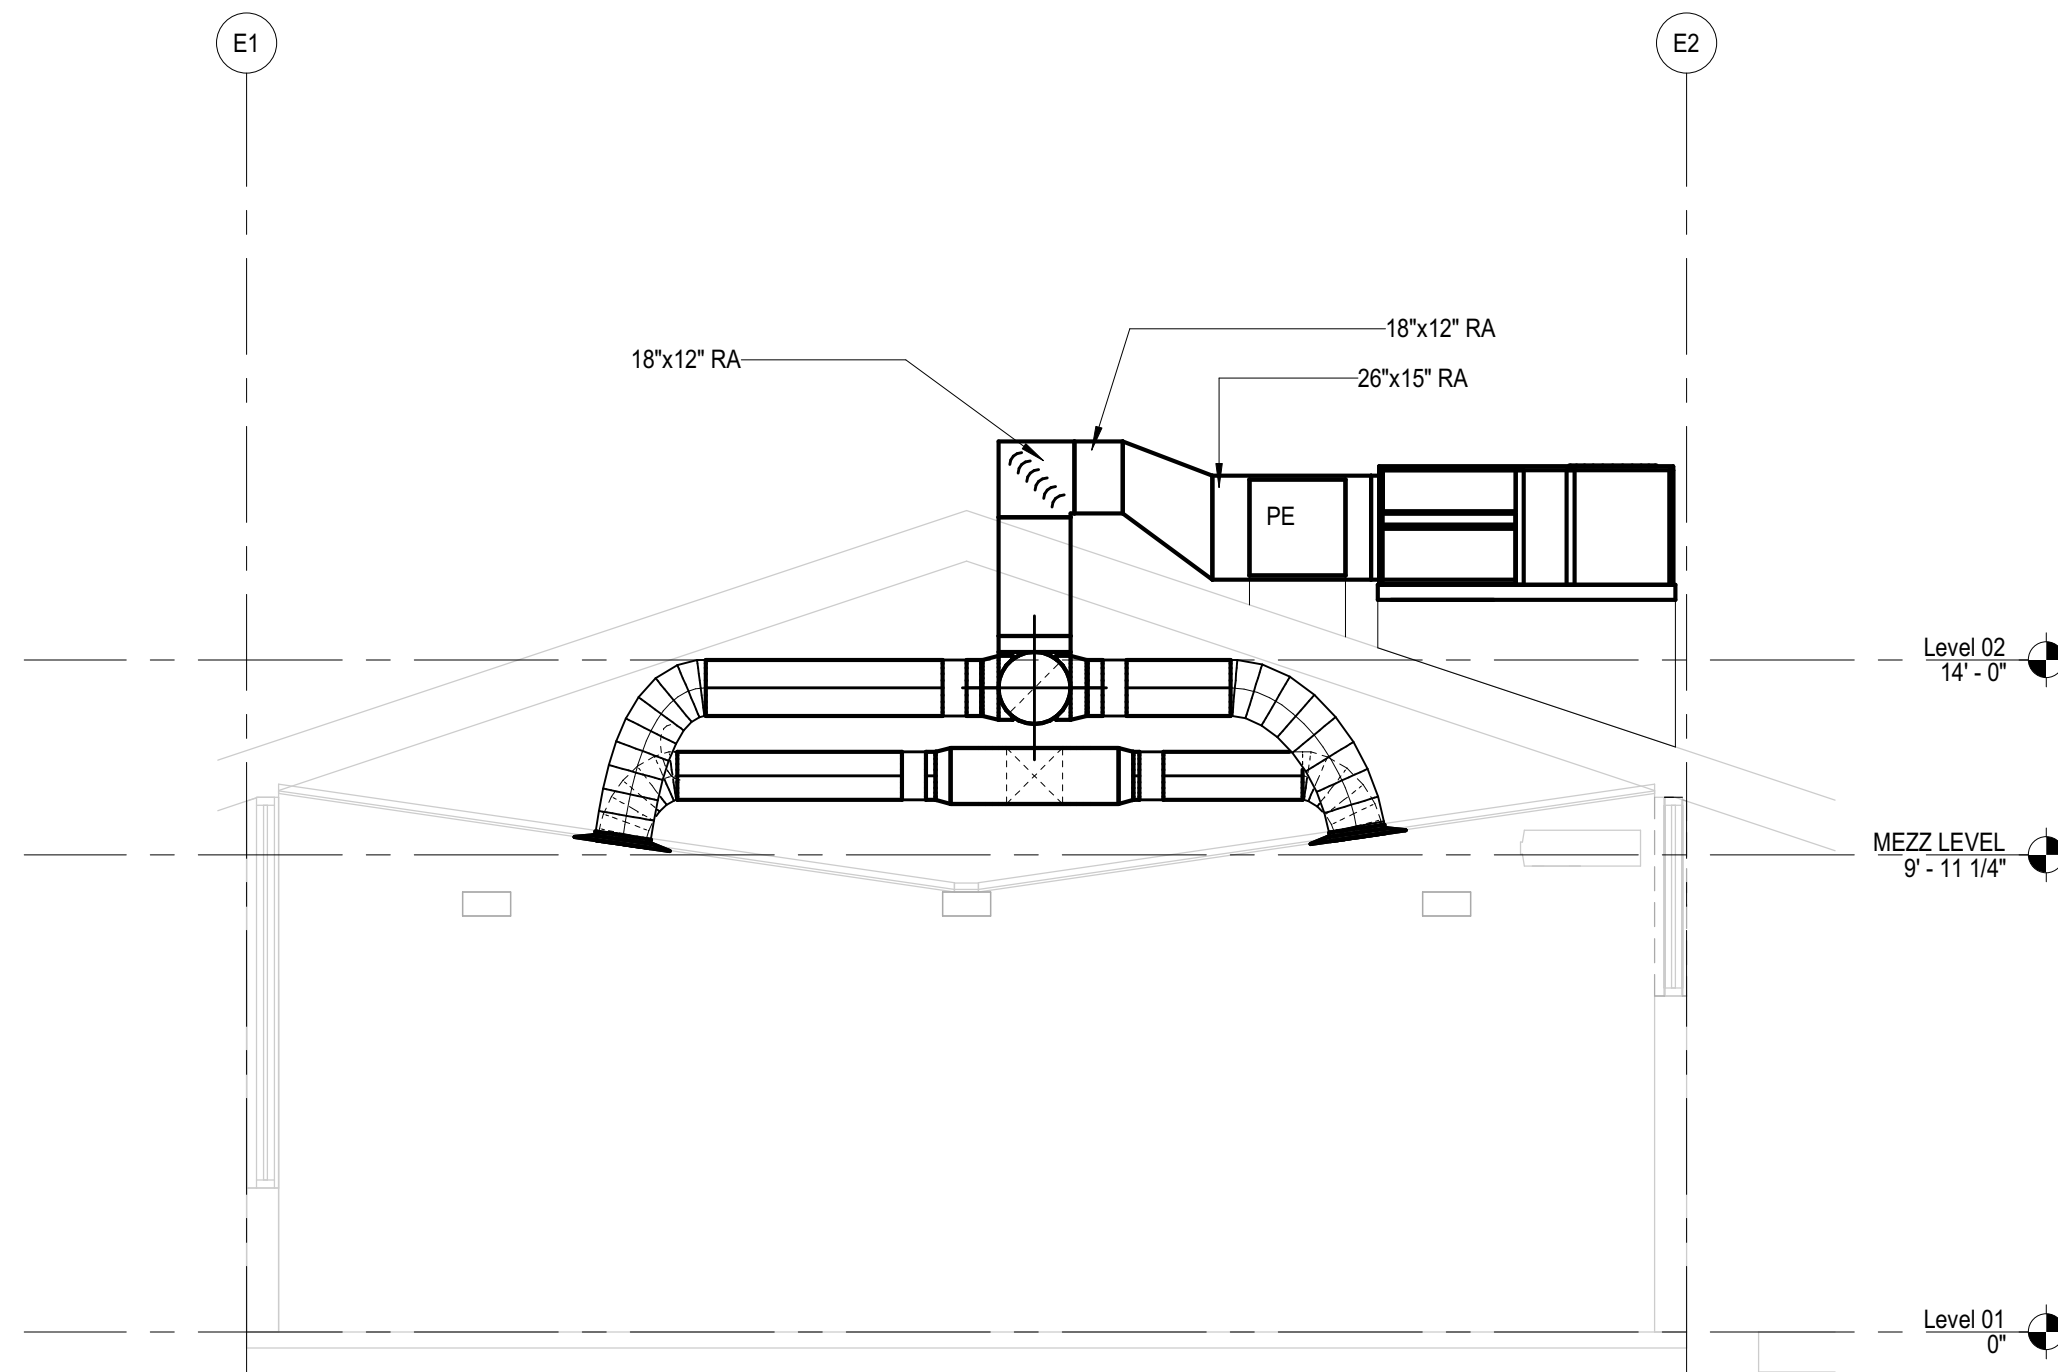

**2 BUILDING E - SECTION 1**  
M1.1B / SCALE: 1/4" = 1'-0"

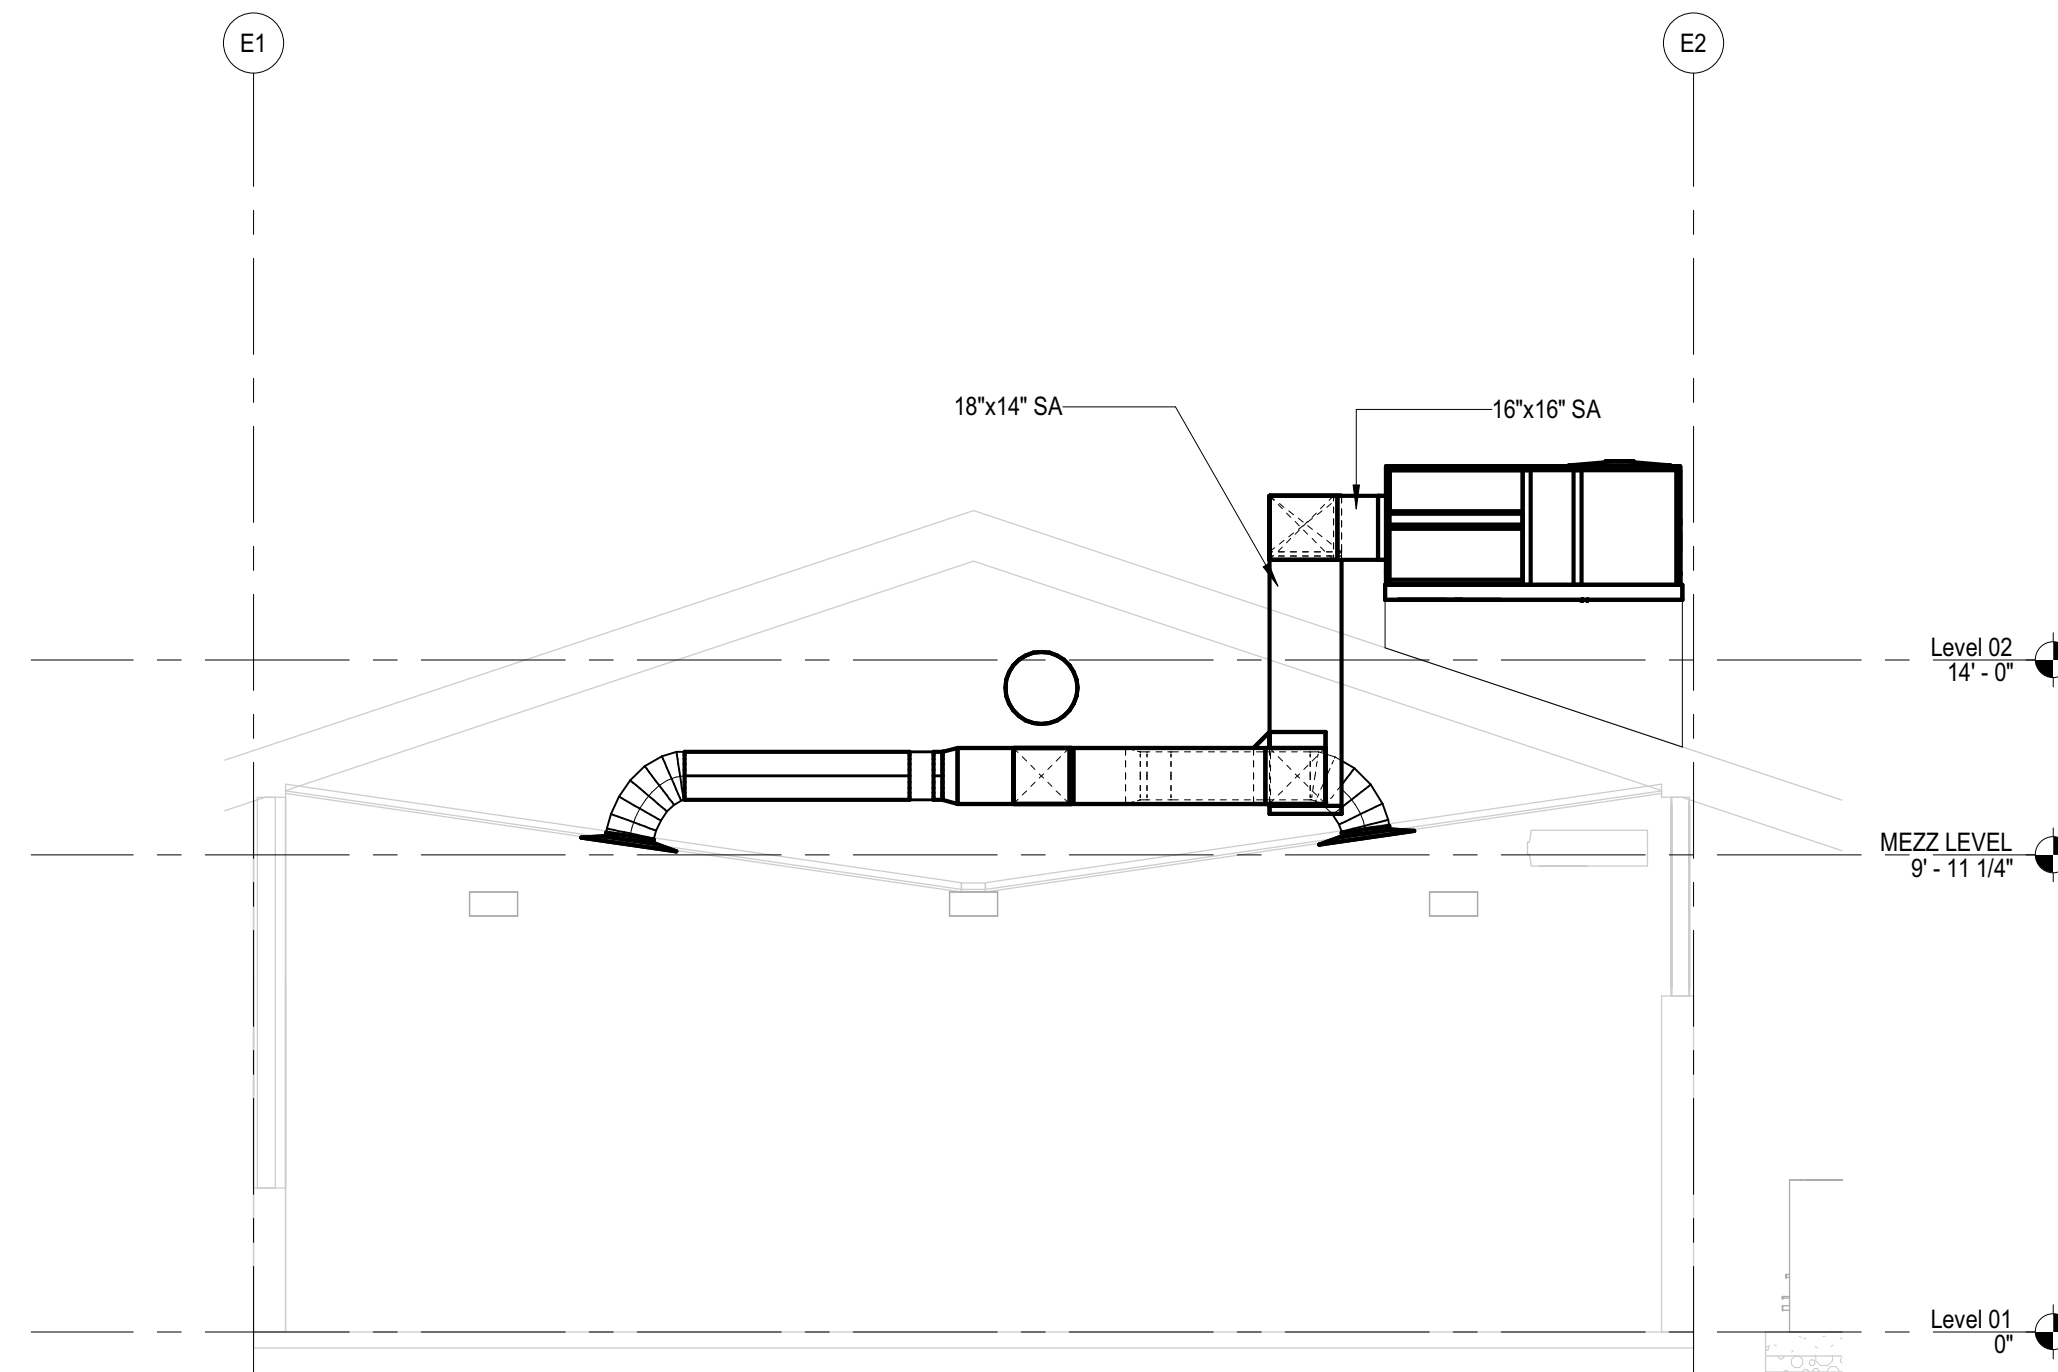


**3 BUILDING E - SECTION 2**  
M1.1B / SCALE: 1/4" = 1'-0"

**DEMO NOTES**

- A. DEMOLISH EXISTING OUTDOOR CONDENSING UNIT AND INDOOR FANCOIL UNITS, ALONG WITH RELATED CONCRETE PADS, PIPING, CONDUIT, FENCE, SUPPORTS AND OTHER APPURTENANCES. REFER TO ARCH PLANS OR SPECS FOR FILLING HOLES AND MATCHING WALL, TYP.

**GENERAL NOTES**

1. SCOPE OF WORK IS CLASSROOMS & MPR ONLY.  
2. DIFFUSERS AND GRILLES TO MATCH (E) CEILING TILES. REFER TO RCP.



**Workman Elementary School**  
COVINA VALLEY USD

1041 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00

AREA B -  
MECHANICAL  
FLOOR PLAN

**M1.1B**





1

2

3

4

5

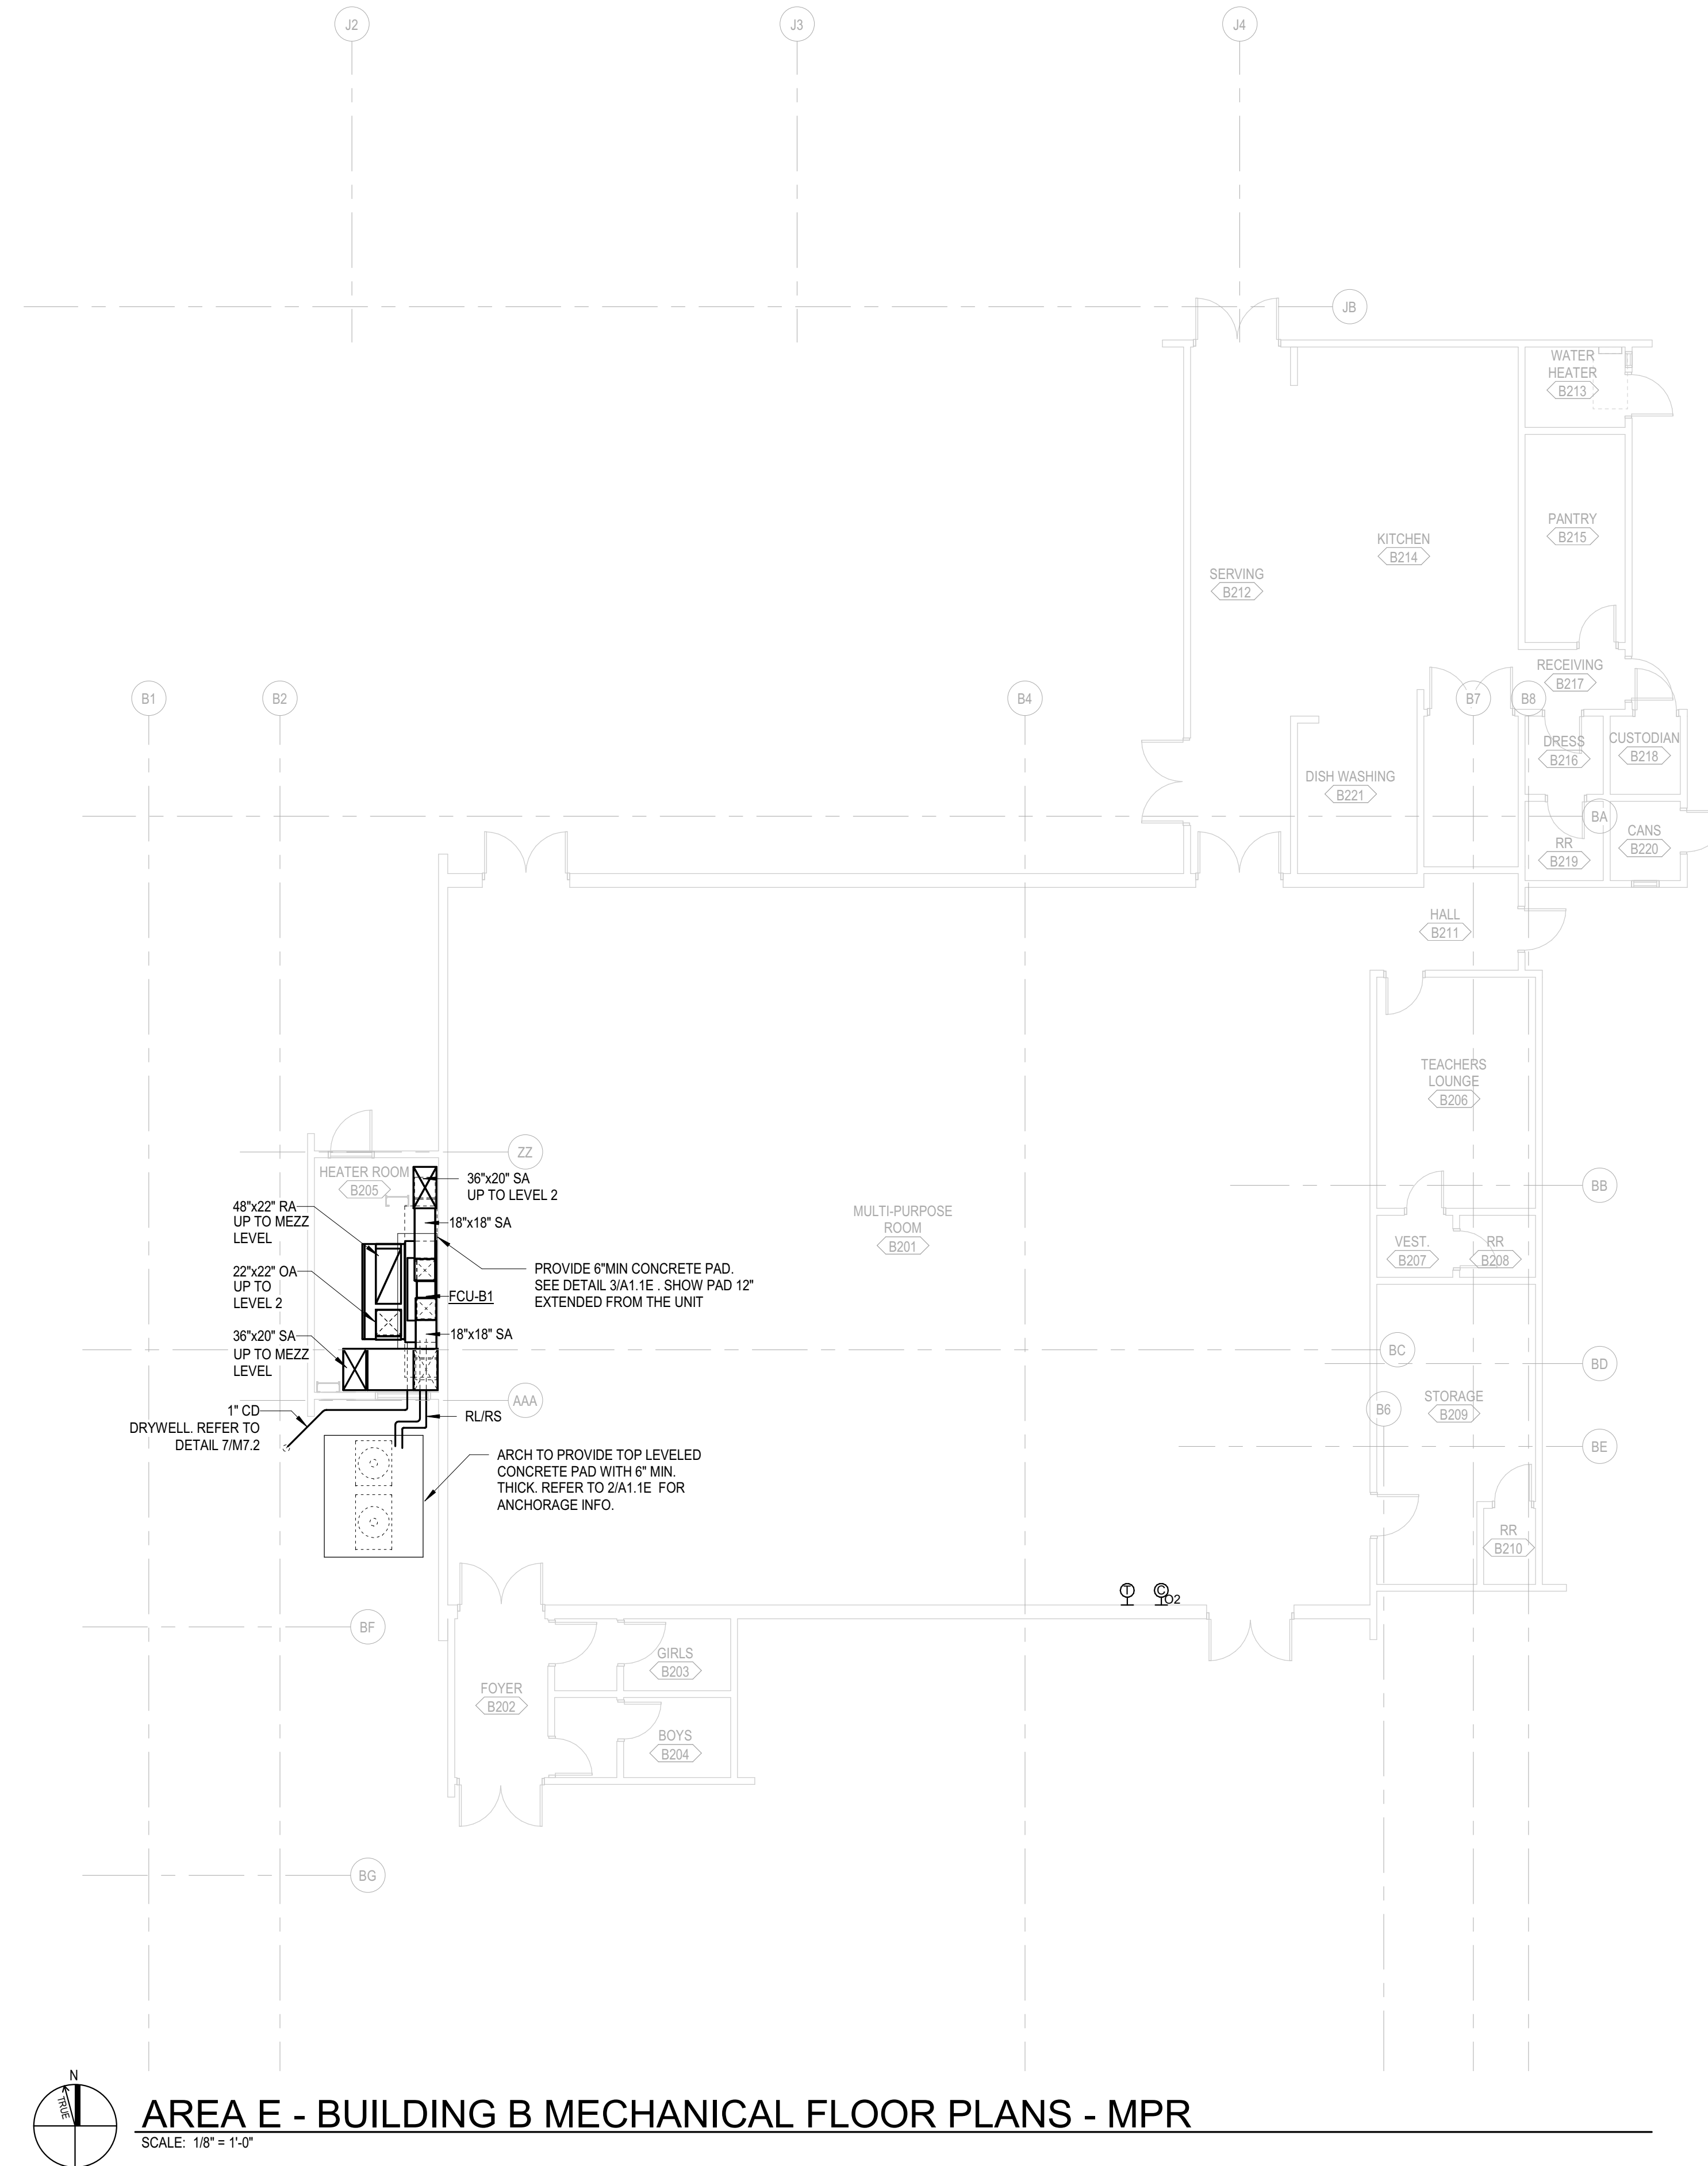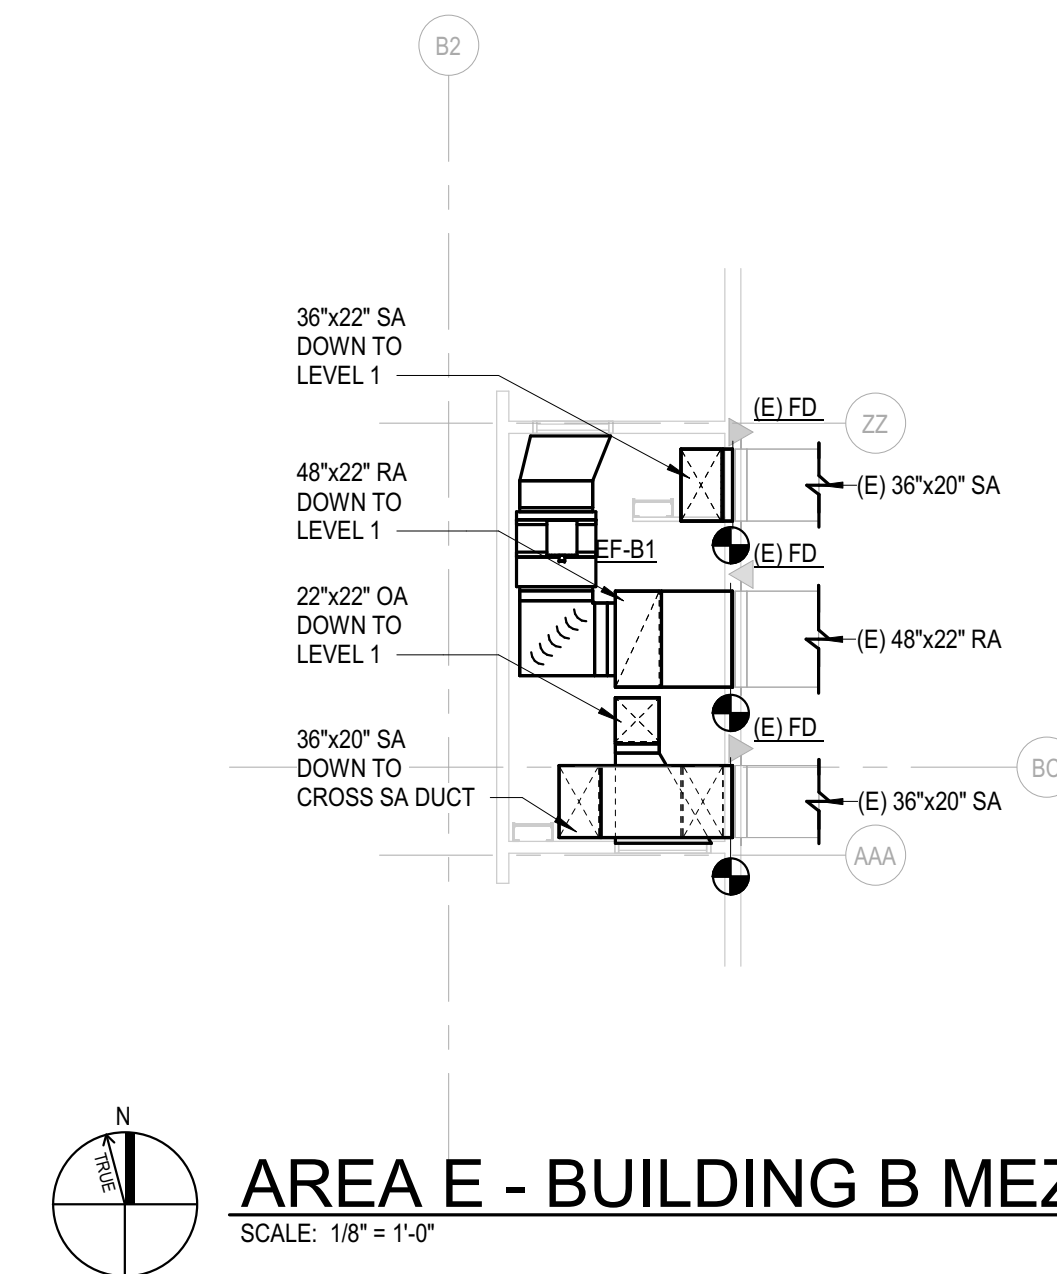

## DEMO NOTES

A DEMO (E) EQUIPMENT AND SA & RA DUCTWORK IN THE SCOPE AREA UP TO POC, ALONG WITH ALL THE SUPPORTS, PIPING, OTHER COMPONENTS.



Workman Elementary School  
COVINA VALLEY USD

1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00

AREA E -  
MECHANICAL  
FLOOR PLAN

M1.1E

Autodesk Docs/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD Workman ES MEP\_2022.rvt  
10/21/2022 5:03:01 PM


1

2


3

4


5

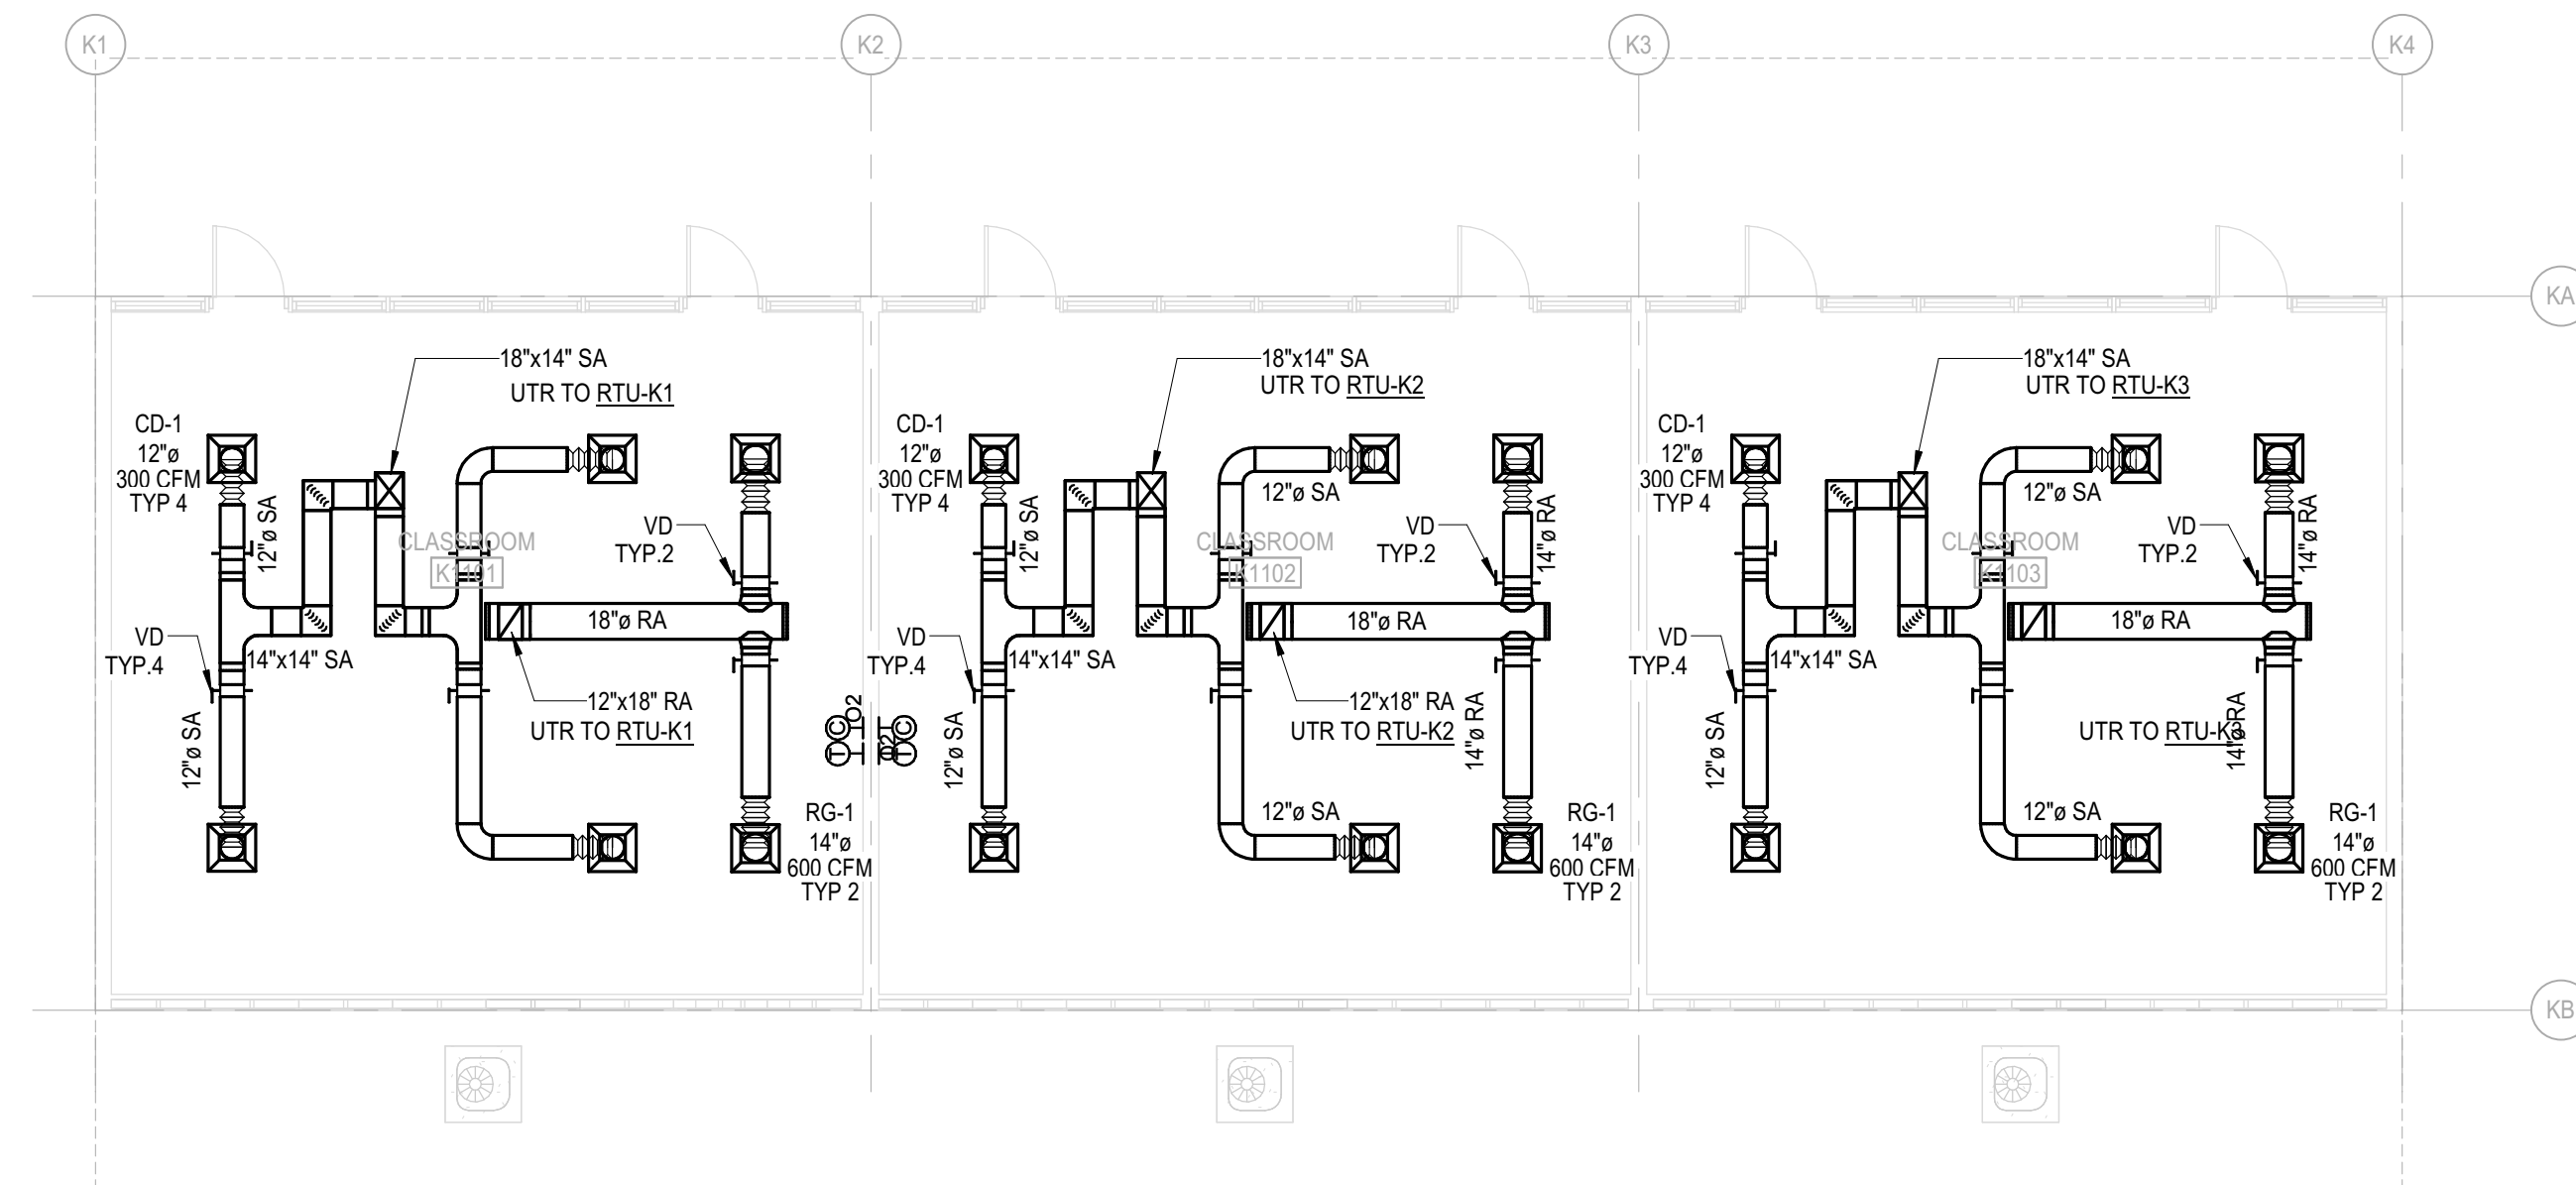

**BUILDING K**

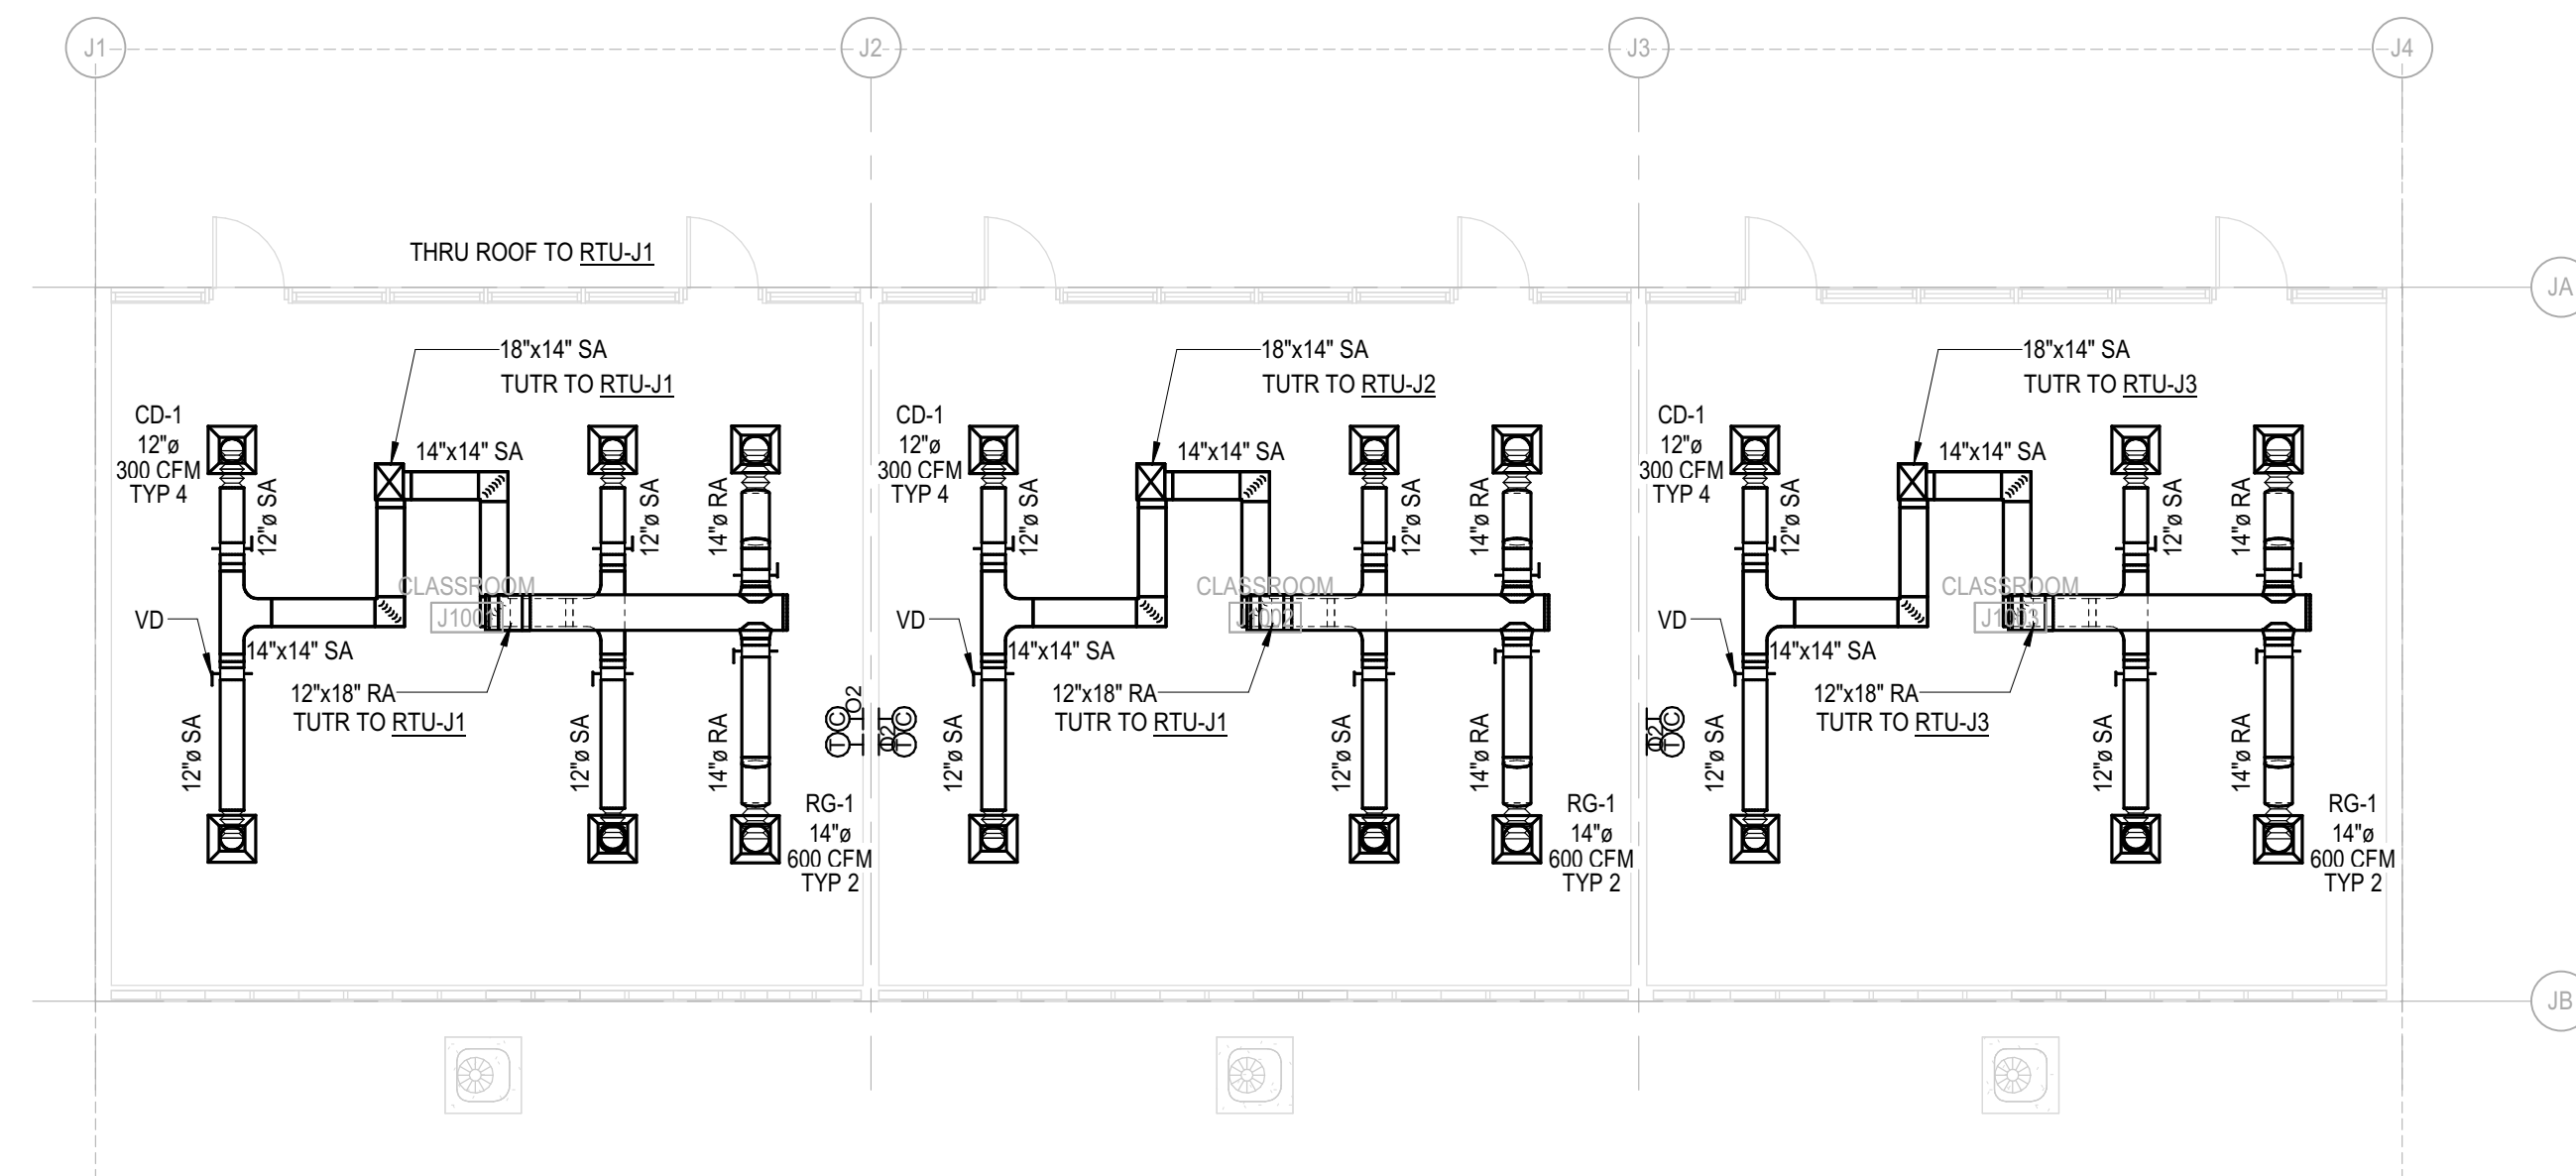

**BUILDING J**



**AREA F - MECHANICAL FLOOR PLAN**


SCALE: 1/8" = 1'-0"

**GENERAL NOTES**

- SCOPE OF WORK IS CLASSROOMS & MPR ONLY.
- PROVIDE LINER TO DUCTWORK FOR 10 FEET FROM RTU.

**DEMO NOTES**

- A. DEMOLISH EXISTING OUTDOOR CONDENSING UNIT AND INDOOR FANCOIL UNITS, ALONG WITH RELATED CONCRETE PADS, PIPING, CONDUIT, FENCE, SUPPORTS, AND OTHER APPURTENANCES. REFER TO ARCH PLANS OR SPECS FOR FILLING HOLES AND MATCHING WALL TYP.

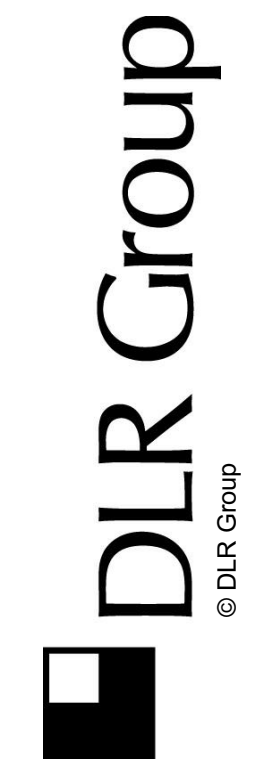

**Workman Elementary School**  
COVINA VALLEY USD  
1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00

AREA F -  
MECHANICAL  
FLOOR PLAN

**M1.1F**



Autodesk Docs/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD\_Workman ES MEP\_2022.rvt  
11/02/2022 5:03:02 PM


1

2

3


4

5



## AREA A - MECHANICAL ROOF PLAN

SCALE: 1/8" = 1'-0"

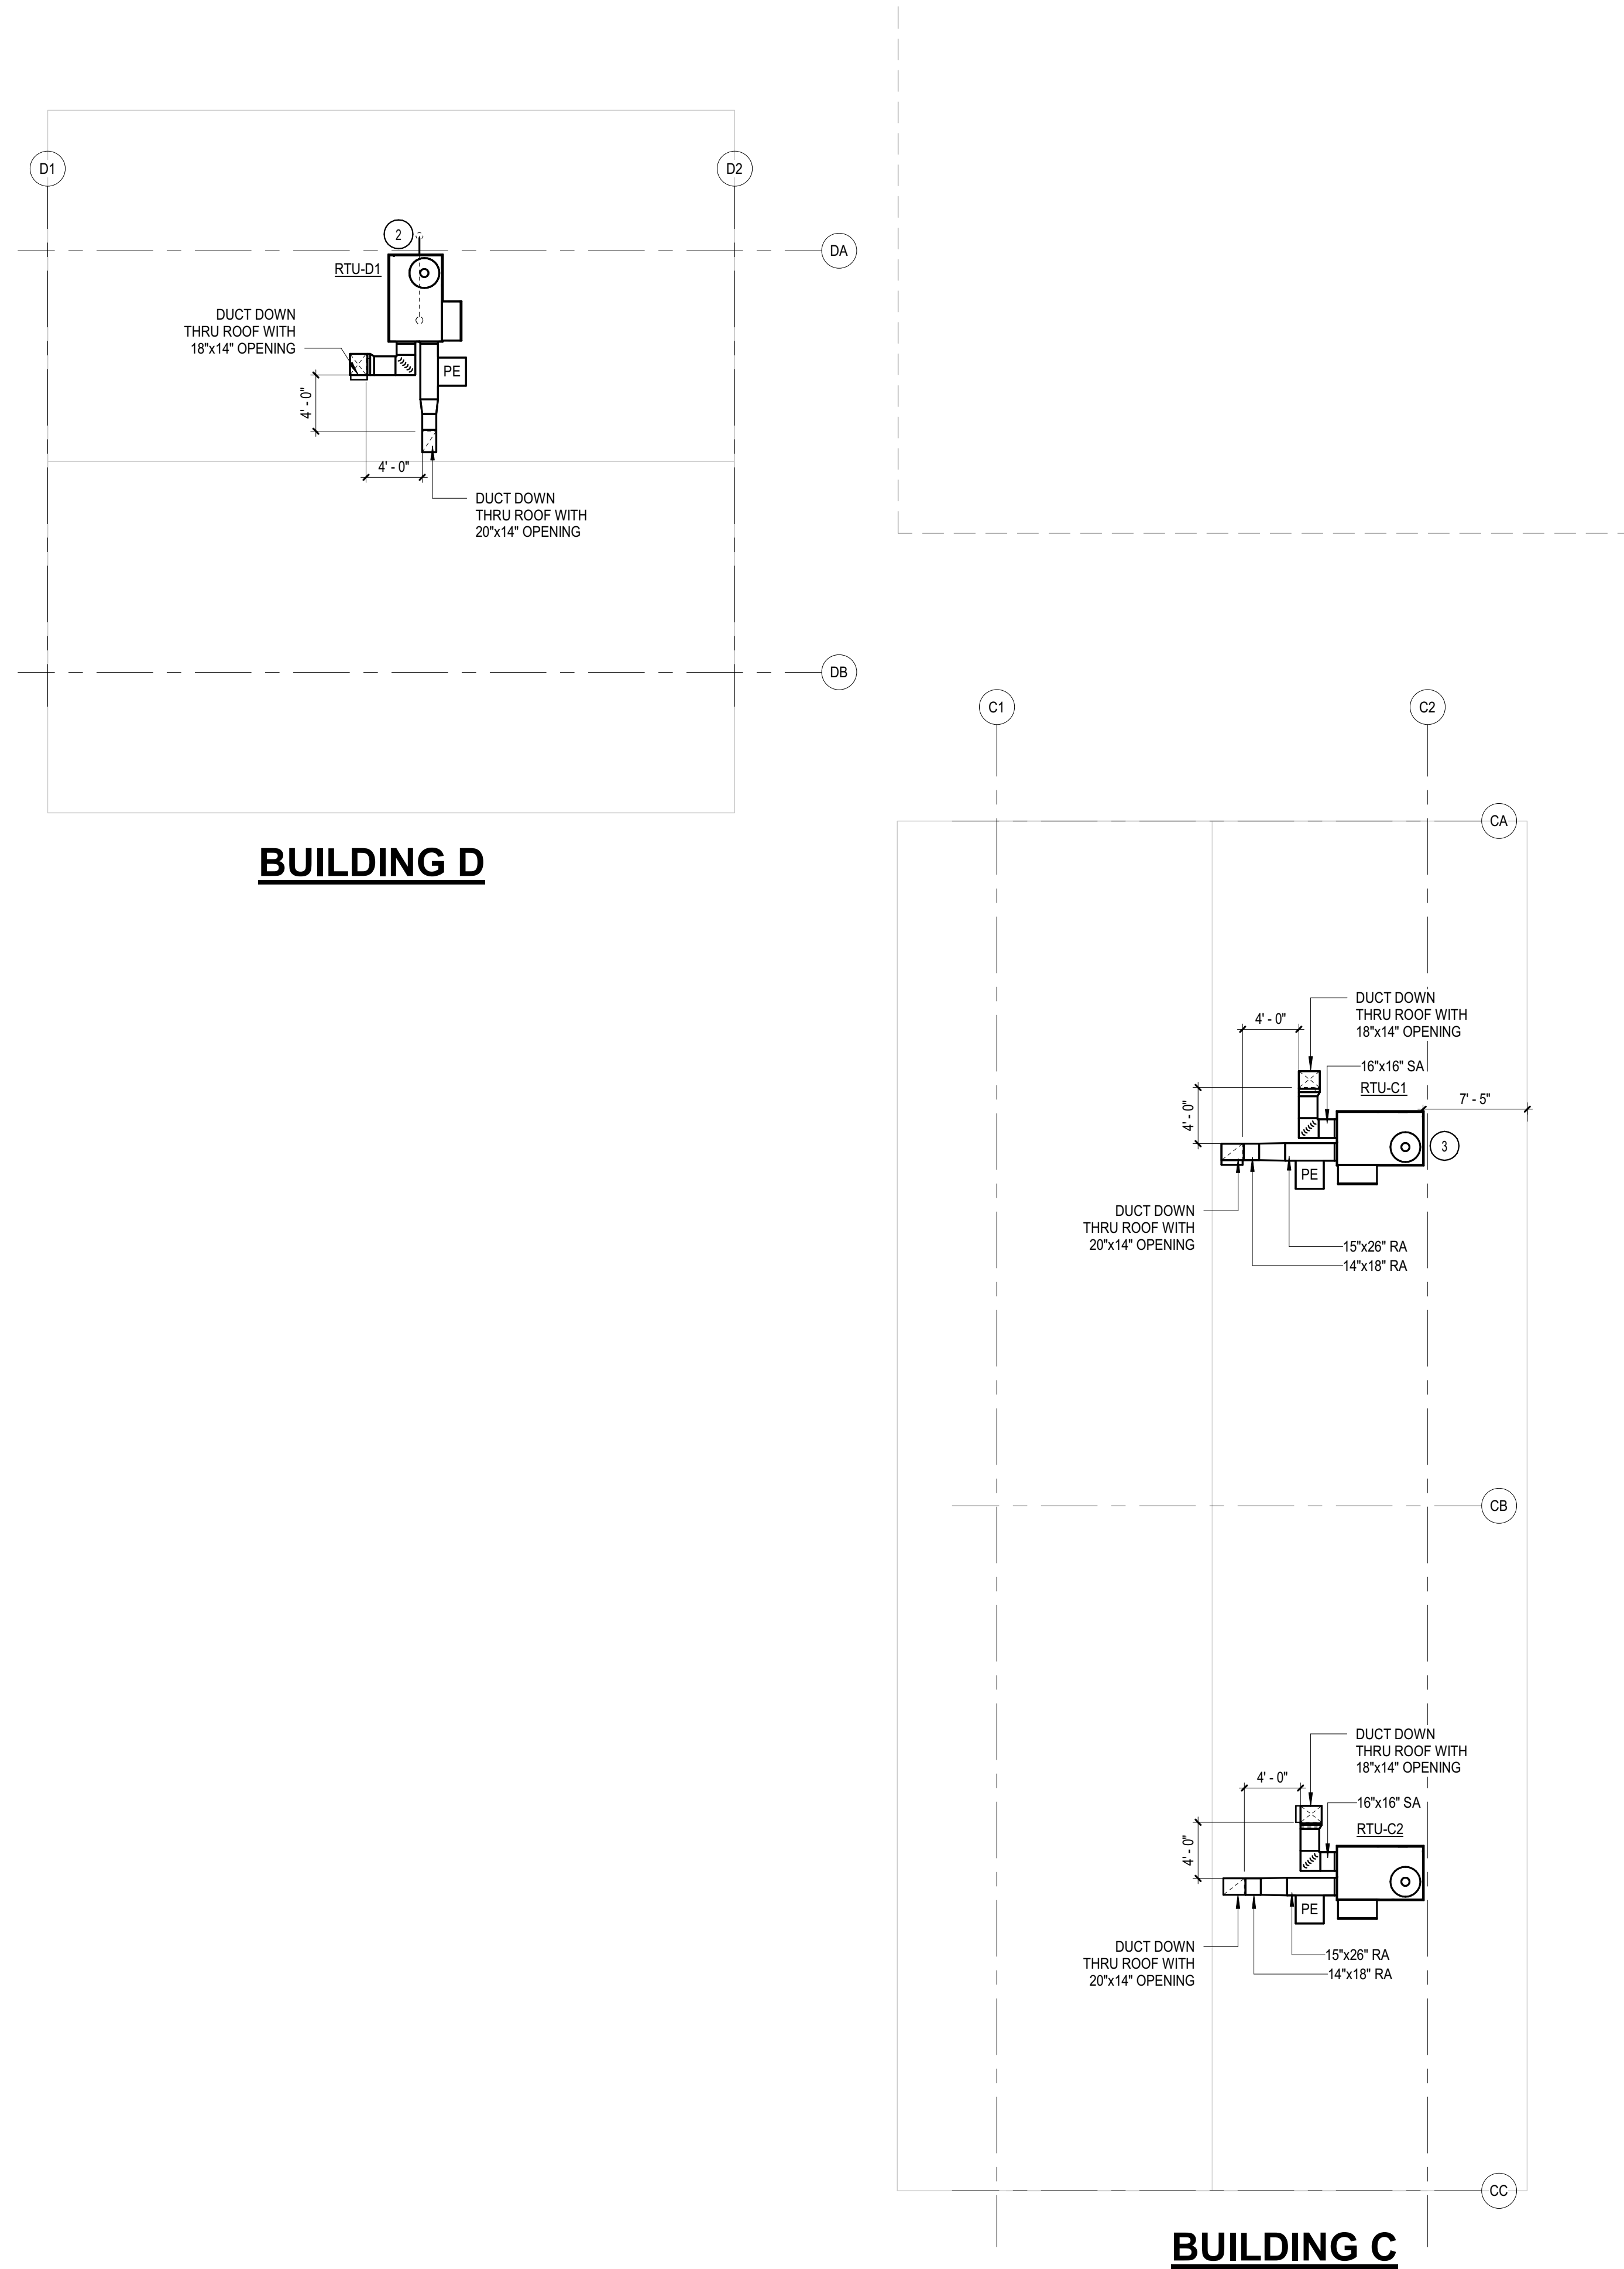

### GENERAL NOTES

- SCOPE OF WORK IS CLASSROOMS & MPR ONLY.
- PROVIDE LINER TO DUCTWORK FOR 10 FEET FROM RTU.

### KEY NOTES

- PROVIDE POWER EXHAUST ON RETURN DUCT WITH LEG LENGTH TO FIT THE ROOF SLOPE. CONTRACTOR TO VERIFY ON SITE. TYP.
- RTU TO BE 10'-0" MIN. FROM ROOF EDGE. CONTRACTOR TO VERIFY ON SITE. TYP.
- RTU IS LESS THAN 10'-0" FROM ROOF EDGE. ARCH TO PROVIDE PROTECTION GUARDS. TYP.
- NEW OPENINGS FOR SUPPLY AND RETURN DUCTS SHOULD BE MADE BETWEEN THE ROOF JOISTS. DO NOT CUT THE JOIST



Workman Elementary School  
COVINA VALLEY USD

1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00


AREA A -  
MECHANICAL  
ROOF PLAN

M1.3A




Autodesk Docs/175-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD Workman ES MEP\_2022.rvt  
11/02/2022 5:03:02 PM

1  
2  
3  
4  
5

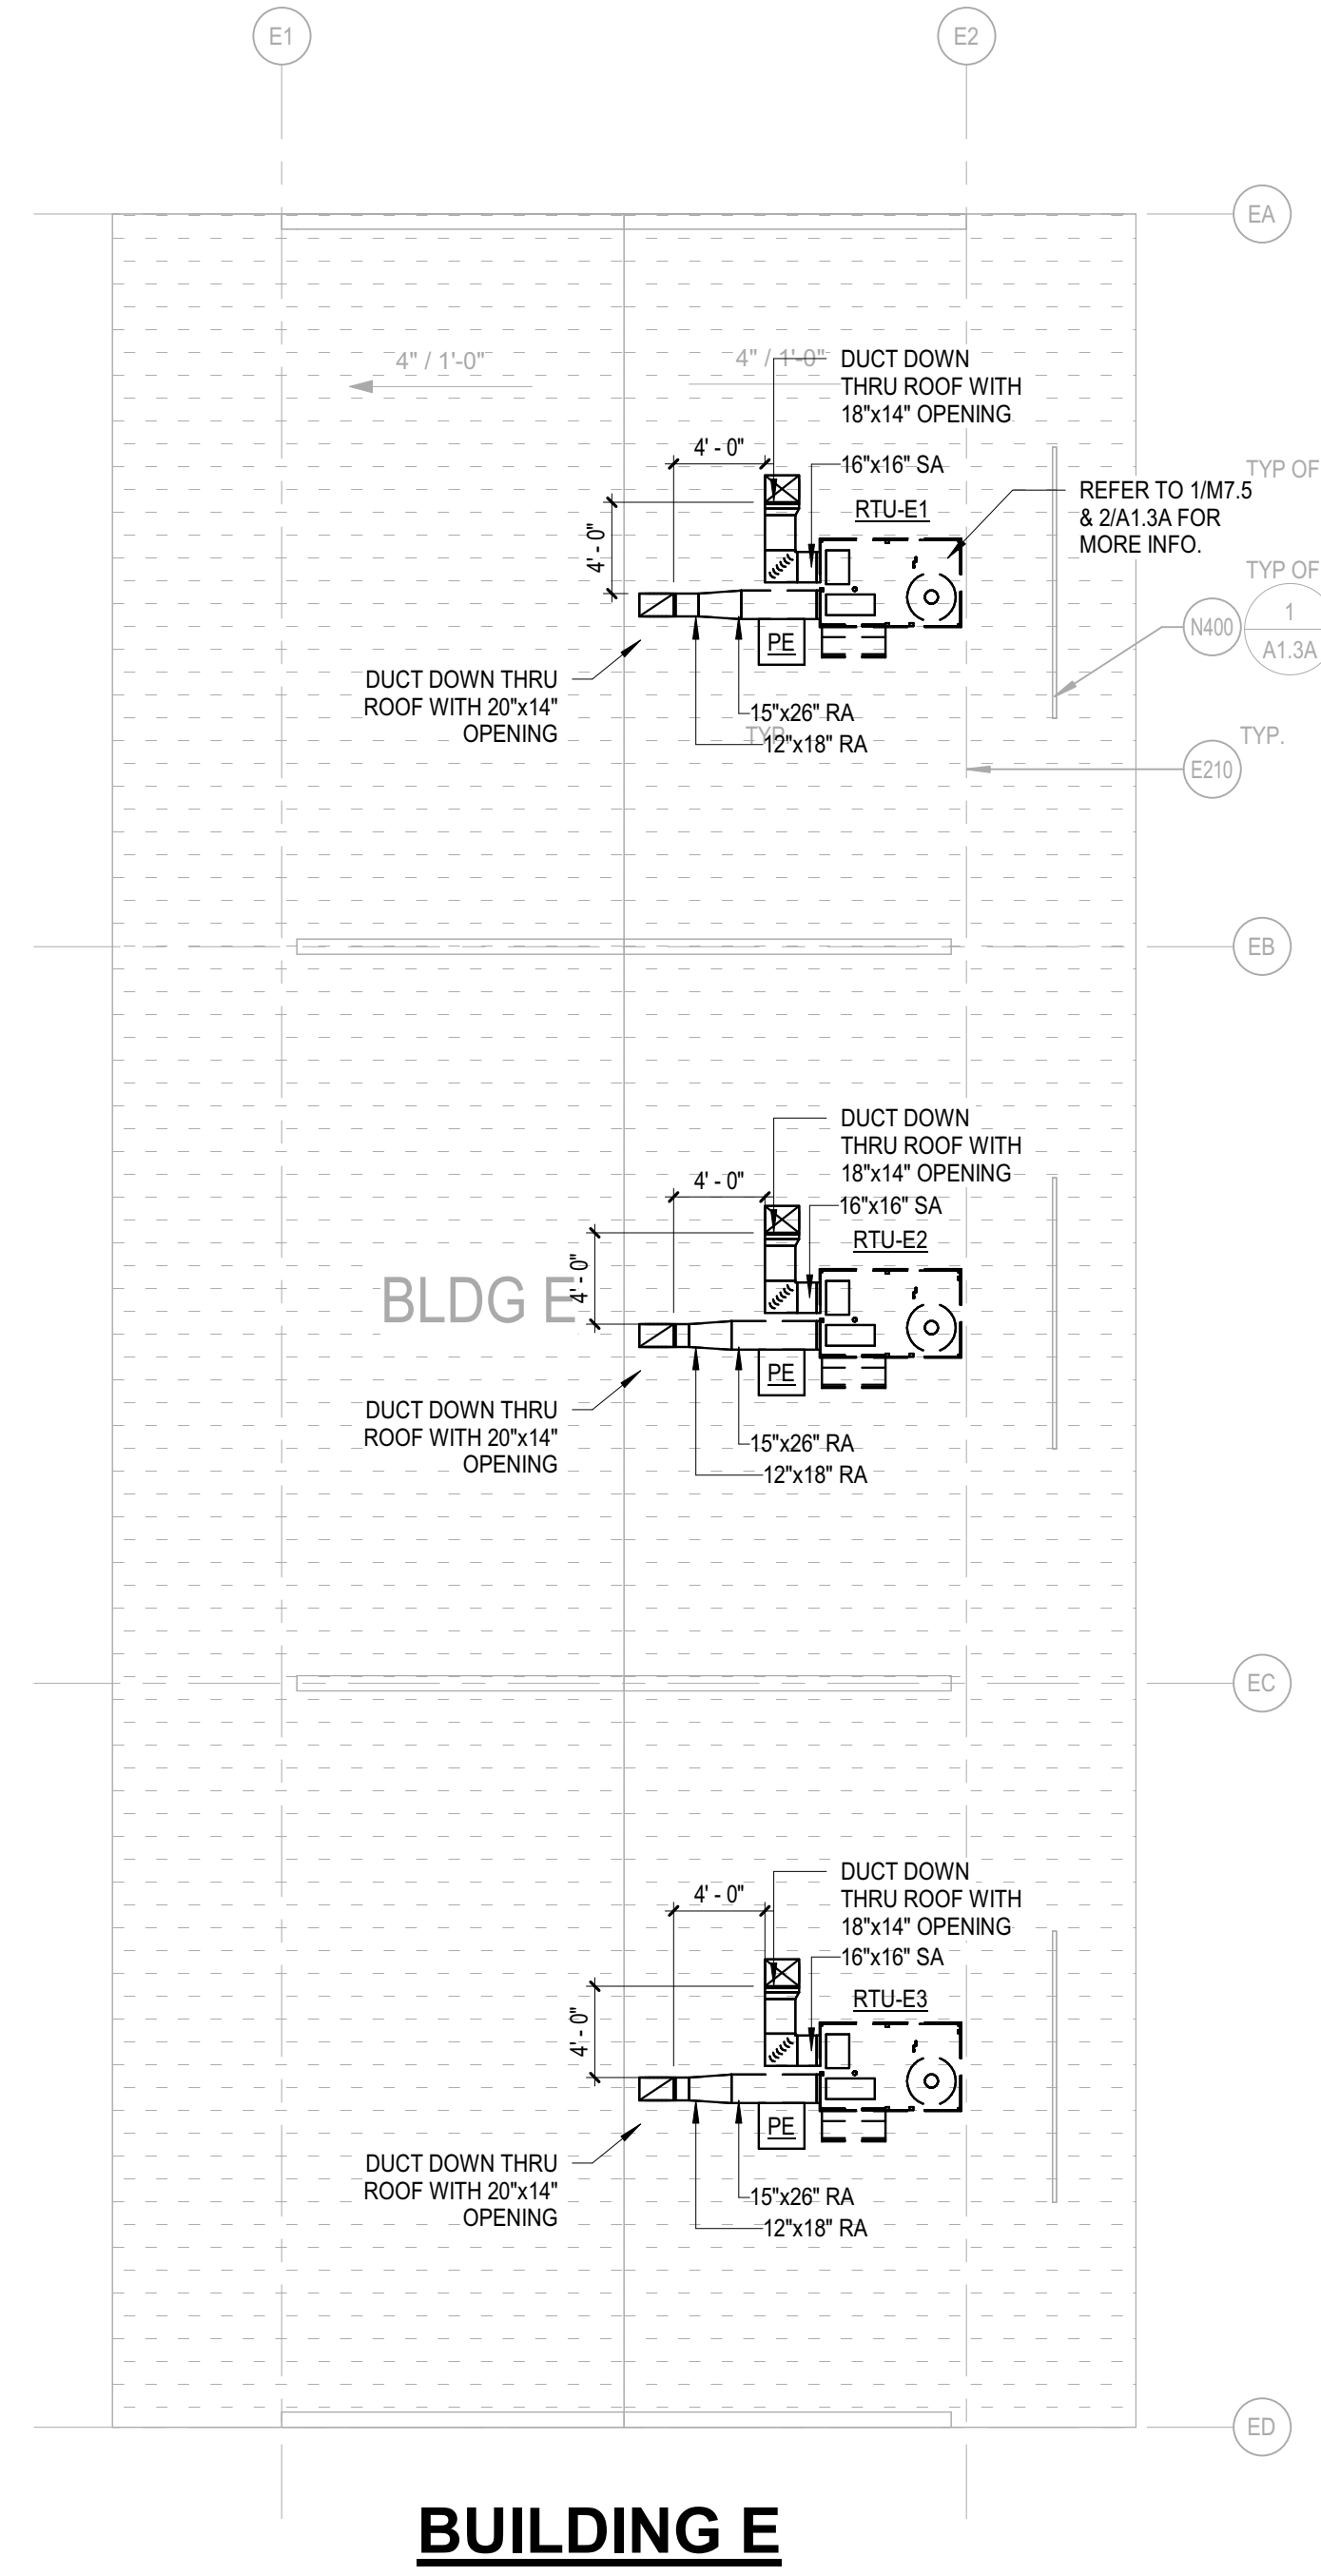


**BUILDING E**


**AREA B - MECHANICAL ROOF PLAN**  
SCALE: 1/8" = 1'-0"

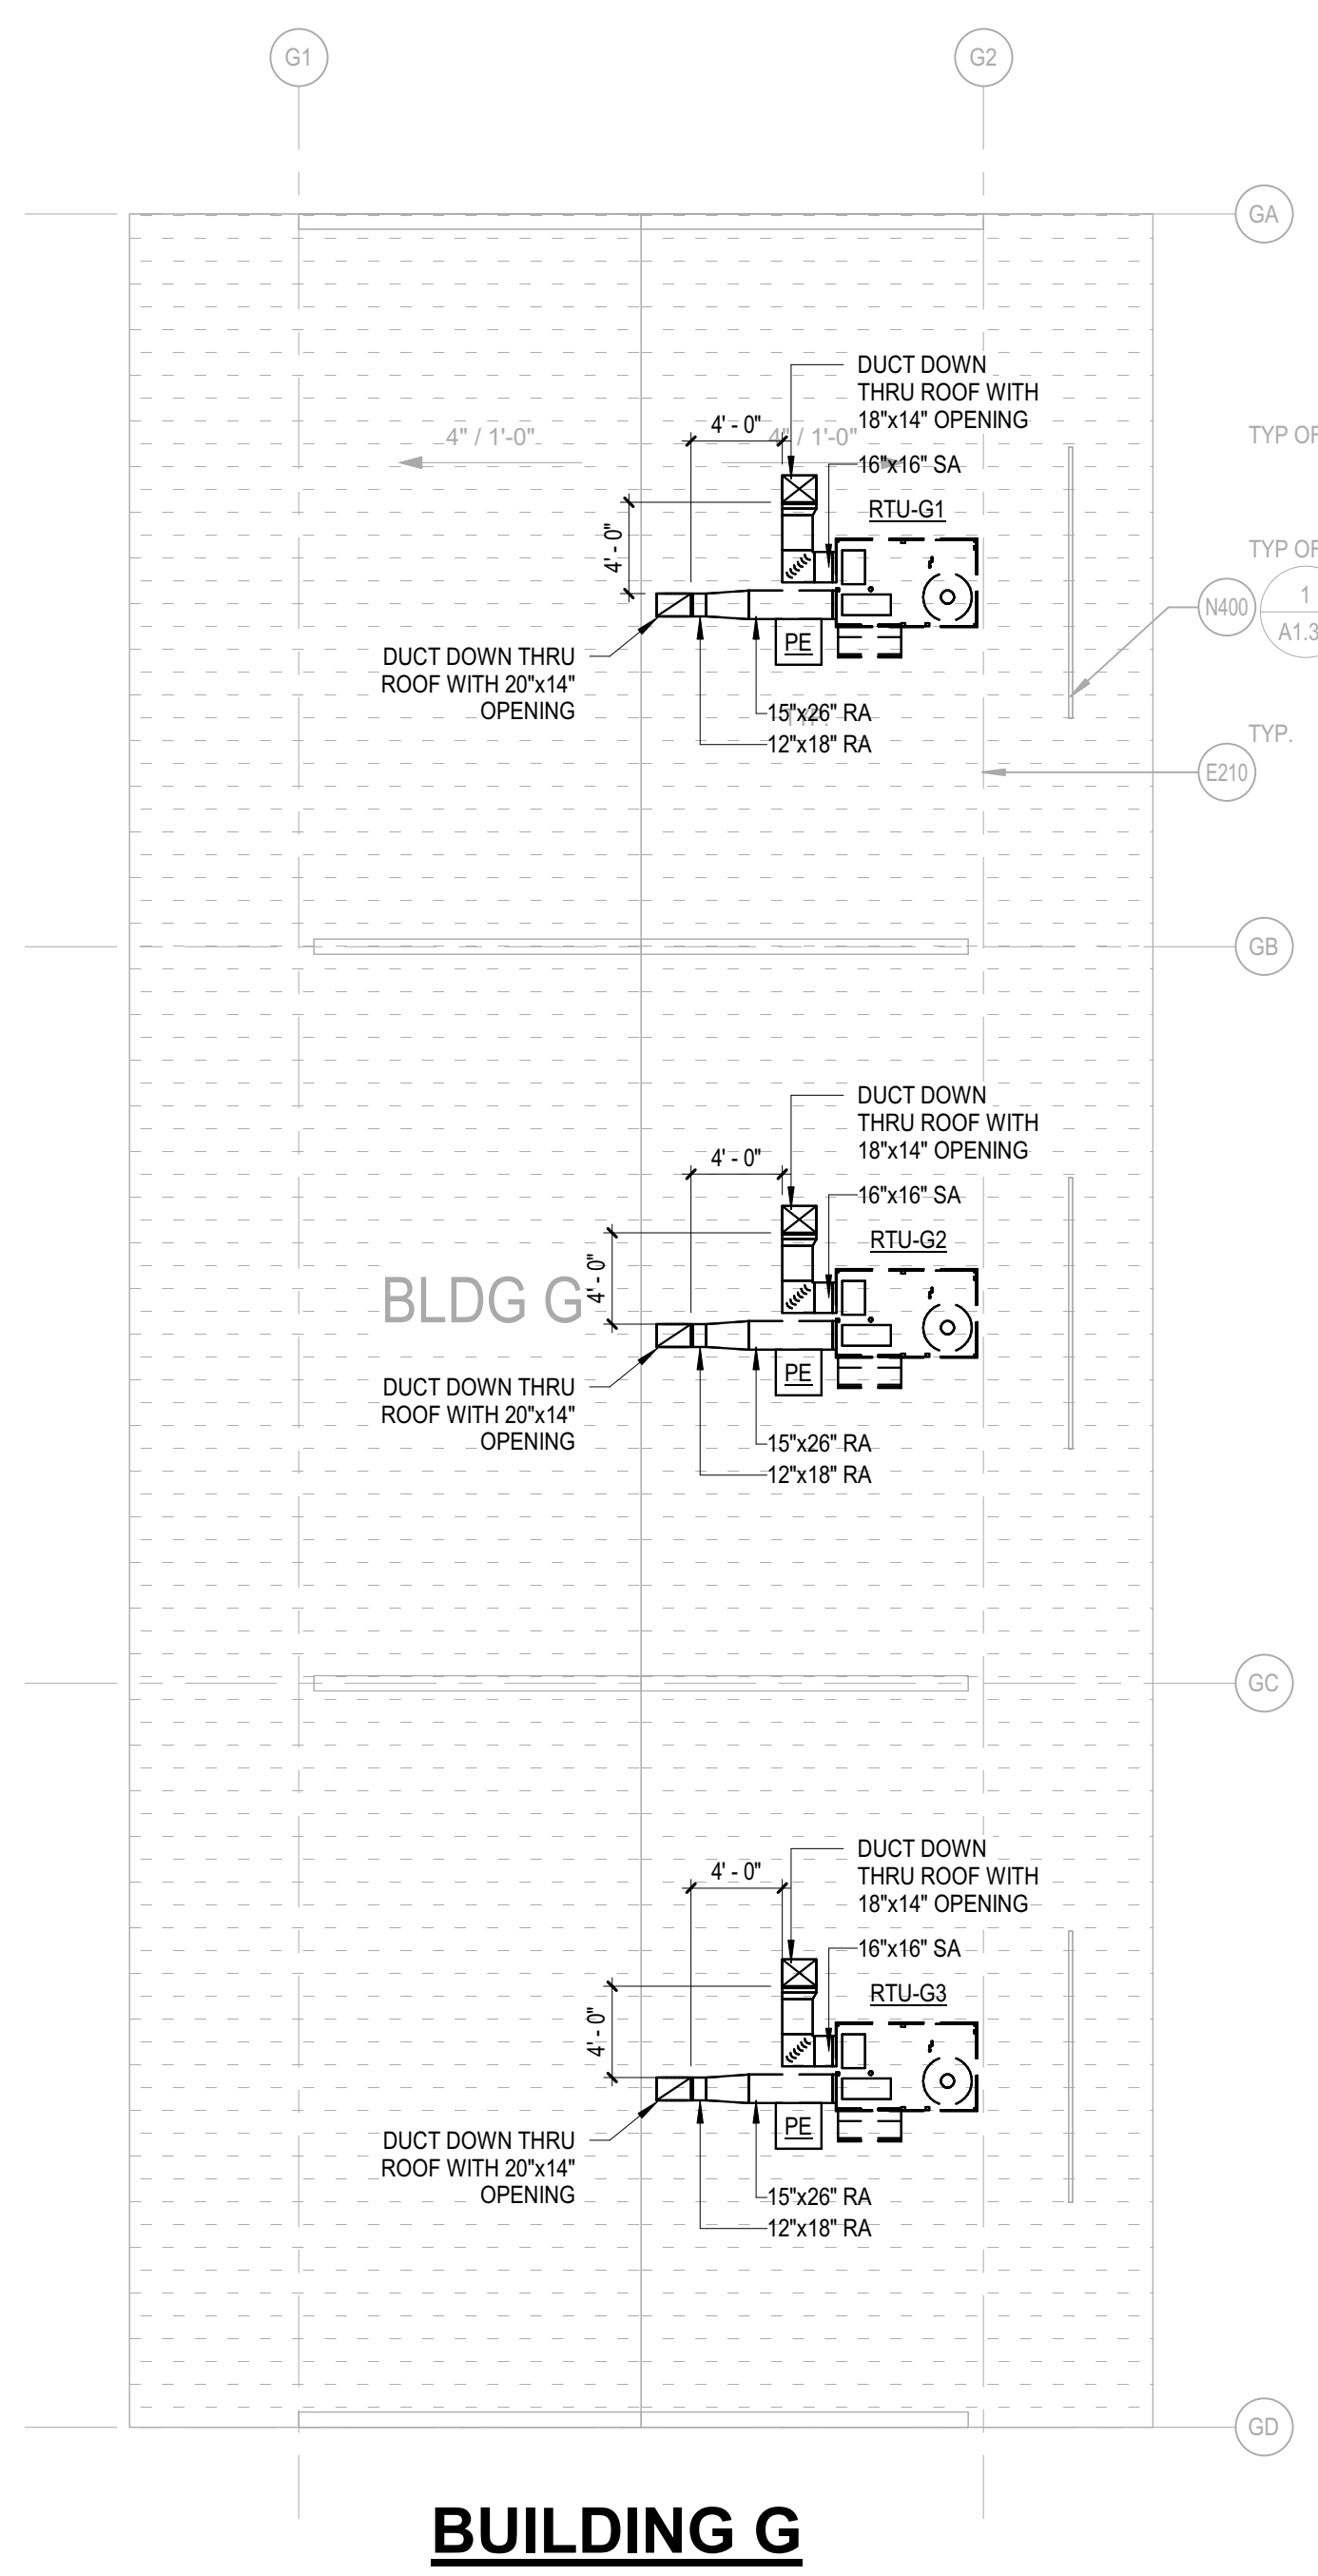

**BUILDING G**

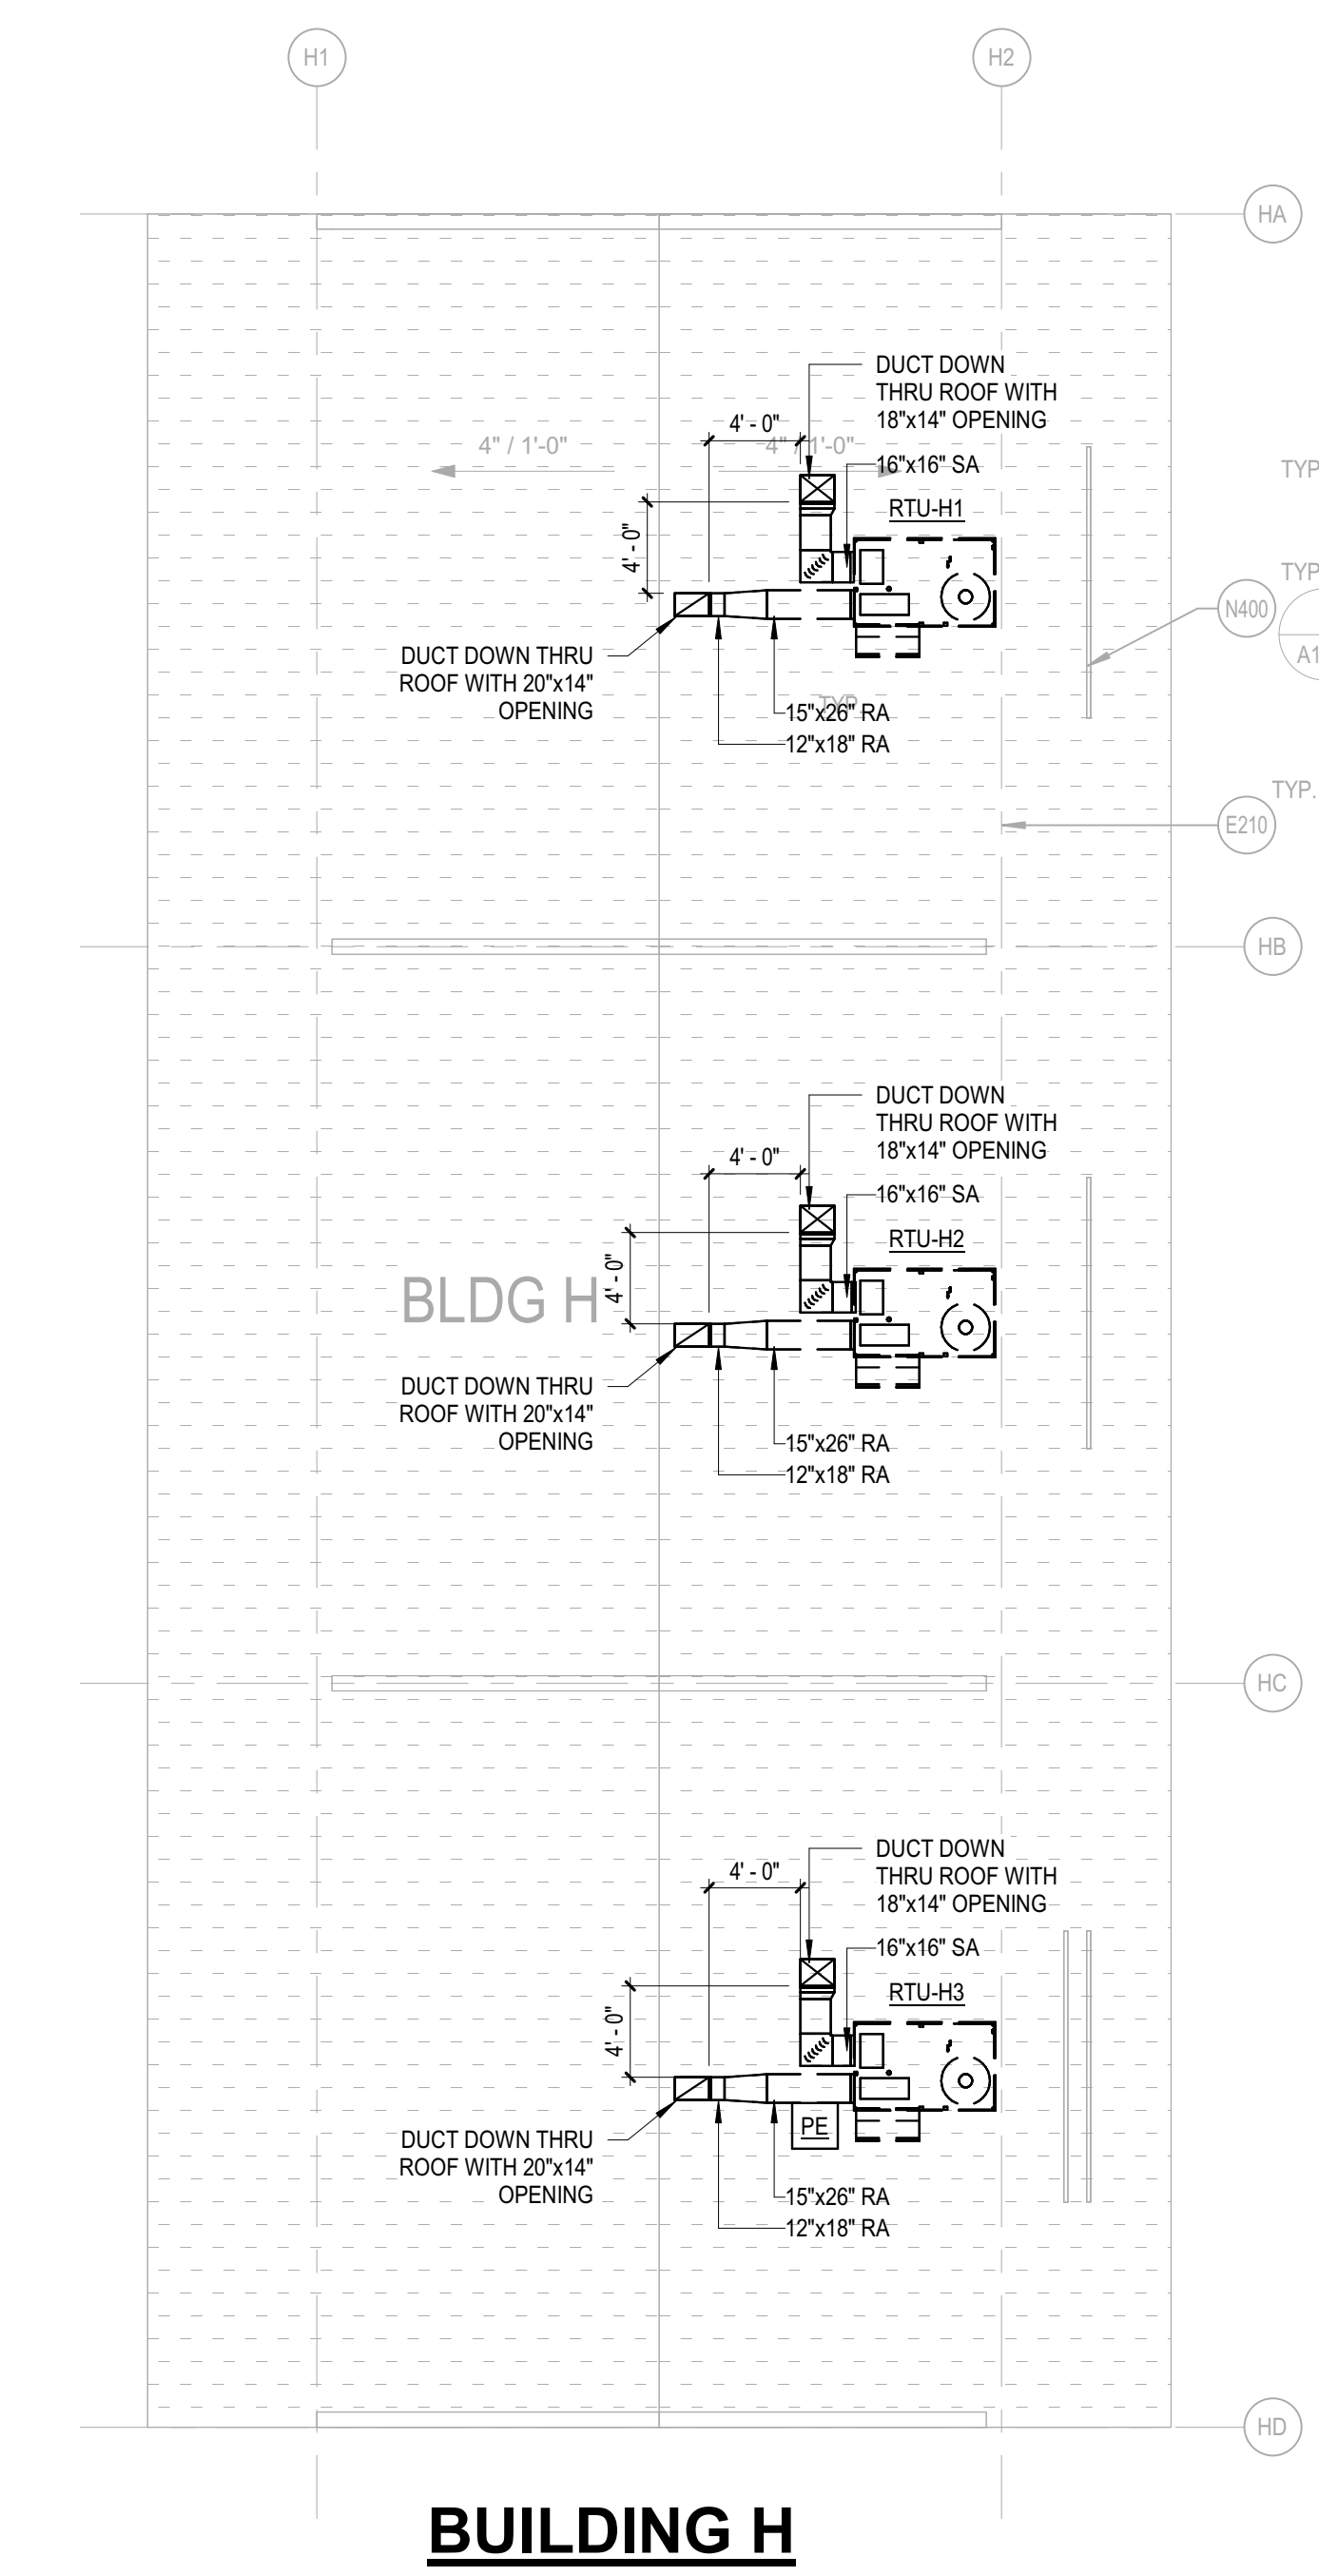

**BUILDING H**

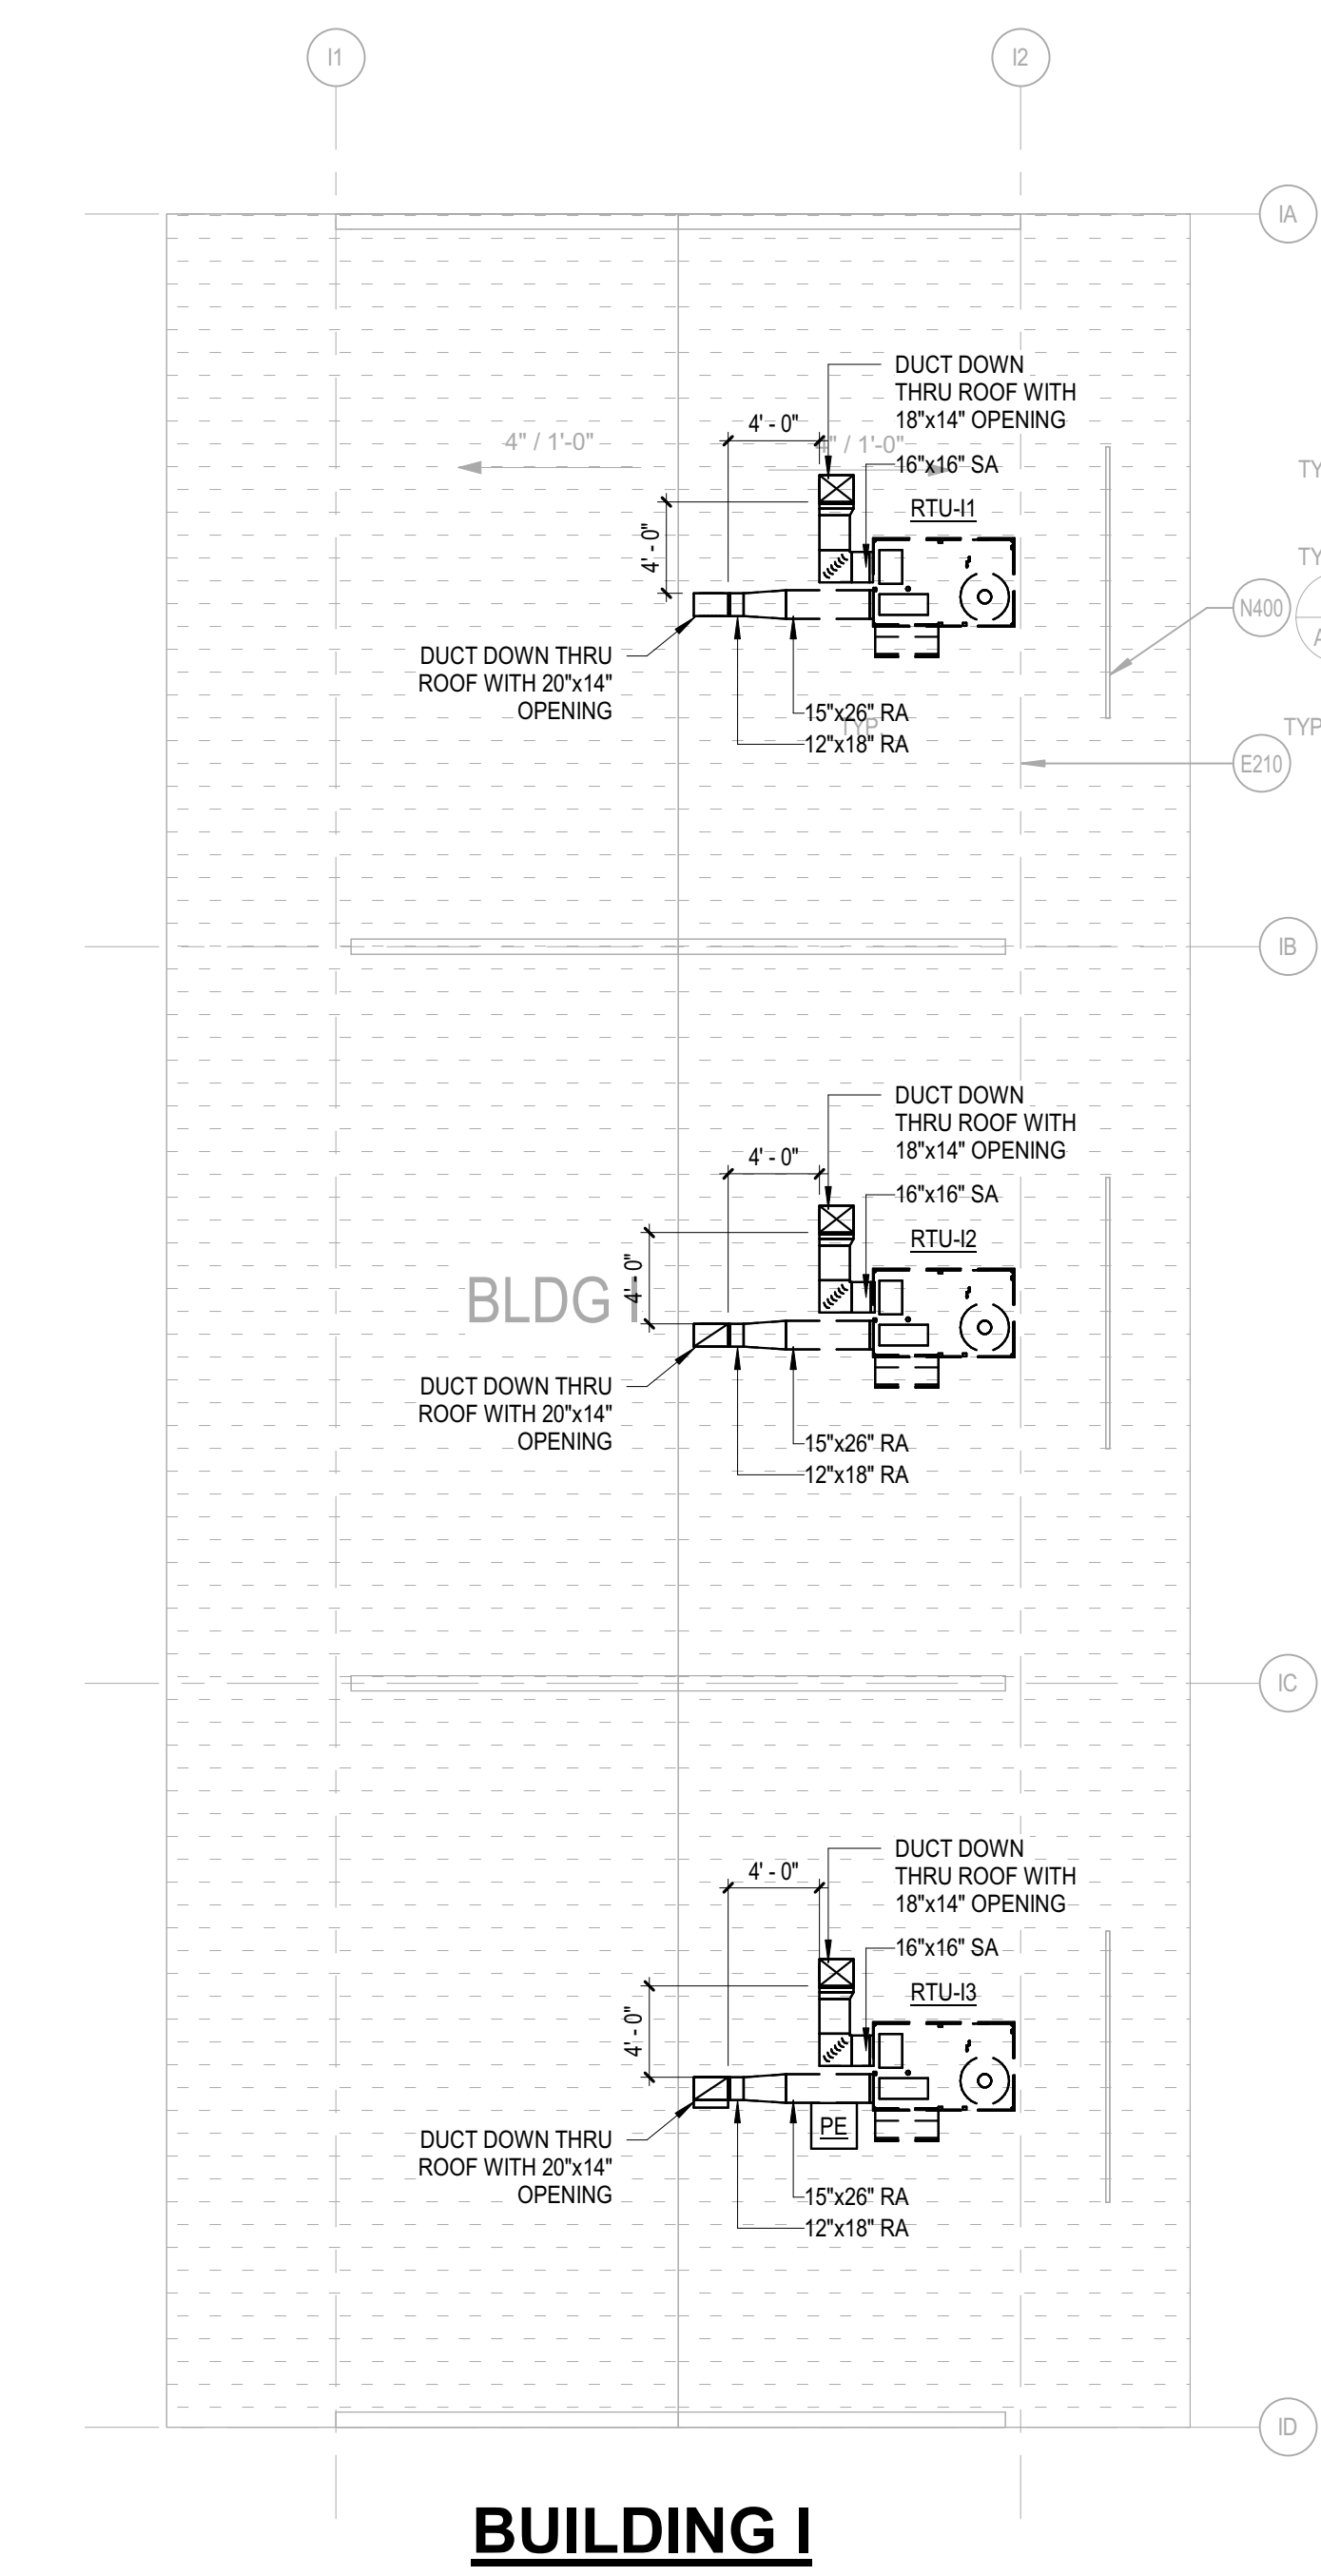

**BUILDING I**

**GENERAL NOTES**

1. SCOPE OF WORK IS CLASSROOMS & MPR ONLY.
2. PROVIDE LINER TO DUCTWORK FOR 10 FEET FROM RTU.
3. PROVIDE FLEXIBLE DUCT AT UNIT CONNECTION FOR SA & RA DUCT.

**KEY NOTES**

1. PROVIDE POWER EXHAUST ON RETURN DUCT WITH LEG LENGTH TO FIT THE ROOF SLOPE. CONTRACTOR TO VERIFY ON SITE. TYP.
2. RTU TO BE 10'-0" MIN. FROM ROOF EDGE. CONTRACTOR TO VERIFY ON SITE. TYP.
3. RTU IS LESS THAN 10'-0" FROM ROOF EDGE. ARCH TO PROVIDE PROTECTION GUARDS. TYP.
4. NEW OPENINGS FOR SUPPLY AND RETURN DUCTS SHOULD BE MADE BETWEEN THE ROOF JOISTS. DO NOT CUT THE JOIST



**Workman Elementary School**  
COVINA VALLEY USD  
1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00  
  
AREA B -  
MECHANICAL  
ROOF PLAN

**M1.3B**





Audodesk Docs/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD\_Workman ES\_MEP\_2022.rvt  
1/02/2022 5:03:03 PM


1

2

3

4

5

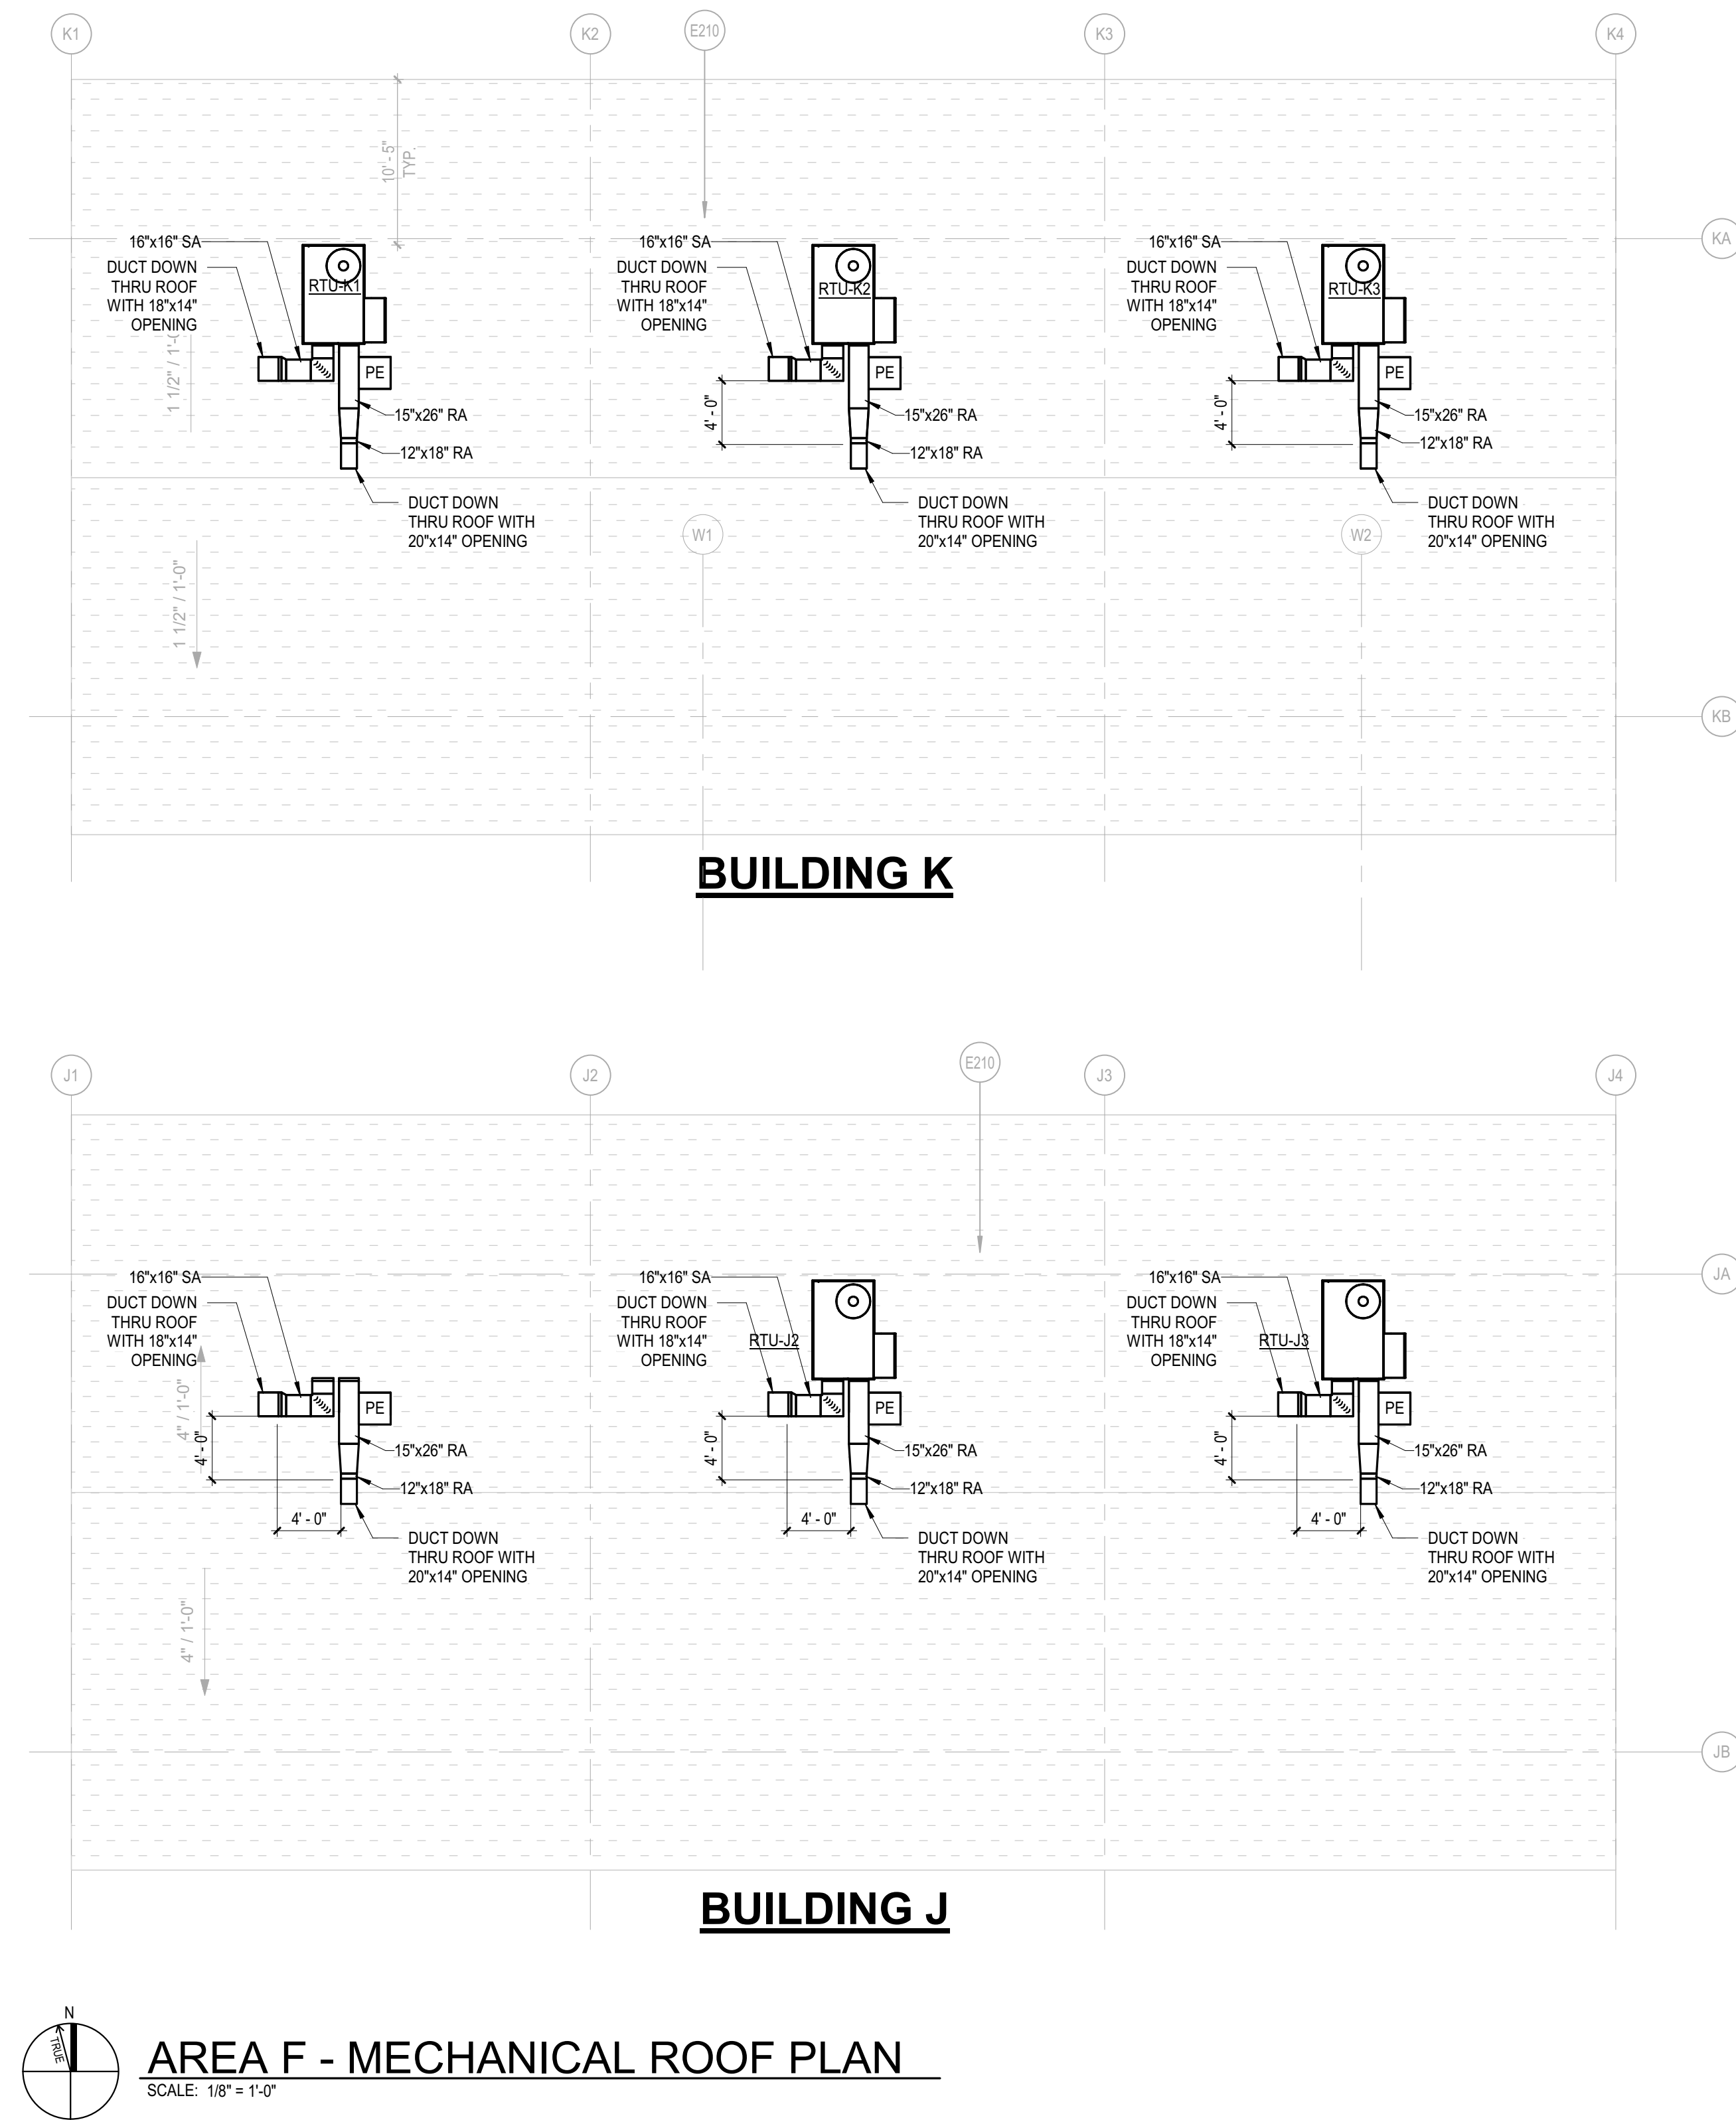


#### GENERAL NOTES

- SCOPE OF WORK IS CLASSROOMS & MPR ONLY.
- PROVIDE LINER TO DUCTWORK FOR 10 FEET FROM RTU.
- NEW OPENINGS FOR SUPPLY AND RETURN DUCTS SHOULD BE MADE BETWEEN THE ROOF JOISTS. DO NOT CUT THE JOIST.
- PROVIDE FLEXIBLE DUCT AT UNIT CONNECTION FOR SA & RA DUCT.

#### KEY NOTES

- PROVIDE POWER EXHAUST ON RETURN DUCT WITH LEG LENGTH TO FIT THE ROOF SLOPE. CONTRACTOR TO VERIFY ON SITE. TYP.
- RTU TO BE 10'-0" MIN. FROM ROOF EDGE. CONTRACTOR TO VERIFY ON SITE. TYP.
- RTU IS LESS THAN 10'-0" FROM ROOF EDGE. ARCH TO PROVIDE PROTECTION GUARDS. TYP.

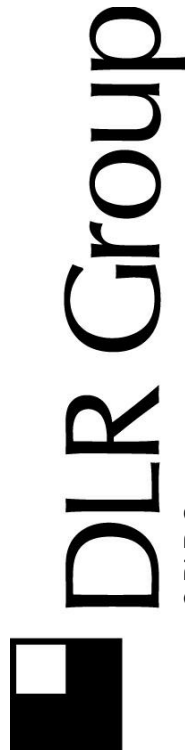

Workman Elementary School  
COVINA VALLEY USD


1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS


75-22605-00

AREA F -  
MECHANICAL  
ROOF PLAN


M1.3F

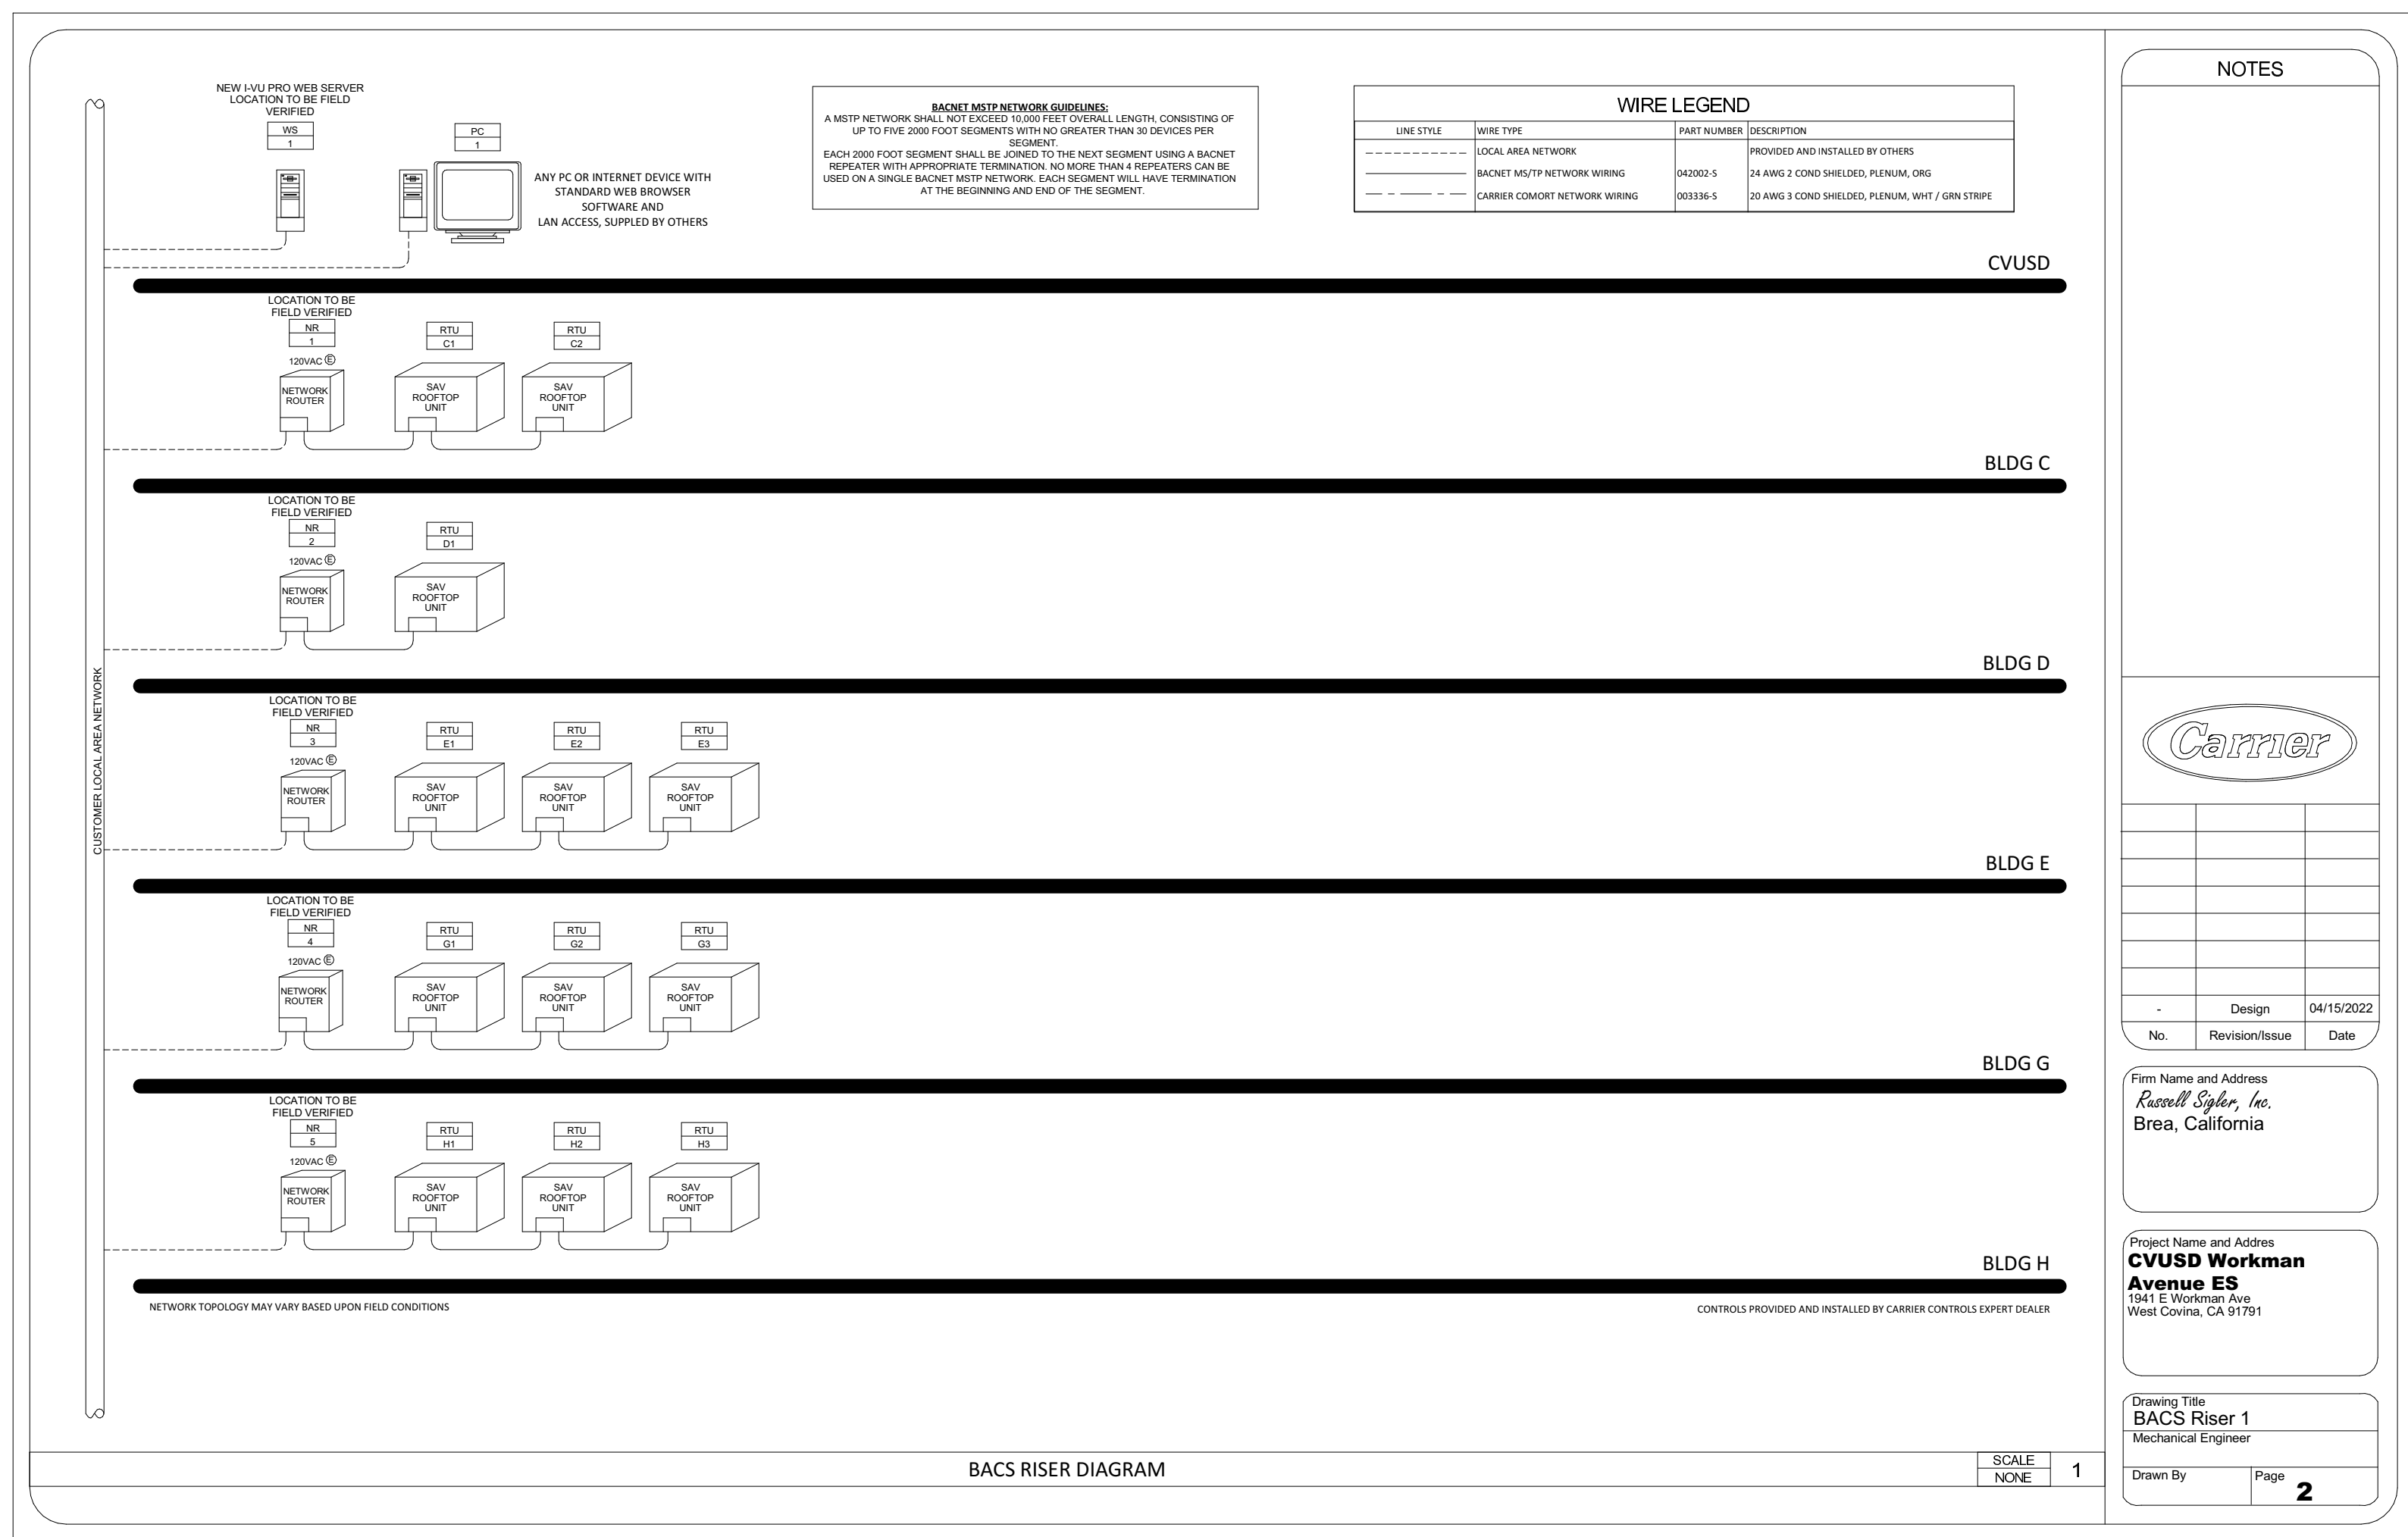

1 BACS RISER DIAGRAM 1  
M5.1 NO SCALE

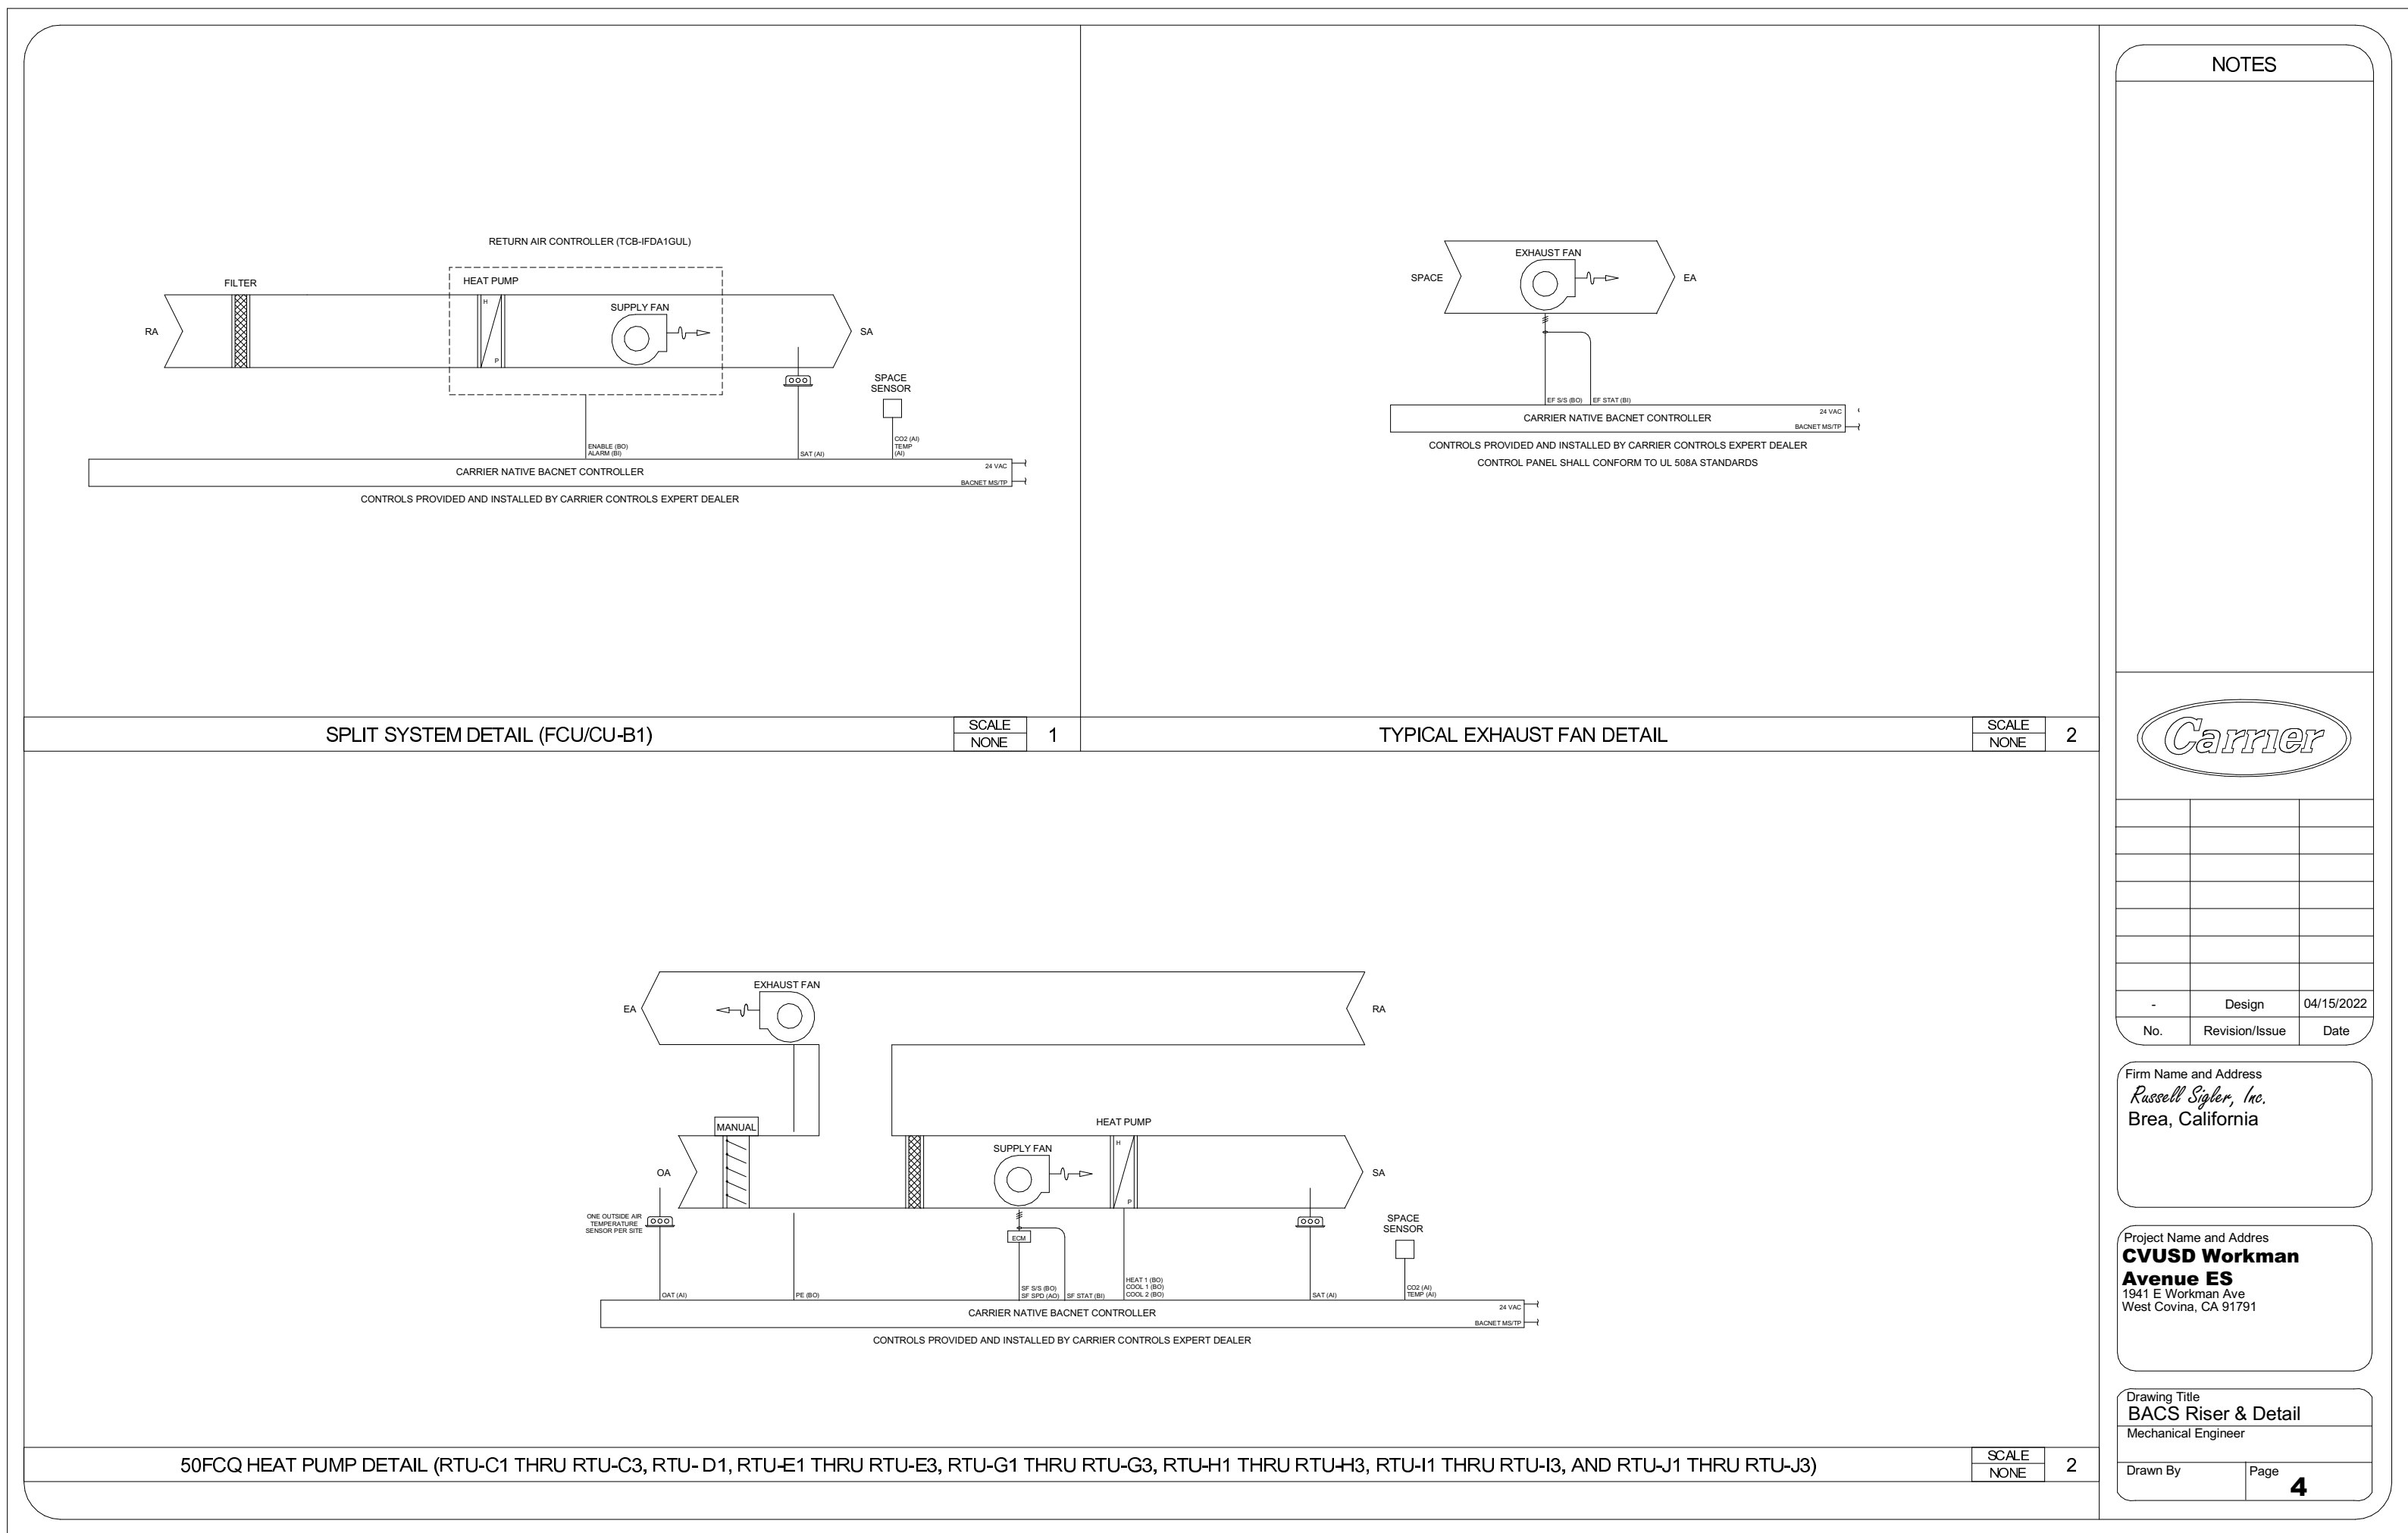

3 BACS RISER DETAIL  
M5.1 NO SCALE

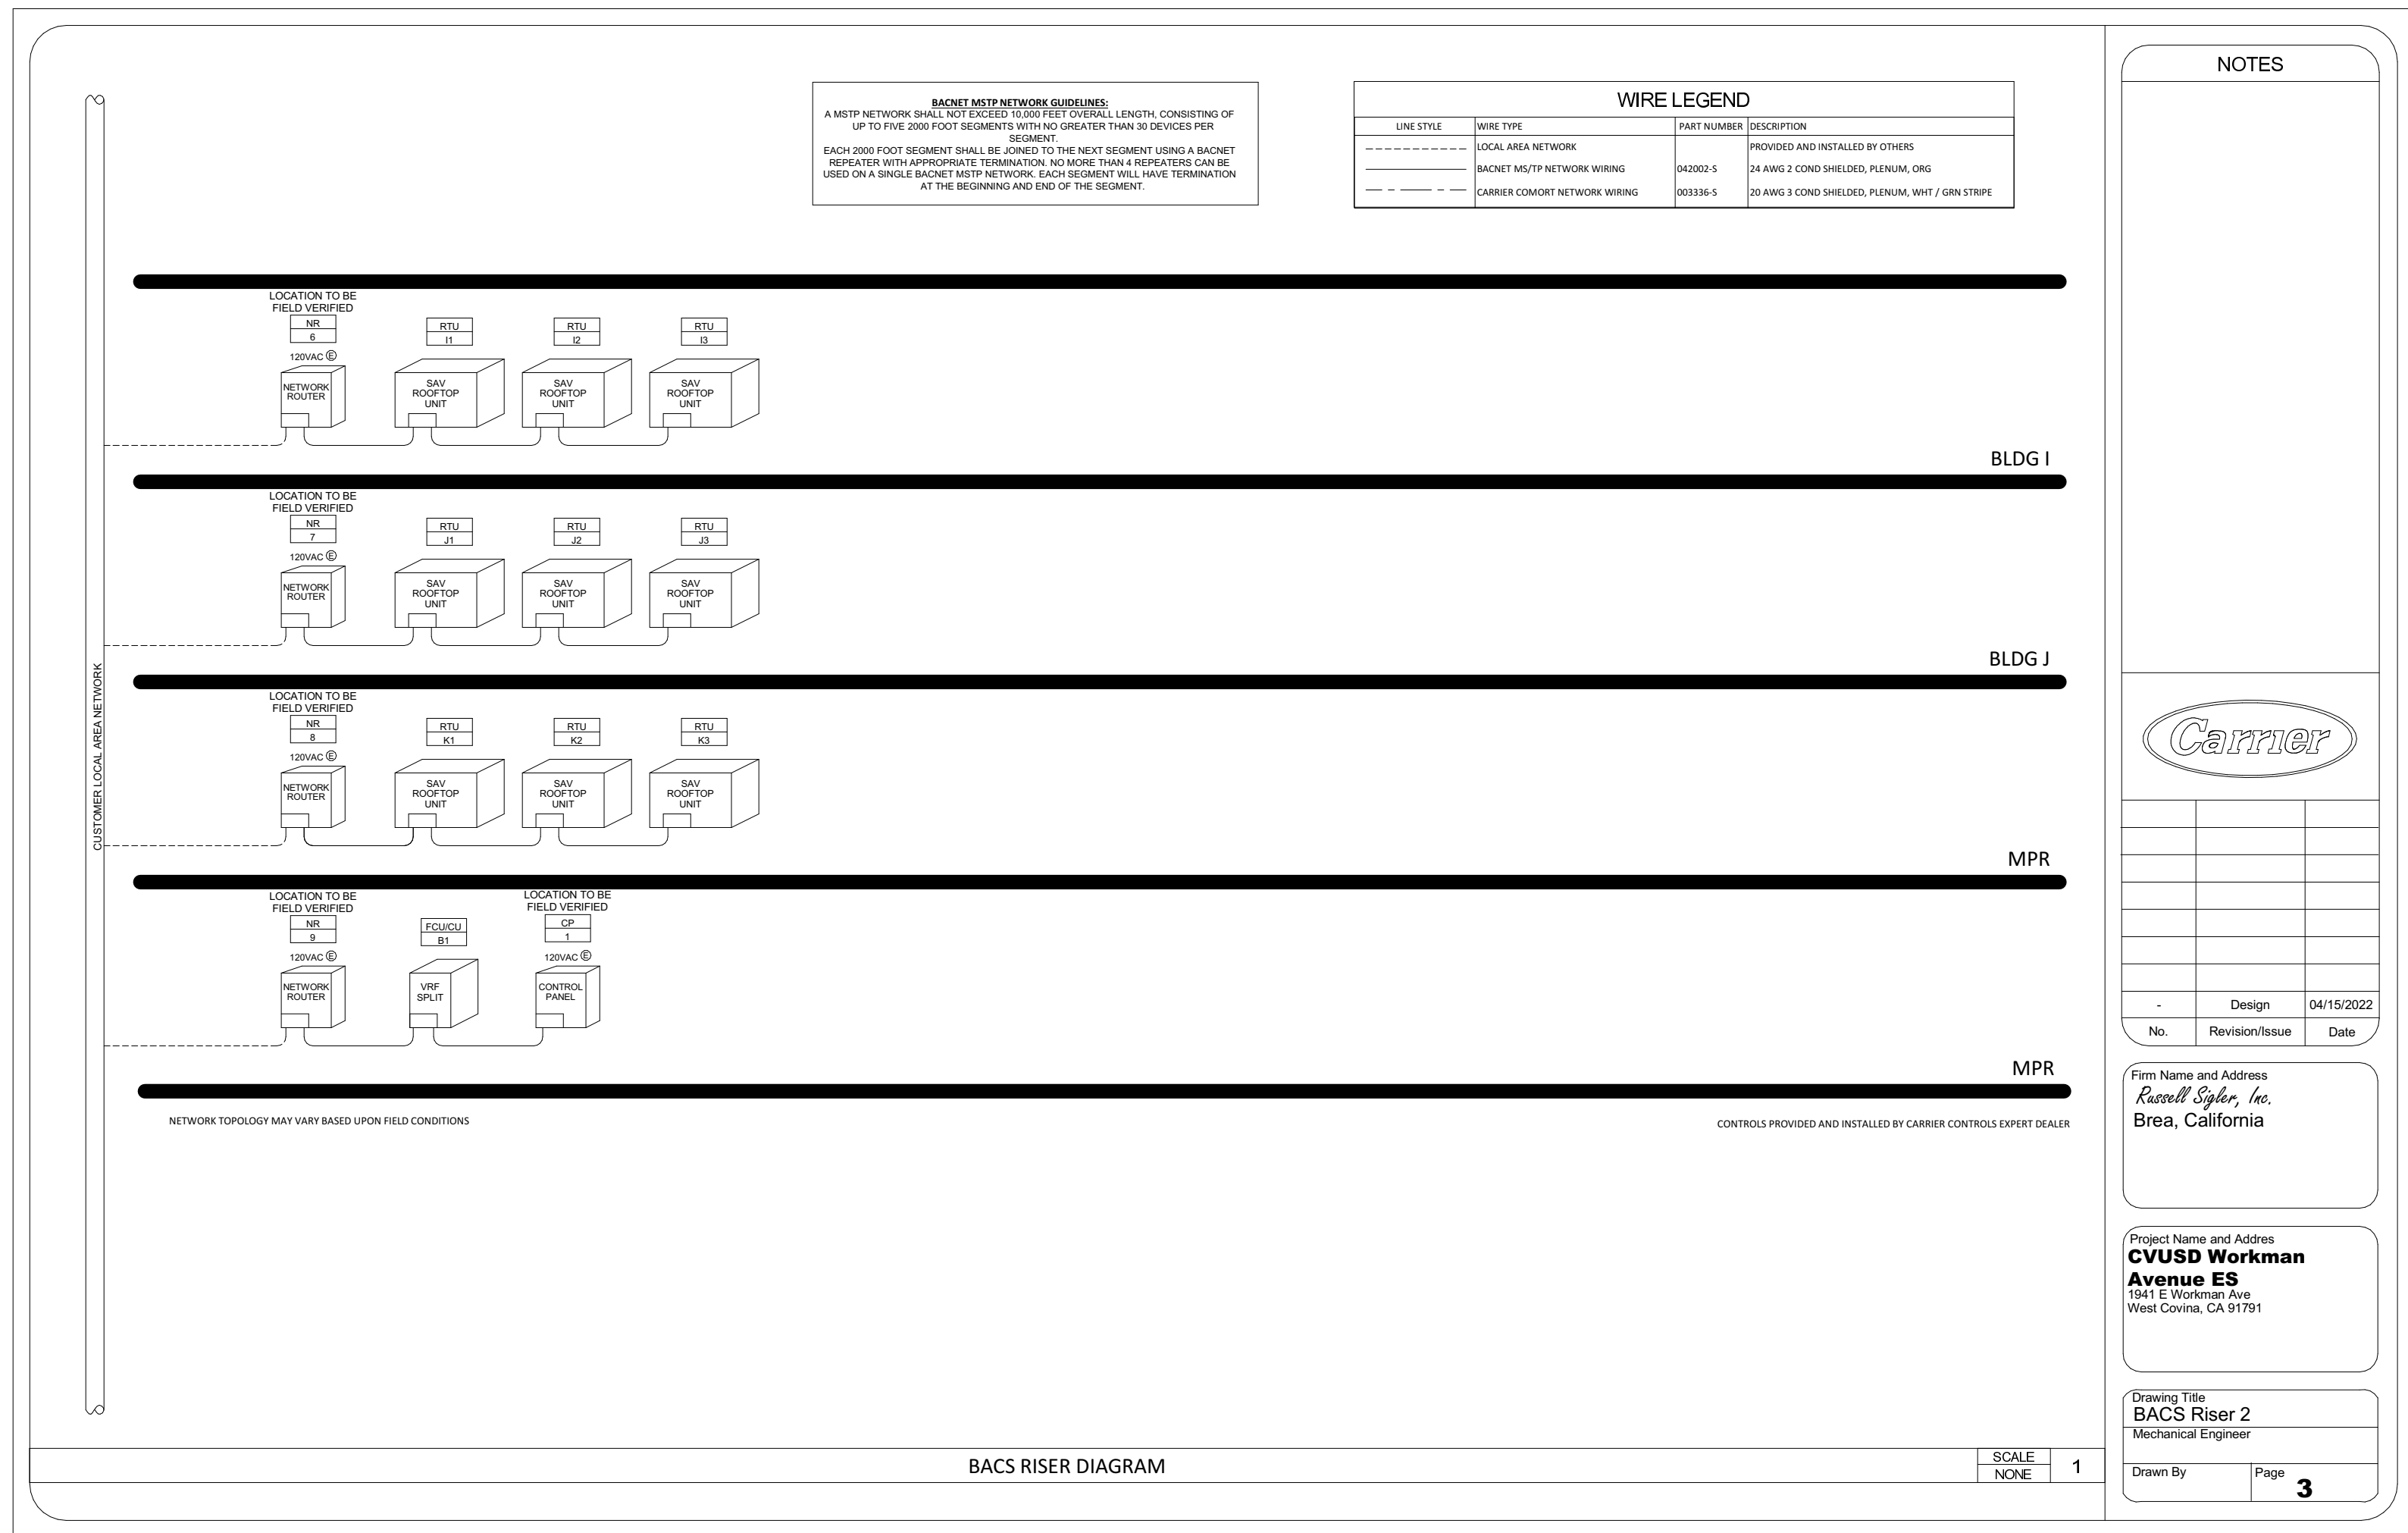

2 BACS RISER DIAGRAM 2  
M5.1 NO SCALE

## SEQUENCES OF OPERATION

HEAT PUMP RTU CONTROLLER (RTU-C1 THRU RTU-C3, RTU- D1, RTU-E1 THRU RTU-E3, RTU-G1 THRU RTU-G3, RTU-H1 THRU RTU-H3, RTU-I1 THRU RTU-I3, AND RTU-J1 THRU RTU-J3)

## INDOOR FAN

THE FAN OPERATES AT A VARIABLE SPEED TO MEET THE LOAD CONDITIONS AND SAT SAFETY REQUIREMENTS TO PROVIDE MAXIMUM ENERGY SAVINGS BY MINIMIZING FAN HORSEPOWER CONSUMPTION. FAN SPEED IS NOT CONTROLLED BY STATIC PRESSURE.

## HEATING MODE

WHEN SPACE TEMPERATURE IS BELOW THE OCCUPIED HEATING SETPOINT, UNIT SHALL OPERATE IN THE HEATING MODE. UNIT SHALL ENABLE AVAILABLE HEAT STAGES TO SATISFY DEMAND IN THE OCCUPIED SPACE.

## COOLING MODE

WHEN SPACE TEMPERATURE IS ABOVE OCCUPIED COOLING SETPOINT, UNIT SHALL ENABLE AVAILABLE COOLING STAGES TO SATISFY DEMAND IN THE OCCUPIED SPACE.

## CO2 CONTROL

UNIT SHALL MONITOR SPACE CO2 WHEN THE SUPPLY FAN IS ENERGIZED. WHEN CO2 IS ABOVE SETPOINT OF 1000 PPM, AN ALARM SHALL BE ENABLED THROUGH THE EMS.


## POWER EXHAUST

**THE EXHAUST FAN SHALL RUN THE UNIT IS OCCUPIED.**




Autodesk Docs/75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD Workman ES MEP\_2022.rvt  
11/02/2022 5:03:09 PM

1

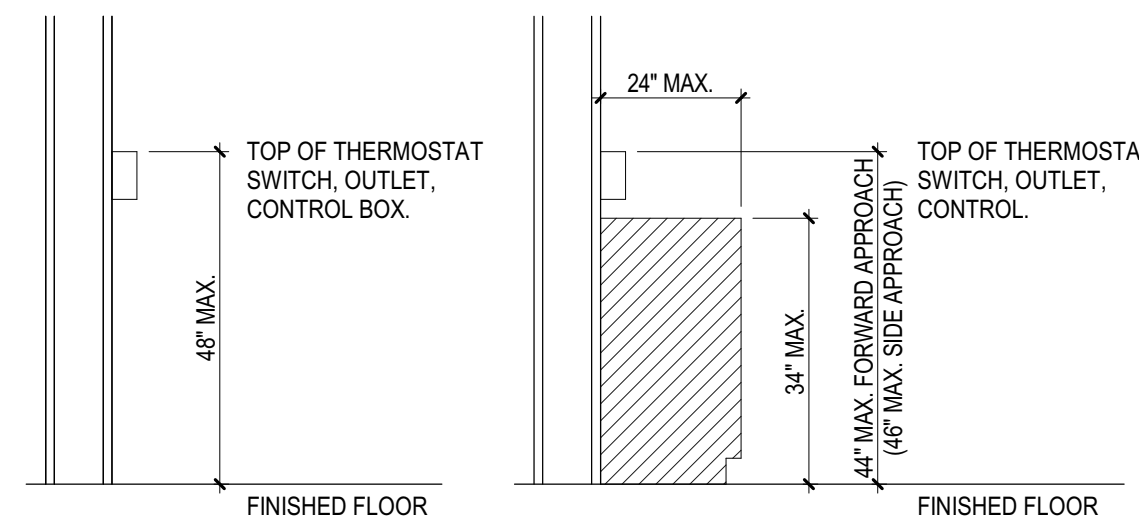


1 THERMOSTAT MOUNTING  
M7.1 NO SCALE

2

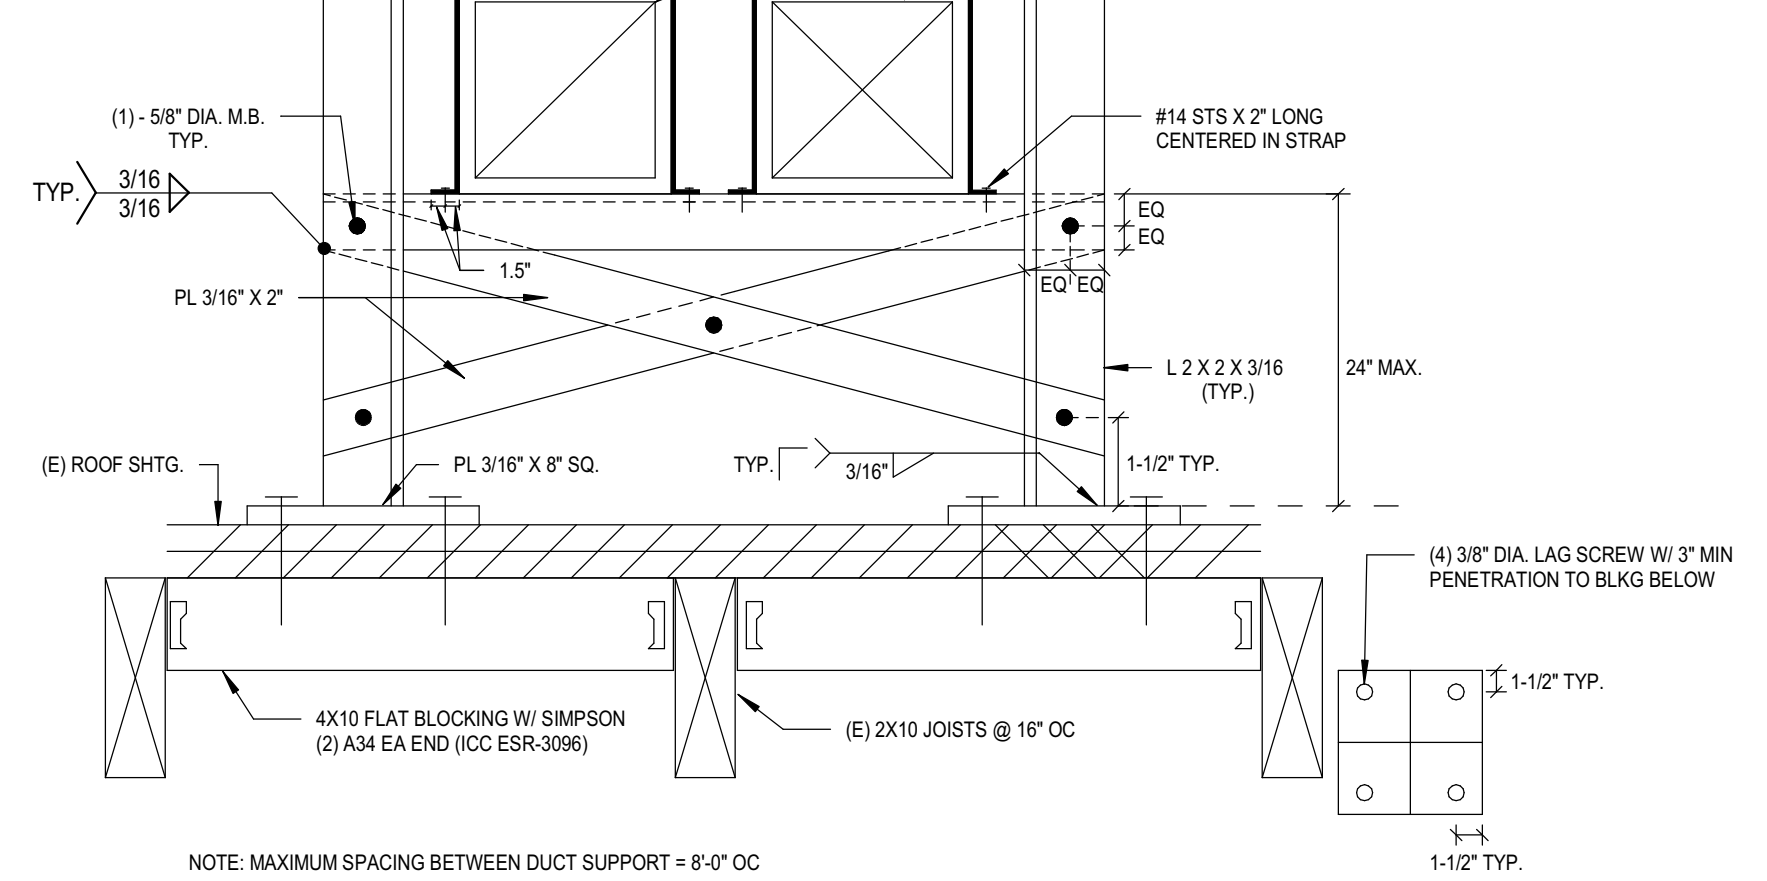


2 DUCT SUPPORT ON ROOF DETAIL  
M7.1 NO SCALE

3

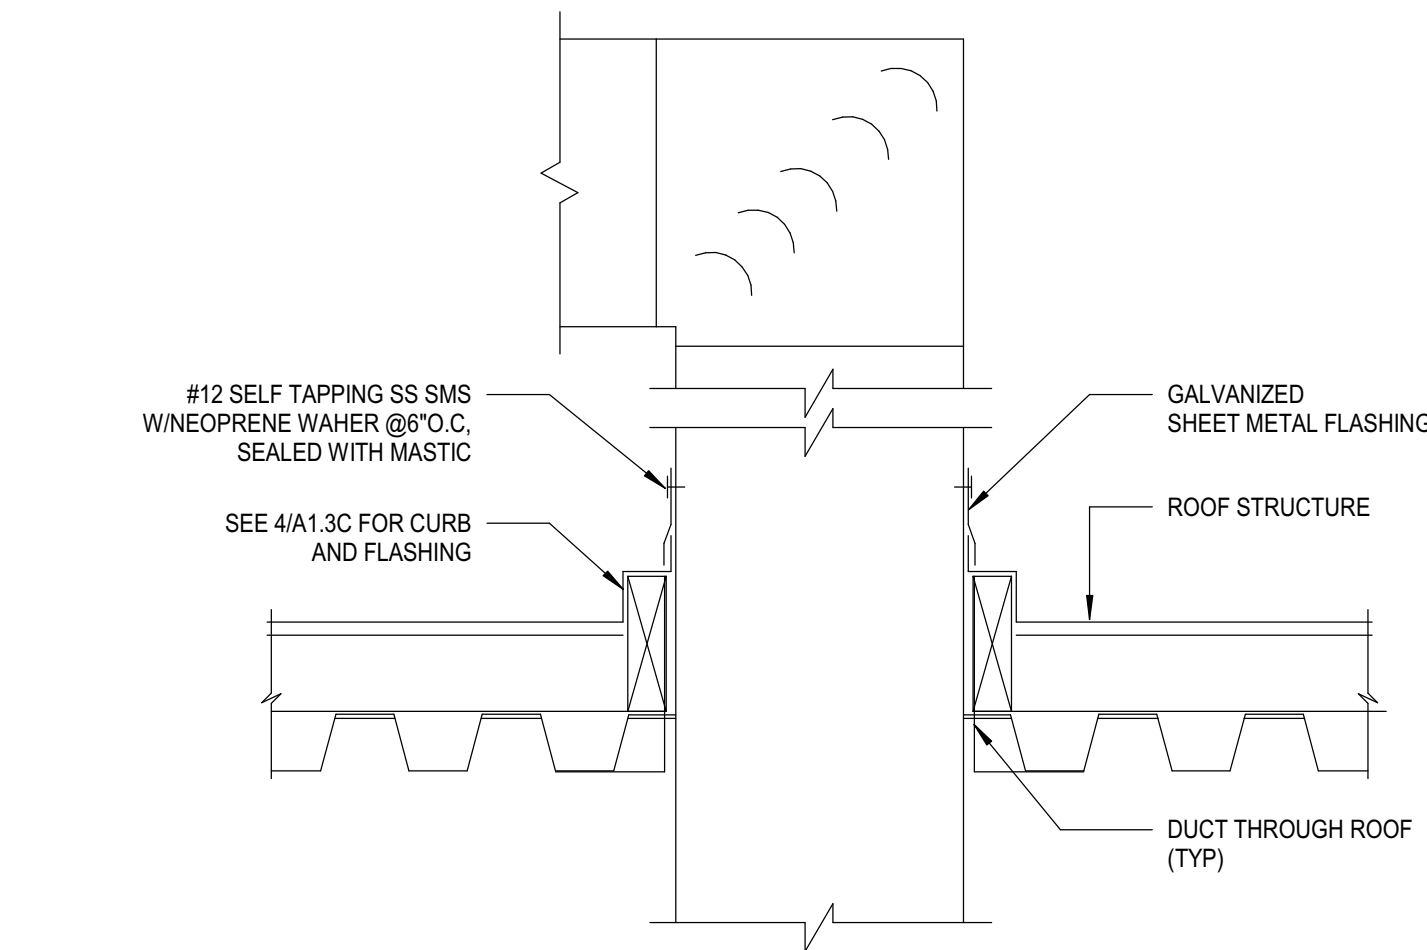


4 DUCT THRU ROOF PENETRATION  
M7.1 NO SCALE

4

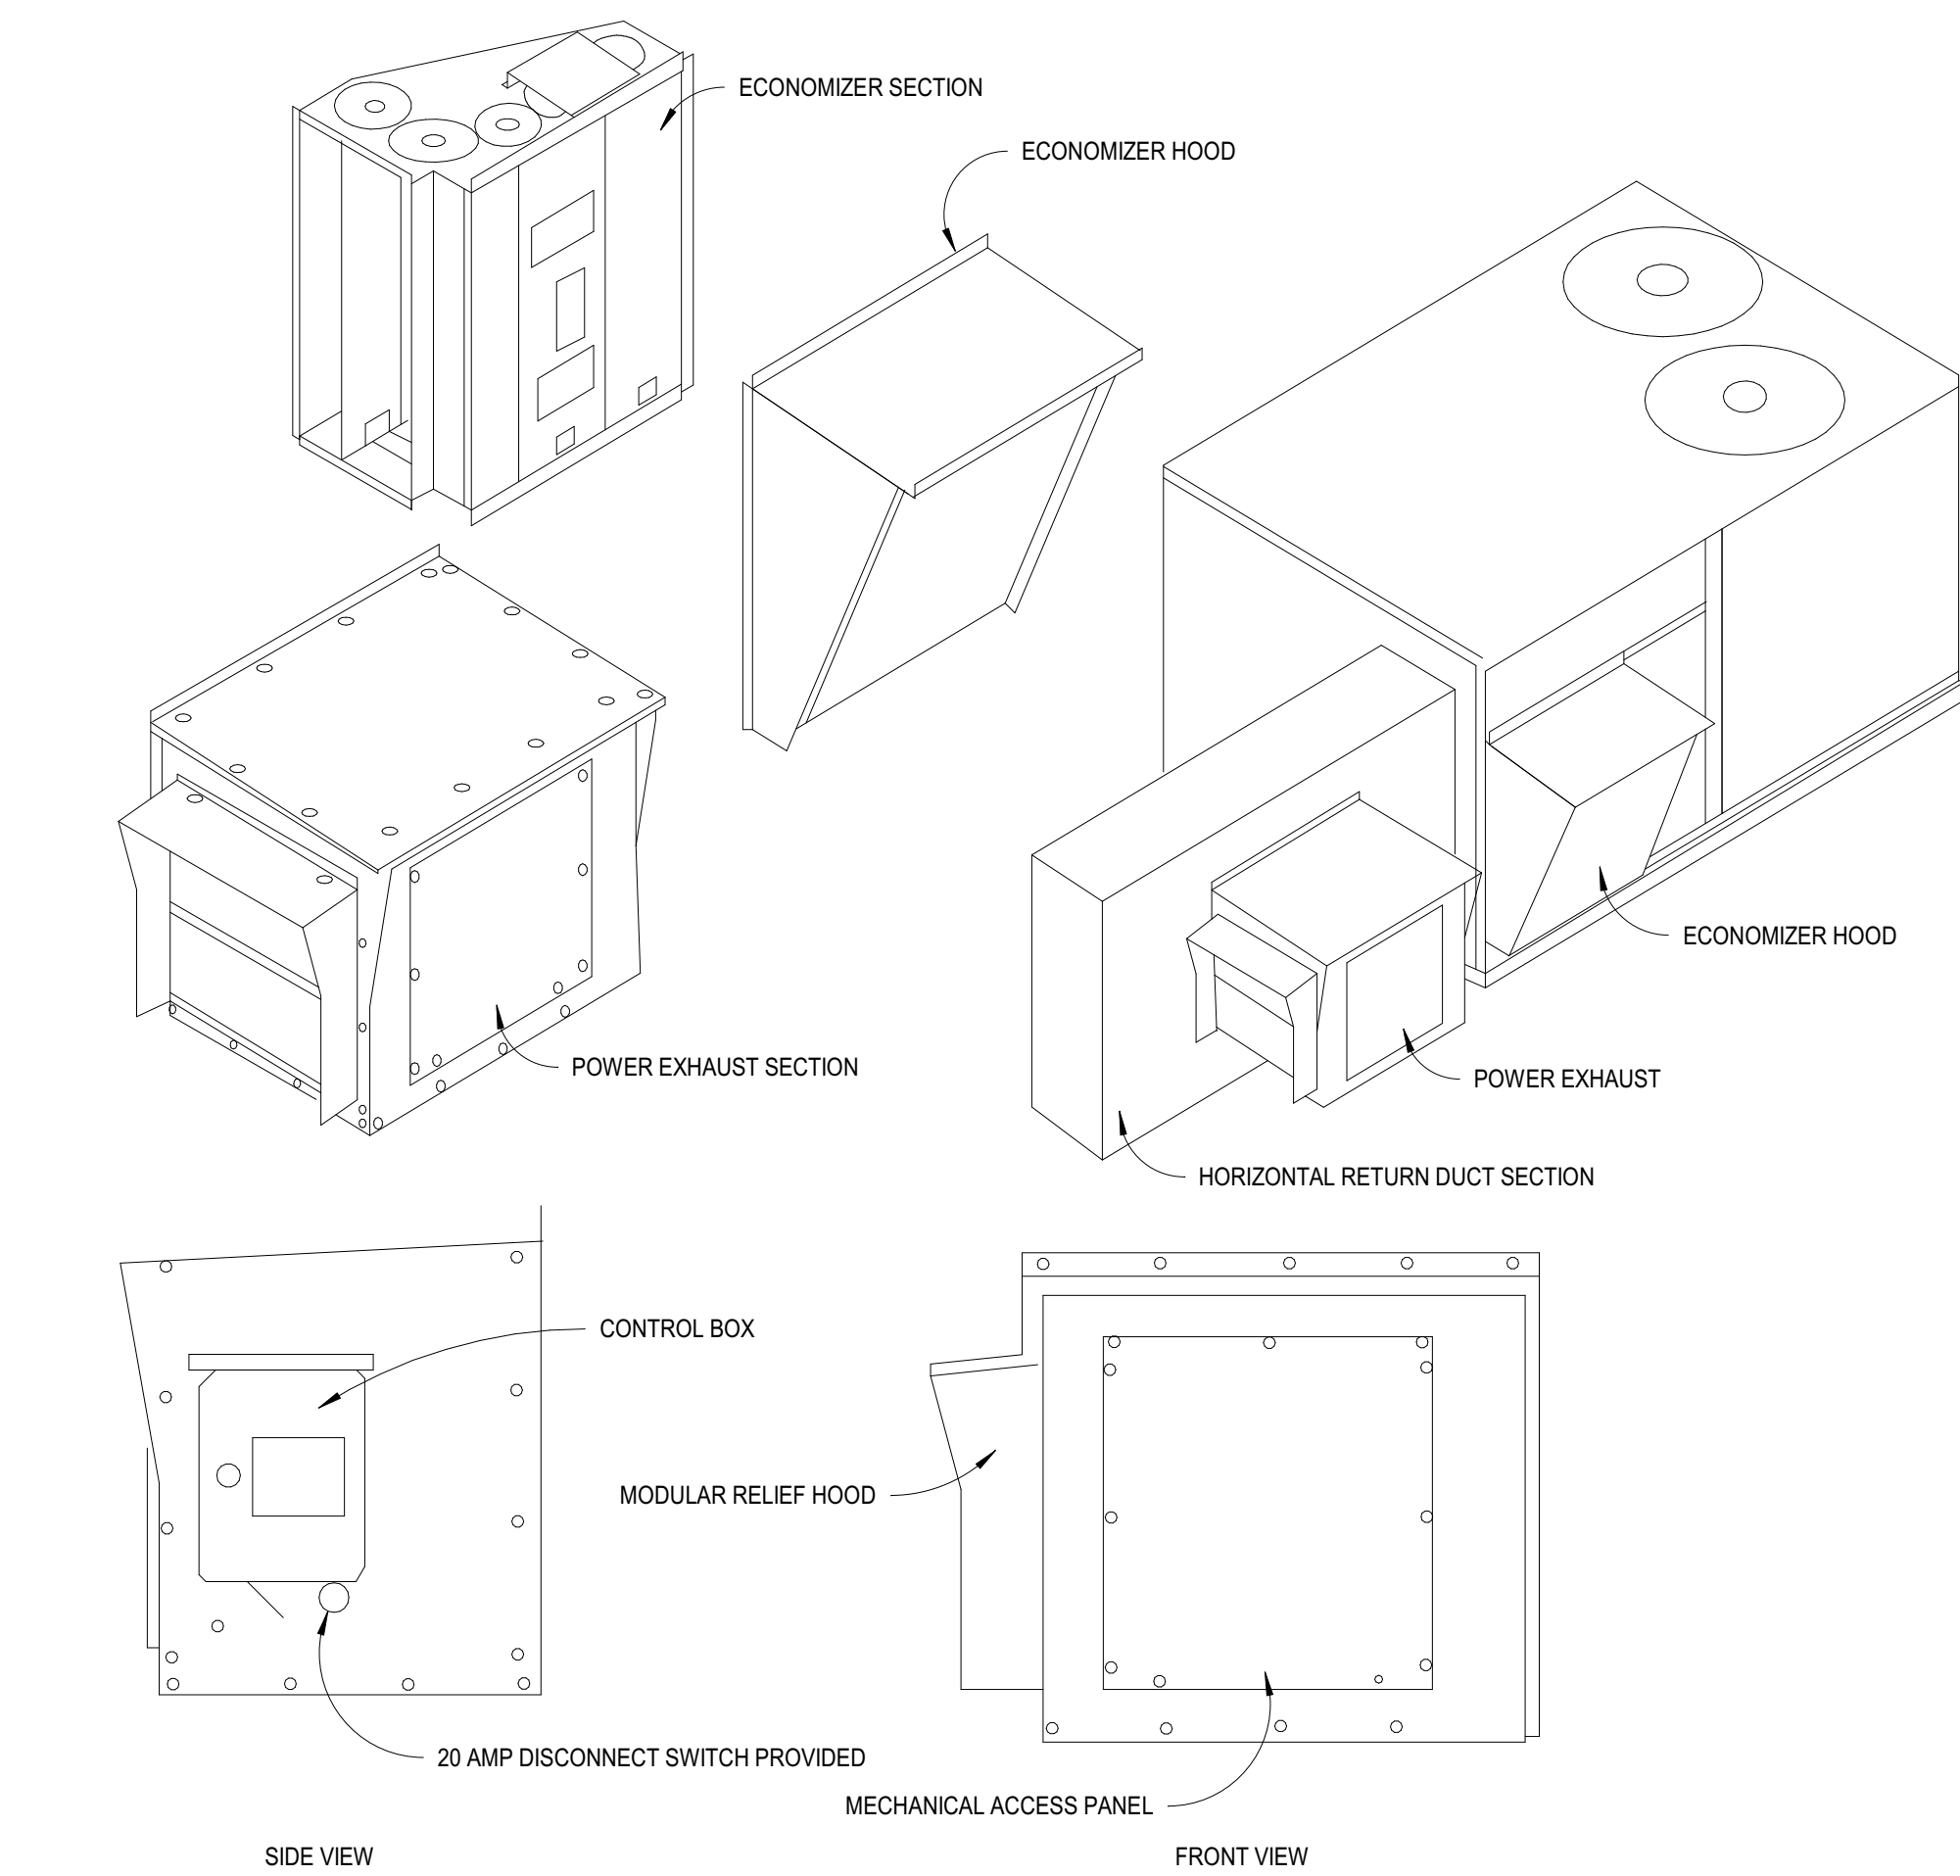


ECONOMIZER AND POWER EXHAUST DETAIL -  
HORIZONTAL DISCHARGE RTU (LESS THAN 15  
TONS)  
3 M7.1 NO SCALE

10 RECTANGULAR ELBOW W/ TURNING VANES DETAIL  
M7.1 NO SCALE

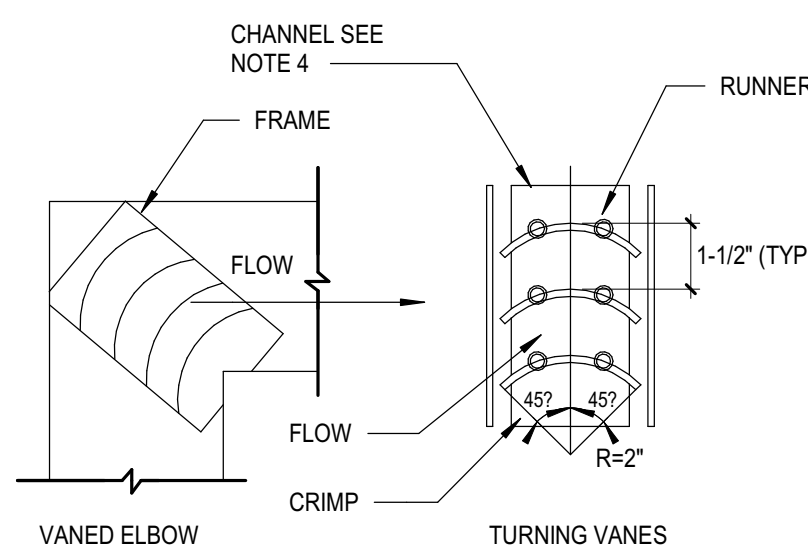

- NOTES:
1. MAXIMUM UNSUPPORTED VANE LENGTH 36".
  2. VANES AND FRAMES 24 GAUGE.
  3. DUCT INLET AND OUTLET DIMENSIONS TO BE EQUAL.
  4. FOR HIGH VELOCITY APPLICATIONS PROVIDE 18 GAUGE CHANNEL AND TACK WELD VANE EDGES TO CHANNEL, TYPICAL BOTH ENDS.
  5. FRAMES AND CHANNELS -BOLTED OR TACK WELDED TO ELBOW.

12 DUCT SUPPORTS  
M7.1 NO SCALE

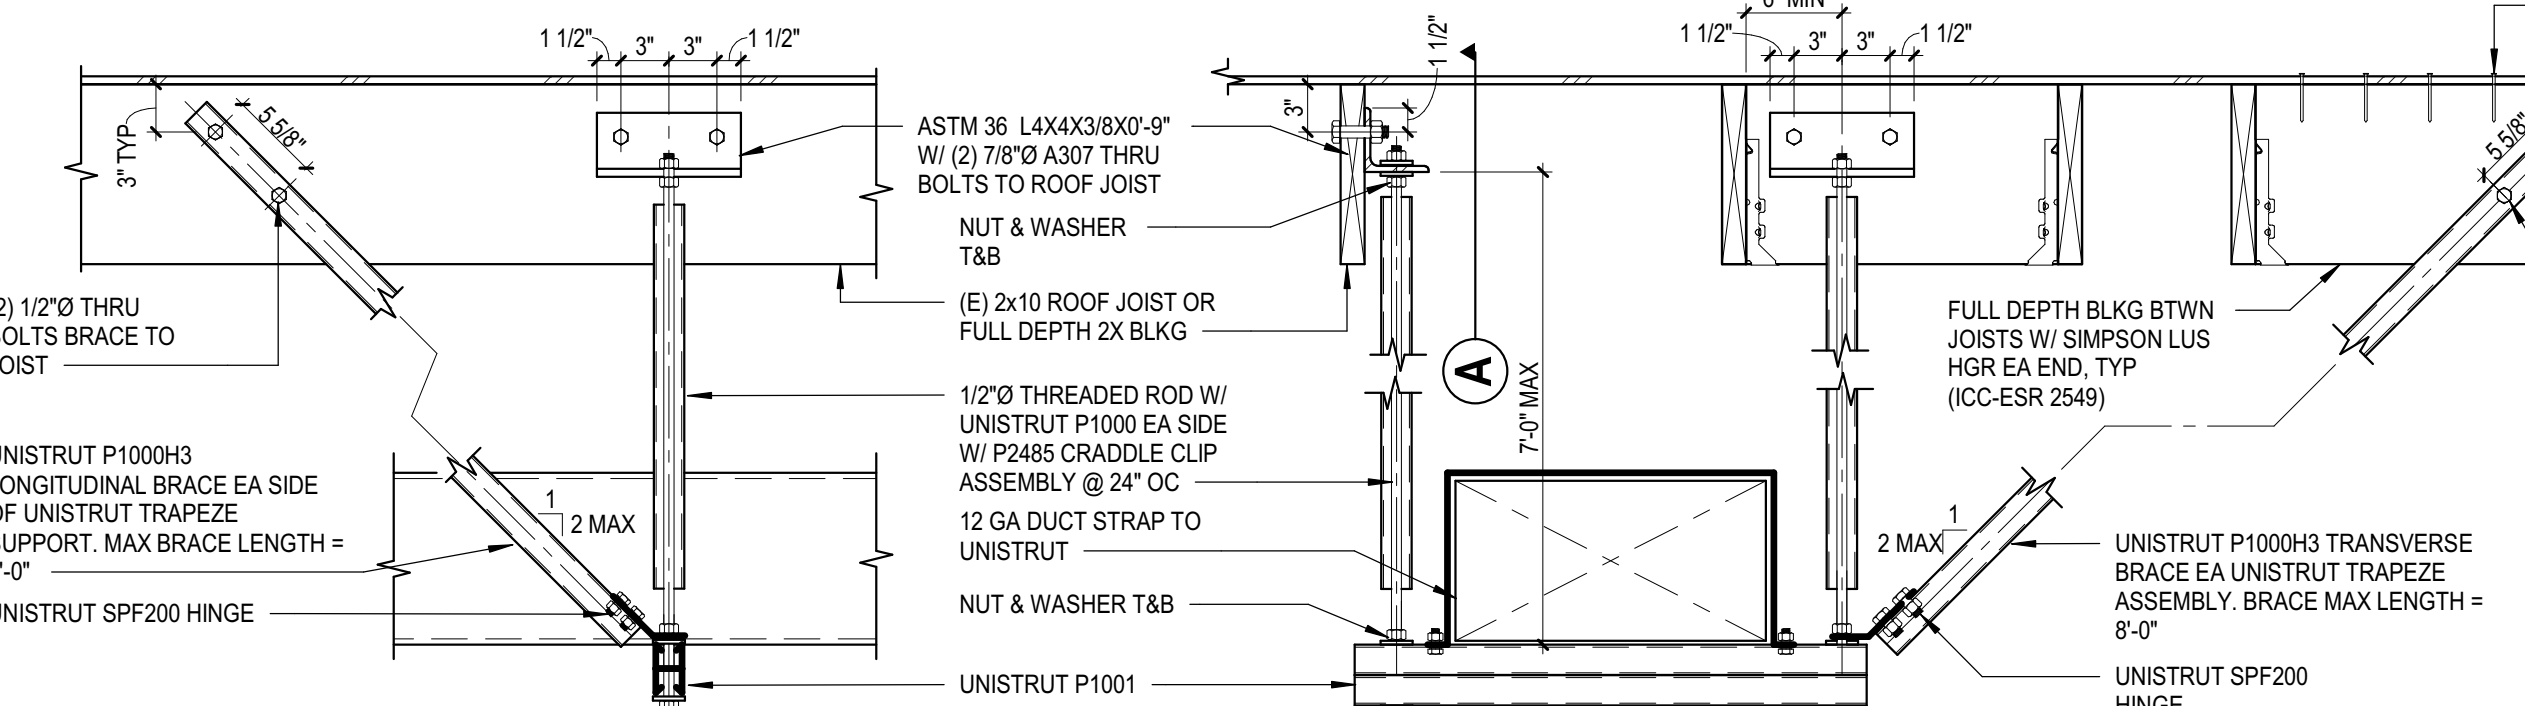


A LONGITUDINAL DIRECTION

B.1 TRANSVERSE DIRECTION - WOOD ROOF

B.2 TRANSVERSE DIRECTION - WOOD WALL


TIEBACK

6 ACOUSTICAL DUCT LINING INSTALLATION DETAIL  
M7.1 NO SCALE

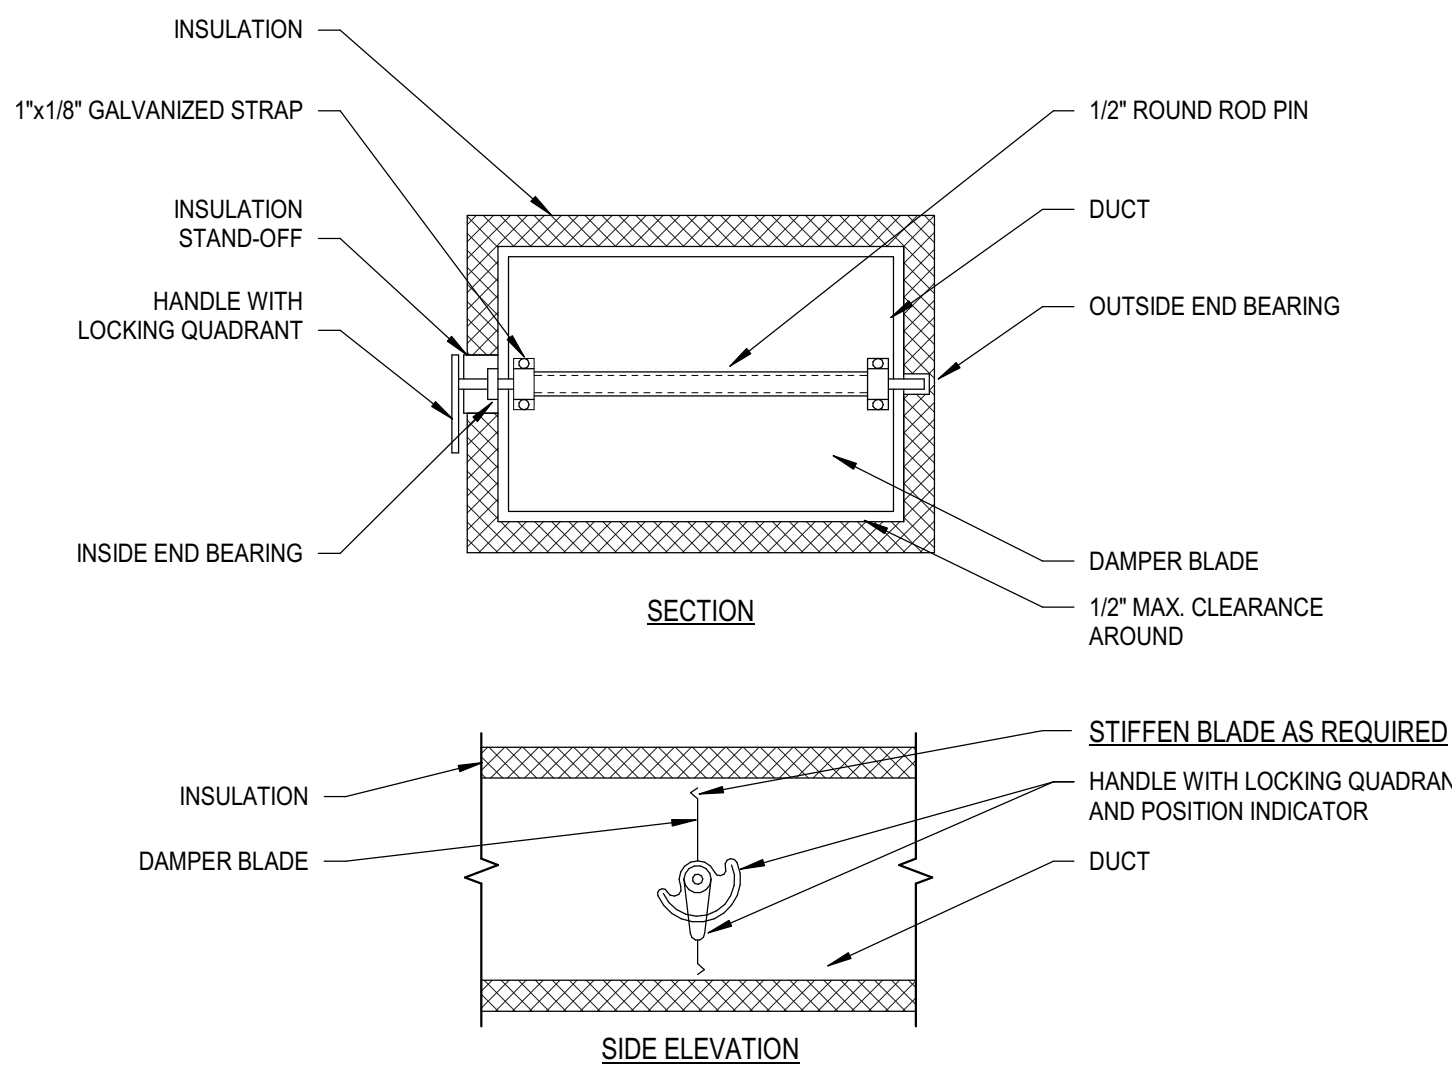


1. DELETE INSULATION STAND-OFF ON DUCTWORK WITHOUT EXTERIOR INSULATION.
2. DETAIL SHOWS SINGLE BLADE DAMPER. MULTI-BLADE DAMPERS INSTALLATIONS SHALL BE SIMILAR.
3. LOCK DAMPER DURING AIR BALANCE AND MARK QUADRANT TO RECORD AIR BALANCED DAMPER POSITION.
4. PROVIDE "HAT" SECTION AT QUADRANT FOR ALL EXTERNALLY INSULATED DUCTWORK.
5. PROVIDE FLUORESCENT COLORED MARKERS ON CEILING AT ALL VOLUME DAMPER LOCATIONS.

7 ROUND VOLUME DAMPER (LARGER THAN 14" DIA.)  
M7.1 NO SCALE

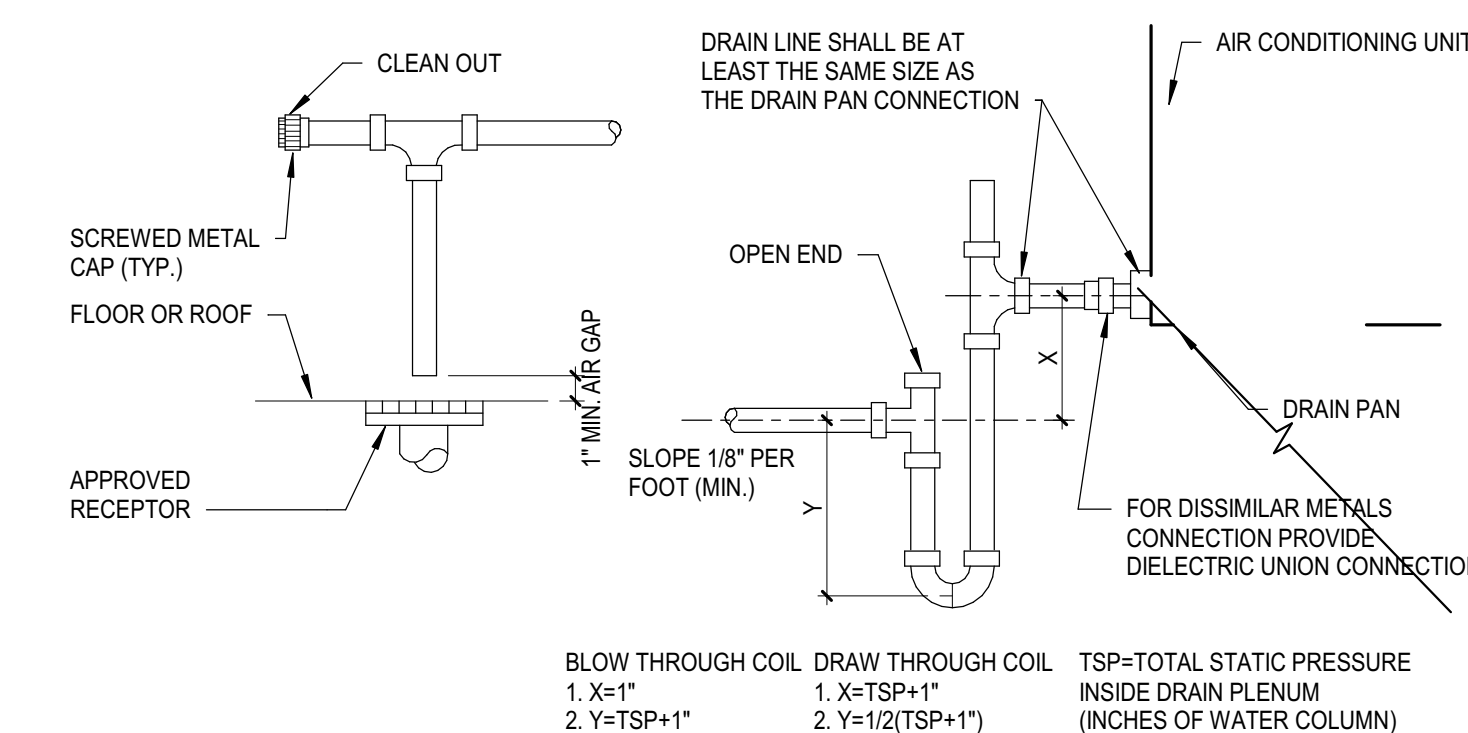


- NOTES:
1. WHERE VERTICAL SPACE DOES NOT PERMIT TRAP INSTALLATION AS REQUIRED ABOVE FLOOR SLAB, EXTEND P-TRAP TO BELOW SLAB.
  2. FOR INDOOR AND OUTDOOR INSTALLATION PROVIDE INSULATED RAIN LINE TO THE POINT OF DISCHARGE AT APPROVED RECEPTOR.

11 CONDENSATE DRAIN CONNECTION DETAIL  
M7.1 NO SCALE

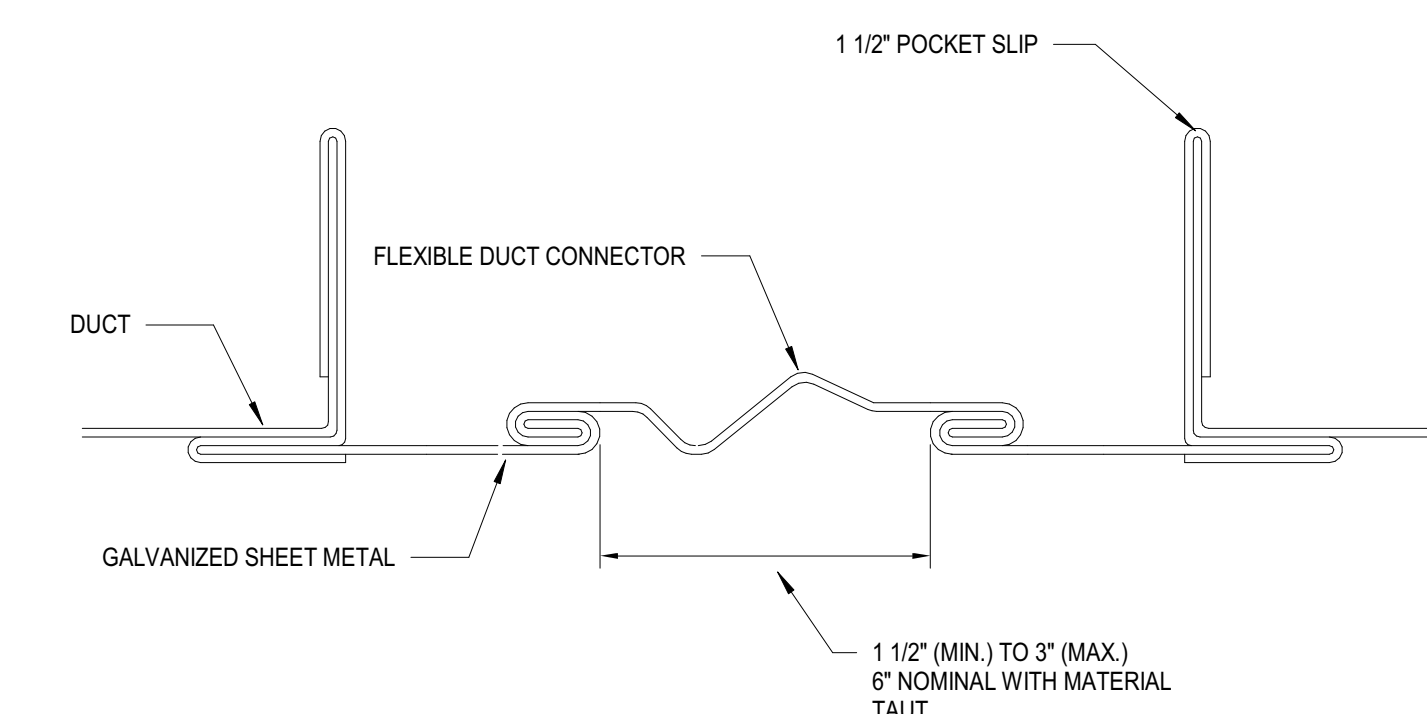


8 FLEXIBLE DUCT CONNECTION  
M7.1 NO SCALE

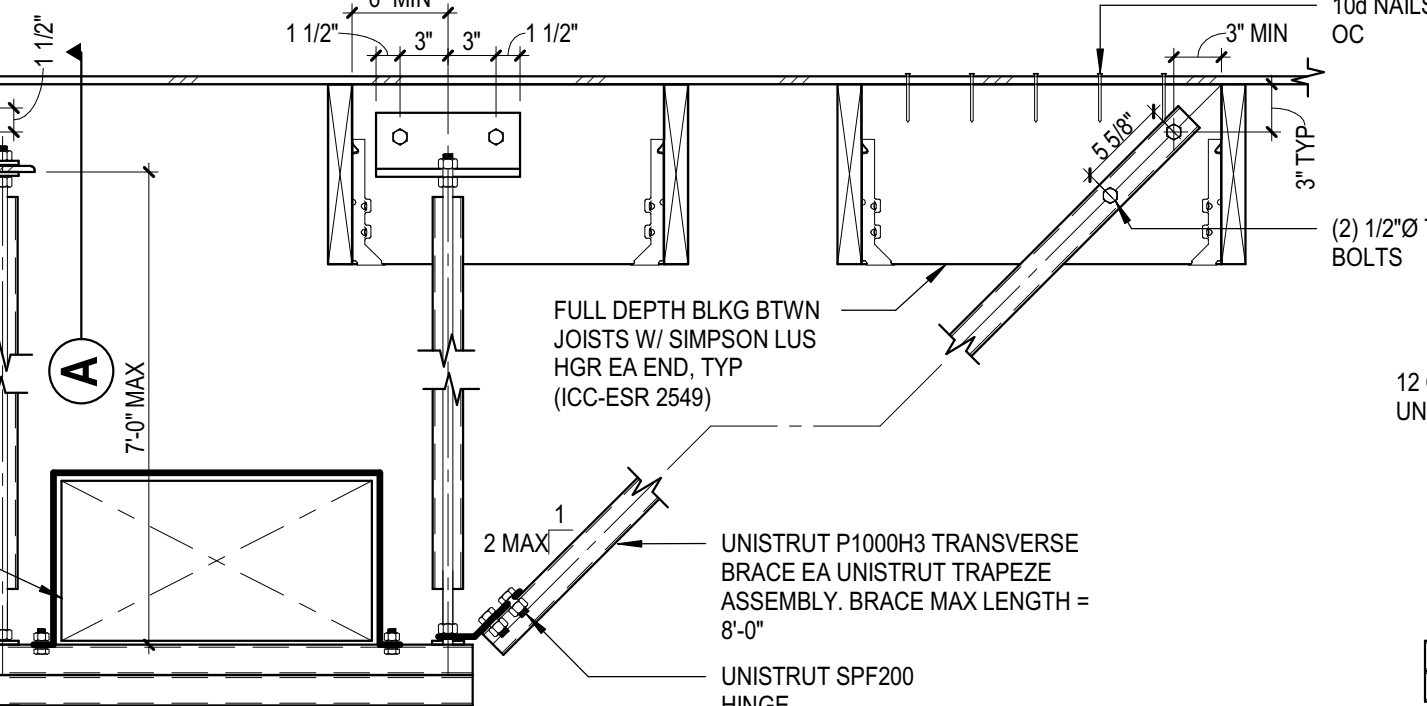

NOTE: SEE DETAIL B.1 FOR INFORMATION NOT SHOWN

Autodesk Docs/175-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD - Workman ES MEP\_2022.rvt  
1/02/2022 5:03:07 PM


1

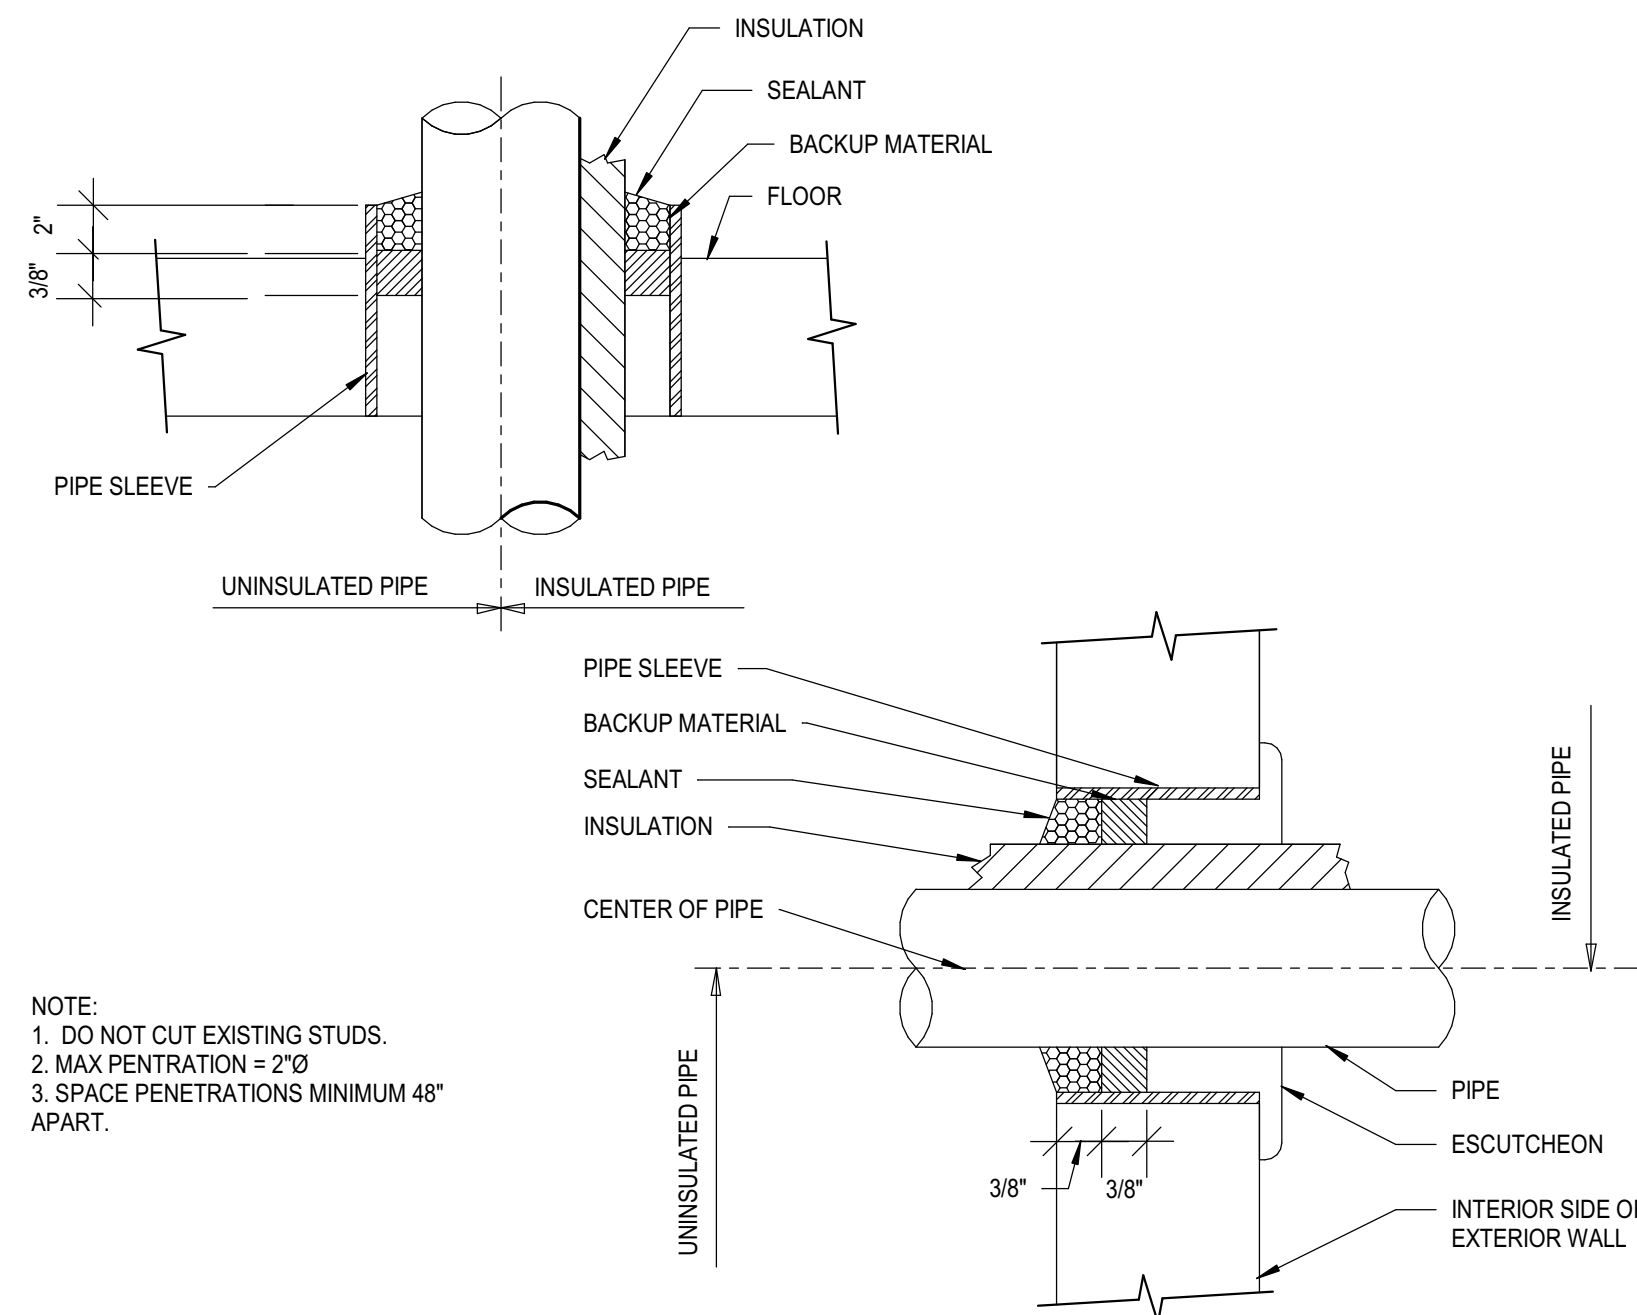

- NOTE:
1. DO NOT CUT EXISTING STUDS.
  2. MAX PENETRATION = 2"Ø
  3. SPACE PENETRATIONS MINIMUM 48" APART.

1  
M7.2 PIPE PENETRATION DETAILS  
1 1/2" = 1'-0"


2

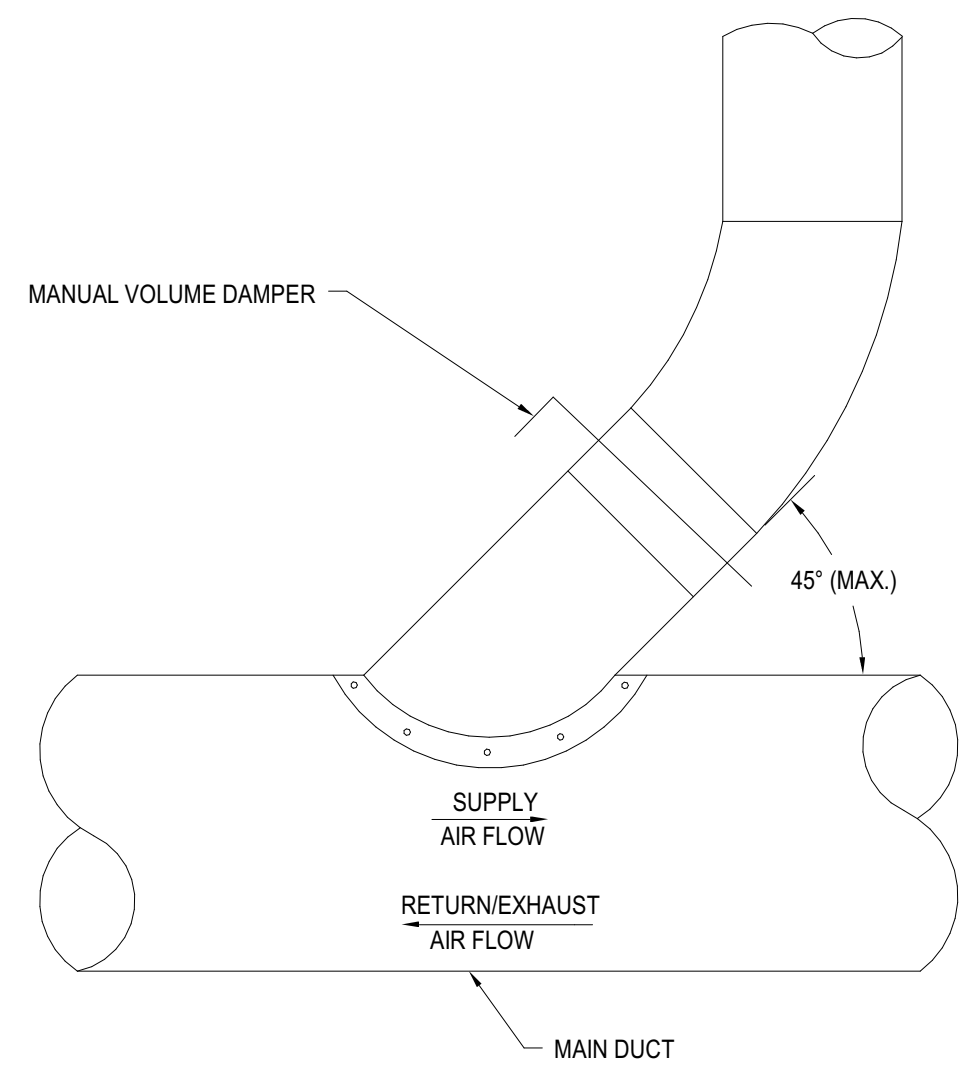

- NOTES:
1. FURNISH LATERAL TEE CONNECTION FOR BRANCHES WHEN SINGLE LINE DUCTWORK IS INDICATED AS THIS: [Symbol].
  2. FOR MANUAL VOLUME DAMPER SEE DETAIL 24M5.2.

5  
M7.2 ROUND DUCT BRANCH TO ROUND MAIN CONNECTION  
12" = 1'-0"

4

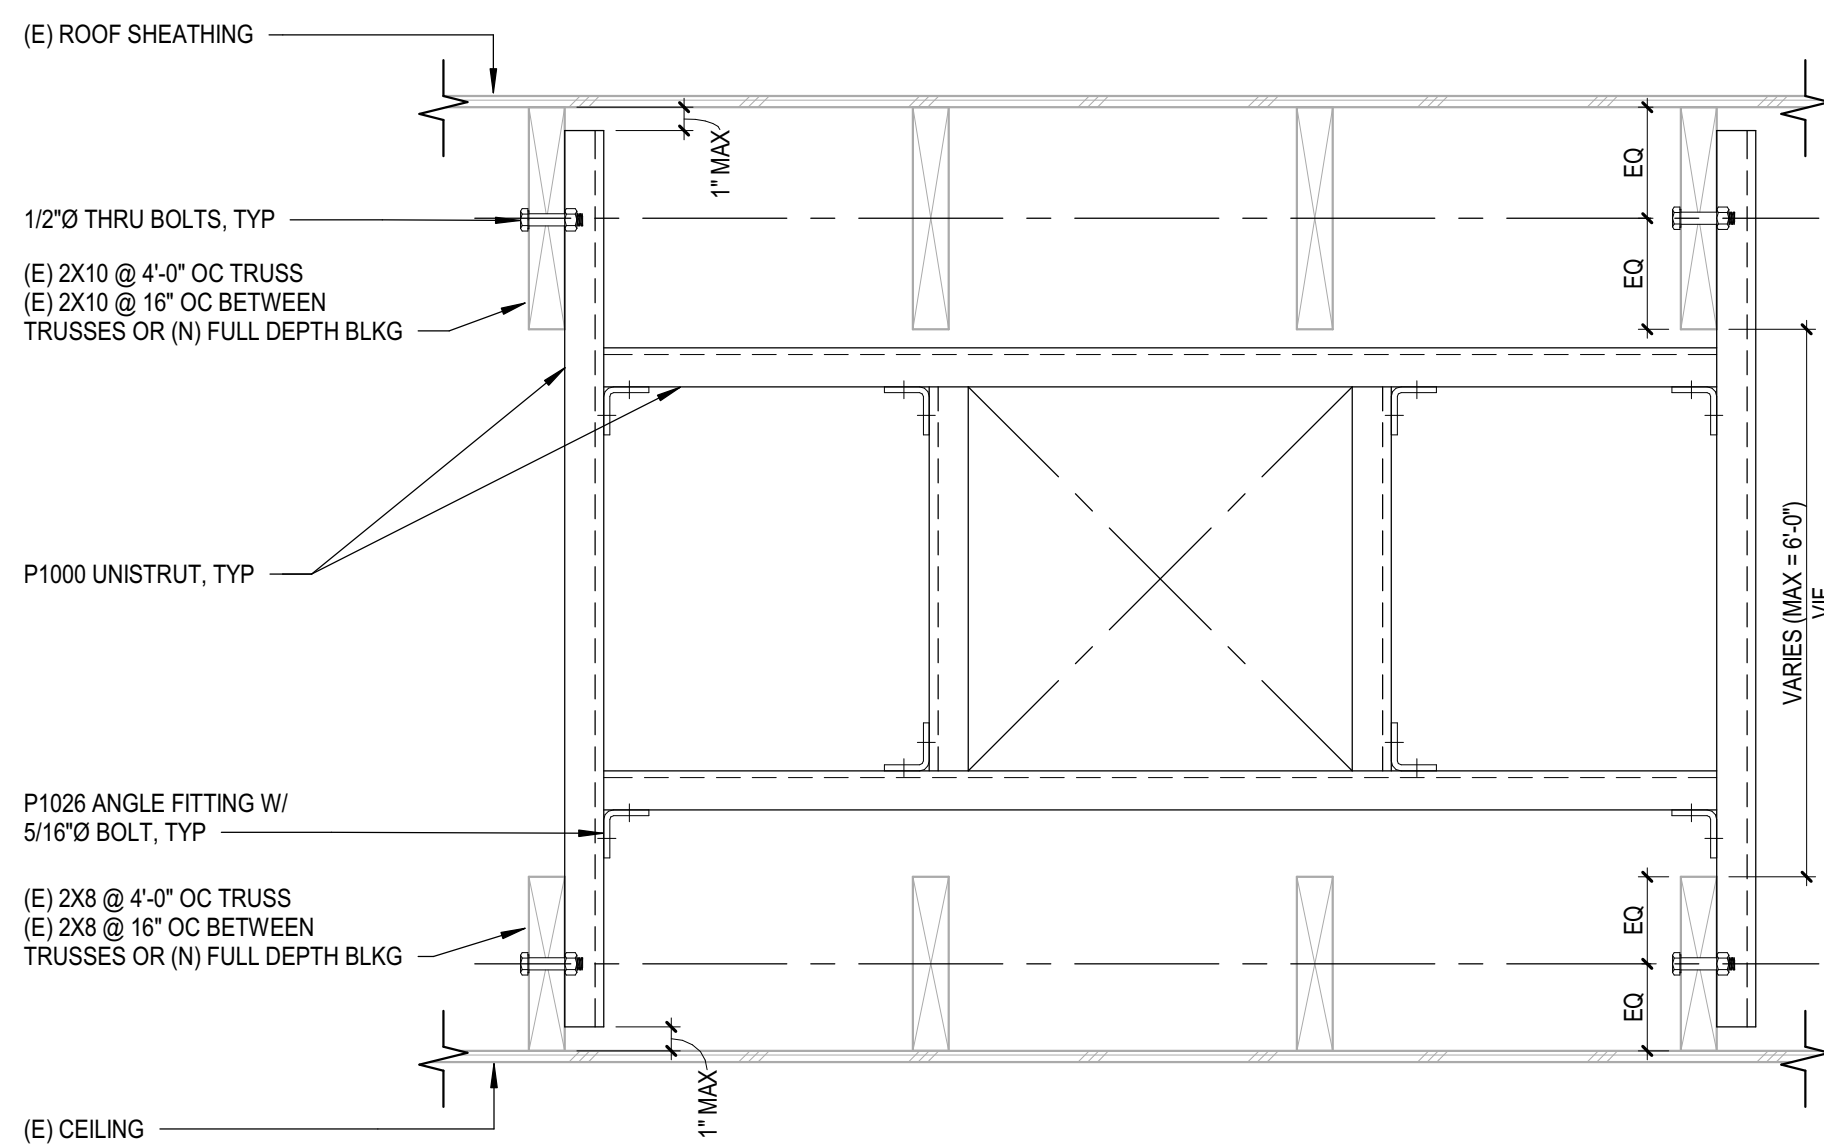


9  
M7.2 DUCT SUPPORT IN CEILING SPACE  
NO SCALE

5

NOTES:

1. FURNISH THIS TYPE OF CONNECTION WHEN SINGLE-LINE DUCTWORK IS INDICATED AS THIS: [Symbol]. FOR BRANCHES WITH LESS THAN 25% OF THE TOTAL AIR FLOW, OR WHERE INDICATED ON DRAWINGS.
2. FOR MANUAL VOLUME DAMPER SEE DETAIL 22M5.1.
3. SLIP-IN VOLUME DAMPER HOUSING WILL NOT BE ALLOWED.

2  
M7.2 RECTANGULAR DUCT BRANCH TO RECTANGULAR DUCT  
NO SCALE

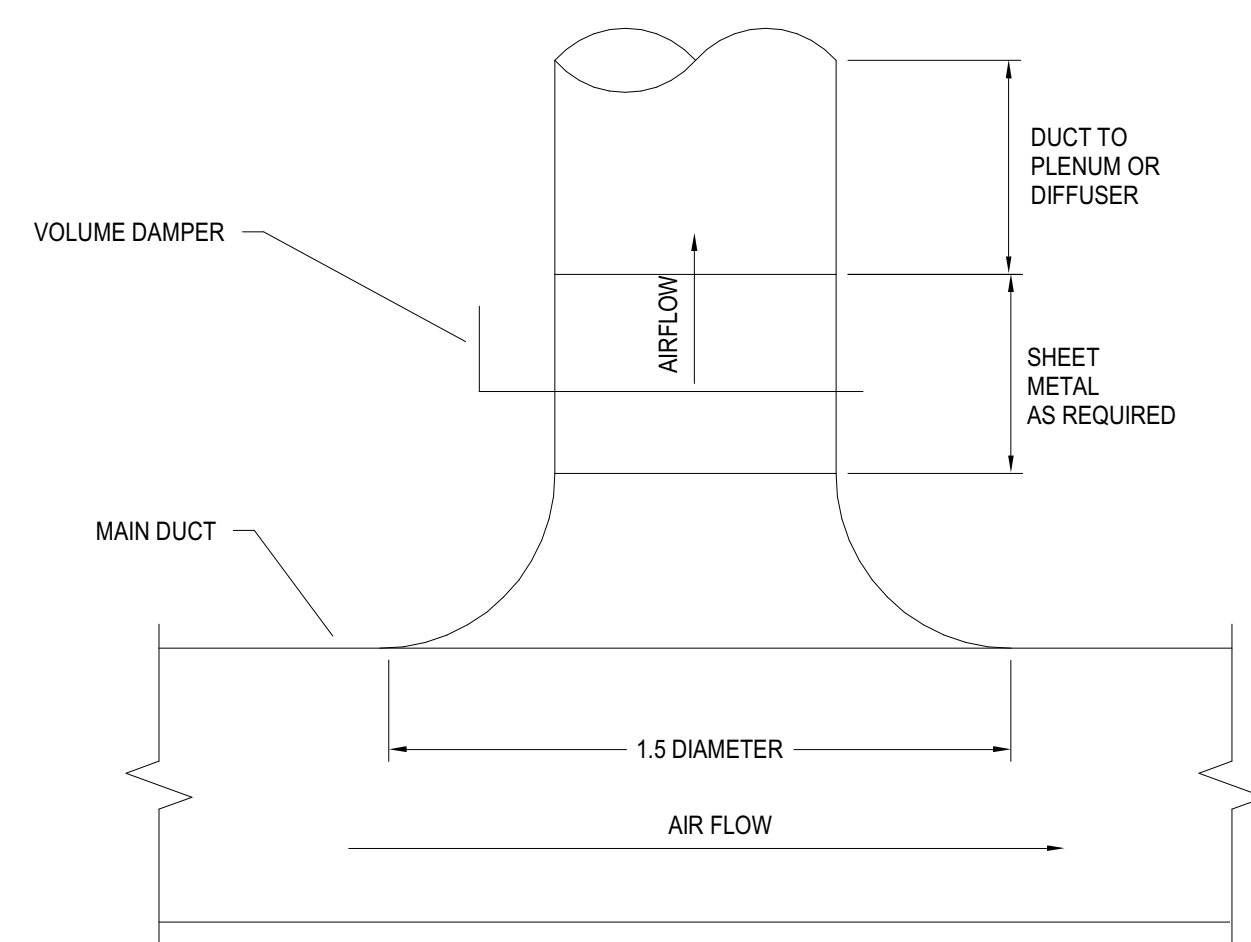


NOTES:

1. FURNISH THIS TYPE CONNECTION WHEN SINGLE-LINE DUCTWORK IS INDICATED AS THIS: [Symbol]. FOR BRANCHES WITH MORE THAN 25% OF TOTAL AIR FLOW


6  
M7.2 ROUND SUPPLY DUCT BRANCH TO RECTANGULAR DUCT  
NO SCALE

6

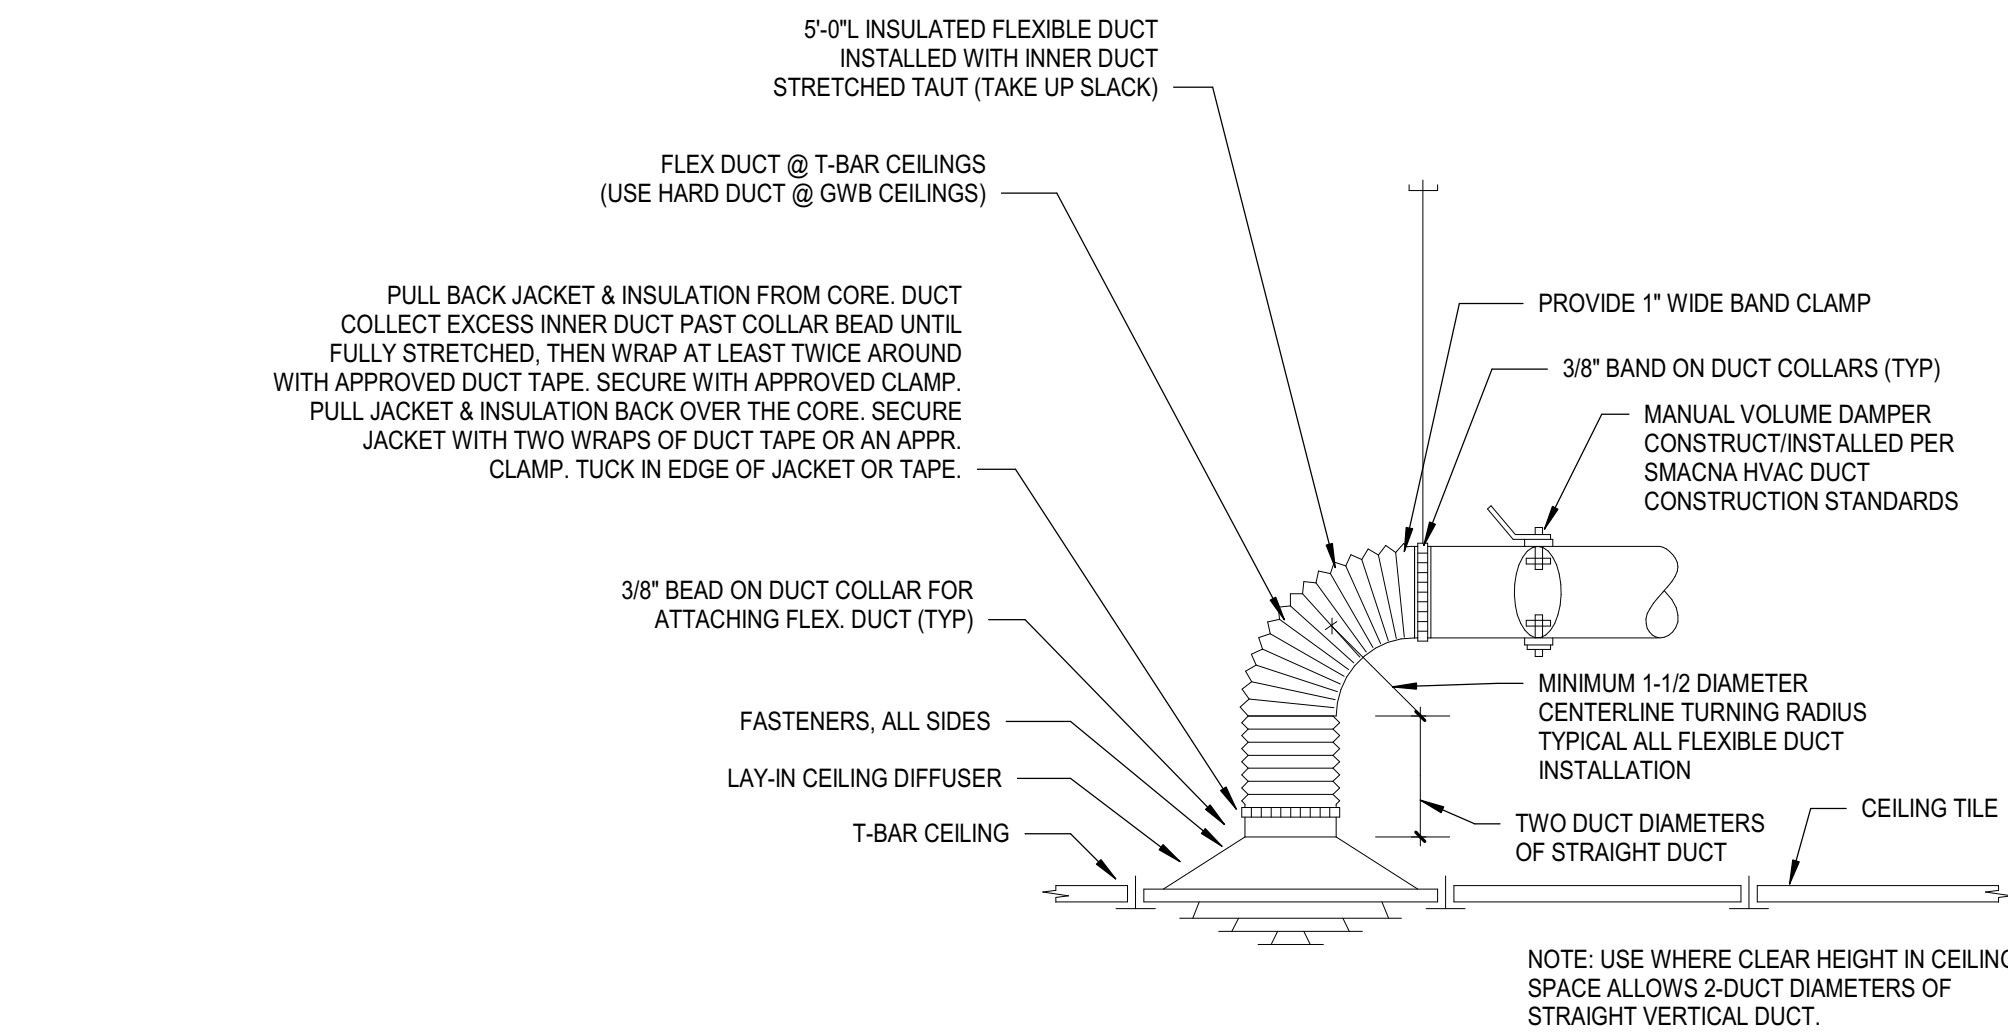

10  
M7.2 CEILING SUPPLY DIFFUSER CONNECTION DETAIL  
NO SCALE

10

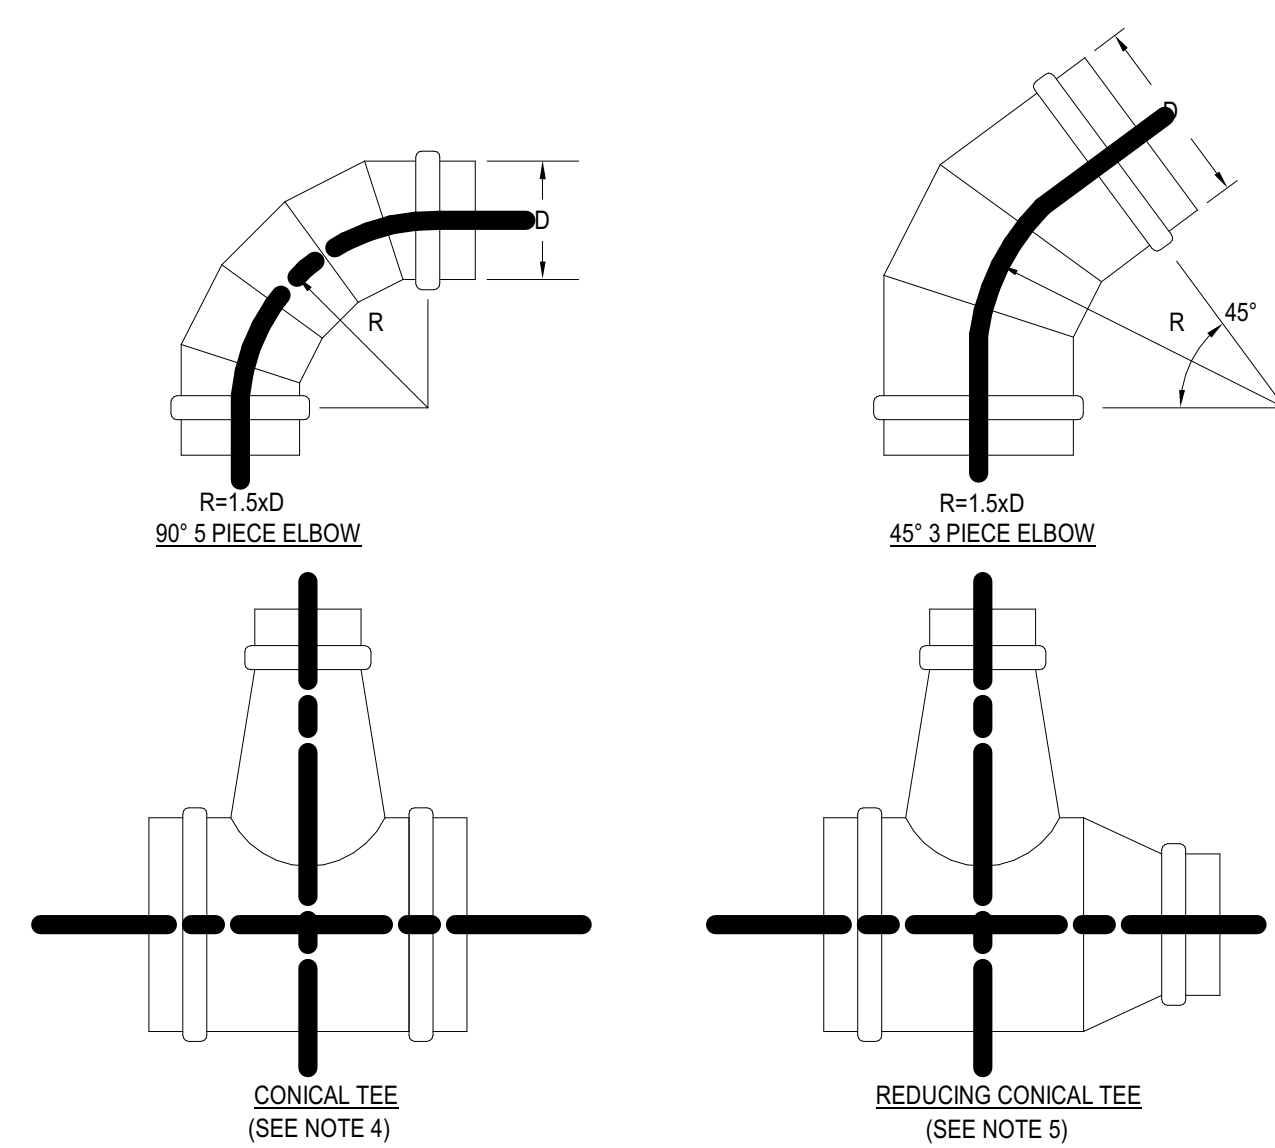


NOTES:

1. FITTINGS TO BE 2 GAGES HEAVIER THAN CONNECTED DUCT.
2. ADJUSTABLE ELBOWS WILL BE PERMITTED FOR DUCT CONSTRUCTION OF 2" W.G. OR LESS.
3. PROVIDE CONTINUOUS SEALANT AT EACH FITTING JOINT.
4. PROVIDE THIS TYPE OF CONNECTION FOR BRANCHES WHEN SINGLE LINE DUCTWORK IS INDICATED AS THIS: [Symbol].
5. PROVIDE THIS TYPE OF CONNECTION FOR BRANCHES WHEN SINGLE LINE DUCTWORK IS INDICATED AS THIS: [Symbol].


3  
M7.2 ROUND DUCT FITTINGS  
NO SCALE

3

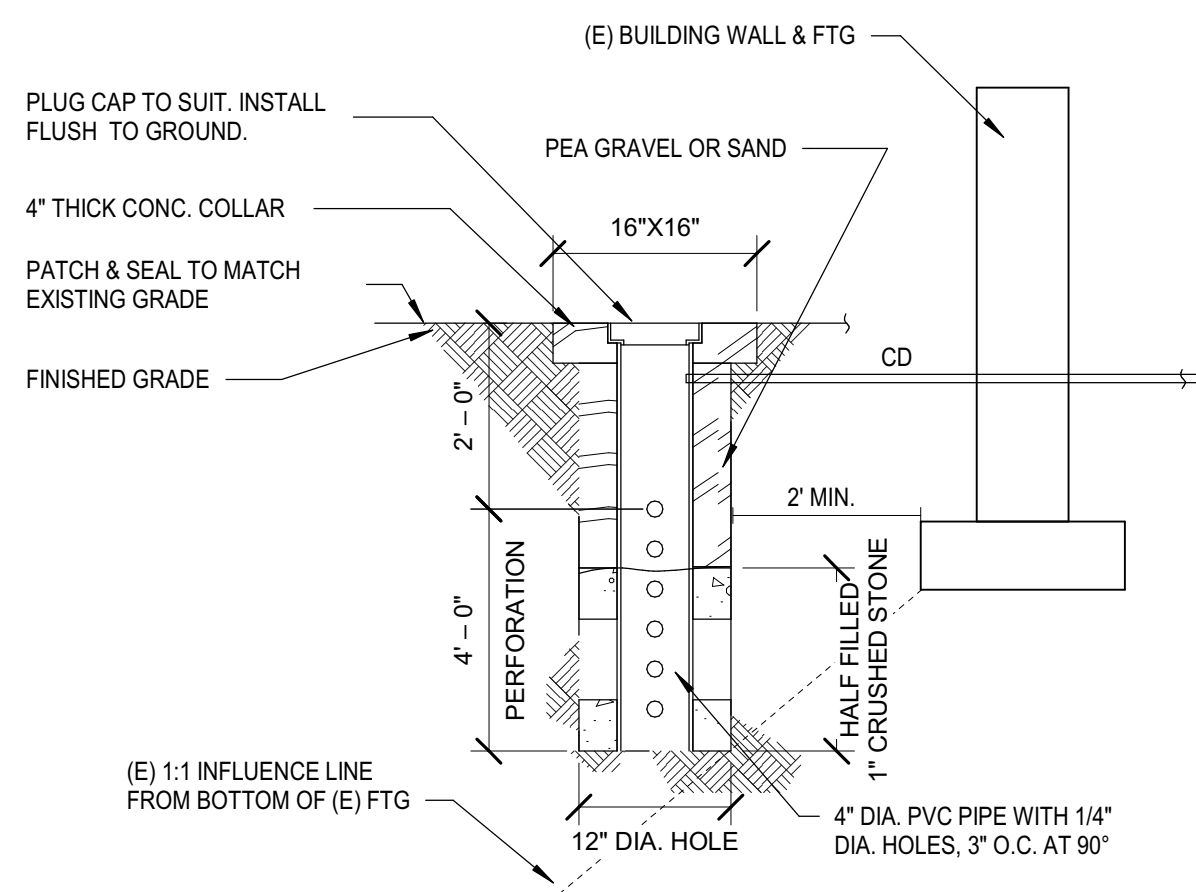

7  
M7.2 DRY WELL DETAIL  
NO SCALE

7

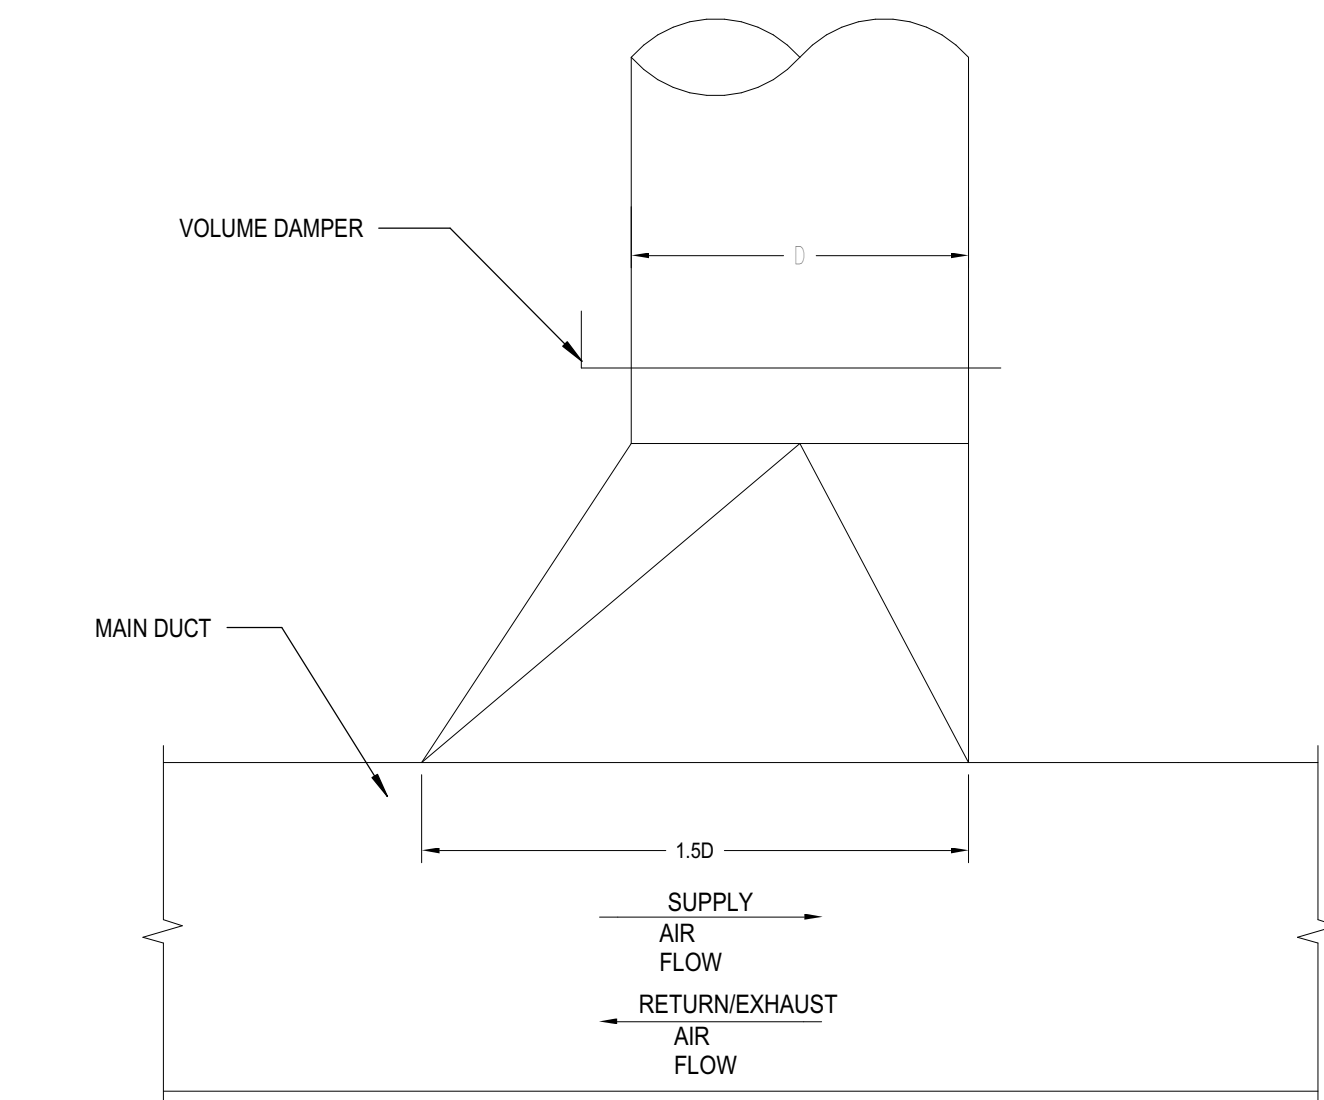


NOTES:

1. FURNISH THIS TYPE CONNECTION WHEN SINGLE-LINE DUCTWORK IS INDICATED AS THIS: [Symbol]. FOR BRANCHES WITH LESS THAN 25% OF TOTAL AIR FLOW.
2. PROVIDE FLUORESCENT COLORED MARKERS ON CEILING AT ALL MANUAL VOLUME DAMPER LOCATION.

4  
M7.2 ROUND DUCT BRANCH TO MAIN RECT. CONNECTION  
NO SCALE

4

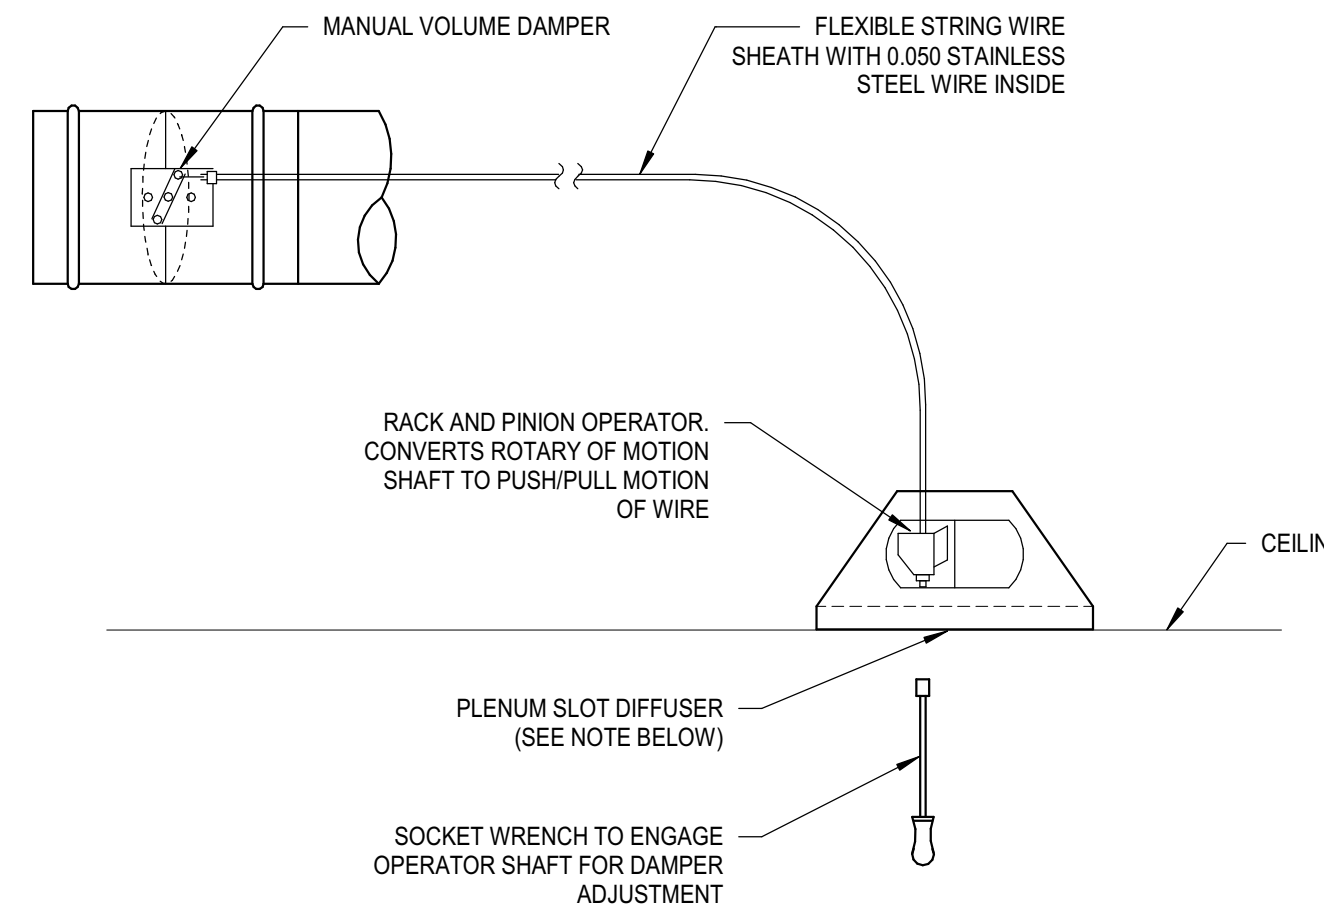


NOTES:

1. DIFFUSER OR REGISTER LOCATED IN GYP BOARD CEILING.
2. PROVIDE REGULATOR FOR ALL MANUAL VOLUME DAMPERS INSTALLED IN INACCESSIBLE CEILING OR HARD TO REACH PLACES.
3. FOR CEILING TYPE AND CONSTRUCTION, SEE ARCHITECTURAL DRAWINGS.

8  
M7.2 BOWDEN TYPE CABLE CONTROL (YOUNG'S REGULATOR)  
NO SCALE

8

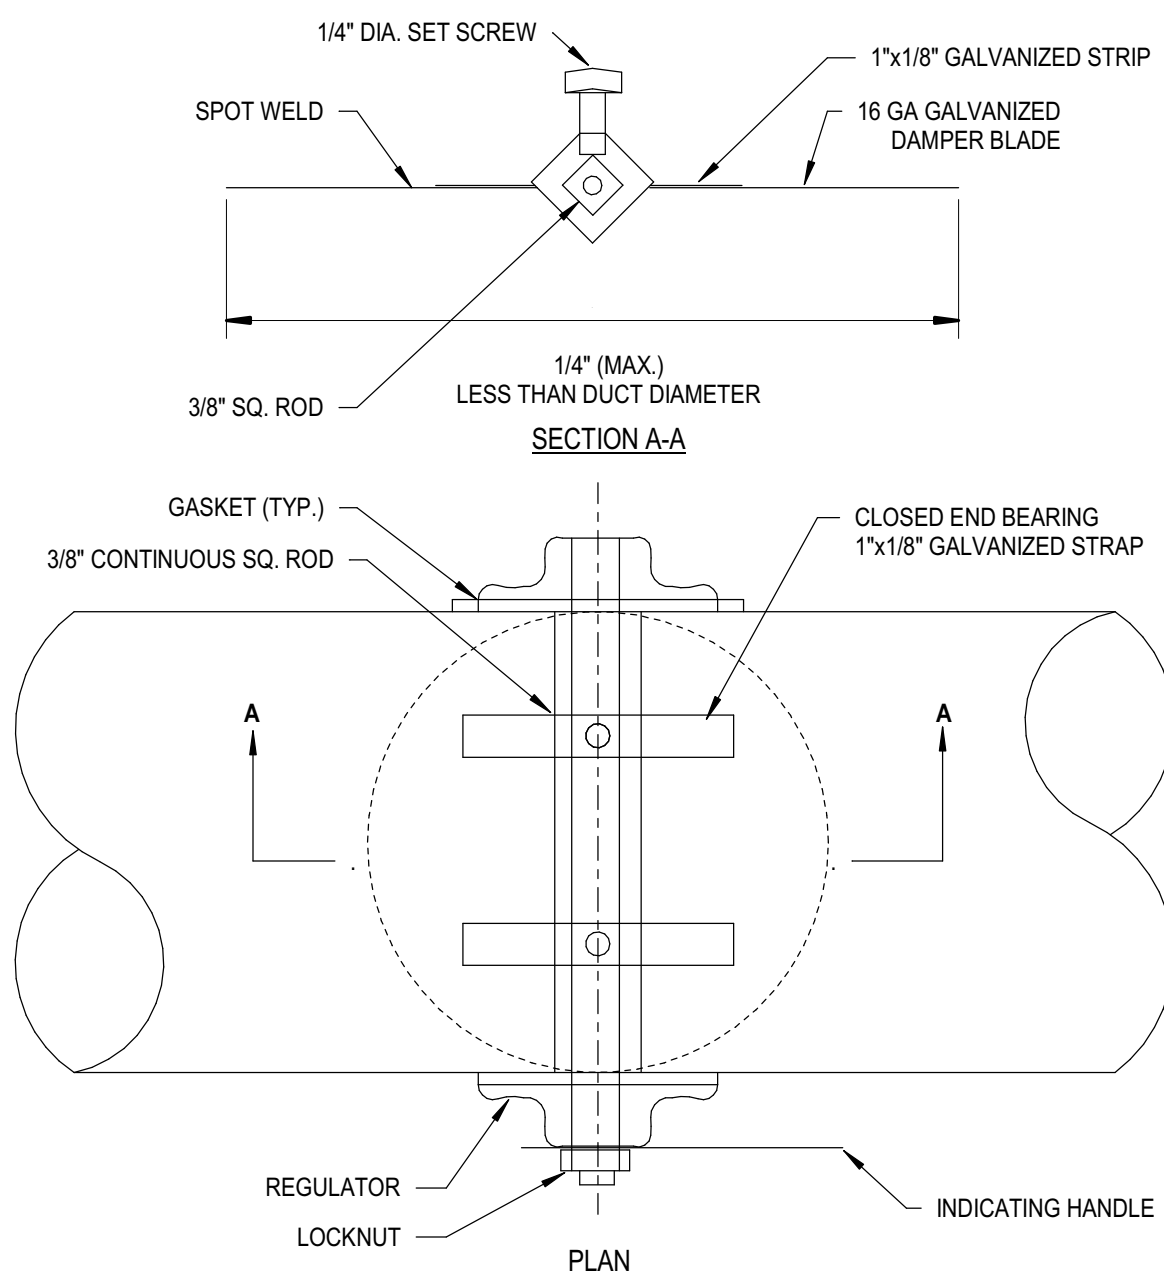

11  
M7.2 ROUND VOLUME DAMPER (UP TO 14")  
NO SCALE

11



Autodesk Docs/75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD\_Workman ES MEP\_2022.rvt  
10/21/2022 5:03:07 PM


Workman Elementary School  
COVINA VALLEY USD  
1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS


75-22605-00

MECHANICAL  
DETAILS

M7.3

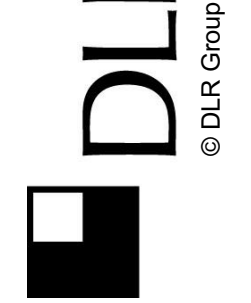

DLR Group  
© DLR Group

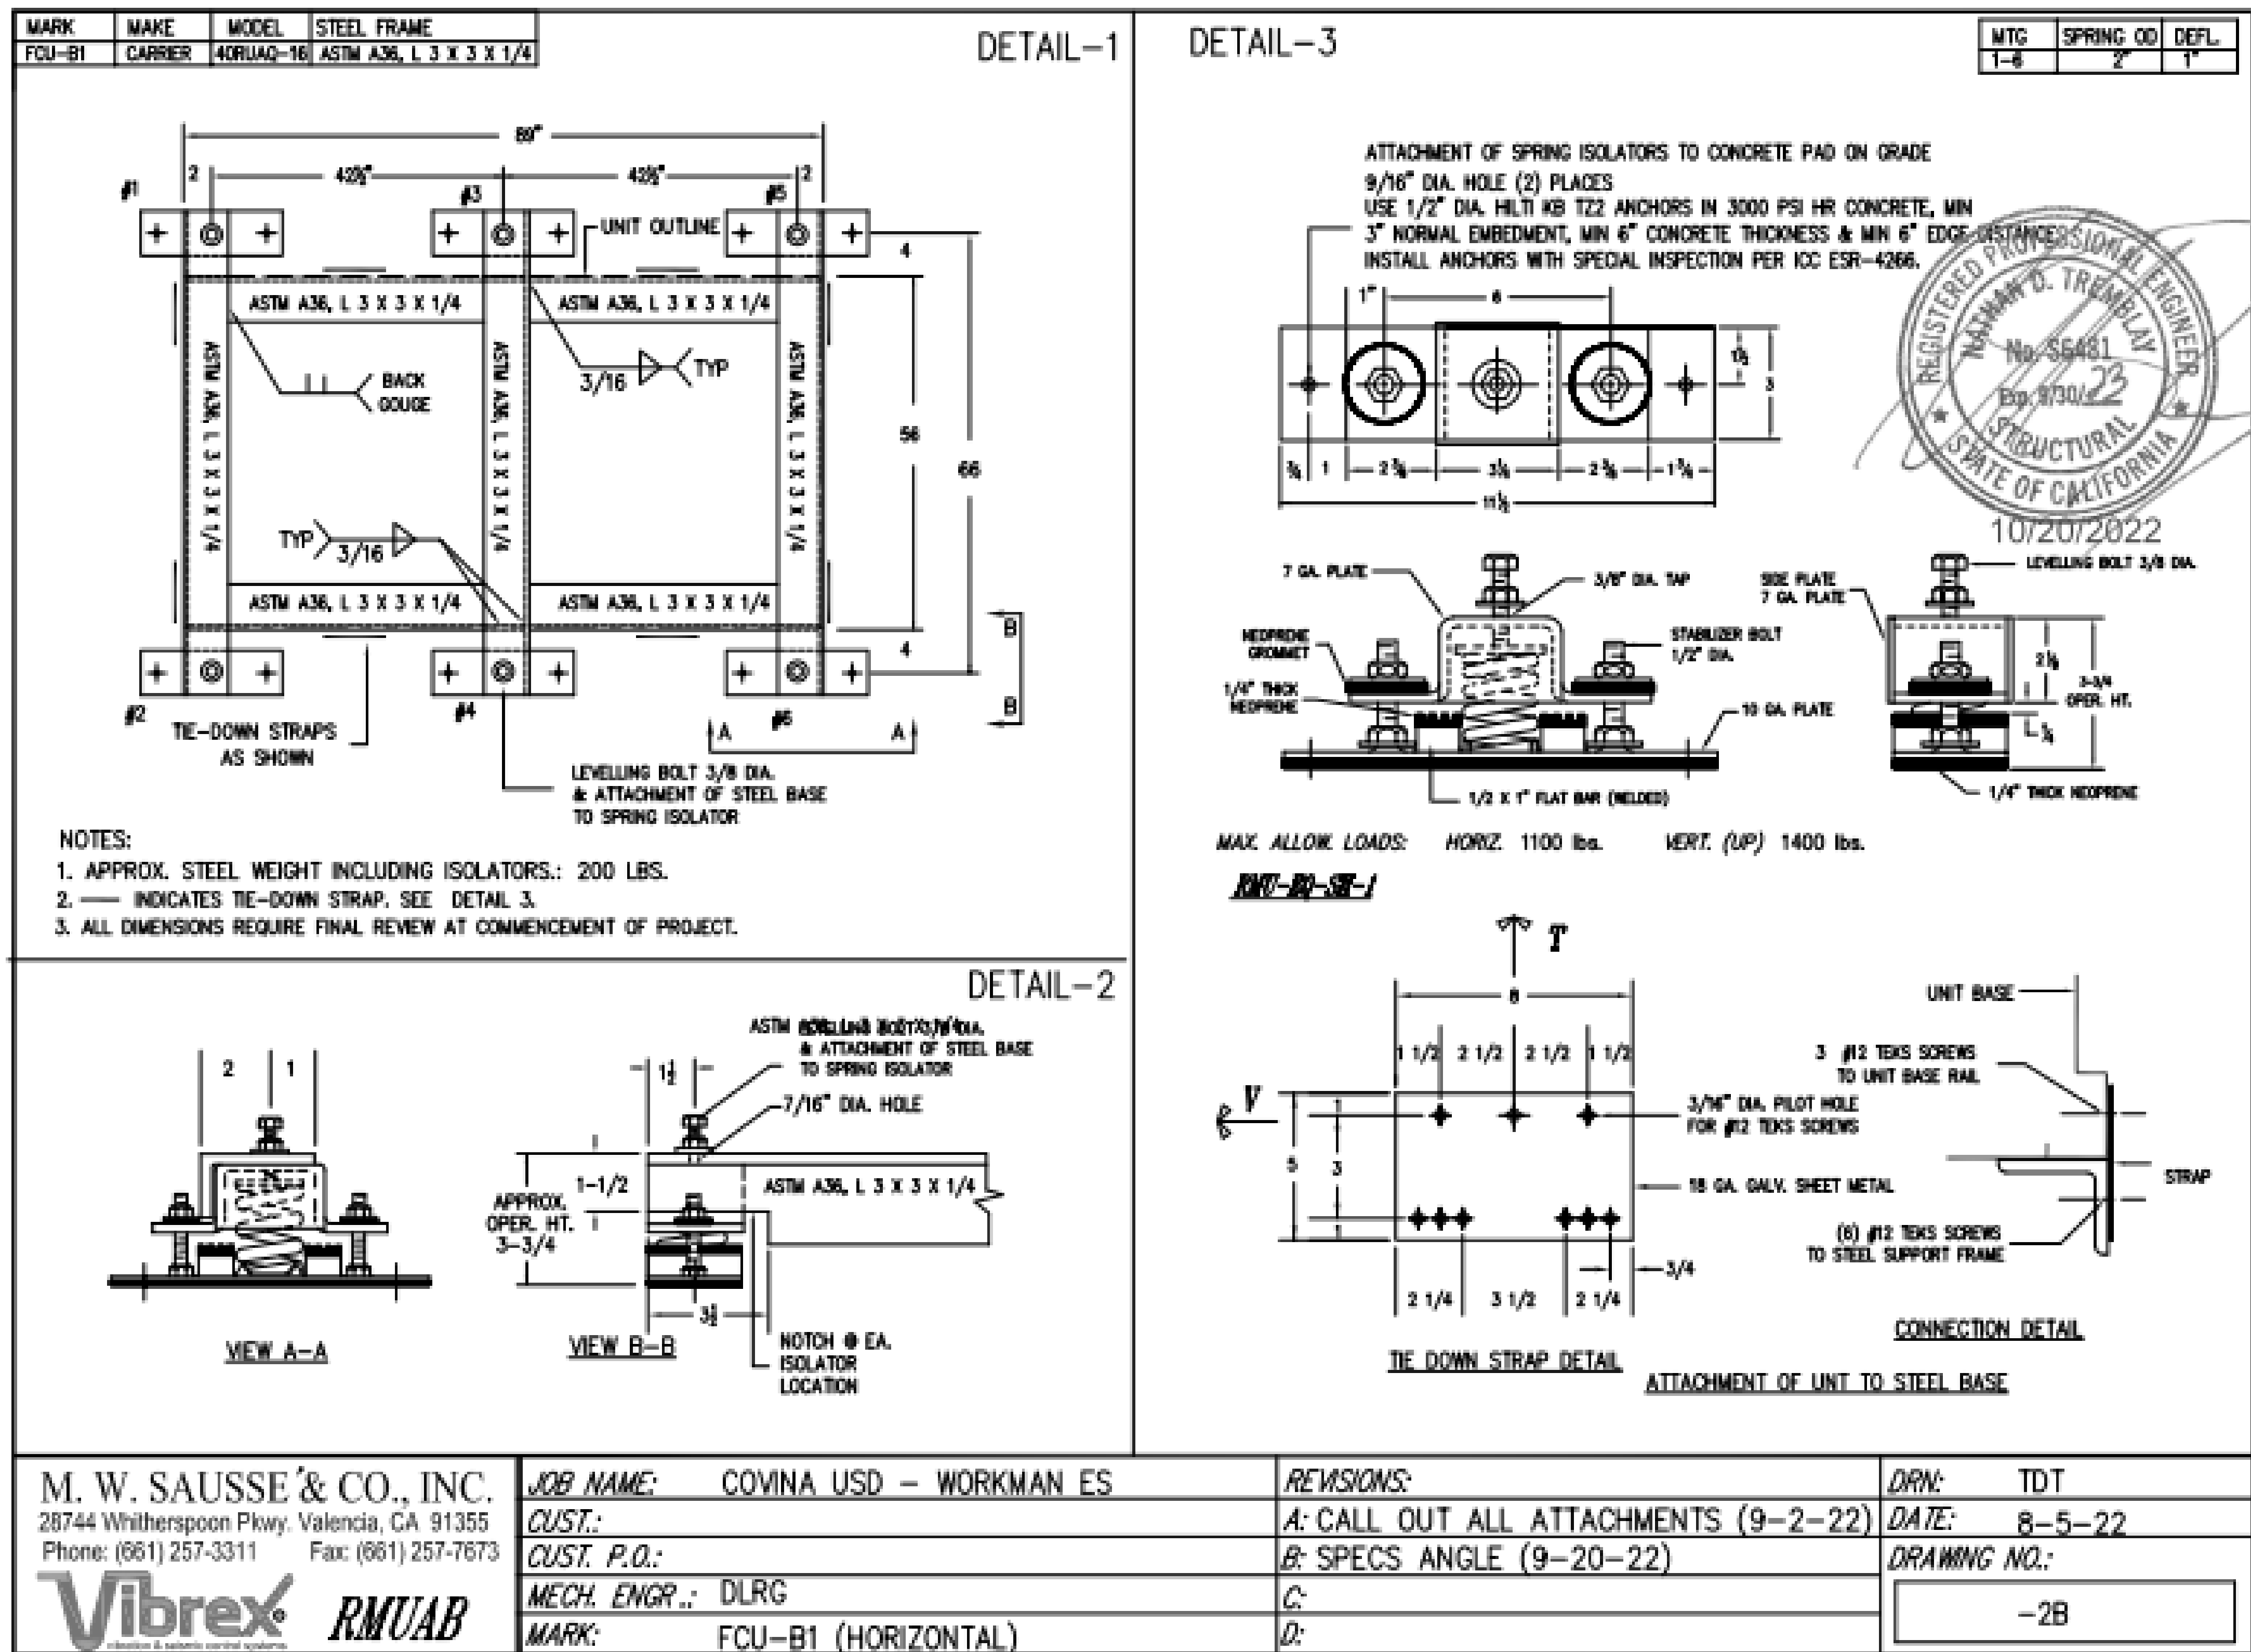

1 FCU-B1  
M7.3 NO SCALE







1

WORKMAN AVE. AC UNIT REPLACEMENT																																										
WORKMAN AVE. E.S. EXISTING UNIT														NEW UNIT																												
TAGS	MAKE	MODEL	CAPACITY (TONS)	GAS INPUT/OUTPUT (BTU/Hr)	ELECTRICAL (SINGLE CIRCUIT)			WEIGHT (LBS)	ECONOMIZER		POWER EXHAUST		OPERATING WEIGHT (LBS)	DIRECT REPLACE MENT? Y/N	CARRIER MODEL #	NET COOLING CAPACITY			AIRFLOW (CFM)		ESP (IN WG)	SEER	EER	HEATING CAPACITY (MBH)	NEW MERV RATING	FILTER QUANTITY & SIZE (W" X H" X D")	ELECTRICAL			WEIGHT LBS	OUTSIDE AIR HOOD WEIGHT (LBS)	ECONOMIZER		POWER EXHAUST				ROOF CURB WEIGHT (LBS)	TOTAL WEIGHT (LBS)	UNIT DIMENSIONS (L" X W" X H")	ANCHORAGE DETAIL REFERENCE	
					V/PH	MCA	FLA		EXISTING	WEIGHT	EXISTING	WEIGHT				NOMINAL TON	TOTAL (BTU/H)	SENSIBLE (BTU/H)	SUPPLY	MIN OSA							V-PH	MCA	MOCp			REQUIRED ?	WEIGHT	REQUIRED ?	MODEL #	MCA	MOCp					WEIGHT
RTU-C1 & RTU-C2 (BDLG. C)	SANYO	CH3622 (36THS22)	3.0	36000	240/1	50	18.3	218	-	-	NO	-	218	Y	50FCQA04A2A3	3	35000	26150	1200	250	1	14.3	11.32	34.1	13	2 (16X25X2)	240/1	26	30	469	12	NO	NA	YES	PCD-SRT12CA	7.1	12.8	152	275	756	75 X 47 X 34	1/M7.5
RTU-D1 (BDLG. D)	SANYO	CH3622 (36THS22)	3.0	36000	240/1	50	18.3	218	-	-	NO	-	218	Y	50FCQA04A2A3	3	35000	26150	1200	250	1	14.3	11.32	34.1	13	2 (16X25X2)	240/1	26	30	469	12	NO	NA	YES	PCD-SRT12CA	7.1	12.8	152	275	756	75 X 47 X 34	1/M7.5
RTU-J1 THRU RTU-J3 (BDLG. J)	SANYO	CH3622 (36THS22)	3.0	36000	240/1	50	18.3	218	-	-	NO	-	218	Y	50FCQA04A2A3	3	35000	26150	1200	250	1	14.3	11.32	34.1	13	2 (16X25X2)	240/1	26	30	469	12	NO	NA	YES	PCD-SRT12CA	7.1	12.8	152	275	756	75 X 47 X 34	1/M7.5
RTU-K1 THRU RTU-K3 (BDLG. K)	SANYO	CH3622 (36THS22)	3.0	36000	240/1	50	18.3	218	-	-	NO	-	218	Y	50FCQA04A2A3	3	35000	26150	1200	250	1	14.3	11.32	34.1	13	2 (16X25X2)	240/1	26	30	469	12	NO	NA	YES	PCD-SRT12CA	7.1	12.8	152	275	756	75 X 47 X 34	1/M7.5
RTU-E1 THRU RTU-E3 (BDLG. E)	SANYO	CH3622 (36THS22)	3.0	36000	240/1	50	18.3	218	-	-	NO	-	218	Y	50FCQA04A2A3	3	35000	26150	1200	250	1	14.3	11.32	34.1	13	2 (16X25X2)	240/1	26	30	469	12	NO	NA	YES	PCD-SRT12CA	7.1	12.8	152	275	756	75 X 47 X 34	1/M7.5
RTU-G1 THRU RTU-G3 (BDLG. G)	SANYO	CH3622 (36THS22)	3.0	36000	240/1	50	18.3	218	-	-	NO	-	218	Y	50FCQA04A2A3	3	35000	26150	1200	250	1	14.3	11.32	34.1	13	2 (16X25X2)	240/1	26	30	469	12	NO	NA	YES	PCD-SRT12CA	7.1	12.8	152	275	756	75 X 47 X 34	1/M7.5
RTU-H1 THRU RTU-H3 (BDLG. H)	SANYO	CH3622 (36THS22)	3.0	36000	240/1	50	18.3	218	-	-	NO	-	218	Y	50FCQA04A2A3	3	35000	26150	1200	250	1	14.3	11.32	34.1	13	2 (16X25X2)	240/1	26	30	469	12	NO	NA	YES	PCD-SRT12CA	7.1	12.8	152	275	756	75 X 47 X 34	1/M7.5
RTU-I1 THRU RTU-I3 (BDLG. I)	SANYO	CH3622 (36THS22)	3.0	36000	240/1	50	18.3	218	-	-	NO	-	218	Y	50FCQA04A2A3	3	35000	26150	1200	250	1	14.3	11.32	34.1	13	2 (16X25X2)	240/1	26	30	469	12	NO	NA	YES	PCD-SRT12CA	7.1	12.8	152	275	756	75 X 47 X 34	1/M7.5
CU-B1 (BLDG. B)	N/A														MMY-AP240S8HT6P-JUL	20						22.7	11.95				460/3	23+23	30+30	1368		NO	NA	NO	NA	NA	NA		1368	104x31x73	1/M7.4	
FCU-B1 (BLDG. B)	N/A														40RUGA25T3A6-0A0A0		234500	166000	7440	2000	1.2			234.5	13	4 (16X20X2)...	460/3	19	30	720		NO	NA	NO	NA	NA	NA		720	89 X 29 X 57	1/M7.3	

NOTES:

1. PROVIDE MECHANICAL UNIT WITH INTEGRAL CONVENIENCE RECEPTACLE.
2. ALL ROOFTOP UNITS SHALL BE PROVIDED WITH UNPOWERED CONVENIENCE OUTLET.
3. ALL ROOFTOP UNITS ARE HORIZONTALLY DISCHARGED CONFIGURATION, UNO. FIELD VERIFY PRIOR TO ORDERING.
4. PROVIDE HINGED ACCESS PANEL FOR ALL ROOFTOP UNITS.
5. FINAL WEIGHT (LBS) IS SUMMATION OF RTU WEIGHT AND OUTSIDE AIR HOOD, AS APPLICABLE.
6. SCCR RATING OF RTUS SHALL BE MINIMUM OF 10KA FOR CLASSROOM RTUs AND MPR FCU-B1, AND 25 KA FOR MPR CU-B1.

2

DIFFUSER AND GRILLE SCHEDULE							
MARK NO.	MANUFACTURER & MODEL NO.	TYPE	OVERALL DIMENSIONS	NECK SIZE	CFM RANGE	MAX NC	MAX SP
CD-1	TITUS PAS	CEILING SUPPLY	24"x24"	6"Ø	0 - 110	25	0.1
				8"Ø	111 - 190	25	0.1
				10"Ø	191 - 280	25	0.1
				12"Ø	281 - 350	25	0.1
				14Ø	351 - 450	25	0.1
				16"Ø	451 - 550	25	0.1
RG-1	TITUS PAR	CEILING RETURN	24"x24"	6"Ø	0 - 100	20	0.1
				8"Ø	101 - 175	20	0.1
				10"Ø	176 - 275	20	0.1
				12"Ø	276 - 380	20	0.1
				14"Ø	381 - 500	20	0.1
				16"Ø	501 - 570	20	0.1

- NOTES:
1. OBTAIN ARCHITECT'S APPROVAL FOR COLOR AND FINISH.
  2. MATCH THE BORDER TYPE TO THE CEILING.
  3. PROVIDE FLAT BLACK INTERNAL FINISH.

3

DUCT SIZING SCHEDULE \*\*\* FOR LOW VELOCITY SUPPLY, RETURN AND EXHAUST

CFM RANGE	ROUND DUCT DIAMETER OR EQUIVALENT RECTANGULAR DUCT	CFM RANGE	ROUND DUCT DIAMETER OR EQUIVALENT RECTANGULAR DUCT
0-110	6" OR 8" X 4"	1400-1900	18" OR 24" X 12"
101-180	8" OR 10" X 6"	1900-2500	20" OR 24" X 14"
181-270	10" OR 10" X 8"	2500-3300	22" OR 32" X 14"
271-400	10" OR 12" X 8"	3300-4100	24" OR 36" X 14"
401-600	12" OR 12" X 10"	4100-5000	26" OR 40" X 16"
601-900	14" OR 16" X 10"	5000-6200	28" OR 48" X 16"
901-1400	16" OR 18" X 12"	6200-7500	30" OR 48" X 18"

REMARKS:

DUCT SIZES INDICATED ARE INSIDE DIMENSIONS WHICH MAY BE ALTERED BY CONTRACTOR TO OTHER DIMENSIONS TO AVOID INTERFERENCES AND CLEARANCE REQUIREMENTS. USE EQUAL FRICTION METHOD, 0.1"WG PER 100FT. OF DUCT TO DETERMINE DUCT SIZES.

VERIFY ALL DIMENSIONS AT THE SITE, MAKE ALL FIELD MEASUREMENTS AND SHOP DRAWINGS NECESSARY FOR FABRICATION AND ERECTION OF SHEET METAL WORK. MAKE ALLOWANCES FOR BEAMS, PIPE OR OTHER OBSTRUCTION AND FOR WORK BY OTHER TRADES AND NOTIFY THE ARCHITECT IN THE EVENT OF ANY POTENTIAL INTERFERENCE. MAKE AN INITIAL VERIFICATION OF BEAM PENETRATIONS SHOWN ON STRUCTURAL DRAWINGS AND ADVISE OF ANY POTENTIAL INTERFERENCES.

LOCATION	AIR VELOCITY GUIDELINES (FPM)					
	NOISE CRITERIA (NC)					
	40	35	30	25	20	15
MAIN SUPPLY DUCT	1700	1500	1000	800	700	600
MAIN RETURN DUCT	1200	1000	750	600	500	400
DUCT TO GRILLE SUPPLY	600	500	400	300	250	200
DUCT TO GRILLE RETURN	600	500	400	300	250	200

DUCT SIZING \*\*\* MEDIUM PRESSURE DUCTWORK

CFM	ROUND DUCT (IN)	RECTANGULAR DUCT (IN) (W IS DUCT WIDTH)				
		WX4	WX6	WX8	WX10	WX12
UP TO 150	6	8	6	X	X	X
151-280	8	10	10	8	X	X
281-500	10	X	16	12	10	X
501-800	12	X	X	16	12	X
801-1200	14	X	X	22	16	14

REMARKS:

DUCT SIZES INDICATED ARE INSIDE DIMENSIONS WHICH MAY BE ALTERED BY CONTRACTOR TO OTHER DIMENSIONS TO AVOID INTERFERENCES AND CLEARANCE REQUIREMENTS. USE EQUAL FRICTION METHOD, 0.1"WG PER 100FT. OF DUCT TO DETERMINE DUCT SIZES.


VERIFY ALL DIMENSIONS AT THE SITE, MAKE ALL FIELD MEASUREMENTS AND SHOP DRAWINGS NECESSARY FOR FABRICATION AND ERECTION OF SHEET METAL WORK. MAKE ALLOWANCES FOR BEAMS, PIPE OR OTHER OBSTRUCTION AND FOR WORK BY OTHER TRADES AND NOTIFY THE ARCHITECT IN THE EVENT OF ANY POTENTIAL INTERFERENCE. MAKE AN INITIAL VERIFICATION OF BEAM PENETRATIONS SHOWN ON STRUCTURAL DRAWINGS AND ADVISE OF ANY POTENTIAL INTERFERENCES.

4

5




Audodesk Docs/75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD - Workman ES MEP\_2022.rvt  
1/02/2022 5:03:11 PM



**MECHANICAL PLUMBING SITE PLAN**

SCALE: 1" = 30'-0"

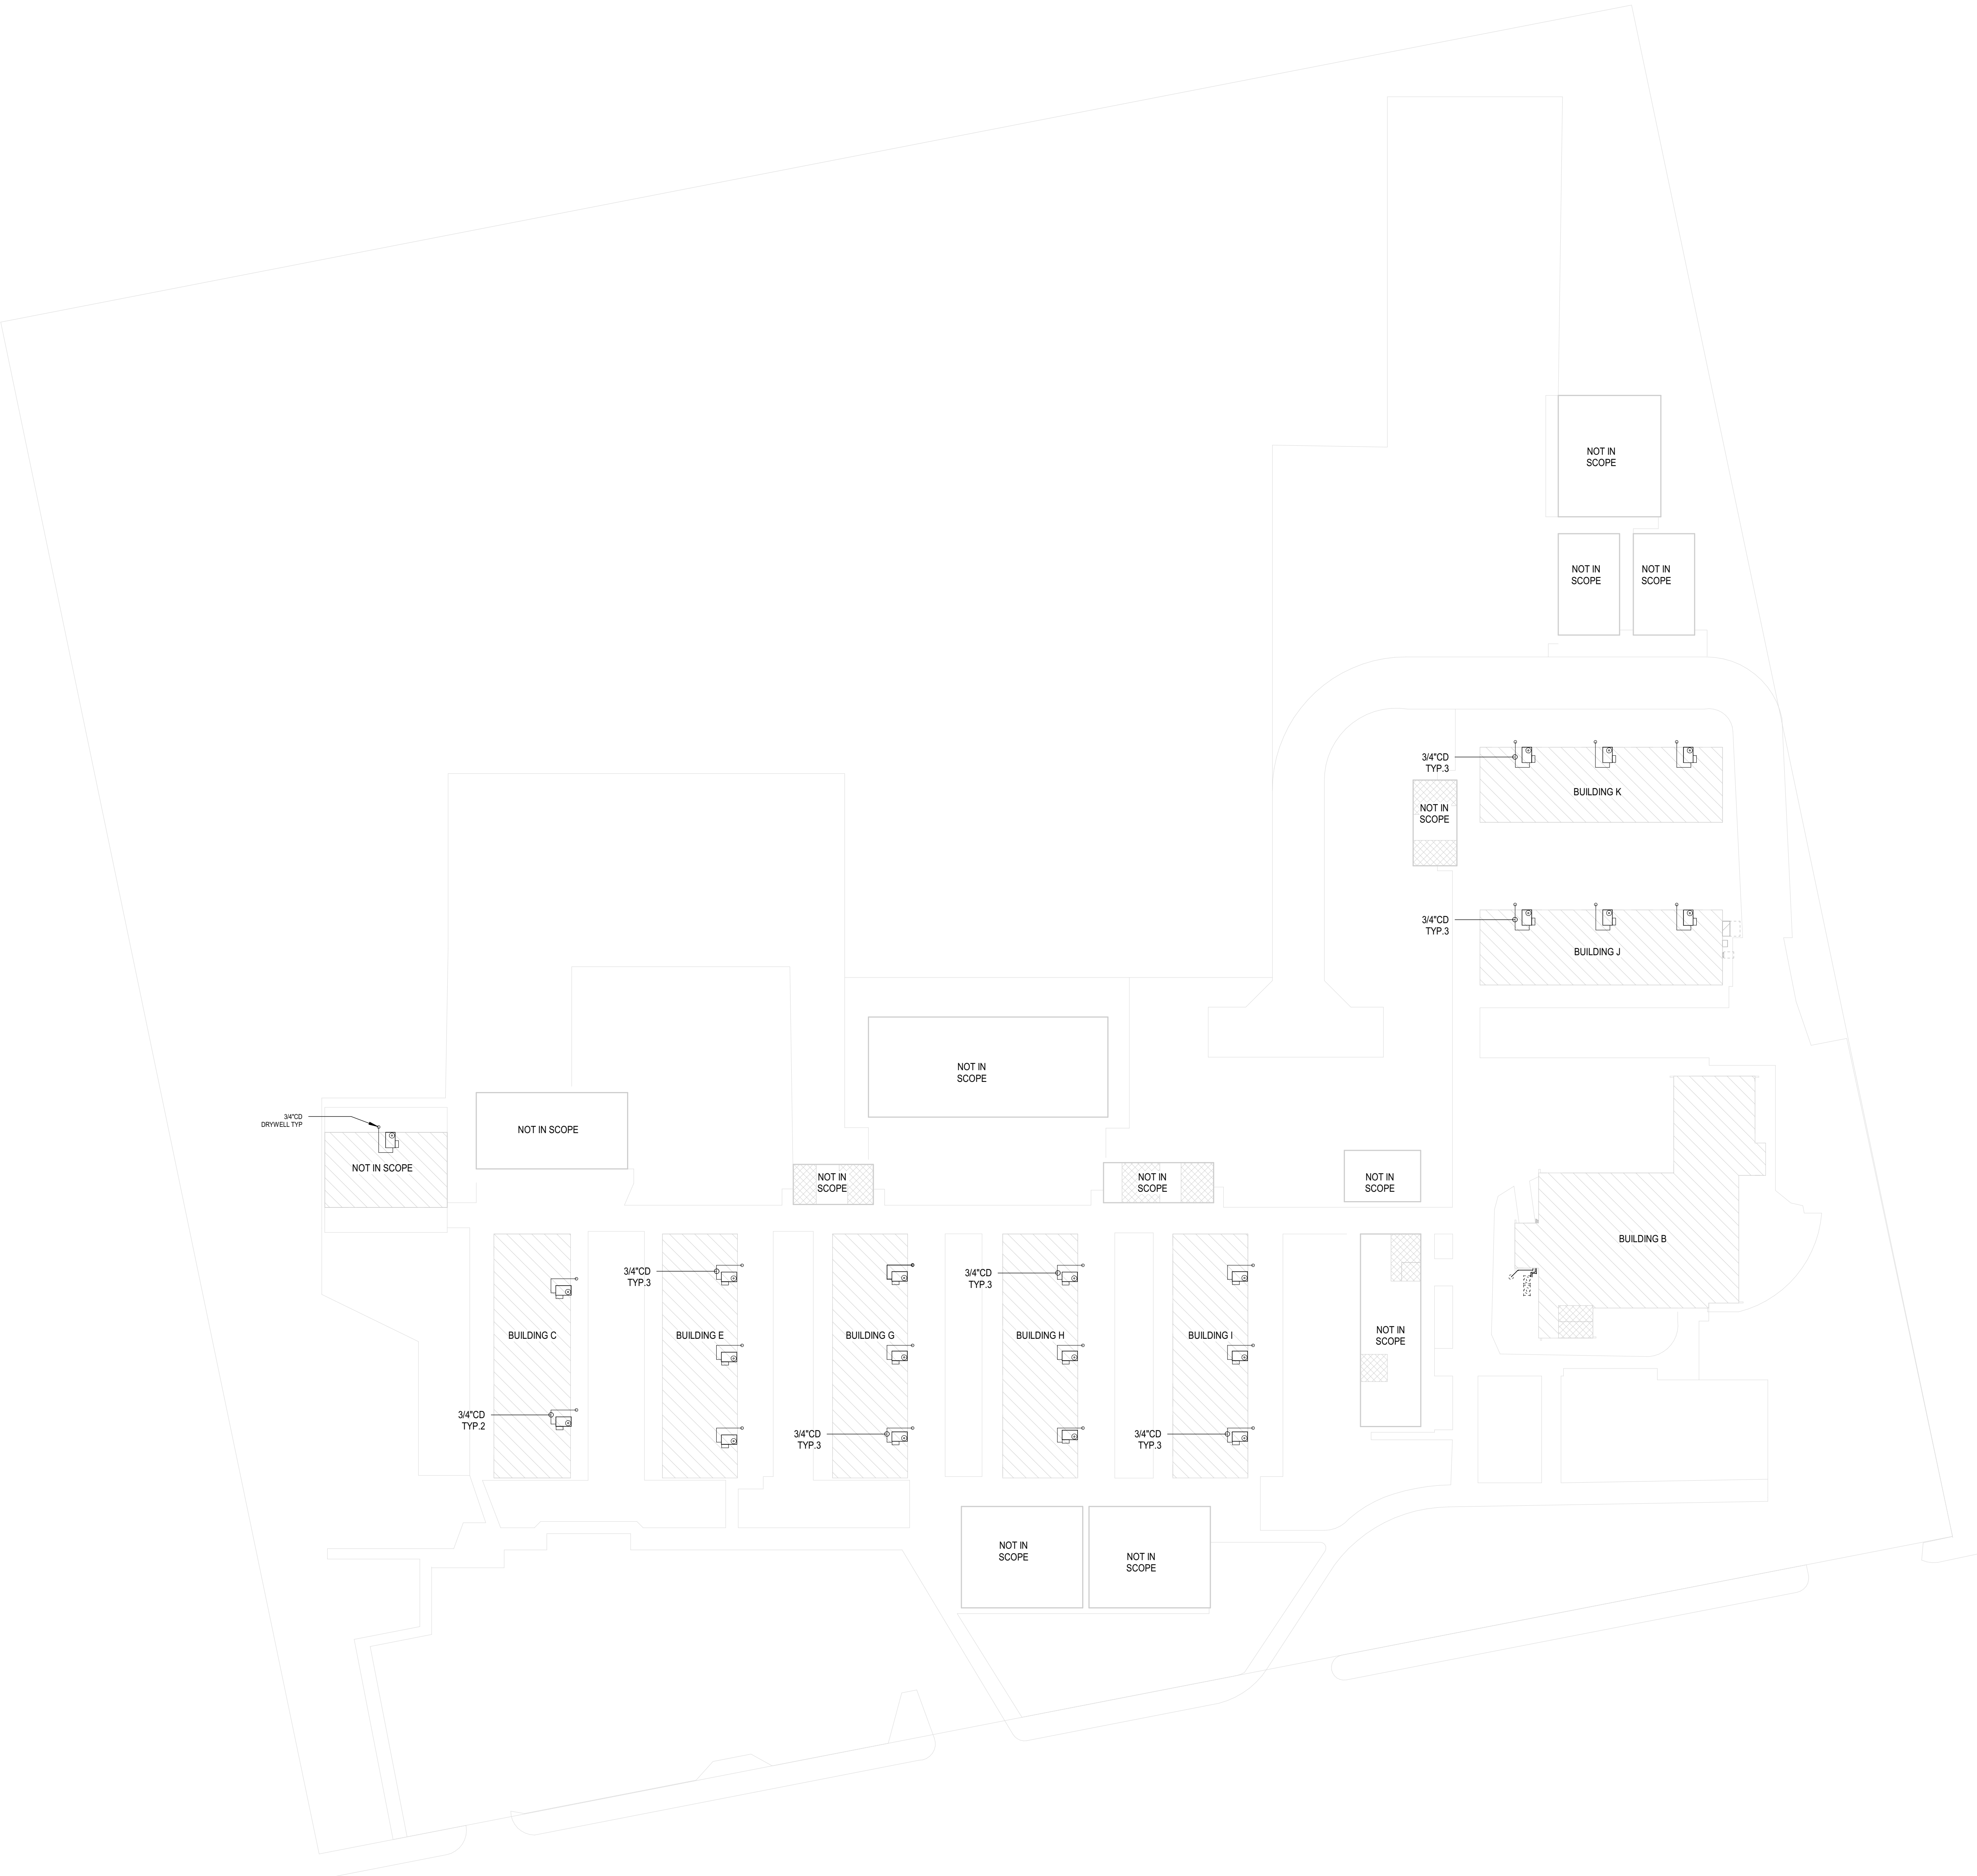

**SITE LEGEND**

- EXISTING BUILDING NOT IN SCOPE
- EXISTING BUILDING - SCOPE OF WORK UNDER THIS DSA APPLICATION
- (E) RESTROOMS - NOT IN SCOPE



**Workman Elementary School**  
COVINA VALLEY USD  
1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00

MECHANICAL  
PLUMBING SITE  
PLAN

**MP1.1**

Autodesk Docs /75-22605-00\_CVUSD - District Wide HVAC Replacement/75-22605-00\_CVUSD\_Workman ES MEP\_2022.rvt  
8/29/2022 11:44:29 AM

## SHEET INDEX

E0.1	ELECTRICAL SYMBOLS, ABBREVIATIONS & NOTES
E2.1	ELECTRICAL FLOOR POWER PLAN - NEW AND DEMOLITION
E5.1	ELECTRICAL DIAGRAMS AND SCHEDULES
E6.1	ELECTRICAL DETAILS

## GENERAL NOTES

- MODIFICATIONS TO EXISTING POWER DISTRIBUTION EQUIPMENT: MATCH EXISTING MANUFACTURER, SWITCH TYPE, FUSE TYPE, BREAKER TYPE AND KAIC RATING FOR ALL INSTALLED DEVICES.
- EXISTING PANEL DIRECTORIES AT PANELS AFFECTED BY WORK: PROVIDE UPDATED TYPED PANEL DIRECTORY. CONSULT OWNER FOR INPUT ON LABELING OF ALL EXISTING CIRCUITS.
- DEVICES AND LIGHT FIXTURES DENOTED 'ER' ARE EXISTING TO BE RELOCATED. NOTIFY A/E IF DEVICES OR FIXTURES ARE DAMAGED.

APPLICABLE CODE: 2019 CBC

02/02/2020

REVISED: 02/14/2020

### MEP COMPONENT ANCHORAGE NOTE

ALL MECHANICAL, PLUMBING, AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE DSA-APPROVED CONSTRUCTION DOCUMENTS. THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACED TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2019 CBC SECTIONS 1617A.1.16 THROUGH 1617A.1.26 AND ASCE 7-16 CHAPTERS 13, 26, AND 30.

- ALL PERMANENT EQUIPMENT AND COMPONENTS.
- TEMPORARY, MOVABLE OR MOBILE EQUIPMENT THAT IS PERMANENTLY ATTACHED (E.G. HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR WATER, "PERMANENTLY ATTACHED" SHALL INCLUDE ALL ELECTRICAL CONNECTIONS EXCEPT PLUGS FOR 110/220 VOLT RECEPTACLES HAVING A FLEXIBLE CABLE.
- TEMPORARY, MOVABLE OR MOBILE EQUIPMENT WHICH IS HEAVIER THAN 400 POUNDS OR HAS A CENTER OF MASS LOCATED 4 FEET OR MORE ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT IS REQUIRED TO BE RESTRAINED IN A MANNER APPROVED BY DSA.

THE FOLLOWING MECHANICAL AND ELECTRICAL COMPONENTS SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE BUT NEED NOT DEMONSTRATE DESIGN COMPLIANCE WITH THE REFERENCES NOTED ABOVE. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING, AND CONDUIT. FLEXIBLE CONNECTIONS MUST ALLOW MOVEMENT IN BOTH TRANSVERSE AND LONGITUDINAL DIRECTIONS:

- COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVING A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OR ROOF LEVEL THAT DIRECTLY SUPPORT THE COMPONENT.
- COMPONENTS WEIGHING LESS THAN 20 POUNDS, OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

THE ANCHORAGE OF ALL MECHANICAL, ELECTRICAL, AND PLUMBING COMPONENTS SHALL BE SUBJECT TO THE APPROVAL OF THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR STRUCTURAL ENGINEER DELEGATED RESPONSIBILITY AND ACCEPTANCE BY DSA. THE PROJECT INSPECTOR WILL VERIFY THAT ALL COMPONENTS AND EQUIPMENT HAVE BEEN ANCHORED IN ACCORDANCE WITH THE ABOVE REQUIREMENTS.

### PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE BRACED TO COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-16 SECTION 13.3 AS DEFINED IN ASCE 7-16 SECTIONS 13.6.5, 13.6.6, 13.6.7, 13.6.8, AND 2019 CBC, SECTIONS 1617A.1.24, 1617A.1.25 AND 1617A.1.26.

THE METHOD OF SHOWING BRACING AND ATTACHEMENTS TO THE STRUCTURE FOR THE IDENTIFIED DISTRIBUTION SYSTEM ARE AS NOTED BELOW. WHEN BRACING AND ATTACHEMENTS ARE BASED ON A PREAPPROVED INSTALLATION GUIDE (E.G., OSHPD OPM FOR 2013 CBC OR LATER), COPIES OF THE BRACING SYSTEM INSTALLATION GUIDE OR MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO THE START OF AND DURING THE HANGING AND BRACING OF THE DISTRIBUTION SYSTEMS. THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

MECHANICAL PIPING (MP), MECHANICAL DUCTS (MD), PLUMBING PIPING (PP), ELECTRICAL DISTRIBUTION SYSTEMS (E):

MP	MD	PP	E	OPTION 1: DETAILED ON THE APPROVED DRAWINGS WITH PROJECT SPECIFIC NOTES AND DETAILS.
MP	MD	PP	(E)	OPTION 2: SHALL COMPLY WITH THE APPLICABLE OSHPD PRE-APPROVAL (OPMM) # 00043-13

## POWER

	CIRCUIT HOME RUN
	CONDUIT TURNING UP
	CONDUIT TURNING DOWN
	CONDUIT STUB-UP
	CONDUIT SLEEVE
	CONDUIT SEAL
	CONDUIT CONCEALED IN CEILING OR WALLS, POWER
	CONDUIT CONCEALED IN CEILING OR WALLS, OTHER (" = SEE ABBREVIATIONS)
	CONDUIT CONCEALED IN FLOOR OR UNDERGROUND, POWER
	CONDUIT CONCEALED IN FLOOR OR UNDERGROUND, OTHER (" = SEE ABBREVIATIONS)
	EXPOSED CONDUIT, POWER
	EXPOSED CONDUIT, OTHER (" = SEE ABBREVIATIONS)
	FIRE RATED SLEEVE
	TRANSFORMER
	BRANCH CIRCUIT PANELBOARD MOUNT 72-INCHES TO TOP
	DISTRIBUTION PANELBOARD MOUNT 72-INCHES TO TOP
	EQUIPMENT CABINET, AS NOTED
	SWITCHBOARD
	MOTOR STARTER OR DRIVE
	DISCONNECT SWITCH
	COMBINATION STARTER / DISCONNECT SWITCH
	CURRENT TRANSFORMER ENCLOSURE
	METER
	GENERATOR
	AUTOMATIC TRANSFER SWITCH
	SYSTEM GROUND ELECTRODE
	THERMOSTAT
	MUSHROOM SWITCH
	ELECTRICAL MANHOLE
	ELECTRICAL HAND HOLE
	MOTOR CONNECTION, HORSEPOWER AS INDICATED
	FUSE AND SWITCH ASSEMBLY
	MANUAL CONTROLLER WITH THERMAL OVERLOAD
	MANUAL CONTROLLER W/O THERMAL OVERLOAD
	CIRCUIT BREAKER ENCLOSURE
	PULL BOX
	EQUIPMENT CONNECTION
	CABLE TRAY, LADDER TYPE OR RUNWAY
	CABLE TRAY
	MULTI-OUTLET ASSEMBLIES MOUNT 18-INCHES AFF. UNO WHERE DENOTED 'AC', MOUNT ABOVE COUNTER
	DIVIDED SURFACE RACEWAY MOUNT 18-INCHES AFF. UNO WHERE DENOTED 'AC', MOUNT ABOVE COUNTER
	PUSHBUTTON STATION: MOUNT 42-INCHES AFF. UNO
	SWITCH, PUSH BUTTON, SINGLE
	SWITCH, PUSH BUTTON, DOUBLE
	SWITCH, PUSH BUTTON, TRIPLE

RECEPTACLES: MOUNT 18-INCHES AFF. UNO

DIAGONAL LINE THROUGH SYMBOL OR DENOTED 'AC' INDICATES MOUNT DEVICE ABOVE COUNTER. WHERE INDICATED AS 'MOUNT ABOVE COUNTER' MOUNT BOTTOM OF BOX 2-INCHES ABOVE TOP OF BACKSPLASH OR 6-INCHES ABOVE COUNTER TOP IF NO BACKSPLASH EXISTS.

LABELS SHALL BE MACHINE PRINTED, UNO

	SIMPLEX RECEPTACLE
	DUPLEX RECEPTACLE
	DUPLEX RECEPTACLE, GFI TYPE
	DUPLEX RECEPTACLE, MOUNT ABOVE COUNTER
	DUPLEX RECEPTACLE, GFI TYPE, MOUNT ABOVE COUNTER
	FOURPLEX RECEPTACLE
	FOURPLEX RECEPTACLE, GFI TYPE
	FOURPLEX RECEPTACLE, MOUNT ABOVE COUNTER
	FOURPLEX RECEPTACLE, GFI TYPE, MOUNT ABOVE COUNTER
	DUPLEX RECEPTACLE, FLUSH IN CEILING
	FOURPLEX RECEPTACLE, FLUSH IN CEILING
	DUPLEX RECEPTACLE, HORIZONTALLY MOUNTED
	DUPLEX RECEPTACLE, HORIZ. MTD. GFI TYPE
	DUPLEX RECEPTACLE, HORIZ. MTD. ABOVE COUNTER
	DUPLEX RECEPTACLE, HORIZ. MTD. GFI TYPE, MOUNT ABOVE COUNTER
	WEATHER RESISTANT GFI DUPLEX RECEPTACLE, ROOF MOUNT 18-INCHES ABOVE ADJACENT STRUCTURE WITH A WEATHERPROOF, IN-USE COVER
	WEATHER RESISTANT GFI DUPLEX RECEPTACLE, MOUNT 18-INCHES AFF. WITH A WEATHERPROOF, IN-USE COVER
	STD DUPLEX RECEPTACLE TO SERVE ELECTRIC WATER COOLER, MOUNT AT HEIGHT PER EWC EQUIPMENT MANUFACTURERS INSTALLATION GUIDELINES. WIRE TO GFCI BWR IN PANELBOARD, DUPLEX RECEPTACLE TO SERVE TELEVISION, MOUNT AT SAME HEIGHT AND WITHIN 8-INCHES OF ADJACENT TV OUTLET

	DUPLEX RECEPTACLE, EMERGENCY
	FOURPLEX RECEPTACLE, EMERGENCY
	DUPLEX RECEPTACLE, LOWER SWITCH
	DUPLEX RECEPTACLE, SWITCHED
	RANGE RECEPTACLE, MOUNT 8-INCHES AFF.
	SPECIAL RECEPTACLE, DEEP WELL BOX
	FLUSH FLOOR OUTLET BOX UNO
	FLUSH FLOOR BOX WITH DUPLEX RECEPTACLE UNO
	MULTI-DEVICE FLOOR BOX WITH DUPLEX RECEPTACLE AND TELECOMMUNICATIONS OUTLETS
	USB ONLY RECEPTACLE RECEPTACLE WITH USB PORTS
	FLUSH JUNCTION BOX, CEILING MOUNTED
	JUNCTION BOX FOR FUTURE PROJECTOR POWER MOUNT 24-INCHES ABOVE SUSPENDED CEILING MOUNT TIGHT TO CEILING AT EXPOSED STRUCTURE LABEL BOX COVER PROJECTOR POWER
	JUNCTION BOX ABOVE SUSPENDED CEILING WITH FLEX CONNECTION
	FLUSH JUNCTION BOX, WALL MOUNTED
	SURFACE JUNCTION BOX, WALL MOUNTED
	SURFACE JUNCTION BOX, CEILING MOUNTED
	HAND DRYER, INSTALL HAND DRYER SPECIFIED IN DIV. 11


## ABBREVIATIONS

(D)	DEMOLISHED
(E)	EXISTING
(R)	RELOCATED
Ø	PHASE
A	AMPERE
AC	ABOVE COUNTER
AF	AMP FRAME (CIRCUIT BREAKER)
AC	AMPERE INTERRUPTING CAPACITY
AL	ALUMINUM
AMP	AMPERE
AP	WIRELESS ACCESS POINT
AT	AMP TRIP (CIRCUIT BREAKER OR FUSE)
ATS	AUTOMATIC TRANSFER SWITCH
AV	AUDIO/VIDEO, AUDIO/VISUAL
AWG	AMERICAN WIRE GAUGE
BAS	BUILDING AUTOMATION SYSTEM
BJ	BONDING JUMPER
BKR	BREAKER
BMS	BUILDING MANAGEMENT SYSTEM
C	CONDUIT
CATV	CABLE TELEVISION
CB	CIRCUIT BREAKER
CCTV	CLOSED CIRCUIT TELEVISION
CFCI	CONTRACTOR FURNISHED CONTRACTOR INSTALLED
CKT	CIRCUIT
CTL	CONTROL
CU	COPPER
DB	DECIBEL
DC	DIRECT CURRENT
DISC	DISCONNECT
DP	DISTRIBUTION PANELBOARD
DW	DISHWASHER
ECG	EMERGENCY COMMUNICATION SYSTEM
ESB	ELECTRICAL GROUNDING BUSBAR
EMD	ESTIMATED MAXIMUM DEMAND
EMGB	ELECTRICAL MAIN GROUNDING BUSBAR
EP	EXPLOSION PROOF
ER	EXISTING TO BE RELOCATED
ERMS	ENERGY REDUCTION MAINTENANCE SWITCH
EW	ELECTRIC WATER COOLER
FA	FIRE ALARM
FAA	FIRE ALARM ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
FC	FOOT CANDLE
FLA	FULL LOAD AMPS
FS	FLOW SWITCH
FSD	FIRE SMOKE DAMPER
G	EQUIPMENT GROUNDING CONDUCTOR
GEN	GENERATOR
GFI, GFCI	GROUND FAULT CIRCUIT INTERRUPTER
GFPE	GROUND FAULT PROTECTION OF EQUIPMENT
GND	EQUIPMENT GROUNDING CONDUCTOR
HH	HANDHOLE
HDA	HAND-OFF-AUTOMATIC
HP	HORSE POWER
IC	INTERCOM
IG	ISOLATED GROUND
JB	JUNCTION BOX
KAIC	THOUSAND AMPERE INTERRUPTING CIRCUIT
KV	KILOVOLT
KVA	KILOVOLT-AMPERES
KW	KILOWATT
LT	LIGHT
LTG	LIGHTING
MCA	MINIMUM CIRCUIT AMPACITY
MCB	MAIN CIRCUIT BREAKER
MCC	MOTOR CONTROL CENTER
MH	MANHOLE
MLO	MAIN LUGS ONLY
MCCP	MAXIMUM OVERCURRENT PROTECTION
MRTS	MOTOR RATED TOGGLE SWITCH
MSB	MAIN SWITCHBOARD
MTD	MOUNTED
MTG	MOUNTING
MTS	MAIN TRANSFER SWITCH
N	NEUTRAL
N.C.	NORMALLY CLOSED
N.O.	NORMALLY OPEN
NF	NON-FUSED
NL	NIGHT LIGHT
OFCI	OWNER FURNISHED CONTRACTOR INSTALLED
OS&Y	OUTSIDE SCREW AND YOKE
P	POLE(S)
PA	PUBLIC ADDRESS
PB	PULL BOX
PH	PHASE
PIV	POST INDICATOR VALVE
PNL	PANEL
PWR	POWER
RCP	REFLECTED CEILING PLAN
RECP	RECEPTACLE
REF	REFERENCE
RESP	RESPONSIVE
SCCR	SHORT CIRCUIT CURRENT RATING
SD	SMOKE DAMPER
SEC	SECONDARY
SFD	SURGE PROTECTION DEVICE
SWBD	SWITCHBOARD
TBB	TELECOMMUNICATIONS BONDING BACKBONE
TC	TIME CLOCK
TGB	TELECOMMUNICATIONS GROUNDING BUSBAR
TMGB	TELECOMMUNICATIONS MAIN GROUNDING BUSBAR
TO	TELECOMMUNICATIONS OUTLET
TR	TELECOMMUNICATIONS ROOM
TS	TAMPER SWITCH
TV	TELEVISION
UG	UNDERGROUND
UPS	UNINTERRUPTABLE POWER SUPPLY
V	VOLT
VA	VOLT-AMPERE
VFD	VARIABLE FREQUENCY DRIVE
W	WIRE
WA	TELECOMMUNICATIONS WORK AREA
WG	WIRE GUARD
WP	WEATHER-PROOF (NEMA 3R)
XFMR	TRANSFORMER

### \*NOTE\*

ALL NOTES ON THIS SHEET ARE APPLICABLE TO ALL OTHER SHEETS IN THIS SET.

THE SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE APPLICABLE IN THIS SET OF DRAWINGS.

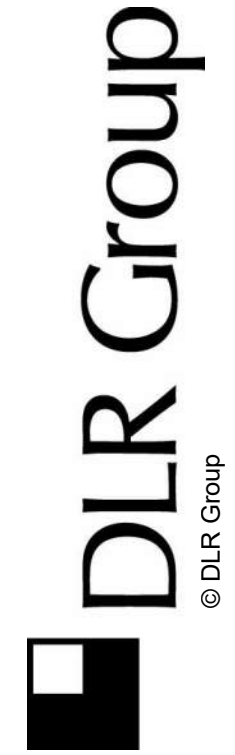

Workman Elementary School

COVINA VALLEY USD

1041 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS

11/04/2022  
REVISIONS


75-22605-00

ELECTRICAL  
SYMBOLS,  
ABBREVIATIONS &  
NOTES

E0.1



Autodesk Docs / 75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD Workman ES MEP\_2022.rvt  
8/29/2022 11:44:35 AM



OVERALL ELECTRICAL POWER PLAN

SCALE: 1/16" = 1'-0"

GENERAL NOTES












- A WORK TO INCLUDE REMOVAL OF EXISTING FEEDER TO EXISTING HVAC EQUIPMENT THAT ARE TO BE REMOVED AND REPLACED. FEEDER TO EXISTING INDOOR FAN COIL UNIT TO BE REMOVED IN ITS ENTIRETY.
- B DISCONNECTING MEANS TO BE NEMA 3R RATED, FURNISHED AND INSTALLED BY DIVISION 26.
- C CARBON MONOXIDE DETECTION SYSTEM NOT REQUIRED. ELECTRIC HEATING IS BEING PROVIDED.
- D SEE SCHEDULE ON SHEET ES.1 FOR ADDITIONAL INFORMATION.
- E FUSES SHALL BE PROVIDED PER EQUIPMENT NAMEPLATE RATING.
- F ELECTRICAL PANELS LOCATED AT GRADE LEVEL DIRECTLY BELOW WHERE SHOWN.
- G ENERGY MANGEMENT SYSTEM (EMS) / BUILDING AUTOMATION SYSTEM (BAS) IS A DELEGATED DESIGN SCOPE BY CONTRACTOR. CONTRACTOR TO FIELD COORDINATE WITH SCHOOL DISTRICT FOR LOCATIONS OF EMS ROUTER AND EMS PANEL AS WELL AS CONDUIT ROUTING.
- H CARBON MONOXIDE DETECTION SYSTEM WILL NOT BE PROVIDED AT THIS TIME UNDER CECB 503.15.1:
- EXCEPTION 2: THE GROUP BUILDING WAS CONSTRUCTED BEFORE THE ADOPTION OF THE 2016 CALIFORNIA BUILDING STANDARDS CODE.
- EXISTING HVAC UNITS ARE BEING REPLACED IN KIND THROUGHOUT.
- J CONTRACTOR TO PROVIDE CONNECTION FROM LOAD SIDE OF HVAC EQUIPMENT DISCONNECT SWITCH TO FEED POWER EXHAUST DISCONNECT SWITCH. PROVIDE SAME SIZE FEEDER. PROVIDE FUSES PER EQUIPMENT NAMEPLATE RATING.

KEYNOTES


No.	DESCRIPTION
1	EXISTING HVAC EQUIPMENT AT GRADE TO BE DISCONNECTED AND REPLACED AS PART OF THIS SCOPE OF WORK WITH ROOF TOP EQUIPMENT. EXTEND EXISTING FEEDER AS REQUIRED. SEE TABLE ON SHEET ES.1 FOR OTHER INFORMATION. PROVIDE ALL REQUIRED CONNECTION.
2	EXISTING HVAC EQUIPMENT AT GRADE TO BE DISCONNECTED AND REPLACED AS PART OF THIS SCOPE OF WORK. PROVIDE NEW FEEDER PER TABLE ON SHEET ES.1. PROVIDE ALL REQUIRED CONNECTION.
3	NEW HVAC EQUIPMENT AT GRADE. PROVIDE NEW FEEDER PER TABLE ON SHEET ES.1. PROVIDE ALL REQUIRED CONNECTION.
4	DUCT SMOKE DETECTOR FOR COMPLIANCE TO CALIFORNIA MECHANICAL CODE SECTION 608 IS NOT REQUIRED PER CODE EXCEPTION NO.2. ROOM HAVE DIRECT EXIT TO EXTERIOR AND TRAVEL DISTANCE DOES NOT EXCEED 100 FEET.
5	EXISTING ELECTRICAL EQUIPMENT TO REMAIN AND TO BE PROTECTED IN PLACE.
6	PROVIDE 120 VOLT CIRCUIT FROM NEAREST PANEL. PROVIDE TANDEM BREAKER IF REQUIRED. FIELD COORDINATE.
8	SIZE 1 MOTOR STARTER FOR EXHAUST FAN. PROVIDE ALL REQUIRED CONNECTIONS.
9	GFCI TYPE RECEPTACLE PROVIDED BY HVAC EQUIPMENT MANUFACTURER. SEE TABLE PROVIDED ON SHEET ES.1. GENERAL NOTE NO.2 FOR CIRCUITING OF OUTLETS. PROVIDE WEATHERPROOF COVER.
10	FUSED DISCONNECT SIZE PER TABLE SHOWN ON ES.1
11	PROVIDE 120V CIRCUIT TO EMS ROUTER AND EMS PANEL. FIELD VERIFY EXACT LOCATION OF EMS ROUTER AND EMS PANEL.

SITE LEGEND

- EXISTING BUILDING NOT IN SCOPE
- EXISTING BUILDING - SCOPE OF WORK UNDER THIS DSA APPLICATION
- (E) RESTROOMS - NOT IN SCOPE

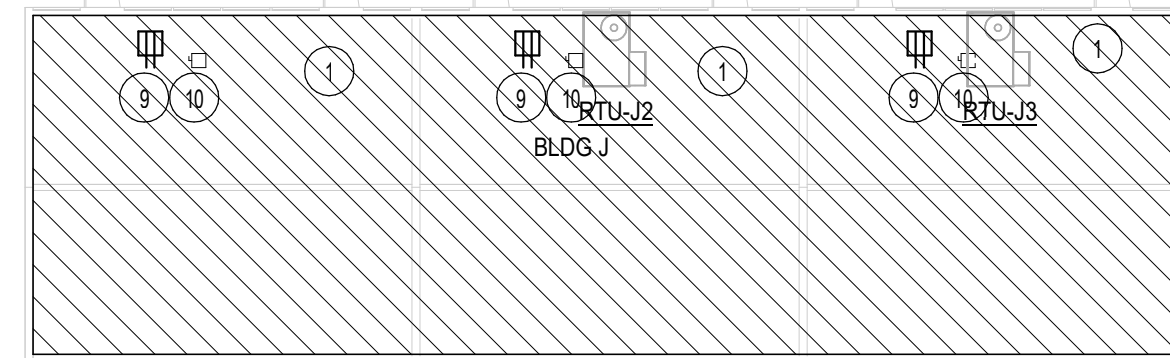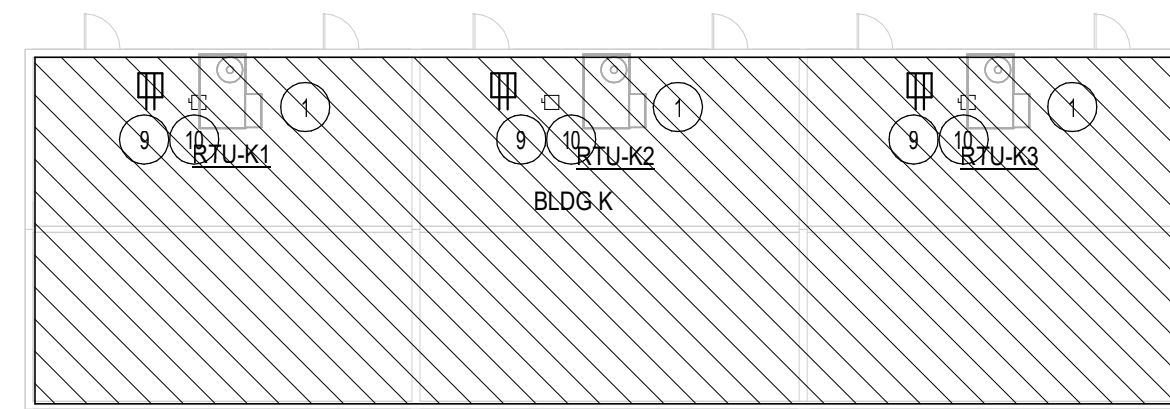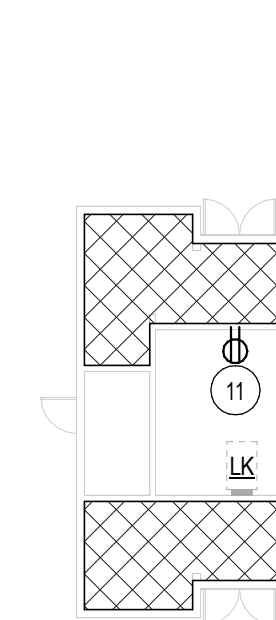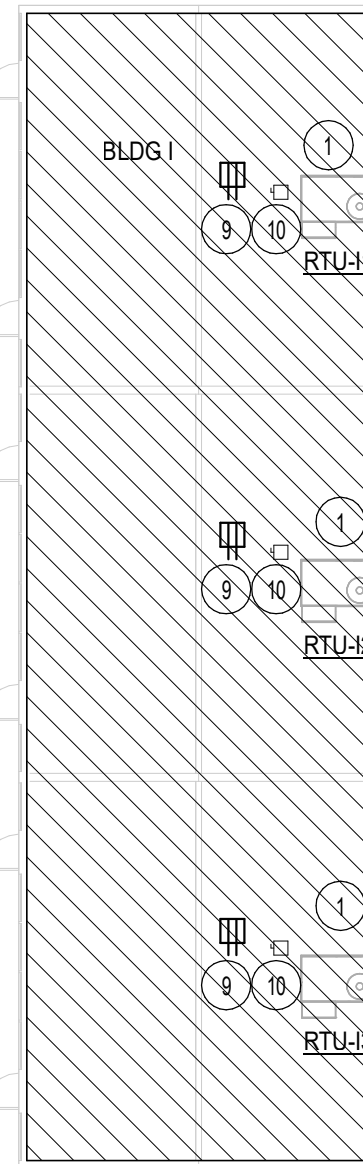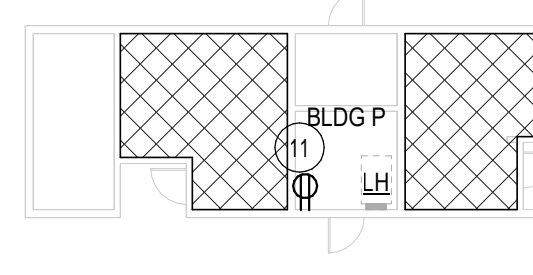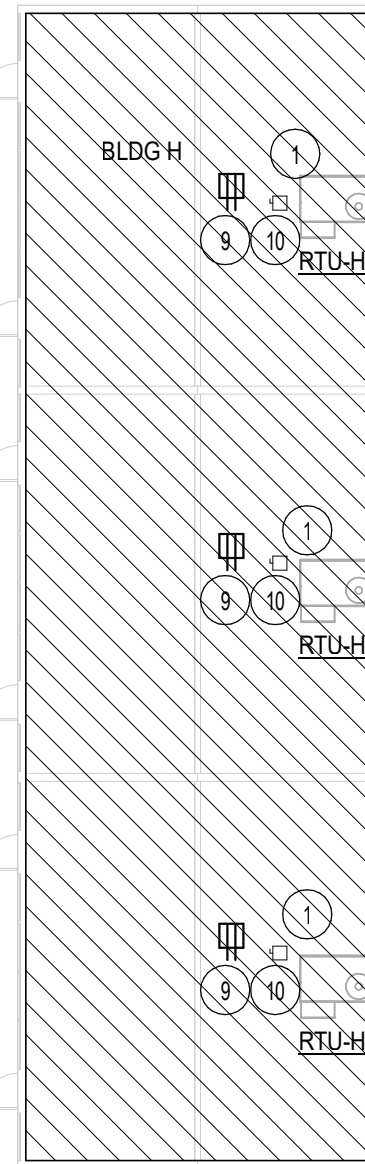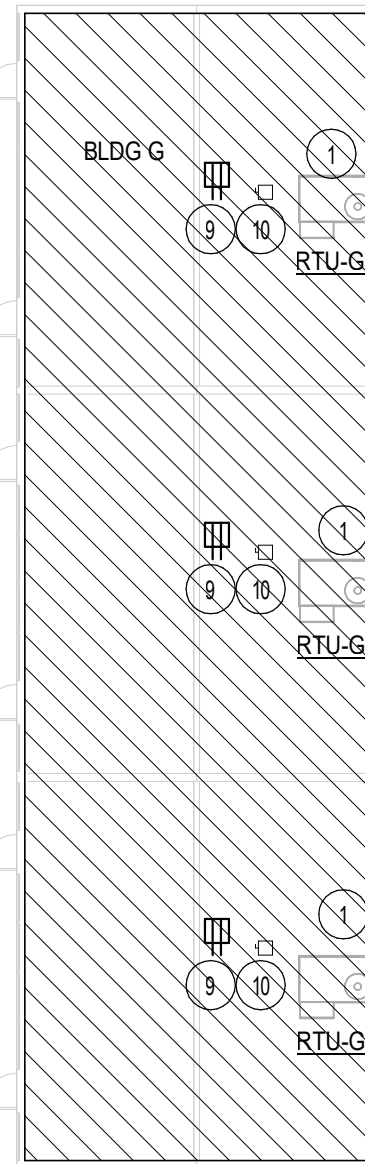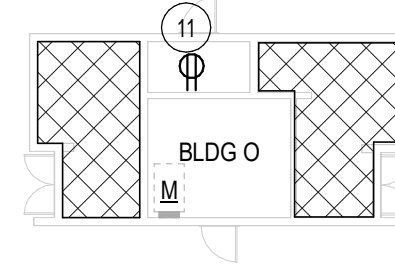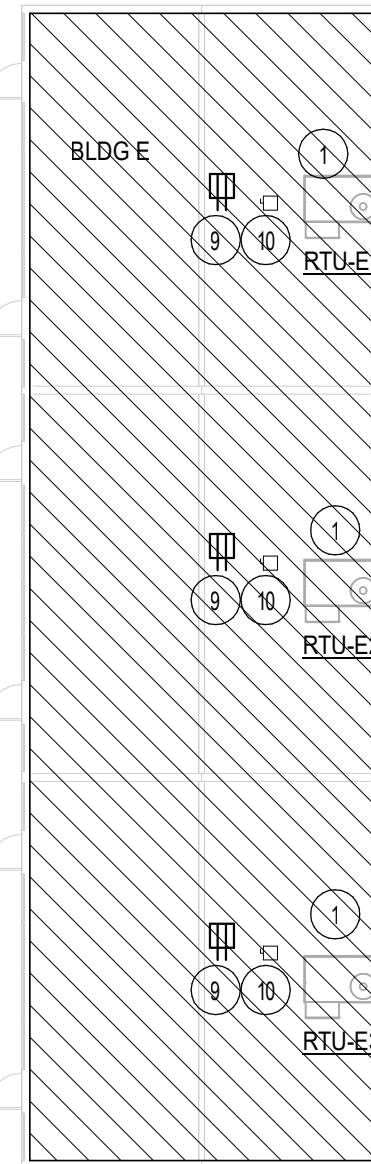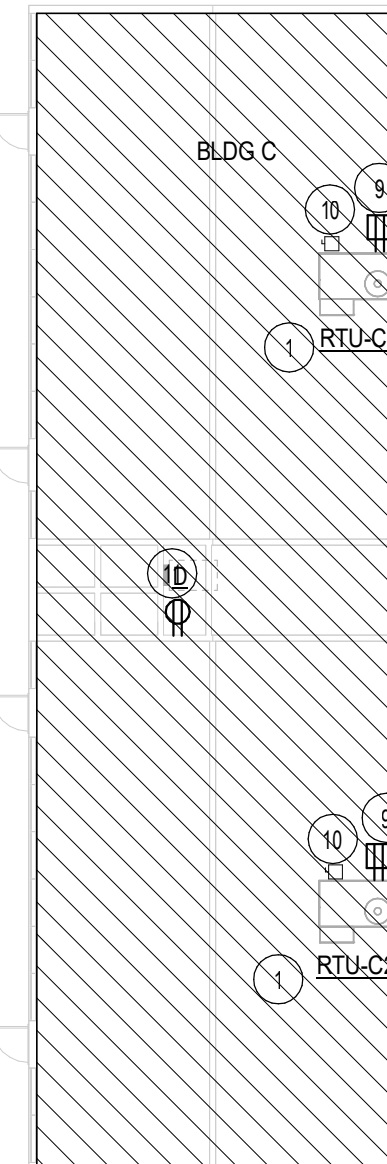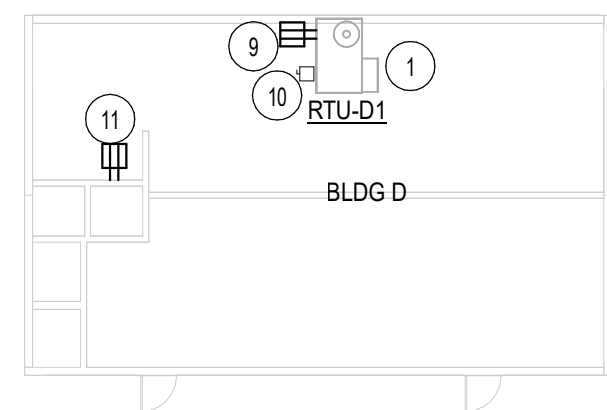

- (E) MSB-C 5
- (E) TRANSFORMER 5
- (E) PANELBOARD 5

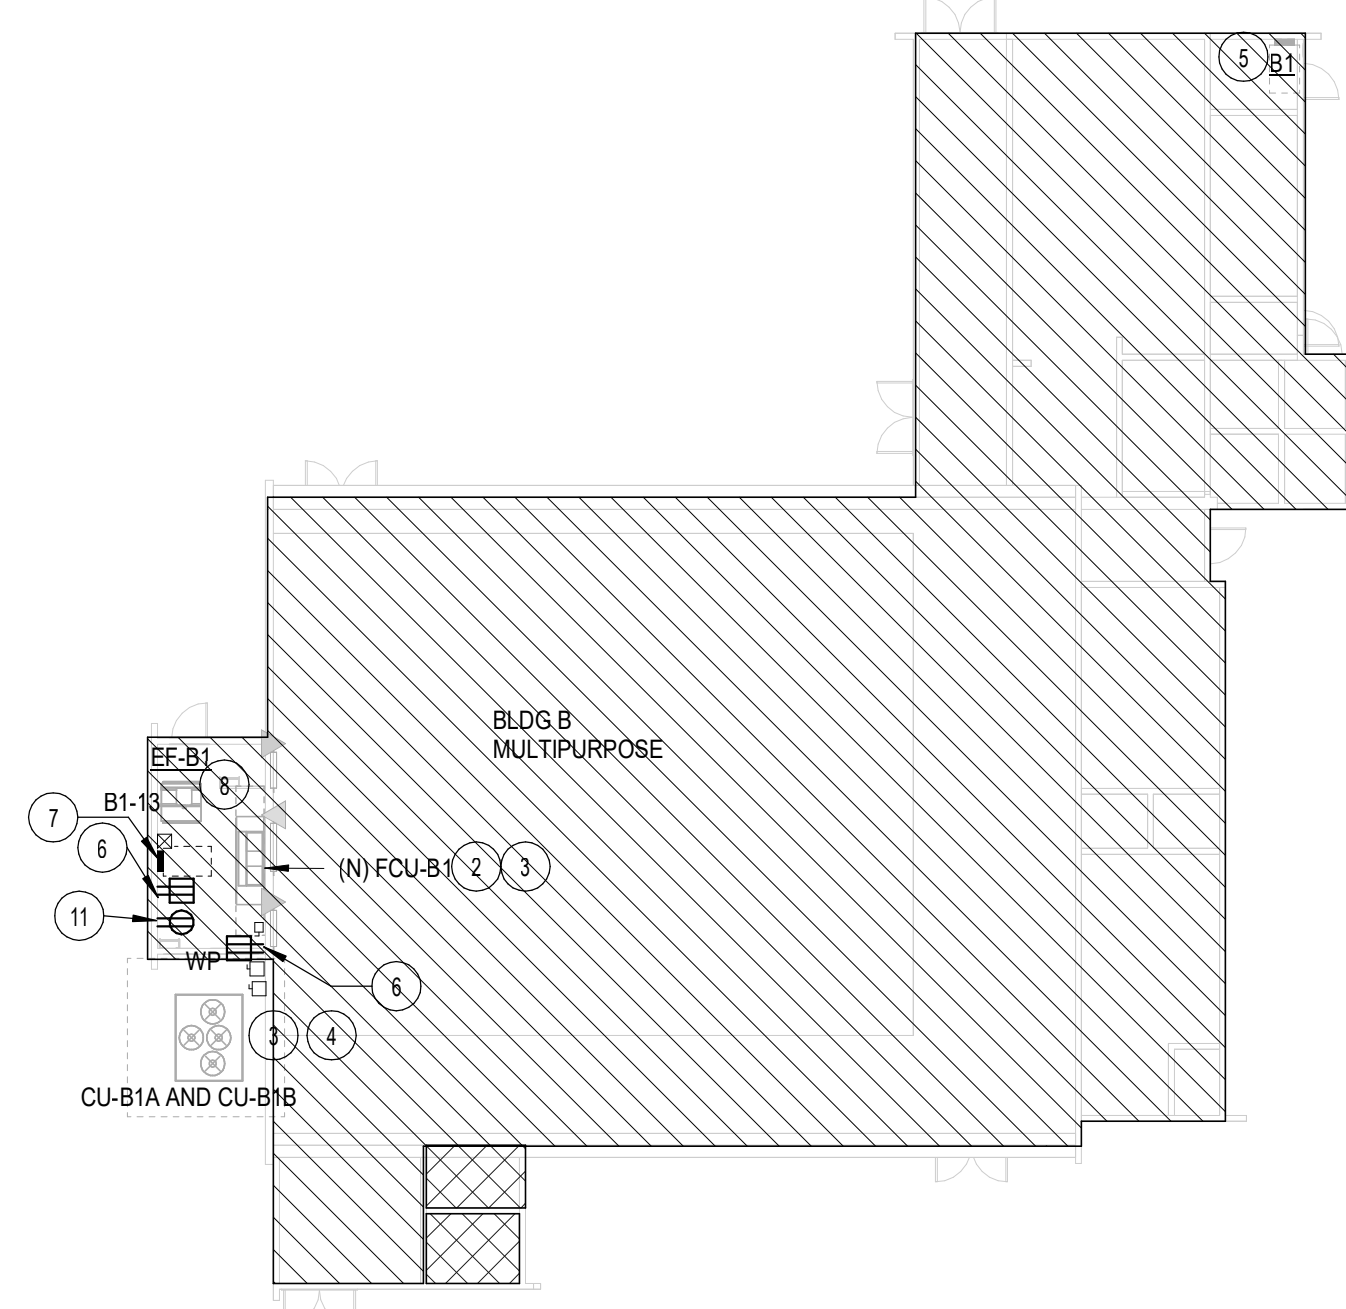

Workman Elementary School  
COVINA VALLEY USD


1941 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00

ELECTRICAL  
FLOOR POWER  
PLAN - NEW AND  
DEMOLITION

E2.1

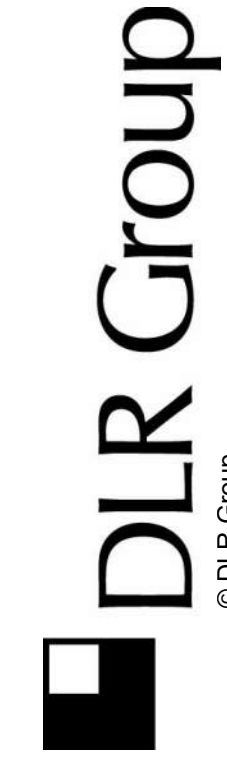



1

2

3


4

5

Audodesk Docs / 75-22605-00 CVUSD - District Wide HVAC Replacement/75-22605-00 CVUSD - Workman ES MEP\_2022.rvt  
9/29/2022 11:44:40 AM

One-Line Diagram

SCALE: 12" = 1'-0"

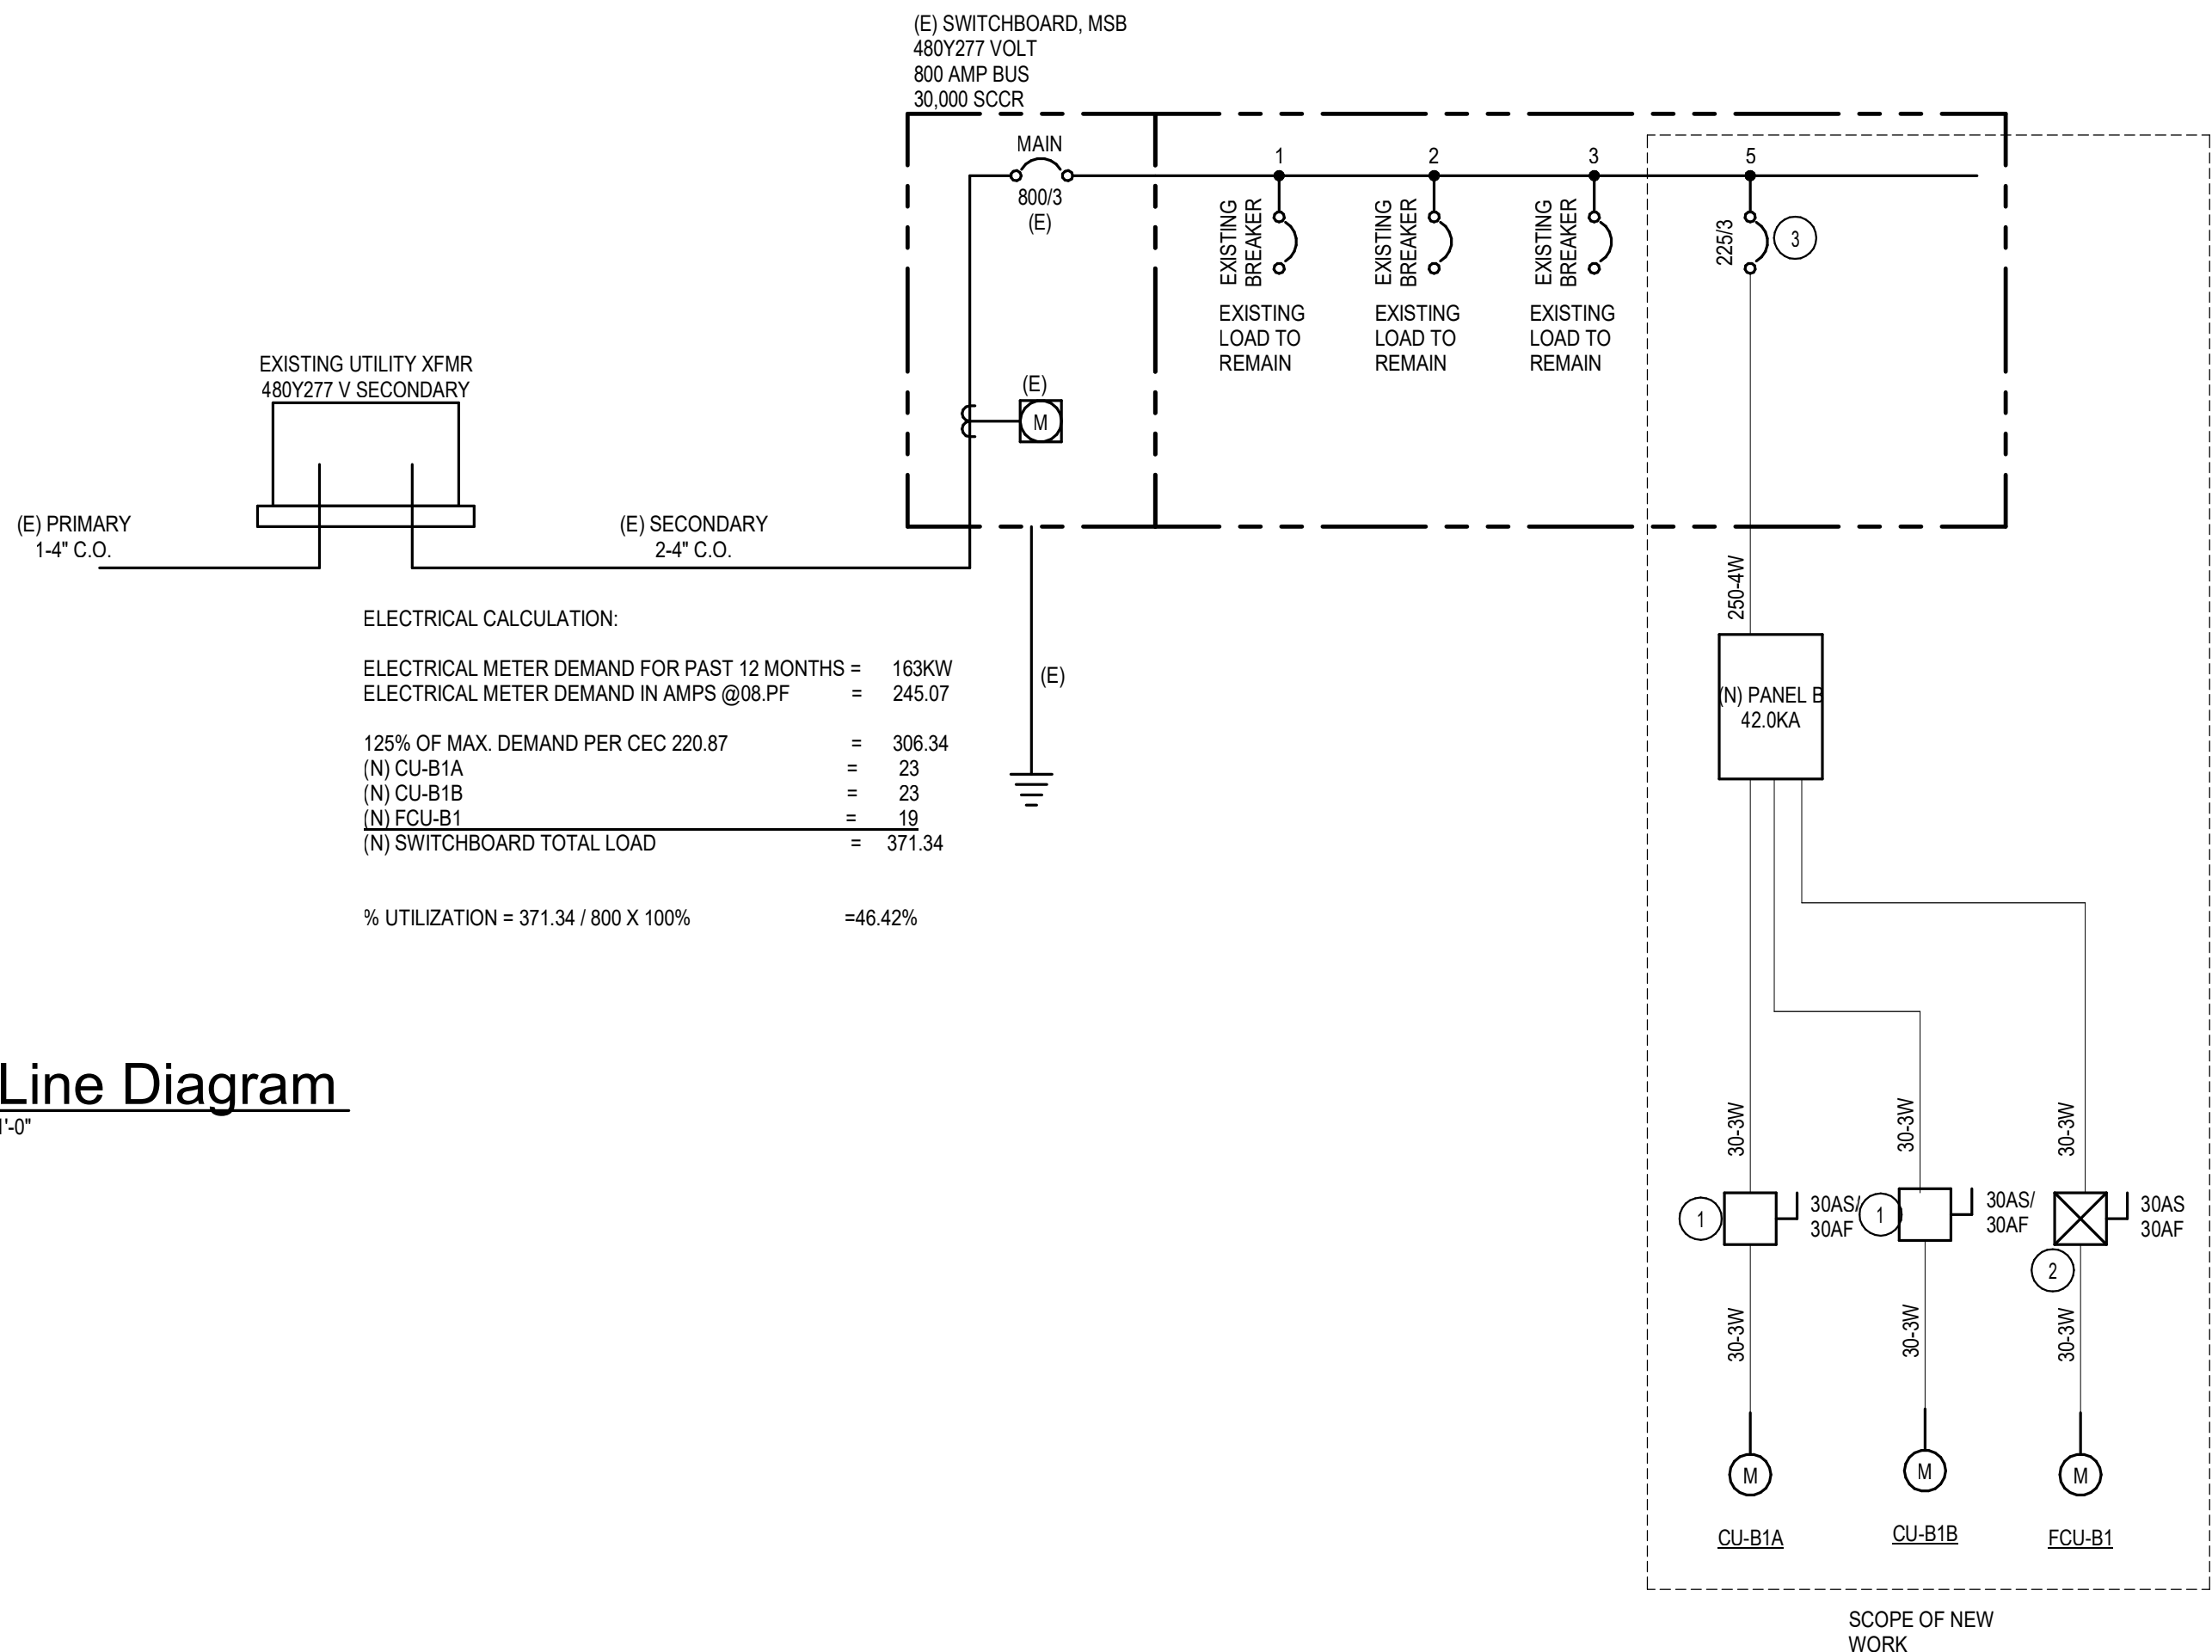

GENERAL SINGLE LINE NOTES

- OVERCURRENT DEVICES OF ENTIRE DISTRIBUTION SYSTEM SHALL MEET STATED FAULT CURRENT VALUES WITH FULLY RATED EQUIPMENT.
- CONDUCTOR LENGTHS INDICATED ON THE SINGLE LINE DIAGRAM ARE FOR FAULT CURRENT CALCULATIONS ONLY. ACTUAL LENGTH SHALL BE DETERMINED BY FIELD CONDITIONS AND ACTUAL ROUTES OF FEEDERS.
- REFER TO SWITCHBOARD SCHEDULES AND DISTRIBUTION PANEL SCHEDULES FOR ADDITIONAL REQUIREMENTS. WHERE A DISCREPANCY EXISTS BETWEEN EQUIPMENT ON THE SINGLE LINE DIAGRAM AND THE DETAILED SCHEDULES, THE ITEM OR ARRANGEMENT WITH BETTER QUALITY, GREATER QUANTITY, OR HIGHER COST SHALL BE USED.
- ALL DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
- REFER TO THE MOTOR AND SPECIAL CONNECTION SCHEDULE FOR ALL FEEDERS DESIGNATED "EQ".
- GROUNDING ELECTRODE CONDUCTORS SIZES ARE NOT INDICATED ON THE SINGLE LINE DIAGRAM ARE. REFER TO THE GROUNDING RISER DIAGRAM FOR CONNECTIONS AND CONDUCTOR SIZES.

KEYNOTES

No.	DESCRIPTION
1	FUSED DISCONNECT TO BE PROVIDED BY CONTRACTOR.
2	VARIABLE FREQUENCY DRIVE WITH ON/OFF SWITCH TO BE PROVIDED UNDER DIVISION 23.
3	CONTRACTOR TO MATCH EXISTING BREAKER.

WORKMAN AVE. AC UNIT REPLACEMENT

WORKMAN AVE. AC UNIT REPLACEMENT																								
EXISTING UNIT							NEW UNIT																	
TAGS	ELECTRICAL						TAGS	DIRECT REPLACEMENT? Y/N	CFM	ELECTRICAL						REQUIRED?	Model#	POWER EXHAUST			FEEDER SIZE	DISCONNECT	NOTES	
	V/PH	MCA	FLA	PANEL CKT#	FEEDER SIZE	DISCONNECT				V/PH	MCA	MOCF	PANEL CKT#	FEEDER SIZE	DISCONNECT			MCA	MOCF					
NA	NA	NA	NA	NA	NA	NA	CU-B1A (BLDG B)	N		460/3	23	30	B-1,3,5	2#10, 1#10GND-0.75°C	30A (30A FUSE)	NO	NA	NA	NA	NA	NA	NA		
NA	NA	NA	NA	NA	NA	NA	CU-B1B (BLDG B)	N		460/3	23	30	B-7,9,11	2#10, 1#10GND-0.75°C	30A (30A FUSE)	NO	NA	NA	NA	NA	NA	NA		
NA	NA	NA	NA	NA	NA	NA	FCU-B1 (BLDG B)	N	8000	460/3	19	30	B-13,15,17	2#10, 1#10GND-0.75°C	30A (30A FUSE)	NO	NA	NA	NA	NA	NA	NA		
CU/FCU-C1 (BLDG C)	240/1	30	18.3	D-1,3	2#10, 1#10GND-0.75°C	30	RTU-C1 (BLDG C)	Y	1,200	240/1	26	30	D-1,3	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-C2 (BLDG C)	240/1	30	18.3	D-5,7	2#10, 1#10GND-0.75°C	30	RTU-C2 (BLDG C)	Y	1,200	240/1	26	30	D-5,7	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-D1 (BLDG D)	240/1	30	18.3	M-13,15	2#10, 1#10GND-0.75°C	30	RTU-D1 (BLDG D)	Y	1,200	240/1	26	30	M-13,15	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-E1 (BLDG E)	240/1	30	18.3	M-1,3	2#10, 1#10GND-0.75°C	30	RTU-E1 (BLDG E)	Y	1,200	240/1	26	30	M-1,3	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-E2 (BLDG E)	240/1	30	18.3	M-5,7	2#10, 1#10GND-0.75°C	30	RTU-E2 (BLDG E)	Y	1,200	240/1	26	30	M-5,7	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-E3 (BLDG E)	240/1	30	18.3	M-9,11	2#10, 1#10GND-0.75°C	30	RTU-E3 (BLDG E)	Y	1,200	240/1	26	30	M-9,11	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-G1 (BLDG G)	240/1	30	18.3	M-2,4	2#10, 1#10GND-0.75°C	30	RTU-G1 (BLDG G)	Y	1,200	240/1	26	30	M-2,4	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-G2 (BLDG G)	240/1	30	18.3	M-6,8	2#10, 1#10GND-0.75°C	30	RTU-G2 (BLDG G)	Y	1,200	240/1	26	30	M-6,8	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-G3 (BLDG G)	240/1	30	18.3	M-10,12	2#10, 1#10GND-0.75°C	30	RTU-G3 (BLDG G)	Y	1,200	240/1	26	30	M-10,12	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-H1 (BLDG H)	240/1	30	18.3	GH-1,3	2#10, 1#10GND-0.75°C	30	RTU-H1 (BLDG H)	Y	1,200	240/1	26	30	GH-1,3	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-H2 (BLDG H)	240/1	30	18.3	GH-5,7	2#10, 1#10GND-0.75°C	30	RTU-H2 (BLDG H)	Y	1,200	240/1	26	30	GH-5,7	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-H3 (BLDG H)	240/1	30	18.3	GH-9,11	2#10, 1#10GND-0.75°C	30	RTU-H3 (BLDG H)	Y	1,200	240/1	26	30	GH-9,11	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-I1 (BLDG I)	240/1	30	18.3	GH-2,4	2#10, 1#10GND-0.75°C	30	RTU-I1 (BLDG I)	Y	1,200	240/1	26	30	GH-2,4	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-I2 (BLDG I)	240/1	30	18.3	GH-6,8	2#10, 1#10GND-0.75°C	30	RTU-I2 (BLDG I)	Y	1,200	240/1	26	30	GH-6,8	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-I3 (BLDG I)	240/1	30	18.3	GH-10,12	2#10, 1#10GND-0.75°C	30	RTU-I3 (BLDG I)	Y	1,200	240/1	26	30	GH-10,12	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-J1 (BLDG J)	240/1	30	18.3	LK-2,4	2#10, 1#10GND-0.75°C	30	RTU-J1 (BLDG J)	Y	1,200	240/1	26	30	LK-2,4	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-J2 (BLDG J)	240/1	30	18.3	LK-6,8	2#10, 1#10GND-0.75°C	30	RTU-J2 (BLDG J)	Y	1,200	240/1	26	30	LK-6,8	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-J3 (BLDG J)	240/1	30	18.3	LK-10,12	2#10, 1#10GND-0.75°C	30	RTU-J3 (BLDG J)	Y	1,200	240/1	26	30	LK-10,12	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-K1 (BLDG K)	240/1	30	18.3	LK-1,3	2#10, 1#10GND-0.75°C	30	RTU-K1 (BLDG K)	Y	1,200	240/1	26	30	LK-1,3	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-K2 (BLDG K)	240/1	30	18.3	LK-5,7	2#10, 1#10GND-0.75°C	30	RTU-K2 (BLDG K)	Y	1,200	240/1	26	30	LK-5,7	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			
CU/FCU-K3 (BLDG K)	240/1	30	18.3	LK-9,11	2#10, 1#10GND-0.75°C	30	RTU-K3 (BLDG K)	Y	1,200	240/1	26	30	LK-9,11	2#10, 1#10GND-0.75°C	30A (30A FUSE)	YES	PCD-SRT12CA	7.1	12.8	2#10, 1#10GND-0.75°C	30A (20A FUSE)			

- GENERAL NOTES:
- CONTRACTOR TO FIELD VERIFY CIRCUITING AND FEEDER INFORMATION PRIOR TO EQUIPMENT REMOVAL. CONTRACTOR TO PROVIDE REQUIRED ADJUSTMENTS AS NEEDED.
  - PROVIDE MECHANICAL UNIT WITH INTEGRAL CONVENIENCE RECEPTACLE. FEED FROM SPARE 20A/1P BREAKER IN NEAREST PANEL. ROUTE 2#12+1#12GND IN 1/2" EMT CONDUIT FROM PANEL TO RECEPTACLE.
  - POWER NO MORE THAN 10 RECEPTACLES ON ONE CIRCUIT. FIELD VERIFY EXACT LOCATION OF NEAREST PANEL AND ROUTE OF NEW CIRCUIT FROM PANEL TO UNIT RECEPTACLE.
  - CONTRACTOR TO DEMOLISH POWER CONNECTION FROM CONDENSING UNITS, FAN COIL UNITS AND CONDENSATE PUMPS. DEMOLITION TO CONSIST OF REMOVAL OF POWER CONNECTION, CABLING, AND CONDUIT BACK TO SOURCE UNLESS NOTED OTHERWISE.
- FIELD COORDINATE EQUIPMENT MANUFACTURER FOR FAULT CURRENT LIMITING FUSE TYPES

FEEDER SCHEDULE - COPPER

MARK (AMPS)	# SETS	Ø & N	GND	CONDUIT SIZE		
				MARK SUFFIX		
				-4W	-3W	-2W
15	1	12	12	3/4"	3/4"	3/4"
20	1	12	12	3/4"	3/4"	3/4"
25	1	10	10	3/4"	3/4"	3/4"
30	1	10	10	3/4"	3/4"	3/4"
35	1	8	10	3/4"	3/4"	3/4"
40	1	8	10	3/4"	3/4"	3/4"
45	1	6	10	1"	3/4"	3/4"
50	1	6	10	1"	3/4"	3/4"
60	1	4	10	1-1/4"	1"	3/4"
70	1	4	8	1-1/4"	1"	3/4"
80	1	3	8	1-1/4"	1-1/4"	1"
90	1	2	8	1-1/4"	1-1/4"	1"
100	1	1	8	1-1/2"	1-1/2"	1-1/4"
110	1	1	6	1-1/2"	1-1/2"	1-1/4"
125	1	1	6	1-1/2"	1-1/2"	1-1/4"
150	1	1/0	6	2"	1-1/2"	1-1/4"
175	1	2/0	6	2"	1-1/2"	1-1/4"
200	1	3/0	6	2"	2"	1-1/2"
225	1	4/0	4	2-1/2"	2"	1-1/2"
250	1	250	4	2-1/2"	2"	1-1/2"
300	1	350	4	2"	2-1/2"	2"
350	1	500	3	3-1/2"	3"	2-1/2"
400	1	600	3	3-1/2"	3"	2-1/2"
400	2	30	3	2"	2"	1-1/2"
450	2	4/0	2	2-1/2"	2"	1-1/2"
500	2	250	2	2-1/2"	2-1/2"	2"
600	2	350	1	3"	2-1/2"	2"
700	2	500	1/0	3-1/2"	3"	2-1/2"
800	2	600	1/0	3-1/2"	3"	2-1/2"
1000	3	400	2/0	3"	3"	2-1/2"
1200	3	600	3/0	3-1/2"	3-1/2"	3"
1600	4	600	4/0	3-1/2"	3-1/2"	3"
2000	5	600	250	4"	3-1/2"	3"
2500	6	600	350	4"	3-1/2"	3"
3000	8	500	400	3-1/2"	3"	2-1/2"
4000	10	600	500	4"	3-1/2"	3"

ABBREVIATIONS:

- Ø PHASE  
N NEUTRAL  
GND EQUIPMENT GROUNDING CONDUCTOR  
-4W FOUR WIRE + GROUND (30 N.GND)  
-3W THREE WIRE + GROUND (30 GND or 20 N.GND)  
-2W TWO WIRE + GROUND

NOTES:

- CONDUCTOR AMPACITIES ARE BASED ON NEC TABLE 310.15(B)(16).
- CONDUIT SIZES ARE BASED ON A MAXIMUM FILL RATIO OF 40%.
- SCHEDULE SHALL BE USED FOR FEEDERS AND BRANCH CIRCUITS WHERE APPLICABLE.
- ALL FEEDERS AND BRANCH CIRCUITS SHALL INCLUDE AN EQUIPMENT GROUNDING CONDUCTOR. SCHEDULE IS VALID FOR TYPE THHN, THWN-2, AND XHHW-2 CONDUCTORS. SEE SPECIFICATIONS FOR CONDUCTOR TYPES REQUIRED.
- SCHEDULE IS VALID FOR TYPE EMT, IMC, FMC, LFMC, HDPE, AND RNC-40 RACEWAYS. SEE SPECIFICATIONS FOR RACEWAY APPLICATIONS.
- OPTIONAL CONFIGURATIONS (1 OR 2 SETS) ARE GIVEN FOR SOME SIZES.
- NOT ALL SIZES USED.

DLR Group  
© DLR Group



Workman Elementary School  
Covina Valley USD  
1041 E WORKMAN AVE, WEST COVINA, CA 91791

100%  
CONSTRUCTION  
DOCUMENTS  
11/04/2022  
REVISIONS

75-22605-00

ELECTRICAL  
DIAGRAMS AND  
SCHEDULES

E5.1



