

**ARLINGTON COUNTY, VIRGINIA
OFFICE OF THE PURCHASING AGENT**

INVITATION TO BID NO. 23-CPHD-ITBPW-379

ADDENDUM NO. 3

Arlington County Invitation to Bid No. 23-CPHD-ITBPW-379 for renovations at 11th Street Park is amended as follows:

ELECTRONIC SEALED BIDS WILL BE RECEIVED BY ARLINGTON COUNTY VIA VENDOR REGISTRY UNTIL 2:00 P.M. ON THE 5TH DAY OF DECEMBER 2022

Sign in sheet for the prebid conference is attached to this addendum.

Arlington County Invitation to Bid No. 23-CPHD-ITBPW-379 for renovations at 11th Street Park received the following questions:

Q: Who is responsible for obtaining and paying for the permit for this project?

A: The LDA permit has already been procured by DPR. All other permits are the responsibility of the contractor.

Q: Please provide basis of design for root aeration geo-composite matting shown on detail E/L-02.

A: Geo-composite matting will need to be used where there is fill within the area shown on the plans in order to protect the large tree roots. It may not be needed over the whole area, this will be determined at the preconstruction meeting with the County Urban Forester.

Q: Please provide a detail for brick paver and curb/gutter reinstallation.

A: Refer to Arlington County standard details R-2.0 and R-2.1 (attached).

Q: Does Detail E/L-02 apply for the entire new sidewalk? If not, please clarify where this detail is applicable. Please also clarify where detail 1/L-08 is applicable for the new sidewalk.

A: The Detail E/L-02 has been removed (ie, crossed out) on the plans and is not applicable. Detail 1/L-08 is for the entirety of the concrete sidewalk.

Q: Please provide a quantity for how many bike racks are required as none are shown on the site plan.

A: Two (2) bike racks to be installed.

Q: Re: the electrical duct bank that needs to be installed under N. Danville Street, would the road closure be for an entire day and reopened at the end of each day? Or can the road be permitted closed for 3 days?

A: Contractor is responsible for coordinating the utility connection and any related permits, including right-of-way permits, to perform the work. The schedule as well as means and methods shall be determined by the contractor.

Q: Sheet E-01 Detail 7 is calling for the pole base to be flush with the ground. As this will be a grass area, the fixture would not have protection from lawnmowers. Please advise if pole base is to be flush as shown or revised and raised 4" above grade (to make the pole base 3'4" in total height).

A: Bid per the requirements indicated in the Contract Documents.

Q: Sheet E-01 Detail 7 is calling for a 24" pole base. The base of the fixture is going to be 8" in diameter. Please confirm if the 24" diameter pole base is correct

A: Bid per the requirements indicated in the Contract Documents.

Q: Sheet E-01 Detail 5 calls for (2) 4" ducts to be installed from the utility pole to the utility meter. Detail 2 on same sheet calls for (2) 2" ducts to be installed. Please advise if we are too install (2) 2" since this is a 20a service.

A: Provide two (2) 4-inch ducts below grade from the utility pole to the utility meter as required by detail 5 on sheet E-01. Stub the ductbank conduit 6-inches above housekeeping pad. Provide one (1) 2-inch conduit extending from the ductbank conduit stub and connect to the utility meter as required by detail 2 on sheet E-01.

The balance of the solicitation remains unchanged.

Arlington County, Virginia


Lucas Alexander, VCO, VCA
Procurement Officer

RETURN THIS PAGE, FULLY COMPLETED AND SIGNED, WITH YOUR BID:


BIDDER ACKNOWLEDGES RECEIPT OF ADDENDUM NUMBER 3.

FIRM NAME: _____


AUTHORIZED SIGNATURE: _____ **DATE:** _____

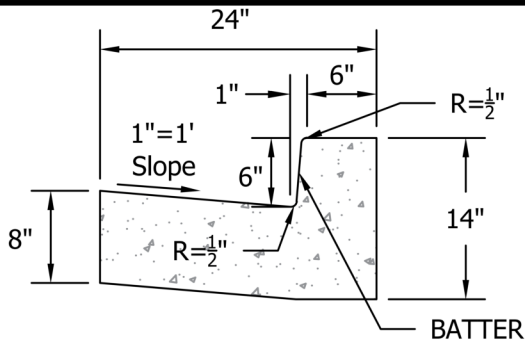


(C-2) STANDARD CURB & GUTTER

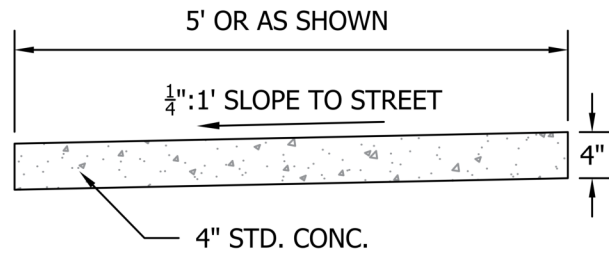


STANDARD CONCRETE SIDEWALK

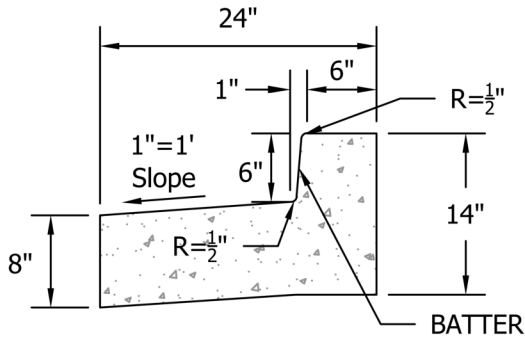


(C-2R) STANDARD REVERSE PITCH CURB & GUTTER

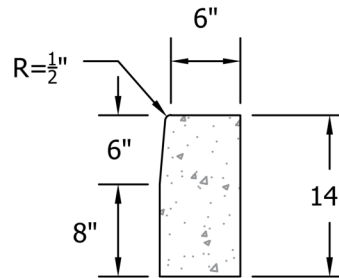

(C-3) STANDARD HEADER CURB

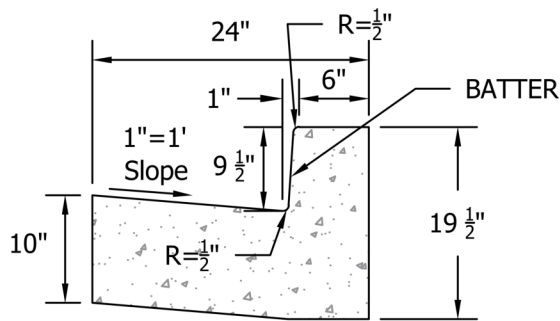

(C-4) STANDARD CURB & GUTTER FOR TRANSIT STATION

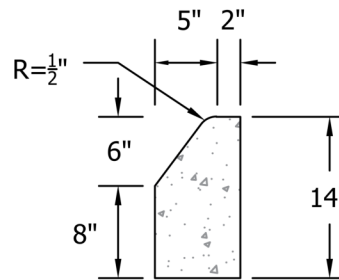

(C-5) ALTERNATE CURB FOR MEDIANS

NOTES:

1. SECTION C-3 IS TO BE USED ONLY WITH RIGID TYPE PAVEMENT UNLESS OTHERWISE DIRECTED IN WRITING OR WHEN SHOWN ON APPROVED PLANS.
2. EXPANSION JOINTS IN HEADER CURB AND STANDARD CURB AND GUTTER SHALL BE 40' APART OR AT EXPANSION JOINTS IN CONCRETE PAVEMENT.
3. EXPANSION JOINTS MAY BE OMITTED IF 1/8" JOINTS ARE PLACED EVERY 10' OF LESS
4. EXPANSION JOINTS IN THE SIDEWALK SHALL BE 40' APART. IF ADJACENT TO CONCRETE CURB, EXPANSION JOINTS SHALL MATCH JOINT OF CURB. AN EXPANSION JOINT SHALL BE PLACED BETWEEN CURB AND SIDEWALK.
5. SEE DRAWING R-2.2 FOR DETAIL OF SIDEWALK STRESS COLUMN TO BE PLACED UNDER SIDEWALK WHEN PLACED ADJACENT TO BACK OF CURB.
6. SEE ARLINGTON COUNTY SPECIFICATION SECTIONS 02611 AND 03100 FOR MATERIAL SPECS.
7. PROVIDE 6" MINIMUM AGGREGATE BASE HAVING CBR-30 UNDER CURB AND GUTTER.
8. PROVIDE 3" MINIMUM AGGREGATE BASE HAVING CBR-30 UNDER SIDEWALK
9. WHENEVER CURB ABUTTS RIGID PAVEMENT, PROVIDE LONGITUDINAL JOINT PER VDOT PR-2.
10. SECTION C-5 TO BE USED WHEN BICYCLE LANE RUNS ALONG A MEDIAN.


CONCRETE CURB & GUTTER AND SIDEWALK




ARLINGTON COUNTY, VIRGINIA
DEPARTMENT OF ENVIRONMENTAL SERVICES

ISSUED 9/14/2020

DRAWING NO.
R-2.0

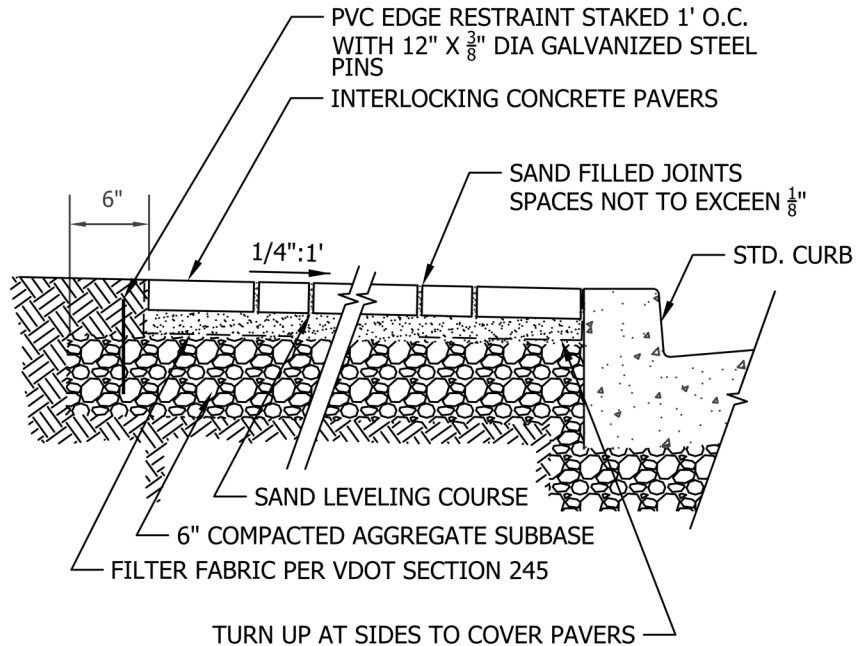

STANDARD INTERLOCKING CONCRETE PAVERS

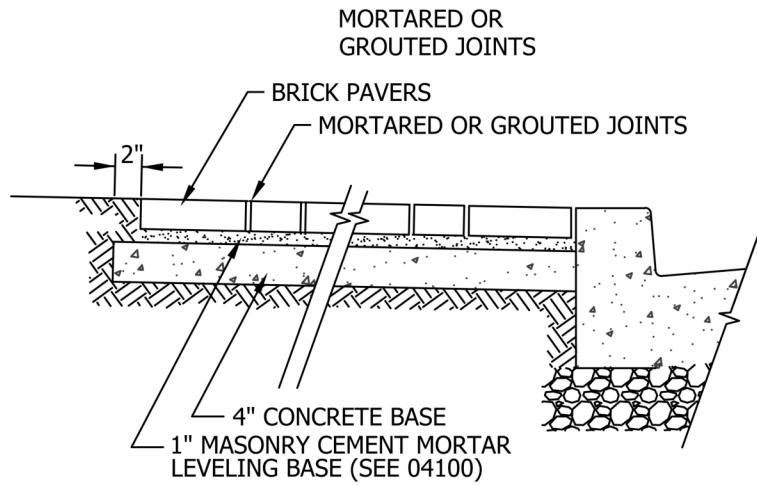

ALTERNATE BRICK PAVERS

NOTES:

1. REFER TO SECTION 02611 AND SECTION 02612 OF THE SPECIFICATIONS FOR INTERLOCKING CONCRETE PAVERS AND BRICK PAVERS AND OTHER RELATED MATERIALS SHOWN ON SIDEWALK APPLICATIONS.
2. ALL BRICK SHALL MEET ASTM SPECIFICATIONS C-902-78.
3. FOR DRIVEWAY APPLICATION SEE DRAWING R-2.4 AND RELATED SPECS.

**INTERLOCKING CONCRETE AND BRICK PAVERS
FOR SIDEWALK APPLICATION**

ISSUED 9/14/2020

DRAWING NO.
R-2.1



ARLINGTON COUNTY, VIRGINIA
DEPARTMENT OF ENVIRONMENTAL SERVICES