GENERAL NOTES:

A. INFORMATION SHOWN ON THIS DRAWING PERTAINING TO EXISTING CONDITIONS HAS BEEN OBTAINED FROM AVAILABLE BUILDING DRAWINGS OR GENERAL FIELD OBSERVATIONS AND MAY NOT INDICATE EXISTING CONDITIONS IN DETAIL OR DIMENSION. DETERMINE EXISTING CONDITIONS PRIOR TO FABRICATION OR PERFORMANCE OF ANY WORK. SHOULD CONDITIONS BE DISCOVERED THAT PREVENT EXECUTION OF THE WORK AS INDICATED, IMMEDIATELY NOTIFY THE ARCHITECT IN WRITING AND AWAIT DIRECTION BEFORE PROCEEDING WITH THE WORK.

B. THE GENERAL LOCATION OF UNDERGROUND UTILITIES INDICATED ARE NOT TO BE ASSUMED TO BE ACCURATE OR COMPLETE. PRIOR TO EXCAVATING, FIELD CHECK AREAS WITH THE MOST ACCURATE INSTRUMENTS AVAILABLE, SUCH AS "FISHER LABS" PIPE AND CABLE LOCATORS.

C. SHOULD DISCREPANCIES BE DISCOVERED BETWEEN THE DRAWINGS AND FIELD CONDITIONS, IMMEDIATELY NOTIFY THE ARCHITECT IN WRITING AND AWAIT DIRECTION BEFORE PROCEEDING WITH THE WORK.

D. NOTIFY "MISS UTILITY" (1-800-257-7777) AT LEAST FIVE (5) WORKING DAYS PRIOR TO STARTING SITE WORK.

E. COORDINATE ROUTING OF UNDERGROUND CONDUITS WITH LOCATIONS OF PROPOSED TREES AND SHRUBS SHOWN ON LANDSCAPE PLANS. DO NOT RUN UNDERGROUND CONDUITS WITHIN CRITICAL ROOT ZONE OF PROPOSED TREES.

F. PROVIDE 2 #10 + #10 GROUND IN 1" UNDERGROUND CONDUIT, UNLESS OTHERWISE NOTED.
- UNDER ROADS, PAVED AREAS, AND RETAINING WALLS: PROVIDE CONDUIT IN CONCRETE-ENCASED DUCTBANK.
- UNDER SIDEWALKS AND UNPAVED SURFACES: PROVIDE DIRECT-BURIED CONDUIT.

SPECIFIC NOTES:

1. PROVIDE 2-WAY SECONDARY UTILITY DUCTBANK.
2. PAD-MOUNTED, WEATHER-PROOF ENCLOSURE FOR ELECTRICAL EQUIPMENT.

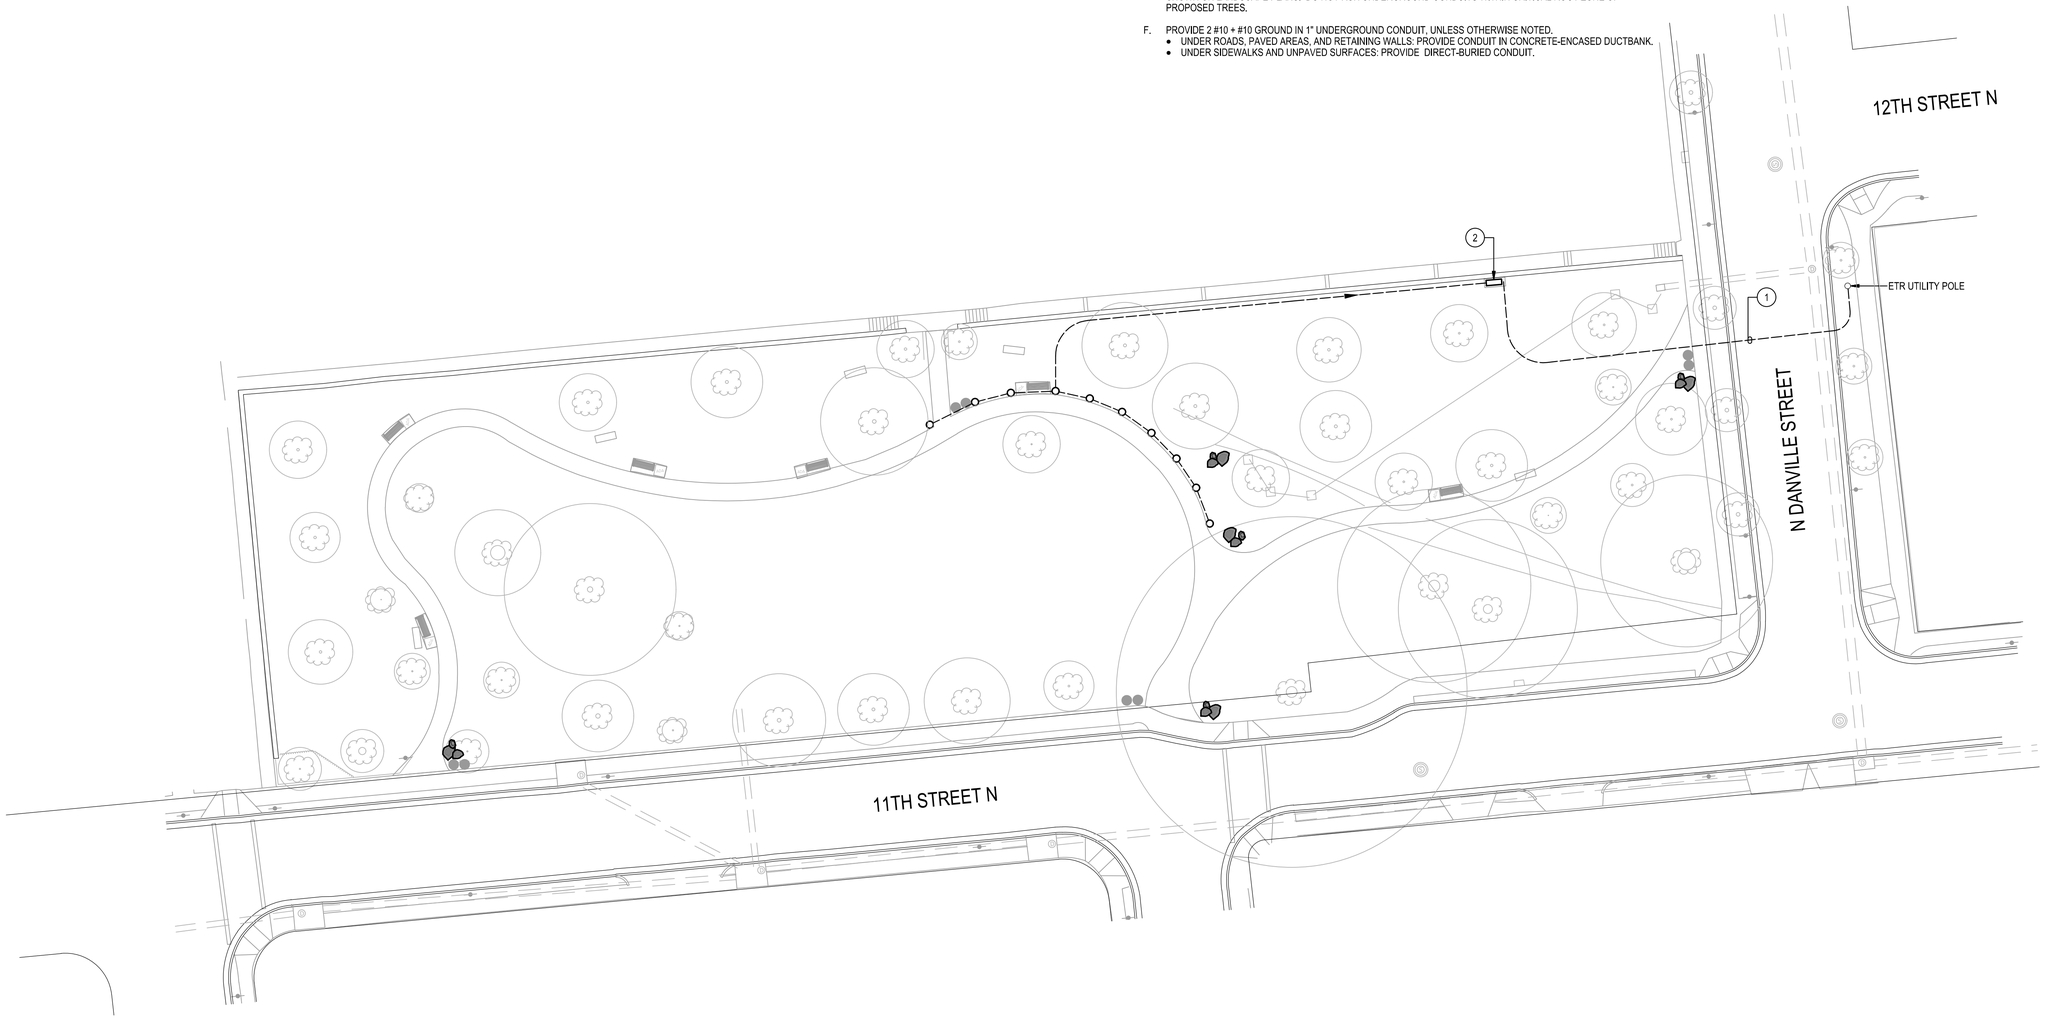

1 / E-02 ELECTRICAL SITE PLAN
SCALE: 1" = 20'-0"

NORTH

20 10 0 20 40
SCALE: 1" = 20'-0"

ARLINGTON VIRGINIA

DEPARTMENT OF PARKS AND RECREATION

Park Development Division
2100 Clarendon Boulevard, Suite 414
Arlington, VA 22201
Phone: 703.228.3332
Fax: 703.228.3328

-

Project Name and Location
11th & Danville Public Space Improvements
2751 11th Street N
Arlington, VA 22201

Sheet Title
ELECTRICAL SITE PLAN

Approval Date
Design Manager

Revisions Date

Designed: BMM
Drawn: BMM
Checked: TMC

Filename: 7570e02.dwg
Plotted: 2022-05-12

Scale:
Date: MAY 12, 2022

Seal
COMMONWEALTH OF VIRGINIA
THOMAS M. CLIFFORD
LIC. NO. 042569
PROFESSIONAL ENGINEER
MAY 12, 2022

Sheet
E-02

Path: I:\7570-21\5-Drawings\Electrical\ Filename: 7570E02.dwg