



ENVIRONMENTAL SERVICE GROUP JOB # AS-1752

ASBESTOS INSPECTION REPORT
COMMERCIAL PROPERTY
513 9TH AVE N.
MYRTLE BEACH, SC



Prepared For:

City of Myrtle Beach
Construction Services
ATTN: Chris Lee
843.918.1111
843.602.2635

Prepared By:

Jeremy Hudson
Environmental Service Group
P.O. Box 2798
Myrtle Beach, SC 29578
843-742-1344

09 August 2017

TABLE OF CONTENTS

1.0	Signature Page
2.0	Executive Summary
3.0	Scope of Work
4.0	Material Data Tables
	4.1 Suspect Material Data Table
	4.2 Building Materials
5.0	Conclusions
6.0	Recommendations

APPENDICES

SITE PLAN

PHOTOGRAPHS

LABORATORY RESULTS

Section 1.0

Signature Page

This report, entitled Inspection Report: Commercial Property – 513 9th Ave N. Myrtle Beach, SC has been prepared, at the request of Chris Lee, of the City of Myrtle Beach, by Environmental Service Group (ESG). The inspection was conducted by and the report was prepared and reviewed by the undersigned.

Inspection Conducted By:	SC-DHEC #	License Expiration Date	Signature	Date
Jeremy Hudson	BI-01530	06/21/2018	<i>Jeremy Hudson</i>	08/09/2017
Report Prepared By:	SC-DHEC #	License Expiration Date	Signature	Date
Jeremy Hudson	BI-01530	06/21/2018	<i>Jeremy Hudson</i>	08/09/2017

Section 2.0

Executive Summary

As authorized by Chris Lee, ESG conducted an Asbestos Survey of the facility on Saturday July 22, 2017. The purpose of this survey was to identify any Asbestos Containing Building Materials (ACBM's) within the structure. The facility has been vacant for some time and is scheduled for future demolition.

The subject building, total approximately 4,910 Sq Ft ± is a former trade shop that consists of one large open room throughout the entire structure. There were no indications that it had ever been utilized for the manufacturing and/or storage of materials that would be considered a threat to human health. Information gained would indicate that the building was constructed in 1968.

A visual description of building materials found within the facility would include floor coverings of non-suspect bare concrete throughout the entire structure, with the exception of areas designated on site plan within this report, that contain *Double-Layered 12x12 Vinyl Tiles w/Mastic. Ceiling coverings would consist of a non-suspect exposed wooden truss system and wooden substrate for the roof. Interior walls were concrete with a *Plaster Skim Coat. There was no insulation observed within the interior wall cavities. Exterior walls are non-suspect painted concrete block and brick & mortar. Exterior/internal doors were metal/glass and wood, and did not contain materials suspect of being ACBMs. The roof consisted of a flat roof design with *Rubber Membrane, *Asphalt Patching/Flashing, and a white paint-like coating.

NOTE: Materials with * were suspect of containing asbestos and were sampled.

Asbestos Assessment: There were materials suspect of being Asbestos Containing Building Materials (ACBMs).

During the asbestos survey, a total of twenty (20) samples of suspect/unknown building materials were collected and submitted for laboratory analysis by Polarized Light Microscopy (PLM) and the Point Count Method.

*Only areas directly affected by the planned renovations were tested. Areas and materials that are not within the planned renovations were not tested.

Asbestos Containing Building Materials (ACBMs) were identified within the facility.

HA1 – Double-Layered 12x12 Vinyl Floor Tiles w/Mastic (10% Chrysotile in Mastic)

If desired, *Environmental Service Group* will assist in preparing, if needed, an *Asbestos Abatement Project Licenses Application* (DHEC form 3430) and, a *Notification of Demolition* (DHEC Form 3428), and forward them to the South Carolina Department of Health and Environmental Control-Asbestos Division for action as appropriate. The projected date for approval to proceed will be approximately ten (10) working days after date of posting.

This report is based on a non-destructive survey of an unfamiliar site. Every effort was made to locate the presence of asbestos containing building materials (ACBMs) within the areas included in the survey. It is recognized that construction techniques often create inaccessible void spaces, which without destructive

sampling techniques being employed, would not be accessed during this survey. It must therefore be assumed that ACBMs other than those located within the survey may exist within the facility.

For the reasons set above, we cannot give assurances that all asbestos containing materials have been located and as such we recommend that further sampling be undertaken should these areas become accessible during the course of any future renovation and/or demolition activities.

Jeremy Hudson

Consultant

SCDHEC Accreditation # BI-01530

Section 3.0

Scope of Work

Environmental Service Group utilized only SCDHEC licensed and AHERA certified asbestos building inspectors, management planners and/or project designers, as needed, to complete the project. The laboratory utilized, EHS Laboratories, is accredited IAW 40 CFR 163 & FR/ Vol. 52. No. 210_763.91 Analysis.

Visual Inspection

An initial building walk-through was conducted to determine the presence and condition of suspect materials that were accessible and/or exposed. Materials which were visually similar in color, texture, and general appearance, and which appeared to have been installed at the same time were grouped into homogeneous sampling areas. Such materials are termed “homogeneous materials” by the EPA. During this walk-through, the approximate locations of the observed homogeneous materials were noted. Only materials that were accessible and/or exposed and suspected to contain asbestos were identified. Following the EPA inspection protocol, each identified suspect homogeneous material may be placed in one of the following EPA classifications:

- Surfacing Materials (spray or trowel applied to building members)
- Thermal System Insulation (materials generally applied to various mechanical systems)
- Miscellaneous Materials (any materials which do not fit either of the above categories)

Sampling Procedures

Following the visual survey, the inspector collected representative samples of exposed and/or accessible materials identified as suspect ACM. Sampling was limited to those accessible materials not involving wholesale destruction of walls, other building elements, physical barriers, or the structural integrity of the component being tested.

General EPA guidelines were used to determine the sampling protocol. Sampling locations were chosen to be representative of the homogeneous materials.

Quantification

Quantities of accessible and/or exposed building materials that were identified as suspect asbestos-containing materials were estimated. This estimation was conducted by taking approximate measurements in the field.

Quantities are estimates and should be confirmed by an engineering survey if demolition activities are contemplated. The level of detail provided by an engineering survey, which is required for a construction estimate, is beyond the scope of the present survey.

Material Assessment

The condition of the suspect material is an indication of the likelihood that it may release asbestos fibers in to the environment. The combination of its current condition coupled with the potential for damage to the material in the future determines which EPA response priority is appropriate for that material.

The condition of each homogeneous suspect material identified within the facility was assessed using the EPA decision tree approach. The friability of each material was determined and then its condition and potential for future damage was assessed using the following criteria:

Source and type of damage

- Physical contact
- Water or air erosion
- Deterioration or material delamination

Extent of damage:

- Good: No damage or little damage
- Damaged: Less than 10% damage, evenly distributed over the entire material or less than 25% damage confined to a localized area of the material.
- Significantly damaged: 10% or more damage distributed evenly over the entire material or 25% or more damage within a localized area of the material

Potential for future damage:

- Frequency of access to material
- Height of material
- Location of material in a plenum
- Exposure of material
- Accessibility
- Presence in an area of air movement, vibrations, loud noises

Section 4.0 Material Data Tables

4.1 Suspect Material Data Table

Project Name: AS 1752 – Commercial Property

Site: 513 9th Ave N. Myrtle Beach, SC

Inspector Name: Jeremy Hudson

Date: 09 August 2017

HA #	AC M	MATERIAL DESCRIPTION	CATEGORY	FRIABLE F/NF	QUANTITY SQ FT±	NO. SAMPLE TAKEN	PRESENT CONDITION	POTENTIAL FOR DISTURBANCE	COMMENTS
1	P	DOUBLE-LAYERED 12X12 FLOOR TILES W/MASTIC	MISC	F	775 SQ FT±	3	D	LPD*	10% CHRYSOTILE
	LOCATION: DESIGNATED AREAS						NOTE: MATERIAL IS CURRENTLY FRIABLE BUT STILL HAS LPD*		
20	ND	CONCRETE WALLS W/PLASTER SKIM COAT	SURF	NF	2,000 SQ FT±	5	SD	PD	ND
	LOCATION: PERIMETER WALLS						NOTE:		
50	ND	HVAC TAPE MASTIC	MISC	NF	<50 SQ FT±	3	D	LPD	ND
	LOCATION: HVAC DUCTWORK						NOTE:		
80	ND	ROOFING MATERIALS	MISC	NF	4,950 SQ FT±	3	G	LPD	ND
	LOCATION: ENTIRE ROOF						NOTE:		
	LOCATION:						NOTE:		
	LOCATION:						NOTE:		
	LOCATION:						NOTE:		
	LOCATION:						NOTE:		

(ACM) ASBESTOS FINDINGS P = POSITIVE (%) ND = NON DETECT

PRESENT CONDITION

CATEGORY (SURF) SURFACING, TSI, (MISC) MISCELLANEOUS

G = GOOD (VERY LOCALIZED LIMITED DAMAGE)

D = DAMAGED (DAMAGE < 10% DISTRIBUTED OR < 25% LOCALIZED)

SD = SIGNIFICANTLY DAMAGED (DAMAGE = OR > 10% DISTRIBUTED / 25% LOCALIZED)

POTENTIAL FOR FUTURE DISTURBANCES

LPD = LOW POTENTIAL FOR DISTURBANCE (CONTACT/VIBRATION/AEROSOL ALL OF LOW CONCERN)

HA# = HOMOGENOUS AREA NUMBER

PD = POTENTIAL FOR DAMAGE (CONTACT/ VIBRATION/ AIR EROSION OF MODERATE CONCERN)

PSD = POTENTIAL FOR SIGNIFICANT DAMAGE (CONTACT/VIBRATION/AIR EROSION OF HIGH CONCERN)

4.2 Building Materials

Project Name: AS 1752 – Commercial Property
 Site: 513 9th Ave N. Myrtle Beach, SC

Inspector Name: Jeremy Hudson
 Date: 09 August 2017

Floors: All Building Size: 4,910 SQ FT±

<u>BUILDING MATERIALS/ CONSTRUCTION</u>	SQ FT	* Tested for ACM's
<i>EXTERIOR</i>		
STRUCTURE:		CONCRETE FOUNDATION, METAL-FRAME WALLS, FLAT ROOF
EXTERIOR COVERING:		CONCRETE BLOCK, BRICK & MORTAR
EXTERIOR COATING:		PAINT
DOORS:		METAL/GLASS/WOOD
WINDOWS:		METAL/GLASS
ROOF MATERIALS:		*RUBBER MEMBRANE, *ASPHALT PATCHING, PAINT-LIKE COATING
ROOF INSULATION:		NONE
EAVES:		NONE
ROOF DRAIN:		NONE
<i>INTERIOR</i>		
FLOOR COVERING:		*DOUBLE-LAYERED 12X12 FLOOR TILES W/MASTIC
WALL COVERING:		*CONCRETE WALLS W/PLASTER SKIM COAT
CEILING MATERIALS:		NONE – EXPOSED WOODEN TRUSS SYSTEM
FIREPROOFING:		NONE
FIRE DOORS:		NONE
<i>MECHANICAL</i>		
FURNACE/ BOILER JACKET:		NONE
EXHAUST BREECHING:		NONE
PIPE INSULATION		NONE
FITTING INSULATION:		NONE
HEAT SHIELDS:		NONE
EXPANSION TANK INSULATION:		NONE
PIPE INSULATION:		NONE
FITTING INSULATION:		NONE
HVAC DUCTWORK:		NONE
FLEX CONNECTORS:		NONE
<i>NOTE: THERE WERE NO OTHER SUSPECT MATERIALS IDENTIFIED</i>		

Section 5.0

Conclusion

A visual inspection and sampling survey of impacted materials within the facility was conducted in accordance with the general Environmental Protection Agency (EPA) / Asbestos Hazard Emergency Response Act (AHERA) sampling guidelines to determine the presence of exposed and/or accessible suspect asbestos-containing materials.

Asbestos Containing Building Materials (ACBMs) were identified within the facility.

HA1 – Double-Layered 12x12 Vinyl Floor Tiles w/Mastic (10% Chrysotile in Mastic)

If desired, *Environmental Service Group* will assist in preparing, if needed, an *Asbestos Abatement Project Licenses Application* (DHEC form 3430) and, a *Notification of Demolition* (DHEC Form 3428), and forward them to the South Carolina Department of Health and Environmental Control-Asbestos Division for action as appropriate. The projected date for approval to proceed will be approximately ten (10) working days after date of posting.

This report is based on a non-destructive survey of an unfamiliar site. Every effort was made to locate the presence of asbestos containing building materials (ACBMs) within the areas included in the survey. It is recognized that construction techniques often create inaccessible void spaces, which without destructive sampling techniques being employed, would not be accessed during this survey. It must therefore be assumed that ACBMs other than those located within the survey may exist within the facility.

For the reasons set above, we cannot give assurances that all asbestos containing materials have been located and as such we recommend that further sampling be undertaken should these areas become accessible during the course of any future renovation and/or demolition activities.

Jeremy Hudson

Consultant

SCDHEC Accreditation # BI-01530

Section 6.0

Recommendations

It is recommended that notification of the presence of ACMs be provided to personnel engaged in day-to-day activities within the structure.

During demolition activities, if additional materials suspect of containing asbestos are identified, suspend work activities, and contact Richard Eason @ 843.902.4495 or Jeremy Hudson @ 843.742.1344

Jeremy Hudson

Jeremy Hudson
SC DHEC # BI-01530


**F = Friable Non = Non-friable*

**Chry = Chrysotile, Amos = Amosite, Croc = Crocidolite, Anth = Anthophyllite, Trem = Tremolite, Act = Actinolite*

GRAPHICS

GRAPHICS – SITE PLANS

513 9th Avenue North
4,910 +/- SF

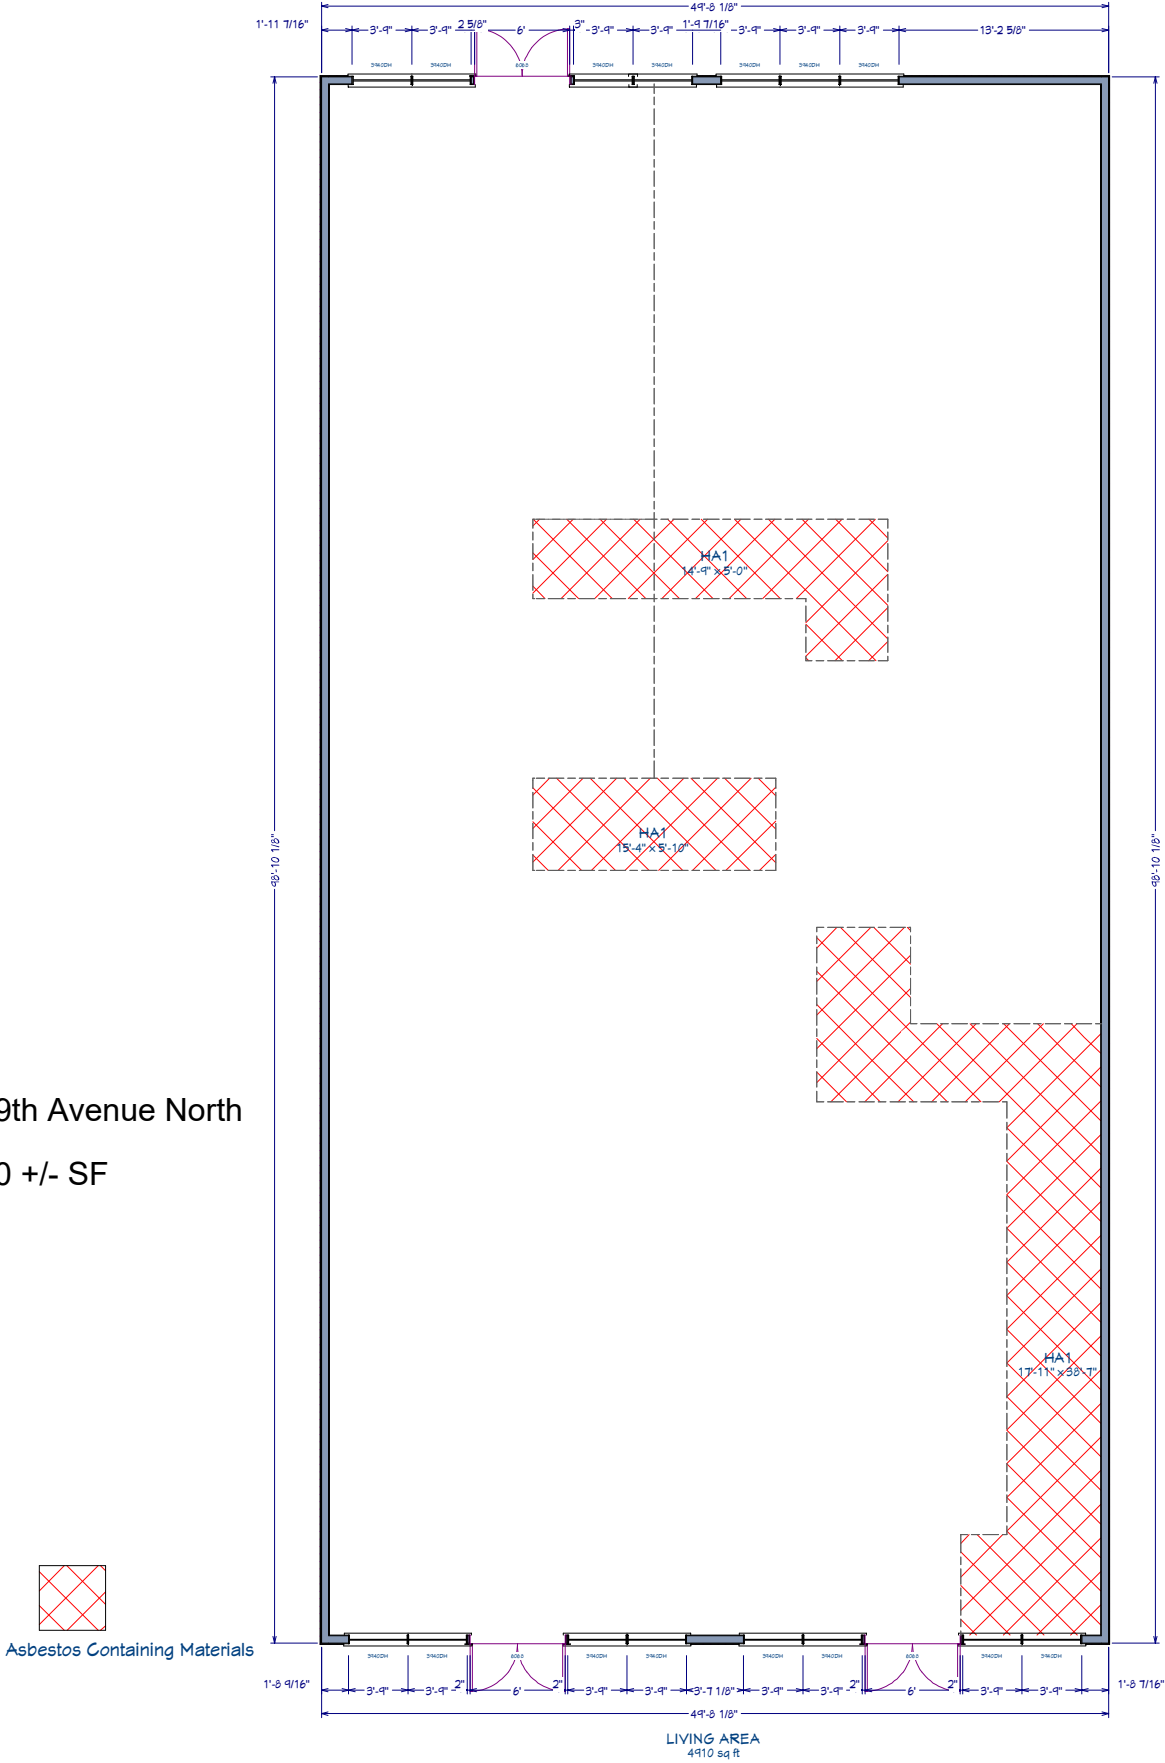

PHOTOGRAPHS

PHOTOGRAPHS

PICTURES

PROJECT No. AS-1752



Picture 1 – Front of Building



Picture 2 – Interior (View From Front Door)



Picture 3 – Interior (View From Back Door)



Picture 4 – **HA1 Double-Layered 12x12 Vinyl Tiles w/Mastic (Designated Areas Only – See Site Plan)**



Picture 5 – **HA1 Double-Layered 12x12 Vinyl Tiles w/Mastic (Designated Areas Only – See Site Plan)**



Picture 6 – **HA1 Double-Layered 12x12 Vinyl Tiles w/Mastic (Designated Areas Only – See Site Plan)**

PICTURES

PROJECT No. AS-1752



Picture 7 – HA20 Plaster Skim Coat on Concrete Block Walls



Picture 8 – HA20 Plaster Skim Coat on Concrete Block Walls



Picture 9 – Non-Suspect Exposed Ceiling Structure



Picture 10 – HA50 HVAC Tape Mastic



Picture 11 – HA80 Roofing Materials



Picture 12 – HA80 Roofing Materials

**CHAIN OF CUSTODY
AND
LABORATORY RESULTS**

**CHAIN OF CUSTODY
&
LABORATORY RESULTS**



August 7, 2017

Environmental Service Group
PO Box 2798
Myrtle Beach, SC 29578

CLIENT PROJECT: 513 9th Ave. N. Myrtle Beach; A51752
CEI LAB CODE: A17-10842

Dear Customer:

Enclosed are asbestos analysis results for PLM Bulk samples received at our laboratory on August 7, 2017. The samples were analyzed for asbestos using polarizing light microscopy (PLM) per the EPA 600 Method.

Sample results containing >1% asbestos are considered asbestos-containing materials (ACMs) per EPA regulatory requirements. The detection limit for the EPA 600 Method is <1% asbestos by weight as determined by visual estimation.

Thank you for your business and we look forward to continuing good relations. If you have any questions, please feel free to call our office at 919-481-1413.

Kind Regards,

A handwritten signature in black ink, appearing to read "Tianbao Bai", written in a cursive style.

Tianbao Bai, Ph.D., CIH
Laboratory Director





ASBESTOS ANALYTICAL REPORT

By: Polarized Light Microscopy

Prepared for

Environmental Service Group

CLIENT PROJECT: 513 9th Ave. N. Myrtle Beach; A51752

CEI LAB CODE: A17-10842

TEST METHOD: EPA 600 / R93 / 116 and EPA 600 / M4-82 / 020

REPORT DATE: 08/07/17

TOTAL SAMPLES ANALYZED: 11

SAMPLES >1% ASBESTOS: 1

TEL: 866-481-1412

www.ceilabs.com



Asbestos Report Summary

By: POLARIZING LIGHT MICROSCOPY

PROJECT: 513 9th Ave. N. Myrtle Beach; A51752

CEI LAB CODE: A17-10842

METHOD: EPA 600 / R93 / 116 and EPA 600 / M4-82 / 020

Client ID	Layer	Lab ID	Color	Sample Description	ASBESTOS %
1-1-F1		A2461386A	Green	Vinyl Tile	None Detected
		A2461386B	Yellow	Mastic	None Detected
		A2461386C	Pink	Vinyl Tile	None Detected
		A2461386D	Yellow	Mastic	Chrysotile 10%
1-1-F2		A2461387A	Green	Vinyl Tile	None Detected
		A2461387B	Yellow	Mastic	None Detected
		A2461387C	Pink	Vinyl Tile	None Detected
		A2461387D		Sample Not Analyzed per COC	
1-1-F3		A2461388		Sample Submitted for TEM Analysis	
20-1-P1		A2461389	White	Plaster Skim Coat	None Detected
20-1-P2		A2461390	White	Plaster Skim Coat	None Detected
20-1-P3		A2461391	White	Plaster Skim Coat	None Detected
20-1-P4		A2461392	White	Plaster Skim Coat	None Detected
20-1-P5		A2461393	White	Plaster Skim Coat	None Detected
50-HVAC1		A2461394	Tan	Hvac Tape Mastic	None Detected
50-HVAC2		A2461395	Tan	Hvac Tape Mastic	None Detected
50-HVAC3		A2461396		Sample Submitted for TEM Analysis	
80-R1		A2461397	Black,Silver	Roofing	None Detected
80-R2		A2461398	Black	Roofing	None Detected
80-R3		A2461399		Sample Submitted for TEM Analysis	



ASBESTOS BULK ANALYSIS

By: POLARIZING LIGHT MICROSCOPY

Client: Environmental Service Group
PO Box 2798
Myrtle Beach, SC 29578

CEI Lab Code: A17-10842

Date Received: 08-07-17

Date Analyzed: 08-07-17

Date Reported: 08-07-17

Project: 513 9th Ave. N. Myrtle Beach; A51752

ASBESTOS BULK PLM, EPA 600 METHOD

Client ID Lab ID	Lab Description	Lab Attributes	NON-ASBESTOS COMPONENTS				ASBESTOS %
			Fibrous		Non-Fibrous		
1-1-F1 A2461386A	Vinyl Tile	Heterogeneous Green Fibrous Bound	2%	Cellulose	60% 30% 8%	Vinyl Calc Carb Binder	None Detected
A2461386B	Mastic	Heterogeneous Yellow Fibrous Bound	2%	Cellulose	98%	Mastic	None Detected
A2461386C	Vinyl Tile	Heterogeneous Pink Fibrous Bound	2%	Cellulose	60% 30% 8%	Vinyl Calc Carb Binder	None Detected
A2461386D	Mastic	Heterogeneous Yellow Fibrous Bound			80% 10%	Mastic Binder	10% Chrysotile
Lab Notes: Analyst opinion: sample contaminated by positive paper material							
1-1-F2 A2461387A	Vinyl Tile	Heterogeneous Green Fibrous Bound	2%	Cellulose	60% 30% 8%	Vinyl Calc Carb Binder	None Detected
A2461387B	Mastic	Heterogeneous Yellow Fibrous Bound	2%	Cellulose	98%	Mastic	None Detected
A2461387C	Vinyl Tile	Heterogeneous Pink Fibrous Bound	2%	Cellulose	60% 30% 8%	Vinyl Calc Carb Binder	None Detected
A2461387D	Sample Not Analyzed per COC						



ASBESTOS BULK ANALYSIS

By: POLARIZING LIGHT MICROSCOPY

Client: Environmental Service Group
PO Box 2798
Myrtle Beach, SC 29578

CEI Lab Code: A17-10842
Date Received: 08-07-17
Date Analyzed: 08-07-17
Date Reported: 08-07-17

Project: 513 9th Ave. N. Myrtle Beach; A51752

ASBESTOS BULK PLM, EPA 600 METHOD

Client ID Lab ID	Lab Description	Lab Attributes	NON-ASBESTOS COMPONENTS				ASBESTOS %
			Fibrous		Non-Fibrous		
1-1-F3 A2461388	Sample Submitted for TEM Analysis						
20-1-P1 A2461389	Plaster Skim Coat	Heterogeneous White Non-fibrous Bound		50% 50%	Calc Carb Binder		None Detected
20-1-P2 A2461390	Plaster Skim Coat	Heterogeneous White Non-fibrous Bound		50% 50%	Calc Carb Binder		None Detected
20-1-P3 A2461391	Plaster Skim Coat	Heterogeneous White Non-fibrous Bound		50% 50%	Calc Carb Binder		None Detected
20-1-P4 A2461392	Plaster Skim Coat	Heterogeneous White Non-fibrous Bound		50% 50%	Calc Carb Binder		None Detected
20-1-P5 A2461393	Plaster Skim Coat	Heterogeneous White Non-fibrous Bound		50% 50%	Calc Carb Binder		None Detected
50-HVAC1 A2461394	Hvac Tape Mastic	Heterogeneous Tan Fibrous Bound	5%	Cellulose	95%	Mastic	None Detected
50-HVAC2 A2461395	Hvac Tape Mastic	Heterogeneous Tan Fibrous Bound	5%	Cellulose	95%	Mastic	None Detected



ASBESTOS BULK ANALYSIS

By: POLARIZING LIGHT MICROSCOPY

Client: Environmental Service Group
PO Box 2798
Myrtle Beach, SC 29578

CEI Lab Code: A17-10842
Date Received: 08-07-17
Date Analyzed: 08-07-17
Date Reported: 08-07-17

Project: 513 9th Ave. N. Myrtle Beach; A51752

ASBESTOS BULK PLM, EPA 600 METHOD

Client ID Lab ID	Lab Description	Lab Attributes	NON-ASBESTOS COMPONENTS				ASBESTOS %
			Fibrous		Non-Fibrous		
50-HVAC3 A2461396	Sample Submitted for TEM Analysis						
80-R1 A2461397	Roofing	Heterogeneous Black,Silver Fibrous Bound	20%	Fiberglass	75% 5%	Tar Paint	None Detected
80-R2 A2461398	Roofing	Heterogeneous Black Fibrous Bound	20%	Fiberglass	80%	Tar	None Detected
80-R3 A2461399	Sample Submitted for TEM Analysis						



LEGEND: Non-Anth = Non-Asbestiform Anthophyllite
 Non-Trem = Non-Asbestiform Tremolite
 Calc Carb = Calcium Carbonate

METHOD: EPA 600 / R93 / 116 and EPA 600 / M4-82 / 020

REPORTING LIMIT: <1% by visual estimation

REPORTING LIMIT FOR POINT COUNTS: 0.25% by 400 Points or 0.1% by 1,000 Points

REGULATORY LIMIT: >1% by weight

Due to the limitations of the EPA 600 method, nonfriable organically bound materials (NOBs) such as vinyl floor tiles can be difficult to analyze via polarized light microscopy (PLM). EPA recommends that all NOBs analyzed by PLM, and found not to contain asbestos, be further analyzed by Transmission Electron Microscopy (TEM). Please note that PLM analysis of dust and soil samples for asbestos is not covered under NVLAP accreditation. Estimated measurement of uncertainty is available on request.

This report relates only to the samples tested or analyzed and may not be reproduced, except in full, without written approval by CEI Labs, Inc. CEI Labs makes no warranty representation regarding the accuracy of client submitted information in preparing and presenting analytical results. Interpretation of the analytical results is the sole responsibility of the client. Samples were received in acceptable condition unless otherwise noted. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. Government.

ANALYST: Sarah Talley
Sarah Talley

APPROVED BY: Tianbao Bai
Tianbao Bai, Ph.D., CIH
Laboratory Director





730 SE Maynard Road, Cary, NC 27511
Tel: 866-481-1412; Fax: 919-481-1442

ASBESTOS CHAIN OF CUSTODY

(14) 77.10.842
A7461386-
A7461399

LAB USE ONLY:

CEI Lab Code:

CEI Lab I.D. Range:

COMPANY INFORMATION	PROJECT INFORMATION
CEI CLIENT #:	Job Contact: Jeremy Hudson
Company: Environmental Service Group	Email / Tel:
Address: PO Box 2798	Project Name: 513 9th Ave N. Myrtle Beach
Myrtle Beach, SC 29578	Project ID#: AS1752
Email: environmental-service@sc.rr.com	PO #:
Tel: 843.902.4495	STATE SAMPLES COLLECTED IN: SC

IF TAT IS NOT MARKED STANDARD 3 DAY TAT APPLIES.

ASBESTOS	METHOD	TURN AROUND TIME					
		4 HR	8 HR	24 HR	2 DAY	3 DAY	5 DAY
PLM BULK	EPA 600	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PLM POINT COUNT (400)	EPA 600	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PLM POINT COUNT (1000)	EPA 600	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PLM GRAV w POINT COUNT	EPA 600		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PLM BULK	CARB 435		<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
PCM AIR	NIOSH 7400	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM AIR	EPA AHERA	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM AIR	NIOSH 7402	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM AIR	ISO 10312	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM AIR	ASTM 6281-09	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM BULK	CHATFIELD		<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM DUST WIPE	ASTM D6480-05 (2010)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM DUST MICROVAC	ASTM D5755-09 (2014)	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM SOIL	ASTM D7521-13			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
TEM VERMICULITE	CINCINNATI METHOD			<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
OTHER:		<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

REMARKS / SPECIAL INSTRUCTIONS:

Stop Positive

☒ Accept Samples

☐ Reject Samples

Relinquished By:

Date/Time

Received By:

Date/Time

[Signature]

7/31/17

1:00 hrs

DC

8-1

10:20

8-7

1:00

Samples will be disposed of 30 days after analysis

Page 1 of 2

ASBESTOS SAMPLING FORM



COMPANY CONTACT INFORMATION

Company: Environmental Service Group	Job Contact: Jeremy Hudson
Project Name: 513 9th Ave N. Myrtle Beach	
Project ID #: AS1752	Tel: 843.902.4495

[illegible]