


BINDING EDGE


BINDING EDGE


BINDING EDGE

/ DATE: 10/12/2018 3:54:1

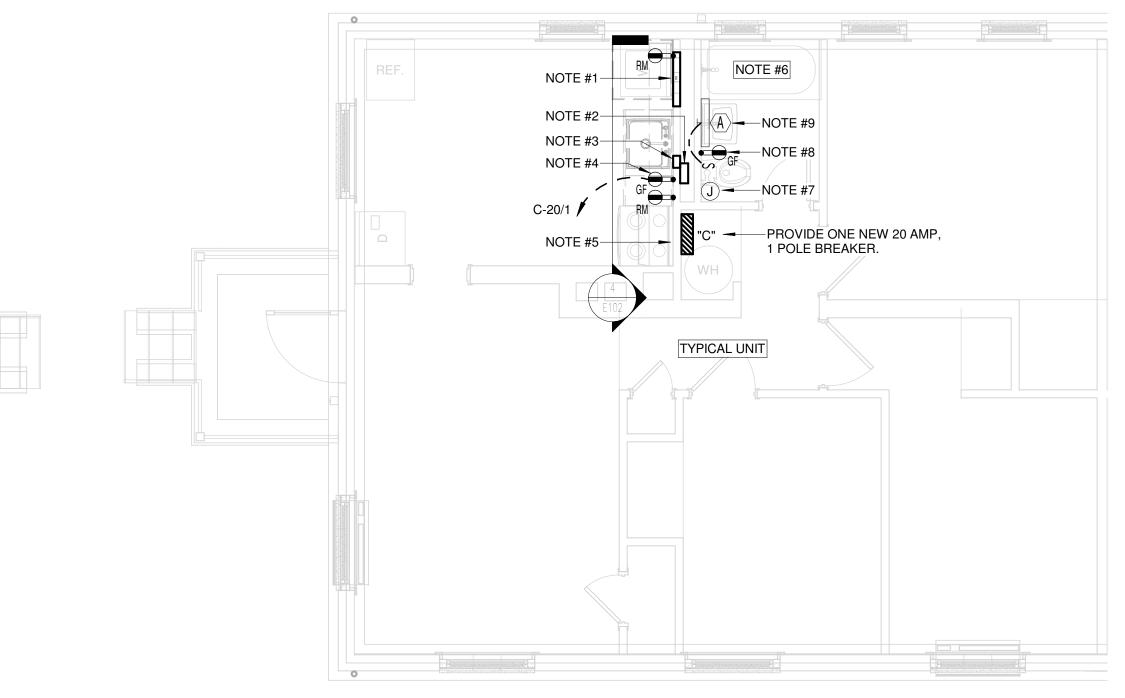


² TYPE C - TYPICAL UNIT ELECTRICAL PLAN 1/4" = 1'-0"

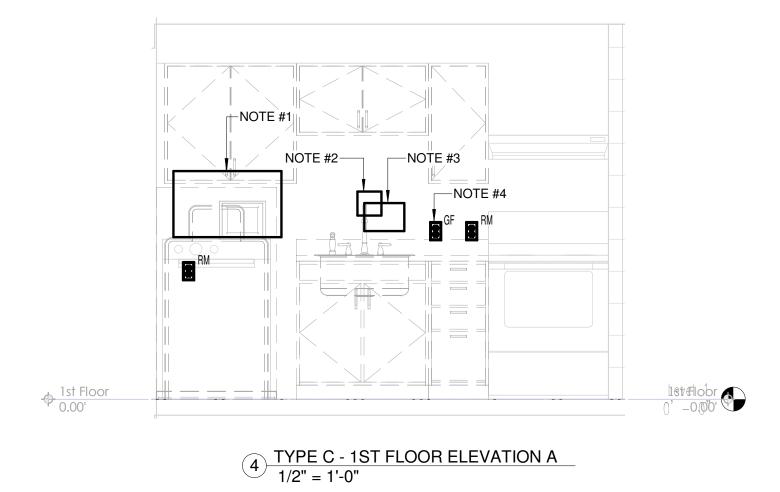

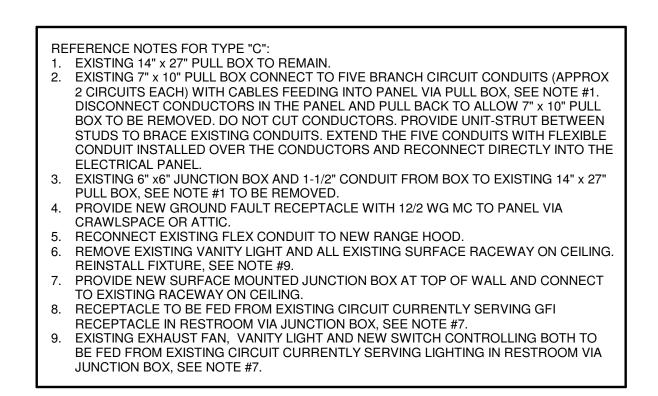

ALL ELECTRICAL WORK IS PART OF DEDUCT ALTERNATE 1



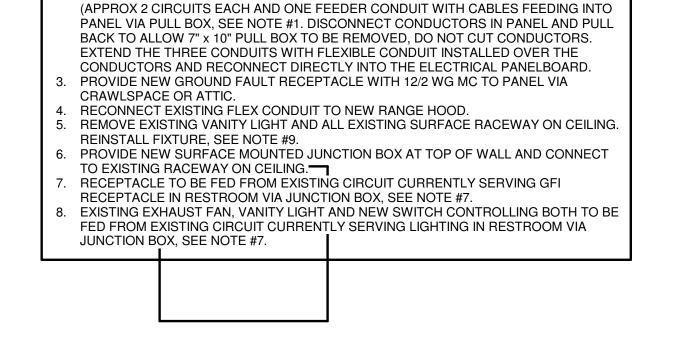



. EXISTING 14" x 21" PULL BOX TO REMAIN WITH TWO 1-1/2" CONDUITS(TOP FOR

FLEX CONDUIT FROM PULL BOX TO PANEL. REMOVE EXISTING CONDUCTORS


UTILIZING EXISTING 1-1/2"(FOR BRANCH CIRCUITING) AND THREE NEW FLEX

2. EXISTING 7" x10" PULL BOX CONNECTED TO TWO BRANCH CIRCUIT CONDUITS

CONDUITS TO HAVE MAX 6 CURRENT CARRYING CONDUCTORS EACH.

FEEDER, BOTTOM FOR BRANCH CIRCUITING) TO PANEL. PROVIDE THREE NEW 3/4"

REFERENCE NOTES FOR TYPE "D":

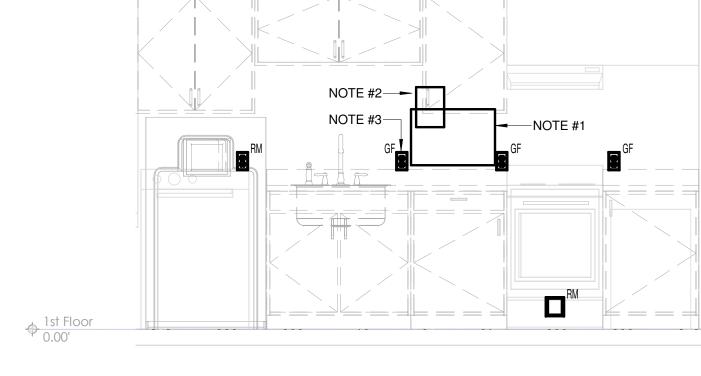

(5) TYPE D - TYPICAL UNIT FIRST FLOOR ELECTRICAL PLAN1/4" = 1'-0"

6 TYPE D - TYPICAL UNIT SECOND FLOOR ELECTRICAL PLAN 1/4" = 1'-0"

18tElc

