CONCEPTUAL SMART HUB WIRING DIAGRAM

NTS

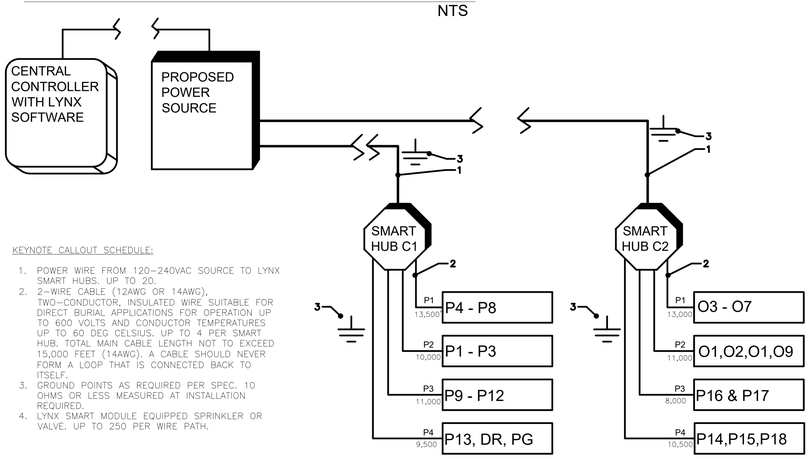

KEYNOTE CALLOUT SCHEDULE:

1. POWER WIRE FROM 120-240VAC SOURCE TO LYNX SMART HUBS, UP TO 20.
2. 2-WIRE CABLE (12AWG OR 14AWG), TWO-CONDUCTOR, INSULATED WIRE SUITABLE FOR DIRECT BURIAL APPLICATIONS FOR OPERATION UP TO 600 VOLTS AND CONDUCTOR TEMPERATURES UP TO 60 DEG CELSIUS. UP TO 4 PER SMART HUB. TOTAL MAIN CABLE LENGTH NOT TO EXCEED 15,000 FEET (14AWG). A CABLE SHOULD NEVER FORM A LOOP THAT IS CONNECTED BACK TO ITSELF.
3. GROUND POINTS AS REQUIRED PER SPEC. 10 OHMS OR LESS MEASURED AT INSTALLATION REQUIRED.
4. LYNX SMART MODULE EQUIPPED SPRINKLER OR VALVE. UP TO 250 PER WIRE PATH.

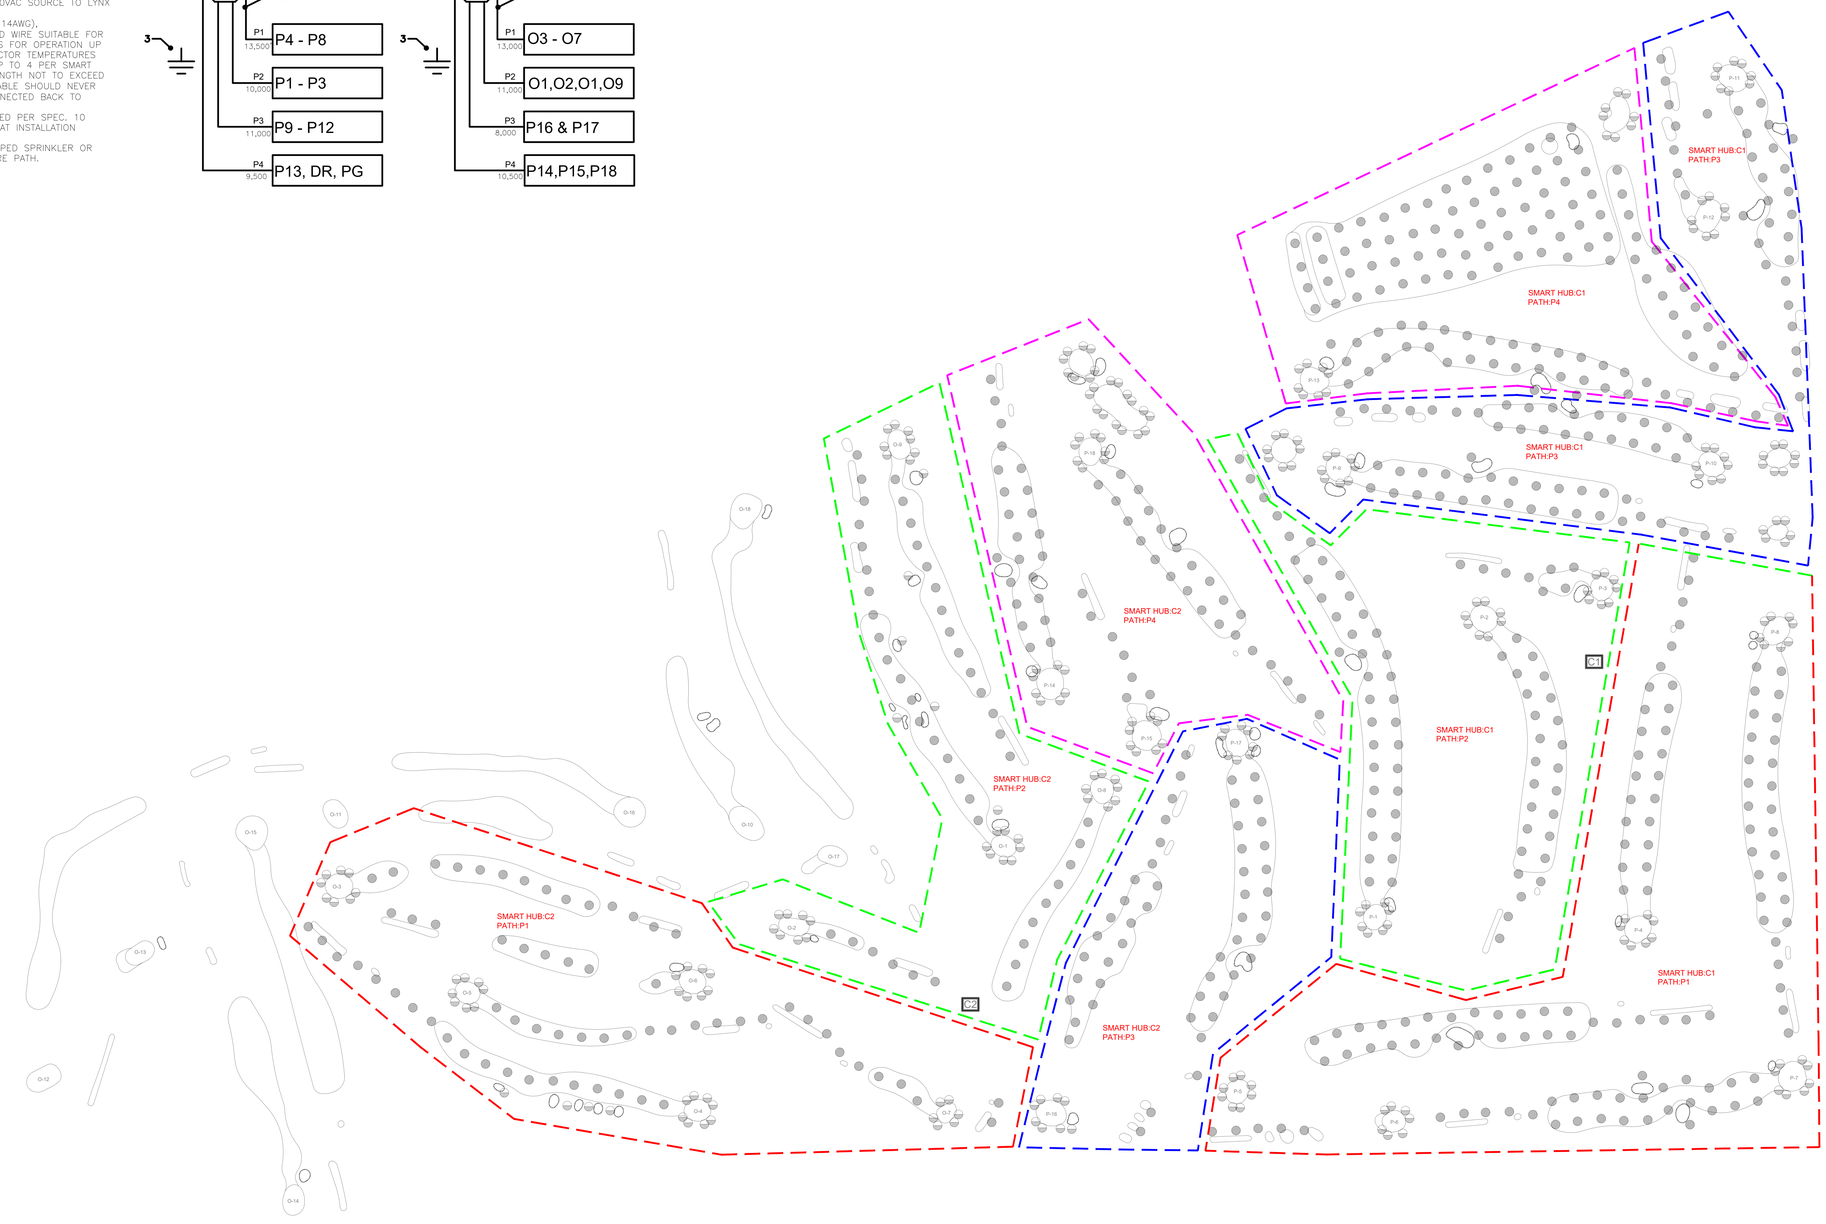

DISCLAIMER:

THIS PLAN HAS BEEN PREPARED FOR INFORMATIONAL PURPOSES ONLY. IT IS CONCEPTUAL IN NATURE AND NOT INTENDED FOR CONSTRUCTION. THE DESIGNER HAS RECEIVED BASE INFORMATION FROM OTHERS AND IS NOT RESPONSIBLE FOR THE ACCURACY AND COMPLETENESS THEREOF. SCHEDULES ARE PROVIDED FOR INFORMATIONAL PURPOSES ONLY AND SHALL BE CONSIDERED CONCEPTUAL IN NATURE. USE OF THIS PLAN BY ANYONE, IN ANY FORM, INDICATES YOUR ACKNOWLEDGMENT OF THE CONCEPTUAL, NOT FOR CONSTRUCTION, NATURE OF THIS PLAN DOCUMENT.

Jerry Pate Design
301 SCHUBERT DRIVE - PENSACOLA, FL 32504
850-479-4653 WWW.JERRYPATEDESIGN.COM

GRAPHIC SCALE
1/64 FIELD
1 INCH = 200 FT.

FORT WALTON BEACH GOLF CLUB

FORT WALTON BEACH, FL

CONCEPTUAL WIRING PLAN

DATE	REVISIONS

SCALE: 1" = 200'

DATE: 05/11/2021

SHEET NO.: IR102

THIS PLAN IS CONCEPTUAL IN NATURE AND IS NOT INTENDED FOR CONSTRUCTION