

**ADDENDUM NUMBER  
BID NUMBER RFP 24-009**

**PAINTING PROJECTS – SUMMER 2024**

**ISSUED: MARCH 6, 2024**


**PURCHASING DEPARTMENT  
UNIFIED SCHOOL DISTRICT 500  
2010 N. 59<sup>th</sup> STREET, ROOM 370  
KANSAS CITY, KANSAS 66104  
(913) 551-3200**


Note the following changes to the above-mentioned bid. This information is to be taken into consideration when responding to the original bid document.

- 1. Addition to the Specifications:** Site drawings for Wyandotte High School, Emerson Elementary, and Lindbergh Elementary are hereby added to the solicitation as Addendum 3 – Attachment A and attached hereto.
- 2. No Other Changes:** No other changes or modification are intended by this Addendum. All other terms and conditions of the solicitation remain in effect.


WE HEREBY ACKNOWLEDGE AND UNDERSTAND THE ABOVE NOTED CHANGES TO THE ORIGINAL BID DOCUMENT AND AGREE TO FURNISH THE ITEMS ON WHICH PRICES ARE QUOTED IN ACCORDANCE WITH ALL TERMS AND CONDITIONS PREVIOUSLY LISTED AND ANY ATTACHED SPECIFICATIONS AND AMENDMENTS.


BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
TITLE: \_\_\_\_\_ PHONE: \_\_\_\_\_  
FIRM \_\_\_\_\_

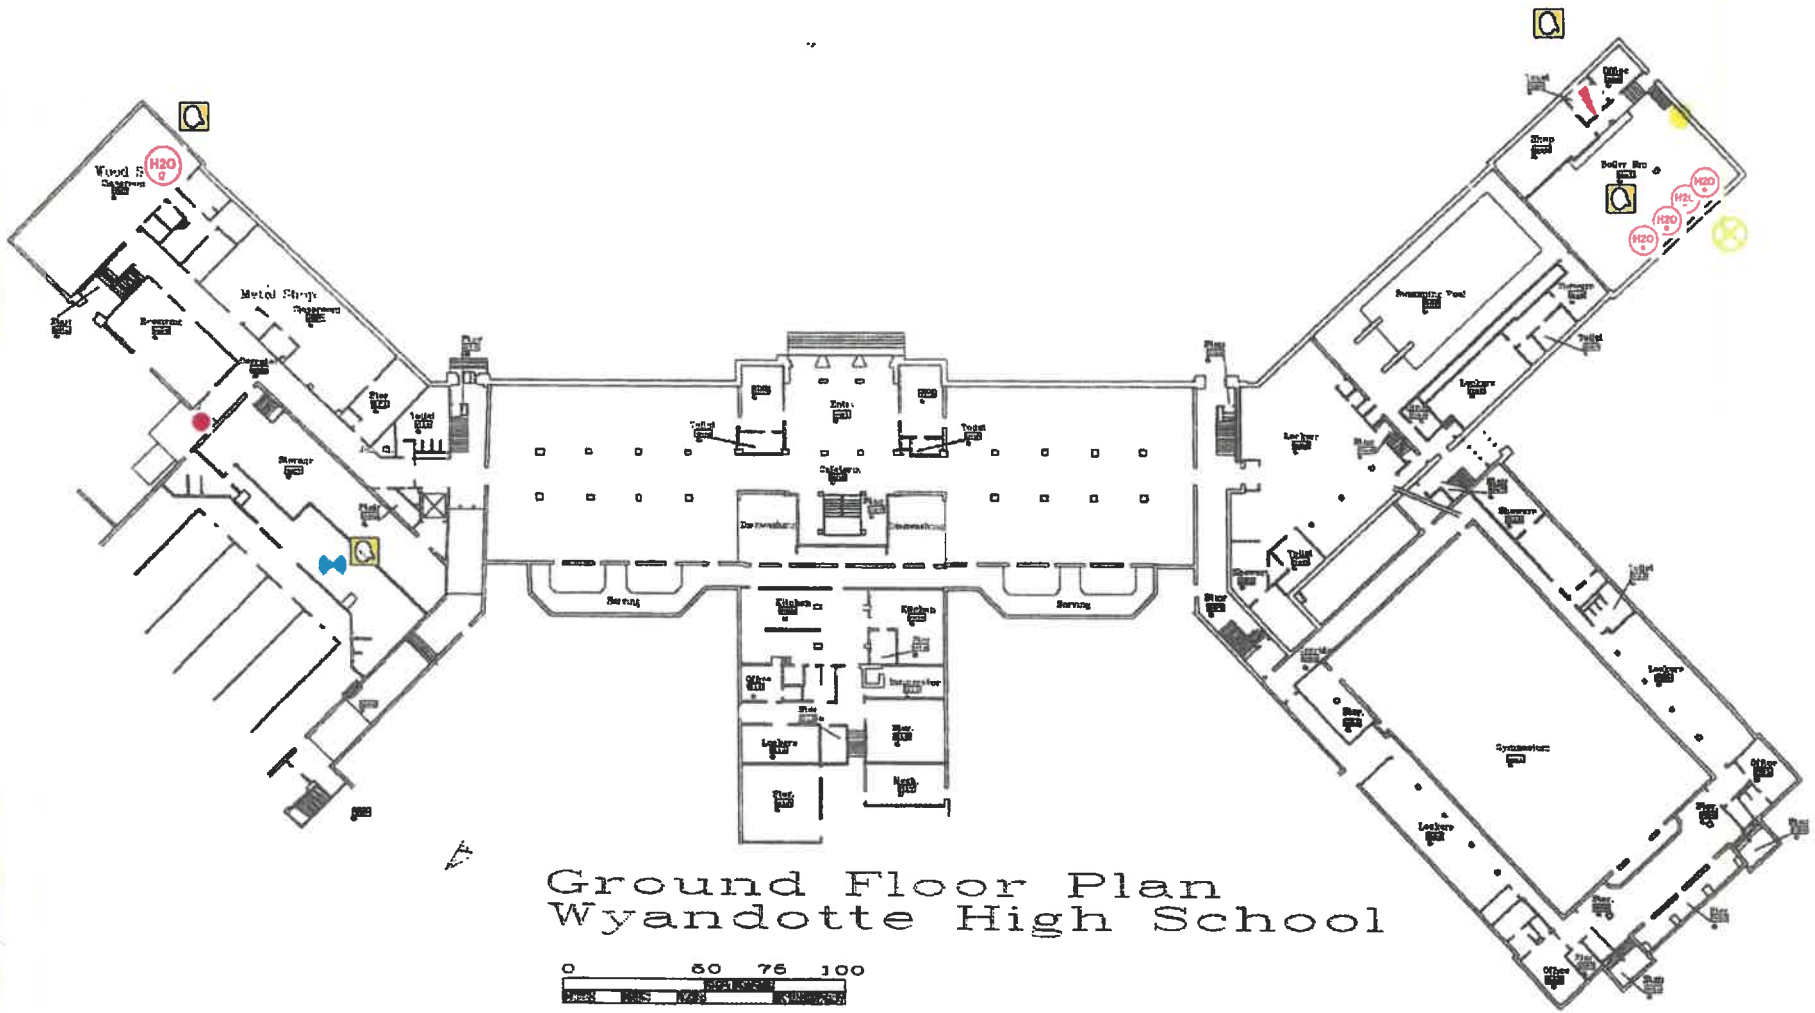


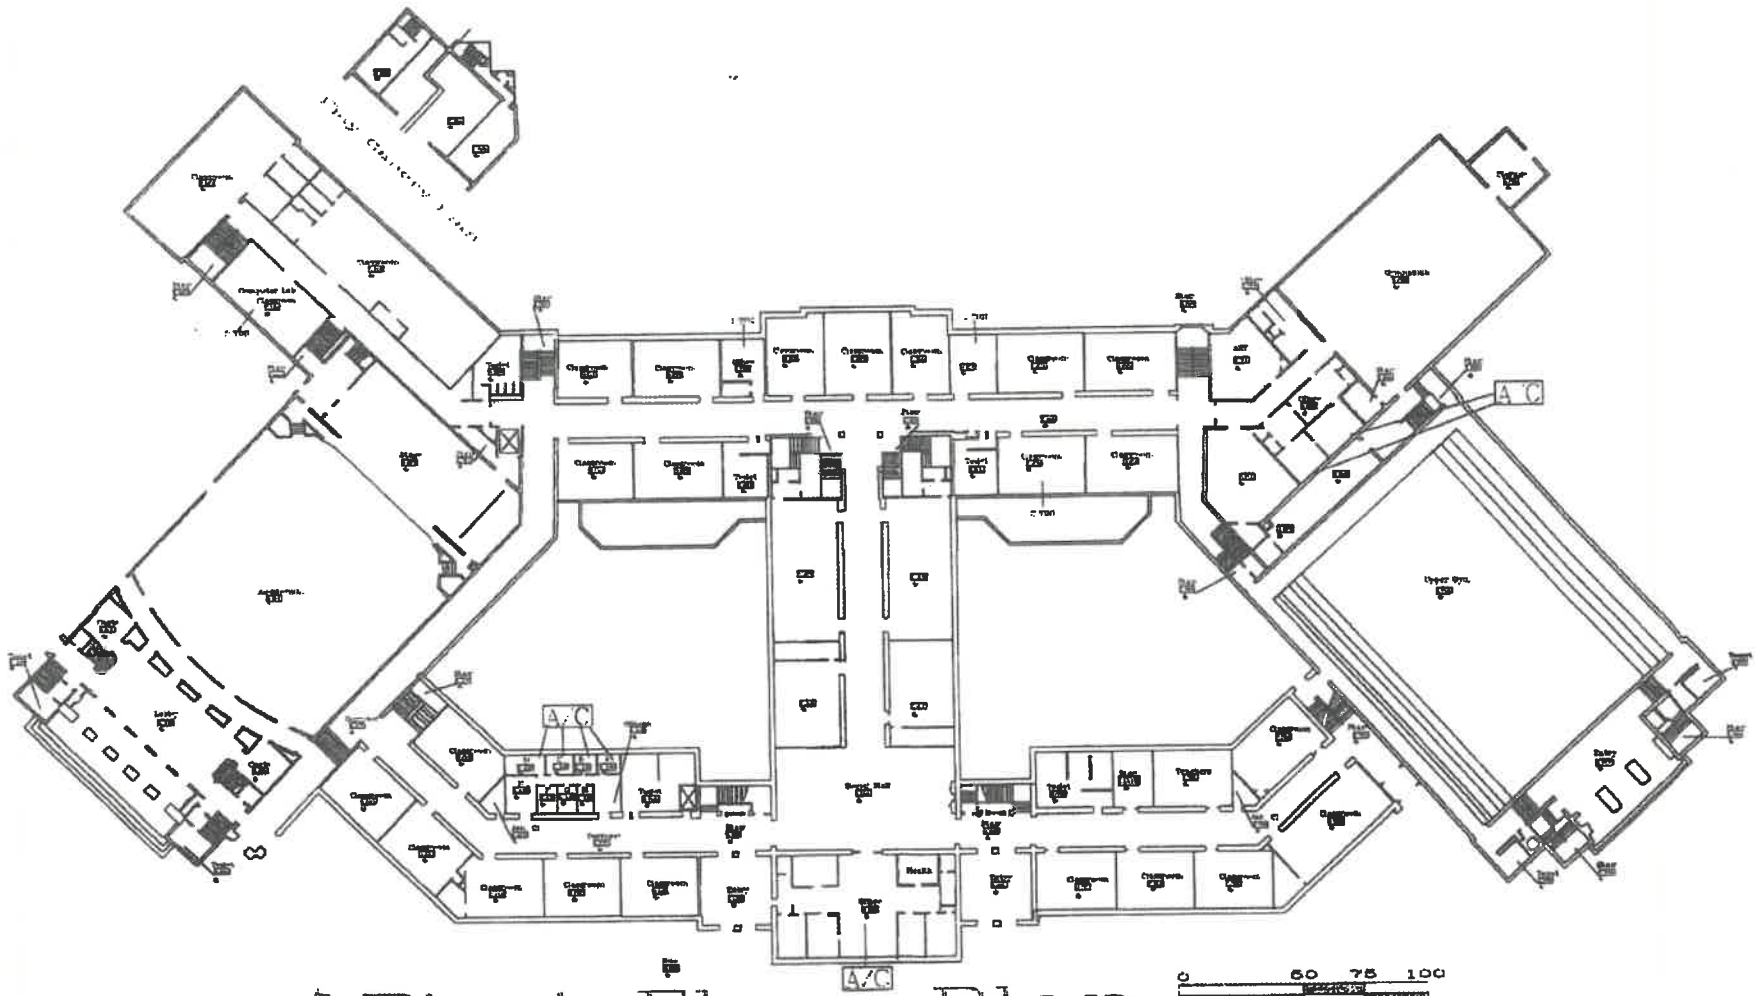

First Floor Plan  
 Wyandotte High School

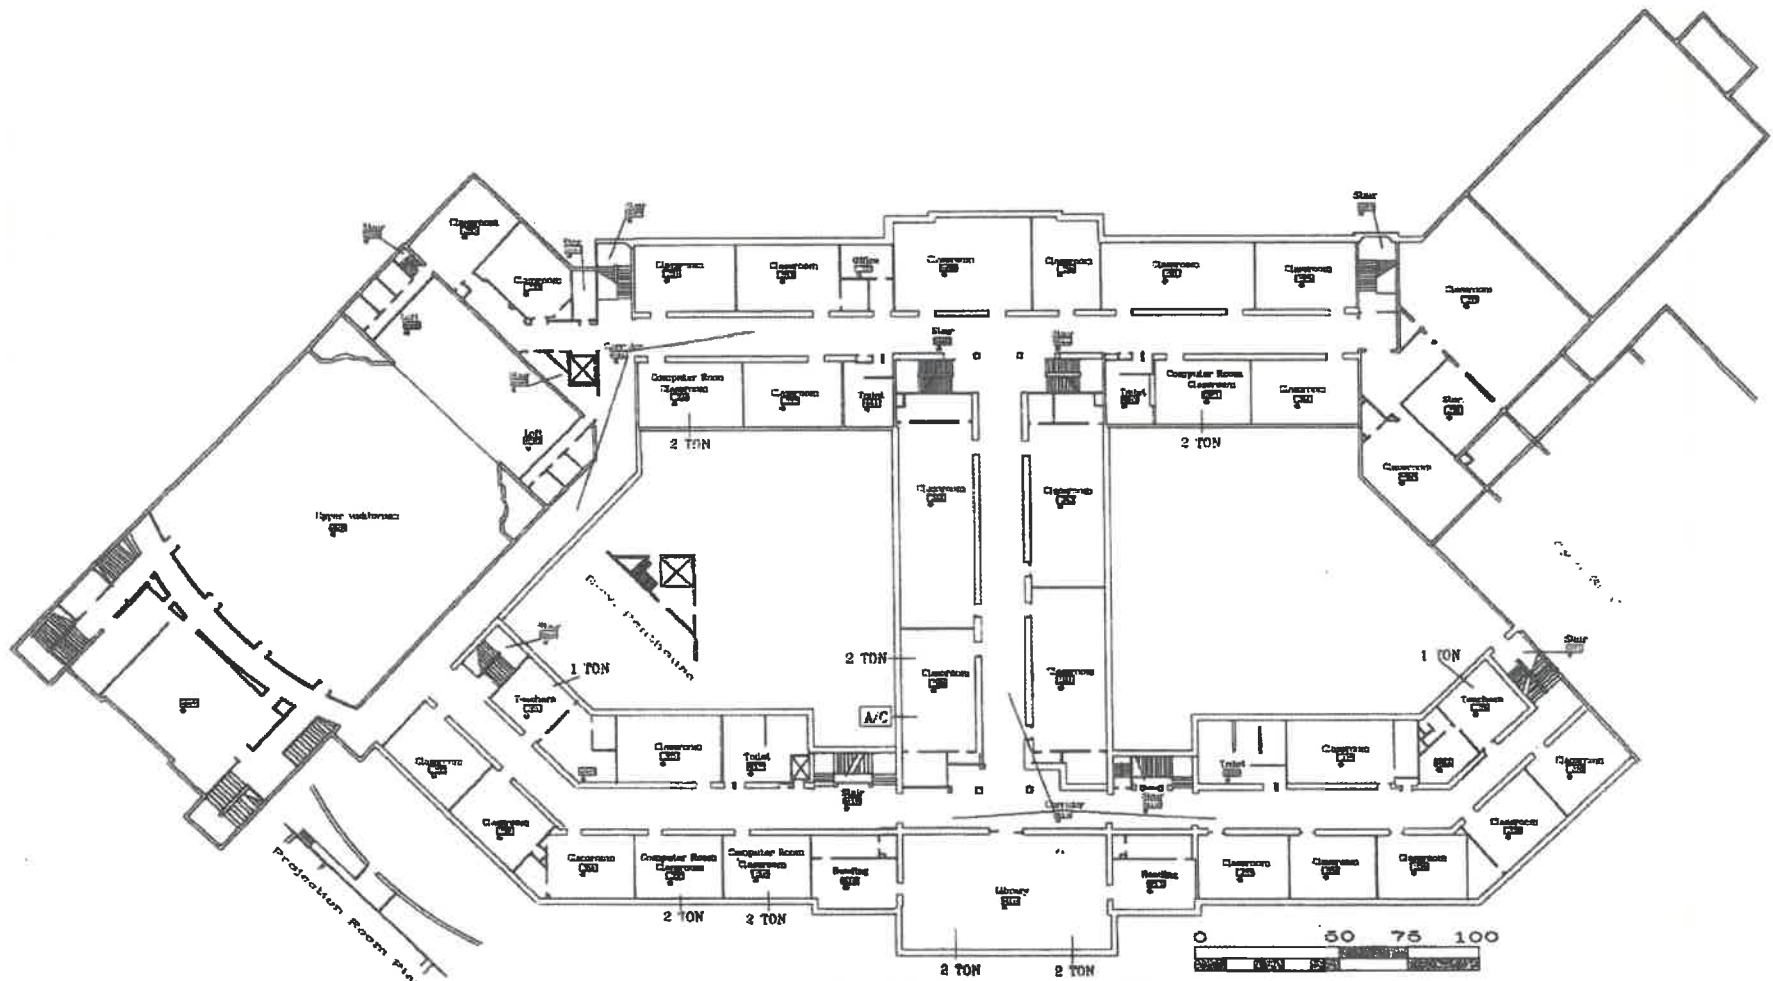


**Second Floor Plan**  
**Wyandotte High School**

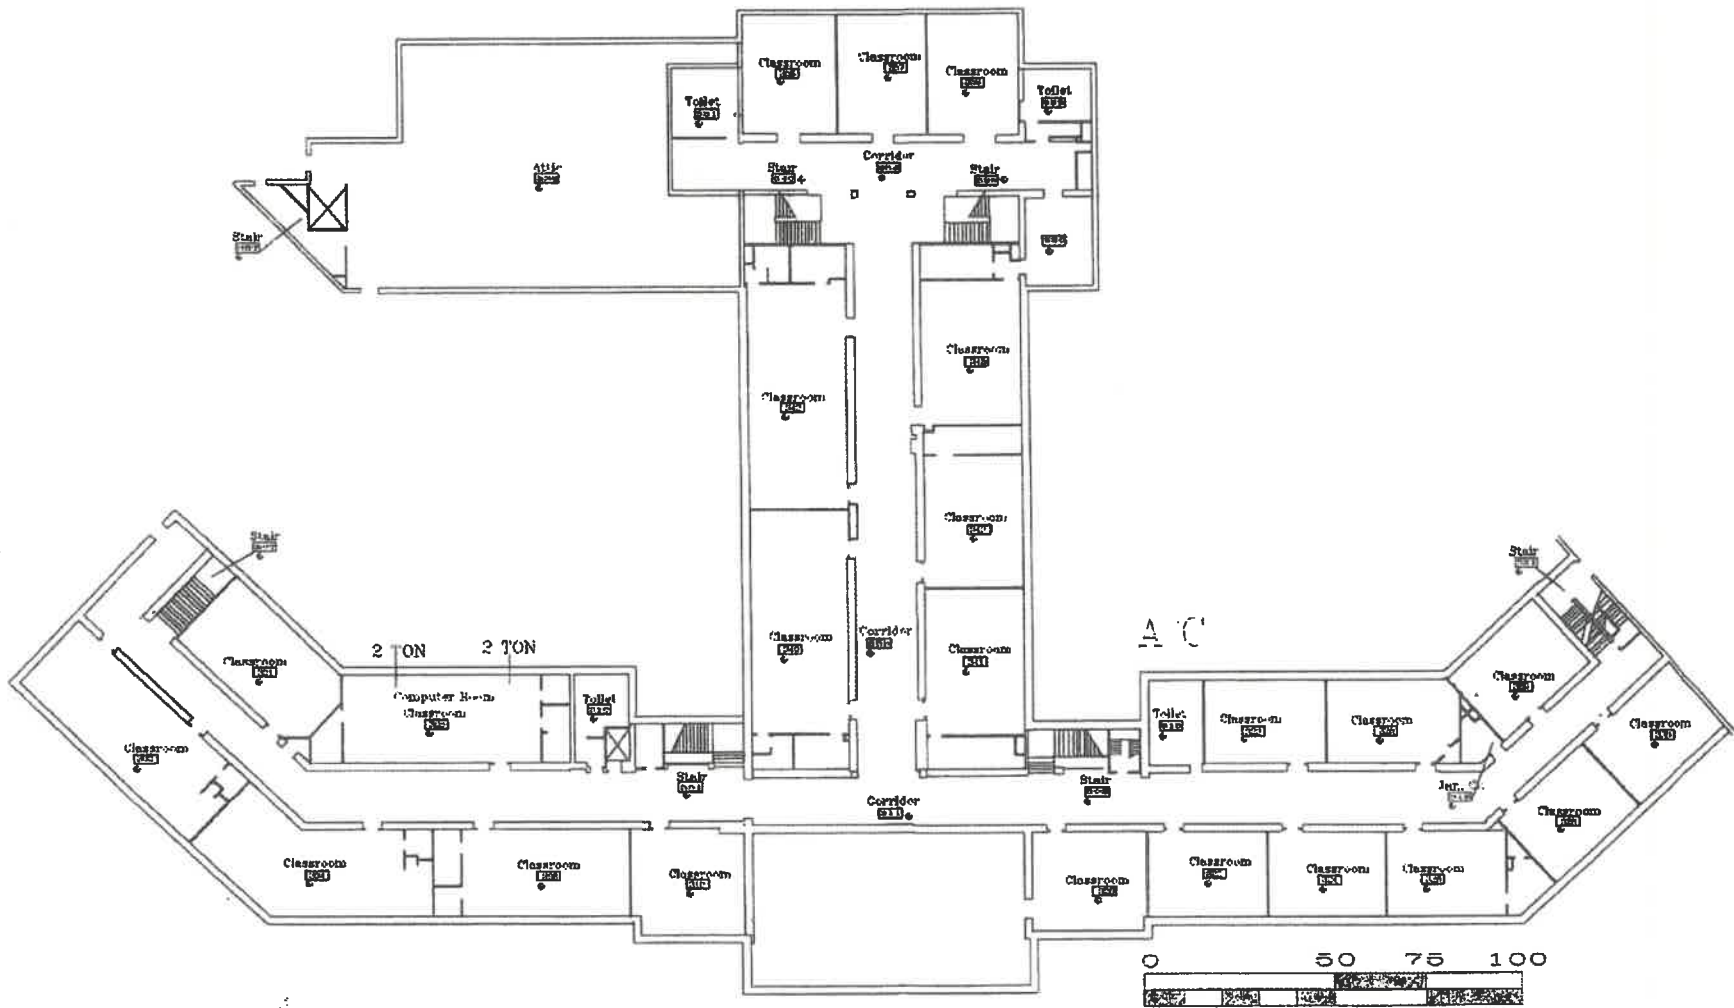

Third Floor Plan  
Wyandotte High School




Symbol key


- Engineering Door
- Alarm Panel
- Fire Alarm Panel
- Main Electric Breaker
- Water Heater, Electric
- Water Heater, Gas
- ⊕ Water Main; internal shut off
- ⊗ Water Main; external pit
- ⊕ Gas Main
- ⊕ Fire Line valve; Internal
- ⊗ Fire Main; external pit
- ⊕ cooling tower fill valve

First Floor Plan  
Emerson Elementary School




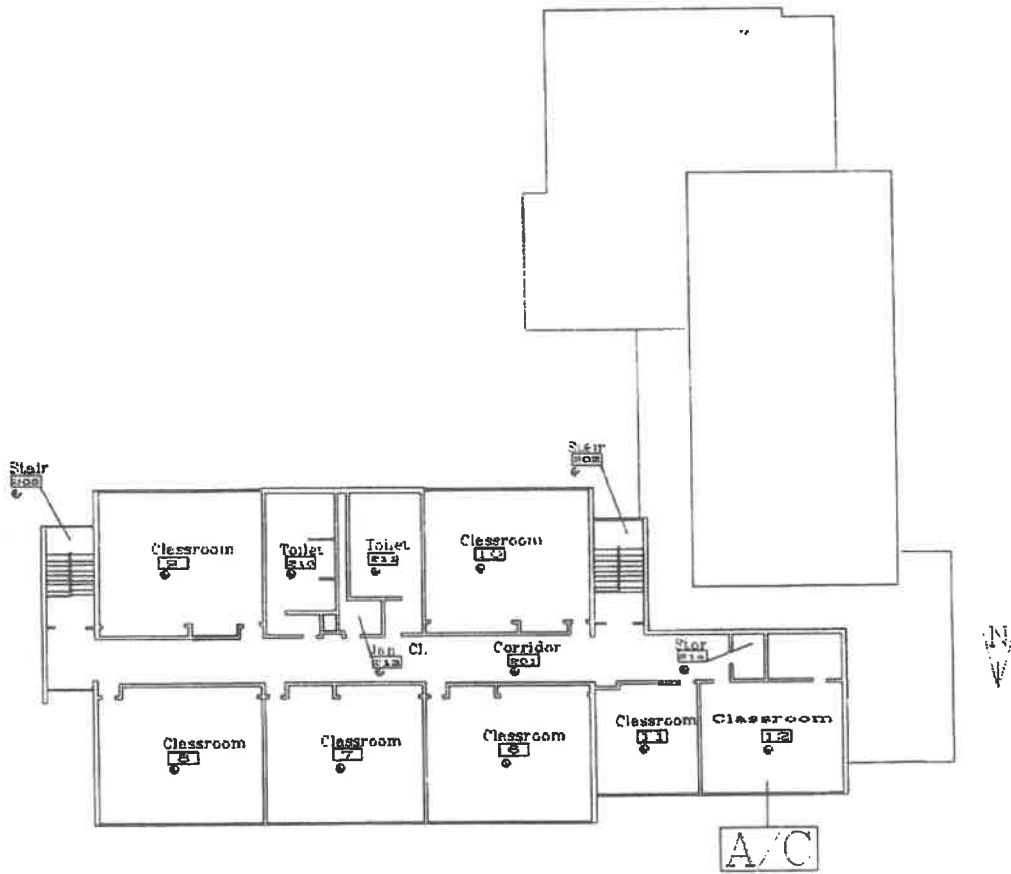

Second Floor Plan  
Emerson Elementary School





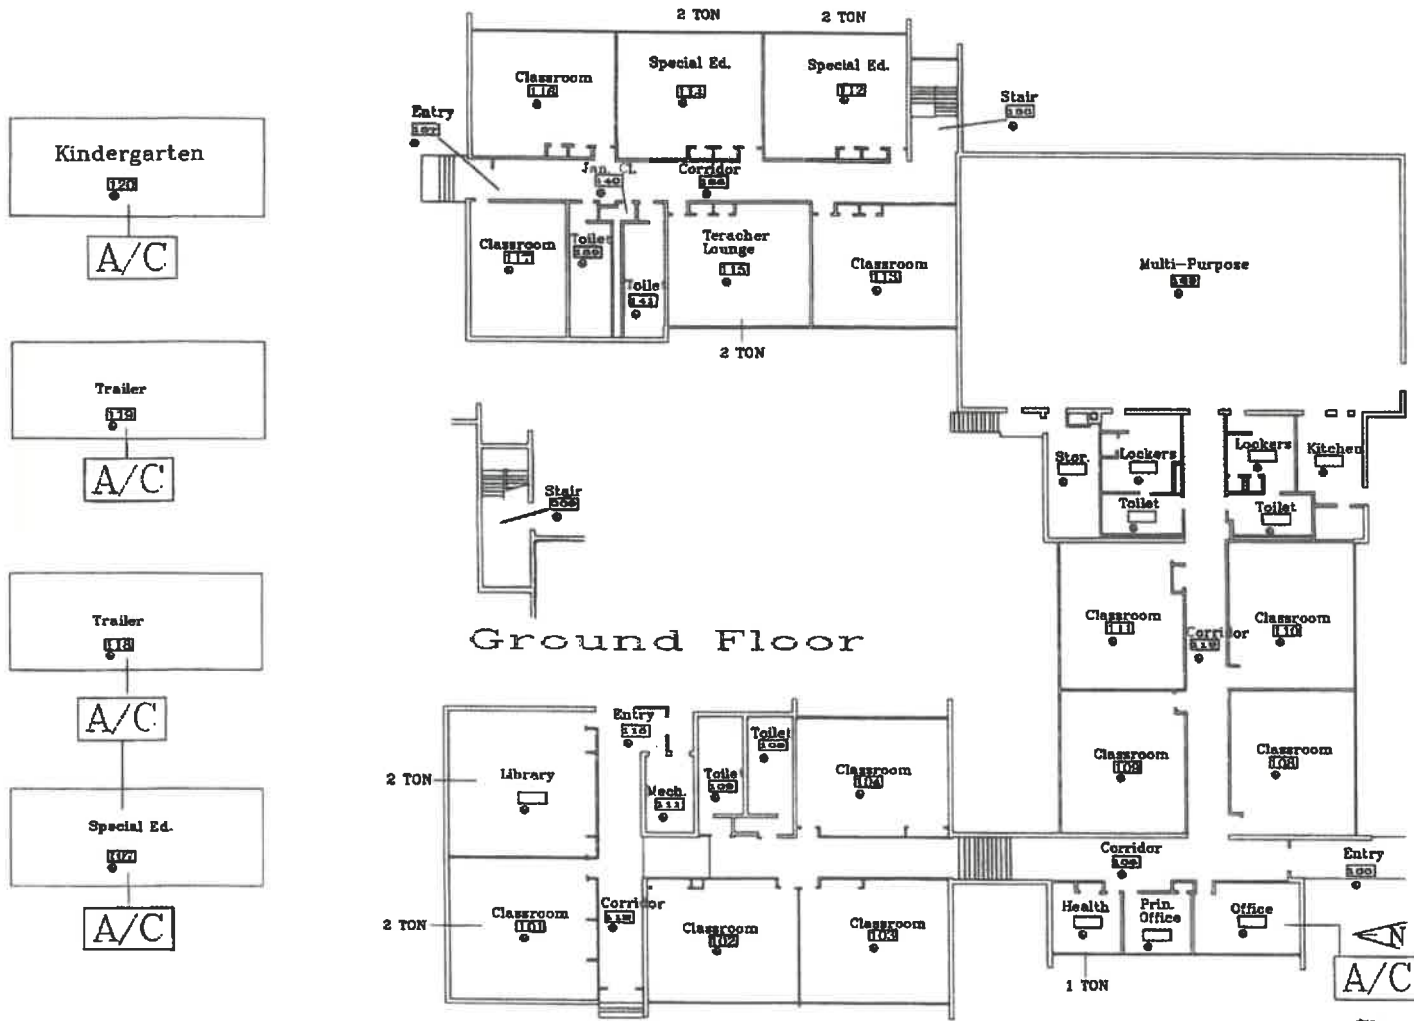

- Symbol key
- Engineering Door
  - AP Alarm Panel
  - FP Fire Alarm Panel
  - ⚡ Main Electric Breaker
  - ⊕ Water Heater, Electric
  - ⊕ Water Heater, Gas
  - ⊕ Water Main; internal shut off
  - ⊕ Water Main; external pit
  - ⊕ Gas Main
  - ⊕ Fire Line valve; internal
  - ⊕ Fire Main; external pit cooling tower fill valve

Floor Plan  
Lindberg Elementary