

System Requirements: Control System Summary

Project Name: Cedar Park Baseball Aka Mel Roberts Park | Project #: 154239

Control System ID: 1 of 2

Distribution Panel Location/ID: Cedar Park 200'R & Large Field

Project Information


Control System

Control System ID: 1 of 2

Control System Type: Control-Link® Control and Monitoring System

Communication Type: PowerLine-ST

Project Notes:



Power Requirements

Control cabinet(s):

Control voltage (phase to neutral) 120/60

VA loading - Inrush 3023.0

VA loading - Sealed 336.0

Lighting Circuits:

Voltage/Hertz/Phase 240/60/1

Equipment Listing

Description	Qty	Size (in)
Control and monitoring cabinet - primary	1	24 X 72

Important Notes:

1. Please confirm that the lighting circuit voltage listed above is accurate for this facility. This is the voltage/phase being connected and utilized at each lighting pole's electrical components enclosure disconnect. Inaccurate voltage/phase can result in additional costs and delays. Contact your Musco sales representative to confirm this item.
2. In a 3 phase design, all 3 phases are to be run to each pole location. Musco's single phase luminaires come pre-wired to utilize all 3 phases across the entire facility.
3. One contactor is required for each circuit at each pole location. Contactors are 3 pole and 100% rated for the published continuous load.
4. If the lighting system will be fed from more than one distribution location, additional equipment may be required. Contact your Musco sales representative.
5. Size overcurrent devices using the full load amps column of the Circuit Summary by Switch chart (Minimum power factor is 0.9). Size conduit per code unless otherwise specified as larger to allow for harness connectors.
6. Avoid use of in-ground junction/pull boxes when possible. If used, all wire connectors must be UL listed for Wet Locations to prevent leakage current.
7. Control power wiring must be in separate conduit from line or load power wiring. Communication cables must be in separate conduit from any power wiring.
8. Refer to Installation Instructions for more details on equipment information and the installation requirements.

System Requirements: Control System Summary

Project Name: Cedar Park Baseball Aka Mel Roberts Park | Project #: 154239

Control System ID: 1 of 2



Distribution Panel Location/ID: Cedar Park 200'R & Large Field

Equipment Layout and Connection Details



Lighting system

Control cabinet location

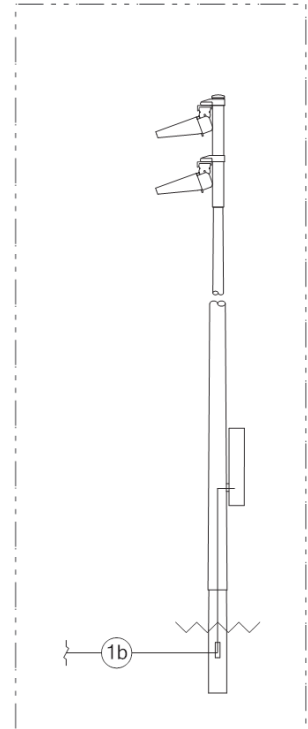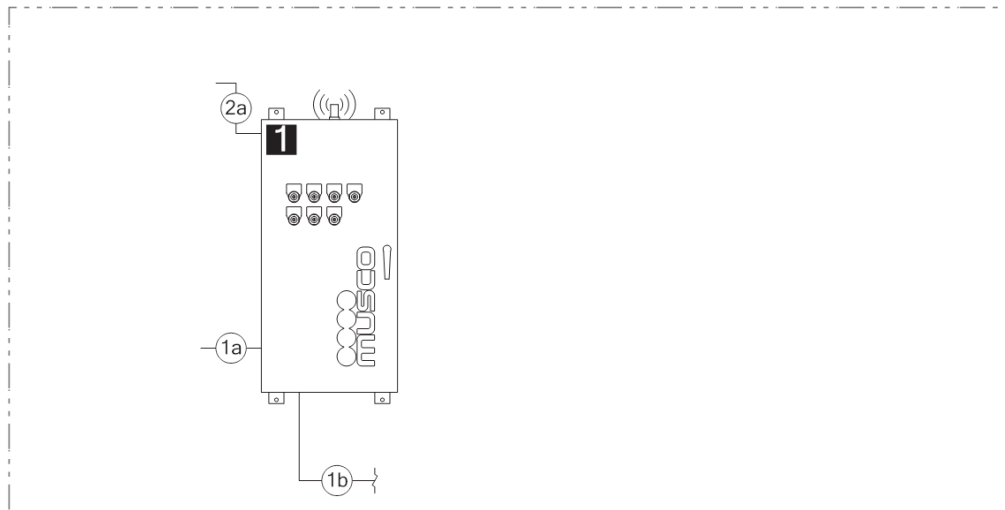

Connection Details

ID	Description
1a	Line power to contactors, and equipment grounding conductor. Requires one circuit per contactor, size wiring per load and voltage drop.
1b	Load power from contactors, and equipment grounding conductor. Requires one circuit per contactor, size wiring per load and voltage drop.
2a	Control power with equipment ground to control cabinet. Requires dedicated 20 A circuit. Provide transformer if control voltage not present.

Equipment

ID	Description
1	Control and monitoring cabinet - primary

System Requirements: Control System Summary

Project Name: Cedar Park Baseball Aka Mel Roberts Park | Project #: 154239

Control System ID: 1 of 2

Distribution Panel Location/ID: Cedar Park 200'R & Large Field

Circuit Summary

Switching Schedule	
Field/Switch Description	Switches
Field C	2
Field B	1

Control Module ID: 1

Lighting Circuit Voltage: 240/60/1

Circuit Summary by Switch							
Switch	Zone Description	Pole ID	Qty of Fixtures	Full load amperes	Contactor Size (Amps)	Cabinet #	Contactor ID
1	Field B	A5	3	13.48	30	1	C1
	Field B	A6	3	13.48	30	1	C2
	Field B	B5	4	22.16	30	1	C3
	Field B	B6	4	22.16	30	1	C4
2	Field C	A1	4	24	30	1	C5
	Field C	A2	4	24	30	1	C6
	Field C	B1	7	39.58	60	1	C7
	Field C	B2	7	40.84	60	1	C8
	Field C	C1	7	37.06	60	1	C9
	Field C	C2	7	37.06	60	1	C10

System Requirements: Control System Summary

Project Name: Cedar Park Baseball Aka Mel Roberts Park | Project #: 154239

Control System ID: 2 of 2

Distribution Panel Location/ID: Cedar Park 190'R

Project Information


Control System

Control System ID: 2 of 2

Control System Type: Control-Link[®] Control and Monitoring System

Communication Type: PowerLine-ST

Project Notes:



Power Requirements

Control cabinet(s):

Control voltage (phase to neutral) 120/60

VA loading - Inrush 1553.0

VA loading - Sealed 180.0

Lighting Circuits:

Voltage/Hertz/Phase 208/60/3

Equipment Listing

Description	Qty	Size (in)
Control and monitoring cabinet - primary	1	24 X 48

Important Notes:

1. Please confirm that the lighting circuit voltage listed above is accurate for this facility. This is the voltage/phase being connected and utilized at each lighting pole's electrical components enclosure disconnect. Inaccurate voltage/phase can result in additional costs and delays. Contact your Musco sales representative to confirm this item.
2. In a 3 phase design, all 3 phases are to be run to each pole location. Musco's single phase luminaires come pre-wired to utilize all 3 phases across the entire facility.
3. One contactor is required for each circuit at each pole location. Contactors are 3 pole and 100% rated for the published continuous load.
4. If the lighting system will be fed from more than one distribution location, additional equipment may be required. Contact your Musco sales representative.
5. Size overcurrent devices using the full load amps column of the Circuit Summary by Switch chart (Minimum power factor is 0.9). Size conduit per code unless otherwise specified as larger to allow for harness connectors.
6. Avoid use of in-ground junction/pull boxes when possible. If used, all wire connectors must be UL listed for Wet Locations to prevent leakage current.
7. Control power wiring must be in separate conduit from line or load power wiring. Communication cables must be in separate conduit from any power wiring.
8. Refer to Installation Instructions for more details on equipment information and the installation requirements.

System Requirements: Control System Summary

Project Name: Cedar Park Baseball Aka Mel Roberts Park | Project #: 154239


Control System ID: 2 of 2

Distribution Panel Location/ID: Cedar Park 190'R


Equipment Layout and Connection Details



Control cabinet location

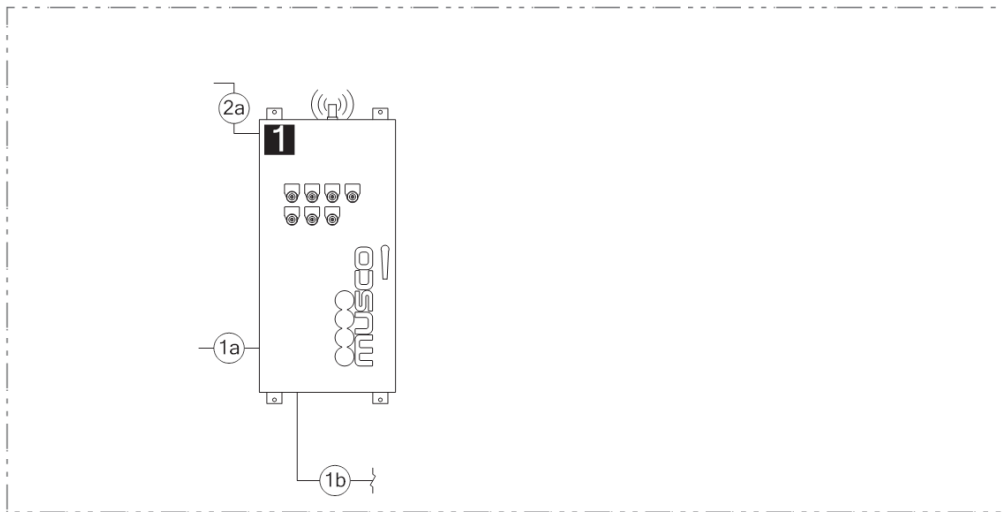

Lighting system

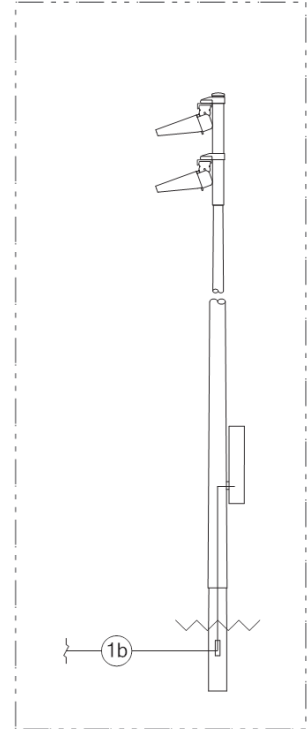

Connection Details

ID	Description
1a	Line power to contactors, and equipment grounding conductor. Requires one circuit per contactor, size wiring per load and voltage drop.
1b	Load power from contactors, and equipment grounding conductor. Requires one circuit per contactor, size wiring per load and voltage drop.
2a	Control power with equipment ground to control cabinet. Requires dedicated 20 A circuit. Provide transformer if control voltage not present.

Equipment

ID	Description
1	Control and monitoring cabinet - primary

System Requirements: Control System Summary

Project Name: Cedar Park Baseball Aka Mel Roberts Park | Project #: 154239

Control System ID: 2 of 2

Distribution Panel Location/ID: Cedar Park 190'R

Circuit Summary

Switching Schedule

Field/Switch Description	Switches
Field A	1

Control Module ID: 2

Lighting Circuit Voltage: 208/60/3

Circuit Summary by Switch

Switch	Zone Description	Pole ID	Qty of Fixtures	Full load amperes	Contactor Size (Amps)	Cabinet #	Contactor ID
1	Field A	A3	3	10.57	30	2	C1
	Field A	A4	3	10.57	30	2	C2
	Field A	B3	4	16.14	30	2	C3
	Field A	B4	4	16.14	30	2	C4