REVISED ON 01/03/2022

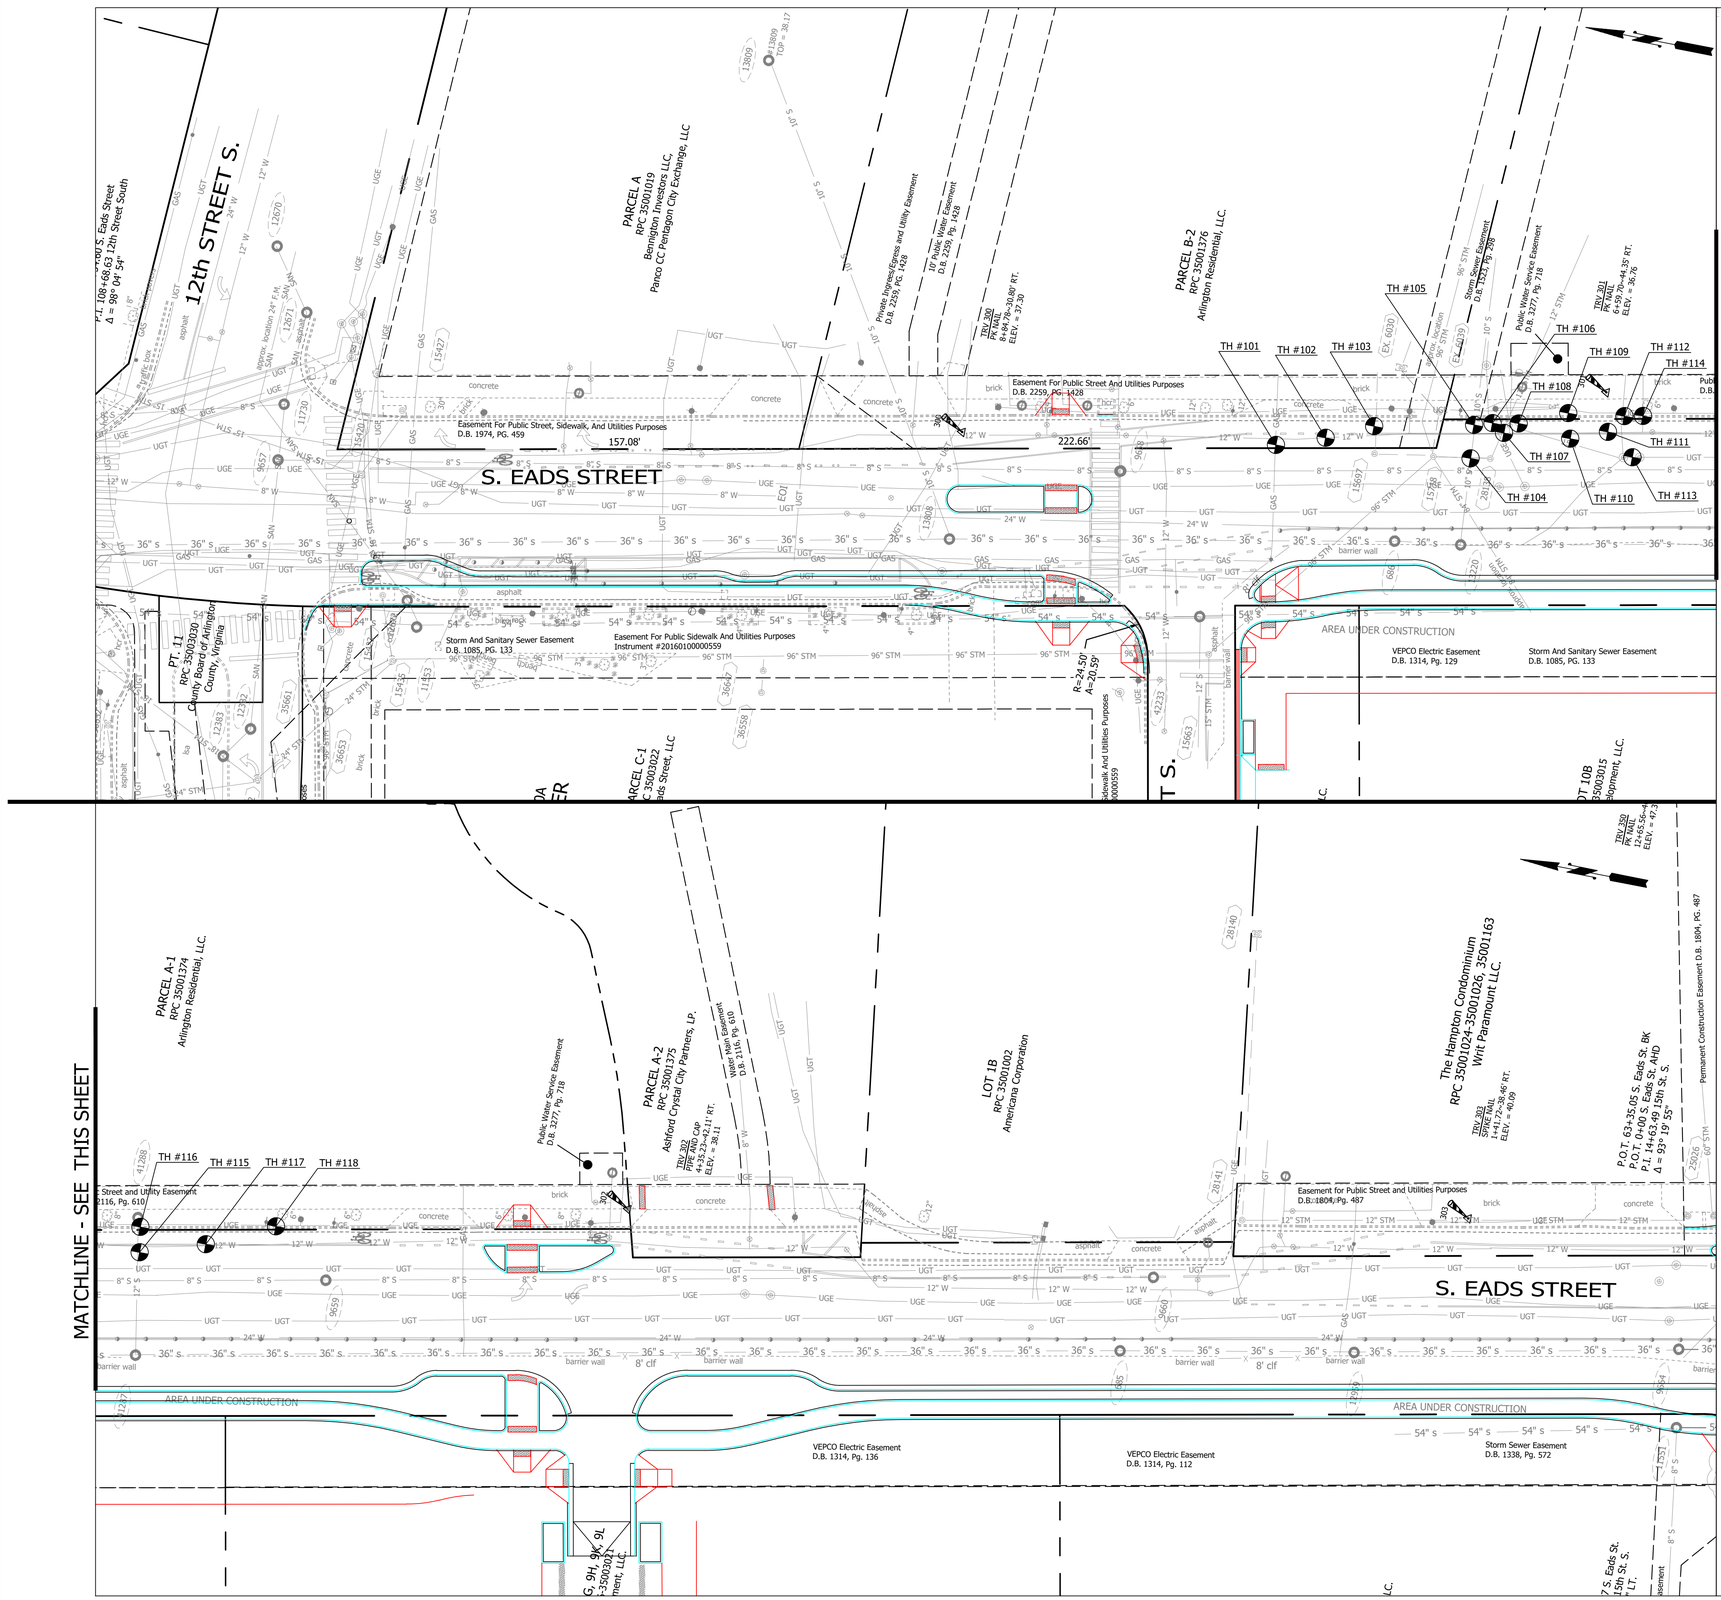

TEST HOLES

TEST HOLE #	Data
TH #101	NONE TOP: 30.44' BOT: 36.44' CLEAR TO 6' UNABLE TO REPRODUCE MISS UTILITY MARKS.
TH #102	12 3/4" WATER LINE TOP: 30.82 BOT: 36.13 APPROXIMATE SIZE DUE TO HARD CRUST ON WATER LINE.
TH #103	NONE A: TOP: 35.81', BOT: 34.76' B: TOP: 35.81', BOT: 34.39' C: TOP: 35.81', BOT: 31.81' PIPE SHOULD BE AT DEPTH OF 3.5', UNABLE TO REACH DUE TO CONCRETE AROUND PIPE IN TEST HOLE "A"
TH #104	NONE TOP: 36.50' BOT: 29.25' CLEARED TO 7.25' AND PROBED TO 8.00'. GRAVEL CAVE-IN. CREW NOTES THAT STRUCTURE IS 11.40'
TH #105	NONE TOP: 36.00' BOT: 29.68' CLEARED TO 6.32' AND PROBED TO 7.00'. LARGE ROCKS AND BRICKS PREVENTED FURTHER INVESTIGATION.
TH #106	48" ELECTRIC DUCTBANK TOP: 34.69' BOT: 33.05'
TH #107	48" ELECTRICAL DUCTBANK TOP: 32.65' BOT: 31.82'
TH #108	48" COMM DUCTBANK TOP: 33.07' BOT: 32.30'
TH #109	(2) 2 1/2" ELECTRIC CONDUITS TOP: 34.74'
TH #110	A: 48" COMMUNICATION DUCTBANK; B: (2) 4 1/2" COMM CONDUIT A: TOP: 34.74' BOT: 32.78'; B: TOP 34.55' DEPTH TO CONDUIT IS 1.84' WITH AN ELEVATION OF 34.55'
TH #111	12" WATER LINE TOP: 30.60'
TH #112	A: (2) 2 1/2" ELECTRIC CONDUIT; B: 24" COMM DUCTBANK A: TOP: 35.12' ; B: TOP: 34.85', BOT: 34.31' STEEL CONDUITS ARE 1.35' DEEP
TH #113	NONE TOP: 36.96' BOT: 35.56' COMM VAULT IS 13' X 7' OR 12' X 6'
TH #114	8 1/2" WATER LINE TOP: 30.03'
TH #115	10 1/2" SANITARY LINE TOP: 34.05'
TH #116	A: (2) 2 1/2" ELECTRIC CONDUITS; B: 10 1/2" SANITARY SEWER LINE A: TOP: 34.95'; B: BOT: 34.09' EDGE OF SANITARY MH IS 1.00' EAST OF CHISEL X WITH AN ELEVATION OF 3640'
TH #117	12 1/2" WATER LINE TOP: 31.46'
TH #118	(2) ELCTRIC CONDUITS TOP: 35.27'

ARLINGTON
VIRGINIA
DEPARTMENT OF
ENVIRONMENTAL SERVICES
FACILITIES & ENGINEERING DIVISION
ENGINEERING BUREAU
2100 CLARENDON BOULEVARD, SUITE 813
ARLINGTON, VA 22201
PHONE: 703.228.3629
FAX: 703.228.3606

COPYRIGHT © 2022 ARLINGTON COUNTY
VIRGINIA - ALL RIGHTS RESERVED

SEAL

100% SUBMISSION

APPROVALS	DATE
QUALITY CONTROL ENGINEER	
CONSTRUCTION MANAGEMENT SUPERVISOR	
WATER, SEWER, STREETS BUREAU CHIEF	
TRANSPORTATION DIRECTOR	
PROJECT MANAGER	

REVISIONS	DATE

S EADS STREET PHASE II
CC23
S EADS ST (12TH ST. S. TO 15TH ST. S.)

TEST HOLE EXHIBIT

DESIGNED: NS
DRAWN: TEC
CHECKED: TL

PLOTTED: APRIL 25 2023

SCALE:

0 25 50
GRAPHIC SCALE

EX-03

FILENAME: CC23-TEST_PIT_PLAN_1.DWG PATH: Q:\DATA\CC23\DESIGN\CAD_ACTIVE PLOTTED BY: BNEWBERRY