

HENRY LEE PARK IMPROVEMENTS

THE CITY OF DAYTONA BEACH



PUBLIC WORKS DEPARTMENT
TECHNICAL SERVICES

950 BELLEVUE AVENUE
DAYTONA BEACH, FL 32114

P 386 671 8610
F 386 957 6404


BRENT COHEN, ARCHITECT
FL LICENSE # AR93854

JAMES V. CHISHOLM
ANDREW HOLMES
DAVID WALLER
JIM NELSON, P.E.
BRENT COHEN

CITY MANAGER
PUBLIC WORKS DIRECTOR
DEPUTY PUBLIC WORKS DIRECTOR
CITY ENGINEER
ARCHITECT

INDEX OF DRAWINGS	SHEET
COVER SHEET	A0.1
ARCHITECTURAL	
SITE PLAN	A1.2
PAVILION FLOOR PLAN + RCP	A2.1
PAVILION DETAILS	A2.2
STRUCTURAL	
GENERAL STRUCTURAL NOTES	S-001
PLANS, SECTIONS, AND DETAILS	S-101

PROJECT LOCATION

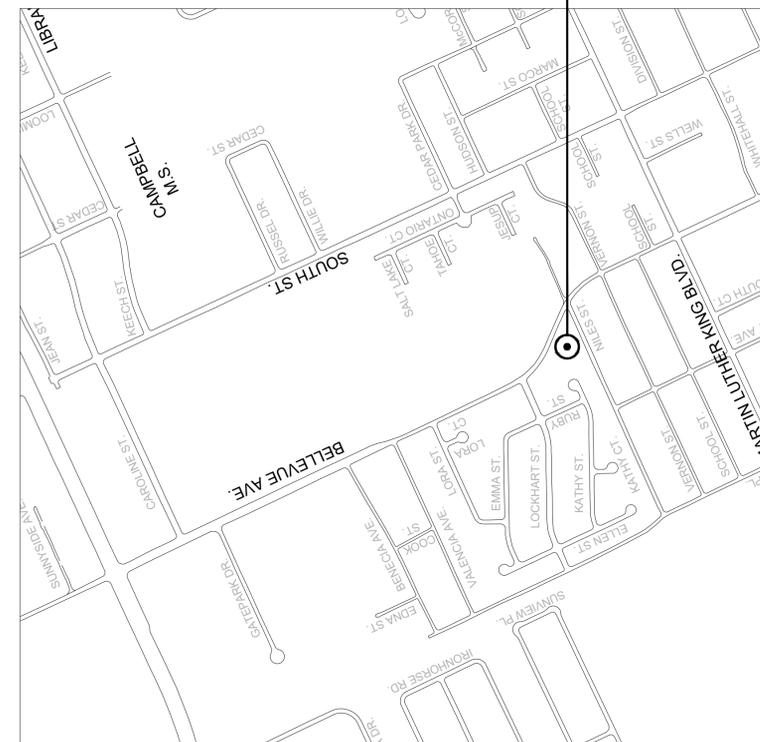

VICINITY MAP

SCALE: NTS




ISSUE	DATE
BID SET	9.26.19

PAVILION, PAVERS, AND FENCING FOR HENRY LEE PARK

701 BEVILLE ROAD
DAYTONA BEACH, FL
32114

SCALE: AS NOTED
DRAWN: BCC
CHECKED: BCC
PROJECT NO: 2019-010

A0.1

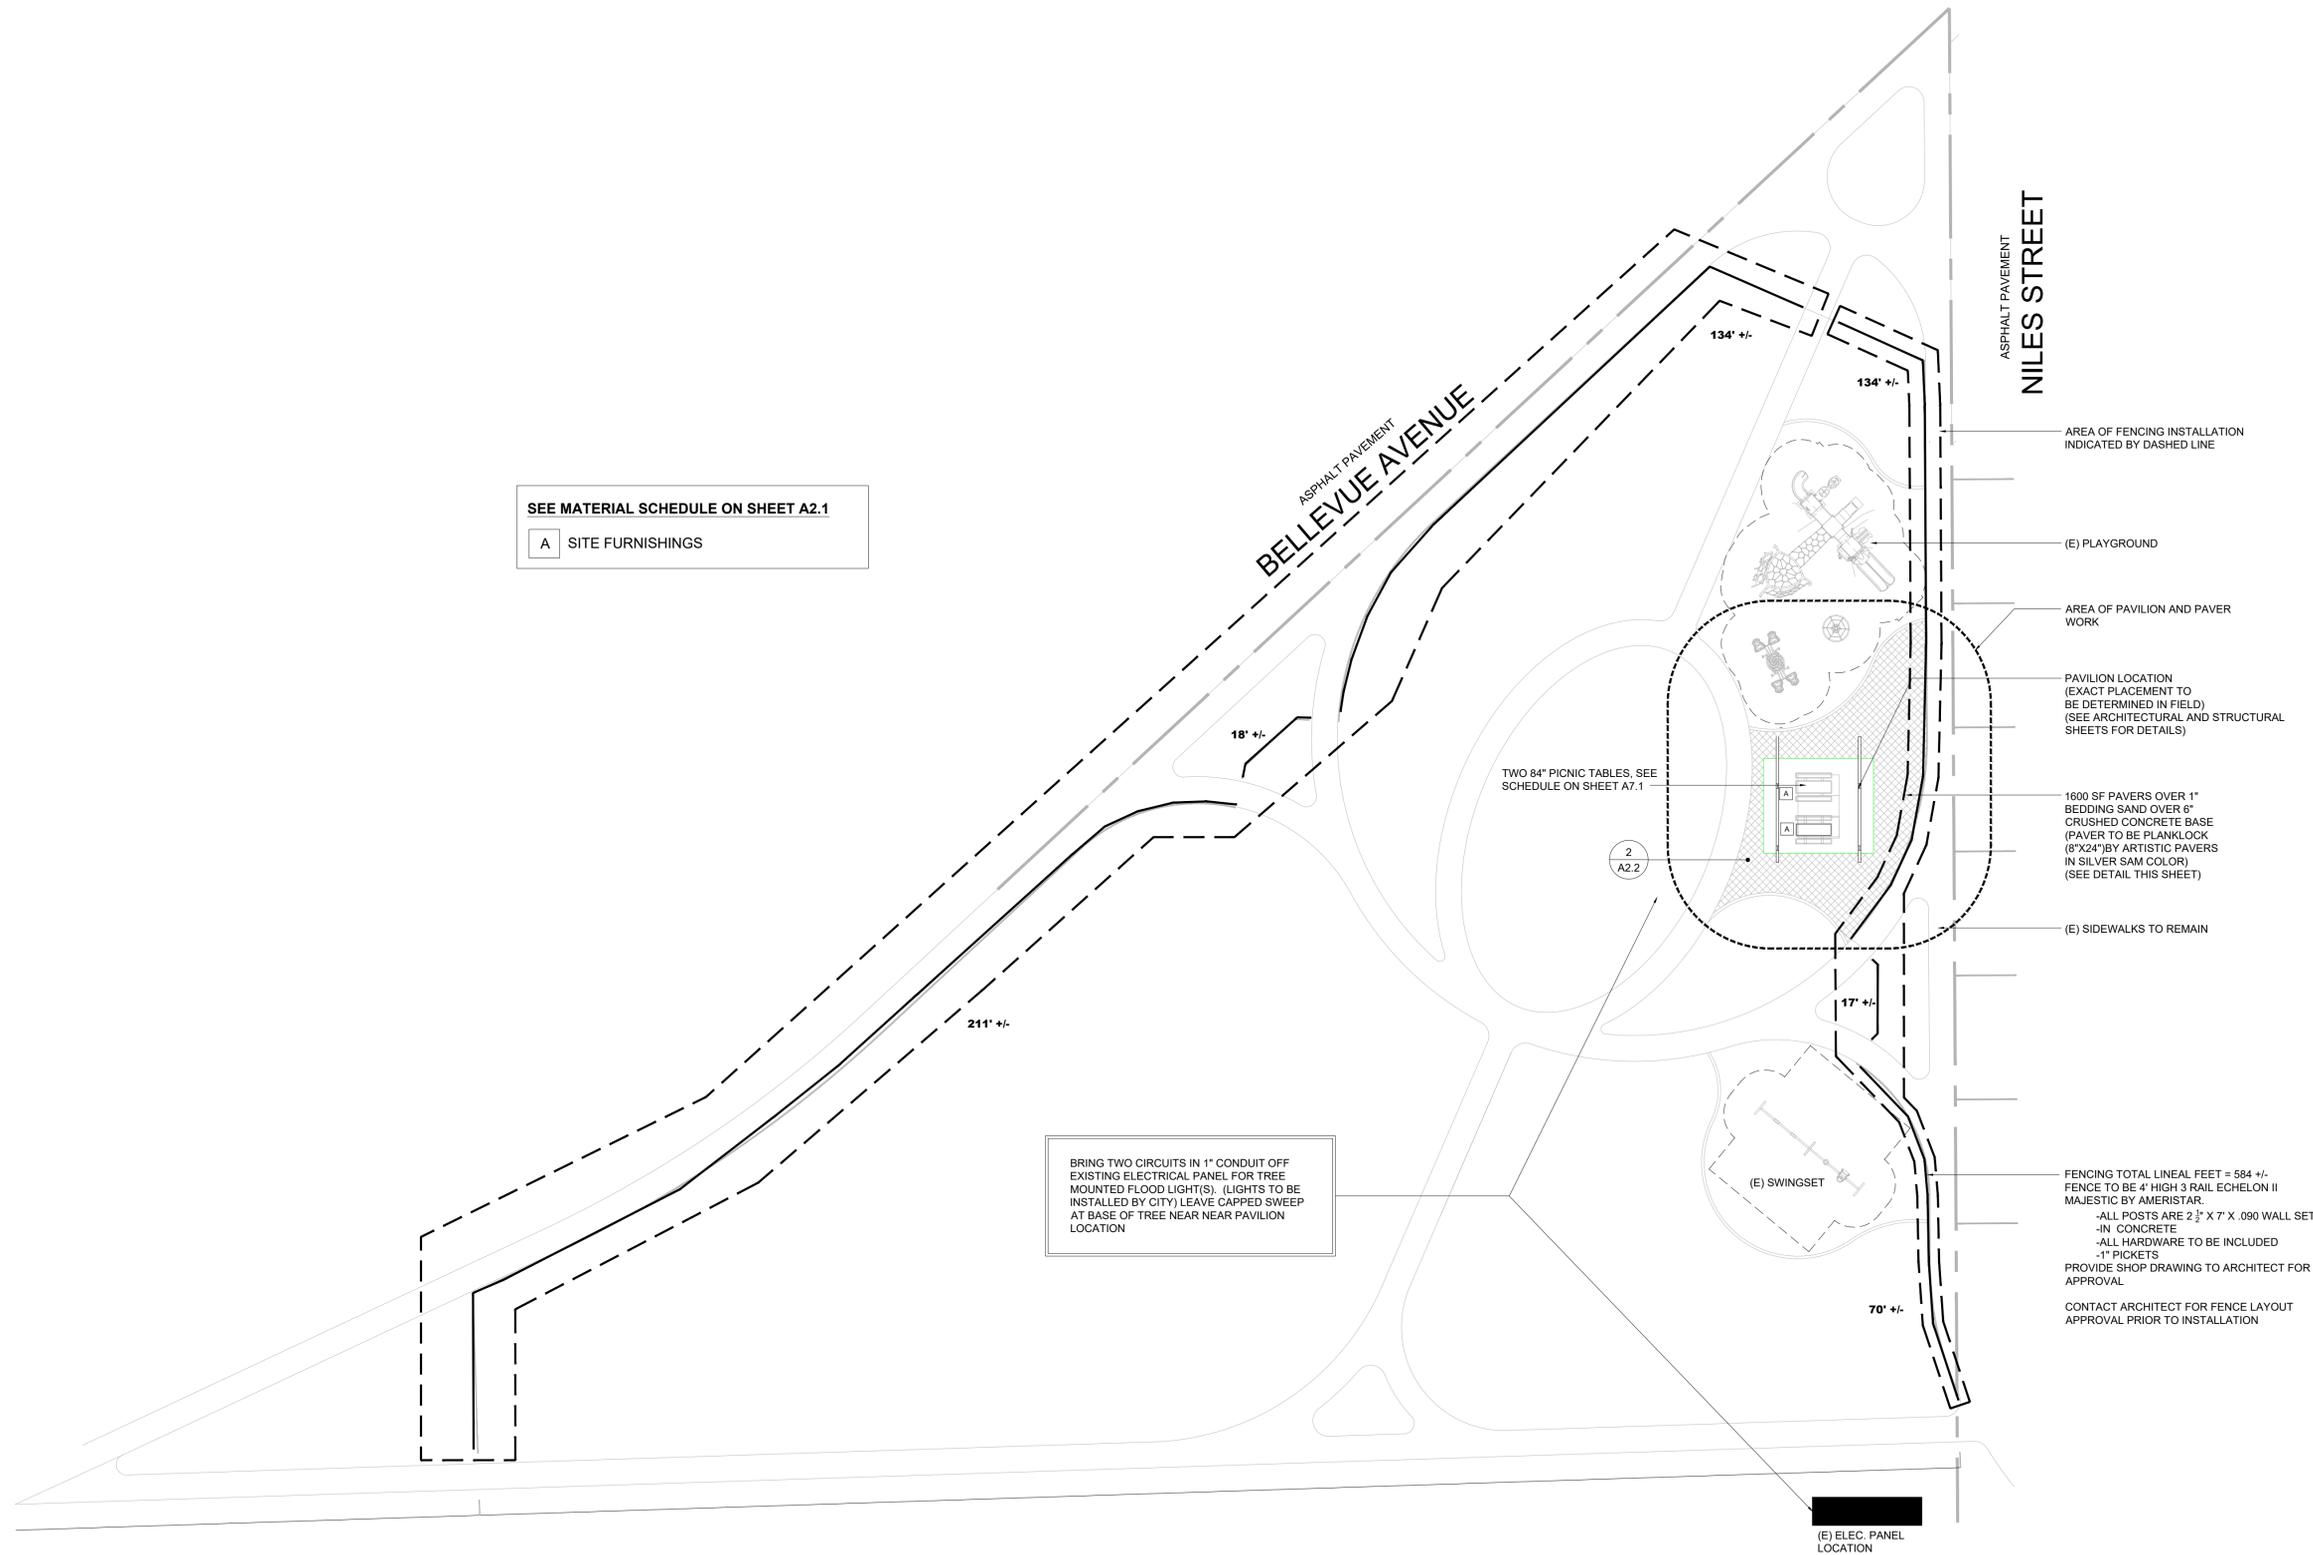


ISSUE	DATE
BID SET	9.26.19

**PAVILION,
PAVERS, AND
FENCING FOR
HENRY LEE
PARK**

701 BEVILLE ROAD
DAYTONA BEACH, FL
32114


SCALE:	AS NOTED
DRAWN:	BCC
CHECKED:	BCC
PROJECT NO:	2019-010

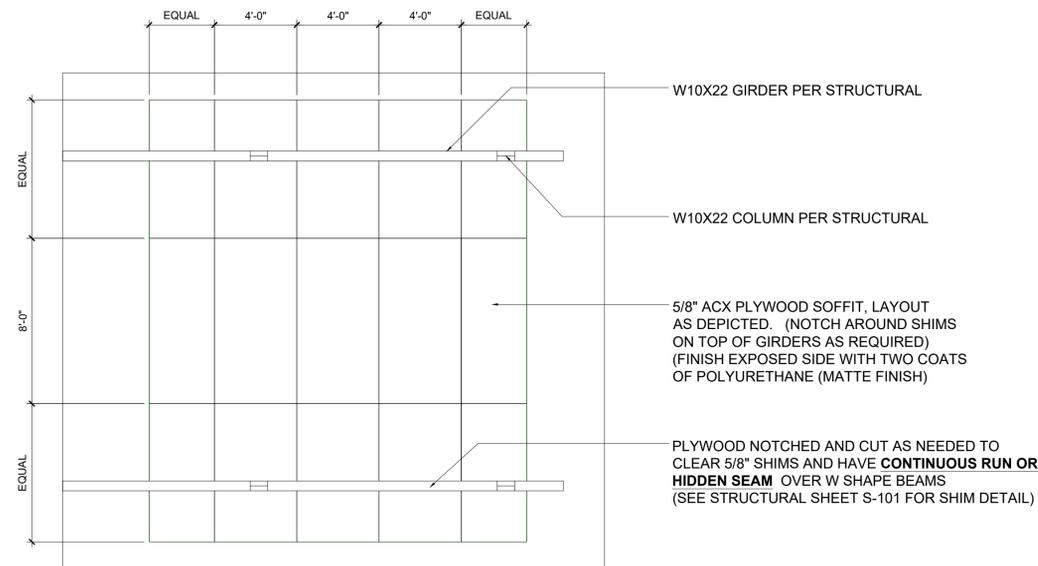

PAVILION REFLECTED CEILING PLAN
SCALE: 1/4" = 1'-0"

REFLECTED CEILING PLAN NOTES

1. ALIGN PLYWOOD FOR CONSISTENT SCREW PATTERN AS NEEDED
2. SELF TAPPING TAPERED HEAD S.S. #10 SCREWS TO BE USED TO FASTEN PLYWOOD SOFFIT

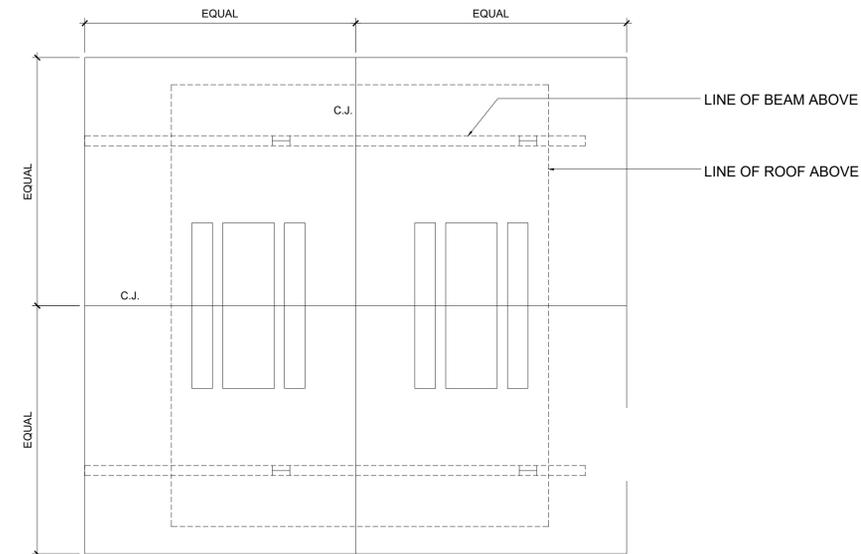


PAVILION FLOOR PLAN
SCALE: 1/4" = 1'-0"


FLOOR PLAN NOTES

1. FOR FLOOR PLAN DIMENSIONS REFER TO SHEET S101

ISSUE	DATE
BID SET	9.26.19

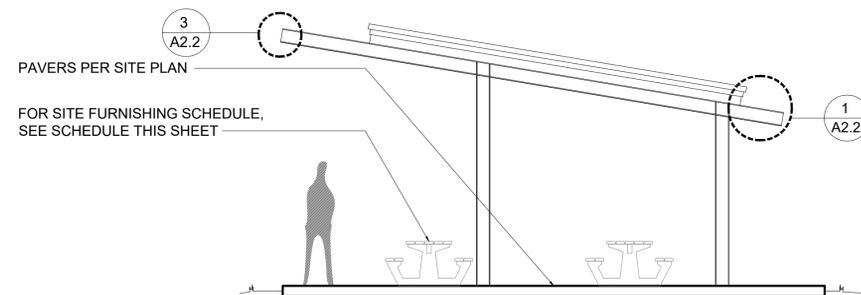

2 PAVILION ELEVATION
1/4" = 1'-0"

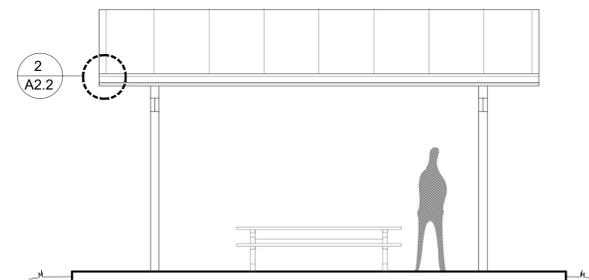

1 PAVILION ELEVATION
1/4" = 1'-0"

**PAVILION,
PAVERS,
AND
FENCING FOR
HENRY LEE
PARK**

701 BEVILLE ROAD
DAYTONA BEACH, FL
32114

SITE FURNISHING SCHEDULE

MARK	MANUFACTURER	PRODUCT/DESCRIPTION	QUANTITY	FINISH	REMARKS
A	WASAU	TF3212 (84" VERSION)	2	G23 GRAY	ALL BENCHES AND TABLES TO BE FASTENED PER MANUFACTURERS SPECIFICATIONS

NOTE: BEFORE MOUNTING ANY SITE FURNISHING AND EQUIPMENT, PLEASE CONTACT ARCHITECT FOR LAYOUT APPROVAL

PAVILION FINISH SCHEDULE


LOCATION	PAINT COLOR	PRODUCT/DESCRIPTION
PAVILION COLUMNS	PT-1	DURATION MATTE (SHERWIN WILLIAMS)
PAVILION EXPOSED PLYWOOD SOFFIT	PT-2	SATIN SHEEN
PAVILION FLOORING AND ADJACENT PATIO AREAS	PV-1	

MATERIAL LEGEND NOTES:

- PT-1 SHERWIN WILLIAMS DURATION ALABASTER #SW7008 MATTE (INTERIOR) MATTE (EXTERIOR) OR APPROVED EQUAL
 PT-2 OSMO OIL CLEAR UV PROTECTION (SATIN SHEEN) OR APPROVED EQUAL
 PV-1 PAVER TO BE PLANKLOCK (8"X24")BY ARTISTIC PAVERS IN SILVER SAM COLOR


SCALE:	AS NOTED
DRAWN:	BCC
CHECKED:	BCC
PROJECT NO:	2019-010

A2.1

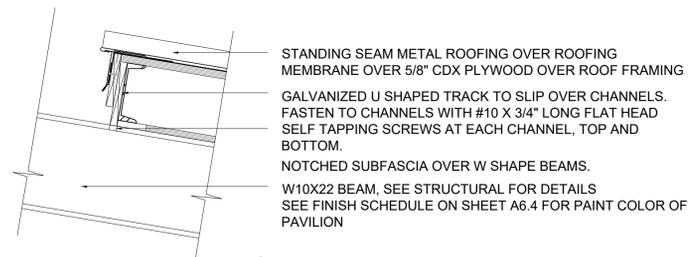


3 ROOF EDGE UPPER DETAIL

SCALE: 1-1/2" = 1'-0"

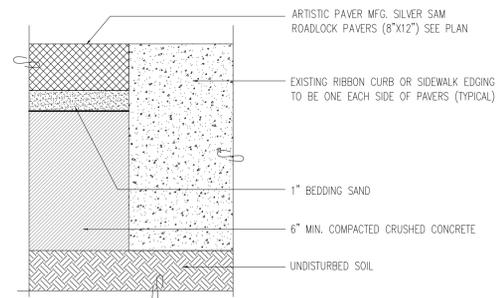

2 PAVER DETAIL

SCALE: 3" = 1'-0"

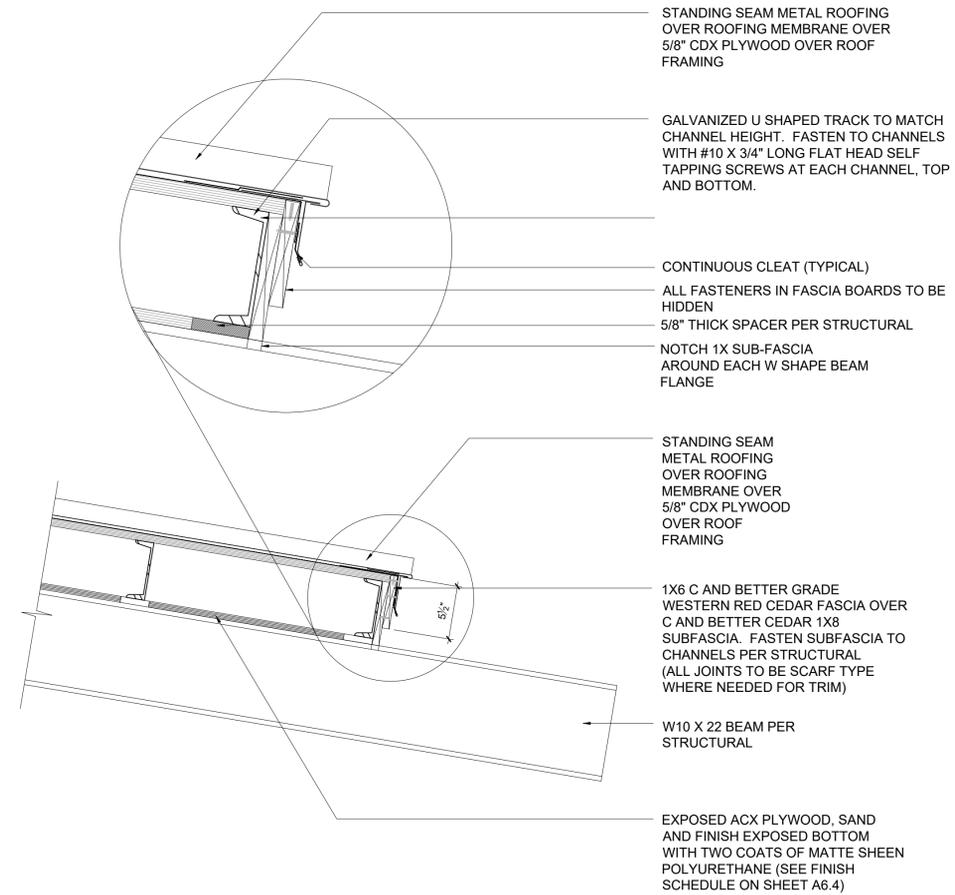

1 ROOF EDGE LOWER DETAIL

SCALE: 1-1/2" = 1'-0"

ISSUE	DATE
BID SET	9.26.19

**PAVILION,
PAVERS, AND
FENCING FOR
HENRY LEE
PARK**

701 BEVILLE ROAD
DAYTONA BEACH, FL
32114

SCALE: AS NOTED
DRAWN: BCC
CHECKED: BCC
PROJECT NO: 2019-010

A2.2

DESIGN SPECIFICATIONS

- DESIGN IS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2017.
- MINIMUM 28 DAY CONCRETE CYLINDER STRENGTH SHALL BE:
 - FOOTINGS AND SLAB ON GRADE 3000 PSI
 - OTHERS 3000 PSI
- REINFORCING STEEL SHALL CONFORM TO ASTM A615 GRADE 60.
- STRUCTURAL STEEL W-SHAPES SHALL CONFORM TO ASTM A992 GRADE 50.
- STRUCTURAL STEEL PLATES, ANGLES, CHANNELS, AND OTHER ROLLED MEMBERS SHALL CONFORM TO ASTM A36.
- ANCHOR RODS SHALL BE ASTM F1554 GRADE 36.
- ASSUMED BEARING CAPACITY FOR SPREAD FOOTINGS IS 2000 PSF.
- DESIGN LOADS:
 - MINIMUM ROOF LIVE LOAD 20 PSF
 - LIVE LOAD REDUCTION PER FBC 2017 SECTION 1607.10 IS INCLUDED
 - WIND LOAD (ASCE 7-10) OCCUPANCY CATEGORY II, BASIC WIND SPEED V = 148 MPH, EXPOSURE B, INTERNAL PRESSURE COEFFICIENT GCp = 0.0
- ALL STRUCTURAL FRAMING AND CONNECTIONS HAVE BEEN DESIGNED FOR THE FINAL COMPLETED CONDITION AND HAVE NOT BEEN INVESTIGATED FOR POTENTIAL LOADINGS ENCOUNTERED DURING ERECTION AND CONSTRUCTION. ANY INVESTIGATION OF THE STRUCTURAL FRAMING AND CONNECTIONS FOR ADEQUACY DURING THE ERECTION AND CONSTRUCTION PROCESS IS THE RESPONSIBILITY OF THE CONTRACTOR.
- CONTRACTOR IS RESPONSIBLE FOR MEANS AND METHODS OF CONSTRUCTION AND JOB SITE SAFETY.

GENERAL NOTES

EARTHWORK

- PROOF ROLL THE BUILDING SITE TO LOCATE ANY UNFORESHOWN SOFT AREAS. ANY SOFT AREAS SHALL BE EXCAVATED AND REPLACED WITH CLEAN FILL. A DENSITY OF AT LEAST 95% OF THE MODIFIED PROCTOR MAXIMUM DRY DENSITY VALUE FOR A DEPTH OF 2 FEET IS REQUIRED UNDER THE NEW SLAB ON GRADE.
- ALL FILL SHALL BE CLEAN SAND AND FREE OF ORGANIC MATERIALS. COMPACT FILL IN 12 INCH (UNCOMPACTED THICKNESS) LIFTS TO A MINIMUM OF 95% OF THE MODIFIED PROCTOR MAXIMUM DRY DENSITY VALUE.


CONCRETE

- FORMWORK SHALL BE DESIGNED IN ACCORDANCE WITH THE ACI 'MANUAL OF CONCRETE PRACTICE', LATEST EDITION.
- REINFORCING STEEL SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH THE ACI 'MANUAL OF CONCRETE PRACTICE', LATEST EDITION, UNLESS OTHERWISE NOTED.
- LAP ALL WALL BARS 36 DIAMETERS LESS OTHERWISE DETAIL.
- CONCRETE PROTECTION FOR REINFORCING BARS SHALL BE IN ACCORDANCE WITH THE 'BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE', ACI 318-14.
- CONTRACTOR SHALL NOTIFY THE ENGINEER AT LEAST 24 HOURS PRIOR TO PLACING CONCRETE.
- DO NOT PLACE OR CUT HOLES IN CONCRETE SLABS, BEAMS, WALLS OR COLUMNS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
- WATER TO CEMENT RATIO SHALL BE EQUAL OR LESS THAN 0.5.
- EXTERIOR EXPOSED CONCRETE SHALL BE AIR-ENTRAINED. AIR CONTENT SHALL BE 5 PERCENT (+/- 1/2 PERCENT).
- PIPES AND CONDUITS EMBEDDED IN OR PASSING THROUGH STRUCTURAL MEMBERS MUST BE APPROVED BY THE STRUCTURAL ENGINEER. PIPES AND CONDUITS EMBEDDED IN CONCRETE SHALL NOT BE LARGER THAN 2 INCHES IN OUTSIDE DIAMETER AT THEIR WIDEST POINT OR FITTING OR 1/3 OF THE THICKNESS OF THE SLAB, BEAM OR WALL.
- ELECTRICAL CONDUIT OR PIPES EMBEDDED IN OR PASSING THROUGH SLABS, BEAMS OR WALLS SHALL BE LOCATED AND PLACED SO THAT:
 - THEY ARE NOT CLOSER THAN THREE DIAMETERS ON CENTER.
 - THE CONCRETE COVER IS NOT LESS THAN 2 INCH.
 - THEY RUN BETWEEN REINFORCING AND DO NOT DISPLACE IT IN ANY MANNER.
- ALUMINUM CONDUITS SHALL NOT BE PLACED IN CONCRETE.
- PROPER CURING PROCEDURES SHALL BE USED FOR SLAB ON GRADE TO PREVENT CURLING.
- CALCIUM CHLORIDE SHALL NOT BE USED IN CONCRETE MIXES.


STRUCTURAL STEEL

- STRUCTURAL STEEL SHALL BE DETAILED, FABRICATED, AND ERECTED IN ACCORDANCE WITH THE AISC 'STEEL CONSTRUCTION MANUAL', THIRTEENTH EDITION, AND THE AISC 'CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES', JUNE 15, 2016 EDITION.
- STEEL DECK FABRICATION AND ERECTION SHALL CONFORM TO THE STANDARD SPECIFICATIONS OF THE STEEL DECK INSTITUTE.
- ALL WELDING SHALL COMPLY WITH AWS D11 USING E70XX ELECTRODES. ALL WELDING TO BE DONE BY AWS PREQUALIFIED WELDERS, CERTIFIED FOR WELDS MADE. PROVIDE CONTINUOUS MINIMUM SIZED WELDS PER AISC REQUIREMENTS, UNLESS NOTED OTHERWISE.
- THE MINIMUM SIZE OF FILLET WELDS SHALL BE AS SPECIFIED IN TABLE J2.4 IN THE AISC 'STEEL CONSTRUCTION MANUAL'.
- MINIMUM STRENGTH OF WELDED CONNECTIONS, UNLESS NOTED OTHERWISE ON THE DRAWINGS, ALL SHOP AND FIELD WELDS SHALL DEVELOP THE FULL TENSILE STRENGTH OF THE MEMBER OF ELEMENT JOINED. ALL MEMBERS WITH MOMENT CONNECTIONS, NOTED ON THE DRAWINGS, SHALL BE WELDED TO DEVELOP THE FULL FLEXURAL CAPACITY OF THE MEMBER, UNLESS NOTED OTHERWISE ON THE DRAWINGS.
- COLUMN BASE PLATES SHALL HAVE OVERSIZED HOLES WITH PLATE WASHERS (MINIMUM 3/8-INCH THICK) PROVIDED WITH ANCHOR RODS.
- GROUT UNDER BASE PLATES IN ACCORDANCE WITH THE 'AISC CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES', JUNE 15, 2016 EDITION.
- CLEAN, PREPARE, AND SHOP PRIME EXTERIOR EXPOSED STRUCTURAL STEEL MEMBERS IN ACCORDANCE WITH SSPC STANDARDS SP-1 AND SP-6.
- WHILE THE DESIGN DOCUMENTS MAY REFERENCE OSHA, THEY ARE NOT INTENDED TO SPECIFICALLY IDENTIFY ALL APPLICABLE OSHA REQUIREMENTS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO IDENTIFY AND COMPLY WITH ALL APPLICABLE OSHA REQUIREMENTS.
- ALL STRUCTURAL STEEL PERMANENTLY EXPOSED TO THE WEATHER, SHALL BE HOT-DIPPED GALVANIZED IN ACCORDANCE WITH ASTM A123, UNLESS OTHERWISE NOTED.


SYMBOL LEGEND

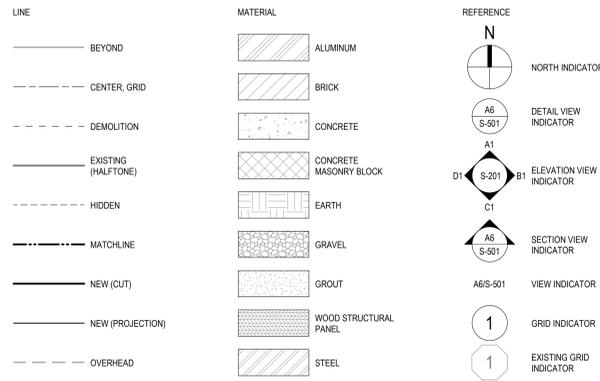


CONCRETE LEGEND

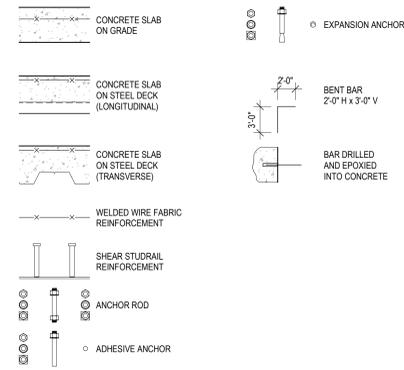


STEEL LEGEND



STEEL SHAPES LEGEND

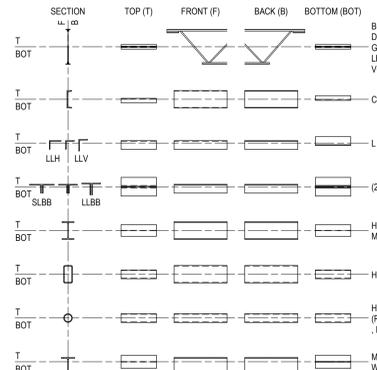

STEEL FRAMING PLAN LEGEND

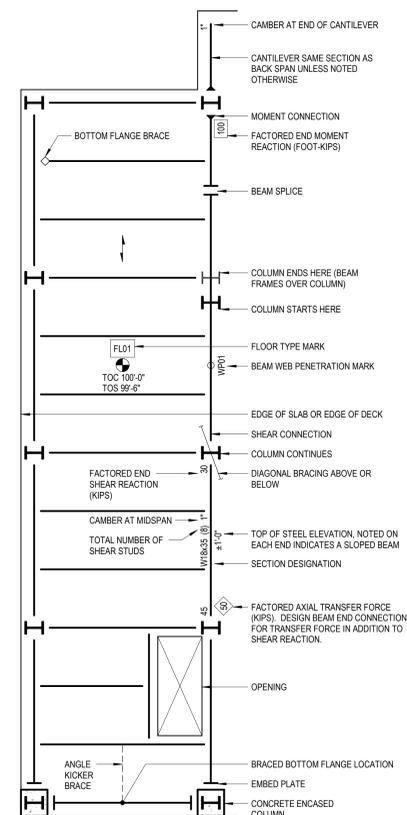

GENERAL WALL (FASCIA) ELEVATION

DESIGN WIND PRESSURE, PSF						DESCRIPTION	
AREA	EFFECTIVE WIND AREA, SF						
	≤ 9	> 9, ≤ 36	> 36				
1	+46.9	-43.5	+46.9	-43.5	-46.9	-43.5	ROOF OR SOFFIT INTERIOR ZONE
2	+70.3	-65.5	+70.3	-65.5	+69.9	-65.5	END ZONE REGION OF THE ROOF OR SOFFIT SURFACE LOCATED WITHIN 3'-3" OF THE BUILDING PERIMETER
3	+93.8	-116.2	+70.3	-65.5	+69.9	-65.5	END ZONE REGION OF THE ROOF OR SOFFIT SURFACE LOCATED WITHIN 3'-3" OF THE BUILDING CORNER
4 (+)	+50.1	-50.1	+50.1	-50.1	+50.1	-50.1	WALL INTERIOR ZONE
4 (-)	+50.1	-50.1	+50.1	-50.1	+50.1	-50.1	
5 (+)	+50.1	-50.1	+50.1	-50.1	+50.1	-50.1	END ZONE REGION OF THE WALL SURFACE LOCATED WITHIN 3'-0" OF THE BUILDING CORNER
5 (-)	+50.1	-50.1	+50.1	-50.1	+50.1	-50.1	

- NOTES:
- WIND PRESSURES SHOWN ARE FACTORED LOADS OBTAINED VIA ASCE 7-10. MULTIPLY BY 0.6 TO CALCULATE SERVICE LOADS.
 - NEGATIVE PRESSURES ACT AWAY FROM COMPONENT SURFACE. POSITIVE PRESSURES ACT TOWARD COMPONENT SURFACES.

WIND PROVISIONS FOR COMPONENTS AND CLADDING TABLE

12" = 1'-0"

SHEET INDEX

- S-001 GENERAL NOTES AND INFORMATION
- S-101 PLANS AND SECTION AND DETAILS



2300 Maitland Center Parkway,
Suite 210
Maitland, FL 32751
407 / 659 6500
407 / 659 0609 fax

www.graef-usa.com

CLIENT:

CITY OF DAYTONA BEACH, FL

PROJECT TITLE:

HENRY LEE PARK PAVILION

701 BELLEVUE AVENUE
DAYTONA BEACH, FL 32114

ISSUE:

PROJECT INFORMATION:

PROJECT NUMBER: 2019-4103.01

DATE: 10/16/2019

DRAWN BY: HQ

CHECKED BY: SDH

APPROVED BY: SDH

SCALE: AS NOTED

SHEET TITLE:

GENERAL NOTES AND INFORMATION

SHEET NUMBER:

S-001



I:\gasnet\gasnet\alproj\012019\020194\103\BIM\Central\2019-4103.01 Pavilion at Henry Lee Park-R18.rvt 10/17/2019 11:27:08 AM

