

PROGRESS SET



GEORGETOWN COUNTY RE-ENTRY FACILITY

GEORGETOWN COUNTY VOLUME 2

611315

MOSELEYARCHITECTS

3200 NORFOLK STREET, RICHMOND, VA 23230
PHONE (804) 794-7555 FAX (804) 355-5690
MOSELEYARCHITECTS.COM

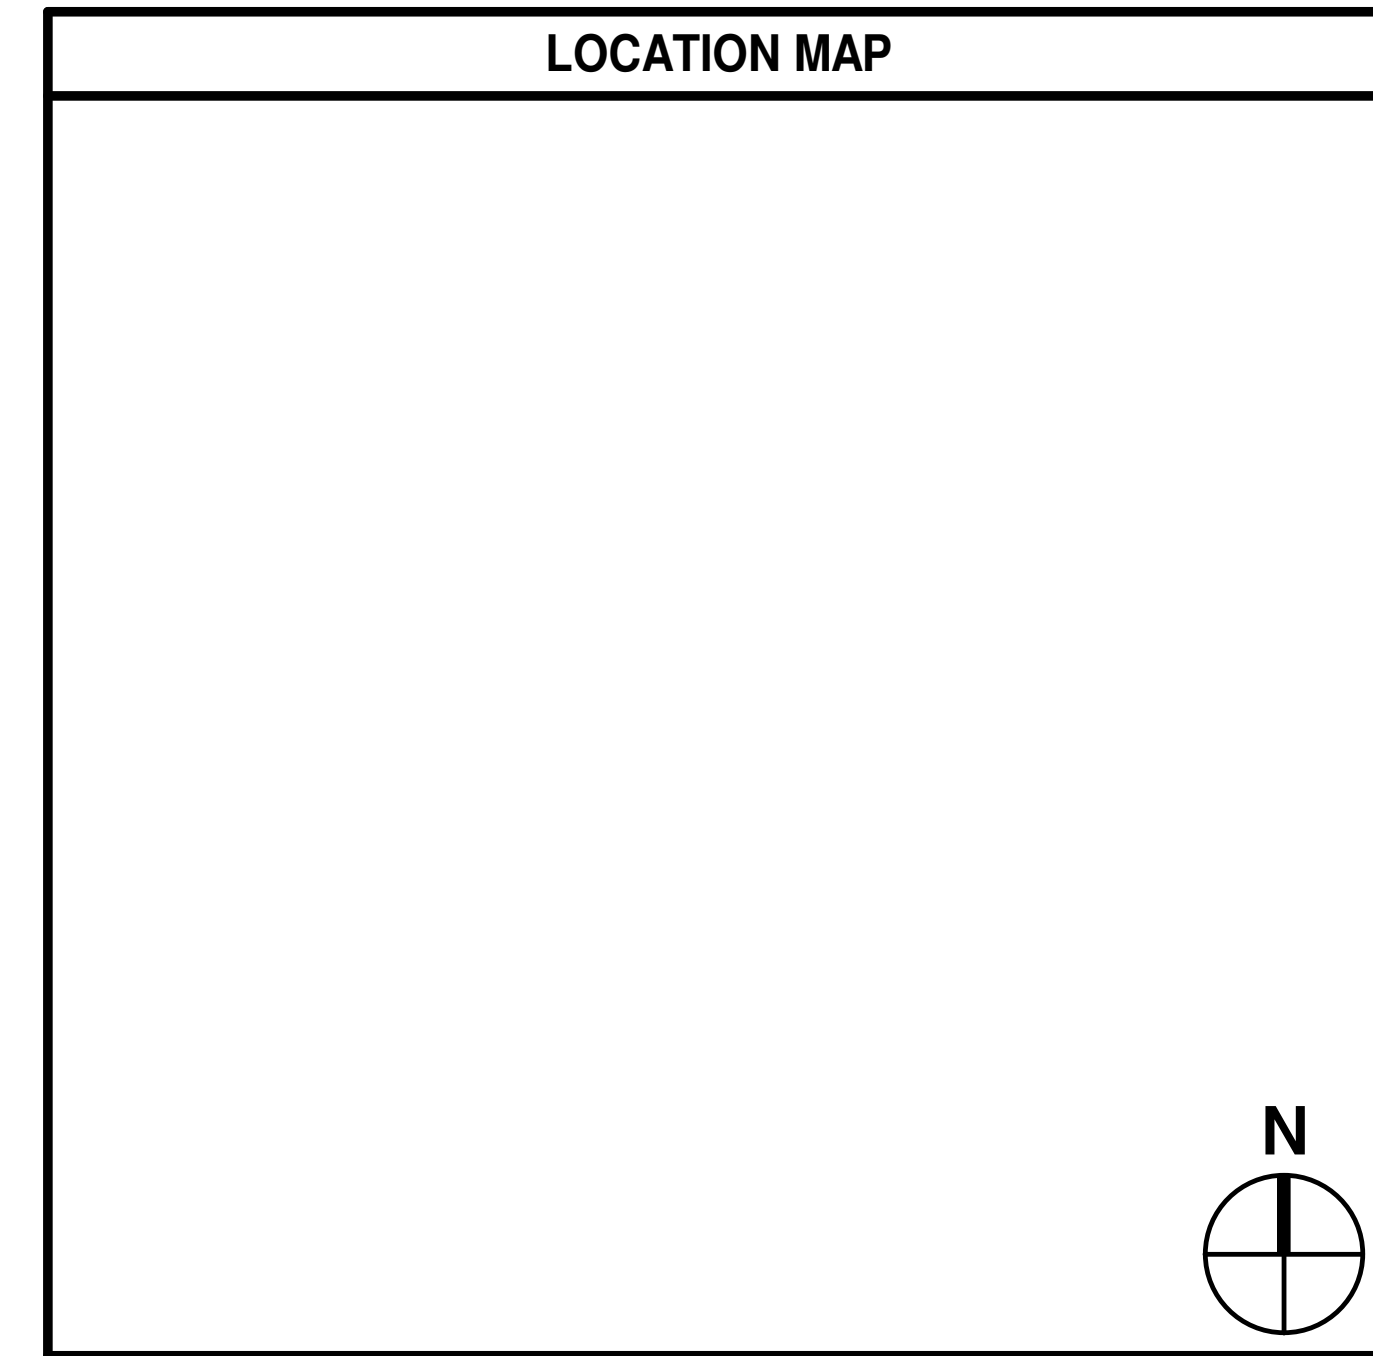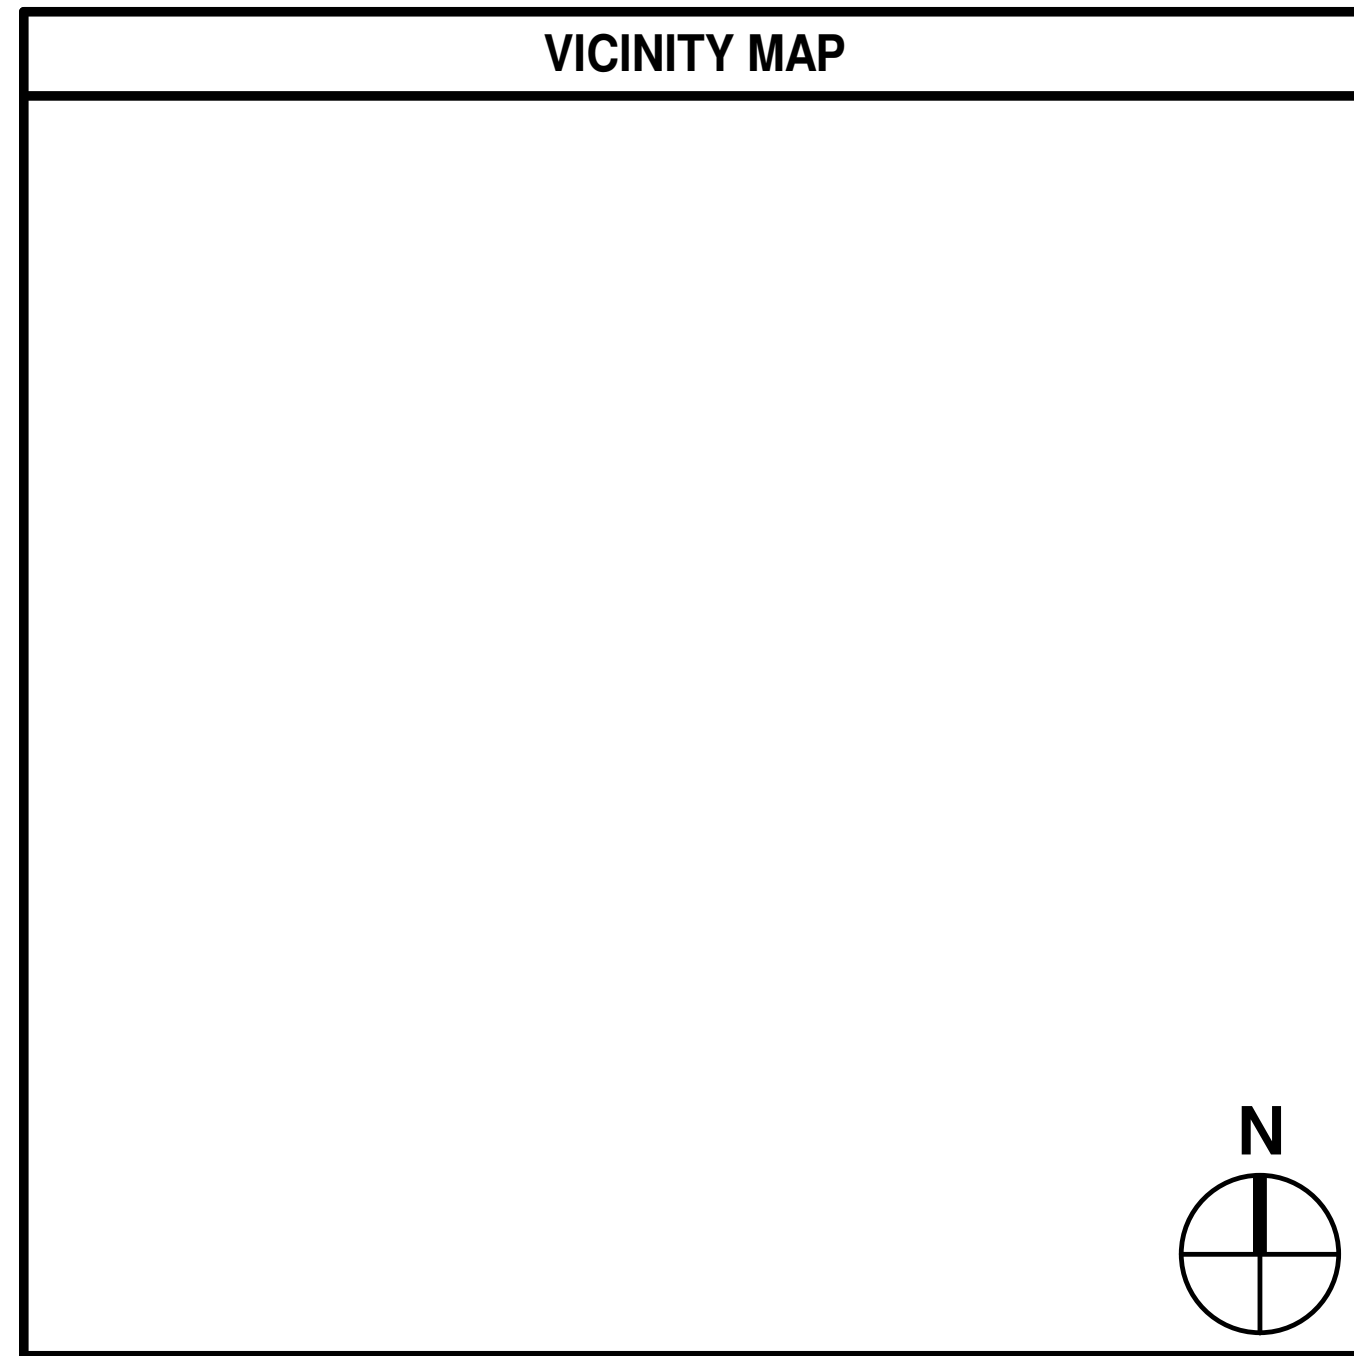

Consultant Firm	Consultant Discipline
Consultant Address	Consultant Location
Consultant Firm	Consultant Discipline
Consultant Address	Consultant Location
Consultant Firm	Consultant Discipline
Consultant Address	Consultant Location
Consultant Firm	Consultant Discipline
Consultant Address	Consultant Location
Consultant Firm	Consultant Discipline
Consultant Address	Consultant Location

DRAWING INDEX - VOLUME 1	DRAWING INDEX - VOLUME 2
<p>LIFE SAFETY</p> <p>LS1.0 CODE SUMMARY</p> <p>LS1.1 LIFE SAFETY INFORMATION</p> <p>ARCHITECTURAL</p> <p>A0.1 GENERAL ARCHITECTURAL INFORMATION</p> <p>A0.2 WALL PARTITION TYPES, WALL JOINTS AND TERMINATIONS</p> <p>A2.1.1 RE-ENTRY BUILDING- FLOOR PLAN, RCP, ROOF PLAN</p> <p>A4.1.1 BUILDING ELEVATIONS</p> <p>A4.1.3 INTERIOR ELEVATIONS</p> <p>A5.0.1 BUILDING SECTIONS</p> <p>A5.1.1 WALL SECTIONS</p> <p>A7.1.1 TOILET ASSEMBLIES, SCHEDULE AND ENLARGED PLANS</p> <p>STRUCTURAL</p> <p>S0.0.1 GENERAL NOTES AND LEGENDS</p> <p>S1.1.1 FOUNDATION PLAN</p> <p>S3.0.1 TYPICAL FOUNDATION & SLAB DETAILS</p> <p>S3.1.1 FOUNDATION SECTIONS</p> <p>PLUMBING</p> <p>P0.1 LEGENDS, ABBREVIATIONS AND GENERAL NOTES</p> <p>P1.0 PLUMBING FIRST FLOOR PLANS</p> <p>MECHANICAL</p> <p>M0.1 LEGENDS, ABBREVIATIONS AND GENERAL NOTES</p> <p>M2.1.1 FLOOR PLAN & SCHEDULES</p> <p>ELECTRICAL</p> <p>E0.1 LEGENDS, ABBREVIATIONS AND GENERAL NOTES</p> <p>E2.1.1 ELECTRICAL FLOOR PLAN</p>	

MOSELEYARCHITECTS

3200 NORFOLK STREET, RICHMOND, VA 23230
PHONE (804) 794-7555 FAX (804) 355-5690
MOSELEYARCHITECTS.COM

RECORD DRAWINGS
PROGRESS
PRINT NOT FOR
CONSTRUCTION

GEORGETOWN COUNTY RE-ENTRY FACILITY
611315
GEORGETOWN COUNTY

PROJECT NO:	611315
DATE:	FEBRUARY 26, 2024
REVISIONS	
DATE	DESCRIPTION

**COVER -
VOLUME 2**

THE CONTRACT DOCUMENTS ARE COMPLEMENTARY, AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL.
IN CASE OF A CONFLICT, DISAGREEMENT, OR AMBIGUITY, PROVIDE THE BETTER QUALITY. IN CASE OF A CONFLICT, DISAGREEMENT, OR AMBIGUITY, PROVIDE THE GREATER QUANTITY OF WORK.

STATE OF SOUTH CAROLINA BUILDING CODE SUMMARY

ADMINISTRATION

Table with 2 columns: APPLICABLE CODES, STANDARDS AND REFERENCES; YEAR. Lists codes like SOUTH CAROLINA BUILDING CODE, FIRE CODE, PLUMBING CODE, etc.

BUILDING DATA

Form for building data including: BUILDING PROJECT TYPE, PRIMARY OCCUPANCY CLASSIFICATION, OTHER OCCUPANCY CLASSIFICATION, SPECIAL USES, CONSTRUCTION TYPE, SPRINKLERS, STANDPIPES, FIRE DISTRICT, SPECIAL INSPECTIONS REQUIRED, ACCESSORY OCCUPANCIES, INCIDENTAL USES, MIXED OCCUPANCY, SEPARATED MIXED USE, NON-SEPARATED MIXED USE, RISK CATEGORY, SEISMIC DESIGN CATEGORY.

GROSS BUILDING AREA

Table with 4 columns: FLOOR, EXISTING (SQ. FT.), NEW (SQ. FT.), SUBTOTAL. Lists floors from FIRST FLOOR B to CONTROL LEVEL 1.

ALLOWABLE AREA

Table with 7 columns: STORY LEVEL, DESCRIPTION AND USE, BUILDING AREA PER STORY, ALLOWABLE AREA FACTOR, AREA FRONTAGE INCREASE, ALLOWABLE AREA PER STORY, ALLOWABLE LARGER THAN ACTUAL.

ALLOWABLE HEIGHT

Table with 4 columns: BUILDING HEIGHT IN FEET (ACTUAL), BUILDING HEIGHT IN STORIES, ALLOWABLE, SHOWN ON PLANS, CODE REFERENCE.

FIRE RESISTANCE RATING OF BUILDING ELEMENTS

Table with 3 columns: BUILDING ELEMENT, CODE REFERENCE, REQUIRED RATING. Lists elements like CONSTRUCTION TYPE, EXTERIOR BEARING WALLS, INTERIOR BEARING WALLS, etc.

LIFE SAFETY PLAN

Table with 2 columns: LIFE SAFETY PLAN REQUIREMENTS, LOCATION OF DOORS WITH DELAYED EGRESS LOCKS AND THE AMOUNT OF DELAY. Lists requirements like FIRE AND/OR SMOKE RATED WALL LOCATIONS, EXIT SIGN LOCATIONS, etc.

SPECIAL INSPECTIONS

Table with 2 columns: ID, DESCRIPTION. Lists inspections like 1705.4.1 GLASS UNIT MASONRY AND MASONRY VENEER IN RISK CATEGORY IV, 1705.13.5 ARCHITECTURAL COMPONENTS, etc.

SPECIAL DETAILED REQUIREMENTS BASED ON USE AND OCCUPANCY

Table with 2 columns: ID, DESCRIPTION. Lists requirements like 406.5.3 MIXED OCCUPANCY SEPARATION (OPEN PARKING GARAGE), 408.3.1 DOOR WIDTH, 408.3.6 EXIT DISCHARGE, etc.

FIRE PROTECTIONS SYSTEMS

Table with 2 columns: ID, DESCRIPTION. Lists systems like 903.1 GENERAL (AUTOMATIC SPRINKLER SYSTEMS), 906.2 PORTABLE FIRE EXTINGUISHER DISTRIBUTION, etc.

FIRE RESISTANCE RATED CONSTRUCTION

Table with 2 columns: ID, DESCRIPTION. Lists construction requirements like 703.2.2 ANALYTICAL METHODS FOR DETERMINING FIRE RESISTANCE, 705.8 MAXIMUM AREA OF EXTERIOR WALL OPENINGS, etc.

INTERIOR FINISHES

Table with 2 columns: ID, DESCRIPTION. Lists finishes like 802.7 FOAM PLASTICS, 803.1.2 CLASS, 803.13 INTERIOR WALL AND CEILING FINISH REQUIREMENTS BY OCCUPANCY, etc.

MEANS OF EGRESS

Table with 2 columns: ID, DESCRIPTION. Lists egress requirements like 1003.5 ELEVATION CHANGE, 1004.1 DESIGN OCCUPANT LOAD, 1004.5 AREAS WITHOUT FIXED SEATING, etc.

PLUMBING FIXTURES

Table with 2 columns: ID, DESCRIPTION. Lists plumbing fixture requirements like 2902.1 USE, 2902.2 CORRIDOR FIRE-RESISTANCE RATING.

LIFE SAFETY - ACCESSORY USE BUILDING 'n' FIRST...		
SPACE NUMBER	SPACE NAME	AREA (SF) GROSS


LIFE SAFETY - FACILITY TOTAL AREA	
	AREA (SF)

LIFE SAFETY - GENERAL DATA								
BUILDING	OCCUPANCY CLASSIFICATION		CONSTRUCTION TYPE	FULLY SPRINKLERED	MIXED OCCUPANCY	NON-SEPARATE MIXED USE	SEPARATED MIXED USE	OCCUPANCY CLASSIFICATION - DESIGN
	PRIMARY	SECONDARY						

LIFE SAFETY - HEIGHT									
BUILDING	SPRINKLERED	ALLOWABLE HEIGHT INCREASE	ALLOWABLE STORIES INCREASE	TABULAR HEIGHT	TABULAR STORIES	ALLOWABLE HEIGHT	ALLOWABLE STORIES	ACTUAL HEIGHT	ACTUAL STORIES

LIFE SAFETY - OPEN PERIMETER - IBC 2012 & OLDER								
TABULAR AREA (SF)	OPEN PERIMETER CALCULATIONS				SPRINKLERED MODIFICATION INCREASE		TOTAL ALLOWABLE AREA (SF)	ACTUAL AREA (SF)
	F (FT)	P (FT)	W (FT)	INCREASE FOR FRONTAGE (SF)	200% / MULTI-STORY (SF)	300% / SINGLE STORY (SF)		

LIFE SAFETY - OPEN PERIMETER - IBC 2015 & NEWER						
TABULAR AREA (SF)	OPEN PERIMETER CALCULATIONS				TOTAL ALLOWABLE AREA (SF)	ACTUAL AREA (SF)
	F (FT)	P (FT)	W (FT)	INCREASE FOR FRONTAGE (SF)		

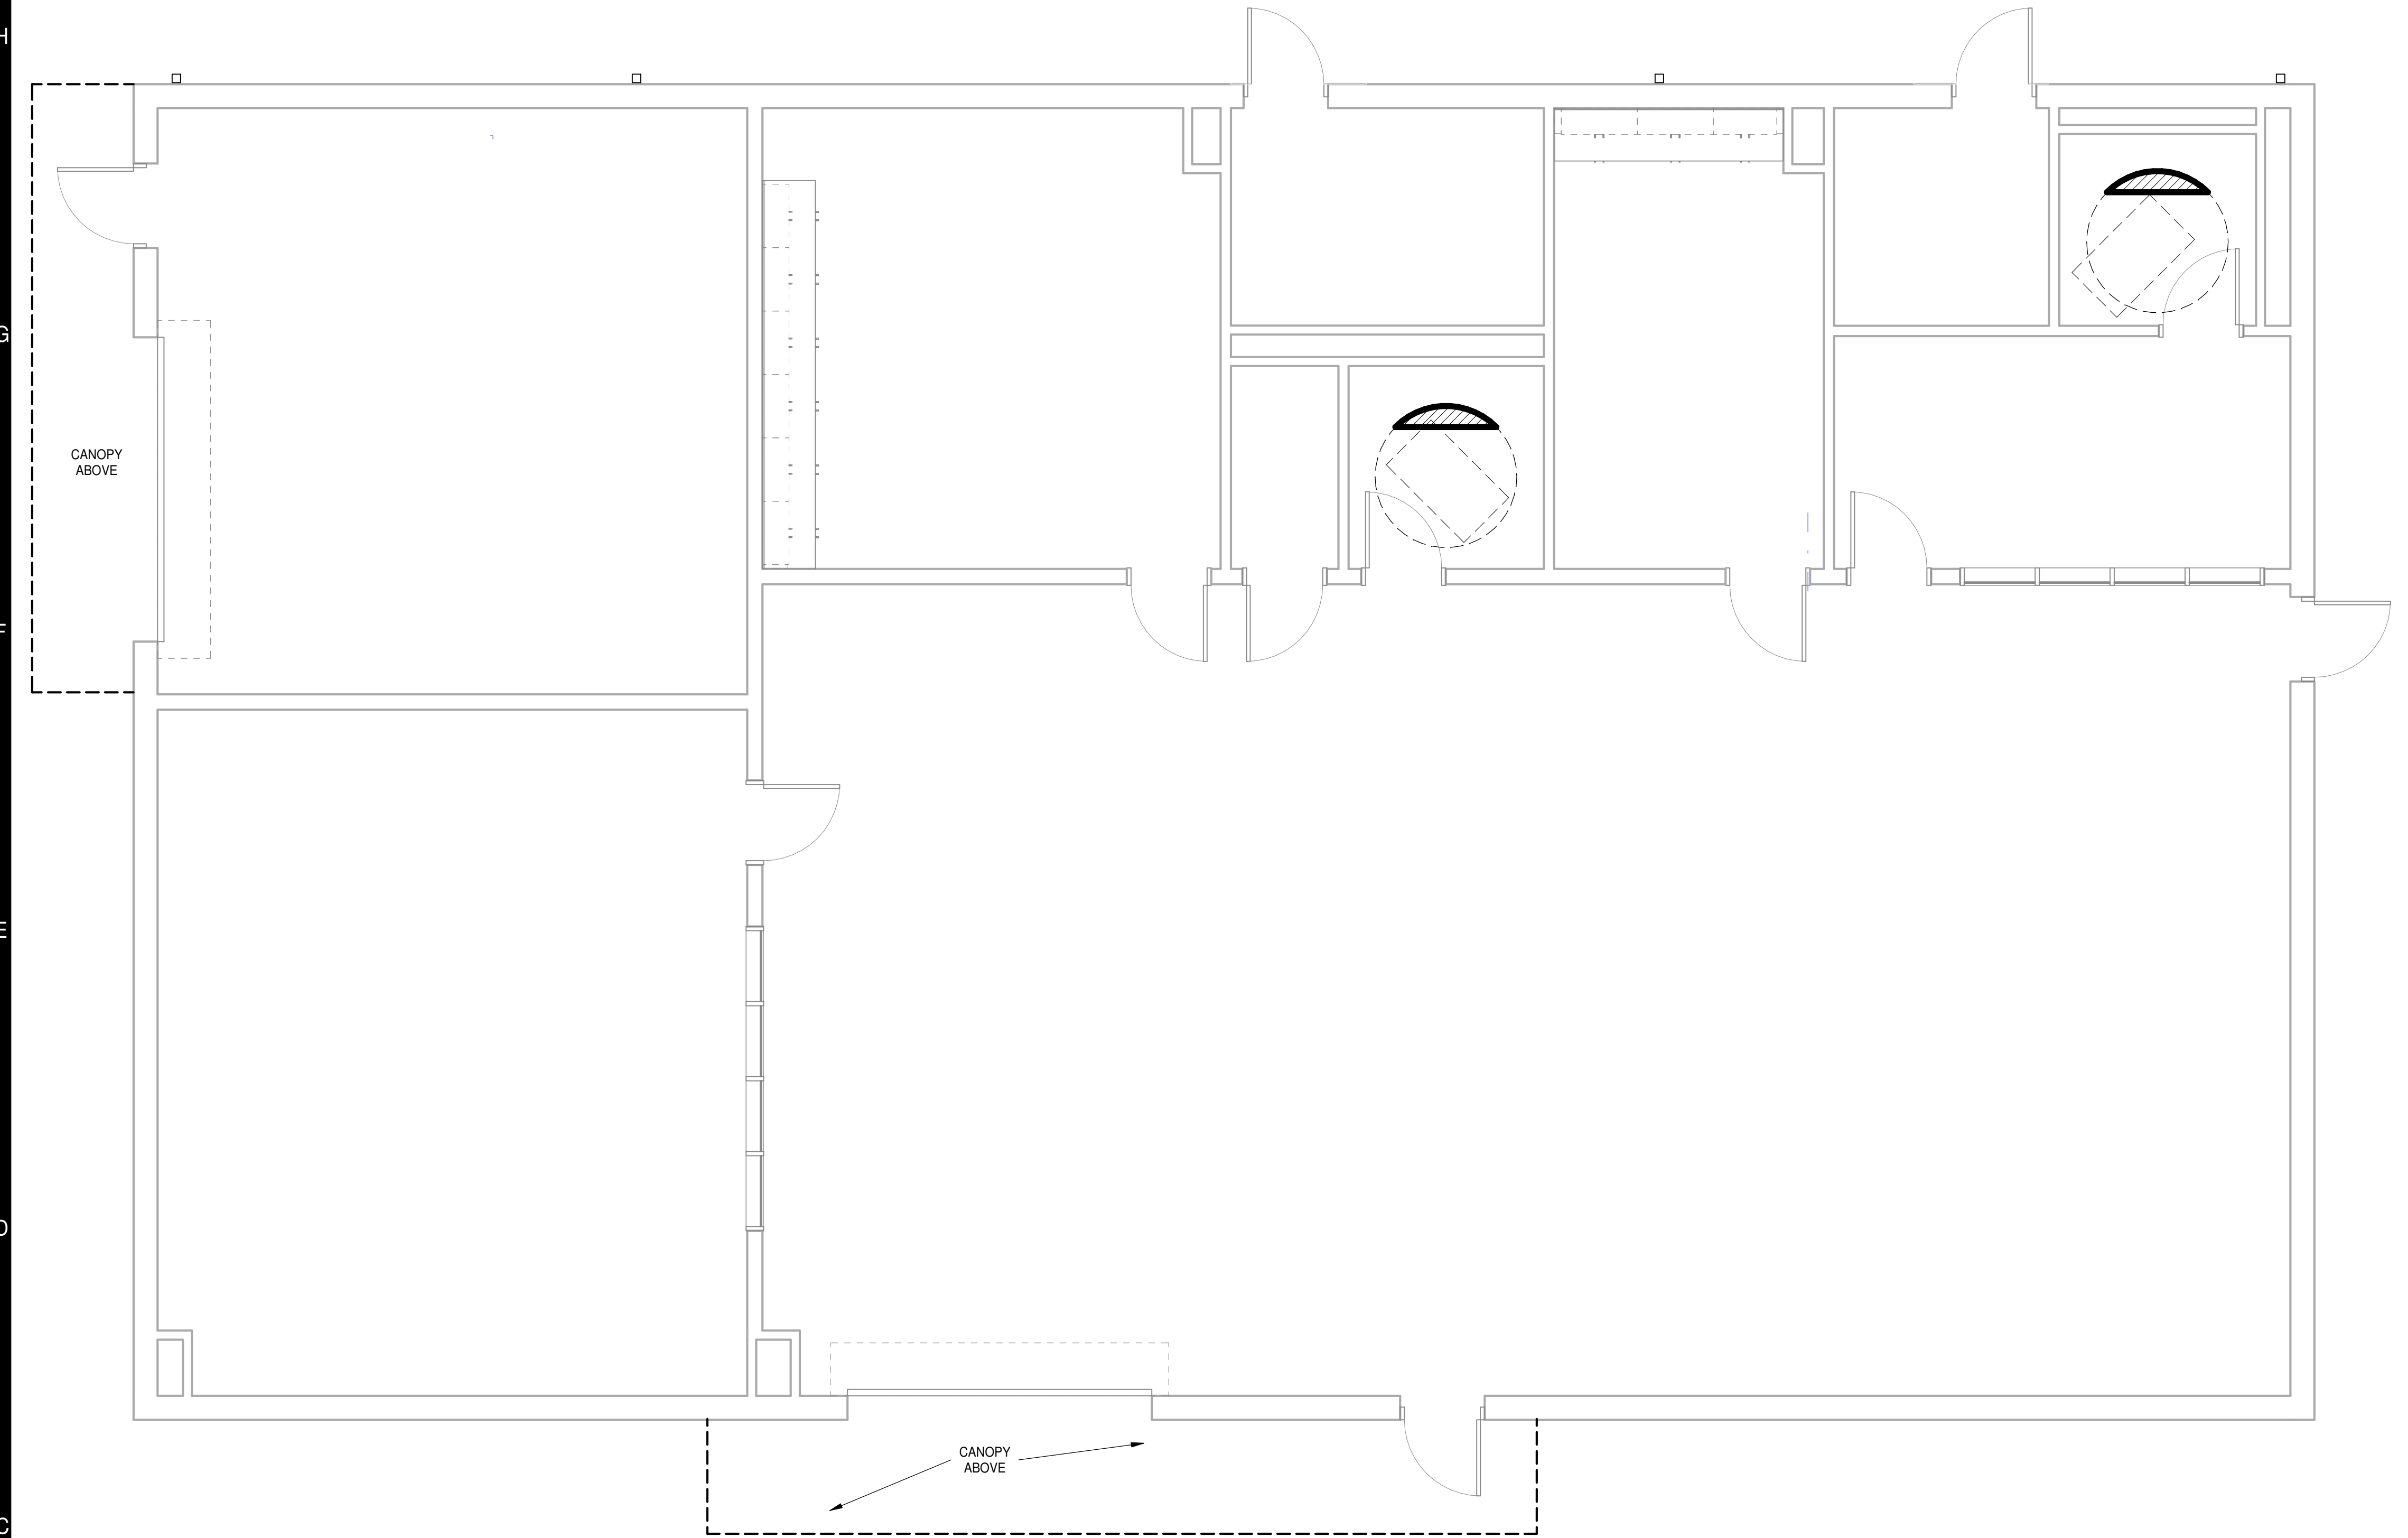

LIFE SAFETY SYMBOL LEGEND																																	
APPLIES TO LS SERIES OF DRAWINGS ONLY																																	
DESIGNATOR MATRIX	SYMBOLS																																
<table border="1"> <thead> <tr> <th>WALL</th> <th>BARRIER</th> <th>PARTITION</th> <th>RATED BEARING OR NON-BEARING WALL</th> </tr> </thead> <tbody> <tr> <td>4 HR FIRE</td> <td>▲▲▲▲</td> <td>□□□□</td> <td>■</td> </tr> <tr> <td>3 HR FIRE</td> <td>▶▶▶▶</td> <td>◇◇◇◇</td> <td>●</td> </tr> <tr> <td>2 HR FIRE</td> <td>××××</td> <td>■</td> <td>▨</td> </tr> <tr> <td>1 HR FIRE</td> <td>▶▶▶▶</td> <td>★ ★ ★ ★</td> <td>▨</td> </tr> <tr> <td>1/2 HR FIRE</td> <td> </td> <td>◆◆◆◆</td> <td> </td> </tr> <tr> <td>SMOKE-TIGHT</td> <td>▲▲▲▲</td> <td>◆◆◆◆</td> <td> </td> </tr> <tr> <td>INCIDENTAL</td> <td> </td> <td>◆◆◆◆</td> <td> </td> </tr> </tbody> </table>	WALL	BARRIER	PARTITION	RATED BEARING OR NON-BEARING WALL	4 HR FIRE	▲▲▲▲	□□□□	■	3 HR FIRE	▶▶▶▶	◇◇◇◇	●	2 HR FIRE	××××	■	▨	1 HR FIRE	▶▶▶▶	★ ★ ★ ★	▨	1/2 HR FIRE		◆◆◆◆		SMOKE-TIGHT	▲▲▲▲	◆◆◆◆		INCIDENTAL		◆◆◆◆		<p>1205 ROOM NUMBER</p> <p>798 1280 DIRECTION OF EGRESS EGRESS LOAD CAPACITY NUMBER OF OCCUPANTS</p> <p>DIRECTION OF EGRESS NUMBER OF OCCUPANTS EGRESS LOAD CAPACITY</p> <p>XXX'-X" MAXIMUM TRAVEL DISTANCE</p> <p>XXX'-X" COMMON PATH OF TRAVEL</p> <p>CPOT</p> <p>◆ FIRE EXTINGUISHER CABINET</p> <p>● FIRE EXTINGUISHER BRACKET</p> <p>▨ EXTENT OF SPRAYED-ON/APPLIED FIRE PROOFING</p> <p>▨ EXTENT OF SMOKE COMPARTMENT</p> <p>▨ EXTENT OF FLOOR / CEILING AND/OR ROOF / CEILING ASSEMBLY</p> <p>3 BUILDING NUMBER</p>
WALL	BARRIER	PARTITION	RATED BEARING OR NON-BEARING WALL																														
4 HR FIRE	▲▲▲▲	□□□□	■																														
3 HR FIRE	▶▶▶▶	◇◇◇◇	●																														
2 HR FIRE	××××	■	▨																														
1 HR FIRE	▶▶▶▶	★ ★ ★ ★	▨																														
1/2 HR FIRE		◆◆◆◆																															
SMOKE-TIGHT	▲▲▲▲	◆◆◆◆																															
INCIDENTAL		◆◆◆◆																															
NOTES:																																	
<p>1. WALL DESIGNATIONS ON THE LS SERIES OF DRAWINGS ARE FOR GRAPHICAL PURPOSES ONLY AND MAY NOT REPRESENT THE ACTUAL WALL/PARTITION CONSTRUCTION.</p> <p>2. REFER TO THE CONTRACT DOCUMENTS, INCLUDING THE LIFE SAFETY SYMBOLS LEGEND AND A0, A1 AND A2 SERIES OF DRAWINGS, FOR ACTUAL WALL/PARTITION TYPES AND CONSTRUCTION REQUIREMENTS.</p> <p>3. RATING OF BEARING OR NON-BEARING WALLS ARE PER TABLE 601 AND SECTION 602.1 AND DO NOT REQUIRE PROTECTED OPENINGS.</p>																																	
DOUBLE FIRE WALL																																	
<p>1/2 = RATING IN HOURS</p> <p>DFW = DOUBLE FIRE WALL</p>	<p>NOTE: RATINGS MAY VARY. REFER TO A0.2 FOR ACTUAL RATINGS OF FIRE WALLS COMPOSING THE DOUBLE FIRE WALLS</p>																																

LIFE SAFETY KEY PLAN				

FIRE RATED ASSEMBLIES				
REPRESENTED BY (Xn)				
THE ASSEMBLIES REFERENCED ARE BASIS OF DESIGN. EQUIVALENT COMPATIBLE TESTED ASSEMBLIES WILL BE ACCEPTABLE IF APPROVED BY THE LHAJ				
MARK	FIRE RATING	APPLIES TO	REFERENCE	REMARKS
Xn	-			
Xn	-			
Xn	-			
Xn	-			

PROJECT NO:	REVISIONS
611315	FEBRUARY 26, 2024
DATE	DESCRIPTION

6210 ARDREY KELL ROAD • THE HUB AT WAVERLY, SUITE 425 • CHARLOTTE, NC 28277
PHONE (704) 540-3755 FAX (704) 540-3754
MOSELEYARCHITECTS.COM


ARCHITECTURAL ABBREVIATIONS

Table of architectural abbreviations with columns for symbol, description, and symbol, description, and symbol, description.

KEYNOTES

- KEYNOTE (1 TO 2 DIGITS)
KEYNOTE (3 DIGITS ONLY)
SIZE, THICKNESS, OR OTHER DESCRIPTIVE INFORMATION


ARCHITECTURAL GRAPHIC SYMBOL LEGEND

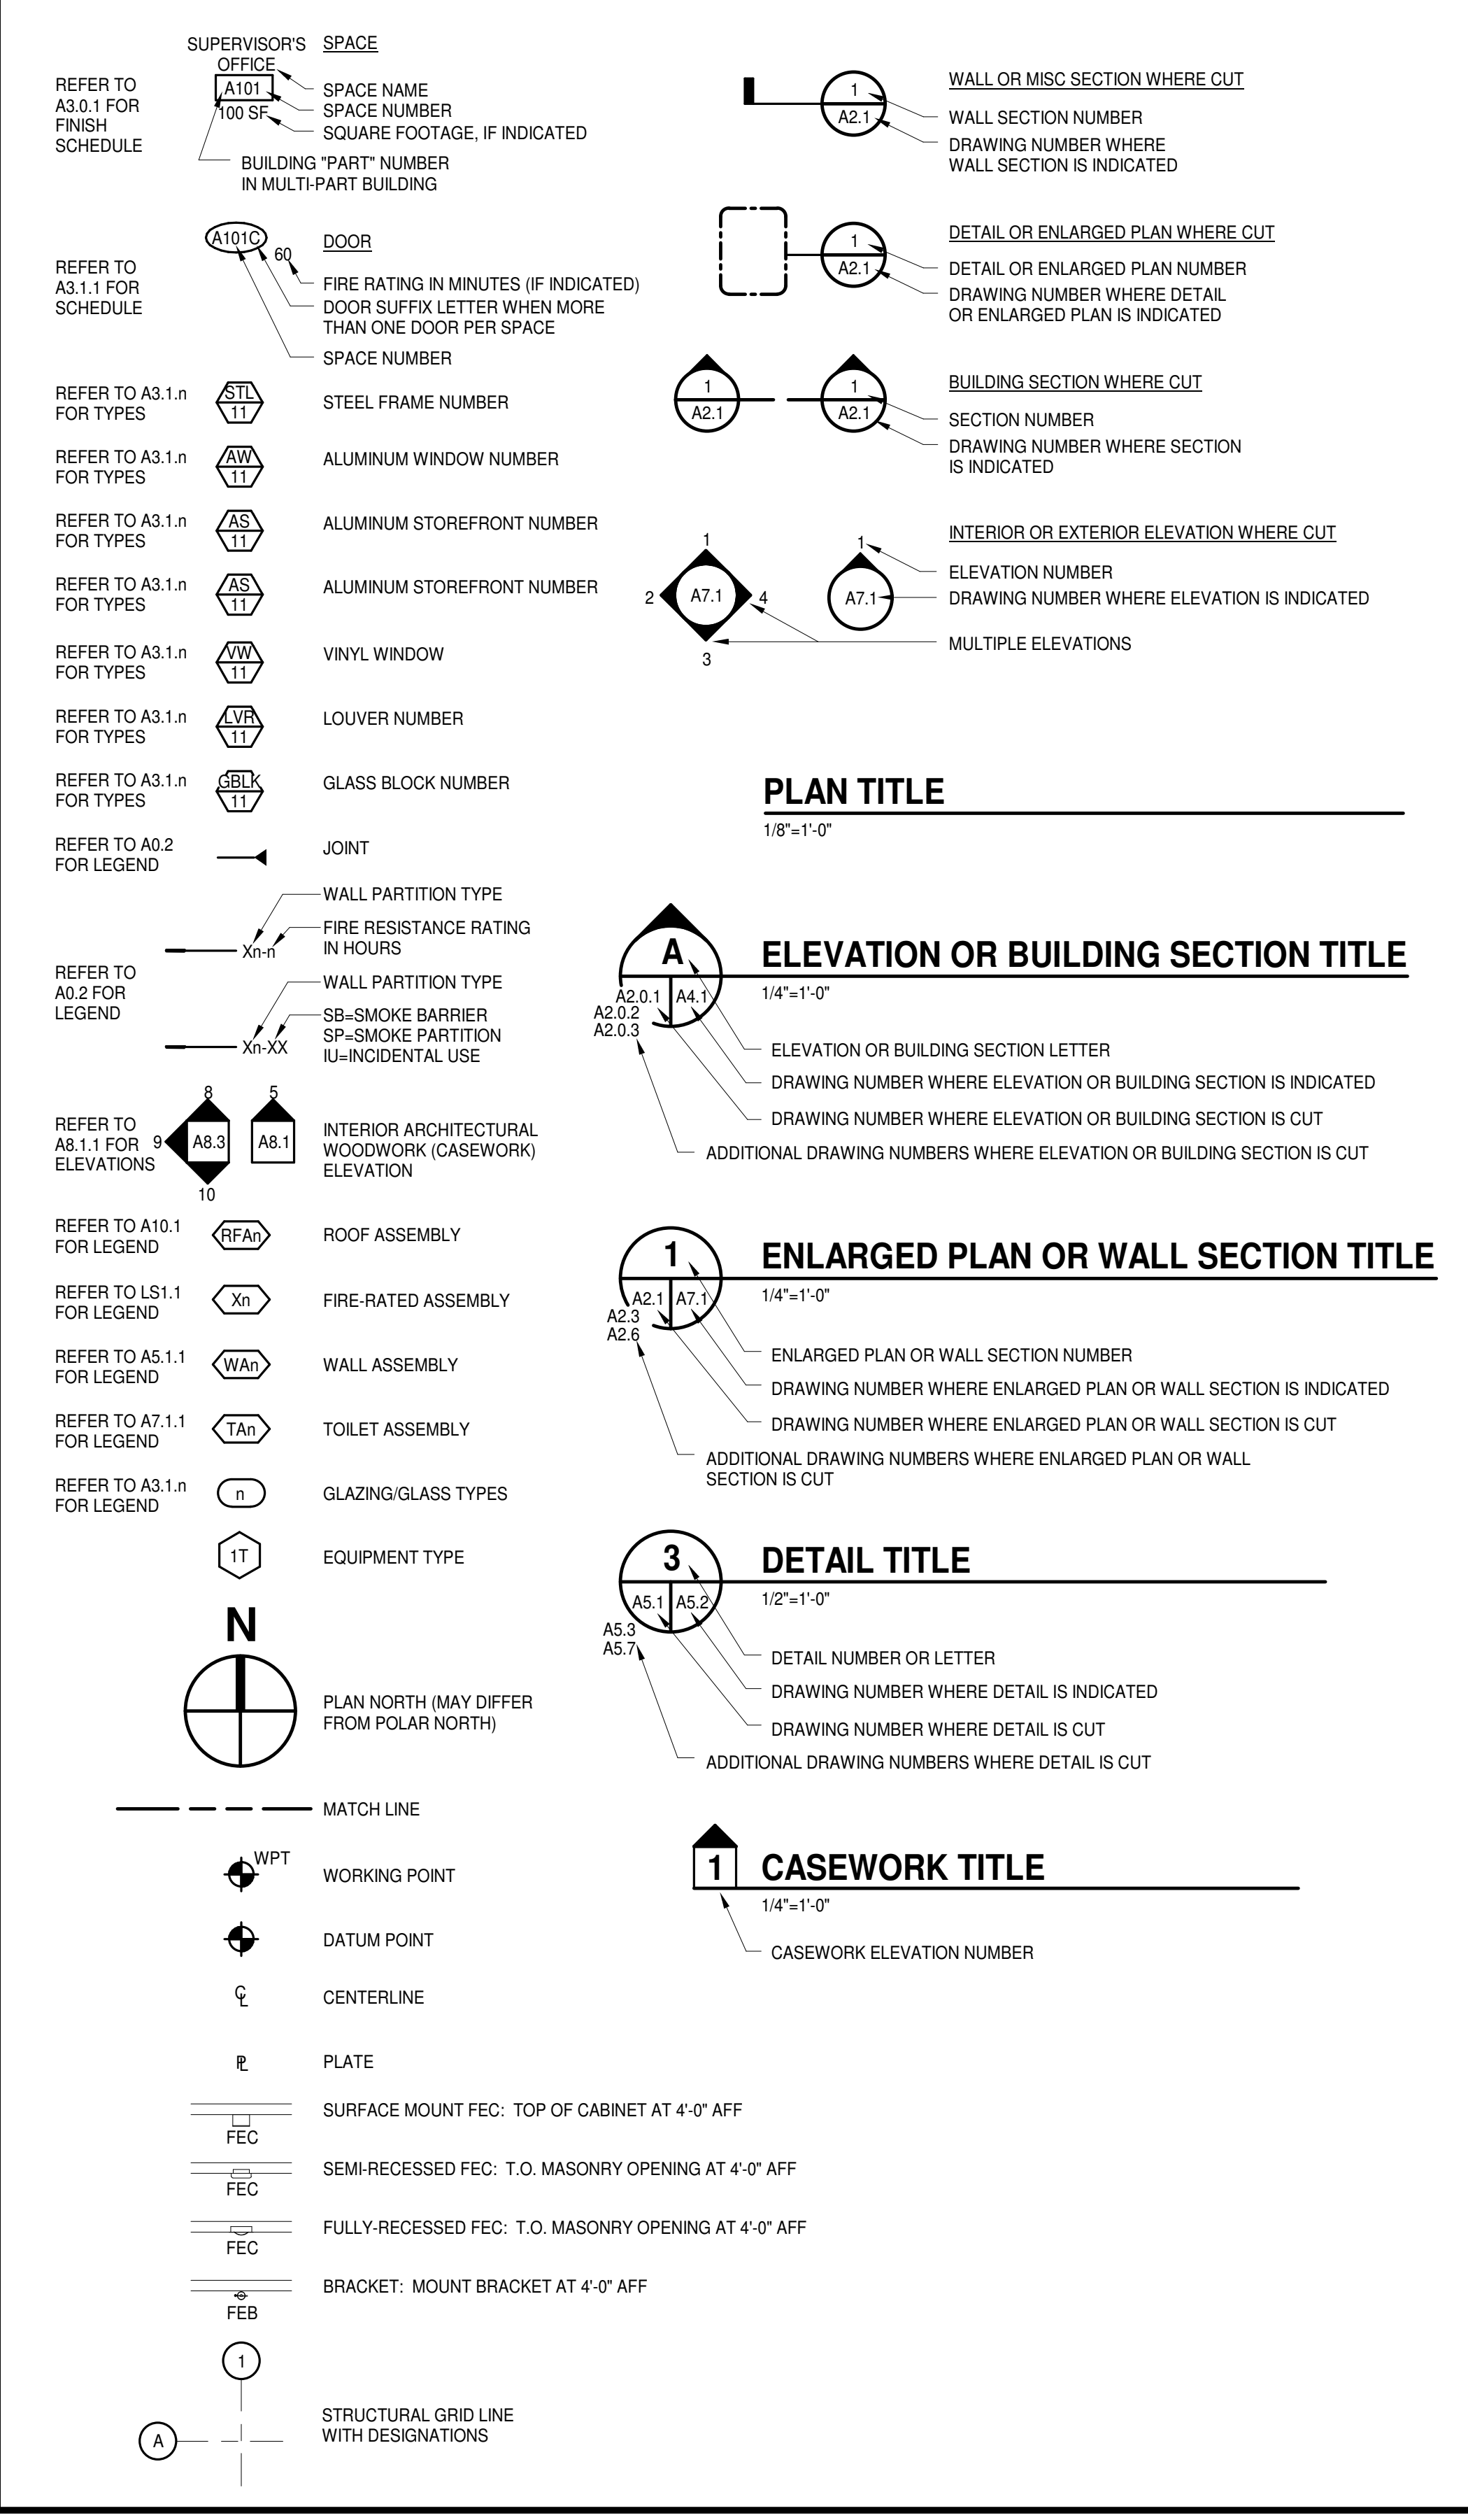

ARCHITECTURAL GENERAL NOTES


- THE CONTRACT DOCUMENTS ARE COMPLEMENTARY AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL.
ELEMENTS IDENTIFIED IN 'LEGENDS' AND/OR 'GENERAL NOTES' MAY NOT BE NOTED IN DETAILS OR SECTIONS.
REFER TO 'ASSEMBLIES' FOR MATERIALS AND COMPONENTS THAT MAKE UP THAT PARTICULAR ASSEMBLY.

ARCHITECTURAL MATERIALS LEGEND

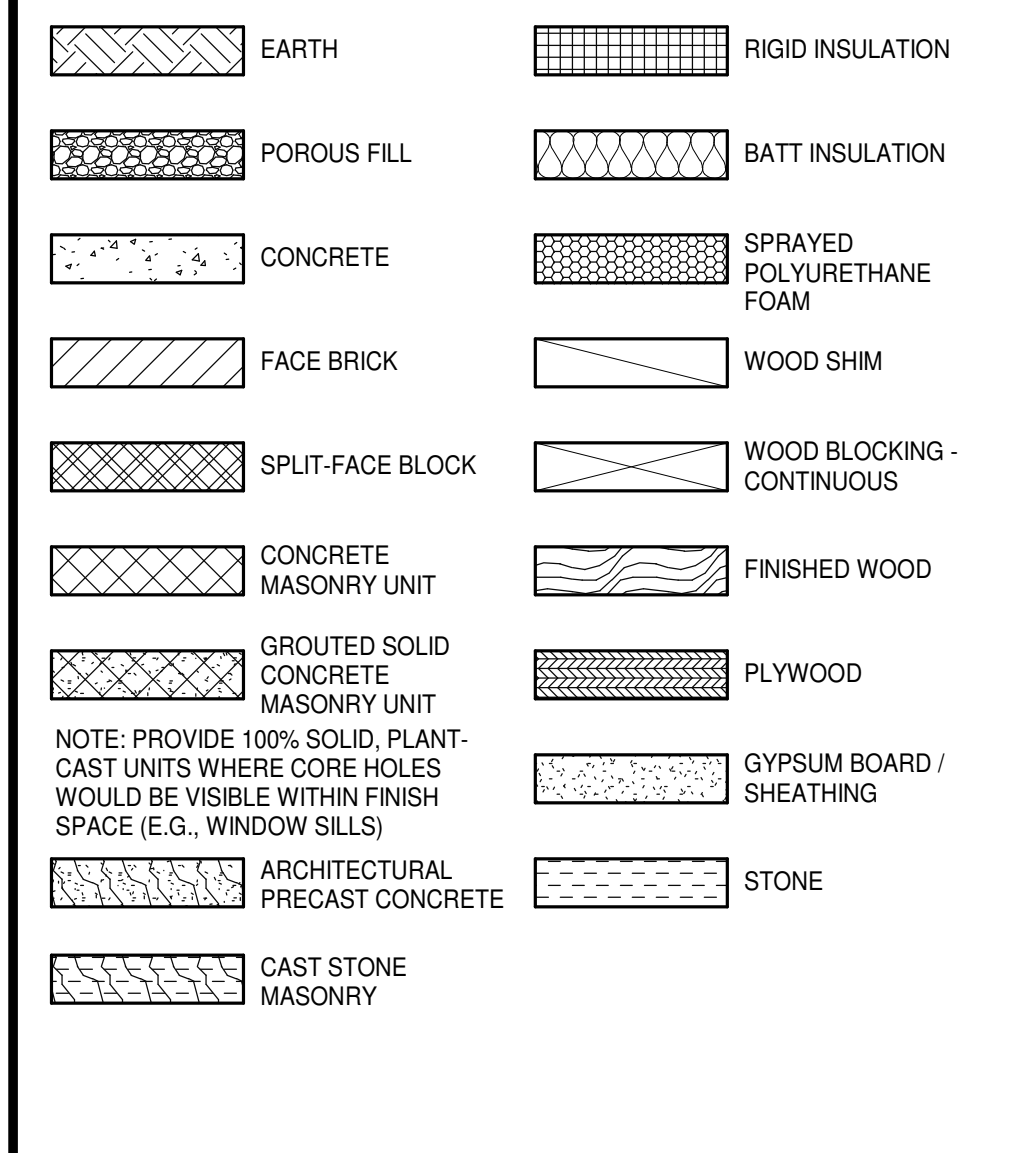


TITLE 1
TITLE 2
TITLE 3
TITLE 4

TEXT LAYOUT ELEVATION

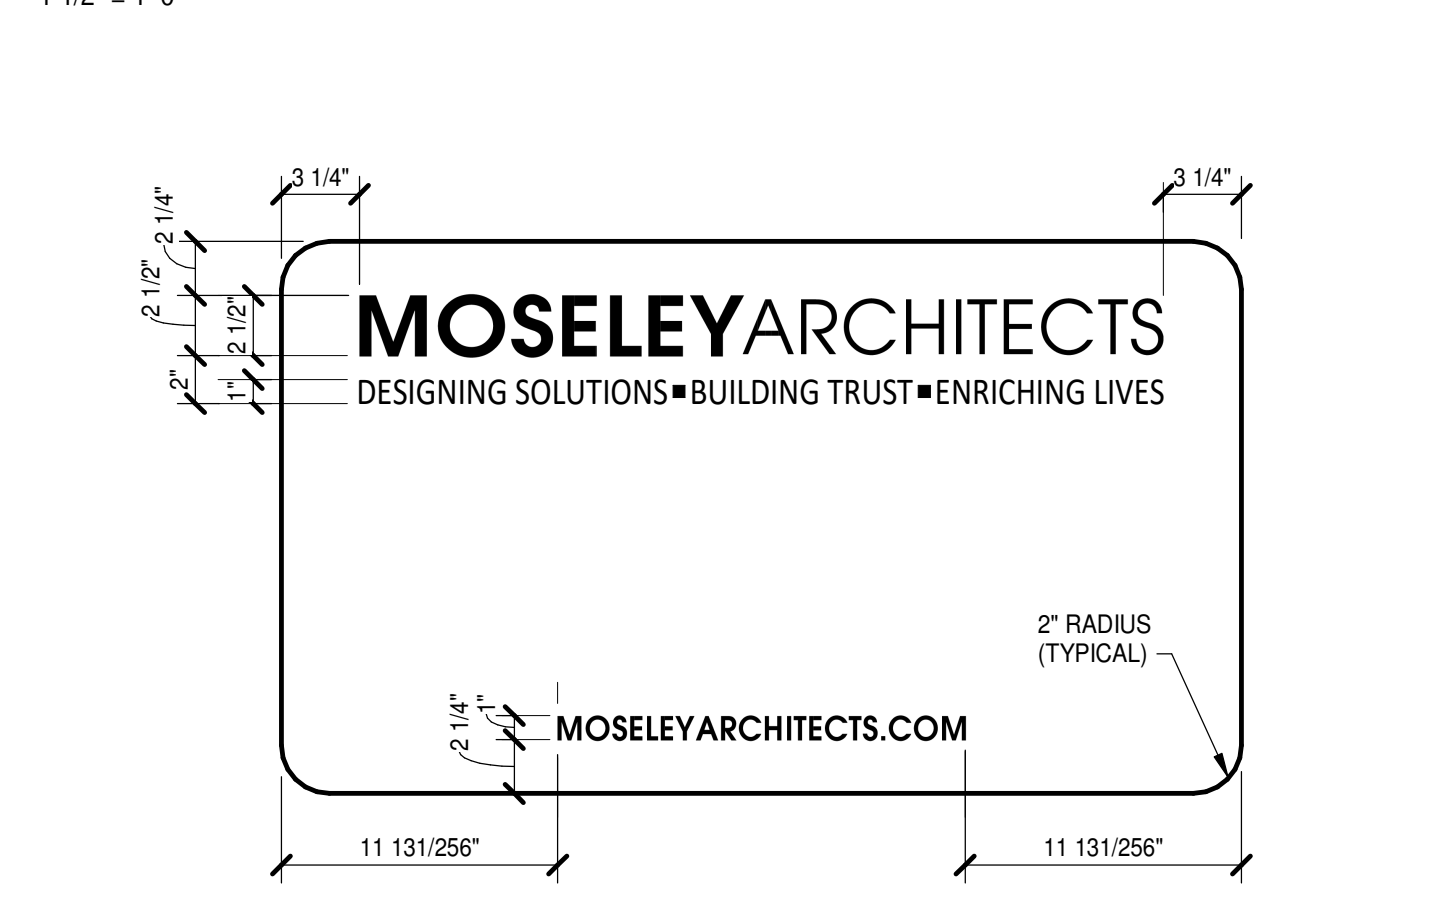

ARCHITECT'S SIGN

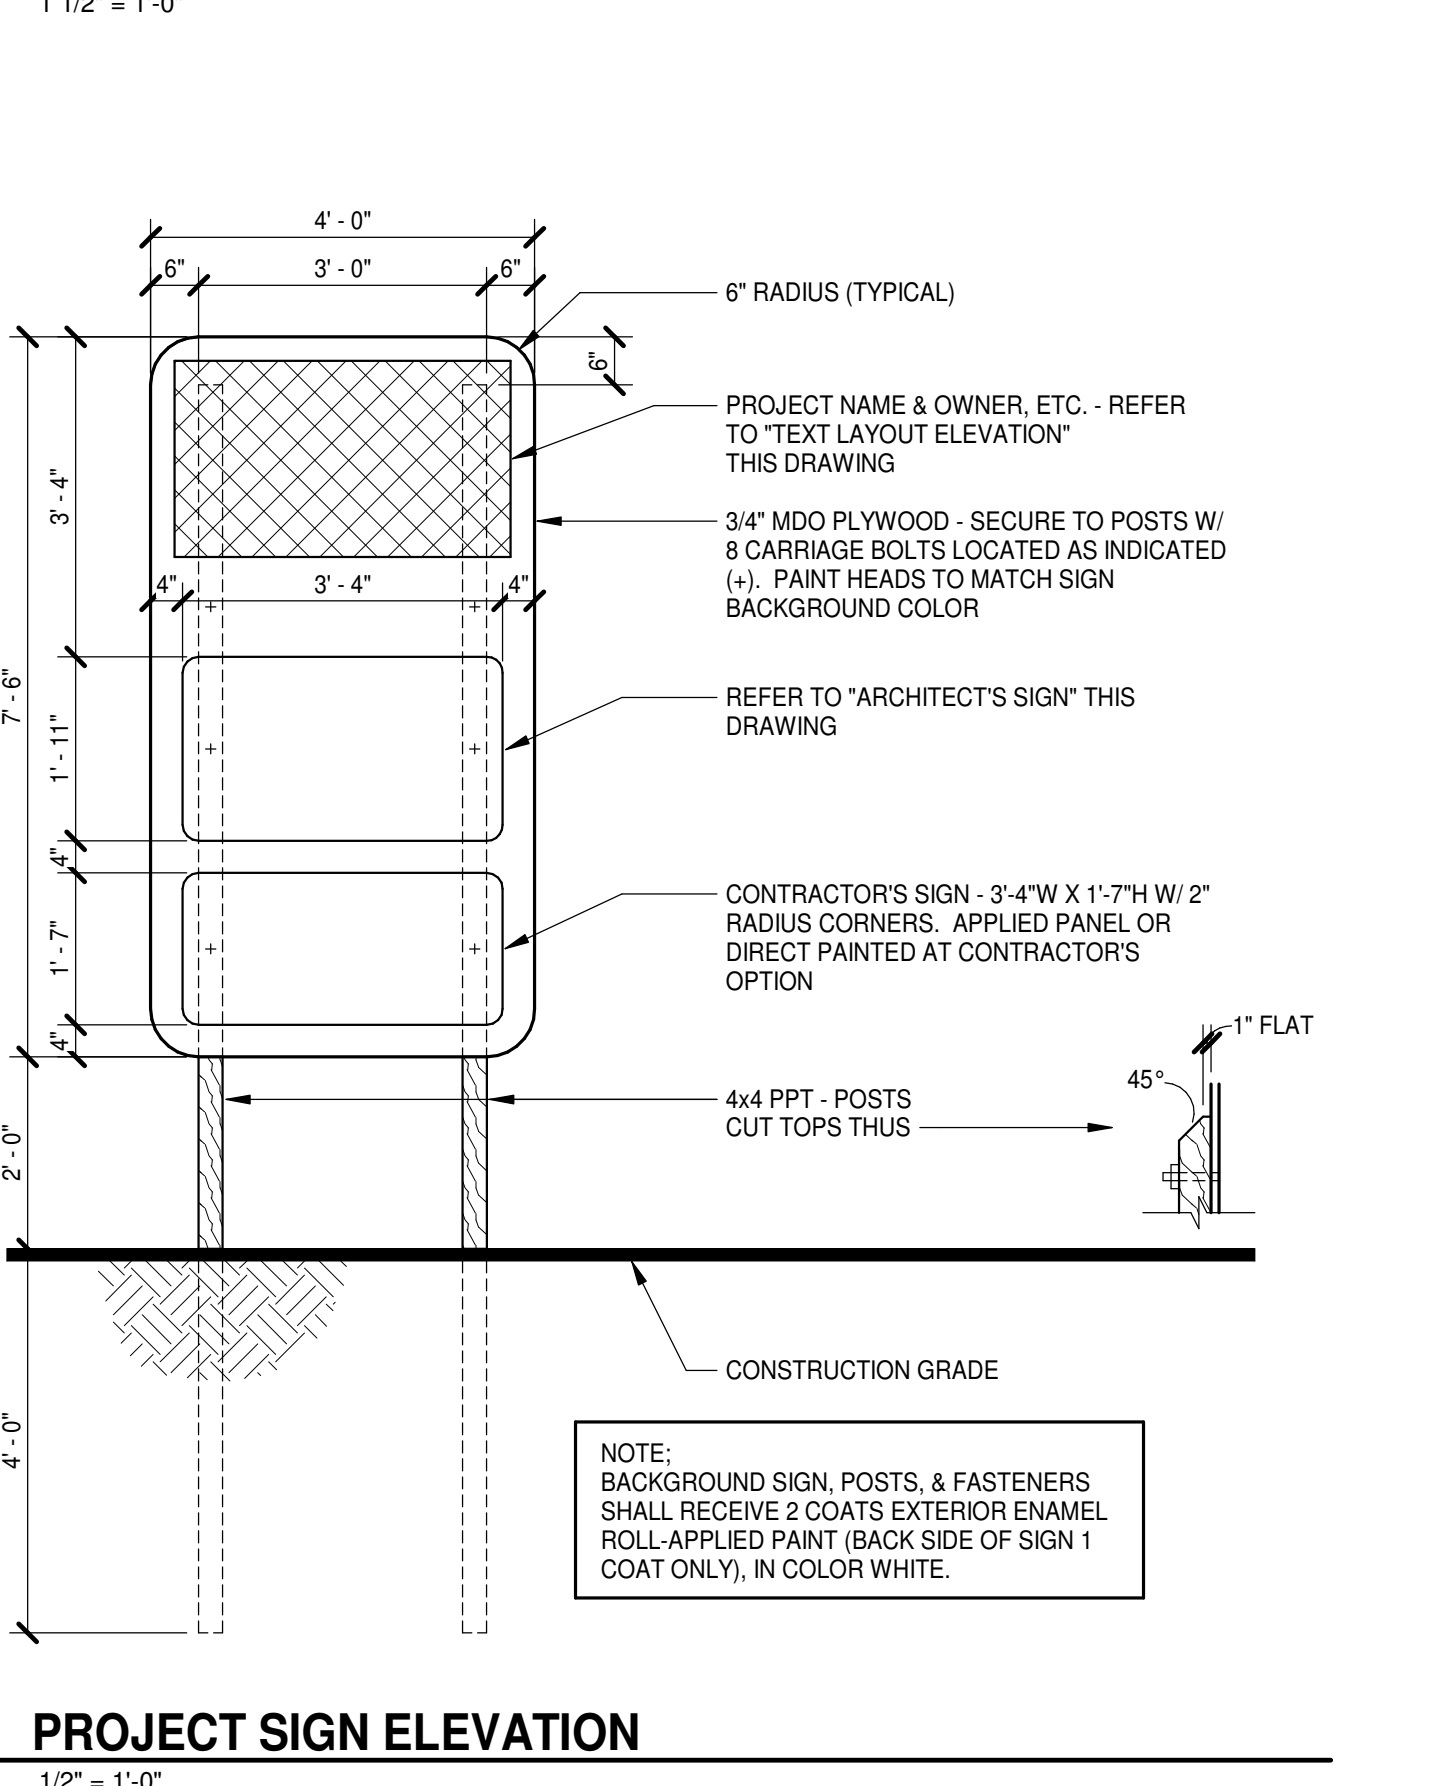

TERMINATION GENERAL NOTES

A. AT FIRE, SMOKE, AND ACOUSTICALLY RATED WALLS: SEAL ALL NON-OBTSTRUCTED HEAD-OF-WALL CONDITIONS IN ACCORDANCE WITH JOINT SYSTEM MANUFACTURER'S RECOMMENDATIONS BASED ON CONDITION ENCOUNTERED (E.G. CMU-TO-DECK (PARALLEL OR PERPENDICULAR TO FLUTES); OR CFSF-TO-DECK (PARALLEL OR PERPENDICULAR TO FLUTES) TO MAINTAIN ASSEMBLY RATING CONSISTENT WITH WALL/PARTITION REQUIREMENTS. BRACE WALL AS INDICATED OR REQUIRED.

B. AT ALL OTHER WALLS INDICATED TO EXTEND TO UNDERSIDE OF FLOOR/ROOF DECK/CAP: SEAL ALL NON-OBTSTRUCTED HEAD-OF-WALL CONDITIONS IN ACCORDANCE WITH JOINT SYSTEM MANUFACTURER'S RECOMMENDATIONS BASED ON CONDITION ENCOUNTERED (E.G. CMU-TO-DECK (PARALLEL OR PERPENDICULAR TO FLUTES); OR CFSF-TO-DECK (PARALLEL OR PERPENDICULAR TO FLUTES) TO MAINTAIN ASSEMBLY RATING CONSISTENT WITH WALL/PARTITION REQUIREMENTS. BRACE WALL AS INDICATED OR REQUIRED.

C. AT ALL WALLS PREVENTED FROM TERMINATING AT THE UNDERSIDE OF FLOOR/ROOF DECK BY OBSTRUCTIONS, COMPLY WITH THE FOLLOWING:

- AT FIRE, SMOKE, AND ACOUSTICALLY RATED WALLS: ENCASE OBSTRUCTION(S) TO MAINTAIN ASSEMBLY RATING CONSISTENT WITH WALL/PARTITION REQUIREMENTS.
- AT SECURITY WALLS: TERMINATE IN ACCORDANCE WITH SECURITY PARTITION REQUIREMENTS.
- AT OTHER WALLS: ENCASE OBSTRUCTION(S) ON ONE SIDE.
- SEAL ENCASMENT TO WALL AND SEAL ENCASMENT TO DECK IN ACCORDANCE WITH JOINT SYSTEM MANUFACTURER'S RECOMMENDATIONS AND TO MAINTAIN ASSEMBLY RATING CONSISTENT WITH WALL/PARTITION REQUIREMENTS.

WALL JOINT GENERAL NOTES

A. LOCATE CONTROL JOINTS IN INTERIOR AND EXTERIOR WALLS AS INDICATED ON DRAWINGS.


B. JOINTS ARE INDICATED THIS ON PLANS AND ELEVATIONS.

C. WALLS AND JOINT TYPES/DETAILS ARE DIAGRAMMATIC. ADJUST JOINT TYPES/DETAILS IN ACCORDANCE WITH ACTUAL FIELD CONDITIONS.

D. PROVIDE TESTED JOINT ASSEMBLIES AT FIRE, SMOKE, AND ACOUSTICALLY RATED WALLS.

E. WHEN USED HEREIN "RATED" MEANS FIRE, SMOKE, AND/OR ACOUSTICAL.

F. REFER TO SPECIFICATIONS FOR ADDITIONAL WALL JOINT REQUIREMENTS.

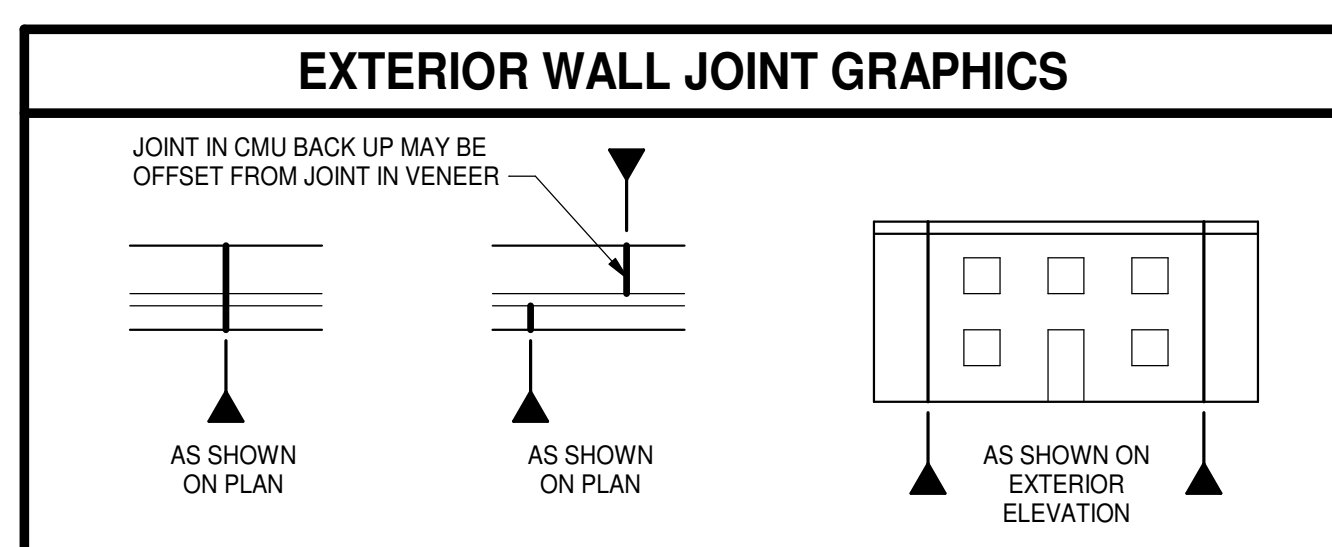

WALL/PARTITION TYPE GENERAL NOTES

A. PLAN DIMENSIONS ARE TO FACE OF WALL OR PARTITION. WHERE APPLIED FINISHES OCCUR SUCH AS CERAMIC TILE DIMENSIONS ARE TO FACE OF APPLIED FINISH. FOR WAINSCOTS, FLOOR PLAN DIMENSIONS ARE TO FACE OF WAINSCOT MATERIAL. APPLIED FINISHES ARE NOT ALLOWED TO REDUCE CLEAR DIMENSIONS. "APPLIED FINISHES" IN THIS CASE DO NOT INCLUDE TRIM, BASE, AND ACOUSTIC WALL PANELS.

B. EXTEND WALL/PARTITION ASSEMBLY COMPONENTS FULL HEIGHT OF ASSEMBLY.

C. ALL INTERIOR MASONRY UNIT PARTITIONS: M1 [Coordinate with partition type schedule below] UNLESS INDICATED OTHERWISE.

D. ALL INTERIOR CFSF PANEL PARTITIONS: P1 [Coordinate with partition type schedule below] UNLESS INDICATED OTHERWISE.

E. REFER TO STRUCTURAL AND DETENTION (delete if no detention work) DRAWINGS AND RELATED SPECIFICATIONS FOR SOLID MASONRY, GROUTING, AND REINFORCEMENT REQUIREMENTS INCLUDING BUT MAY NOT BE LIMITED TO:

- MASONRY WALLS/PARTITIONS
- LINTELS
- LINTEL BEARING CONDITIONS
- BOND BEAMS
- SHELF BEARING CONDITIONS
- STRUCTURAL REINFORCING REQUIREMENTS
- CHANGES IN WYTHE

F. THE TERMS "WALL" AND "PARTITION" MAY BE USED INTERCHANGEABLY THROUGHOUT THE CONTRACT DOCUMENTS.

G. EXTEND ALL FIRE, SMOKE, INCIDENTAL USE, AND ACOUSTICAL-RATED WALLS/PARTITIONS TO UNDERSIDE OF FLOOR DECK, ROOF DECK, STRUCTURAL ELEMENT ENCASMENT OR SOLID CAP ABOVE.

H. PARTITIONS THAT DO NOT EXTEND TO UNDERSIDE OF DECK OR CAP ABOVE:

- EXTEND 4 INCHES MINIMUM ABOVE HIGHEST ADJACENT FINISH CEILING UNLESS INDICATED OTHERWISE.

I. DO NOT CONNECT TIES, ANCHORS, OR REINFORCING TO SINGLE CANTILEVERED FIRE WALL OR BETWEEN DOUBLE FIRE WALLS.

J. SEAL AROUND ALL PENETRATIONS.


K. COMPLY WITH TERMINATION, WALL JOINT, AND MISCELLANEOUS DETAILS FOR THOSE CONDITIONS WHERE APPLICABLE. COMPLY WITH REFERENCED STANDARDS WHERE DETAILS ARE NOT IDENTIFIED IN THE DRAWINGS.

L. WALL/PARTITION TYPES DO NOT ADDRESS WALL FINISHES. REFER TO FINISH SCHEDULE.


M. FINISHED SPACES: PROVIDE CHASES AROUND ALL EXPOSED VERTICAL COMPONENTS, INCLUDING BUT NOT LIMITED TO: DUCTWORK, PIPING, AND CONDUIT. UNLESS COMPONENTS ARE SPECIFICALLY INDICATED TO REMAIN EXPOSED. IF NOT OTHERWISE INDICATED, PROVIDE (Mn or Pn - Coordinate with partition type in schedule below) CHASE CONSTRUCTION.

- HOLD CHASES TIGHT TO COMPONENTS ALLOWING FOR ACCESS, INSULATION, AND TOLERANCES.
- EXTEND CHASES FROM FLOOR TO 4 INCHES MINIMUM ABOVE FINISH CEILING OR IF NO CEILING IS INDICATED, EXTEND CHASES TO UNDERSIDE OF FLOOR DECK, ROOF DECK, OR SOLID CAP ABOVE AND TERMINATE ACCORDINGLY.


N. PROVIDE BACKER BOARD/UNIT OF SAME THICKNESS INDICATED IN LIEU OF GYPSUM BOARD PANEL AT PORTIONS OF WALLS/PARTITIONS TO RECEIVE TILE.

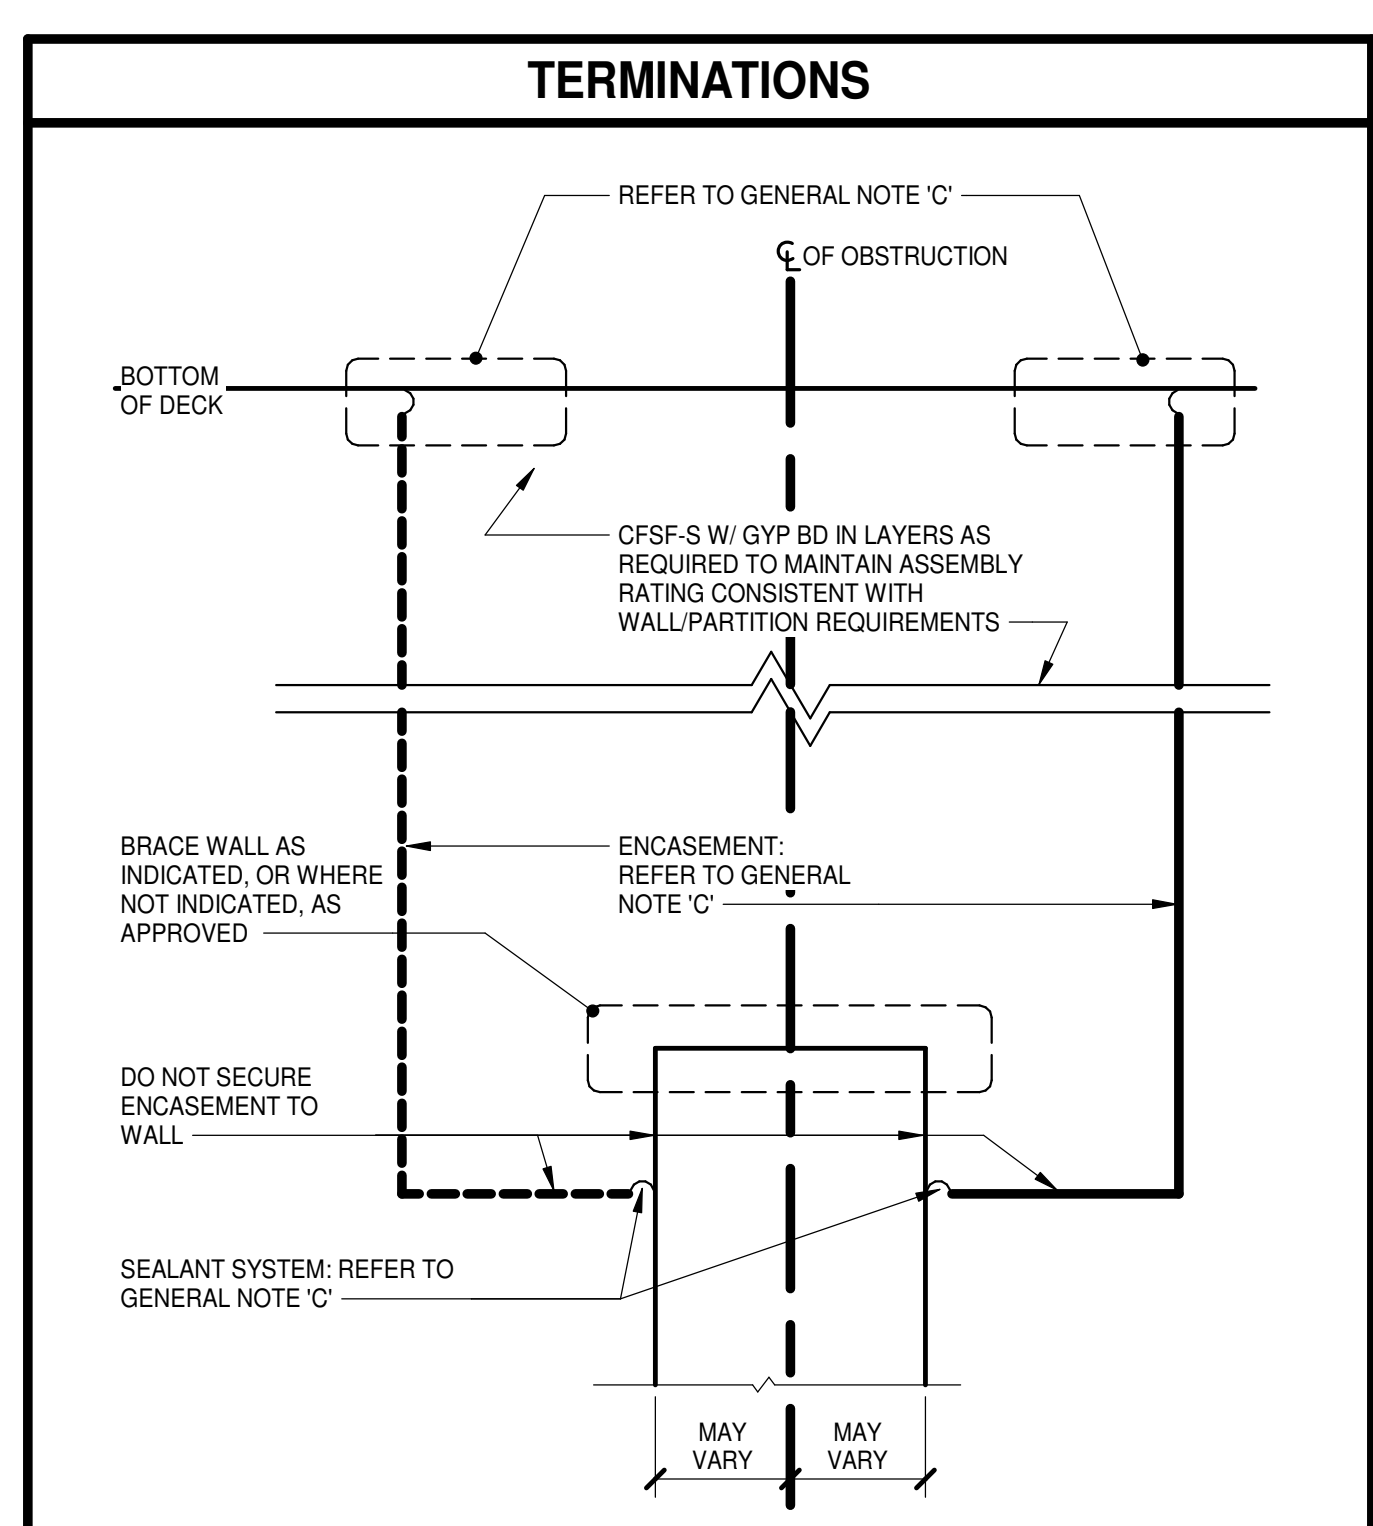

HEAD-OF-WALL TERMINATION @ OBSTRUCTION
 OBSTRUCTION MAY VARY (BEAM, JOIST, GIRDER, CHANNEL, DUCTWORK, PIPING)

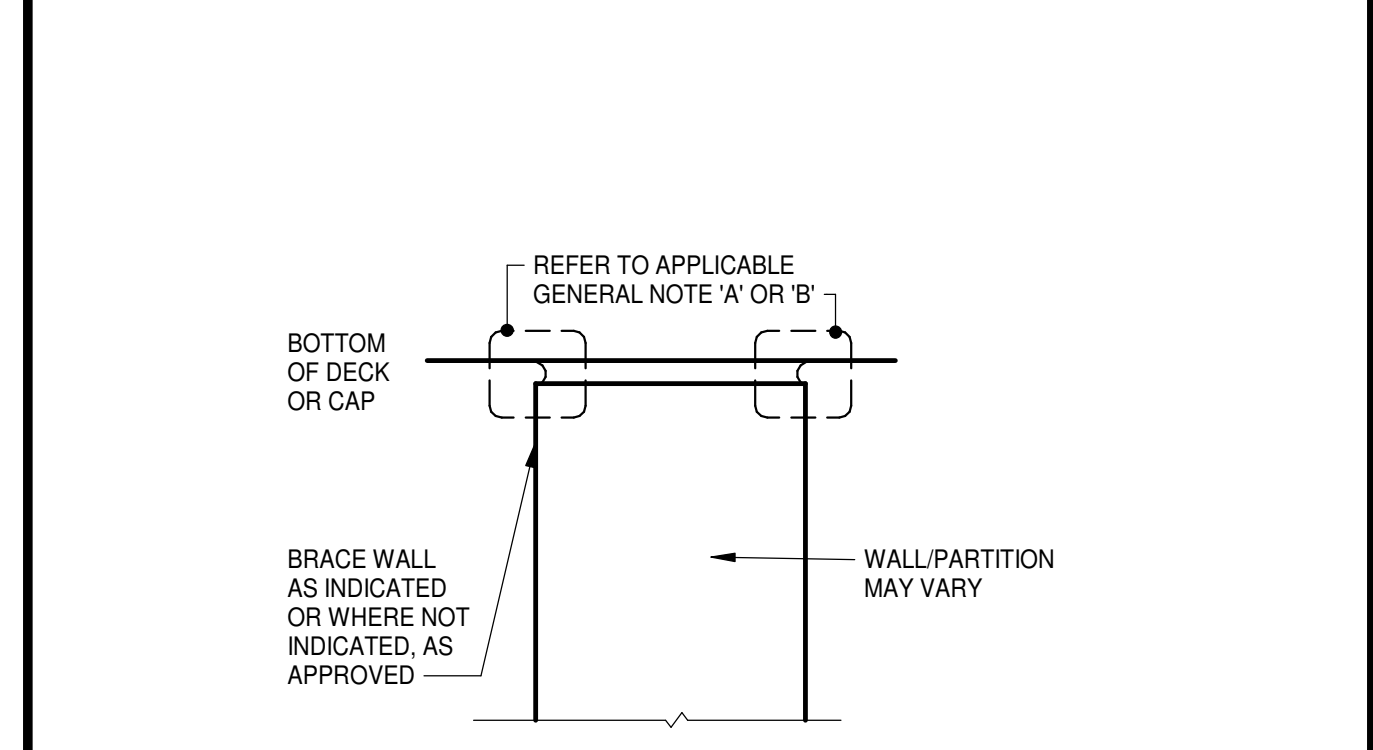

HEAD-OF-WALL TERMINATION @ NON-OBTSTRUCTION

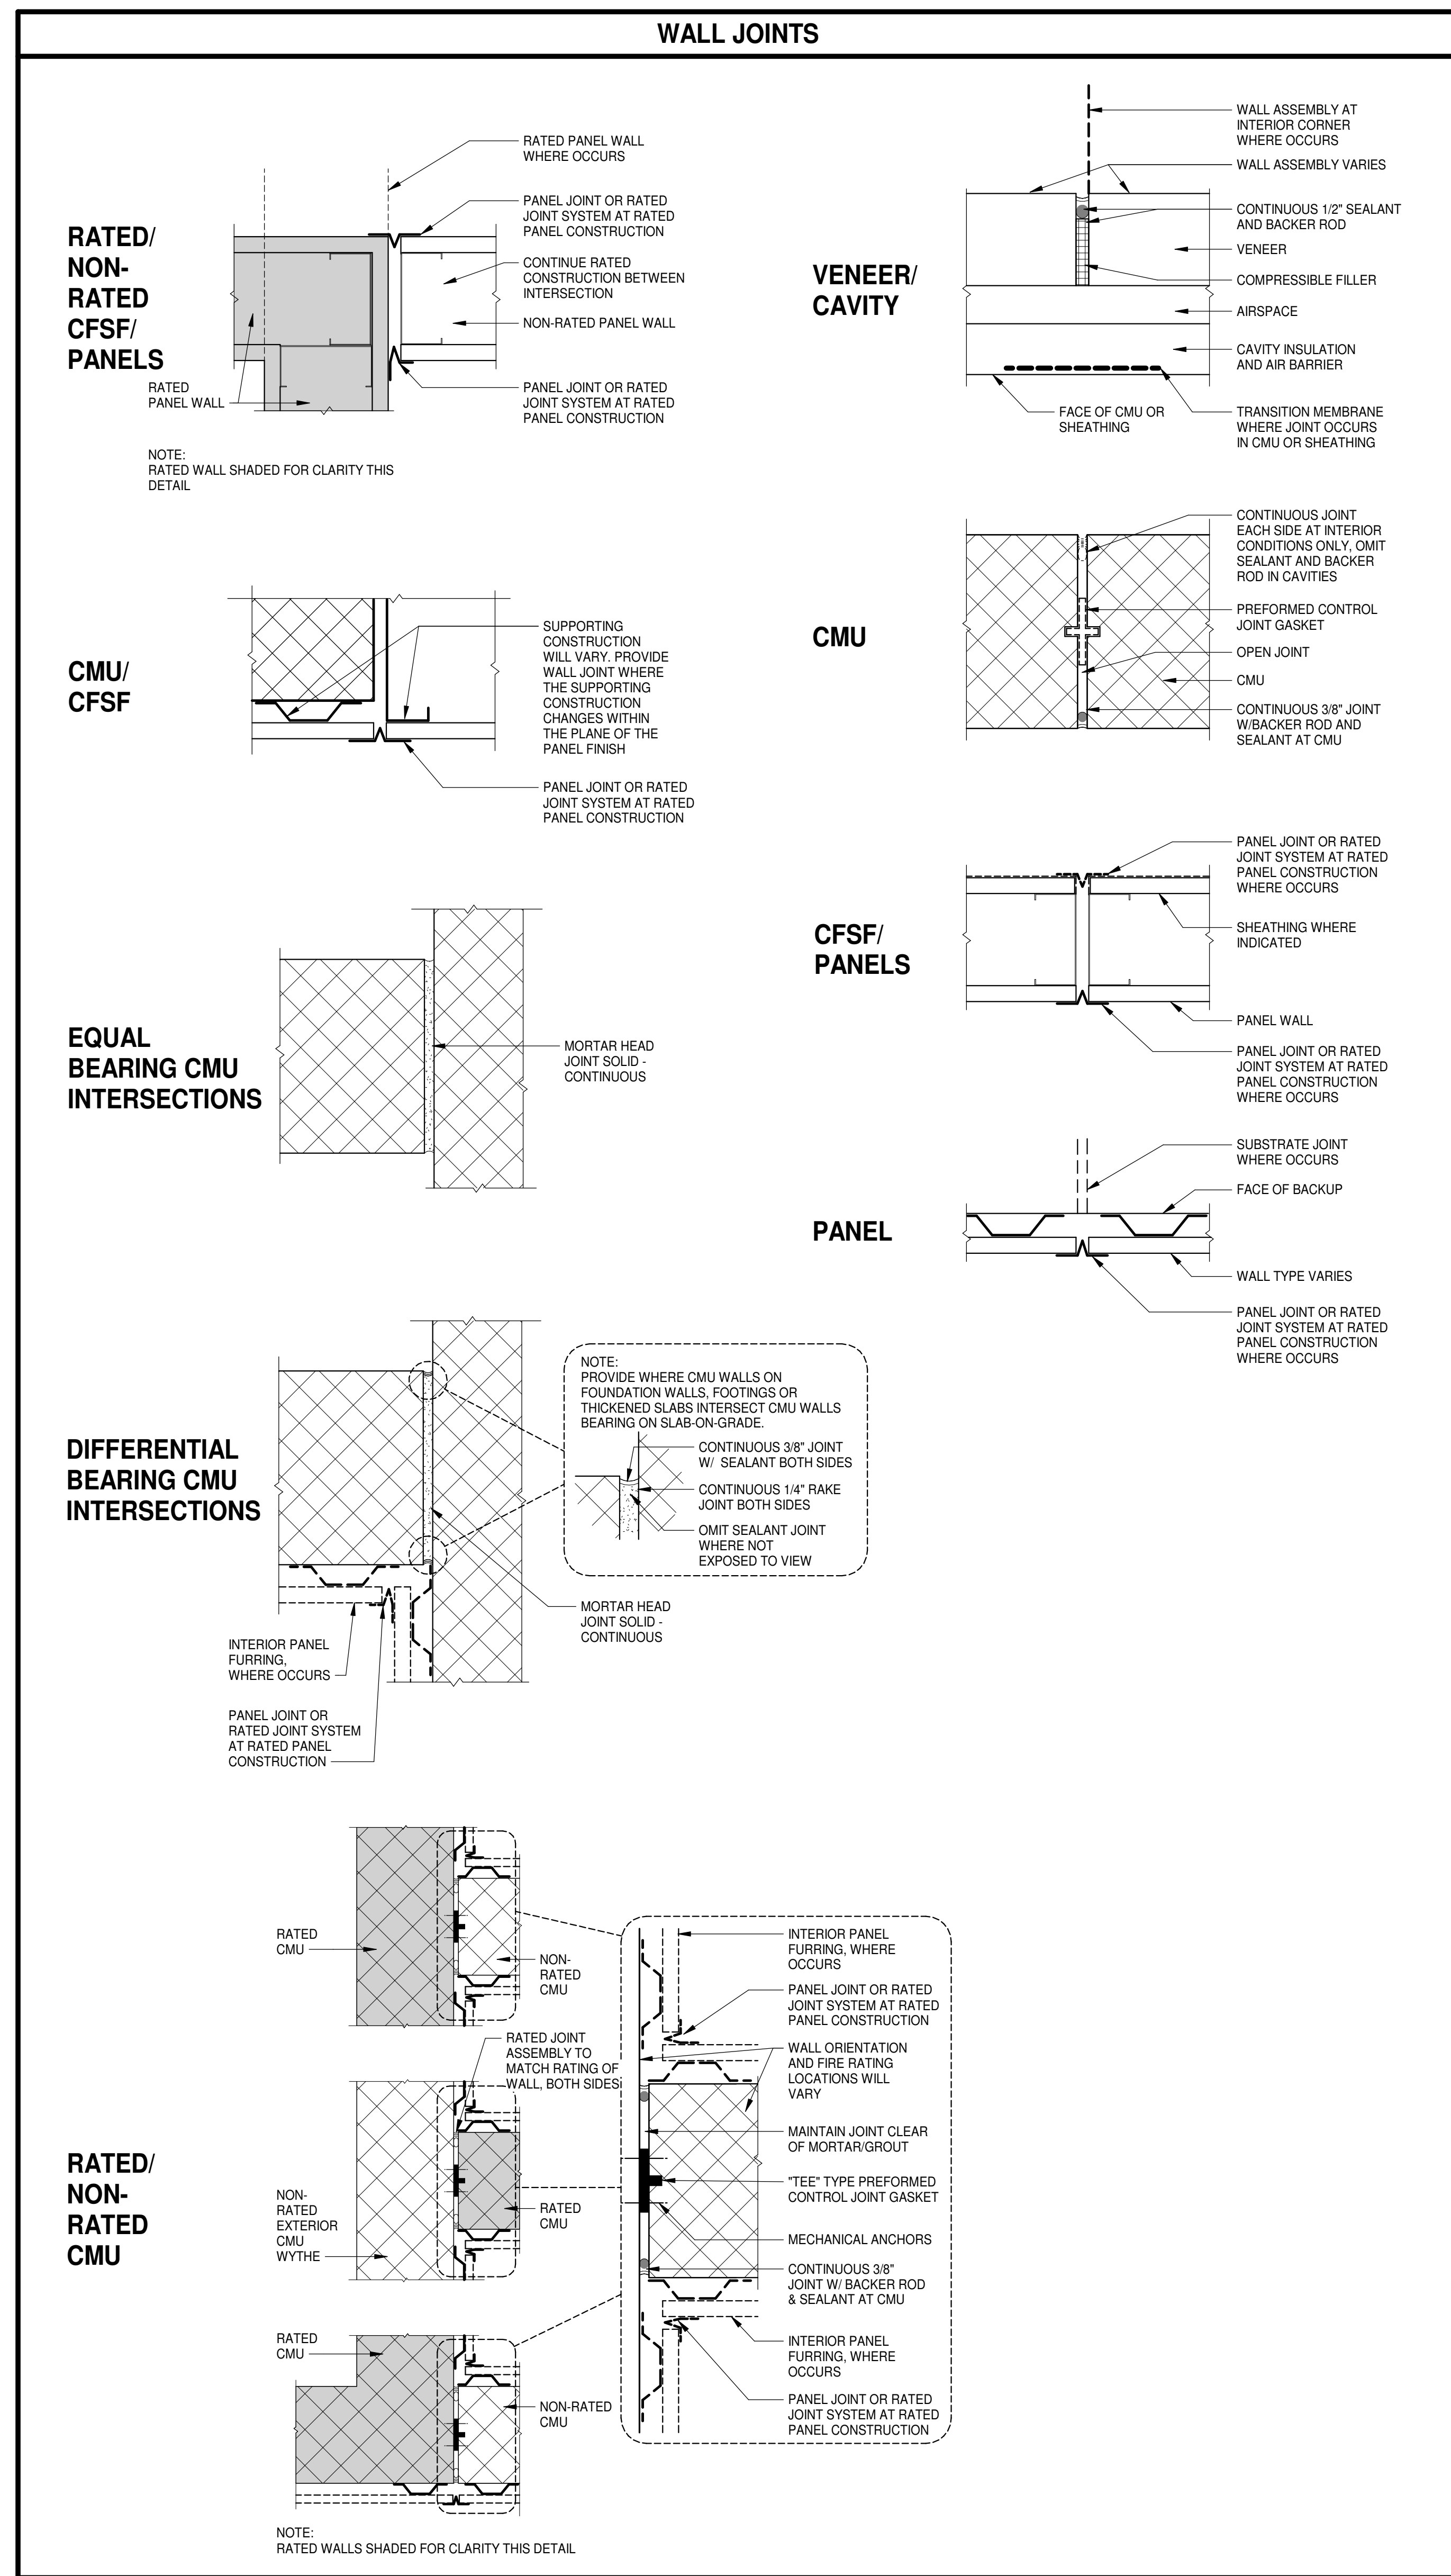

MASONRY UNIT WALL/PARTITION TYPES
 REPRESENTED BY x_{mn}

MARK	FIRE RATED ASSEMBLY (REFER TO LS 1.1 FOR LEGEND)	REMARKS	INFORMATION
M1		-	
M2		-	
M3		-	

PANEL WALL/PARTITION TYPES
 REPRESENTED BY x_{mn}

MARK	FIRE RATED ASSEMBLY (REFER TO LS 1.1 FOR LEGEND)	REMARKS	INFORMATION
P1		-	
P2		-	
P3		-	
P4		-	

SECURITY WALL/PARTITION TYPES
 REPRESENTED BY x_{mn}

MARK	FIRE RATED ASSEMBLY (REFER TO LS 1.1 FOR LEGEND)	REMARKS	INFORMATION
S1		-	
S2		-	

FLOOR PLAN GENERAL NOTES

A. GENERAL NOTE 1...
 B. GENERAL NOTE 2...

REFLECTED CEILING PLAN LEGEND
 APPLIES TO DRAWINGS A9.1.n - A9.1.n

REFER TO M, E & FP DRAWINGS FOR REFLECTED CEILING PLAN SYMBOLS NOT INDICATED BELOW


	SPACE NUMBER CEILING HEIGHT, AFF UNO
	INTERIOR APPLICATIONS: GYPSUM BOARD CEILING EXTERIOR APPLICATIONS: GYPSUM SOFFIT BOARD OR GYPSUM SHEATHING
	2'-0" x 2'-0" LAY-IN ACOUSTICAL CEILING PANELS IN SUSPENDED GRID
	1 HR RATED HORIZONTAL SHAFT WALL ABOVE ACP CEILING
	1'-0" x 1'-0" ACT ON 3/4" FRT PLYWOOD ON CFS-S SUSPENDED FRAMING
	ACCESS PANEL
	EXTERIOR WALL
	INTERIOR WALL/PARTITION TO UNDERSIDE OF DECK
	INTERIOR WALL/PARTITION TO CAP ABOVE OR TERMINATES ADJACENT TO A RATED HORIZONTAL ASSEMBLY
	INTERIOR WALL/PARTITION 4' MIN ABOVE HIGHEST ADJACENT CEILING. IF NECESSARY TO ACHIEVE RESULTS DESIRED, EXTEND WALL HEIGHT SO WALL BRACING IS NOT EXPOSED TO VIEW IN FINISHED SPACES
	INTERIOR WALL/PARTITION TO UNDERSIDE OF CEILING
	EXISTING TO REMAIN, VERIFY VERTICAL EXTENTS WHERE THE HEIGHT IMPACTS THE WORK

REFLECTED CEILING PLAN/DETAIL GENERAL NOTES


A. ALL CEILING HEIGHTS SHALL BE 9'-0" AFF UNLESS INDICATED OTHERWISE.
 B. DRAWINGS INDICATE GRID LAYOUT DIAGMATICALLY. REFER TO SPECIFICATIONS FOR SPECIFIC GRID LAYOUT CRITERIA AT PERIMETER CONDITIONS THAT MAY DIFFER FROM GRID LAYOUT INDICATED ON DRAWINGS.
 C. CENTER CEILING MOUNTED ITEMS WITHIN CEILING PANELS, UNLESS INDICATED OTHERWISE.
 D. IF ADDITIONAL SPRINKLER HEADS ARE REQUIRED TO SATISFY CODE OR COVERAGE DENSITIES (OTHER THAN THOSE THAT MAY BE INDICATED), PROVIDE ADDITIONAL SPRINKLER HEADS AT NO ADDITIONAL COST AND OBTAIN APPROVAL OF ARCHITECT FOR LOCATION OF SUCH HEADS, IF ANY.

DOOR SCHEDULE


NUMBER	DOOR TYPE	SIZE (NOMINAL)	DOOR			FRAME					FIRE RATING	NOTES		
			MATL	LOUVER	UC	GLAZING TYPE	TYPE	NUMBER	SECTIONS	HEAD DETAIL			JAMB DETAIL	JAMB DETAIL
V100A	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V100B	OH	12'-0" x 12'-0" x 2"	--	--	--	STL	1	A	1	1	1	1	--	
V101	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V102	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V103	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	20 MIN	
V104	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V105	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V106	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	20 MIN	
V107	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V108	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	20 MIN	
V109	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V109A	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V109B	F	3'-0" x 7'-0" x 1'3/4"	STL	--	--	STL	1	A	1	1	1	1	--	
V109C	OH	12'-0" x 12'-0" x 2"	STL	--	G2	STL	--	--	PER MANUF	PER MANUF	PER MANUF	PER MANUF	--	

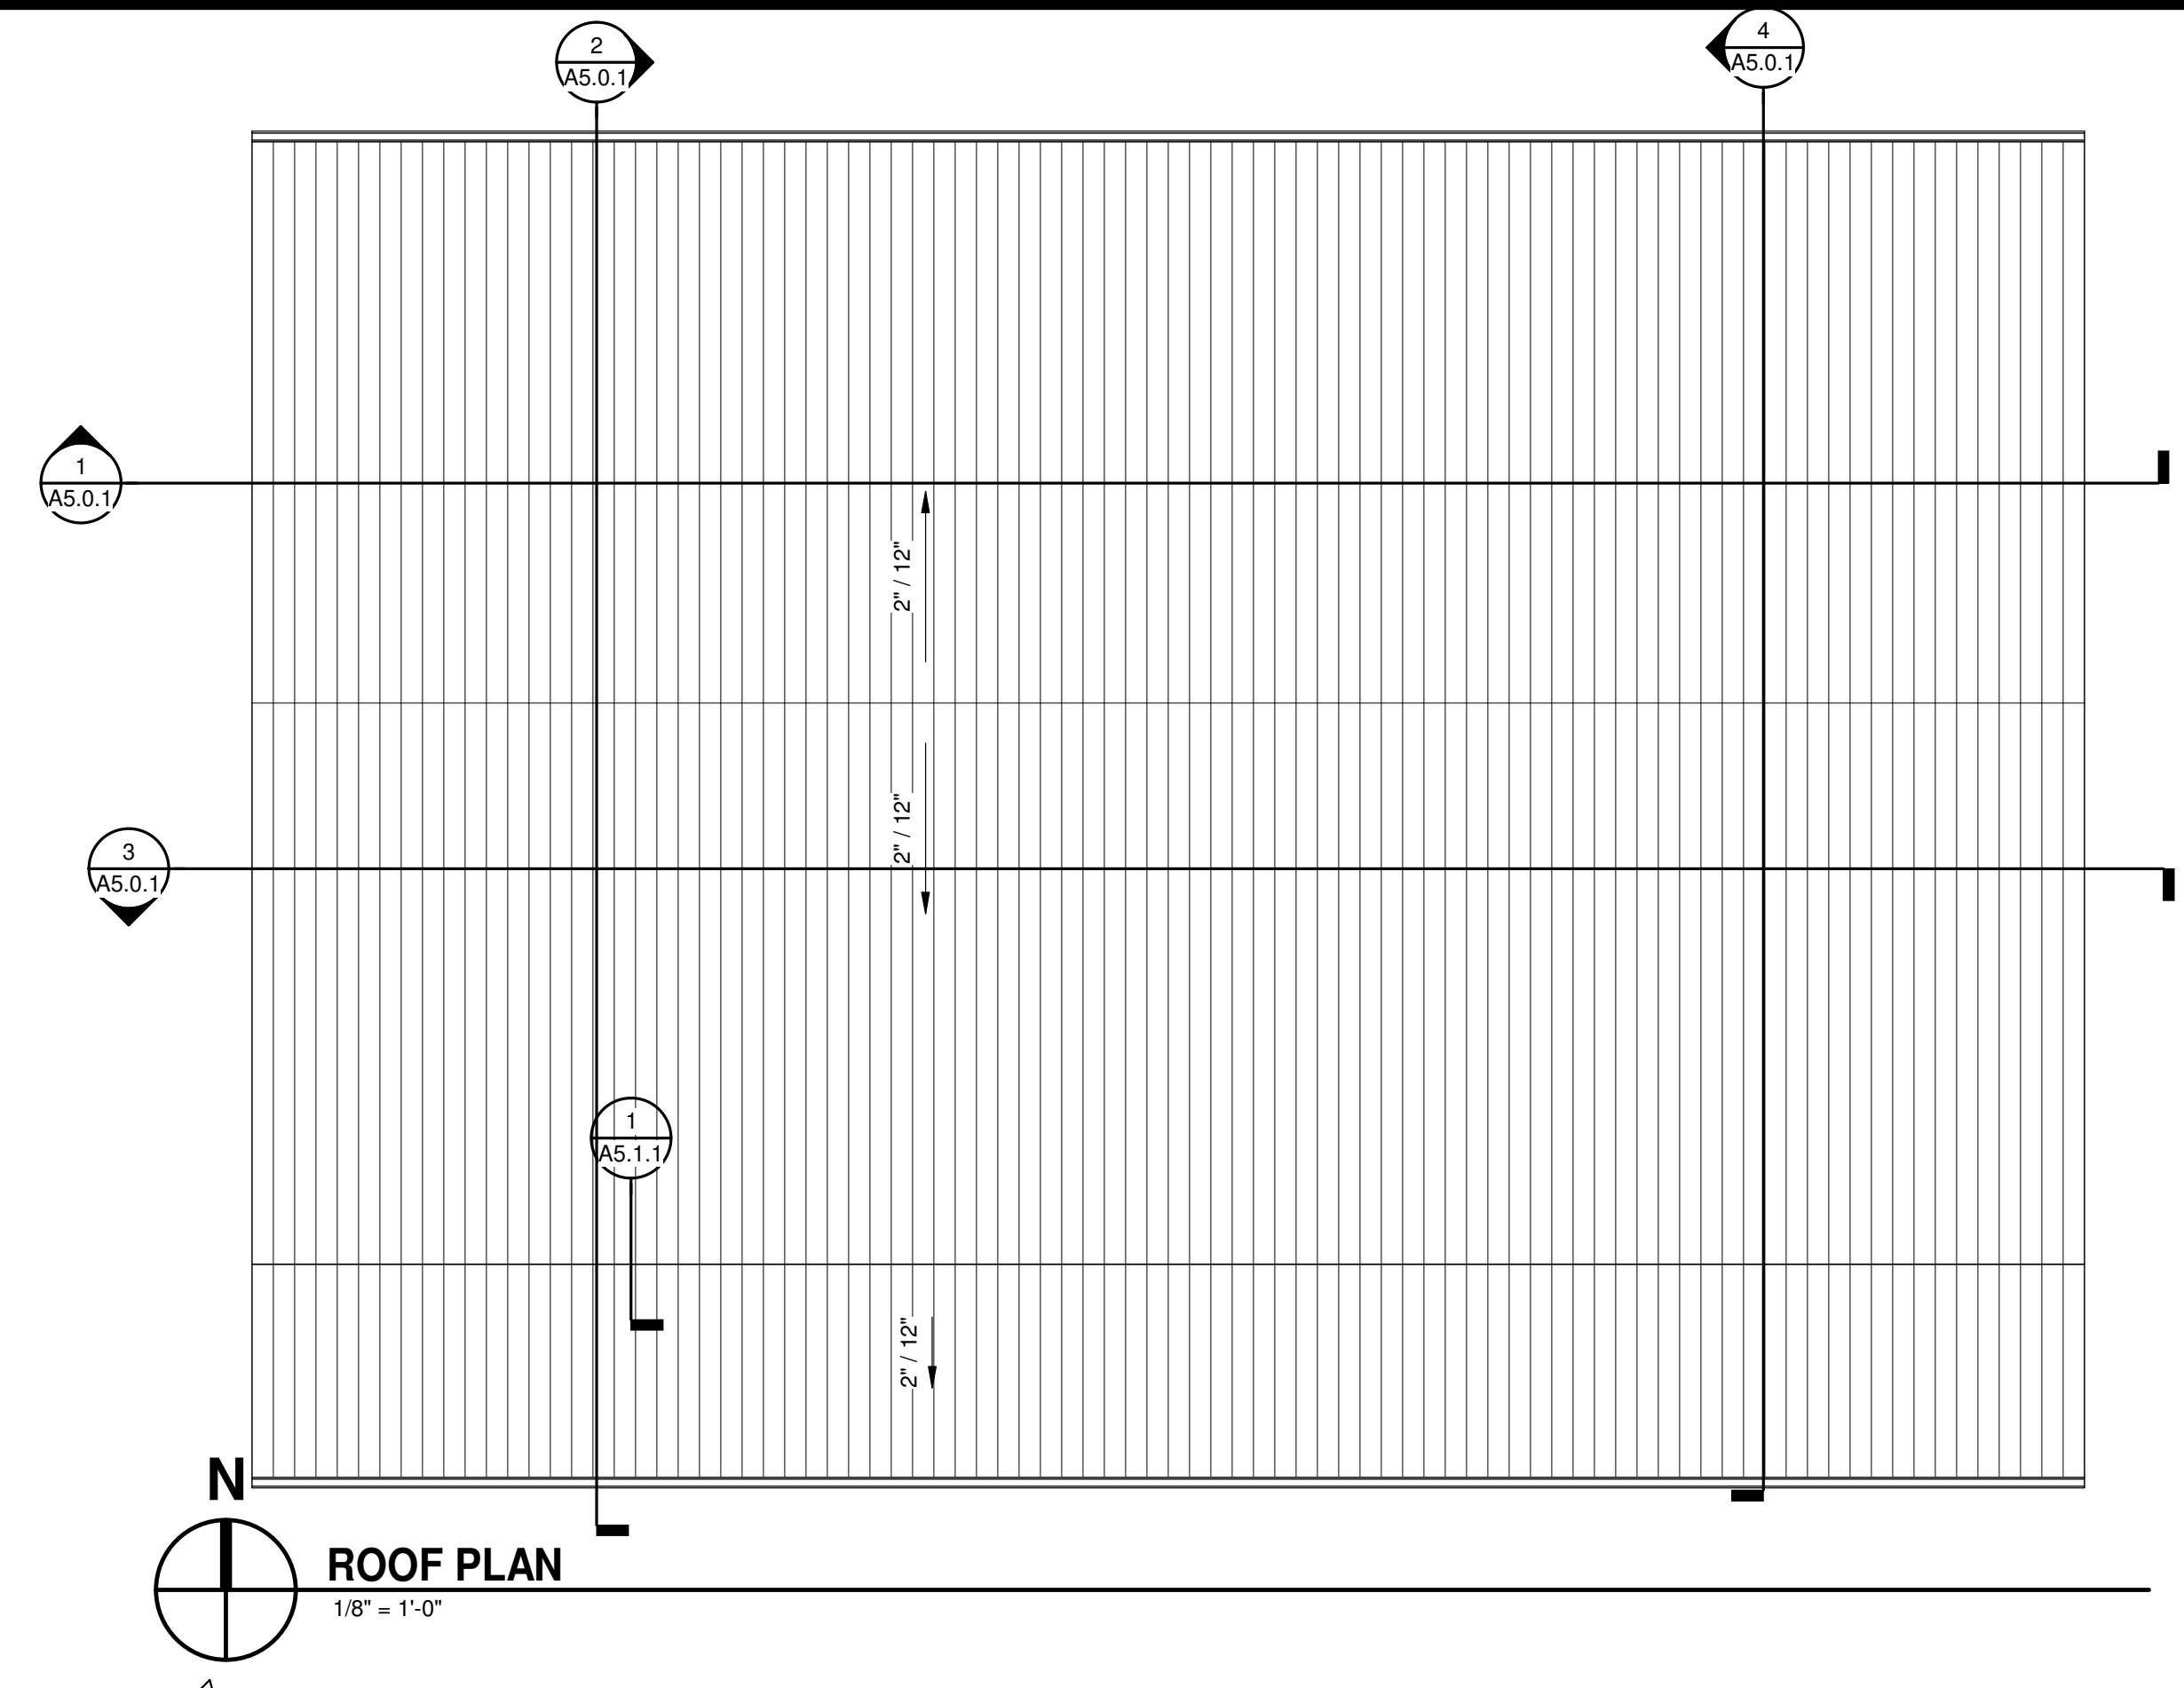

ROOF PLAN
 1/8" = 1'-0"

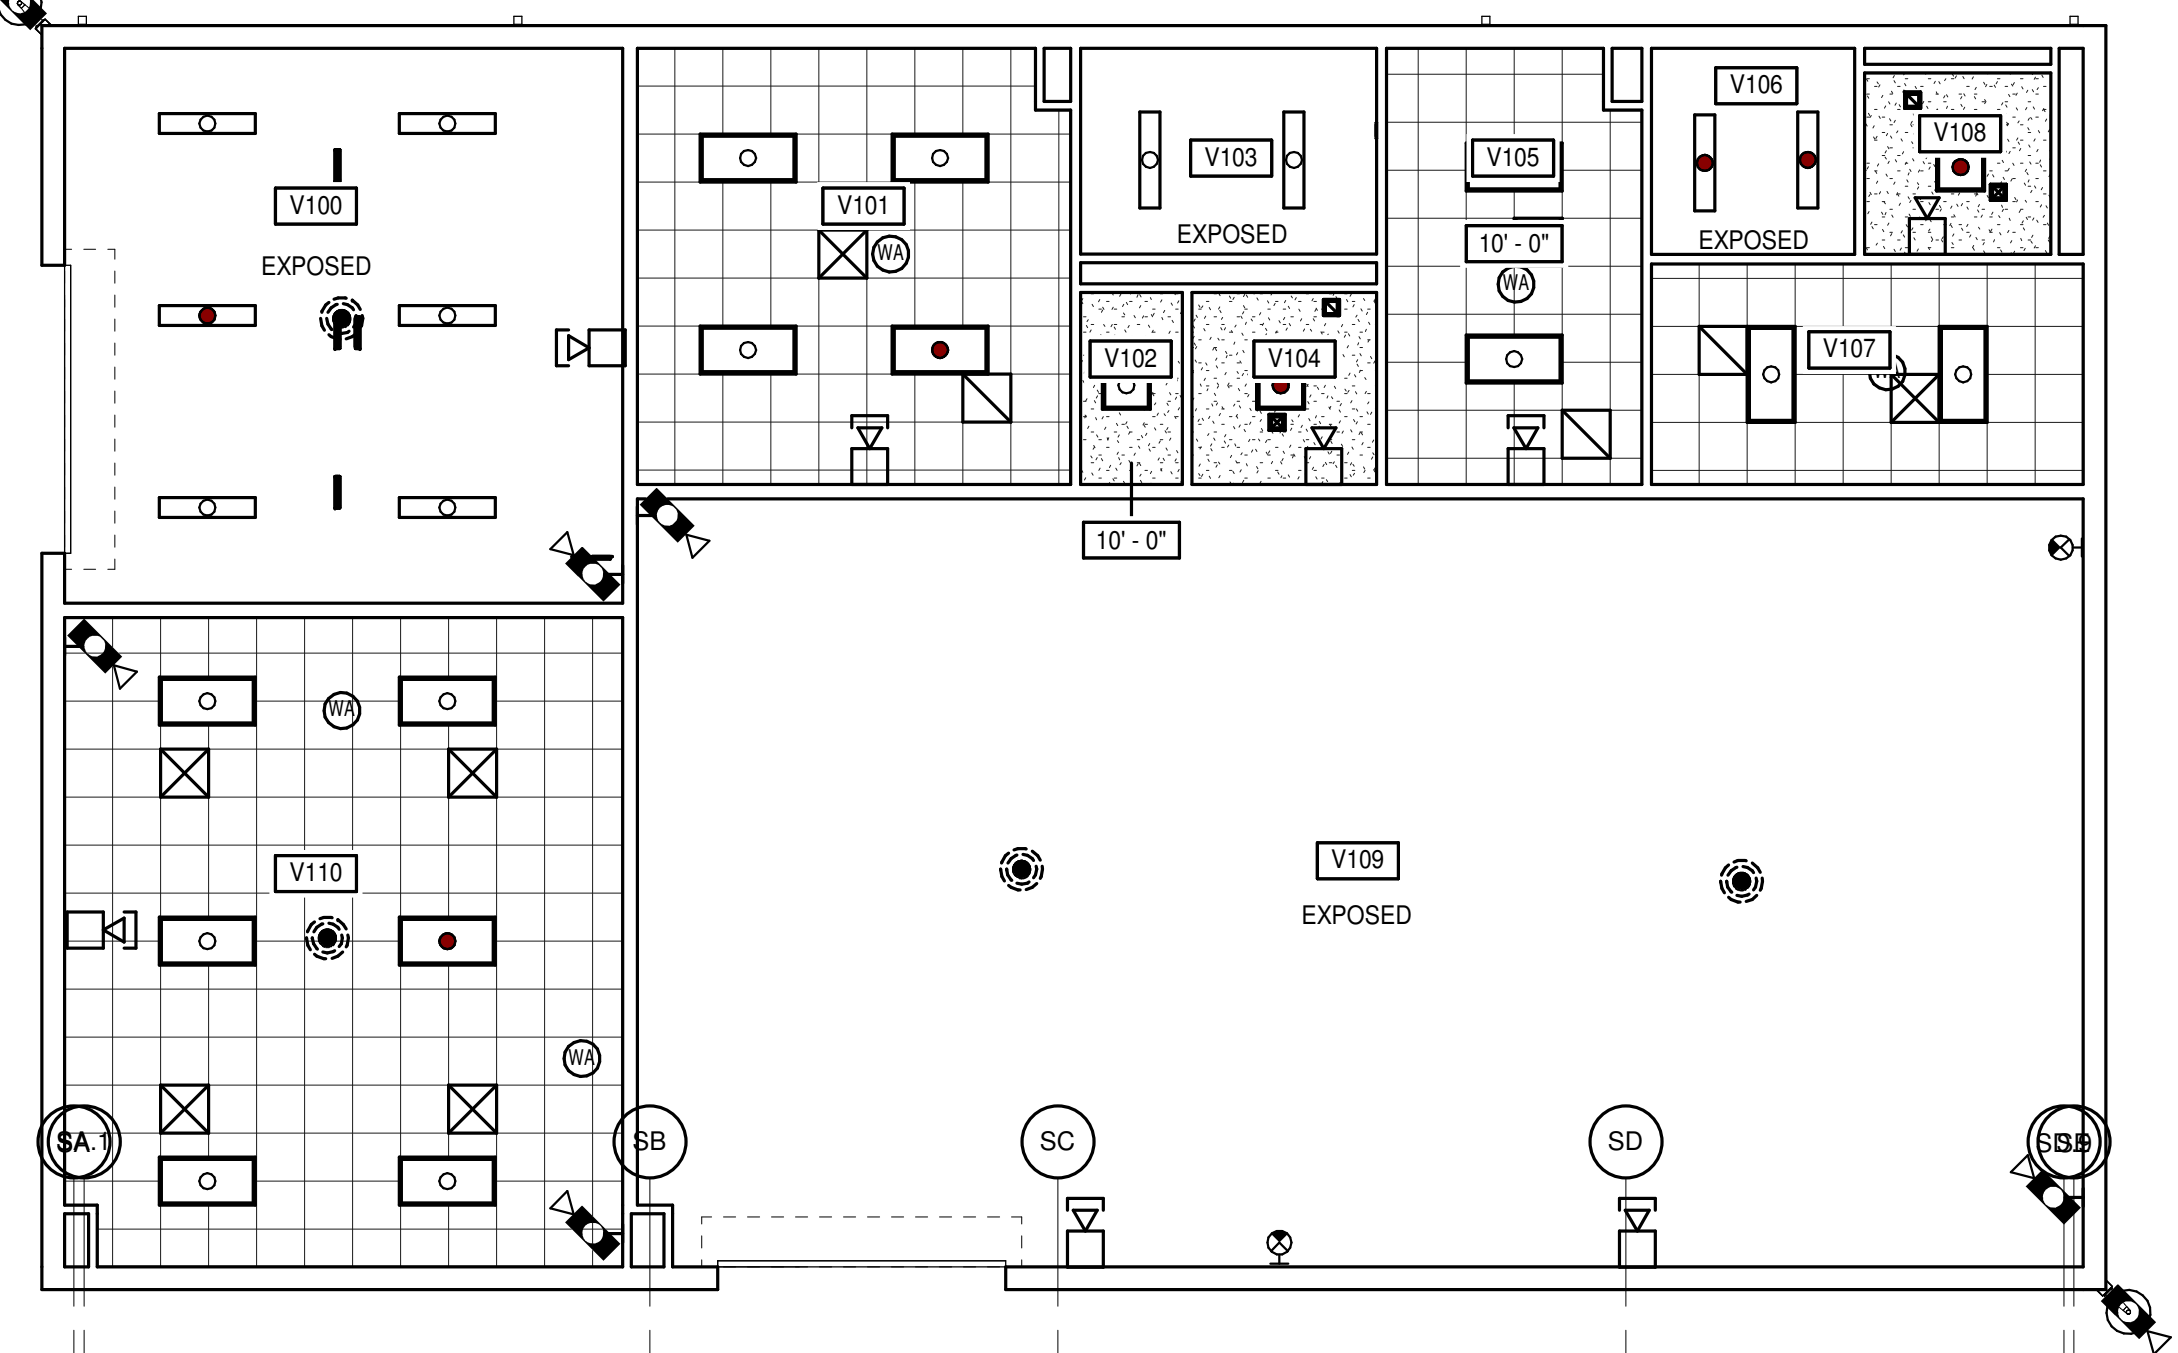

2 RE-ENTRY BUILDING - RCP
 A4.1.1 A2.1.1 1/8" = 1'-0"

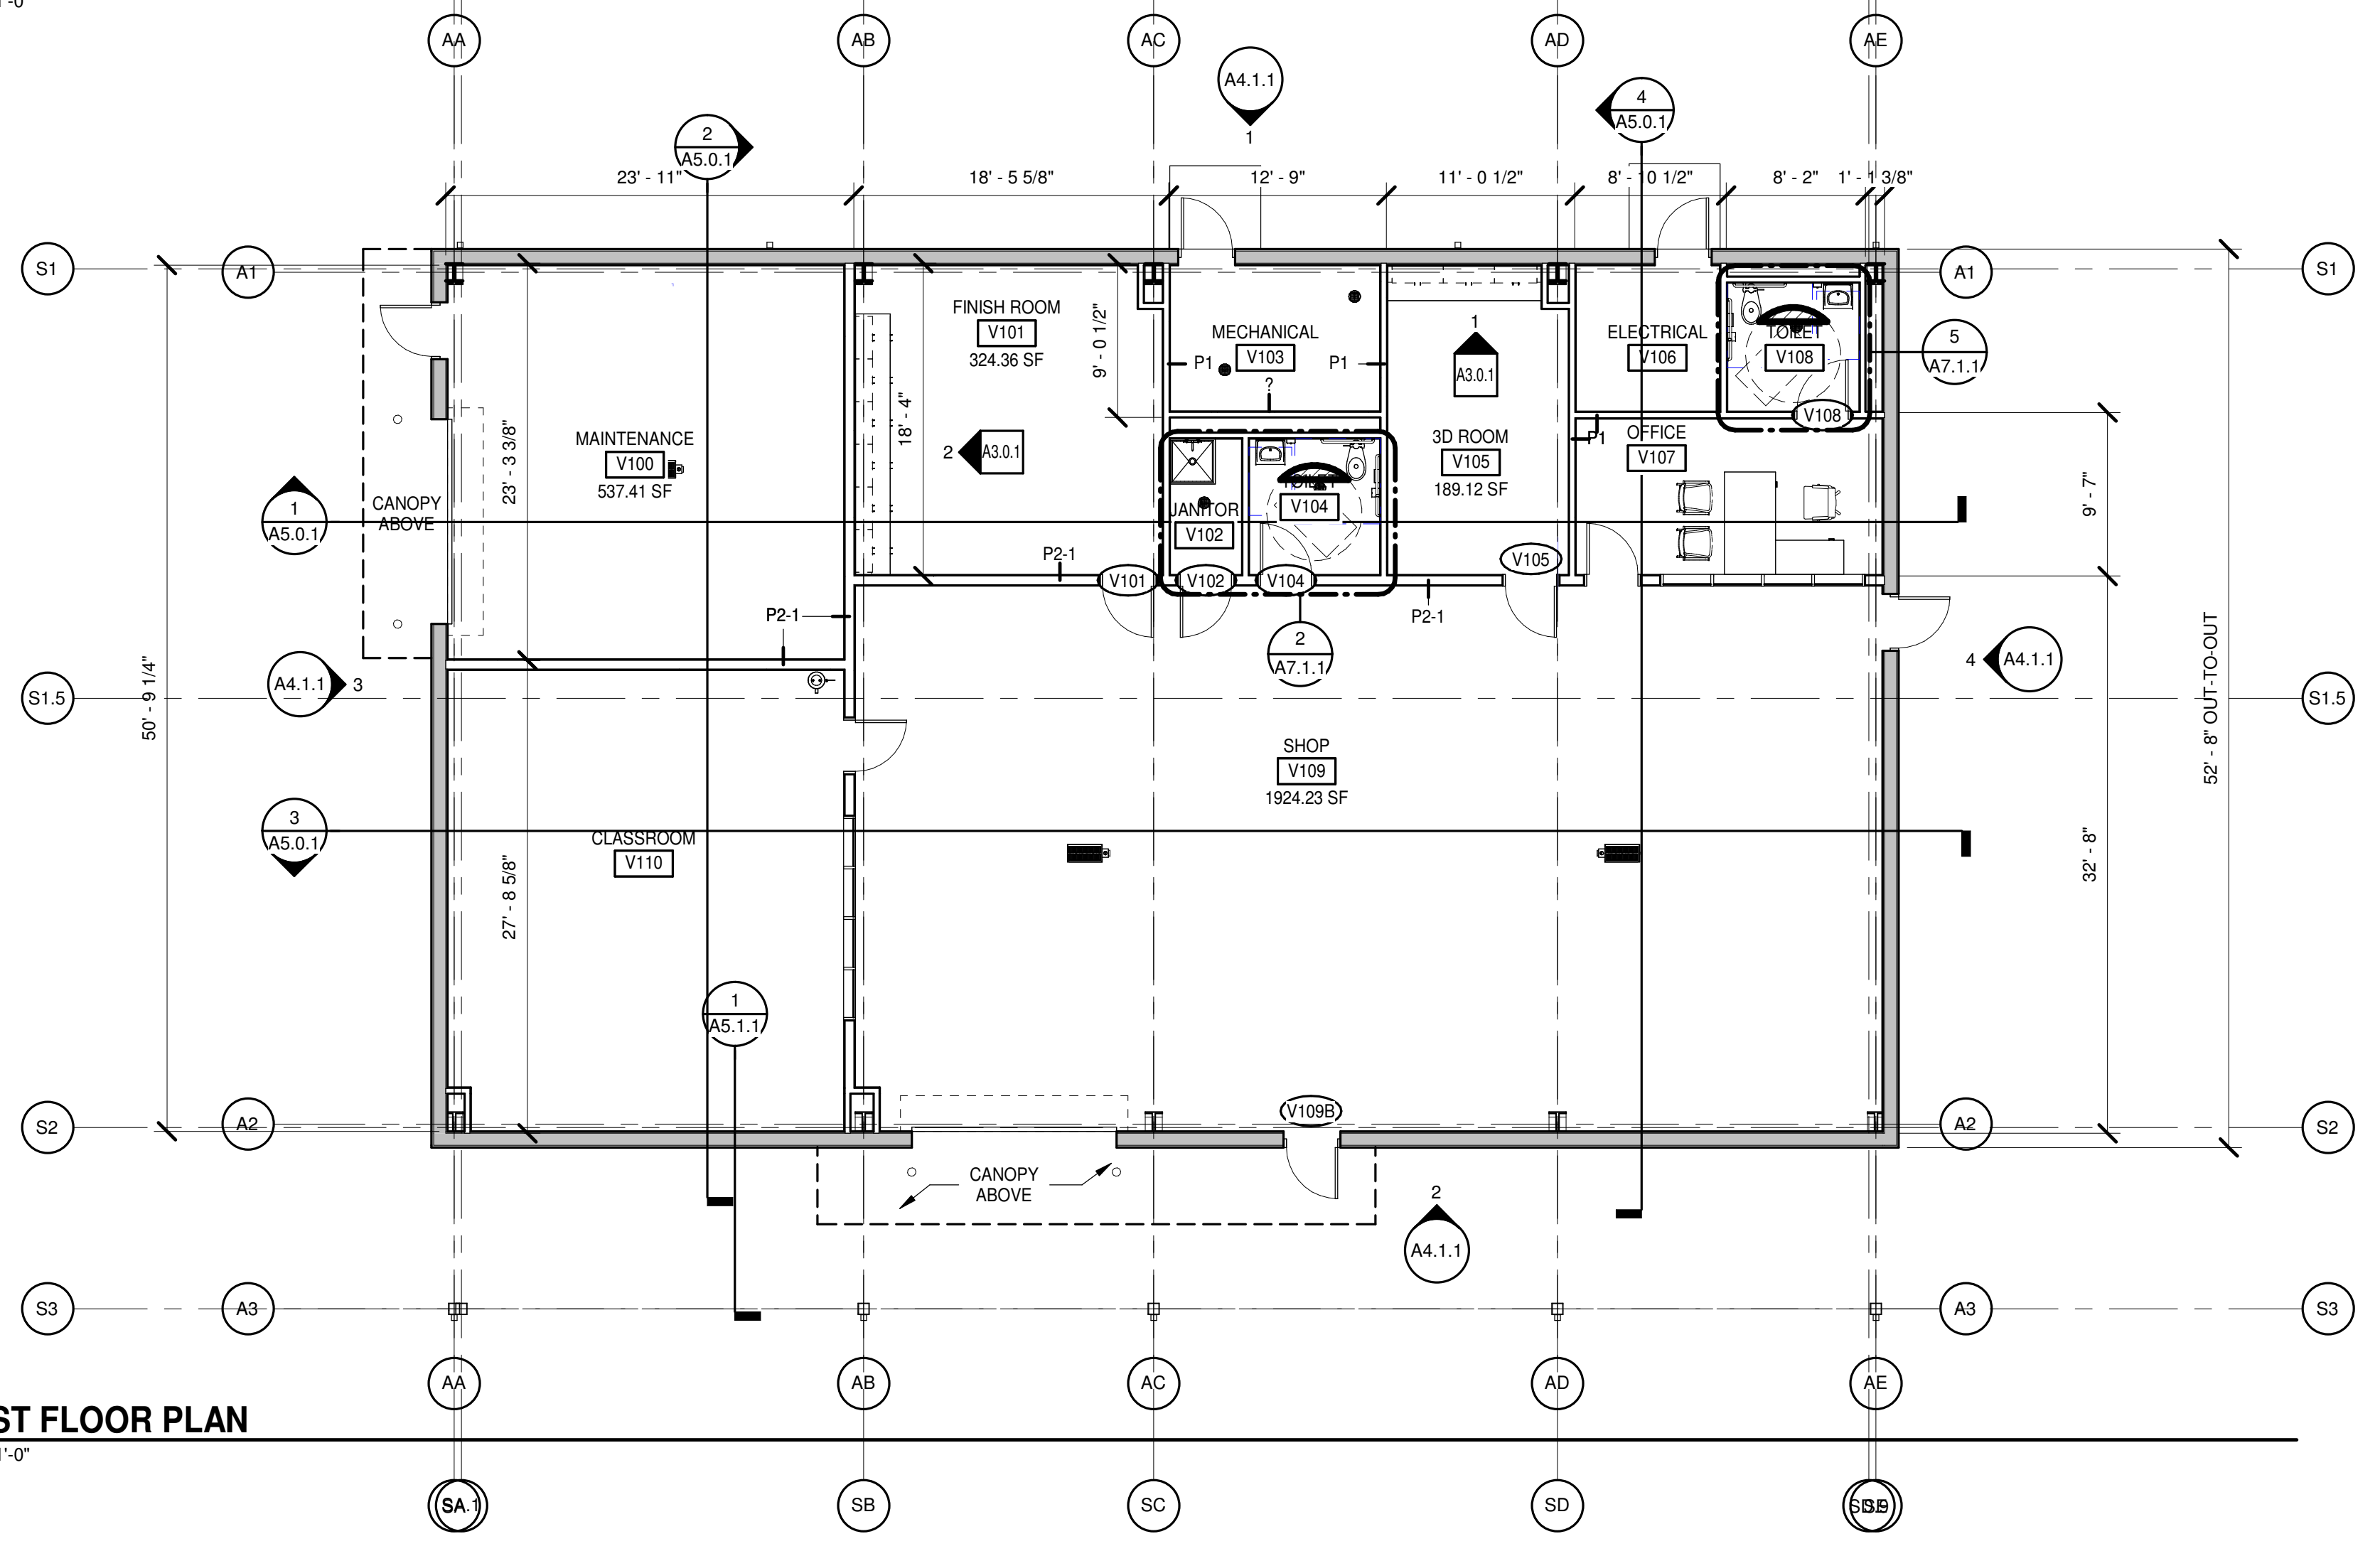


FIRST FLOOR PLAN
 1/8" = 1'-0"


BUILDING ELEVATION KEYNOTES	
REPRESENTED BY [Symbol]	
APPLIES TO DRAWINGS A4.1 - A4.n	
1	STANDING SEAM METAL ROOF
2	PEMB METAL WALL PANELS
3	PREFINISHED ALUMINUM PROTECTIVE COVER
4	PREFINISHED ALUMINUM GUTTER AND DOWNSPOUT
5	BOLLARDS - REFER TO ARCHITECTURAL SITE PLAN
6	SECURITY CAMERA, TYP. - REFER TO SECURITY DRAWINGS
7	WALL SCONCE - REFER TO ELECTRICAL
8	SITE LIGHTING - REFER TO ELECTRICAL




3 WEST ELEVATION
 A2.1.1 | A4.1.1 | 1/4" = 1'-0"

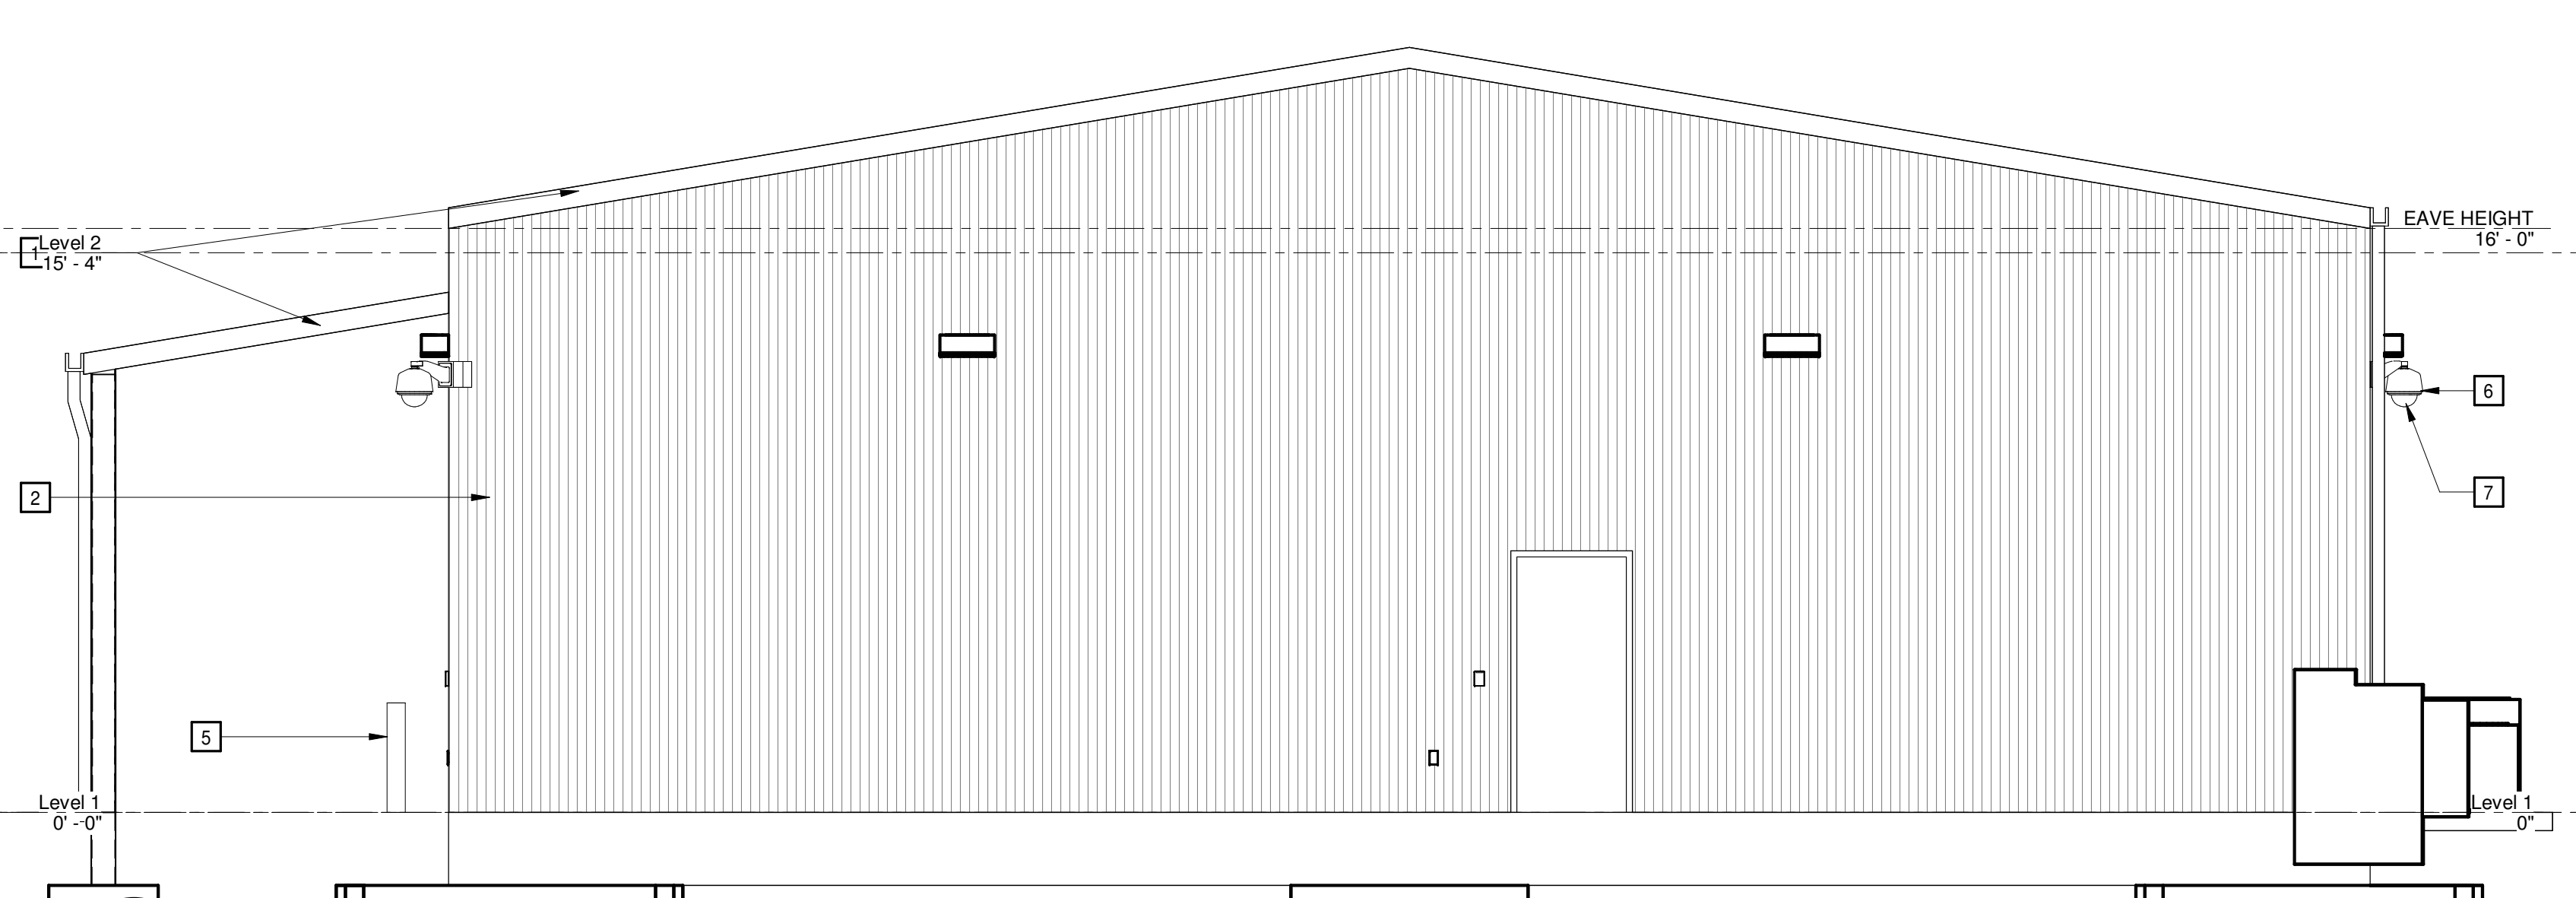

4 EAST ELEVATION
 A2.1.1 | A4.1.1 | 1/4" = 1'-0"

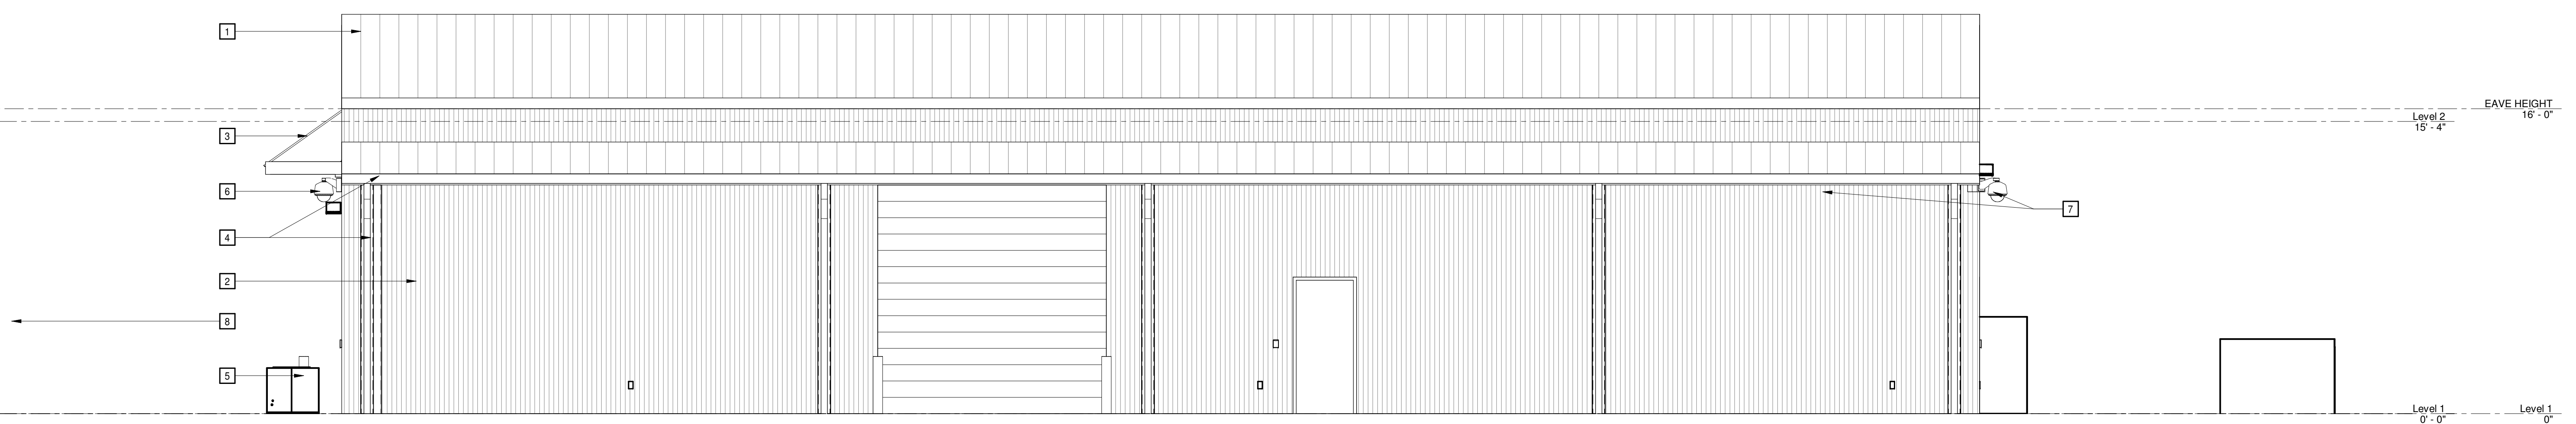

2 SOUTH ELEVATION
 A2.1.1 | A4.1.1 | 1/4" = 1'-0"

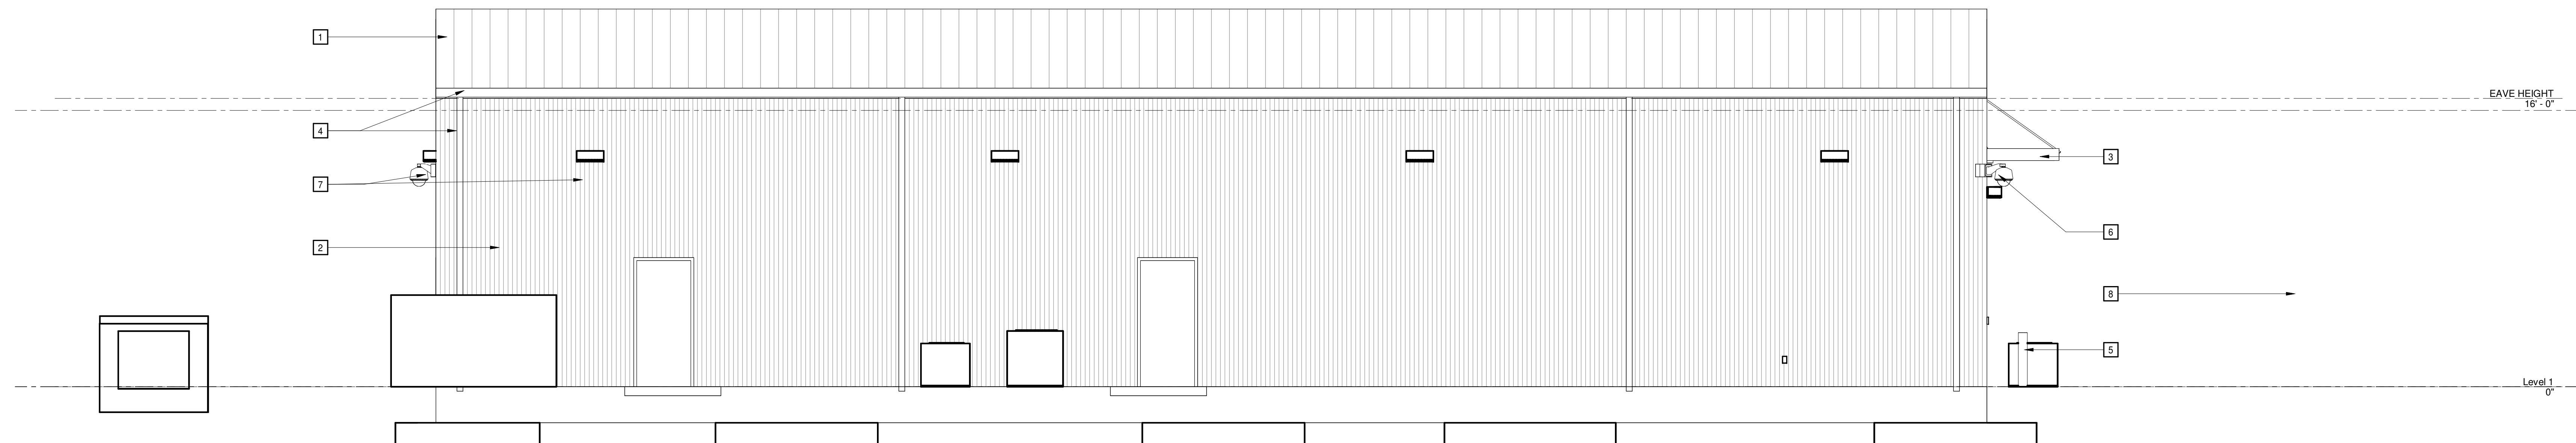

1 NORTH ELEVATION
 A2.1.1 | A4.1.1 | 1/4" = 1'-0"

PROJECT NO:	611315
DATE:	FEBRUARY 26, 2024
REVISIONS	
DATE	DESCRIPTION

PROJECT NO:	611315
DATE:	FEBRUARY 26, 2024
REVISIONS	
DATE	DESCRIPTION

GENERAL NOTES




A. GENERAL NOTE 1...

B. GENERAL NOTE 2...

INTERIOR ELEVATION KEYNOTES


REPRESENTED BY [Symbol]

APPLIES TO DRAWINGS A4.2.0-A4.2.1

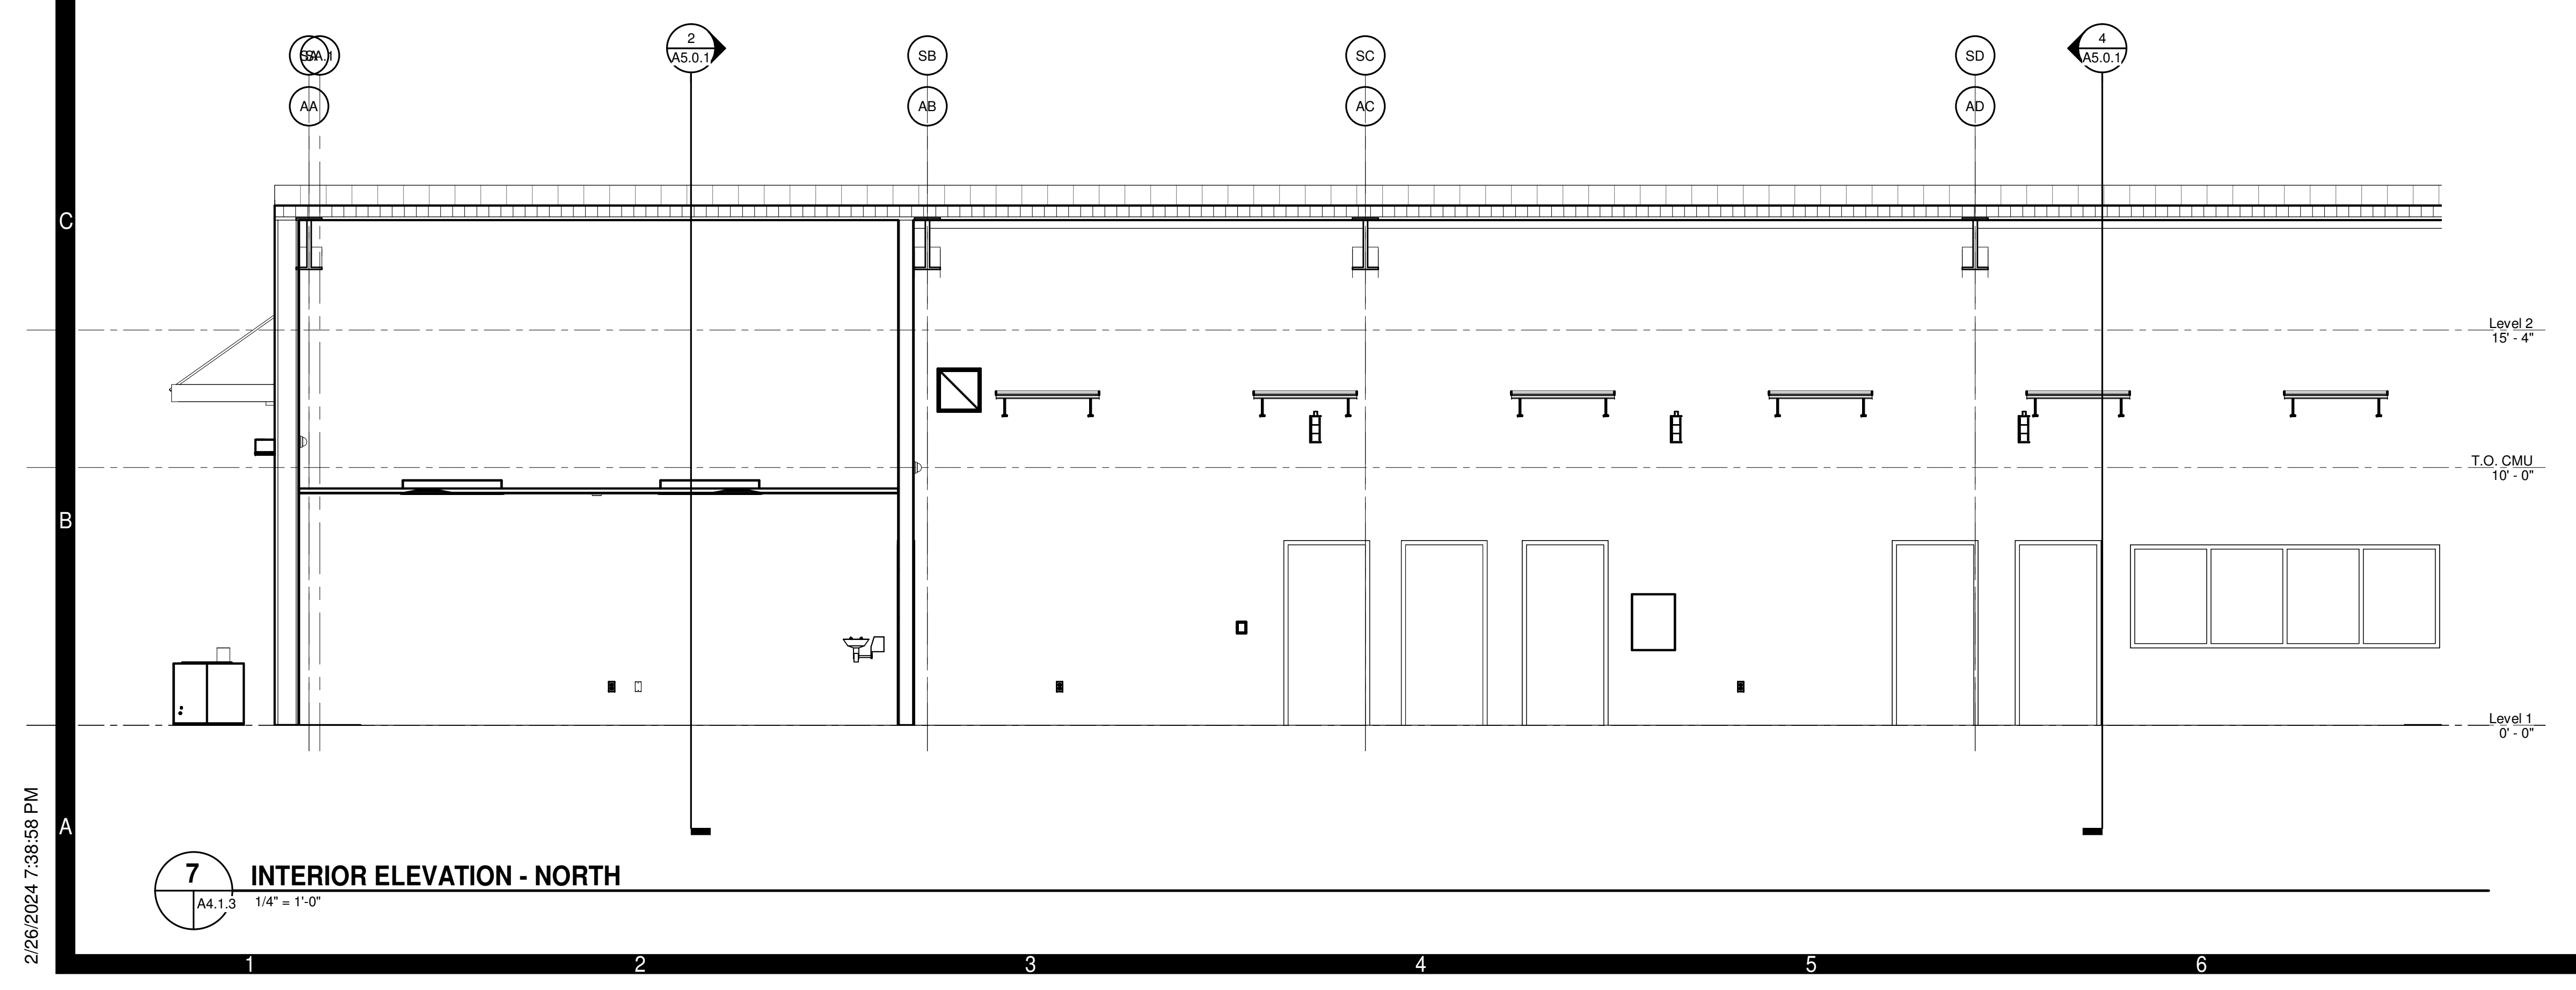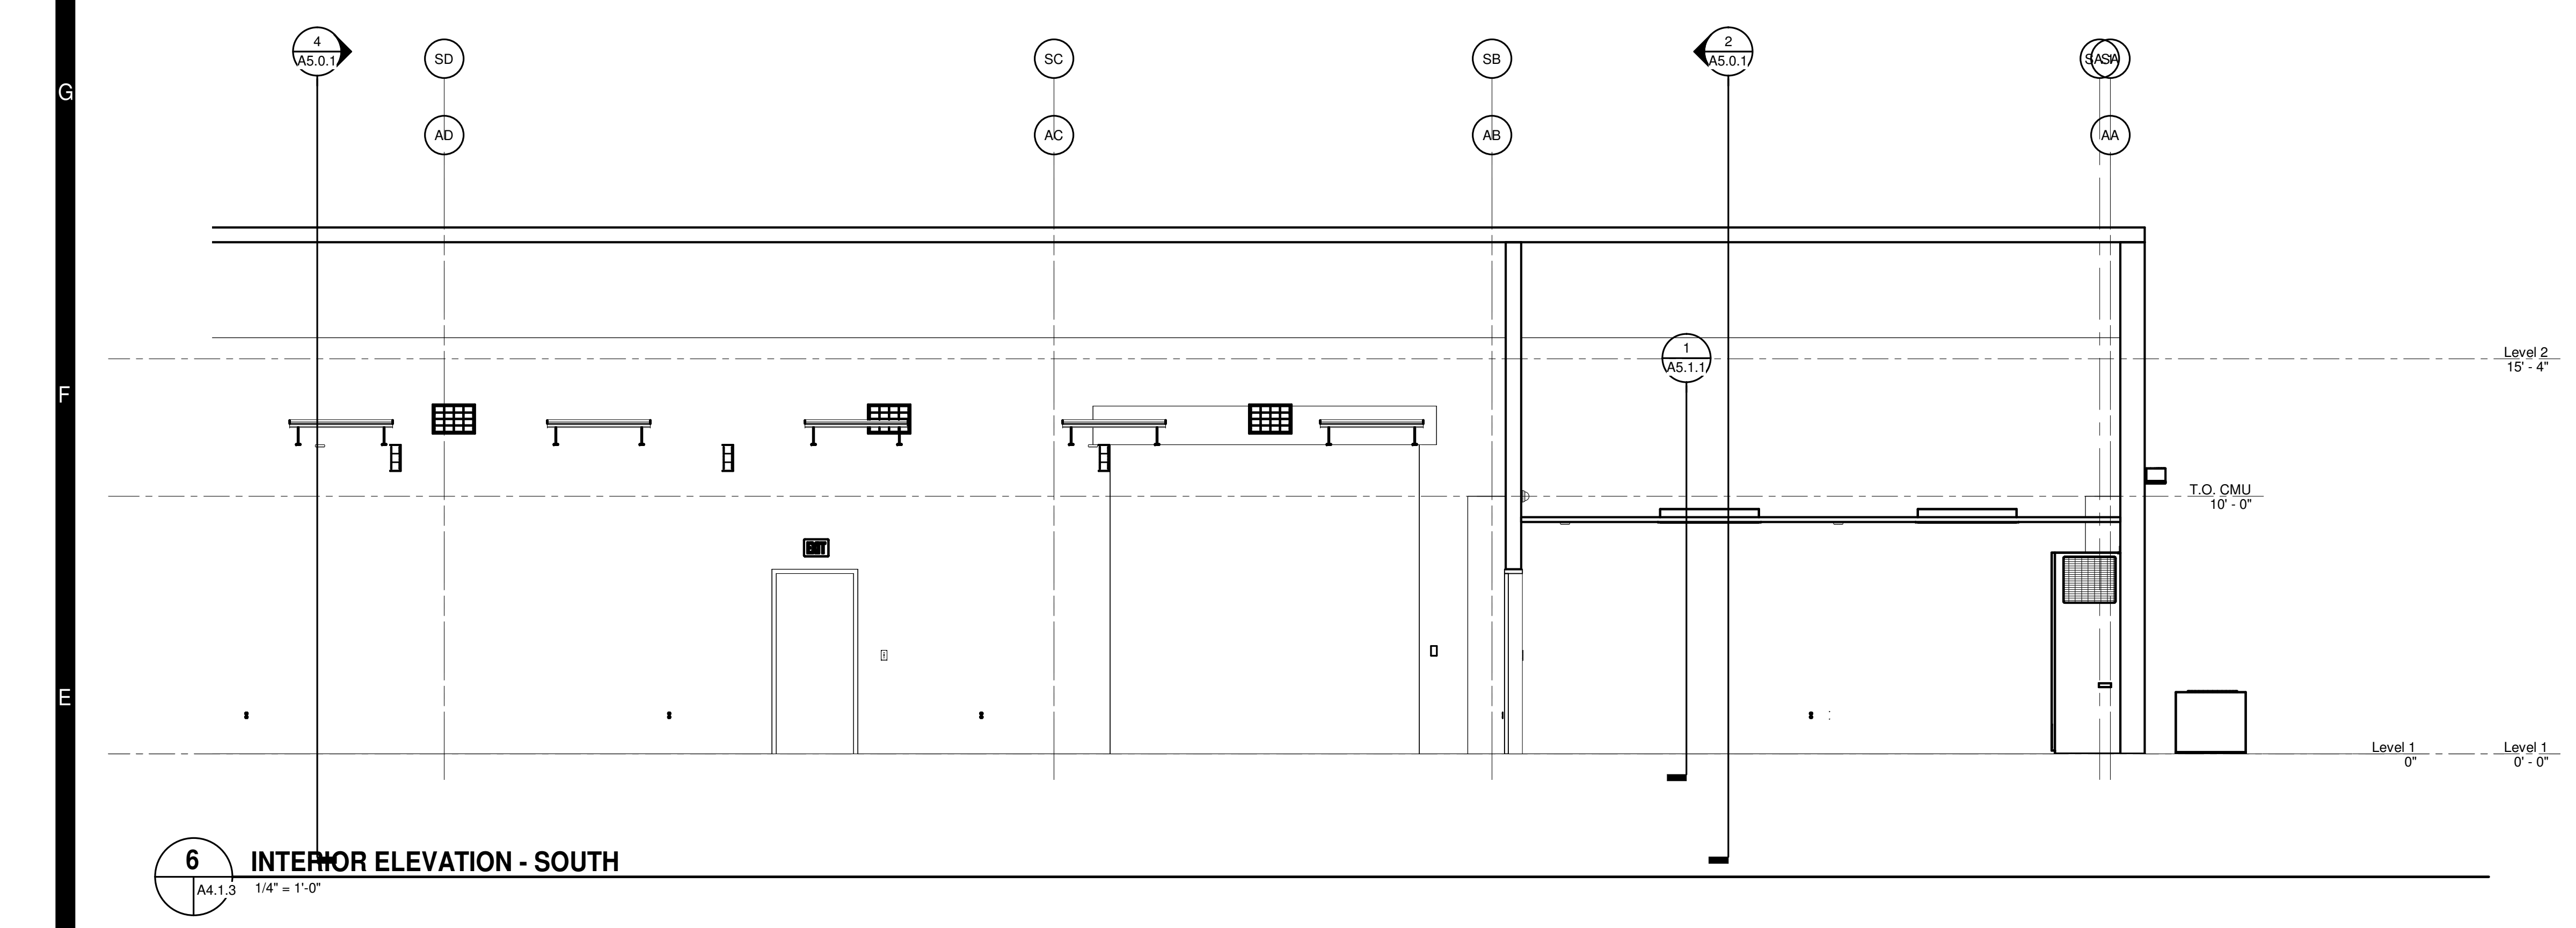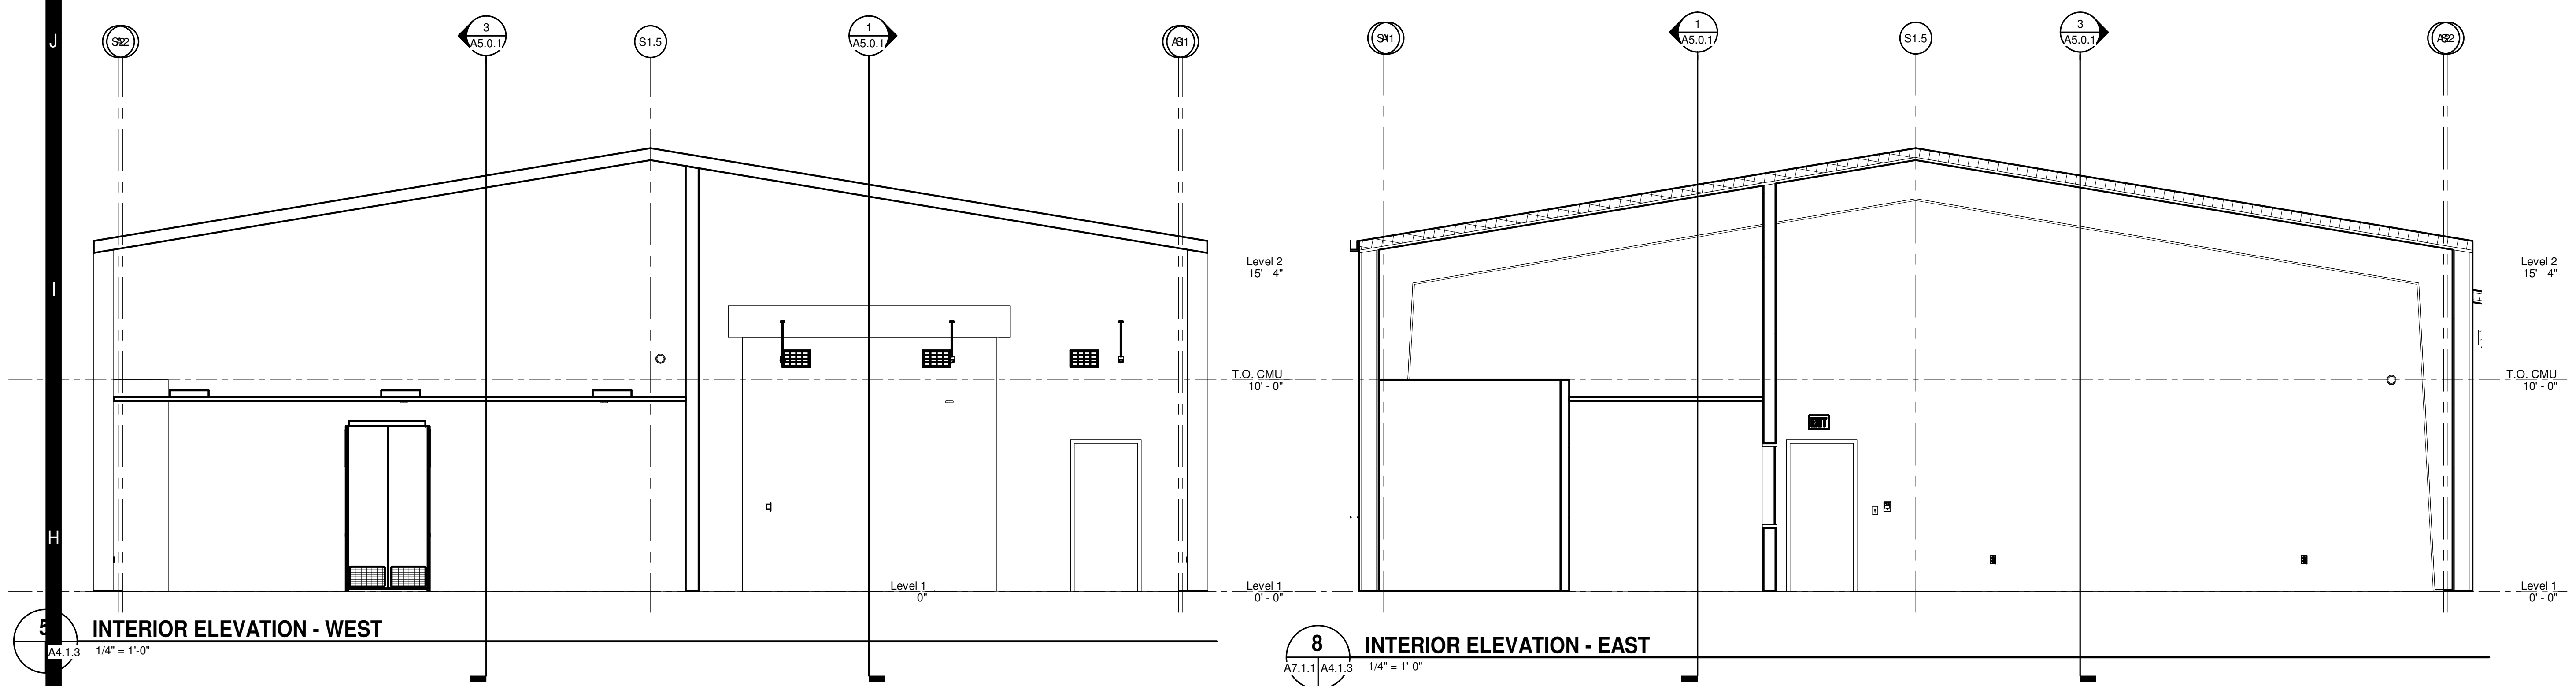


PROJECT NO:	611315
DATE:	FEBRUARY 26, 2024
REVISIONS	
DATE	DESCRIPTION

2/28/2024 7:38:59 PM

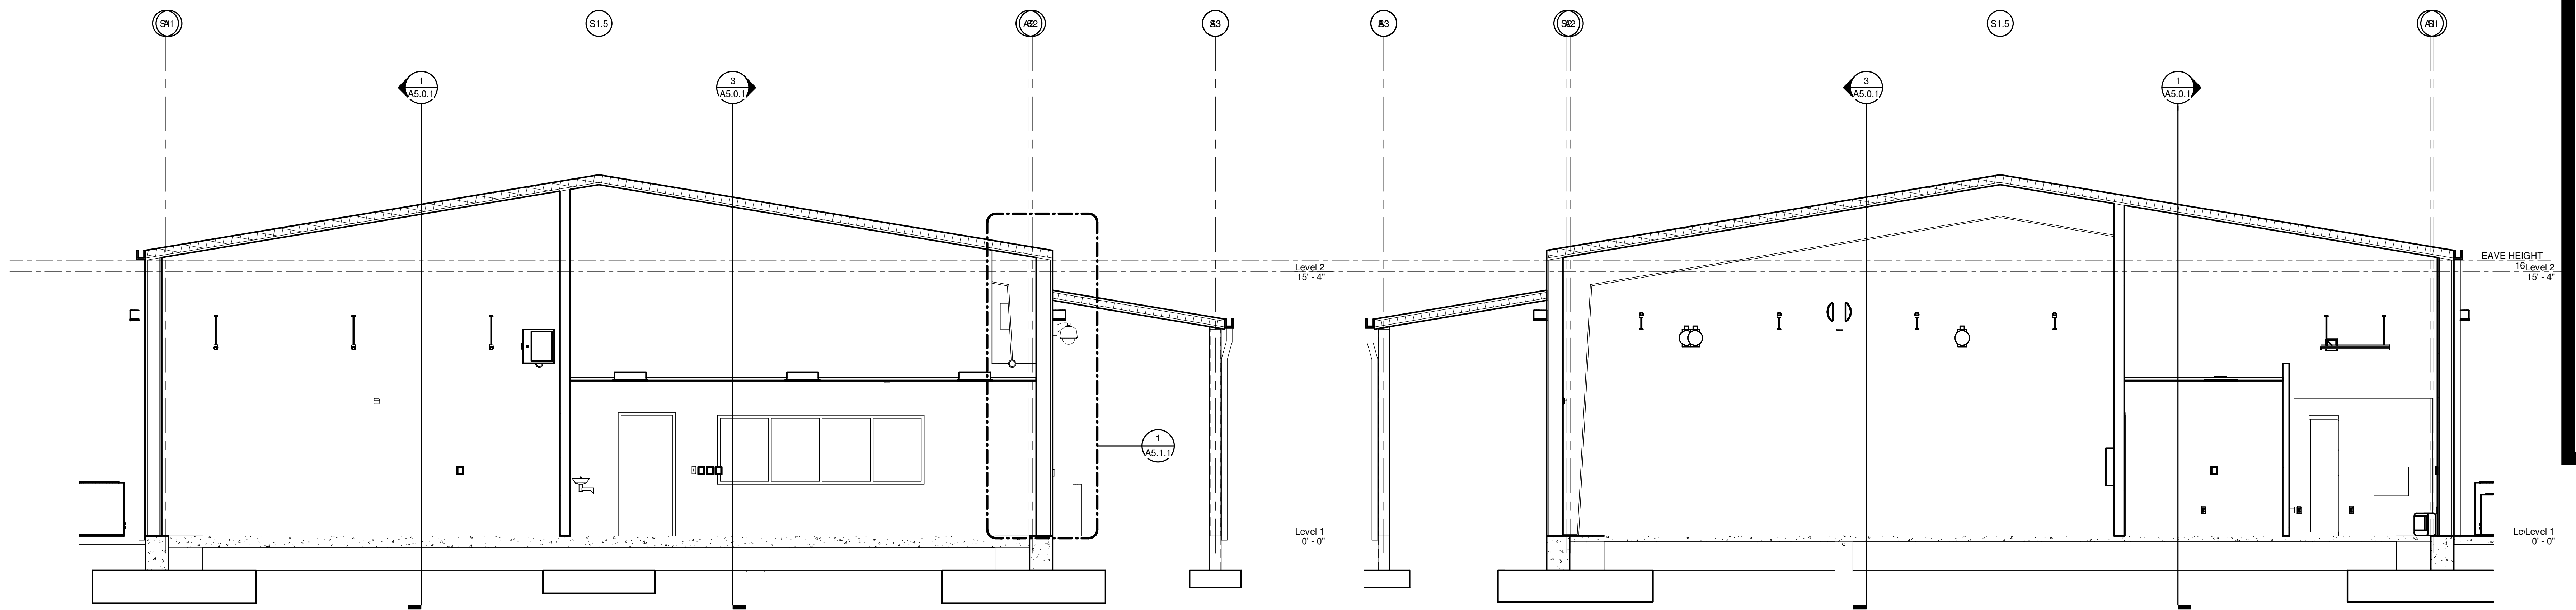


2 BUILDING SECTION
A2.1.1 | A5.0.1 | 1/4" = 1'-0"

4 BUILDING SECTION
A2.1.1 | A5.0.1 | 1/4" = 1'-0"

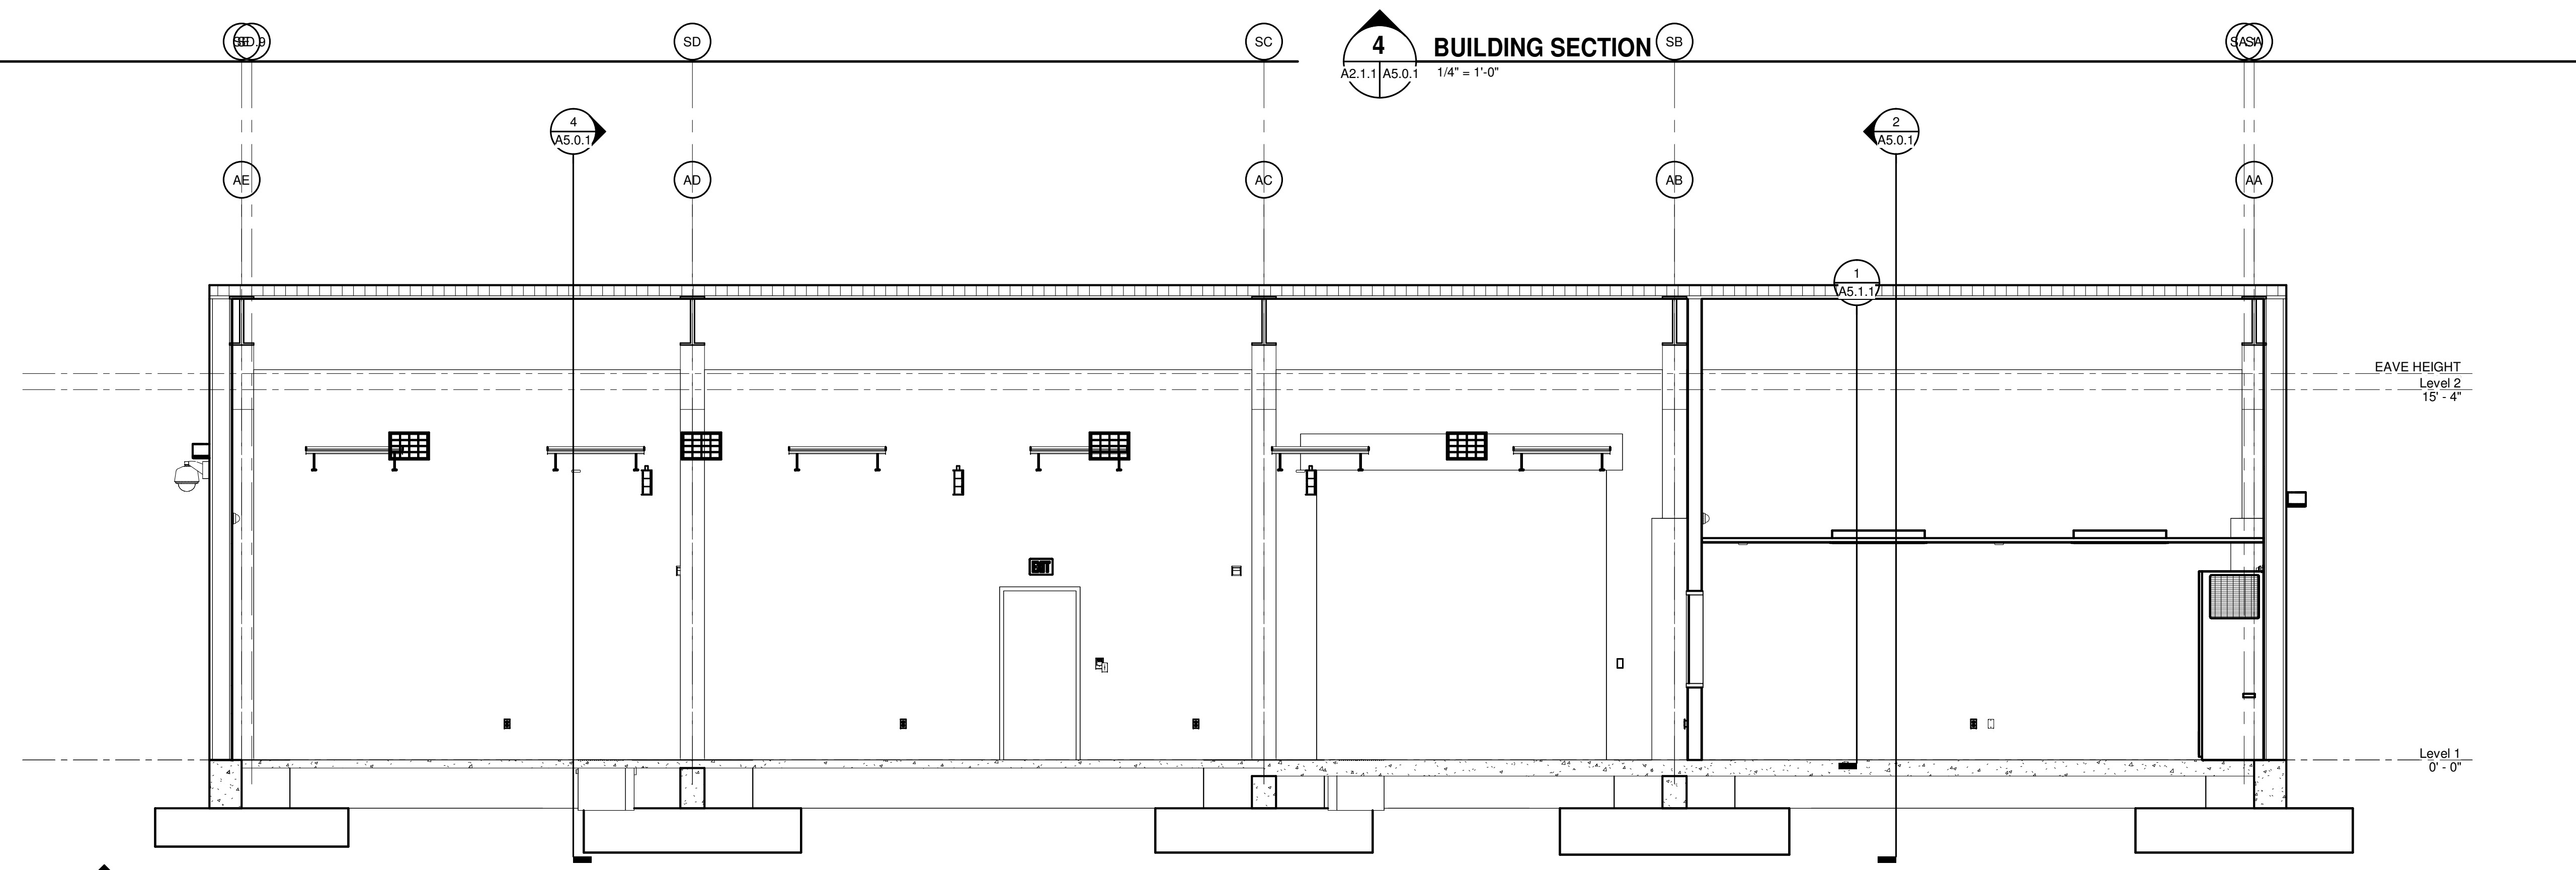

3 BUILDING SECTION
A2.1.1 | A5.0.1 | 1/4" = 1'-0"

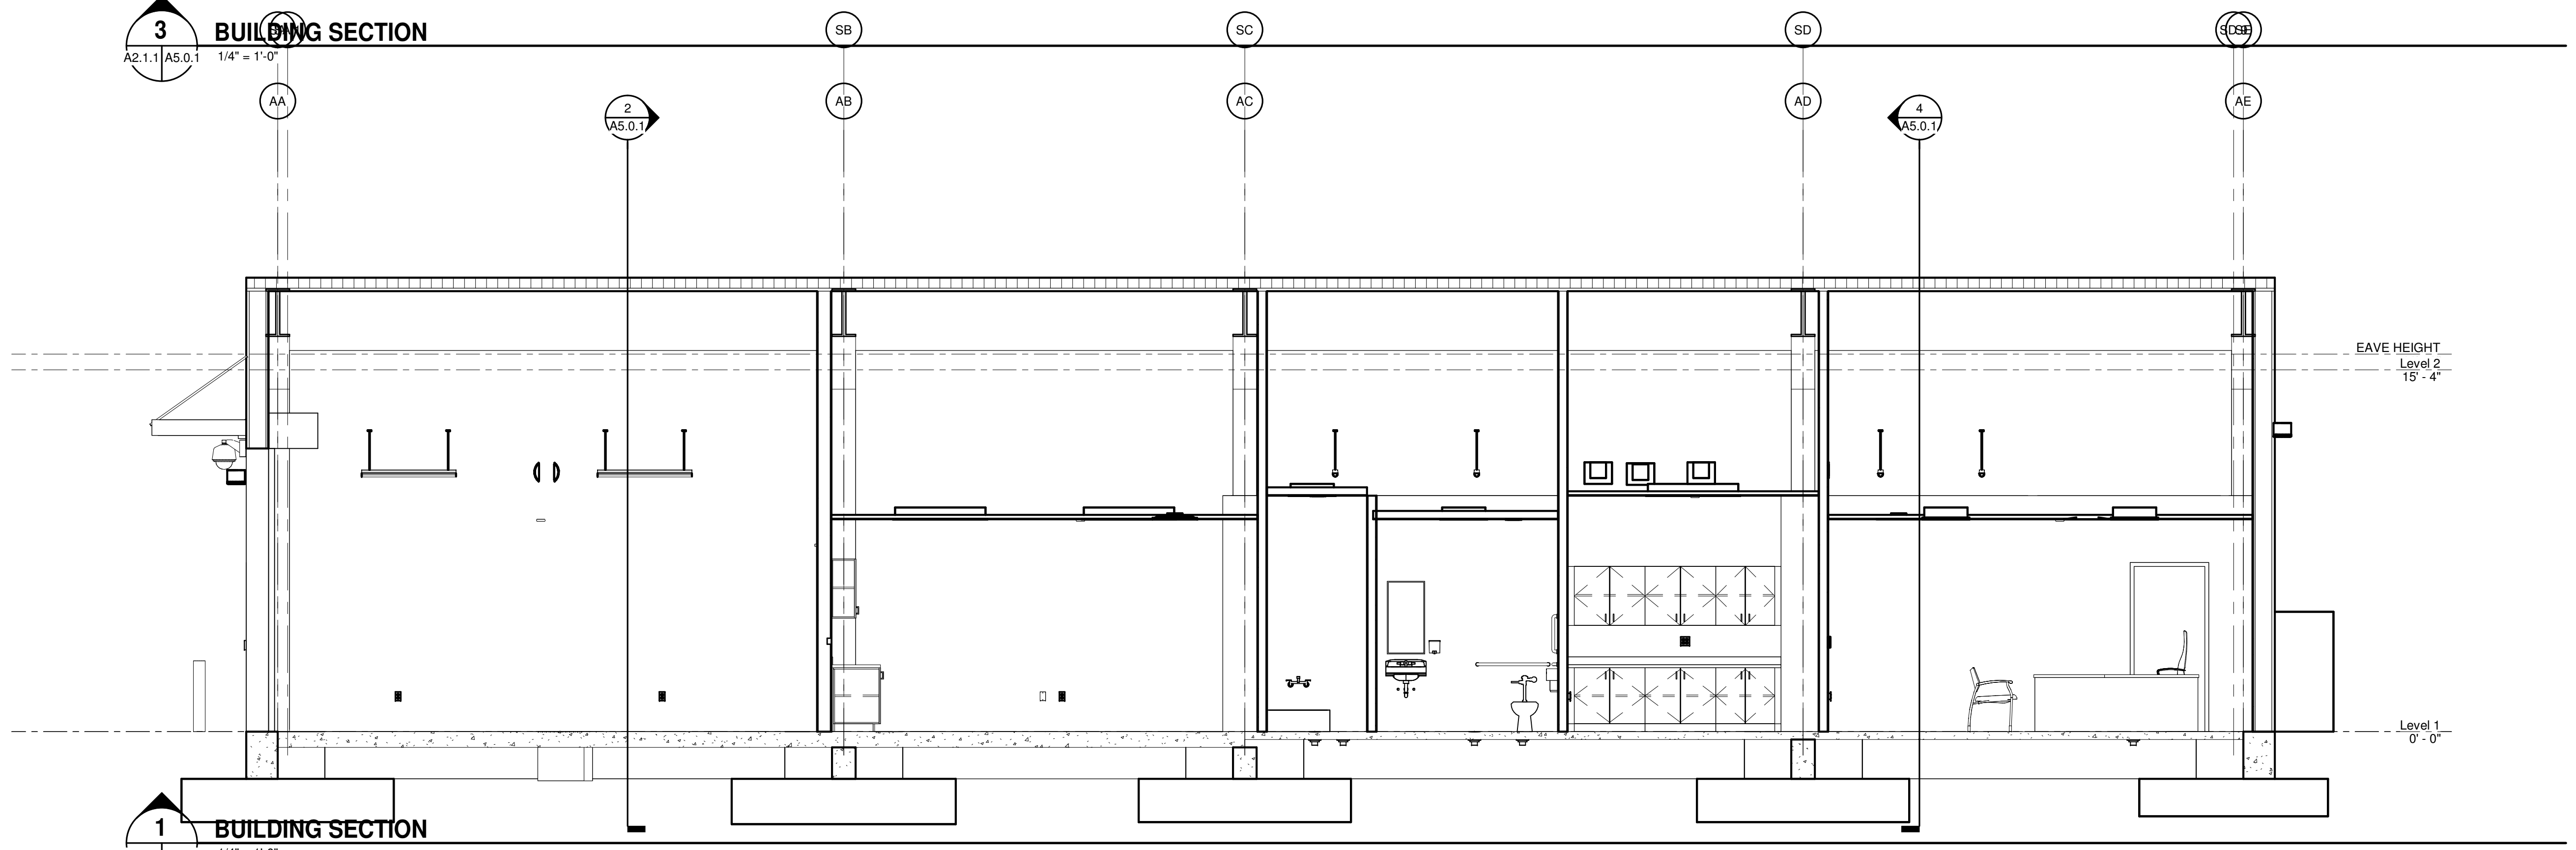

1 BUILDING SECTION
A2.1.1 | A5.0.1 | 1/4" = 1'-0"

J
I
H
G
F
E
D
C
B
A

1 2 3 4 5 6 7 8 9 10

PROJECT NO:	611315
DATE:	FEBRUARY 26, 2024
REVISIONS	
DATE	DESCRIPTION

GENERAL NOTES


A. GENERAL NOTE 1...

B. GENERAL NOTE 2...

WALL SECTION KEYNOTES

REPRESENTED BY []

APPLIES TO DRAWINGS A5.1.1 - A5.1.n

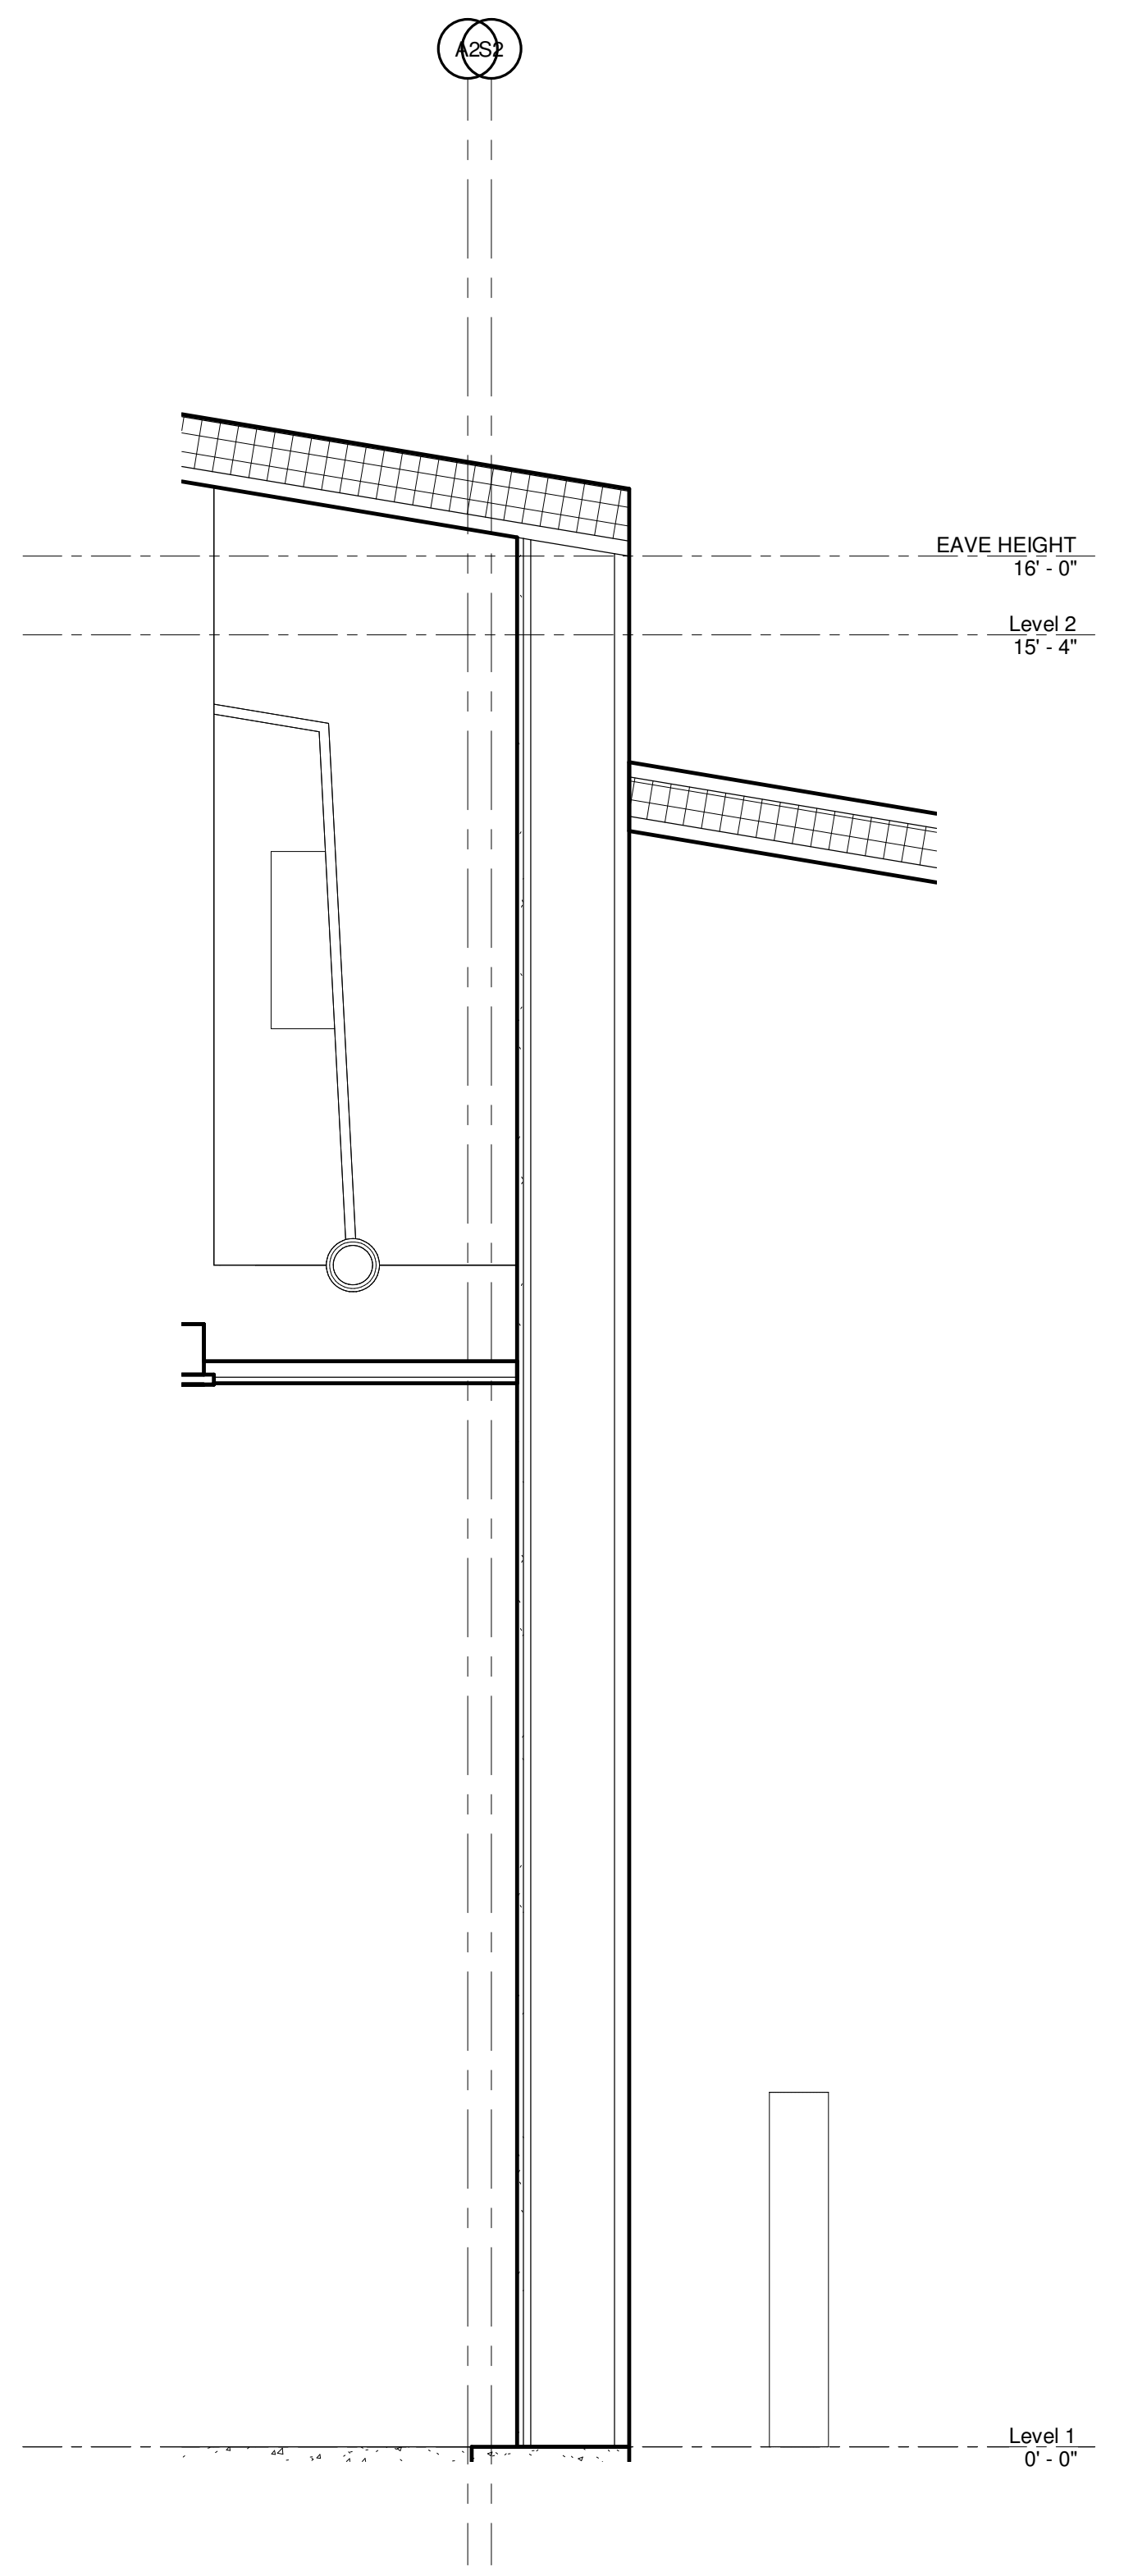

EXTERIOR WALL ASSEMBLIES							
APPLIES TO A5.1 AND A5.2 SERIES OF DRAWINGS REPRESENTED BY (WA _n)							
MARK	FIRE RATING (REFER TO LS 1.1 FOR LEGEND)	REMARKS	INFORMATION	MARK	FIRE RATING (REFER TO LS 1.1 FOR LEGEND)	REMARKS	INFORMATION
WA1	○			WAn	○		
WA2	○						

1 WALL SECTION - OVERHEAD DOOR
 A2.1.1 | A5.1.1 | 3/4" = 1'-0"

TOILET ASSEMBLIES, SCHEDULE AND ENLARGED PLAN GENERAL NOTES

A. PLAN DIMENSIONS ARE TO FACE OF WALL OR PARTITION. WHERE APPLIED FINISHES OCCUR SUCH AS CERAMIC TILE, DIMENSIONS ARE TO FACE OF APPLIED FINISH. FOR WAINSCOTS, FLOOR PLAN DIMENSIONS ARE TO FACE OF WAINSCOT MATERIAL. APPLIED FINISHES ARE NOT ALLOWED TO REDUCE CLEAR DIMENSIONS. "APPLIED FINISHES" IN THIS CASE DO NOT INCLUDE TRIM, BASE, AND ACOUSTIC WALL PANELS.

B. CLEAR DIMENSIONS ARE TO FACE OF APPLIED WALL AND PARTITION FINISHES.

TOILET ASSEMBLIES


APPLIES TO DRAWINGS A7.1 - A7.n
 REPRESENTED BY (TAn)

MARK	REMARKS	PLAN	MARK	REMARKS	PLAN
TA1			TA10	BARRIER FREE	
TA2	OMIT (E)		TA11	CENTER OVER LAVATORY	
TA3	BARRIER FREE		TA12	BARRIER FREE	
TA4	OMIT (E)		TA13	OMIT (C, H, J)	
TA5	BARRIER FREE		TA14	BARRIER FREE	
TA6	OMIT (E)		TA15	BARRIER FREE	
TA7	BARRIER FREE		LEGEND NOTES: A. HANDING/ORIENTATION MAY VARY. REFER TO PLANS FOR PROPER ORIENTATION. B. PLUMBING FIXTURE GRAPHICS IN THIS LEGEND ARE REPRESENTATIVE ONLY. ACTUAL PLUMBING FIXTURES MAY VARY. C. COAT/ROBE HOOKS INDICATED ON THE BACK OF TOILET COMPARTMENT DOORS ARE PART OF THE TOILET COMPARTMENT ASSEMBLY AND ARE NOT CONSIDERED A TOILET ACCESSORY.		
TA8	OMIT (E)				
TA9					

TOILET ACCESSORIES SCHEDULE			
MARK	DESCRIPTION	MOUNTING HEIGHT	REMARKS
D	TOILET TISSUE DISPENSER	REFER TO WATER CLOSET ELEVATIONS	
D1	42" HORIZONTAL GRAB BAR	REFER TO WATER CLOSET ELEVATIONS	
D2	18" VERTICAL GRAB BAR	REFER TO WATER CLOSET ELEVATIONS	
D3	38" HORIZONTAL GRAB BAR	REFER TO WATER CLOSET ELEVATIONS	
D4	SANITARY NAPKIN DISPOSAL	REFER TO WATER CLOSET ELEVATIONS	
D7	MIRROR (18" x 36"), OVER LAV AND COUNTERTOP	3'-4" AFF TO BOTTOM OF REFLECTIVE SURFACE	
F	SOAP DISPENSER	3'-4" AFF TO DISPENSING OUTLET	

- ACCESSORY ITEMS ARE IDENTIFIED BY () ON PLANS. LETTERS CORRESPOND TO SCHEDULE ABOVE.
- ACTUAL DIMENSIONS OF ACCESSORIES MAY VARY. COORDINATE DIFFERENCES, IF ANY.
- REFER TO ALL CASEWORK ELEVATIONS FOR ADDITIONAL TOILET ACCESSORY LOCATIONS.
- PROVIDE MOP AND BROOM HOLDER W/ SHELF () AT ALL CUSTODIAL/JANITORIAL SINKS. MOUNT AT 5'-0" AFF TO CENTERLINE AND LOCATE ON SIDE WALL OF SINK (NOT ON WALL ABOVE FAUCET).
- PROVIDE ROBE HOOK ON INTERIOR FACE OF ALL TOILET ROOM DOORS WHEREIN ONLY ONE WATER CLOSET IS PROVIDED. MOUNT AT 3'-11" AFF TO TOP.

5 ENLARGED PLAN

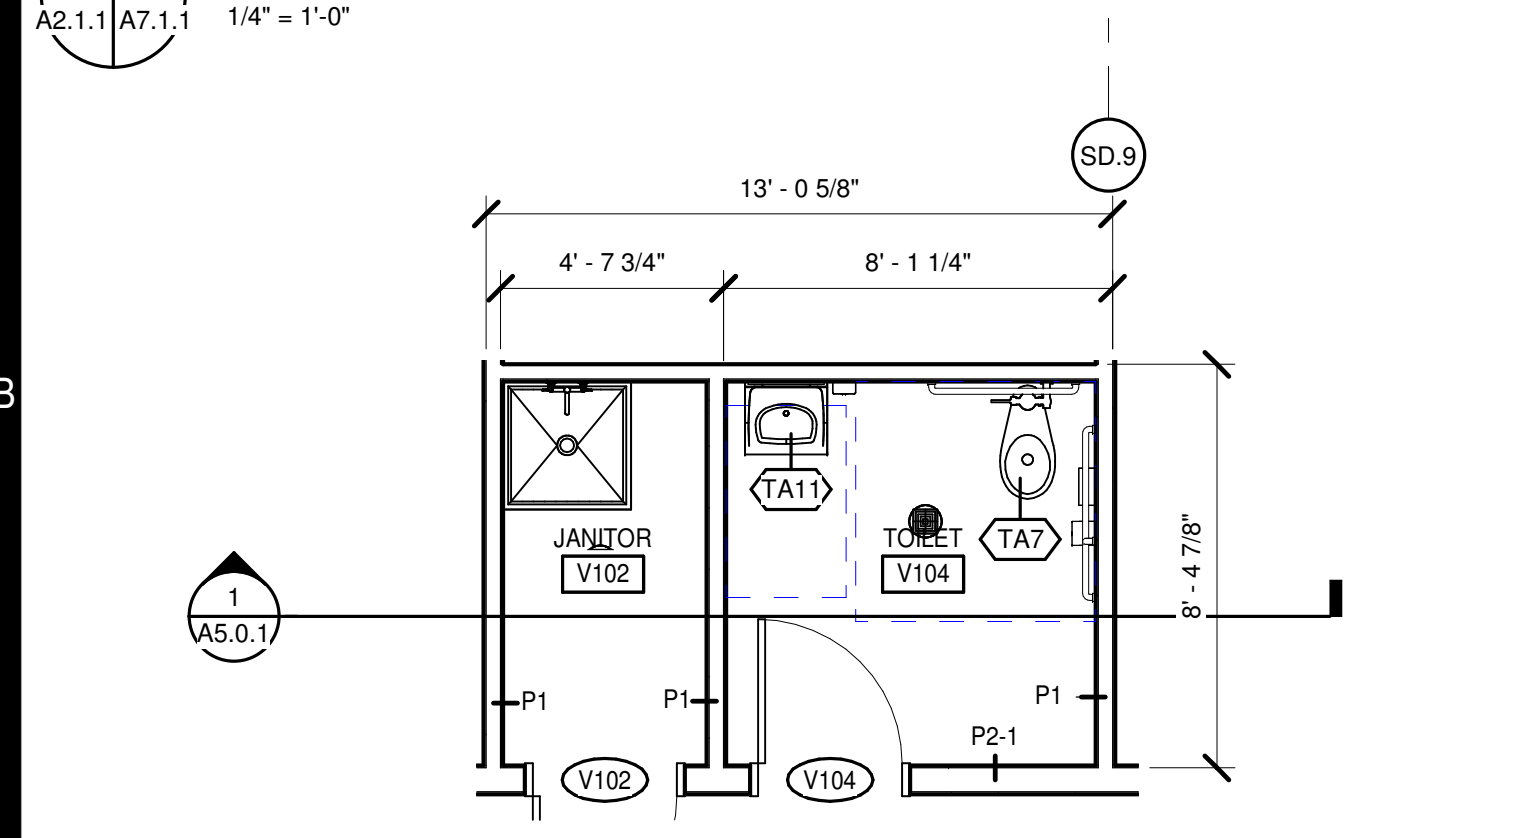


2 ENLARGED PLAN



BATHTUB ELEVATIONS

3/4" = 1'-0"

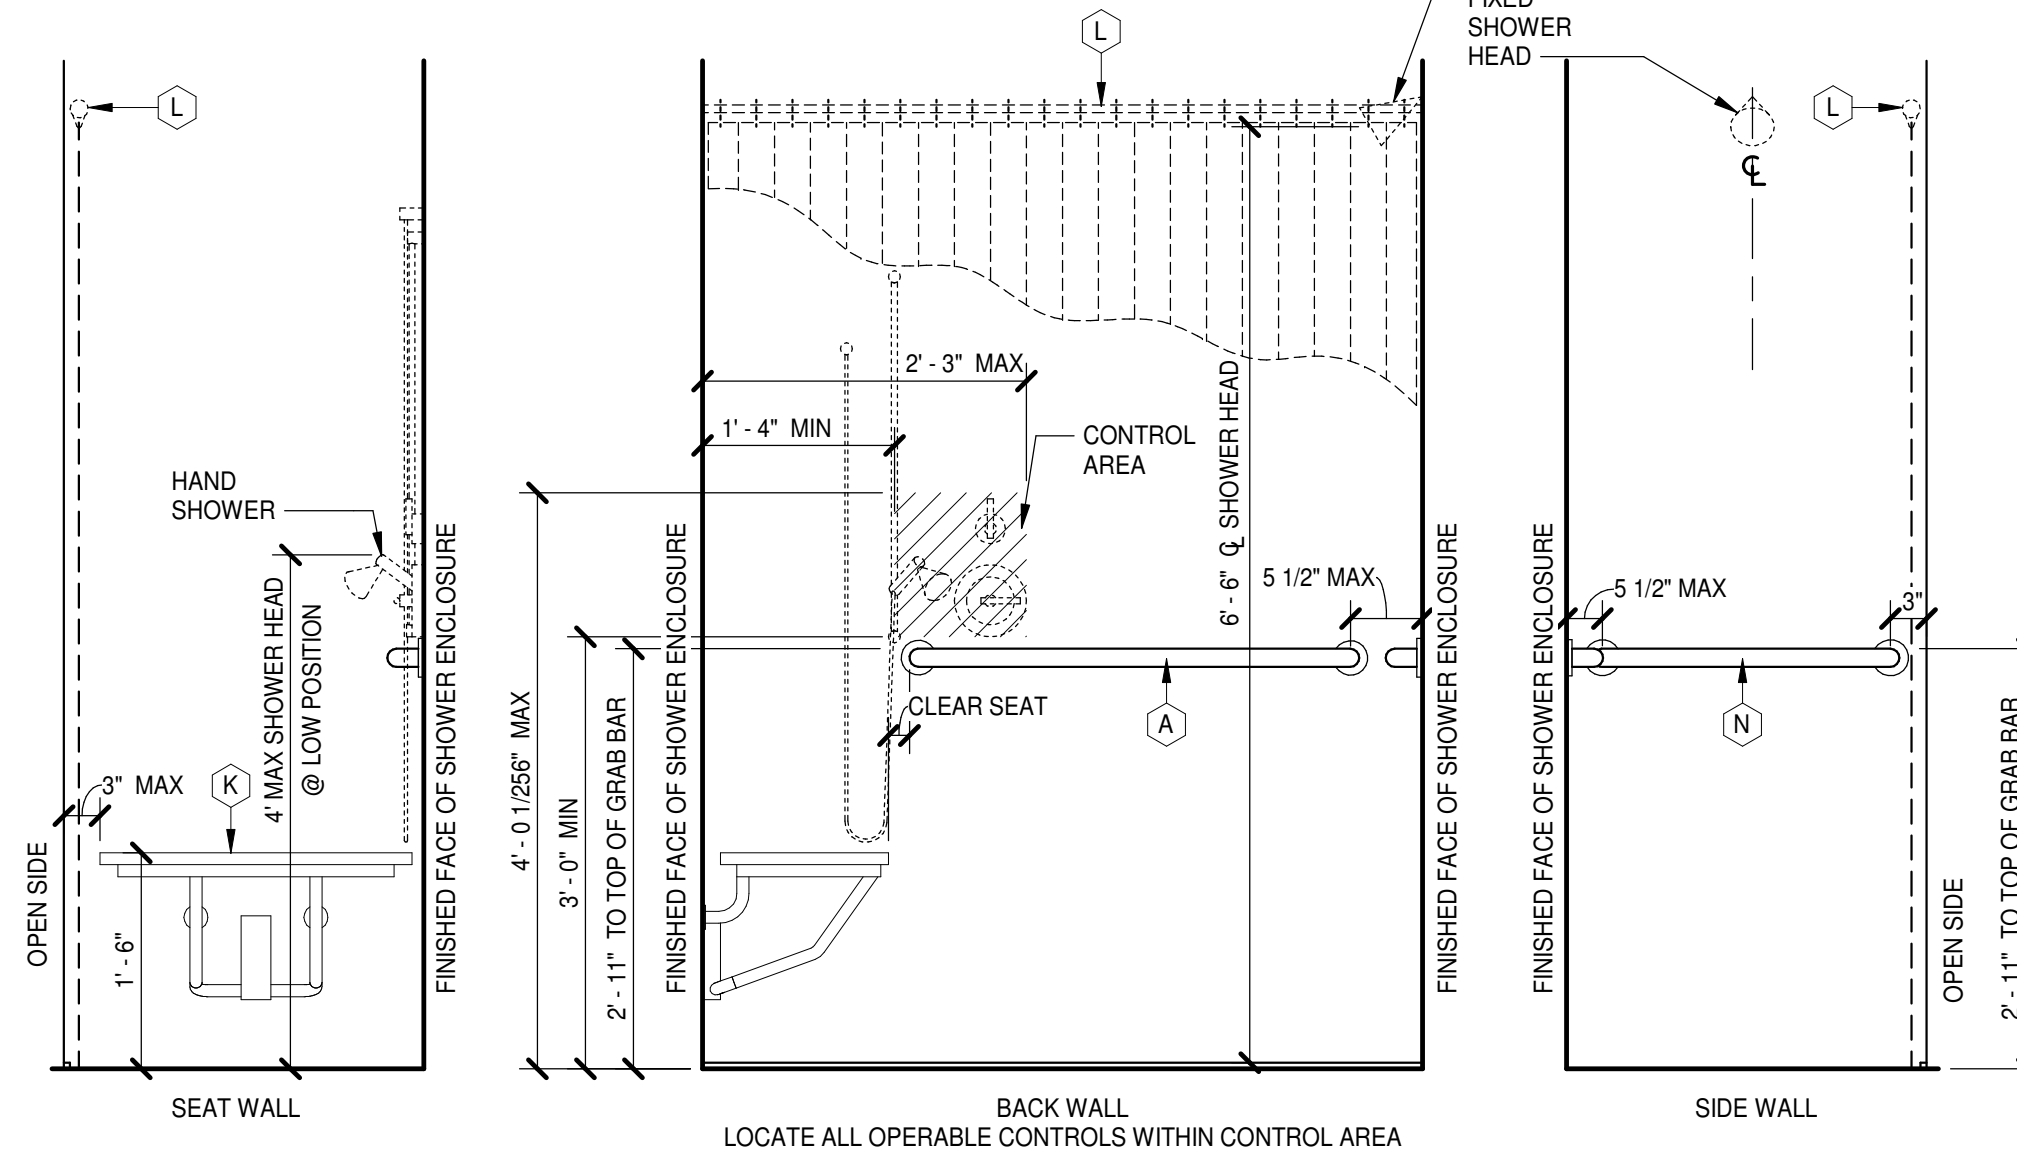

ROLL-IN SHOWER ELEVATIONS

3/4" = 1'-0"



TRANSFER-TYPE SHOWER ELEVATIONS

3/4" = 1'-0"



WATER CLOSET ELEVATIONS

3/4" = 1'-0"



PROJECT NO:	811316
DATE:	FEBRUARY 26, 2024
	REVISIONS
DATE	DESCRIPTION

STRUCTURAL STEEL

- ALL STRUCTURAL STEEL WORK SHALL CONFORM TO THE FOLLOWING AISC DOCUMENTS:
 - ASTM A992 (FY=50 KSI)
 - ASTM A36 (FY=36 KSI)
 - ASTM 360 "SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS"
 - ASTM 303 "CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES"
 - RCSC'S "SPECIFICATION FOR STRUCTURAL JOINTS USING HIGH STRENGTH BOLTS"
 - ASTM 341 "SEISMIC PROVISIONS FOR STRUCTURAL STEEL BUILDINGS"
- STRUCTURAL STEEL SHALL COMPLY WITH THE FOLLOWING SPECIFICATIONS:
 - WIDE FLANGE SHAPES AND ANGLES: ASTM A500, GRADE C (FY=50 KSI)
 - MISCELLANEOUS SHAPES, PLATES & BARS (TO 8" THICK): ASTM A36 (FY=36 KSI)
 - HOLLOW STRUCTURAL SECTIONS (HSS):
 - SQUARE & RECTANGLE: ASTM A500, GRADE C (FY=50 KSI)
 - ROUND: ASTM A500, GRADE C (FY=50 KSI)
 - HIGH STRENGTH BOLTS (CONVENTIONAL): ASTM F436 (FLAT AND BEVELED)
 - WASHERS: ASTM A563
 - HEAVY HEX NUTS: ASTM F1554 GRADE F1554 OR F2280 (TYPE I)
 - TWIST OFF TENSION CONTROL BOLTS: ASTM F1989 (TYPE 325 OR 400)
 - COMPRESSIBLE WASHER DIRECT-TENSION INDICATORS: ASTM F1554, GRADE 55 INCLUDE SUPPLEMENT S1
 - ANCHOR RODS: AWS D1.1 CLAUSE 9, TYPE B (FY=61 KSI)
 - WELDING ELECTRODES: ASTM A51
 - HEADED SHEAR STUDS: AWS D1.1 CLAUSE 9, TYPE B (FY=61 KSI)
 - THREADED ROD: ASTM A36
 - CLEAVES: AISI C-1035, ASTM A666, CLASS A
 - TURNBUCKLES: AISI C-1035, ASTM A666, CLASS C
 - WELDING SHALL BE IN ACCORDANCE WITH AWS D1.1 "STRUCTURAL WELDING CODE - STEEL".
 - WHERE STRUCTURAL STEEL IS EXPOSED BELOW GRADE, PROVIDE MINIMUM 3" CONCRETE COVER OR COAT WITH BITUMINOUS MASTIC.
 - STRUCTURAL STEEL EXPOSED TO WEATHER IN THE FINISHED WORK SHALL BE HOT DIPPED GALVANIZED IN ACCORDANCE WITH ASTM A123, UNLESS NOTED OTHERWISE.

COLD FORMED STEEL FRAMING

- ALL STRUCTURAL COLD FORMED STEEL FRAMING (CFSF) SHALL COMPLY WITH AISI'S "NORTH AMERICAN SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS".
- CFSF-S (STRUCTURAL) INCLUDES ALL EXTERIOR WALLS, SOFFITS, BULKHEADS, TRUSSES, RAFTERS, JOISTS AND CEILING JOISTS (IF SELF-SUPPORTING). PROVIDE ENGINEERING DESIGN OF ALL CFSF-S AND SUBMIT CALCULATIONS, ERECTION DRAWINGS AND DETAIL DRAWINGS SIGNED AND SEALED BY A PROFESSIONAL ENGINEER LICENSED IN THE STATE OF SOUTH CAROLINA. REFER TO SECTION 05400 FOR ADDITIONAL INFORMATION.
- CFSF-NS (NON-STRUCTURAL) INCLUDES INTERIOR NON-LOAD BEARING STUD WALLS AND SUSPENDED CEILING FRAMING SYSTEM. REFER TO SECTION 092216 FOR ADDITIONAL INFORMATION.
- ALL FRAMING MEMBERS, BRIDGING AND ACCESSORIES SHALL BE FORMED FROM STEEL SHEET HAVING A GALVANIZED COATING IN ACCORDANCE WITH ASTM A653.
- ALL C-SHAPED FRAMING MEMBERS SHALL HAVE A MINIMUM FLANGE WIDTH OF 1 5/8 INCHES.
- MINIMUM YIELD STRENGTH SHALL BE AS FOLLOWS:
 - FY = 33,000 PSI 33 MILS AND 43 MILS
 - FY = 50,000 PSI 54 MILS, 59 MILS AND 97 MILS

POST INSTALLED ANCHORS & DOWELS

- INSTALL ALL ANCHORS IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED PROCEDURES AT NOT LESS THAN THE MINIMUM EDGE DISTANCES INDICATED IN THE MANUFACTURER'S LITERATURE. SUBMIT MANUFACTURER'S PRODUCT DATA FOR REVIEW BY THE ARCHITECT.
- ALL ANCHORS (INCLUDING THREADED RODS, NUTS, WASHERS) SHALL BE ZINC PLATED IN ACCORDANCE WITH ASTM B633, FOR SERVICE CONDITION C-1.
- SCREW ANCHORS SHALL BE ONE OF THE FOLLOWING:
 - SCREW-BOLT + BY DEWALT
 - TITEN HD BY SIMPSON STRONG-TIE ANCHORING SYSTEMS
 - KWIK HUS-EZ BY HILTI

- HOLE DIAMETER THROUGH STEEL MEMBER SHALL BE AS REQUIRED BY ANCHOR MANUFACTURER.
- MINIMUM SCREW ANCHOR EMBEDMENTS SHALL BE AS FOLLOWS, UNO:
- 4" EMBEDMENT FOR 1/2" DIAMETER ANCHOR
 - 5" EMBEDMENT FOR 5/8" DIAMETER ANCHOR
 - 6" EMBEDMENT FOR 3/4" DIAMETER ANCHOR
- ADHESIVE DOWELS SHALL CONSIST OF DEFORMED REINFORCING BAR (ASTM A615, GRADE 60) AND ADHESIVE (TYPE PER NOTE A BELOW).
- A "ADHESIVE ANCHORS" OR "ADHESIVE DOWELS" INSTALLED IN SOLID CONCRETE SHALL UTILIZE ONE OF THE FOLLOWING ADHESIVE SYSTEMS, OR APPROVED EQUAL:
 - HYBRID (FAST CURE)
 - AC208+ BY DEWALT
 - ACRYLIC-TIE XP BY SIMPSON STRONG-TIE ANCHORING SYSTEMS
 - HIT-HY 200-V3, BY HILTI
 - EPOXY (SLOW CURE)
 - PURE 110+ BY DEWALT
 - SET-XP BY SIMPSON STRONG-TIE ANCHORING SYSTEMS
 - HIT RE 500-V3 EPOXY ADHESIVE, BY HILTI
- BASIS OF DESIGN INCLUDES THE FOLLOWING DESIGN PARAMETERS:
- CRACKED CONCRETE
 - ALLOWABLE WITH HAMMER-DRILL, HOLLOW DRILL BIT SYSTEM, AND CORE DRILLING METHODS
 - CURRENT ICC-ES REPORT WITH APPROVAL FOR DEVELOPMENT OF BAR USING ACI PROVISIONS FOR EMBEDMENT DEPTHS GREATER THAN 20 BAR DIAMETERS
- INSTALL ANCHORS PER THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS, AS INCLUDED IN THE ANCHOR PACKAGING.
- OVERHEAD ADHESIVE ANCHORS SHALL BE INSTALLED USING A PISTON PLUG SYSTEM.
- ACI0308 ADHESIVE ANCHOR INSTALLER CERTIFICATION IS REQUIRED FOR ALL INSTALLERS OF ADHESIVE ANCHORS IN HORIZONTAL OR UPWARDLY INCLINED ORIENTATION. THE HILTI ADHESIVE ANCHOR INSTALLER CERTIFICATION PROGRAM (HAIICP) IS AN APPROVED EQUIVALENT.
- THE CONTRACTOR SHALL ARRANGE AN ANCHOR MANUFACTURER'S REPRESENTATIVE TO PROVIDE ONSITE INSTALLATION TRAINING FOR ALL ANCHOR PRODUCTS SPECIFIED. THE STRUCTURAL ENGINEER OF RECORD SHALL RECEIVE DOCUMENTED CONFIRMATION THAT ALL PERSONNEL WHO INSTALL ANCHORS ARE TRAINED PRIOR TO THE COMMENCEMENT OF ANCHOR INSTALLATION.
- EXISTING REINFORCING BARS IN THE CONCRETE STRUCTURE MAY CONFLICT WITH SPECIFIC ANCHOR LOCATIONS. UNLESS NOTED ON THE DRAWINGS THAT THE BARS CAN BE CUT, THE CONTRACTOR SHALL REVIEW THE EXISTING STRUCTURAL DRAWINGS AND SHALL UNDERTAKE TO LOCATE THE POSITION OF THE REINFORCING BARS AT THE LOCATIONS OF THE CONCRETE ANCHORS BY GPR, X-RAY, CHIPPING OR OTHER APPROVED METHODS.

ACI 318 LAP LENGTHS

SPLICERS IN THE REINFORCING STEEL SHALL BE ONLY AT THE LOCATIONS SHOWN ON THE STRUCTURAL DRAWINGS. LAP SPLICES SHALL BE IN ACCORDANCE WITH ACI 318 CHAPTER 25 AS INDICATED BELOW. TOP BAR LAP (HORIZONTAL BARS WITH MORE THAN 12" OF CONCRETE CAST BELOW THE BAR) SHALL BE MODIFIED BY A MULTIPLICATION OF 1.3 TIMES THE LENGTHS LISTED IN THE TABLE BELOW. LENGTHS INDICATED IN INCHES.

NORMAL-WEIGHT (145 PCF)		#3	#4	#5	#6	#7	#8	#9
3000	21	28	36	43	62	71	80	
4000	20	26	33	40	58	66	74	
4000	18	25	31	37	54	62	69	
5000	17	22	28	33	48	55	62	

FIBER REINFORCING

- SYNTHETIC MACRO-FIBER MAY BE SUBSTITUTED FOR WELDED WIRE FABRIC IN SLAB-GRADE, AND SHALL CONFORM TO ASTM C1116, TYPE III SYNTHETIC FIBER REINFORCED CONCRETE.
- DOSAGE RATES SHALL BE DETERMINED BY FIBER MANUFACTURER TO PROVIDE FRC EQUIVALENT FLEXURAL STRENGTH (FE,3) EQUAL TO THE PERFORMANCE OF THE REINFORCING STEEL INDICATED FOR EACH SLAB CASE. TESTING SHALL BE PERFORMED IN ACCORDANCE WITH ASTM C1609. DOSAGE SHALL NOT BE LESS THAN 3 LB PER CU YD IN ANY CASE.
- FIBER SHALL BE ADDED AT THE CONCRETE BATCH PLANT.
- FIBER SHALL BE INCLUDED IN THE CONCRETE MIX DESIGNS SUBMITTED FOR REVIEW.

FLOWABLE FILL

- CONTROLLED LOW STRENGTH MATERIAL (CLSM), ALSO REFERRED TO AS FLOWABLE FILL, MAY BE SUBMITTED FOR APPROVAL AS A SUBSTITUTE FOR COMPACTED FILL AT FOUNDATION UNDERCUT LOCATIONS. THE CLSM MIXTURE SHALL BE PROPORTIONED TO PRODUCE AN UNCONFINED COMPRESSIVE STRENGTH OF 100 PSI MINIMUM TO 300 PSI MAXIMUM.

GENERAL

- ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE SOUTH CAROLINA BUILDING CODE (SCBC, 2021 EDITION), EFFECTIVE JANUARY 1, 2023.
- THE STRUCTURAL DRAWINGS ARE INTENDED TO BE USED IN CONJUNCTION WITH THE ARCHITECTURAL DRAWINGS AND THE DRAWINGS OF THE OTHER ENGINEERING DISCIPLINES.
- THE CONTRACT DOCUMENTS ARE COMPLEMENTARY AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL. IN THE CASE OF A CONFLICT, DISAGREEMENT, OR AMBIGUITY, PROVIDE THE GREATER QUANTITY OF WORK.
- VERIFY AND COORDINATE MECHANICAL UNIT SUPPORTS AND OPENINGS WITH EQUIPMENT PURCHASED FOR THE PROJECT. COORDINATE REQUIREMENTS FOR SLEEVES, HANGERS, INSERTS, ANCHORS AND ALL OTHER ITEMS TO BE SET IN STRUCTURAL WORK.
- SPECIAL INSPECTIONS ARE REQUIRED BY THE SCBC, SECTION 1704. REFER TO THE STATEMENT OF SPECIAL INSPECTIONS PREPARED FOR THIS PROJECT AND THE PROJECT SPECIFICATIONS FOR SPECIFIC INSPECTION REQUIREMENTS. REFER TO SPECIFICATION SECTION 014000 FOR GENERAL INSPECTION REQUIREMENTS. SPECIAL INSPECTOR SHALL SUBMIT INSPECTION REPORTS IN COMPLIANCE WITH BC SECTION 1704.2.4. USE OF "GENERAL CONFORMANCE" OR "GENERAL ACCORDANCE" IS UNACCEPTABLE.
- CONTRACTOR SHALL CONDUCT PRE-INSTALL MEETINGS ON PROJECT SITE PRIOR TO COMMENCEMENT OF WORK. REFER TO PROJECT SPECIFICATIONS FOR SPECIFIC REQUIREMENTS. GENERAL CONTRACTOR WILL CONDUCT THE MEETING AND SHALL BE RESPONSIBLE FOR THE ATTENDANCE OF ALL REQUIRED TRADES AND SUBCONTRACTORS INCLUDING THE SPECIAL INSPECTOR.

FOUNDATIONS

- FOUNDATIONS ARE DESIGNED TO BEAR ON CONTROLLED COMPACTED FILL WITH AN ALLOWABLE BEARING CAPACITY OF 2,000 PSF. FOUNDATION DESIGN CRITERIA IS IN ACCORDANCE WITH THE GEOTECHNICAL ENGINEERING REPORT PREPARED BY S&ME, INC. DATED JANUARY 31, 2024.
- THE GEOTECHNICAL ENGINEER FOR THE OWNERS TESTING AGENCY SHALL VERIFY BEARING CAPACITY AND SUITABILITY OF SUBGRADE PRIOR TO PLACING FOUNDATIONS AND GRADE SLABS.
- SELECT AND PLACE CONTROLLED COMPACTED FILL UNDER DIRECT SUPERVISION OF THE GEOTECHNICAL ENGINEER FOR THE OWNERS TESTING AGENCY.
- COORDINATE TOP OF FOOTING ELEVATIONS WITH ACTUAL LOCATION, SIZE AND INVERT OF ALL UNDERGROUND PIPE (AND CONDUIT), IF UNDERGROUND PIPE (AND CONDUIT) MUST CROSS FOOTING, TOP OF FOOTING ELEVATION SHALL ALLOW UNDERSLAB PIPING TO PASS ABOVE THE FOOTING.
- AVOID INFLUENCE OF PIPE TRENCH ADJACENT TO COLUMN FOOTING. REFER TO "FOOTING EXCAVATION LIMITS".
- PROTECT FOOTINGS AND GRADE SLABS FROM FROST HEAVE UNTIL BUILDING IS PERMANENTLY ENCLOSED.

CONCRETE

- ALL CONCRETE WORK SHALL CONFORM TO THE REQUIREMENTS OF ACI 318 "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE" AND ACI 301 "STANDARD SPECIFICATIONS FOR STRUCTURAL CONCRETE".
- CONCRETE SHALL BE NORMAL WEIGHT AND SHALL OBTAIN ULTIMATE 28 DAY COMPRESSIVE STRENGTHS (F'c) AS FOLLOWS:


BUILDING ELEMENT	DURABILITY REQUIREMENTS CATEGORIES AND CLASSES (NOTE 3)	F'c (psi) 28 DAY STRENGTH (NOTE 4)	MAX W/C (NOTE 4)	AIR ENTRAINMENT (NOTE 5)	UNIT WEIGHT PCF (NOTE 6)	MAX AGGREGATE (NOTE 7 & 8)	CEMENT (ASTM C150)	CL % (NOTE 10)
SPREAD FOOTINGS AND WALL FOOTINGS	F0 S0 W0 C1	3,500	0.55	4.5	145	1 1/2"	II	0.30
INTERIOR SLABS ON GRADE	F0 S0 W0 C0	3,500	0.50	N/A	145	3/4"	I/II	0.30
INTERIOR COLUMNS, WALLS AND PIERS	F1 S0 W0 C1	4,000	0.50	5.0	145	3/4"	I/II	0.30
EXTERIOR SLABS ON GRADE	F1 S0 W1 C1	3,500	0.55	5.0	145	3/4"	I/II	0.30
EXTERIOR COLUMNS, WALLS AND PIERS	F1 S0 W1 C1	4,000	0.50	6.0	145	3/4"	I/II	0.30
TIE BEAMS	F1 S0 W0 C1	4,000	0.50	N/A	145	3/4"	I/II	0.30
- CONCRETE MIXTURE PROPORTIONS SHALL BE ESTABLISHED IN ACCORDANCE WITH ARTICLE 4.2.3 OF ACI 301 OR BY AN ALTERNATIVE METHOD ACCEPTABLE TO THE ENGINEER OF RECORD. EACH MIX DESIGN SHALL IDENTIFY THE INTENDED LOCATION OF USE.
- MINIMUM CONCRETE COVER OVER REINFORCING SHALL BE UNO:

	UNFORMED SURFACE CAST AGAINST EARTH	FORMED SURFACE EXPOSED TO EARTH/WEATHER	FORMED SLABS AND WALLS NOT EXPOSED TO EARTH/WEATHER FOR #11 AND SMALLER BAR	ALL OTHER FORMED ELEMENTS NOT EXPOSED TO EARTH/WEATHER
A	3 IN	2 IN	3/4 IN	1 1/2 IN


DESIGN LOAD DATA

CLASSIFICATION OF BUILDING RISK CATEGORY (2021 SCBC TABLE 1604.5)	II		
2. FLOOR LIVE LOADS	UNIFORM	CONCENTRATED	
			OFFICE CLASSROOM: 50 PSF (2000 LB) MAINTENANCE / SHOP MECHANICAL / ELECTRICAL ROOM: 100 PSF (2000 LB) 150 PSF
3. ROOF LIVE LOADS			CONCENTRATED LOAD APPLIED OVER 2'-6" x 2'-6" AREA. REDUCTION OF FLOOR LIVE LOAD HAS NOT BEEN UTILIZED.
	MINIMUM ROOF LIVE LOAD	20 PSF	300 LB
			CONCENTRATED LOAD APPLIED OVER 2'-6" x 2'-6" AREA. REDUCTION OF MINIMUM ROOF LIVE LOAD HAS NOT BEEN UTILIZED.
4. ROOF SNOW LOAD			
	GROUND SNOW LOAD (Pg)	5 PSF	
	IMPORTANCE FACTOR (Is)	1.0	
	MECHANICAL EXPOSURE	1.0	
	EXPOSURE THERMAL FACTOR (Ce)	1.0	
	FLAT ROOF SNOW LOAD (Pp) = 0.7 x Ce x Cr x Is x Pg	3.5 PSF	
	MINIMUM P1 FOR Pp = 20 PSF OR LESS	5 PSF	
	Pp min = 1 x Pg	3.5 PSF	
	SLOPED ROOF SNOW LOAD (Ps = Cs x Pp)		
5. WIND DESIGN DATA			ULTIMATE DESIGN WIND SPEED (3 SECOND GUST): 145 MPH NOMINAL DESIGN WIND SPEED (3 SECOND GUST): 112 MPH
			C: ±0.18 (ENCLOSED) C: ±0.18 (ENCLOSED) C: ±0.18 (ENCLOSED) REFER TO DRAWING S0.0.2 (PER ABC & ASCE7)
6. SEISMIC DESIGN DATA			
	SEISMIC DESIGN CATEGORY	D	
	SEISMIC IMPORTANCE FACTOR (Ie)	1.0	
	SITE CLASS	D	
	MAPPED SPECTRAL RESPONSE ACCELERATIONS (Sa)	0.475	
	(Ss)	0.158	
	DESIGN SPECTRAL RESPONSE ACCELERATIONS (Sd)	0.45	
	(Sd1)	0.24	
	(Sd2)	0.45	
	(Sd3)	0.24	
	BASIC SEISMIC FORCE RESISTING SYSTEM:	C. MOMENT-RESISTING FRAME SYSTEMS	
		4. STEEL ORDINARY MOMENT FRAMES	
	RESPONSE MODIFICATION COEFFICIENT (R)	3.5	
	SYSTEM OVERSTRENGTH FACTOR	3.0	
	DEFLECTION AMPLIFICATION FACTOR	3.0	
	SEISMIC RESPONSE COEFFICIENT (Ca)	0.125	
	DESIGN BASE SHEAR (V = Cs x V)	0.125W	
	ANALYSIS PROCEDURE	EQUIVALENT LATERAL FORCE PROCEDURE	

LEGEND FOR SECTION AND DETAIL MARKS

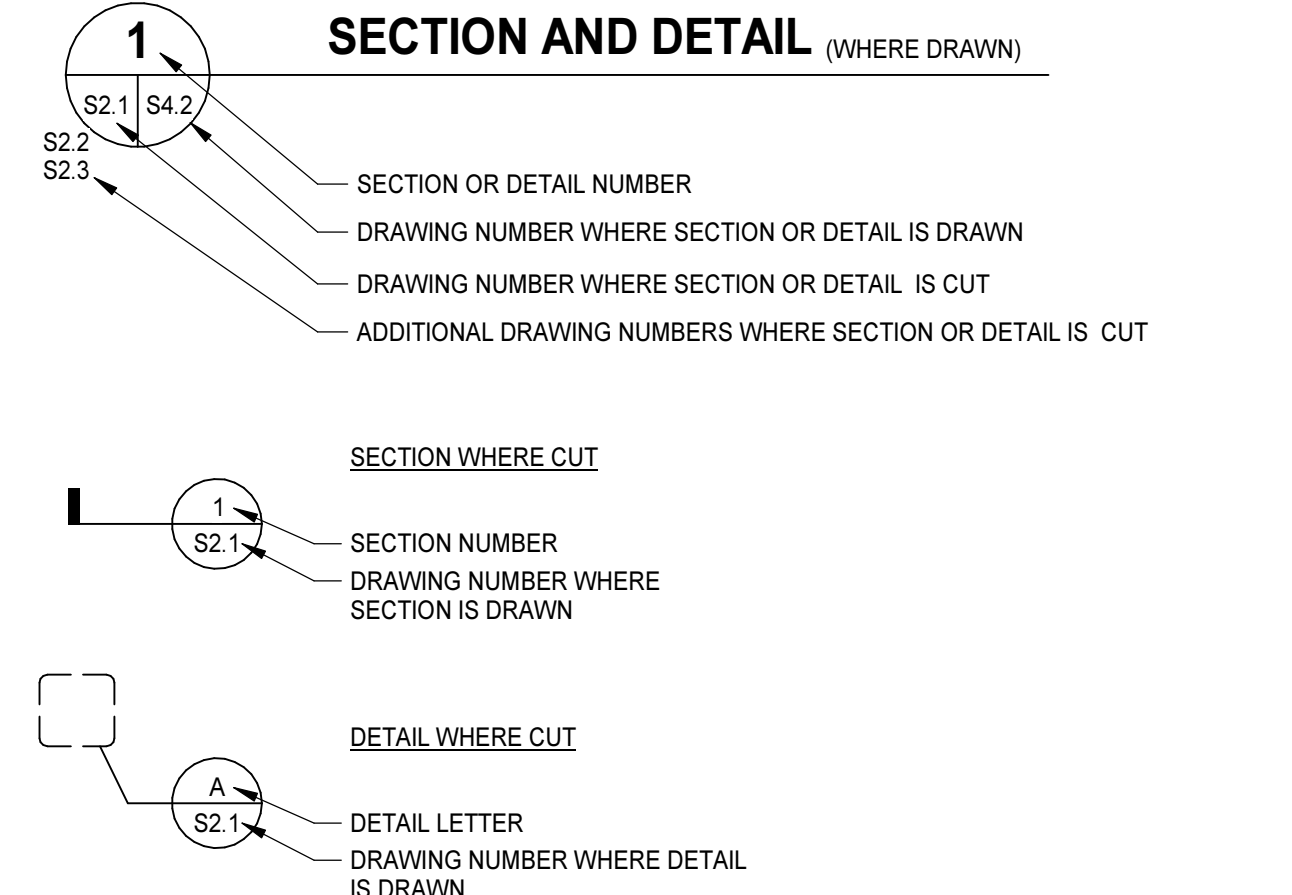

STRUCTURAL MATERIALS LEGEND

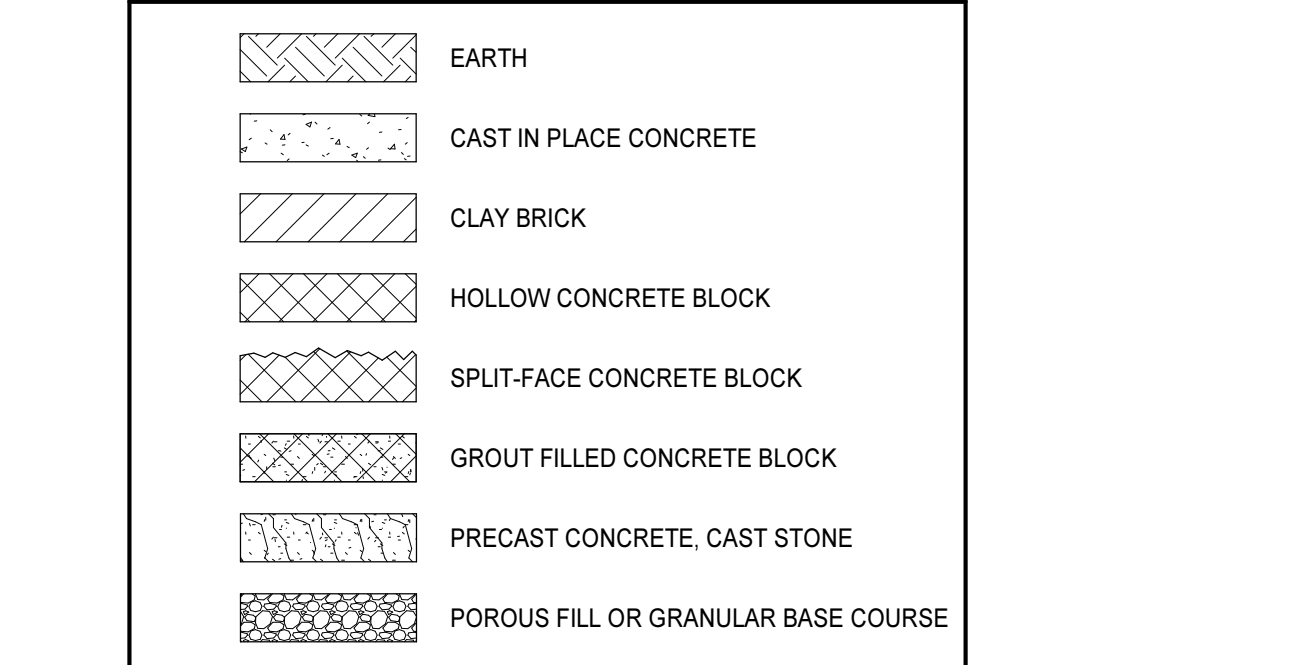

STRUCTURAL ABBREVIATIONS

AB	ANCHOR BOLT	HSS	HOLLOW STRUCTURAL SECTION
AESS	ARCHITECTURALLY EXPOSED STRUCTURAL STEEL	HT	HEIGHT
AFF	ABOVE FINISHED FLOOR	IN	INCH
ALUM	ALUMINUM	INFO	INFORMATION
APPROX	APPROXIMATE	INT	INTERIOR
ARCH	ARCHITECTURAL ARCHITECT	JBE	JOIST BEARING ELEVATION
AVG	AVERAGE	JS	JOIST SUBSTITUTE
BLDG	BUILDING	JST	JOIST
BM	BEAM	JT	JOINT
BMC	BUILDING MOUNTED CANOPES	K	KIP
BOT	BOTTOM	LBS	POUNDS
BRG	BEARING	LF	LINEAR FEET (FOOT)
BTWN	BETWEEN	LLH	LONG LEG HORIZONTAL
CANT	CANTILEVER	LLV	LONG LEG VERTICAL
CFSF	COLD FORMED STEEL FRAMING	M	METERS
CIP	CAST IN PLACE	MAS	MASONRY
CJ	CONTROL JOINT	MATL	MATERIAL
CLG	CEILING	MAX	MAXIMUM
CLR	CLEAR	MBMA	METAL BUILDING MANUFACTURERS ASSOC
CMU	CONCRETE MASONRY UNIT		
COL	COLUMN	MBS	METAL BUILDING SYSTEM
CONC	CONCRETE	MECH	MECHANICAL
CONN	CONNECTION	MFR	MANUFACTURER
CONSTR	CONSTRUCTION	MIN	MINIMUM
CONT	CONTINUOUS	MM	MILLIMETER(S)
CTR	CENTER	NOM	NOMINAL
DBA	DEFORMED BAR ANCHOR	NS	NON SHRINK
DBL	DOUBLE	OC	ON CENTER
DA	DIAMETER	OD	OUTSIDE DIAMETER
DIAG	DIAGONAL	OCFI	OWNER FURNISHED CONTRACTOR INSTALLED
DIM	DIENSION		
DN	DOWN	OPNG	OPENING
DWG	DRAWING	OPST	OPPOSITE
EA	EACH	PAF	POWDERACTUATED FASTENERS
EJ	EACH FACE	PC CONC	PRECAST CONCRETE
EF	EXPANSION JOINT	PEMB	PRE-ENGINEERED METAL BUILDING
EL	ELEVATION	PFCB	PRE-FABRICATED BUILDING COLUMN
ELECT	ELECTRICAL	PLF	POUNDS PER LINEAR FOOT
ELEV	ELEVATION	POLY	POLYETHYLENE
EOD	EDGE OF DECK	PPT	PRESSURE PRESERVATIVE TREATED
EOS	EDGE OF SLAB	PSF	POUNDS PER SQUARE FOOT
EQ	EQUAL	PTFE	POLY-TETRAFLUOROETHYLENE
EW	EACH WAY	R	RADIUS
EX	EXISTING	RD	ROOF DRAIN
EXP	EXPANSION	REF	REFERENCE
EXT	EXTERIOR	REINF	REINFORCING, REINFORCED
FB	FIXED BASE	REQD	REQUIRED
FD	FLOOR DRAIN	SIM	SIMILAR
FDN	FOUNDATION	SL	SLOPE
FF	FINISHED FLOOR	SOG	SLAB ON GRADE
FN	FINISHED	SPA	SPACES
FLR	FLOOR	SS	STAINLESS STEEL
F0B	FACE OF BRICK	STD	STANDARD
F0C	FACE OF CONCRETE	STIF	STIFFENER
F0M	FACE OF MASONRY	STRUCT	STRUCTURAL
FRMG	FRAMING	SUSP	SUSPENDED
FRG	FIRE RETARDANT TREATED	SYM	SYMMETRY(RICAL)
FT	FOOT	T&B	TOP AND BOTTOM
FTT	FOOTING	T&G	TONGUE AND GROOVE
GA	GAGE	TF	TRANSFER FORCE
GALV	GALVANIZED	TOC	TOP OF CONCRETE
GB	GRADE	TOS	TOP OF STEEL
GC	GENERAL CONTRACTOR	TOSL	TOP OF SLAB
GRD	GRADE	TOW	TOP OF WALL
HD	HEADED	TYP	TYPICAL
HK	HOOK	UNO	UNLESS NOTED OTHERWISE
HORIZ	HORIZONTAL	VB	VAPOR BARRIER
HS	HIGH STRENGTH	VERT	VERTICAL
		VR	VAPOR RETARDER
		WP	WORK POINT
		WWF	WELDED WIRE FABRIC

PLAN LEGEND

CL	CENTERLINE
JBE (+X'X')	JOIST BEARING ELEVATION
BP1, BP2 ...	BEAM BEARING PLATE
BP1-A, BP-B ...	COLUMN BASE PLATE
H1, H2 ...	WOOD HEADER
J1, J2 ...	WOOD JOIST
T-1, T-2 ...	TRUSS
WP1, WP2 ...	WOOD POST
P-1, P-2 ...	CONCRETE PIER
JS	JOIST SUBSTITUTE
KCS	CONSTANT SHEAR JOIST
SP	SPECIAL JOIST
	WALL FOOTING STEP
(-X'X')	TOP OF FOOTING ELEVATION
WP +	WORK POINT
(+X'X')	TOP OF SLAB ELEVATION
L1, L2 ...	LINTEL
(XX)	COLUMN FOOTING
(+X'X')	TOP OF STEEL BEAM ELEVATION
(J)	INDICATES TOP OF STRUCTURAL MEMBER SHALL BE IN SAME PLANE AS TOP OF JOIST
(SL)	INDICATES TOP OF STRUCTURAL MEMBER SHALL BE SLOPED
WFX	WALL FOOTING
	THICKENED SLAB
*	STEEL JOIST BOTTOM CHORD EXTENSION, WELDED
▶	STEEL BEAM MOMENT CONNECTION
(EX)	EXISTING
TF	TRANSFER FORCE
#6@45"	CMU WALL REINFORCING SIZE AND SPACING
	CHANGE IN SLAB ELEVATION
TCX	TOP CHORD EXTENSION

COMPONENTS AND CLADDING DESIGN PRESSURE (ULTIMATE DESIGN PSF)

ZONE	AREA ≤ 10 FT ²	AREA ≤ 25 FT ²	AREA ≤ 50 FT ²	AREA ≤ 100 FT ²
1	43 PSF / -101 PSF	40 PSF / -93 PSF	37 PSF / -88 PSF	34 PSF / -82 PSF
2	43 PSF / -141 PSF	40 PSF / -119 PSF	37 PSF / -101 PSF	34 PSF / -84 PSF
3	43 PSF / -165 PSF	40 PSF / -136 PSF	37 PSF / -115 PSF	34 PSF / -94 PSF
4	58 PSF / -61 PSF	55 PSF / -59 PSF	53 PSF / -57 PSF	52 PSF / -55 PSF
5	58 PSF / -72 PSF	55 PSF / -67 PSF	53 PSF / -63 PSF	52 PSF / -60 PSF

COMPONENTS AND CLADDING ROOF WIND PRESSURE DIAGRAM NOTES:

- PRESSURE INDICATED ARE FOR ALLOWABLE STRESS DESIGN PER ASCE 7-16.
- EFFECTIVE WIND AREA SHALL BE DETERMINED IN ACCORDANCE WITH ASCE 7-16.
- REDUCTION FACTORS FOR EFFECTIVE WIND AREAS ARE ALLOWED AS DEFINED BY TABLE 30.6.2 OF ASCE 7-16.
- ROOF ZONE 1, UNLESS OTHERWISE INDICATED.
- ZONE 2 INDICATED BY:
- ZONE 3 INDICATED BY:
- INTERIOR REGIONS OF WALLS ARE ZONE 4 AND CORNER REGIONS OF WALLS ARE ZONE 5.
- (+) INDICATES PRESS

Inspections & Testing	Continuous	Periodic	Y/N	Reference Standard or Compliance Document	Agent
Inspection Agents					
1. Special Inspector of Record (SIOR)					
2. Structural Engineer of Record (SEOR) Moseley Architects					
3. Steel Fabricator's Quality Control Inspector					
4. Structural Observer					
Inspection Agents					
O - Observe - The inspector shall observe these items on a regular basis					
P - Perform - These tasks shall be performed for each welded or bolted joint.					
1704.2.4 Report Requirement					
Special Inspector to keep record of special inspections and furnish inspection reports to the building official and to the Registered Design Professional in Responsible Charge	●		Y	IBC 1704.2.4	1
1704.2.5 Inspection of Fabricated Items					
Work done in fabricator shop requires special inspection unless the fabricator is registered and approved in accordance with 1704.2.5.1. Where fabricator is approved, provide fabricator certification document.	●		Y	1704.2.5	1, 3
At completion of fabrication, submit certificate of compliance to building official stating the work was performed in accordance with the approved construction documents.	●		Y	1704.2.5.1	1
1704.4 Contractor Responsibility					
Each contractor responsible for the construction of a main wind- or seismic force resisting system, designated seismic system or a wind- or seismic-resisting component listed in the statement of special inspections shall submit a written statement of responsibility.	●		Y	1704.4	
1704.5 Submittals to the Building Official					
Certificates of compliance for the fabrication of structural, load-bearing or lateral load-resisting members or assemblies on the premises of a registered and approved fabricator in accordance with 1704.2.5.1	●		Y	1704.5 1704.2.5.1	2, 3
Certificates of compliance for the seismic qualification of nonstructural components, supports and attachments in accordance with Section 1705.14.2	●		Y	1704.5 1705.14.2	2, 3
Certificates of compliance for designated seismic systems in accordance with Section 1705.14.3	●		Y	1704.5 1705.14.3	2, 3
Reports of preconstruction tests for shotcrete in accordance with ACI 318	●		N	1704.5 ACI 318	1, 2
Certificates of compliance for open web steel joists and joist girders in accordance with Section 2207.5	●		N	1704.5 2207.5	2, 3
Reports of material properties verifying compliance with the requirements of AWS D1.4 for weldability as specified in Section 26.6.4, of ACI 318 for reinforcing bars in concrete complying with a standard other than ASTM A 706 that are to be welded.	●		Y	1704.5 AWS D1.4 26.6.4 of ACI 318 ASTM A 706	1, 2
Reports of mill tests in accordance with Section 20.2.2.5 of ACI 318 for reinforcing bars complying with ASTM A 615 and used to resist earthquake-induced flexural or axial forces in the special moment frames, special structural walls or coupling beams connecting special structural walls of seismic force-resisting systems in structures assigned to Seismic Design Category B, C, D, E, or F.	●		N	1704.5 20.2.2.5 of ACI 318 ASTM A 615	2, 3
1704.6 Structural Observation					
The owner shall employ a registered design professional to perform structural observations. Prior to commencement of observation, the structural observer shall submit to the building official a written statement identifying frequency and extent of structural observations.					
1. Structural observations for structures	●		N	1704.6.1	4
Inspections & Testing					
1705.2 Steel Construction					
Structural Steel inspections and non-destructive testing shall be in accordance with the quality assurance inspection requirements of AISC 360-16				1705.2.1 AISC 360-16	
QC inspection tasks shall be performed by fabricator's or erector's Quality Control Inspector (Agent 3), as applicable, in accordance with sections NS.4, NS.6, and NS.7.					
QA inspection tasks shall be performed by the Quality Assurance Inspector (Agent 1), in accordance with sections NS.4, NS.6, and NS.7.					
Prior to Welding (AISC 360-16 Table NS.4-1)					
Welder qualification records and continuity records					P O
Welding procedure specifications (WPSs) available					P P
Manufacturer certifications for welding consumables					P P
Material identification (type/grade)					O O
Welder identification system					O O
Fit-up of groove welds (including joint geometry)					O O
a. Joint preparation					
b. Dimensions (alignment, root opening, root face, bevel)					
c. Cleanliness (condition of steel surfaces)					
d. Tacking (tack weld quality and location)					
e. Backing type and fit (if applicable)					
Configuration and finish of access holes					O O
Fit-up of fillet welds					O O
a. Dimensions (alignment, gaps at root)					
b. Cleanliness (condition of steel surfaces)					
c. Tacking (tack weld quality and location)					
Check welding equipment					O -
During Welding (AISC 360-16 Table NS.4-2)					
Control and handling of welding consumables					O O
a. Packaging					
b. Exposure control					
No welding over cracked tack welds					O O
Environmental conditions					O O
a. Wind speed within limits					
b. Precipitation and temperature					
WPS followed					O O
a. Settings on welding equipment					
b. Travel speed					
c. Selected welding materials					
d. Shielding gas type/flow rate					
e. Preheat applied					
f. Interpass temperature maintained (min. max.)					
g. Proper position (F, V, H, OH)					
Welding techniques					O O
a. Interpass and final cleaning					
b. Each pass within profile limitations					
c. Each pass meets quality requirements					
Placement and installation of steel headed stud anchors					P P

Inspections & Testing	Reference Standard or Compliance Document	Agent
After Welding (AISC 360-16 Table NS.4-3)		
Welds cleaned		QC O
Size, length and location of welds		P P
Welds meet visual acceptance criteria		P P
a. Crack prohibition		
b. Weld/base-metal fusion		
c. Crater cross section		
d. Weld profiles		
e. Weld size		
f. Undercut		
g. Porosity		
Arc strikes		P P
k-area		P P
Weld across holes in rolled heavy shapes and built-up heavy shapes		P P
Backing removed and weld tabs removed (if required)		P P
Repair activities		P P
Document acceptance or rejection of welded joint or member		P P
No prohibited welds have been added without the approval of the EOR		O O
Nondestructive Testing (AISC 360-16 Section NS.5)		
Risk Category II Structures - Perform Ultrasonic Testing on 10% of CJP groove welds or butt, T- and corner joints subject to transversely applied tension loading, in materials 5/16 in. thick or greater.		P P
Risk Category III or IV Structures - Perform Ultrasonic Testing on all CJP groove welds subject to transversely applied tension loading in butt, T- and corner joints, in materials 5/16 in. thick or greater.		P P
Access Holes - Perform Magnetic Particle Testing or Liquid Penetrant Testing when the flange thickness exceeds 2 in. for rolled shapes, or when the web thickness exceeds 2 in. for built-up shapes.		P P
Welded Joints Subject to Fatigue		P P
Prior to Welding (AISC 341-16 Table J6.1)		
Visual inspection tasks prior to welding		QC QA
Material identification (type/grade)		O O
Welder identification system		O O
Fit-up of groove welds (including joint geometry)		
a. Joint preparation		
b. Dimensions (alignment, root opening, root face, bevel)		P/O*
c. Cleanliness (condition of steel surfaces)		
d. Tacking (tack weld quality and location)		
e. Backing type and fit (if applicable)		
Configuration and finish of access holes		O O
Fit-up of fillet welds		
a. Dimensions (alignment, gaps at root)		
b. Cleanliness (condition of steel surfaces)		P/O*
c. Tacking (tack weld quality and location)		
*Following performance of this inspection task for ten welds to be made by a given welder, with the welder demonstrating understanding of requirements and possession of skills and tools to verify these items, the Perform designation of this task shall be reduced to Observe, and the welder shall perform this task. Should the inspector determine that the welder has discontinued performance of this task, the task shall be returned to Perform until such time as the inspector has re-established adequate assurance that the welder will perform the inspection tasks listed.		
During Welding (AISC 341-16 Table J6.2)		
Visual inspection tasks during welding		QC QA
WPS followed		
a. Settings on welding equipment		
b. Travel speed		
c. Selected welding materials		
d. Shielding gas type/flow rate		O O
e. Preheat applied		
f. Interpass temperature maintained (min. max.)		
g. Proper position (F, V, H, OH)		
h. Intermix of filler metals avoided unless approved		
Use of qualified welders		O O
Control and handling of welding consumables		
a. Packaging		O O
b. Exposure control		
Environmental conditions		O O
a. Wind speed within limits		
b. Precipitation and temperature		
Welding techniques		O O
a. Interpass and final cleaning		
b. Each pass within profile limitations		
c. Each pass meets quality requirements		
No welding over cracked tack welds		O O
After Welding (AISC 341-16 Table J6.3)		
Visual inspection tasks after welding		QC QA
Welds cleaned		O O
Size, length and location of welds		P P
Welds meet visual acceptance criteria		
a. Crack prohibition		
b. Weld/base-metal fusion		
c. Crater cross section		P P
d. Weld profiles		
e. Weld size		
f. Undercut		
g. Porosity		P P
*k-area		P P
Placement of reinforcing or contouring fillet welds (if required)		P P
Backing removed, weld tabs removed and finished, and fillet welds added (if required)		P P
Repair activities		P P
*When welding doubler plates, continuity plates, or stiffeners has been performed in the k-area, visually inspect web k-area for cracks within 3 in. (75 mm) of the weld. The visual inspection shall be performed no sooner than 48 hours following completion of the welding.		
Prior to Bolting (AISC 360-16 Table NS.6-1)		
Manufacturer's certifications available for fastener materials		O O
Fasteners marked in accordance with ASTM requirements		O O
Correct fasteners selected for the joint detail (grade, type, bolt length if threads are to be excluded from shear plane)		O O
Correct bolting procedure selected for joint detail		O O
Connecting elements, including the appropriate faying surface condition and hole preparation, if specified, meet applicable requirements		O O
Pre-installation verification testing by installation personnel observed and documented for fastener assemblies and methods used (Not required for Snug Tight bolts)		P O
Protected storage provided for bolts, nuts, washers and other fastener components		O O

Inspections & Testing	Reference Standard or Compliance Document	Agent
During Bolting (AISC 360-16 Table NS.6-2)		
These inspections are not required for snug-tight joints.		QC QA
These inspections are not required for prestressed joints and slipcritical joints, when the installer is using the turn-of-nut method with matching techniques, the direct-tension-indicator method, or the twist-off-type tension control bolt method.		
Fastener assemblies, placed in all holes and washers and nuts are positioned as required		O O
Joint brought to the snug-tight condition prior to the prestressing operation		O O
Fastener component not turned by the wrench prevented from rotating		O O
Fasteners are prestensioned in accordance with the RCSC Specification, progressing systematically from the most rigid point toward the free edges		O O
After Bolting (AISC 360-16 Table NS.6-3)		
Document acceptance or rejection of bolted connections		P P
Other Inspection Tasks (AISC 360-16 Section NS.8)		
Verify compliance of fabricated steel with the details shown on the approved shop drawings		P
Verify compliance of the erected steel frame with the field installed details shown on the approved erection drawings, including braces, stiffeners, member locations and joint details.		P
Anchor rods and other embedment supporting structural steel		P
a. Verify the diameter, grade, type and length of the anchor rod or embedded item		P
b. Verify the extent or depth of embedment into the concrete.		P
Reduced Beam Sections (RBS) requirements, if applicable (ref. AISC 341-16)		P
a. Contour and finish		P
b. Dimensional tolerances		P
Protected zone—no holes and unapproved attachments made by fabricator or erector, as applicable (ref. AISC 341-16)		P
H-piles - Protected zone—no holes and unapproved attachments made by the responsible contractor, as applicable (ref. AISC 341-16)		P
Inspections & Testing		
1705.2.2 Cold-Formed Steel Deck		
Special inspections in accordance with SDI QA/QC-2017 Standard for Quality control and Quality assurance for Installation of Steel Deck.		● Y
1705.3 Concrete Construction		Table 1705.3
Inspect reinforcing steel, including prestressing tendons, and verify placement.		
Inspect reinforcing bar welding		
a. Verify weldability of reinforcing bars other than ASTM A 706		● Y
Inspect single-pass fillet welds, maximum 5/16"		● N
c. Inspect all welds		● N
Inspect anchors cast in concrete		● Y
Inspect anchors post-installed in hardened concrete members		● Y
a. Adhesive anchors installed in horizontally or upwardly inclined orientation to resist sustained tension loads.		● Y
b. Mechanical anchors and adhesive anchors not defined above		● Y
Verify use of approved design mix.		● Y
Prior to placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete.		● Y
Inspect concrete and shotcrete placement for proper application techniques.		● Y
Inspect for maintenance of specified curing temperature and techniques.		● Y
Inspect prestressed concrete for:		
a. Application of prestressing forces		● N
b. Grouting of bonded prestressing tendons in the seismic-force-resisting system.		● N
Inspect erection of precast structural members.		● N
For precast concrete diaphragm connections or reinforcement at joints classified as moderate or high deformability elements (MDE or HDE) in structures assigned to Seismic Design Category C, D, E, or F, inspect such connections and reinforcement in the field for:		
a. Installation of the embedded parts		● N
b. Completion of the continuity of reinforcement across joints		● N
c. Completion of connections in the field		● N
Inspect installation tolerances of precast concrete diaphragm connections for compliance with ACI 550.5.		● N
Verify in-situ concrete strength, prior to stressing of tendons in post-tensioned concrete and prior to removal of shores and forms from beams and structural slabs.		● N
Inspect formwork for shape, location, and dimensions of the concrete member being formed		● Y

Inspections & Testing	Continuous	Periodic	Y/N	Reference Standard or Compliance Document	Agent
1705.6 Soils					
Verify materials below shallow foundations are adequate to achieve the required bearing capacity.			● Y	Table 1705.6	1
Verify excavations are extended to proper depth and have reached proper material.			● Y		1
Perform classification and testing of compacted fill materials.			● Y		1
During fill placement, verify use of proper materials and procedures in accordance with the provisions of the approved geotechnical report. Verify densities and lift thicknesses during placement and compaction of compacted fill.			● Y		1
Prior to placement of controlled fill, observe subgrade and verify that site has been prepared properly.			● Y		1
1705.12 Wind Resistance					
Provide inspections when required by 1705.12.			● Y		1, 2
a. Structural wood				1705.12.1	
b. CFS light frame construction				1705.12.2	
c. Wind resisting components				1705.12.3	
1705.13 Seismic Resistance					
Provide inspections when required by 1705.13.			● Y		1, 2
a. Structural steel				1705.13.1	
b. Structural wood				1705.13.2	
c. CFS light frame construction				1705.13.3	
d. Designated seismic systems				1705.13.4	
e. Architectural components				1705.13.5	
f. Plumbing, Mechanical, Electrical components				1705.13.6	
g. Storage Racks				1705.13.7	
h. Seismic Isolation Systems				1705.13.8	
i. Cold-Formed Steel Special Bolted Moment Frames				1705.13.9	
1705.14 Testing and Qualification for Seismic Resistance					
Test and qualify seismic resistance in accordance with 1705.14 and the project specifications.			● Y		1, 2
a. Structural Steel				1705.14.1	
b. Non-Structural Components				1705.14.2	
c. Designated Seismic Systems				1705.14.3	
d. Seismic Isolation Systems				1705.14.4	
1705.15 Sprayed Fire-Resistant Materials (SFRM)					
Inspect sprayed fire-resistant materials in accordance with 1705.15 and the project specifications.			● N		1
a. Condition of substrate					
b. Thickness of application					
c. Density					
d. Bond strength/adhesion/cohesion					
e. Condition of finished application					
1705.16 Masonic and Intumescent Fire-Resistant Coatings					
Perform inspections in accordance with AWCI 12-B and 1705.16.			● N	AWCI 12-B	1
1705.17 Exterior Insulation and Finish Systems (EIFS)					
Perform inspections in accordance with project specifications and 1705.17.			● N		1
1705.18 Fire-Resistant Penetrations and Joints					
Perform inspections in accordance with project specifications and 1705.18.			● N	1705.18.1, 1705.18.2	1, 2
1705.19 Smoke Control					
Perform testing in accordance with project specifications and 1705.19.			● N		1

MOSELEY ARCHITECTS

6210 ARDREY KELL ROAD • THE HUB AT WAWERLY, SUITE 425 • CHARLOTTE, NC 28277
PHONE (704) 540-3755 FAX (704) 540-3754 MOSELEYARCHITECTS.COM

PROGRESS PRINT NOT FOR CONSTRUCTION

GEORGETOWN COUNTY RE-ENTRY FACILITY

GEORGETOWN COUNTY GEORGETOWN, SOUTH CAROLINA



PROJECT NO: 611315
DATE: FEBRUARY 26, 2024
REVISIONS
DATE DESCRIPTION

SCHEDULE OF SPECIAL INSPECTIONS - 2021 IBC

S0.0.2

2/25/2024 4:35:24 PM

J
H
G
F
E
D
C
B
A

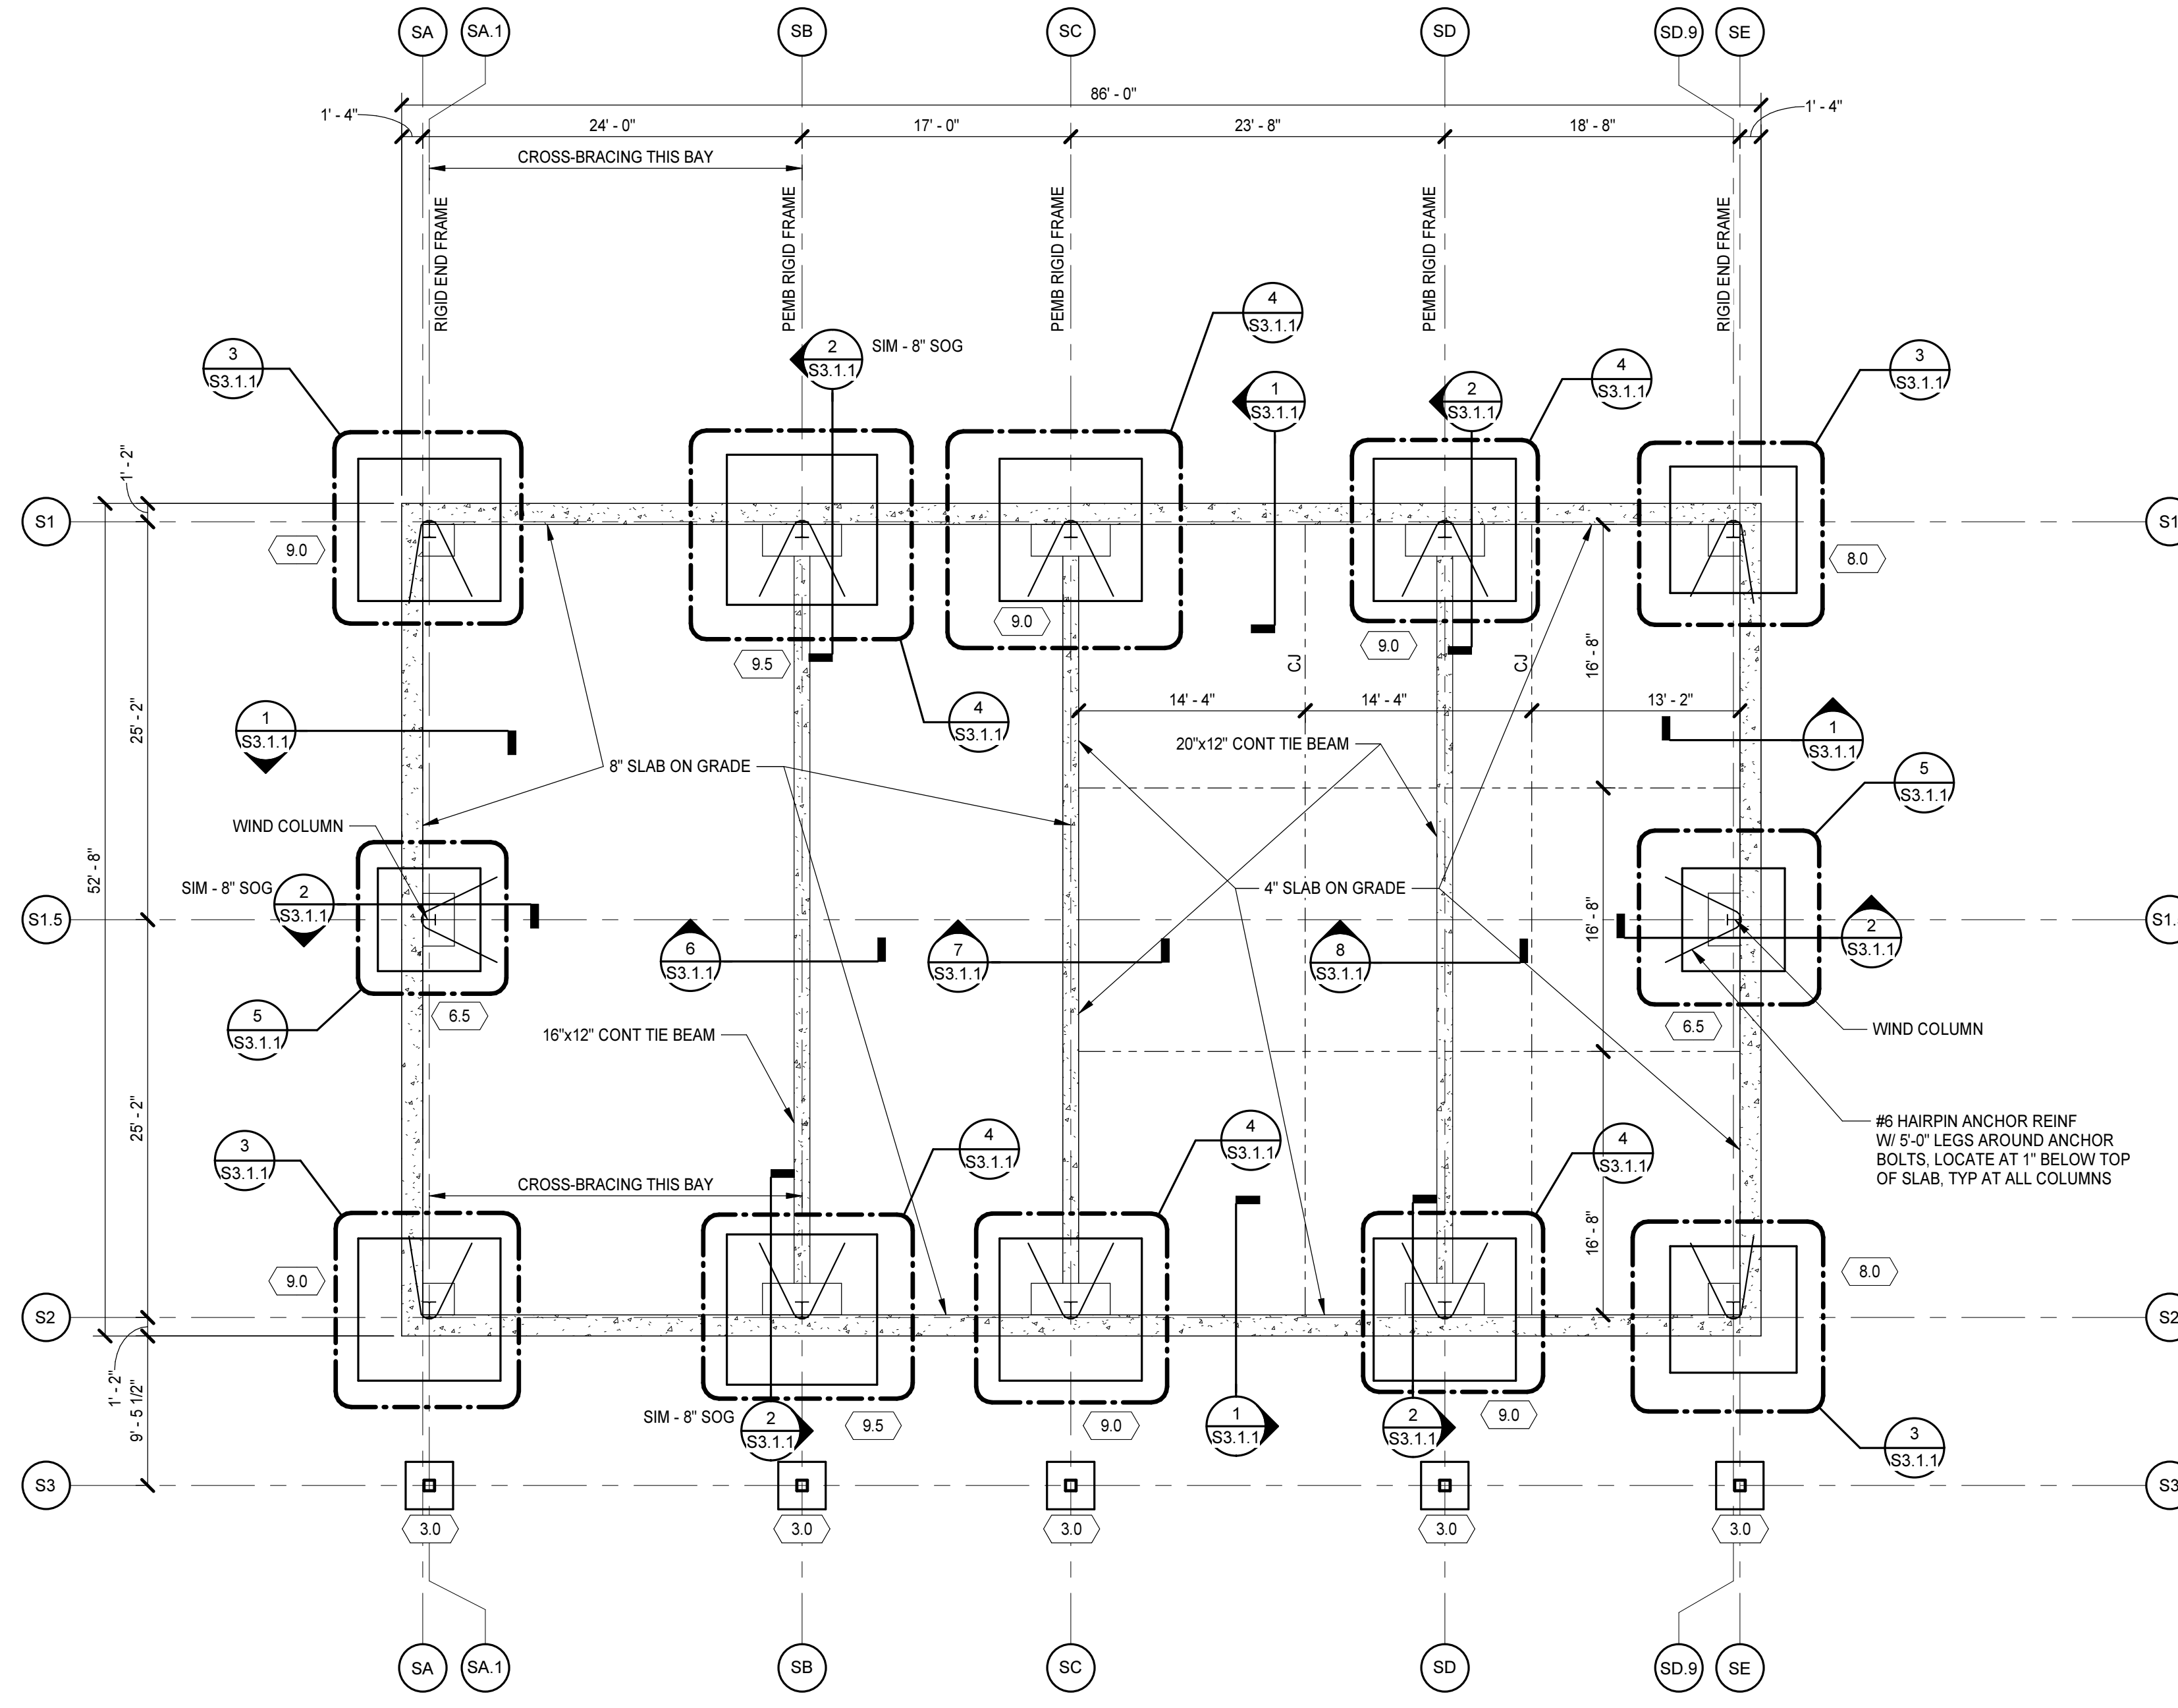

FIRST FLOOR PLAN FOUNDATION

1/8" = 1'-0"



- FOUNDATION PLAN NOTES:**
1. FINISHED FIRST FLOOR ELEVATION = 19.80' = REFERENCE DATUM EL (+2'-0"). ALL STRUCTURAL ELEVATIONS INDICATED ARE REFERENCED FROM THIS ELEVATION, UNO.
 2. FLOOR CONSTRUCTION SHALL BE 4" NORMAL WEIGHT CONCRETE SLAB ON GRADE REINFORCED WITH 6x6-W2 8xW2 9 WWF (AT 1" FROM TOP OF SLAB) OVER VAPOR BARRIER OVER 6" GRANULAR BASE COURSE, UNO.
 3. 8" NORMAL WEIGHT CONCRETE SLAB ON GRADE REINFORCED WITH #5 AT 12" ON CENTER AT MID-DEPTH OVER VAPOR BARRIER OVER 6" GRANULAR BASE COURSE, UNO. JOINTS ARE NOT PERMITTED IN THIS SLAB. POUR SLAB, SLAB EDGE TURNDOWN, AND PIERS MONOLITHICALLY.
 4. BASE COURSE SHALL BE A CLEAN, DENSELY-GRADED "CRUSHER RUN" MATERIAL WITH A BALANCED FINE CONTENT, SUCH AS MATERIAL LISTED IN THE *SCDOT QUALIFIED PRODUCT LIST 2*. THE BASE COURSE SHALL BE COMPACTED AND SHALL BE FINISHED TO A FLAT, SMOOTH, LOW-FRICTION SURFACE. COMPACTION SHALL BE MONITORED BY THE ON-SITE TESTING AGENCY. OPEN GRADED STONE, SUCH AS #57 STONE, IS NOT ACCEPTABLE.
 5. COORDINATE TOP OF FOOTING ELEVATIONS WITH ALL UNDERSLAB UTILITIES. REFER TO FOUNDATION NOTE #4 ON DRAWING S0.0.1.
 6. REFER TO DRAWING S0.0.1 FOR GENERAL NOTES, PLAN LEGEND, AND STRUCTURAL ABBREVIATIONS.
 7. REFER TO DRAWINGS S3.0.1 FOR TYPICAL FOUNDATION, SLAB DETAILS AND SCHEDULES.


**PROGRESS
PRINT NOT FOR
CONSTRUCTION**

GEORGETOWN COUNTY RE-ENTRY FACILITY
 GEORGETOWN COUNTY
 GEORGETOWN, SOUTH CAROLINA


PROJECT NO:	611315
DATE:	FEBRUARY 26, 2024
REVISIONS	
DATE	DESCRIPTION

FOUNDATION PLAN

S1.1.1

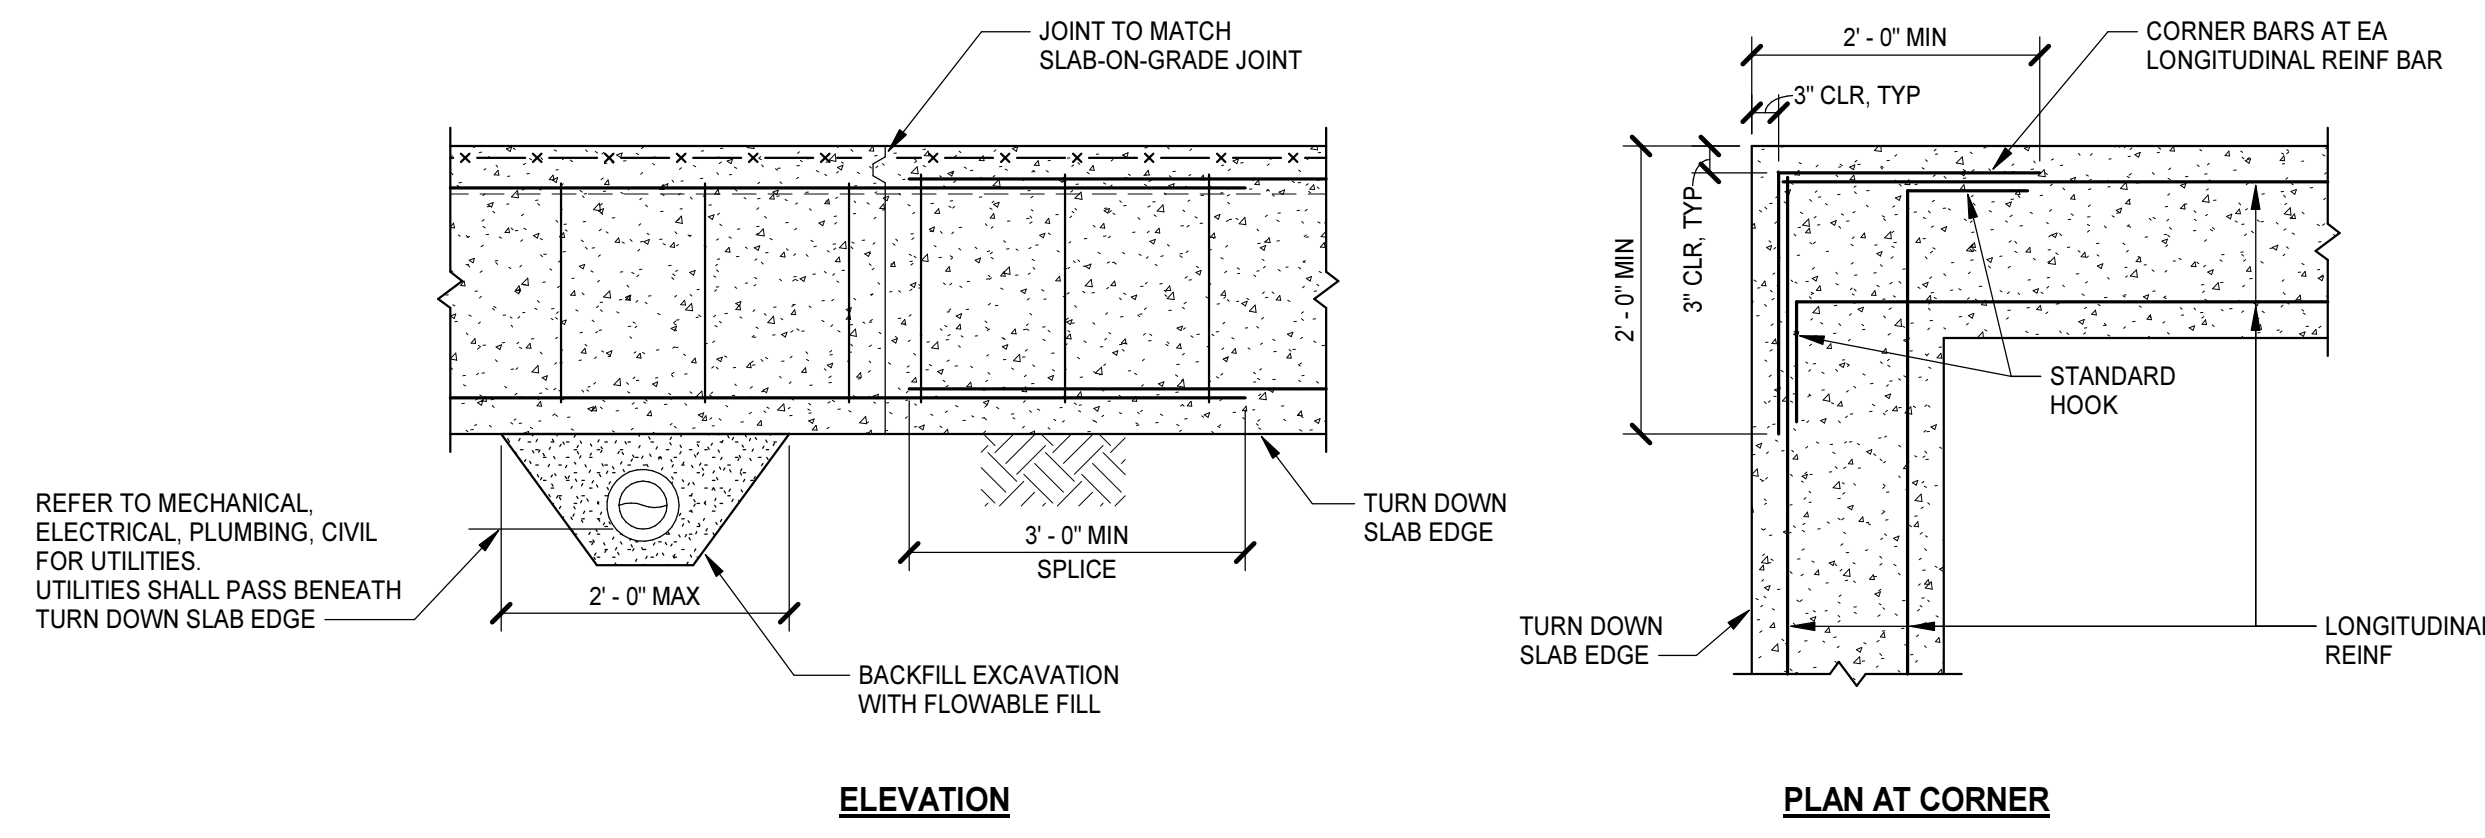


CONCRETE TURN DOWN SLAB EDGE DETAILS
NO SCALE

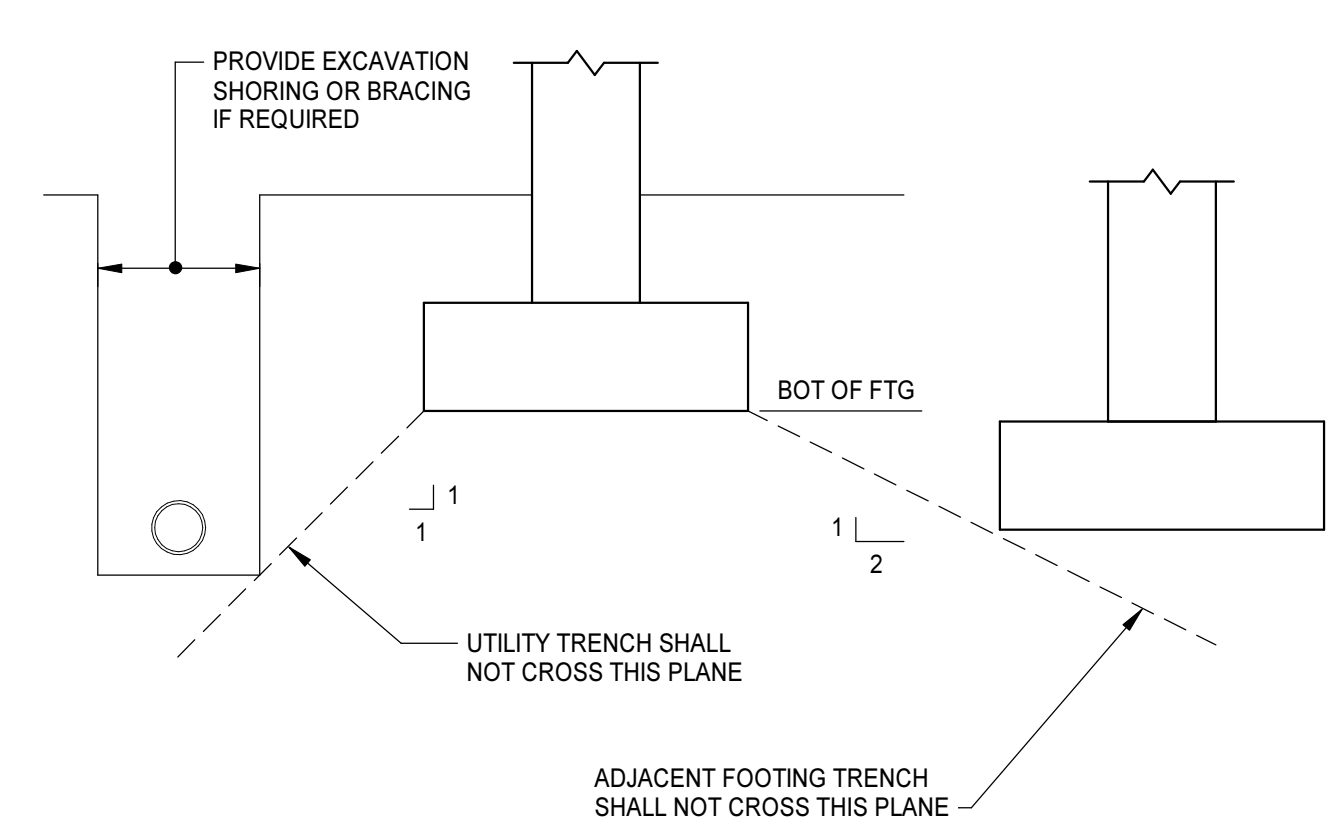


FOOTING EXCAVATION LIMITS
NO SCALE

SPREAD FOOTING SCHEDULE				
MARK	SIZE			REINFORCING
	LENGTH	WIDTH	THICKNESS	
3.0	3'-0"	3'-0"	1'-0"	(4) #5 EA WAY BOT
6.5	6'-6"	6'-6"	1'-4"	(6) #6 EA WAY TOP & BOT
8.0	8'-0"	8'-0"	1'-7"	(9) #6 EA WAY TOP & BOT
9.0	9'-0"	9'-0"	1'-10"	(10) #6 EA WAY TOP & BOT
9.5	9'-6"	9'-6"	1'-11"	(11) #6 EA WAY TOP & BOT

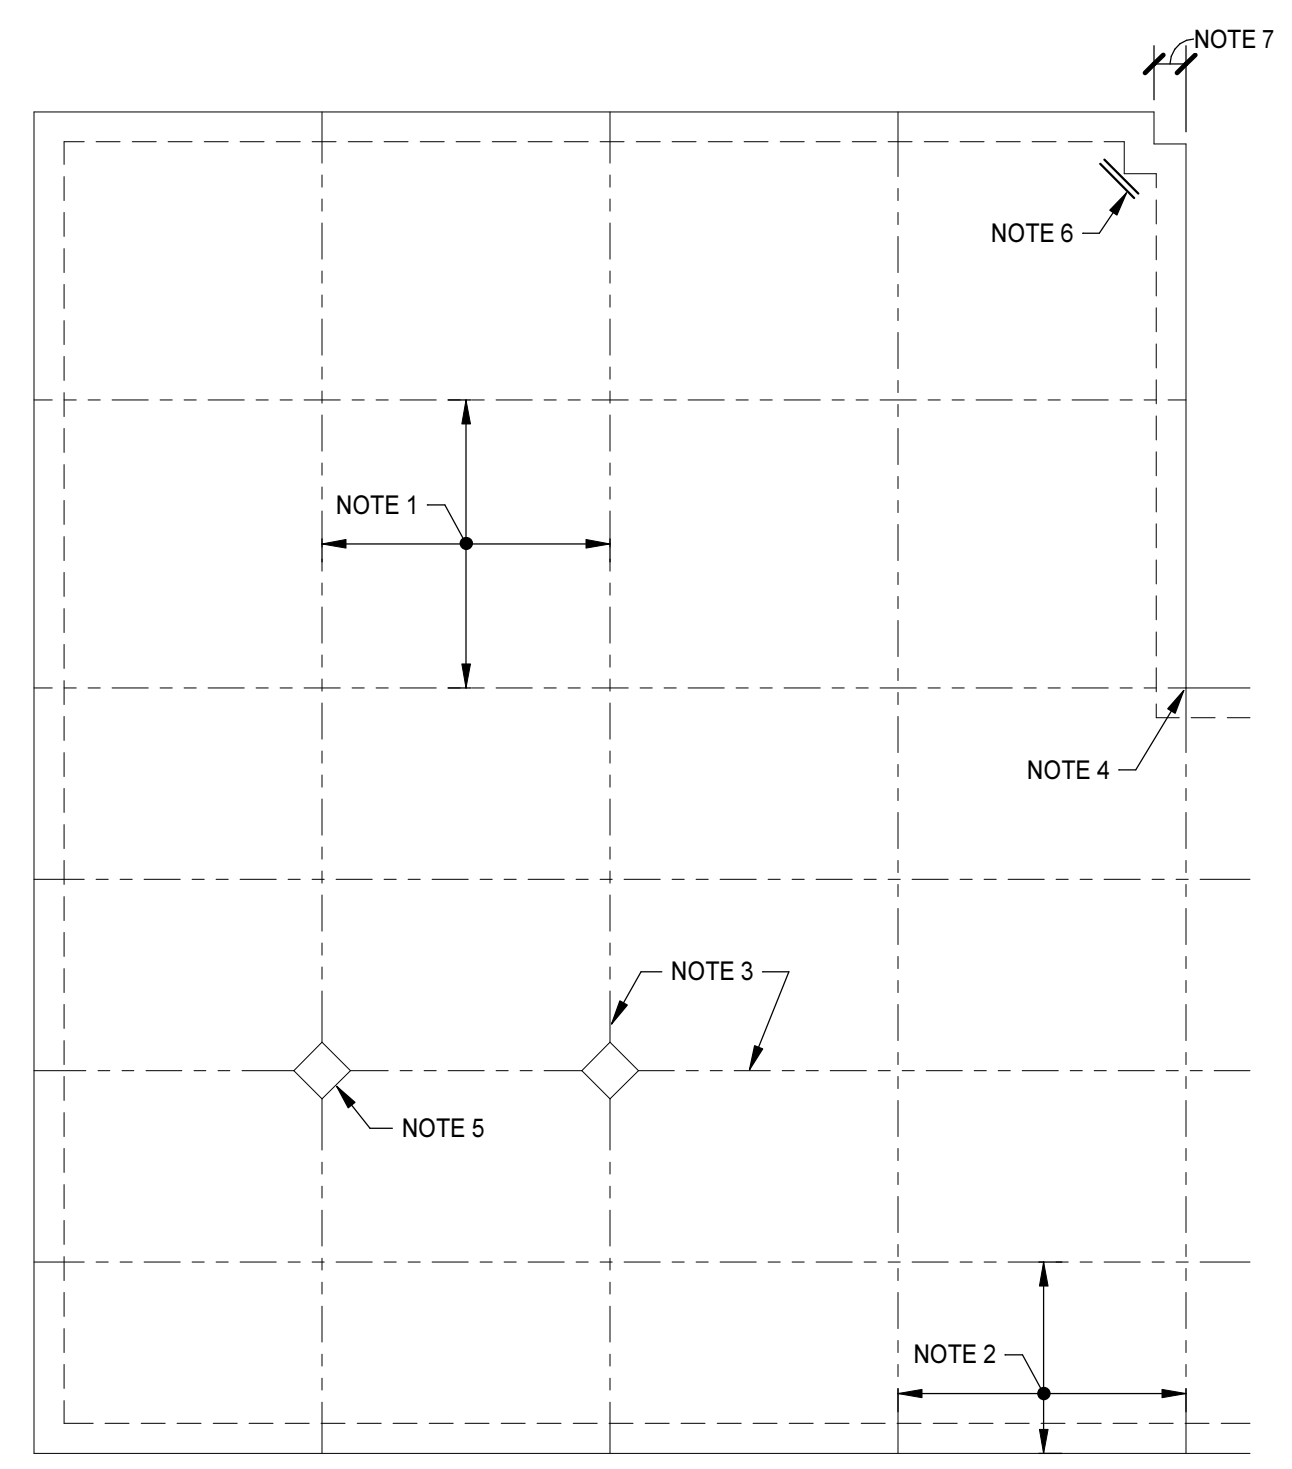


SLAB-ON-GRADE JOINT LAYOUT GUIDELINES
NO SCALE

- NOTES:**
1. PROVIDE CONTROL JOINTS IN SLABS ON GRADE WITHIN THE BUILDING SUCH THAT THE AREA BOUNDED BY CONTROL JOINTS DOES NOT EXCEED 225 SQUARE FEET AND JOINT SPACING DOES NOT EXCEED 15'-0" ON CENTER IN ANY ONE DIRECTION.
 2. THE RATIO OF LENGTH TO WIDTH OF THE AREA BOUNDED BY CONTROL JOINTS SHALL NOT EXCEED 1.5 TO 1.
 3. LOCATE CONSTRUCTION JOINTS AND OR CONTROL JOINTS AT COLUMN CENTERLINES.
 4. LOCATE CONSTRUCTION JOINTS AND OR CONTROL JOINTS AT RE-ENTRANT CORNERS.
 5. PROVIDE DIAMOND OR CIRCULAR BLOCKOUTS AT COLUMNS.
 6. REINFORCE ALL RE-ENTRANT CORNERS OF SLAB PER "SLAB REINFORCING AT RE-ENTRANT CORNERS".
 7. CONTROL JOINT NOT REQUIRED IF DIMENSION AT RE-ENTRANT CORNER IS 2'-0" OR LESS. PROVIDE REINFORCING PER "SLAB REINFORCING AT RE-ENTRANT CORNER".
 8. CONTROL JOINT / CONSTRUCTION JOINT PLANS SHALL BE SUBMITTED FOR REVIEW.

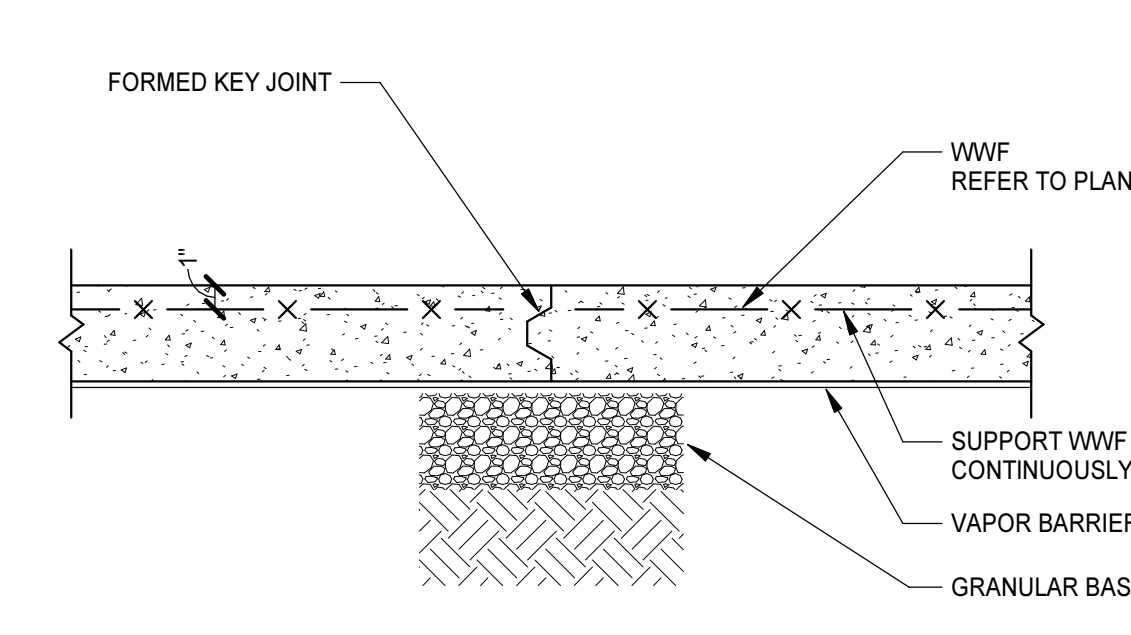


CONSTRUCTION JOINT

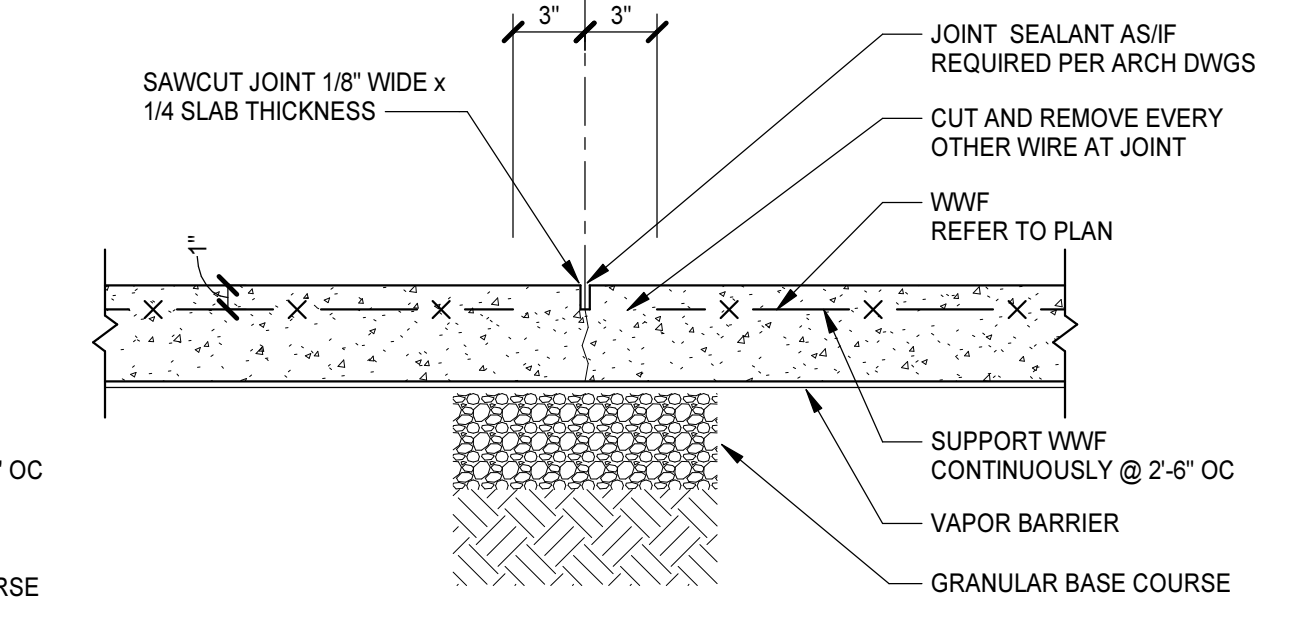


CONTROL JOINT

- NOTES:**
1. SAWCUT AS SOON AS CONCRETE WILL SUPPORT EQUIPMENT AND EARLY ENOUGH TO PREVENT CRACKING. DO NOT DISLODGE AGGREGATE.
 2. CONSTRUCTION JOINT MAY REPLACE CONTROL JOINT.


SLAB-ON-GRADE JOINT DETAILS
NO SCALE

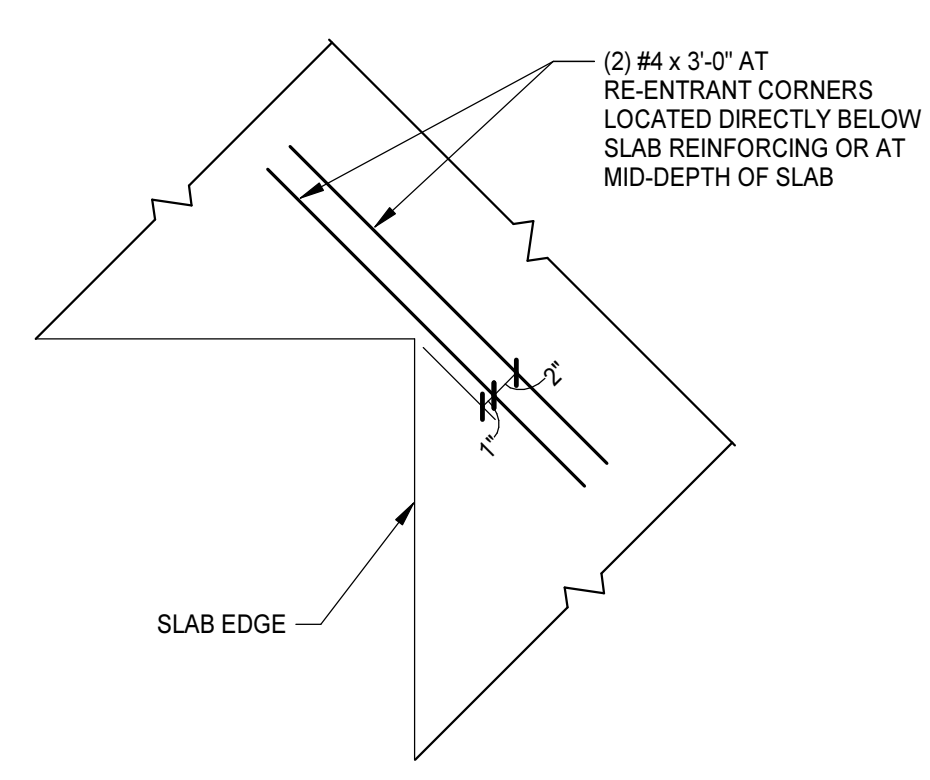


SLAB REINFORCING AT RE-ENTRANT CORNER
NO SCALE

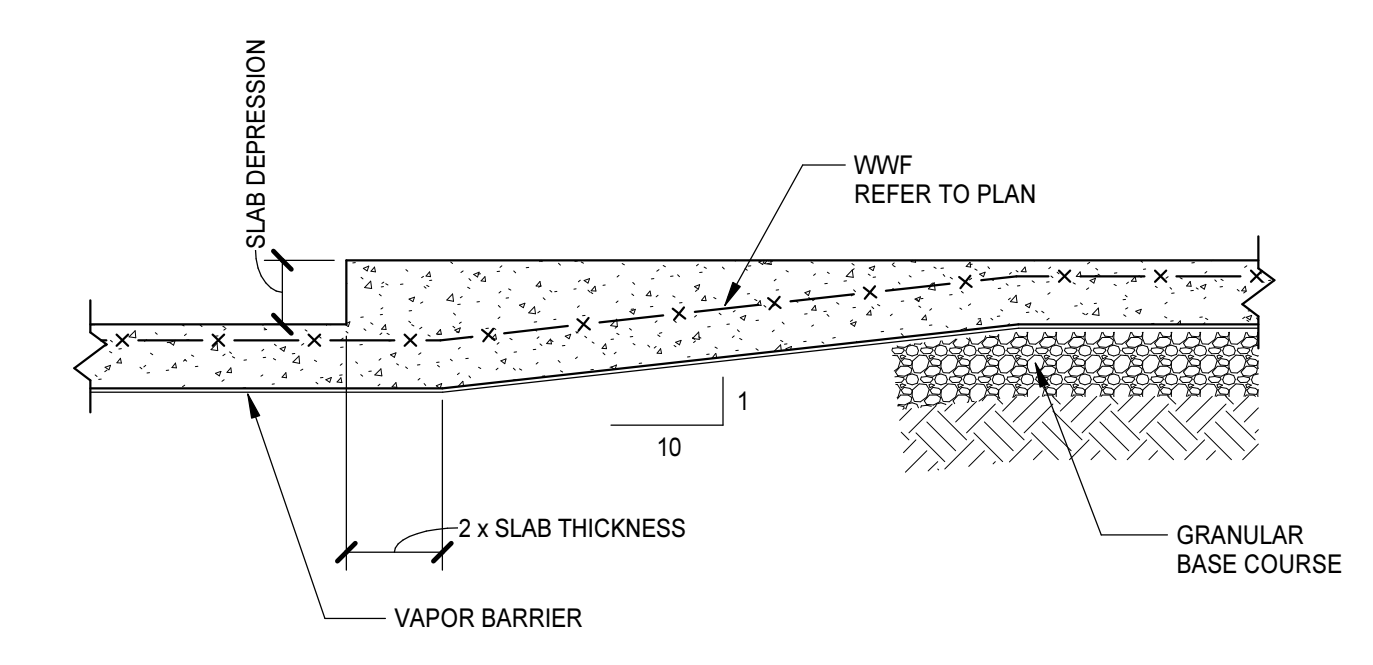


DETAIL AT SLAB DEPRESSION
NO SCALE

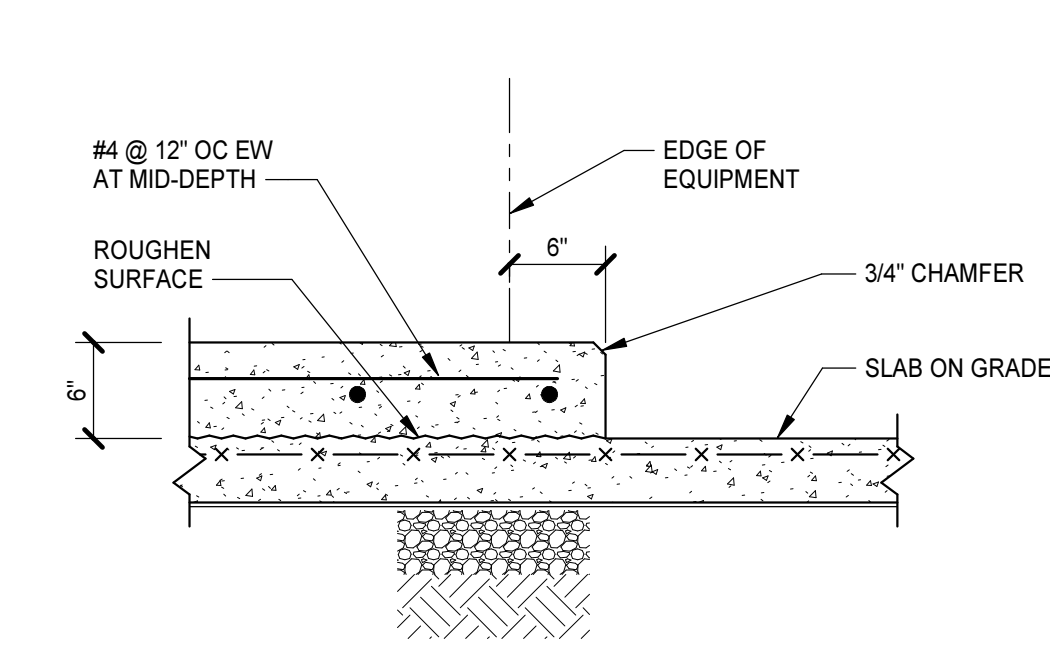

HOUSEKEEPING PAD

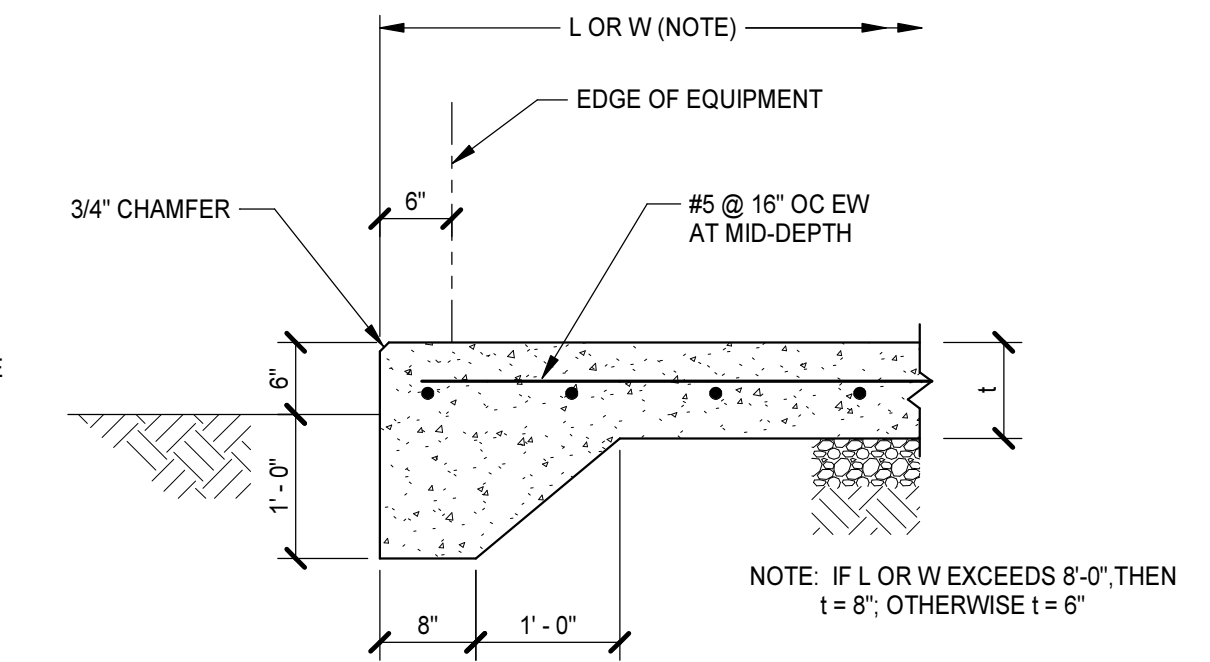

EXTERIOR EQUIPMENT PAD







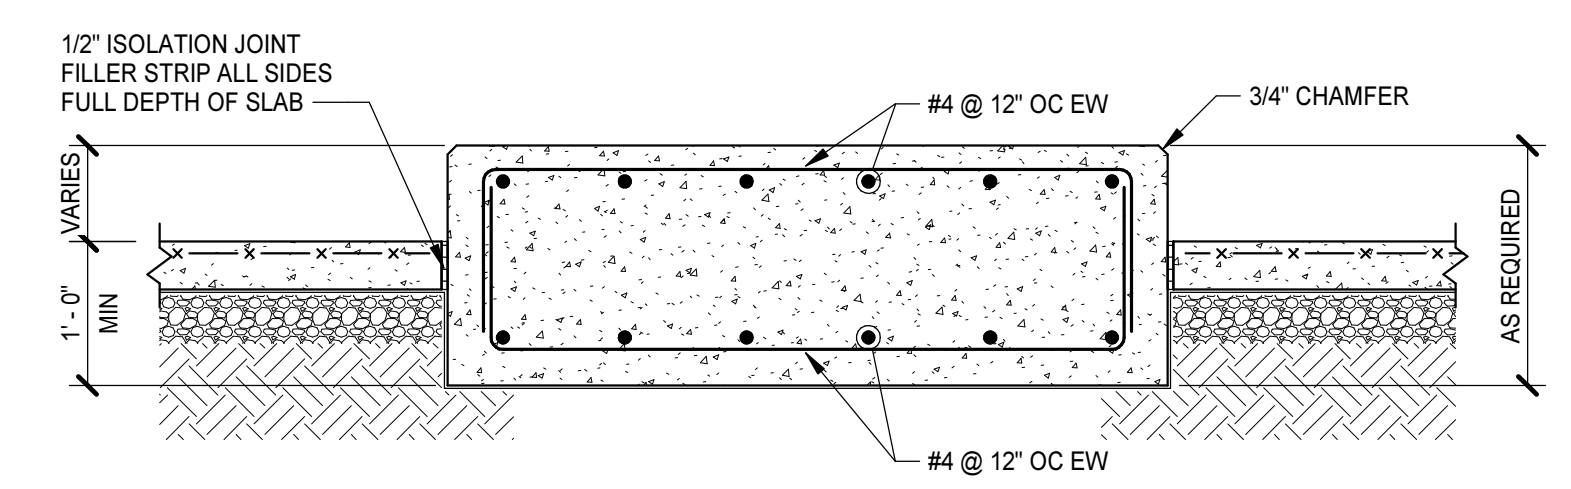


HEAVY EQUIPMENT PAD


EQUIPMENT PAD DETAILS
NO SCALE

PROJECT NO:	811315
DATE:	FEBRUARY 26, 2024
REVISIONS	
DATE	DESCRIPTION


PROJECT NO:	611315
DATE:	FEBRUARY 26, 2024
REVISIONS	
DATE	DESCRIPTION

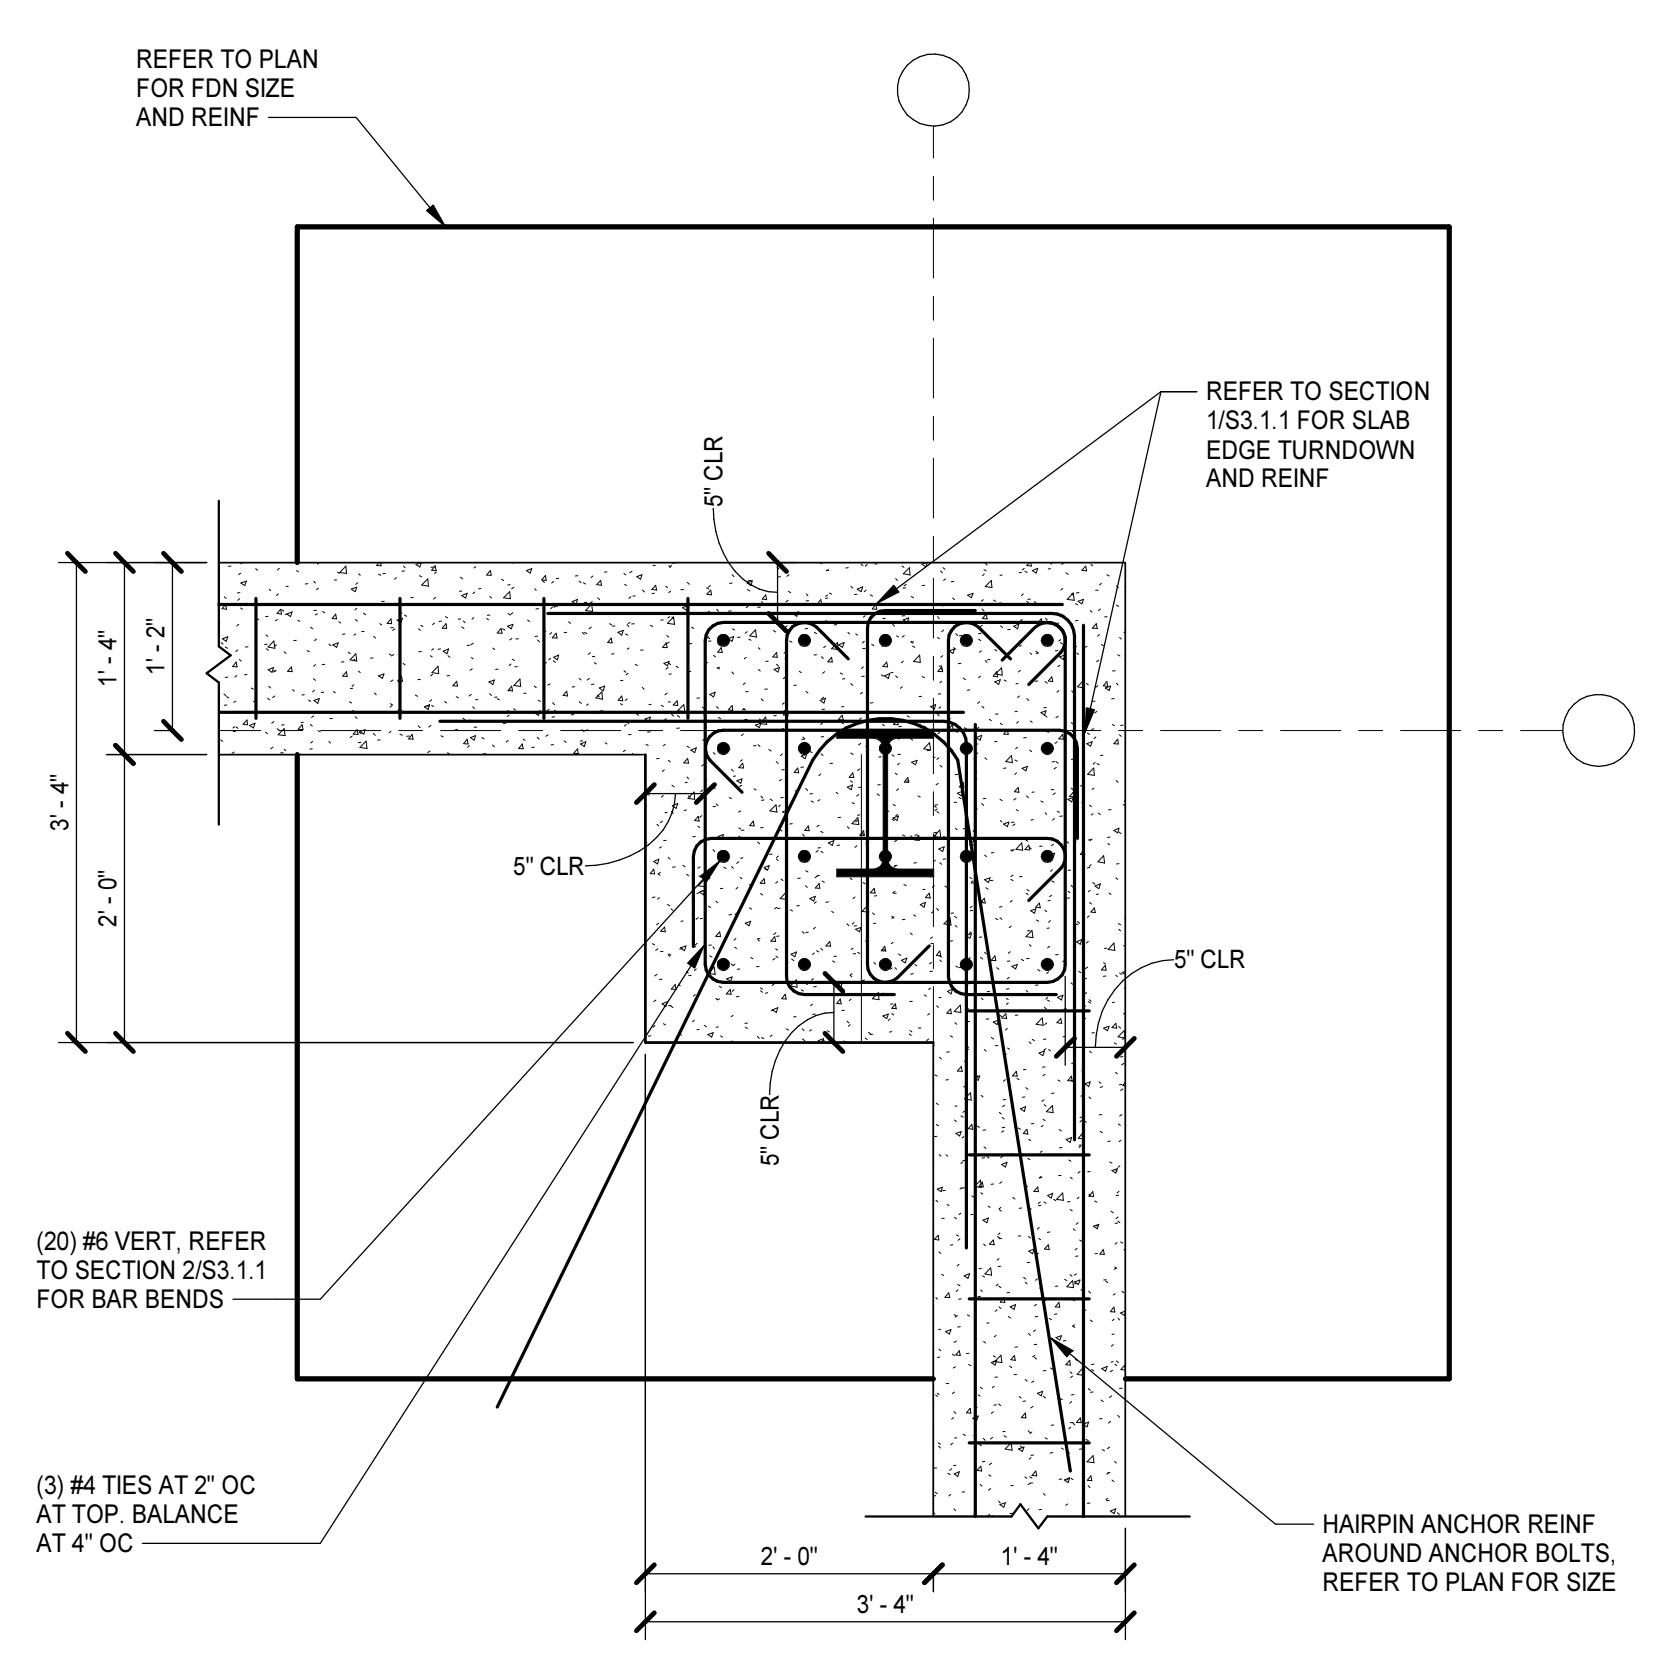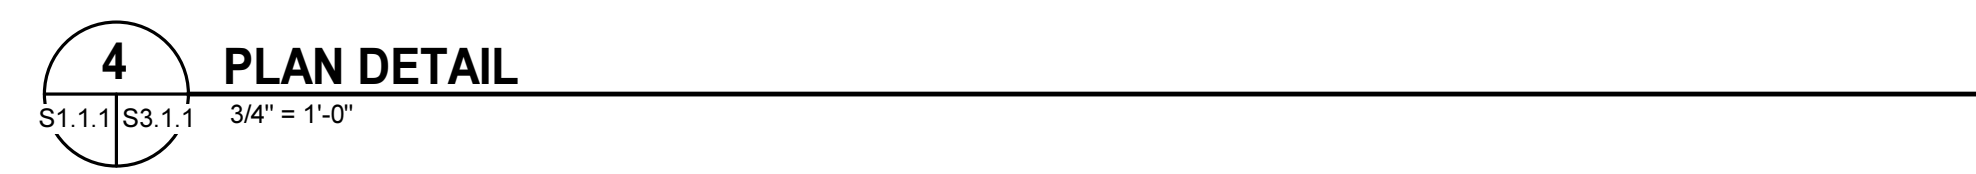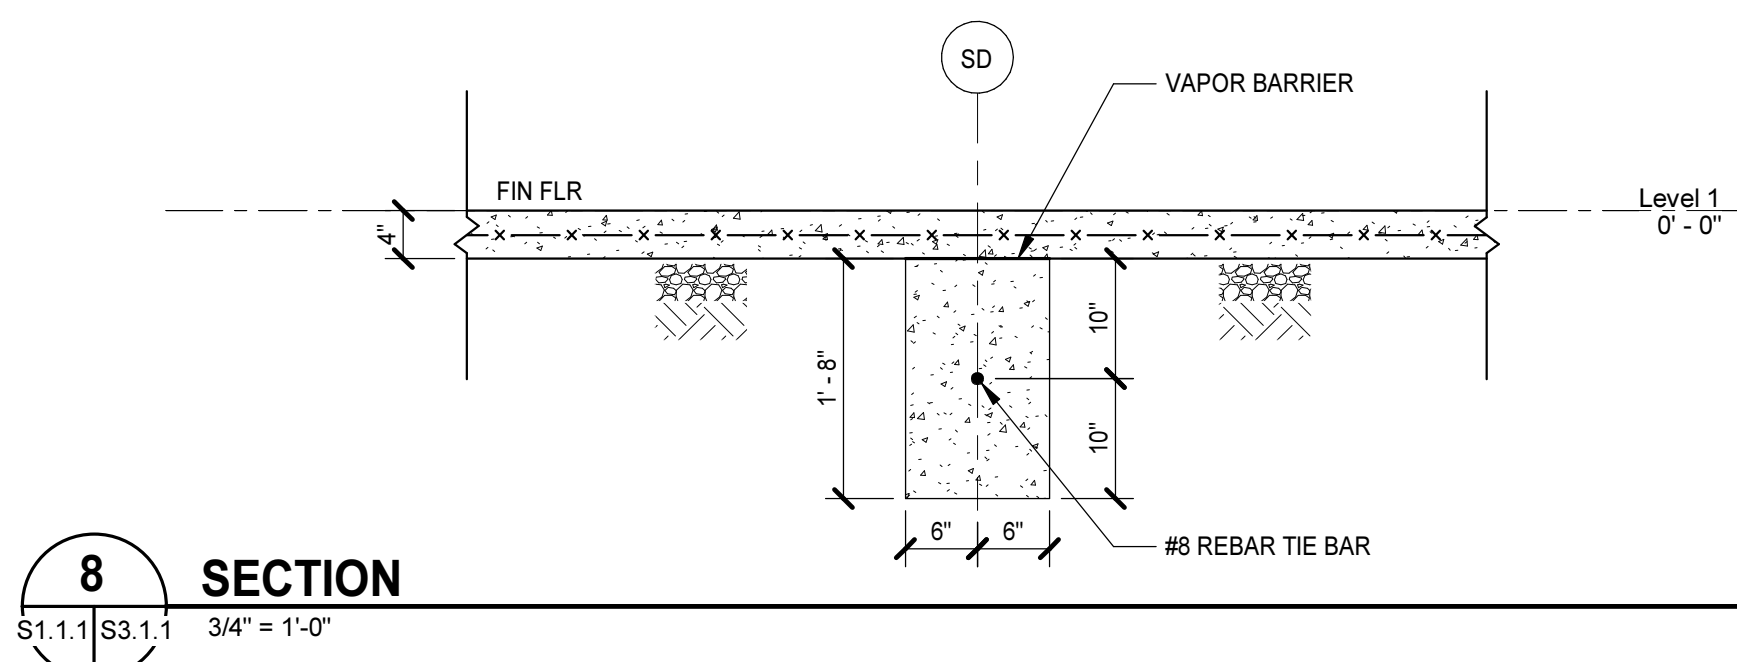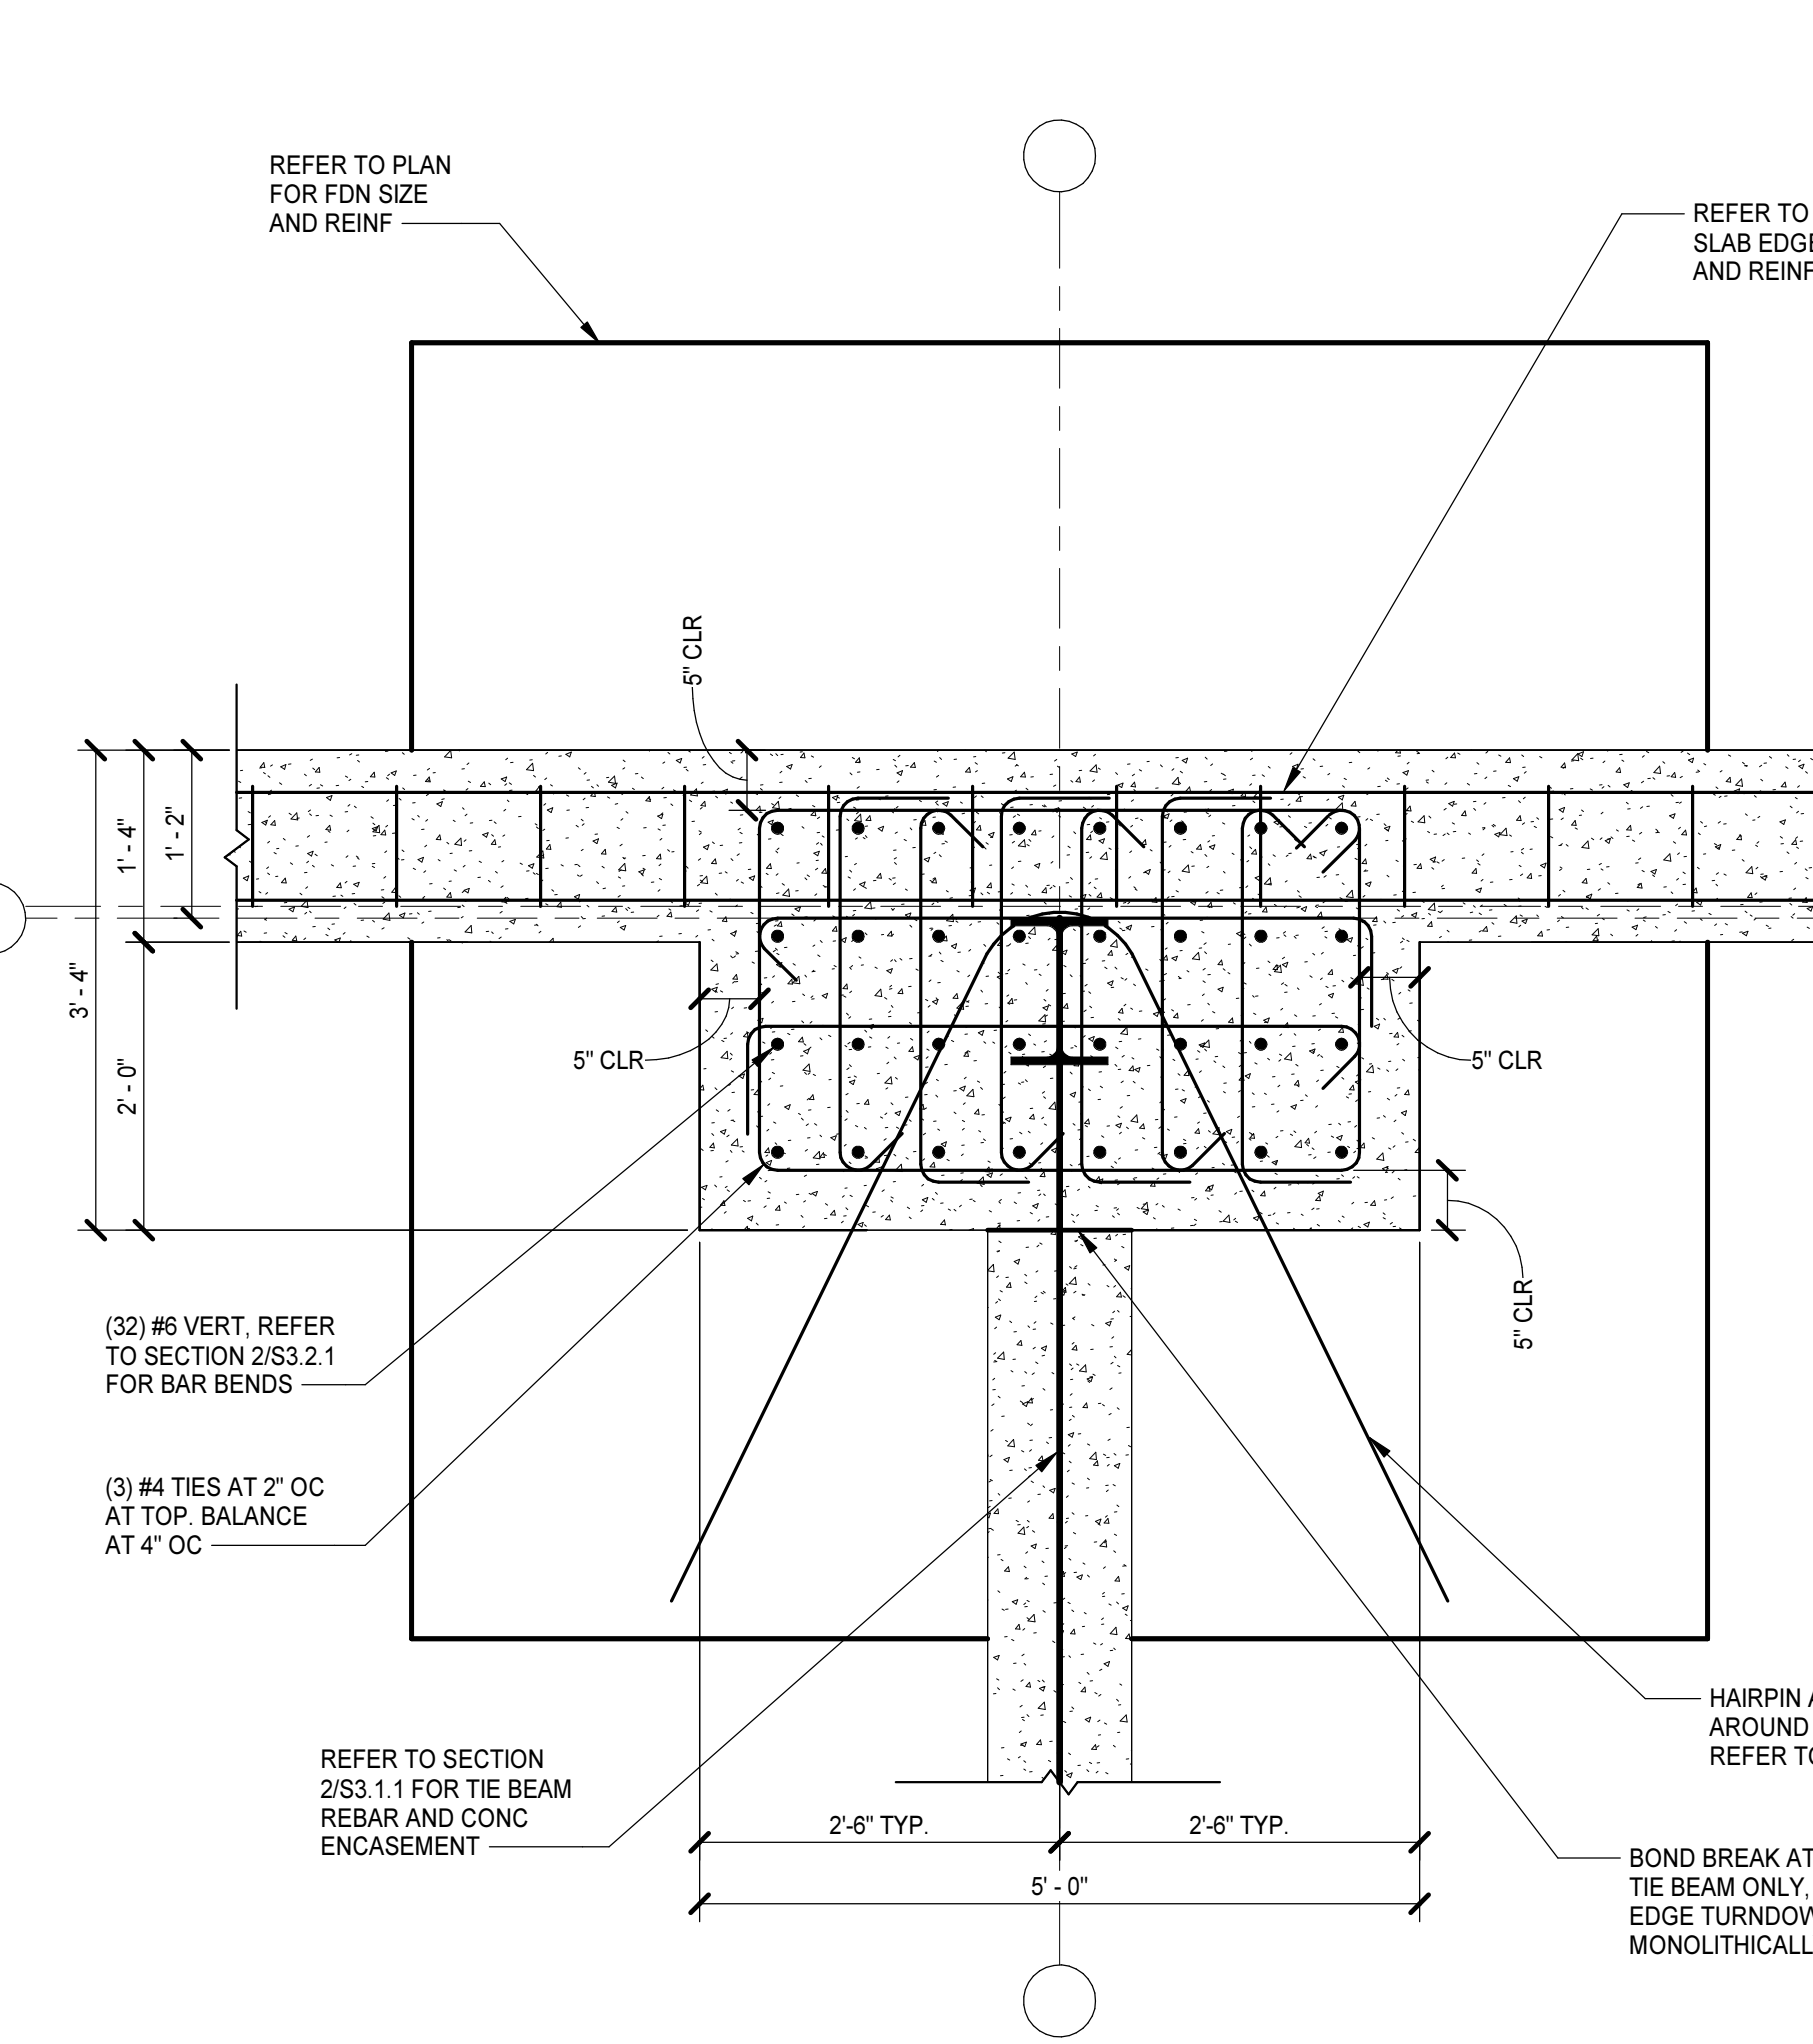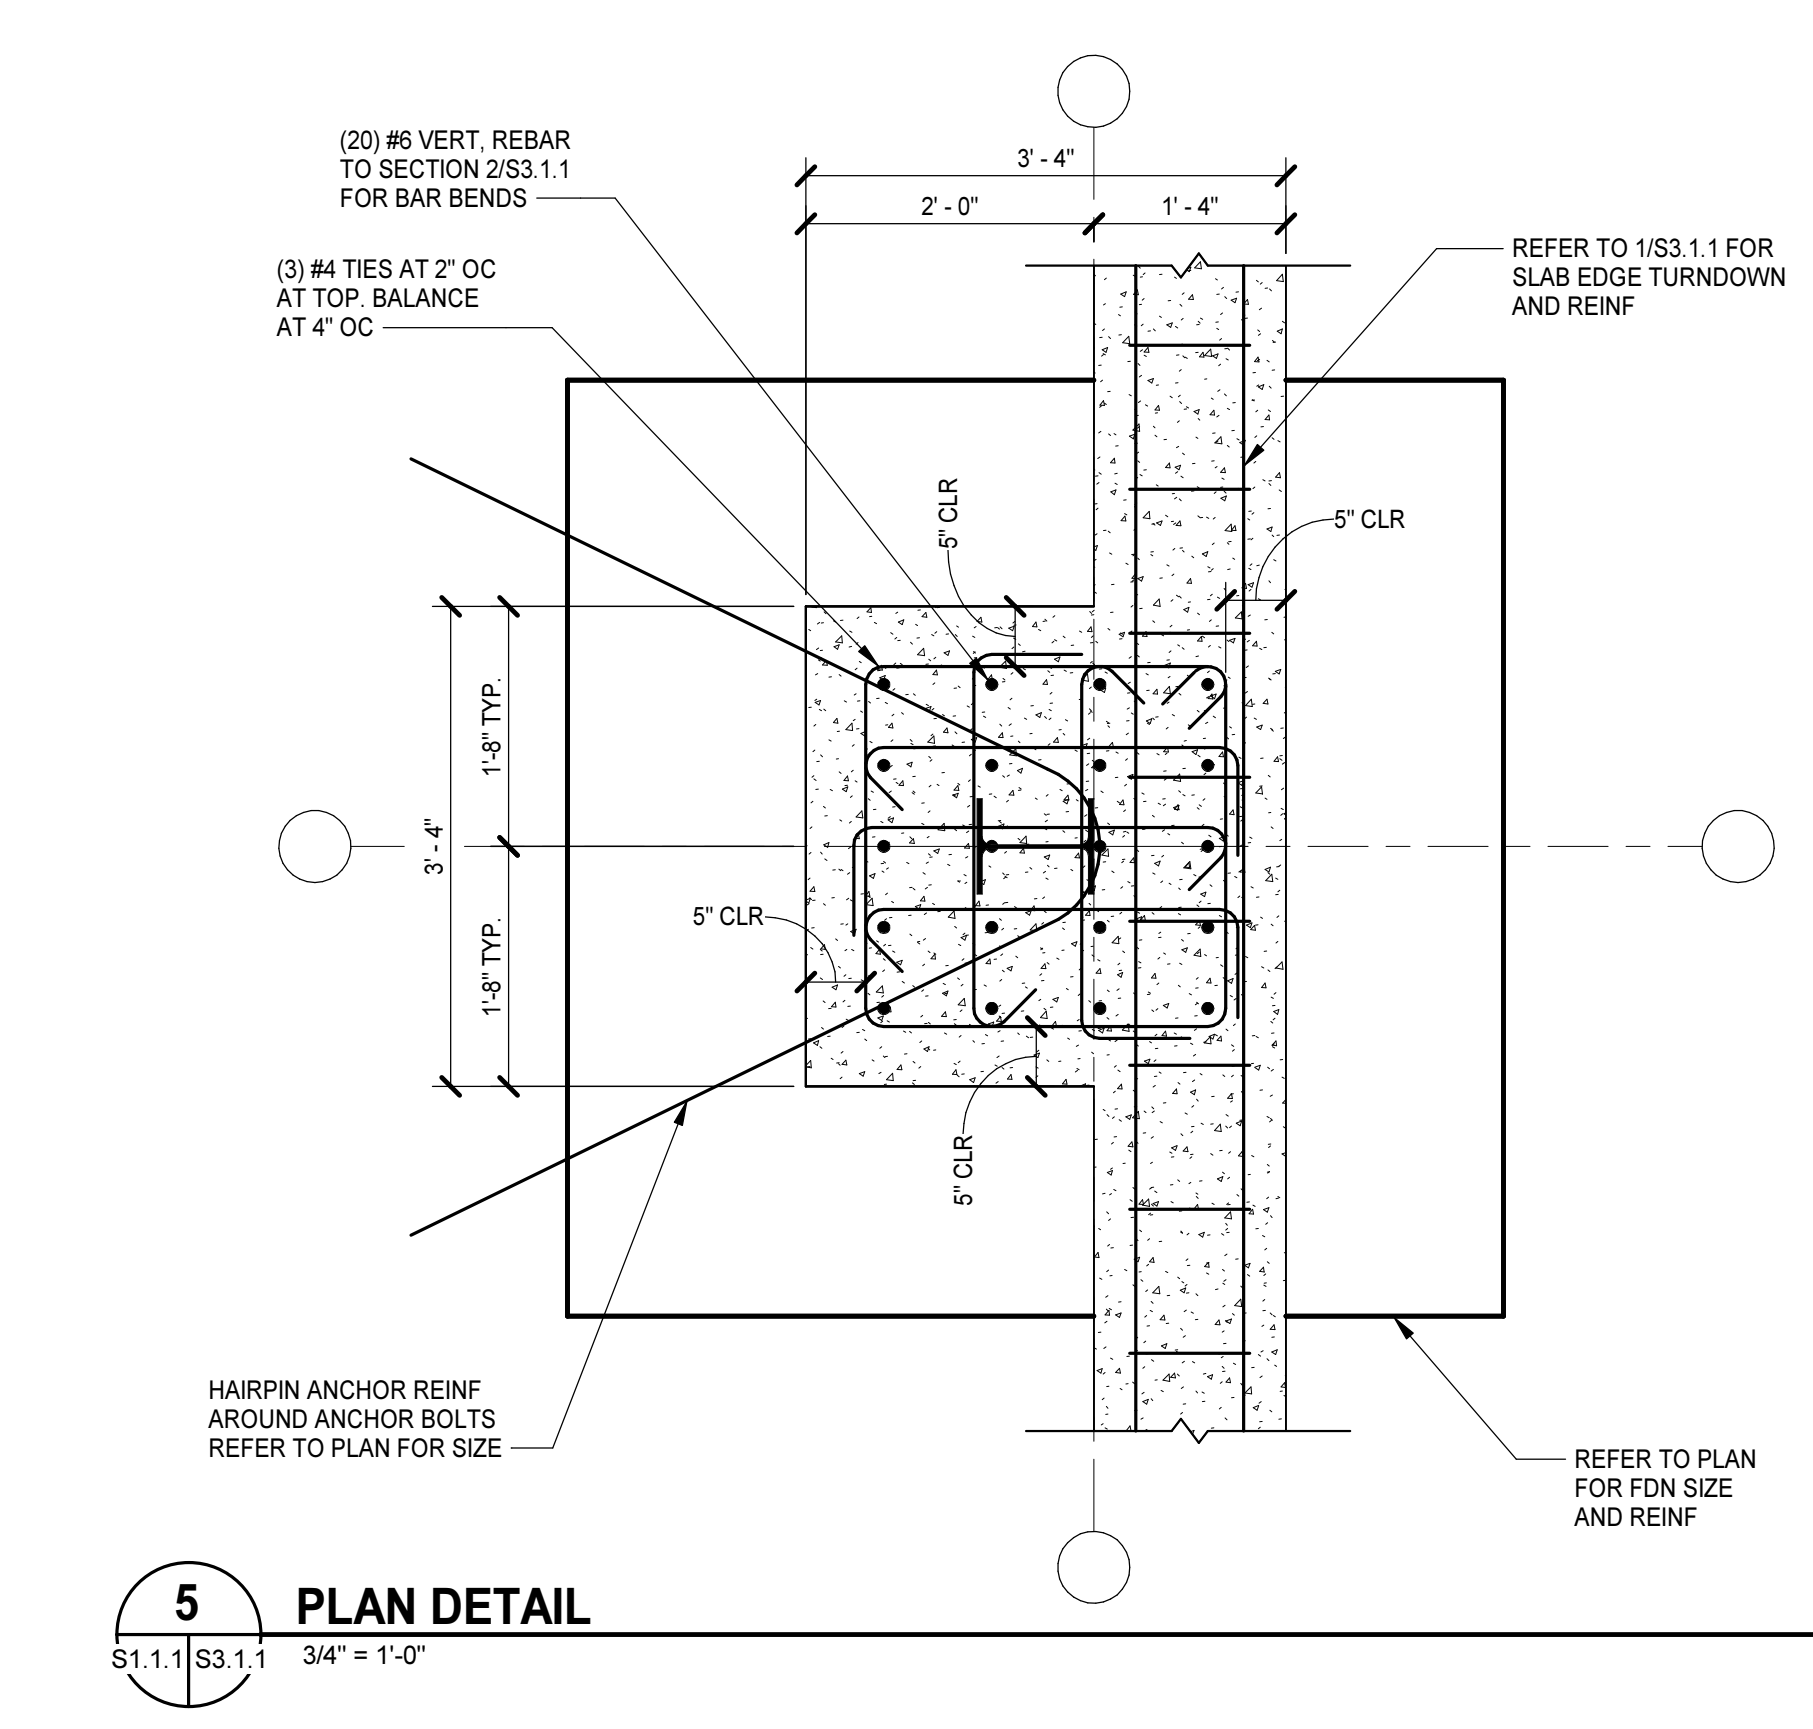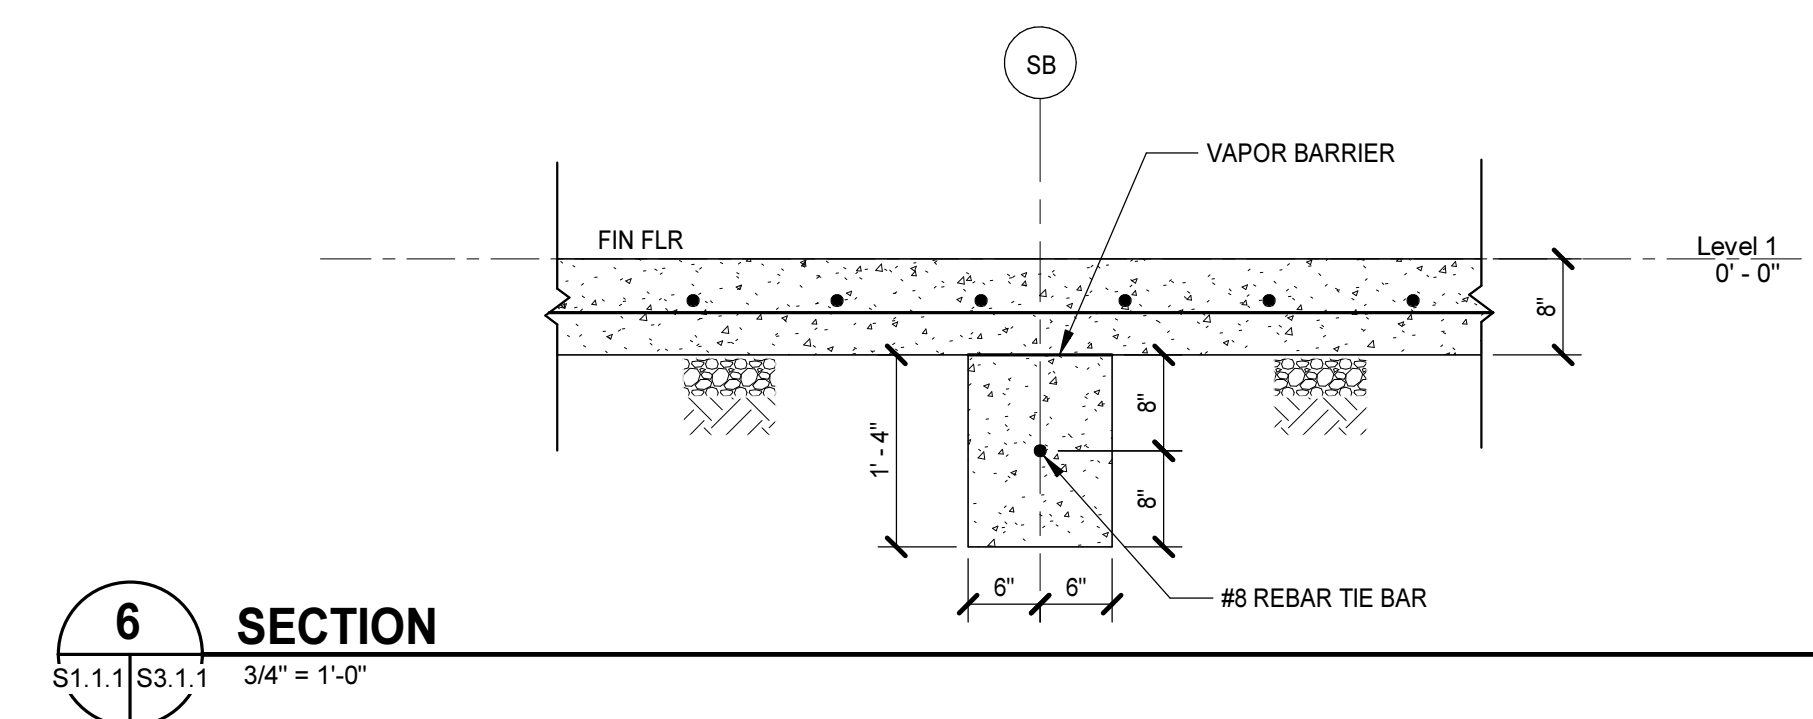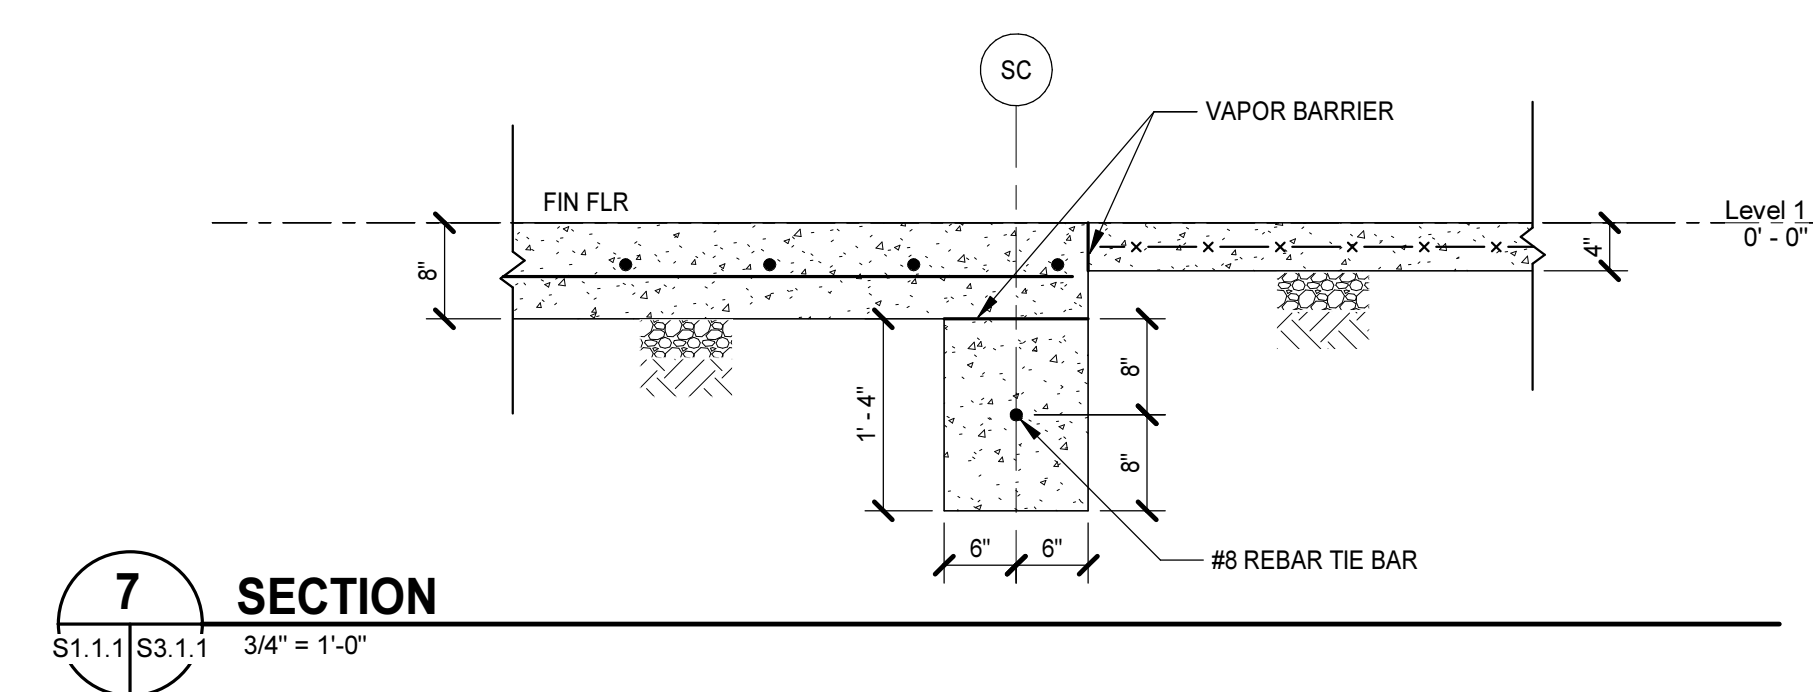


3 PLAN DETAIL
 S1.1.1 | S3.1.1 | 3/4" = 1'-0"

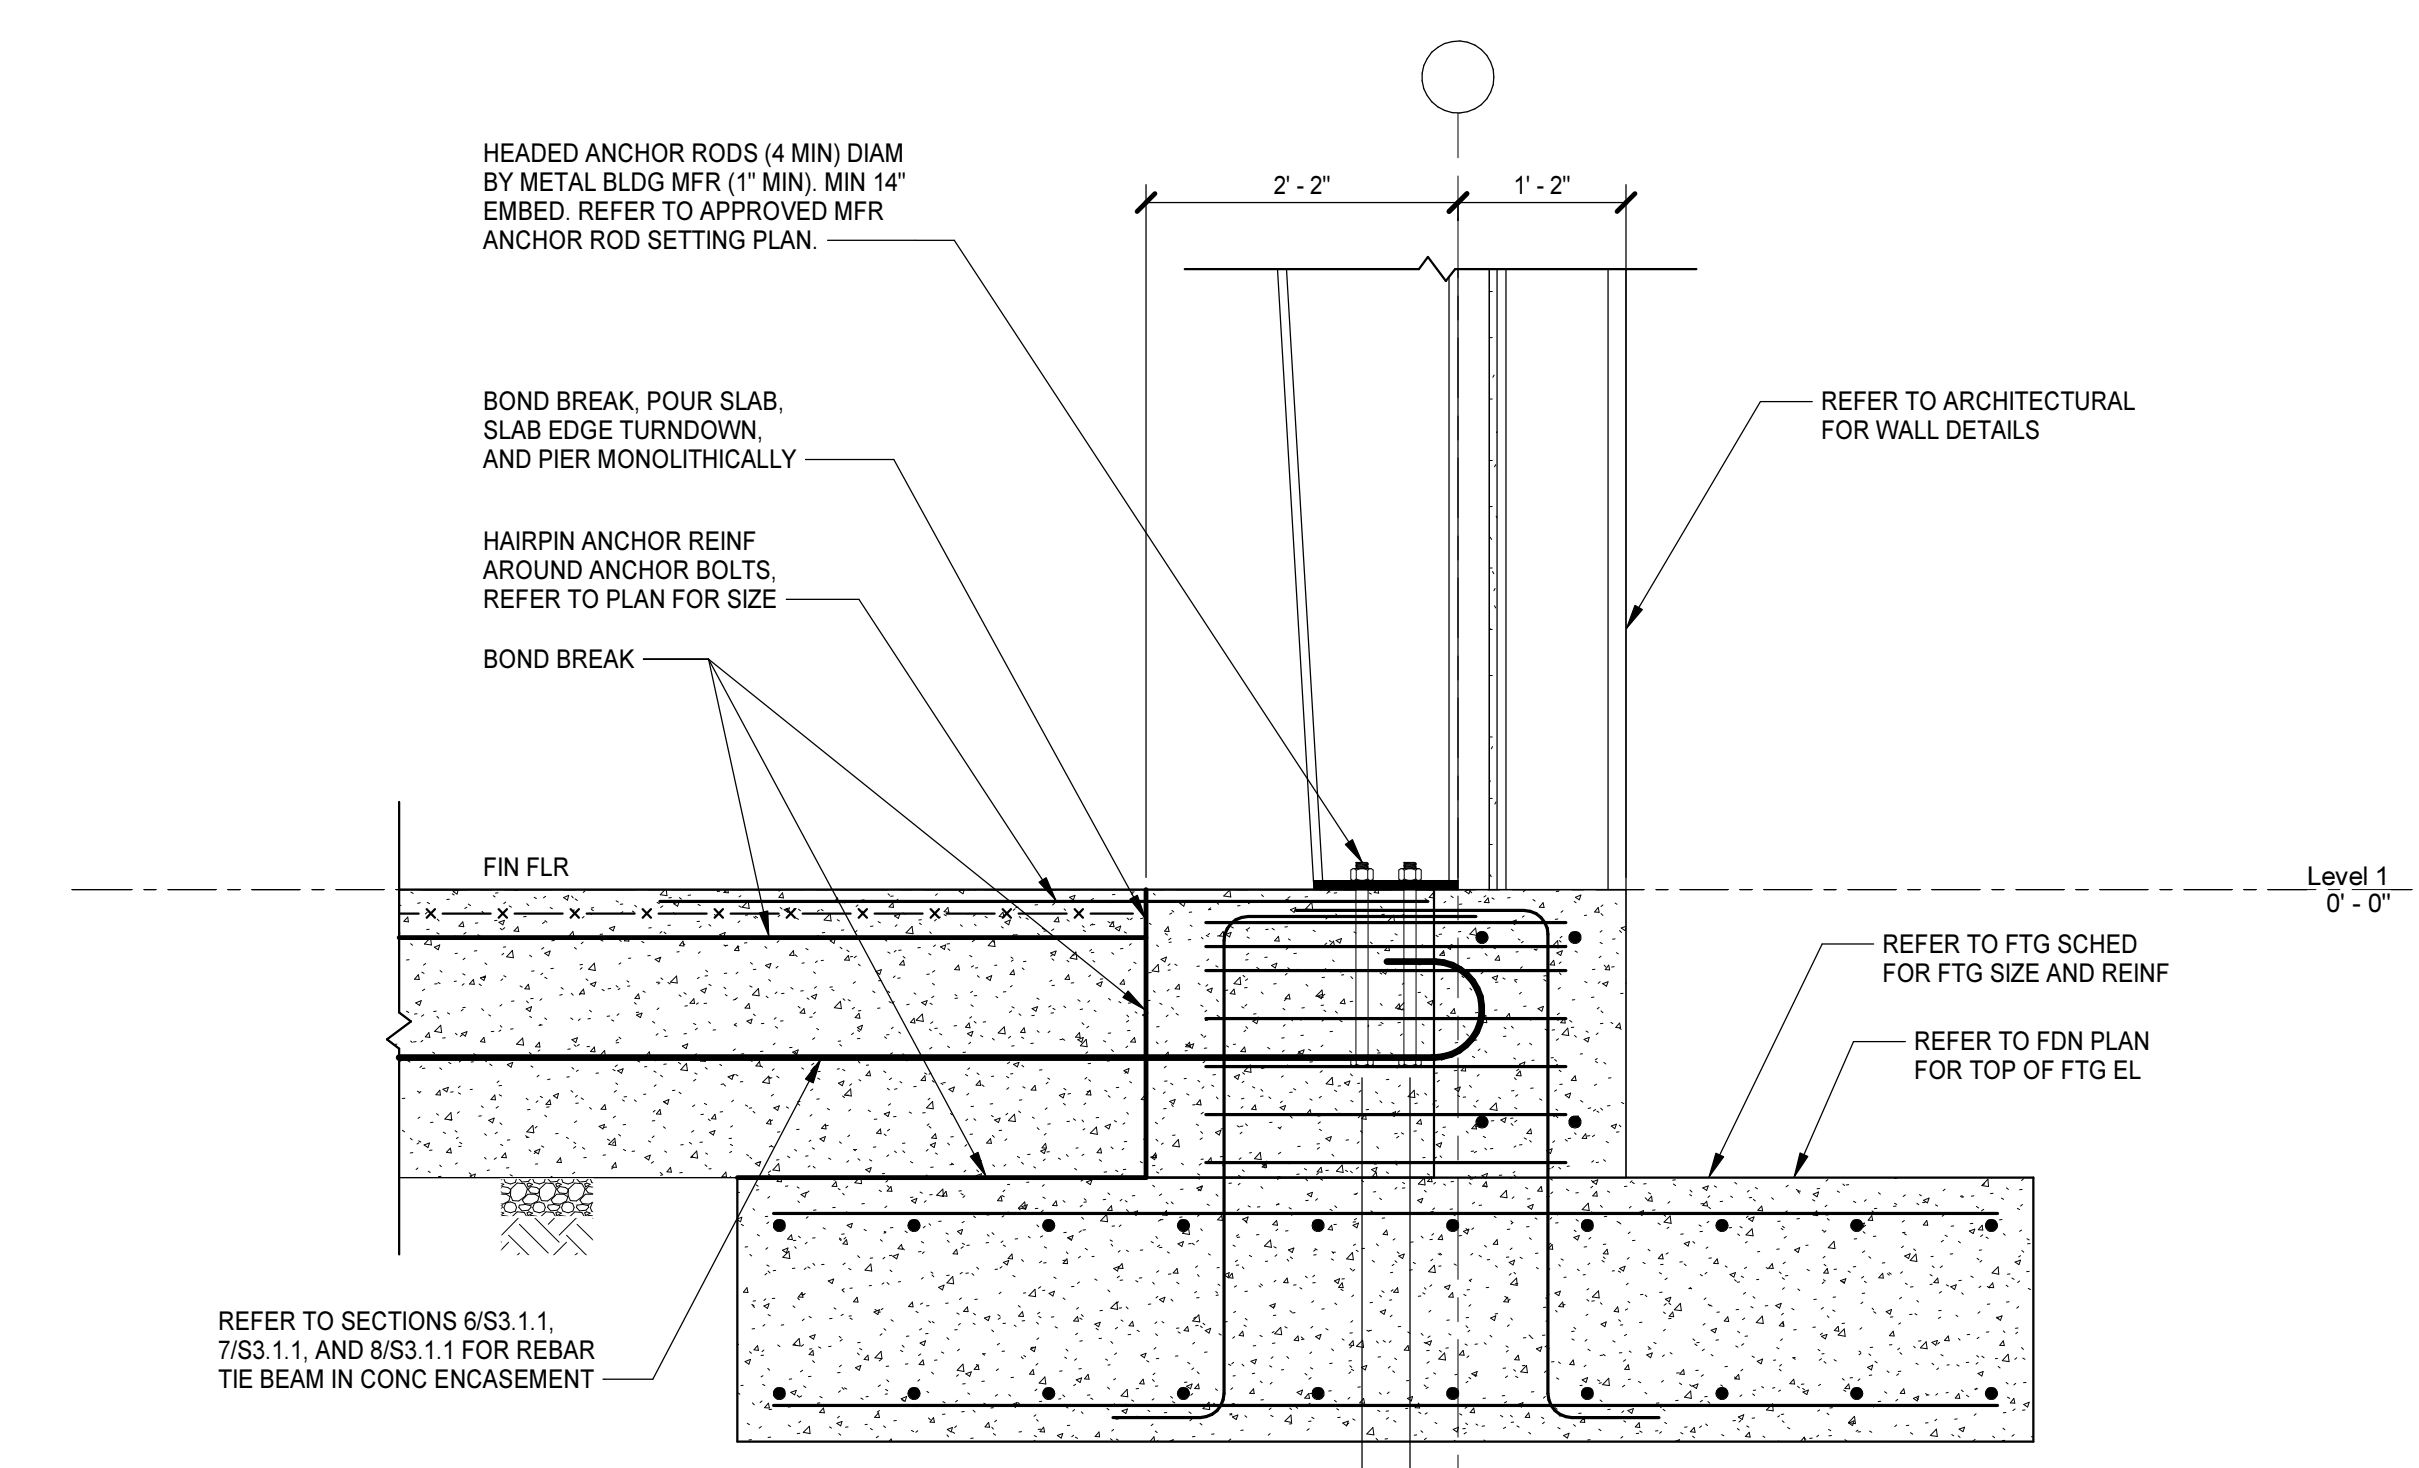


2 SECTION
 S1.1.1 | S3.1.1 | 3/4" = 1'-0"

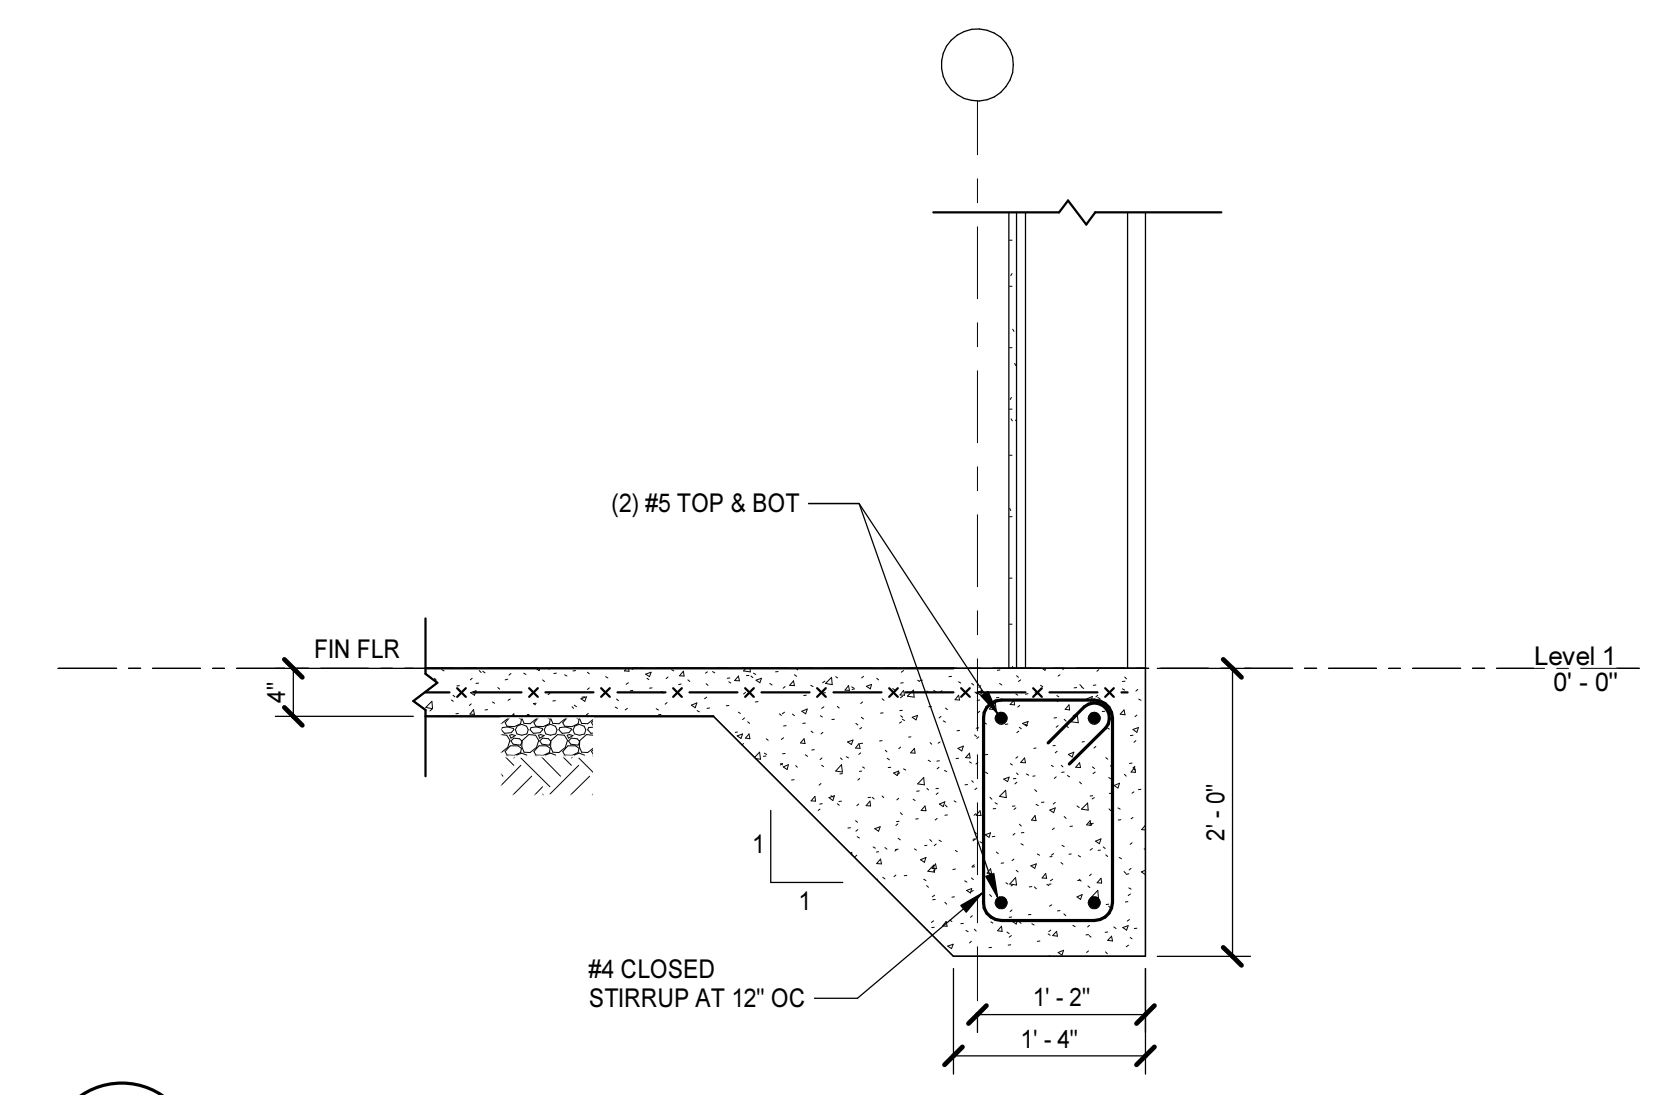

1 SECTION
 S1.1.1 | S3.1.1 | 3/4" = 1'-0"

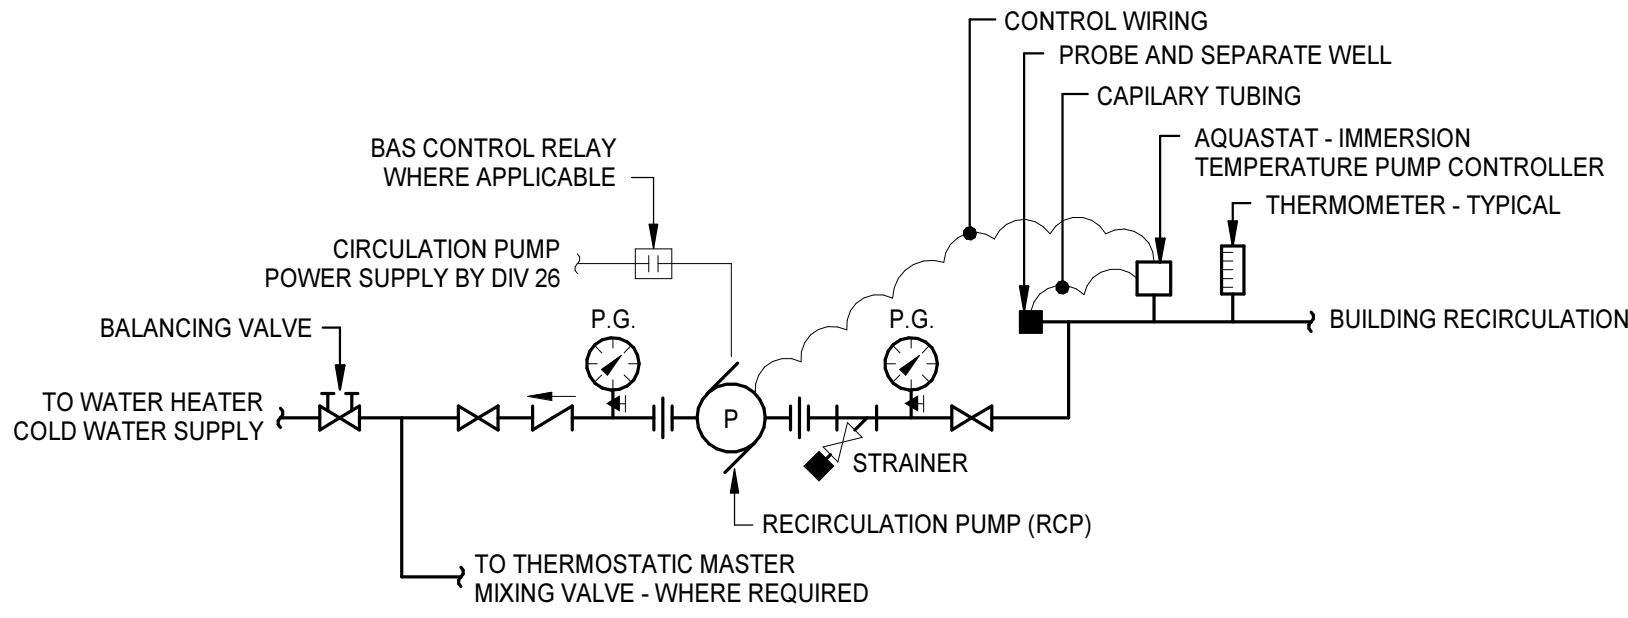

CIRCULATION PUMP DETAIL
NO SCALE

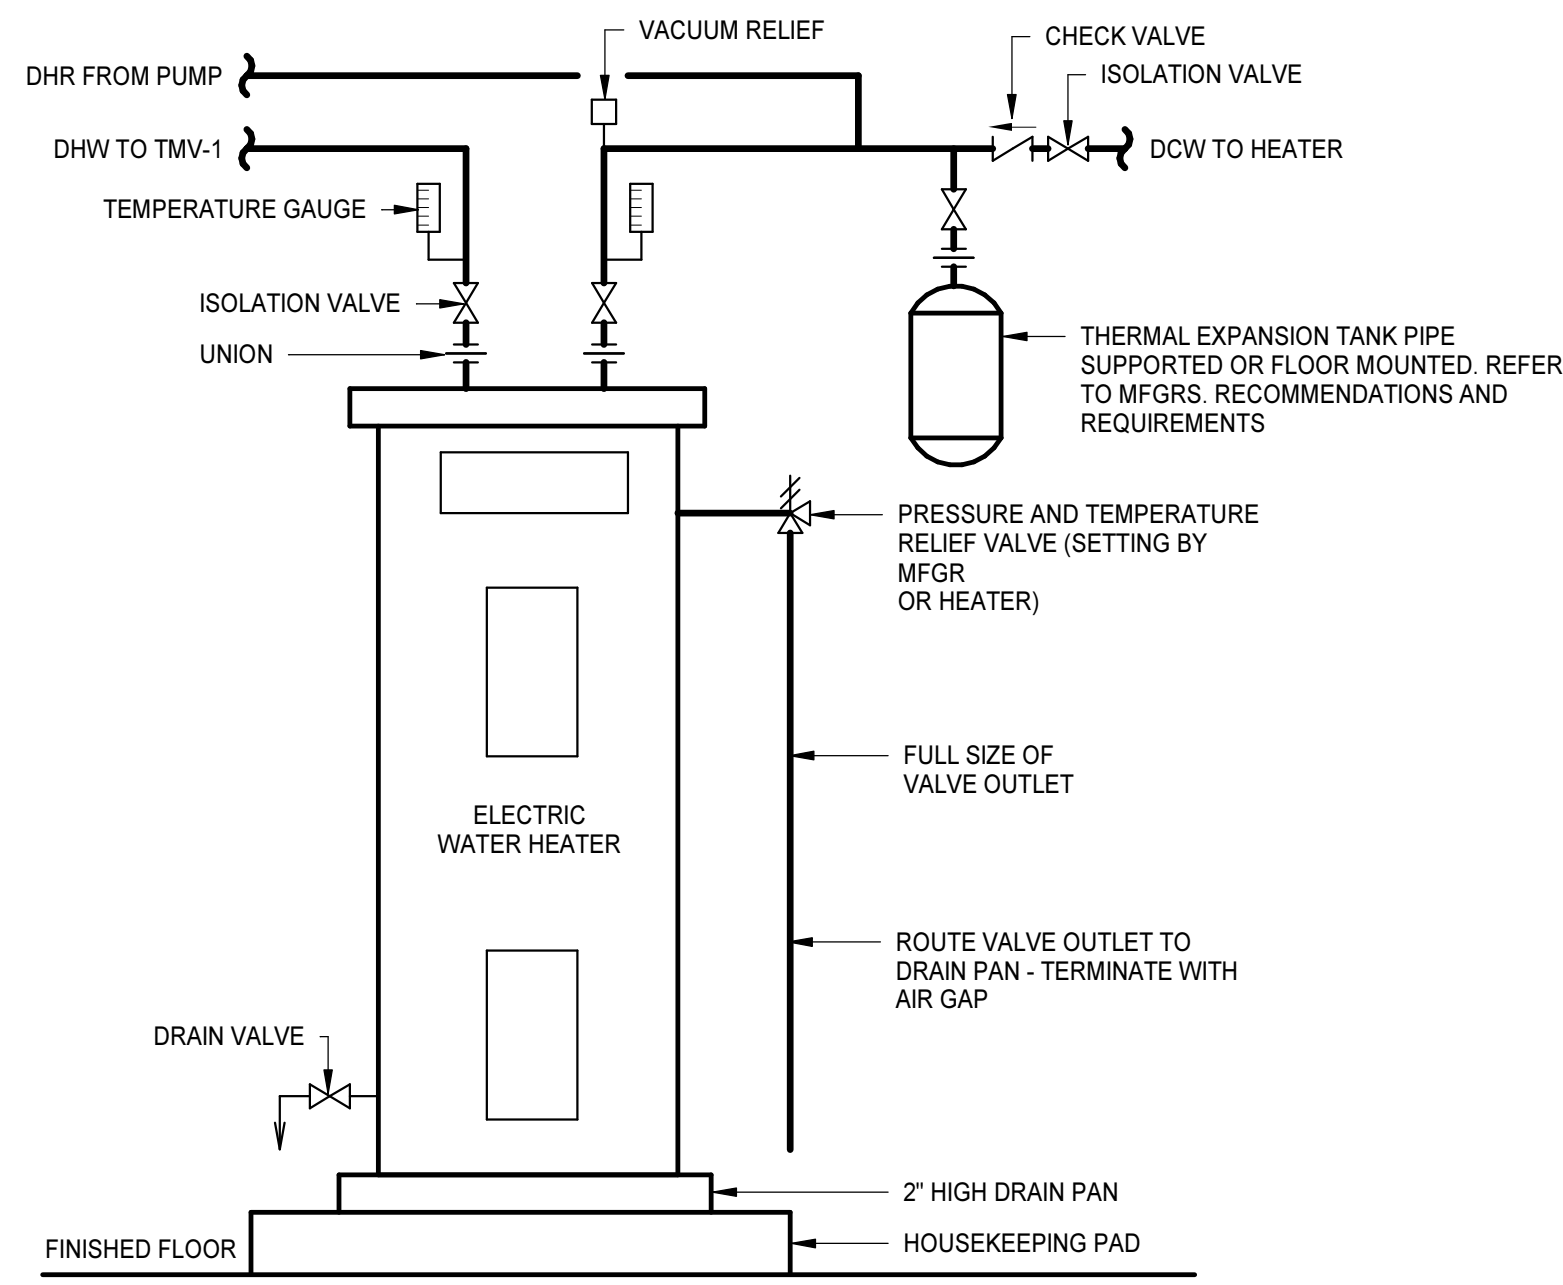


FLOOR MOUNTED ELECTRIC WATER HEATER DETAIL
NO SCALE

ABBREVIATIONS

Table listing abbreviations for plumbing symbols and components, including terms like AT (Air Admittance Valve), EWC (Electric Water Cooler), and PC (Precast).

GRAPHICS SYMBOLS LEGEND

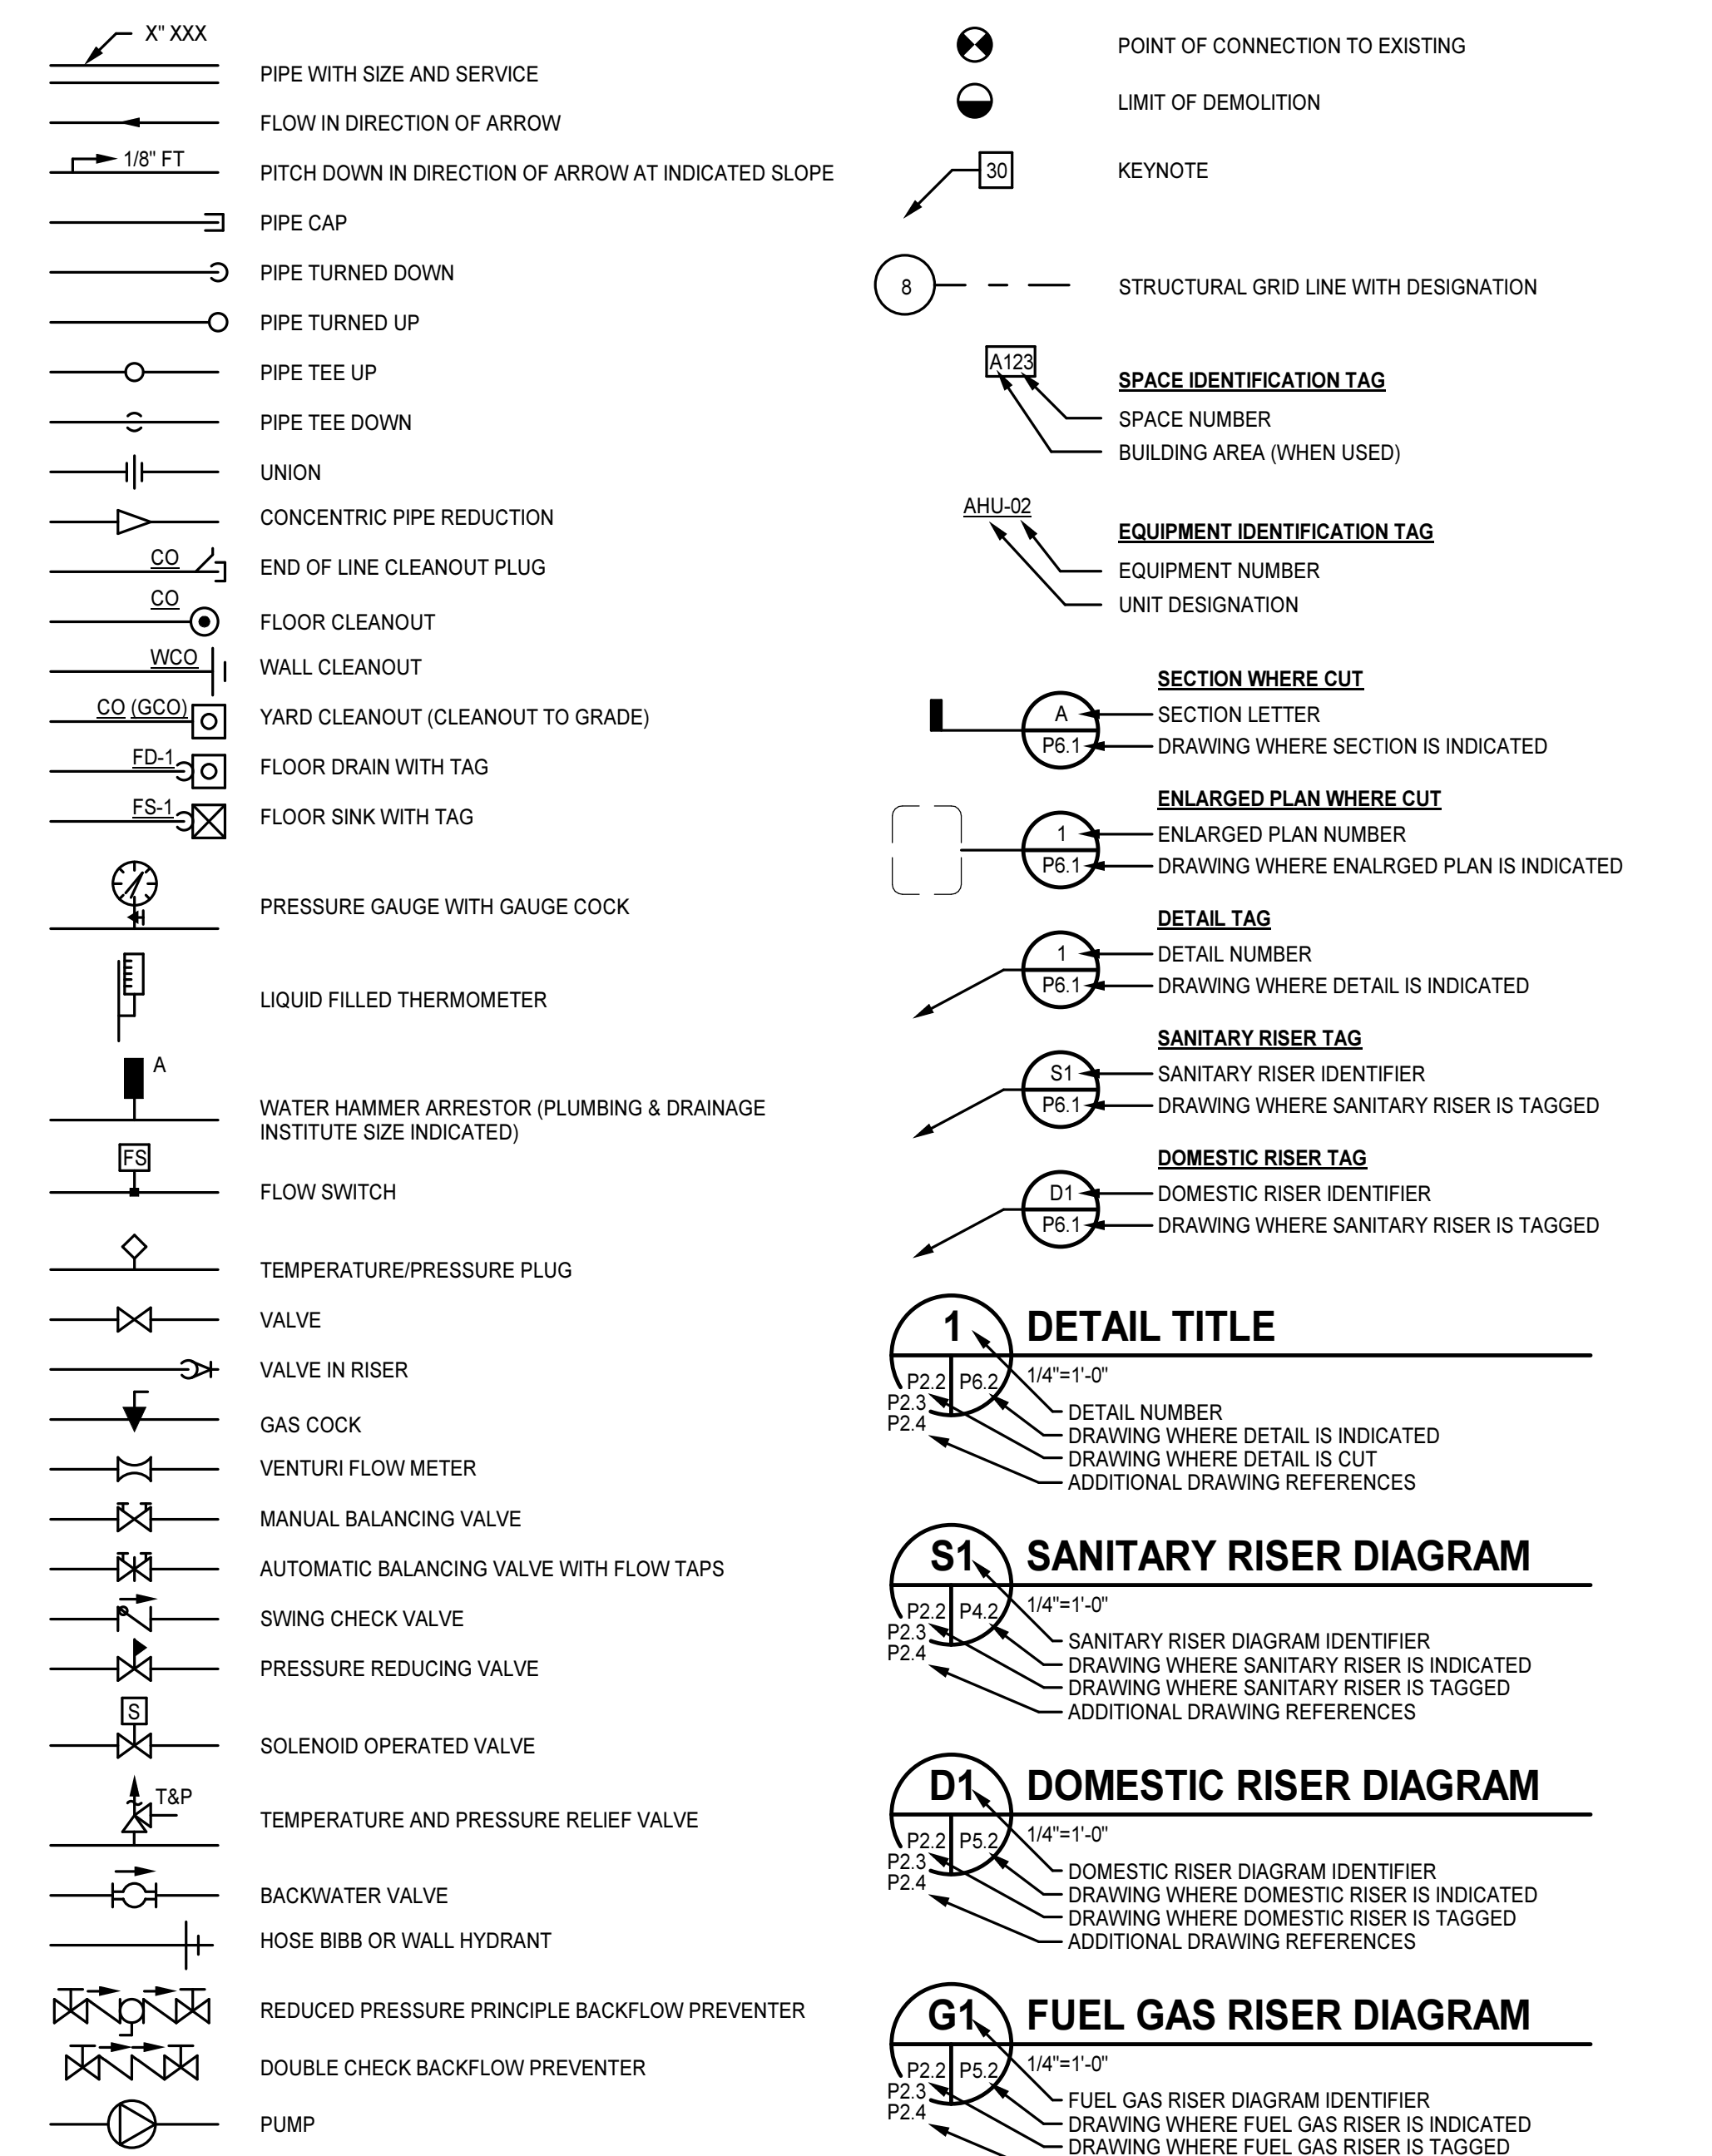

PUMP SCHEDULE

PUMP SCHEDULE table with columns for TAG, BASIS OF DESIGN, LOCATION, SYSTEM TYPE, AREA SERVED, PUMP TYPE, OPERATING DATA, ELECTRICAL DATA, CONNECTION SIZE, and NOTES.

ELECTRIC WATER HEATER SCHEDULE

ELECTRIC WATER HEATER SCHEDULE table with columns for TAG, BASIS OF DESIGN, CAPACITY, RECOVERY RATE, TEMPERATURE RISE, INPUT RATE, VOLTAGE, PHASE, HERTZ, TEMPERATURE SETTING, and NOTES.

BACKFLOW PREVENTER SCHEDULE

BACKFLOW PREVENTER SCHEDULE table with columns for TAG, BASIS OF DESIGN, LOCATION, SYSTEM, SIZE, DESIGN FLOW RATE, PRESSURE DROP, and NOTES.

PLUMBING FIXTURE ROUGHING-IN SCHEDULE

PLUMBING FIXTURE ROUGHING-IN SCHEDULE table with columns for TAG, FIXTURE, HEIGHT A.F.F., COLD WATER, TEPID WATER, HOT WATER, VENT, SOIL WASTE, and NOTES.

DRAIN AND CLEANOUT SCHEDULE

DRAIN AND CLEANOUT SCHEDULE table with columns for TAG, BASIS OF DESIGN, STRAINER/GRATE, and NOTES.

GENERAL DATA

GENERAL DATA table containing PLUMBING GENERAL DATA with columns for Item and Value, including service sizing, storm drainage, and water heaters.

GENERAL NOTES

- A. THE CONTRACT DOCUMENTS ARE COMPLEMENTARY AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL...
B. COORDINATE PIPING LOCATIONS AND INSTALLATION WITH EACH TRADE TO AVOID CONFLICTS WITH OTHER TRADES...
C. PROVIDE FLOOR CLEANOUTS INDICATED FLUSH WITH FLOOR FINISHES...
D. PROVIDE CLEANOUTS WHERE INDICATED AND ADDITIONAL CLEANOUTS AS REQUIRED BY LOCAL CODE...
E. REFER TO DRAWINGS FROM EACH DISCIPLINE BEFORE ROUGHING-IN PLUMBING FIXTURES...
F. OBTAIN DIMENSIONS AND ROUTING IN FIELD BEFORE INSTALLATION OF PLUMBING AND FIXTURES...
G. INSTALL ALL DRAINAGE PATTERN FITTINGS AND PIPING IN ACCORDANCE WITH APPLICABLE FEDERAL, STATE, AND LOCAL CODES...
H. REFER TO STRUCTURAL DRAWINGS FOR DETAILS AND MAXIMUM SPACING REQUIREMENTS REGARDING HANGER ATTACHMENTS TO STEEL BAR JOISTS...
I. PROVIDE ISOLATION VALVES IN ACCORDANCE WITH DIAGRAMS, DETAILS, AND DIVISION 22 SPECIFICATIONS.

**PROGRESS
 PRINT NOT FOR
 CONSTRUCTION**

GEORGETOWN COUNTY RE-ENTRY FACILITY


611315
 GEORGETOWN COUNTY
 GEORGETOWN, SOUTH CAROLINA

PROJECT NO:	611315
DATE:	DECEMBER 8, 2023
REVISIONS	
DATE	DESCRIPTION


PLUMBING FIRST
 FLOOR PLANS

FIRE PROTECTION KEYNOTES
 APPLIES TO DRAWINGS FP2.1 - FP2.n
 REPRESENTED BY [Symbol]


1. KEYNOTE 1.
 2. KEYNOTE 2.

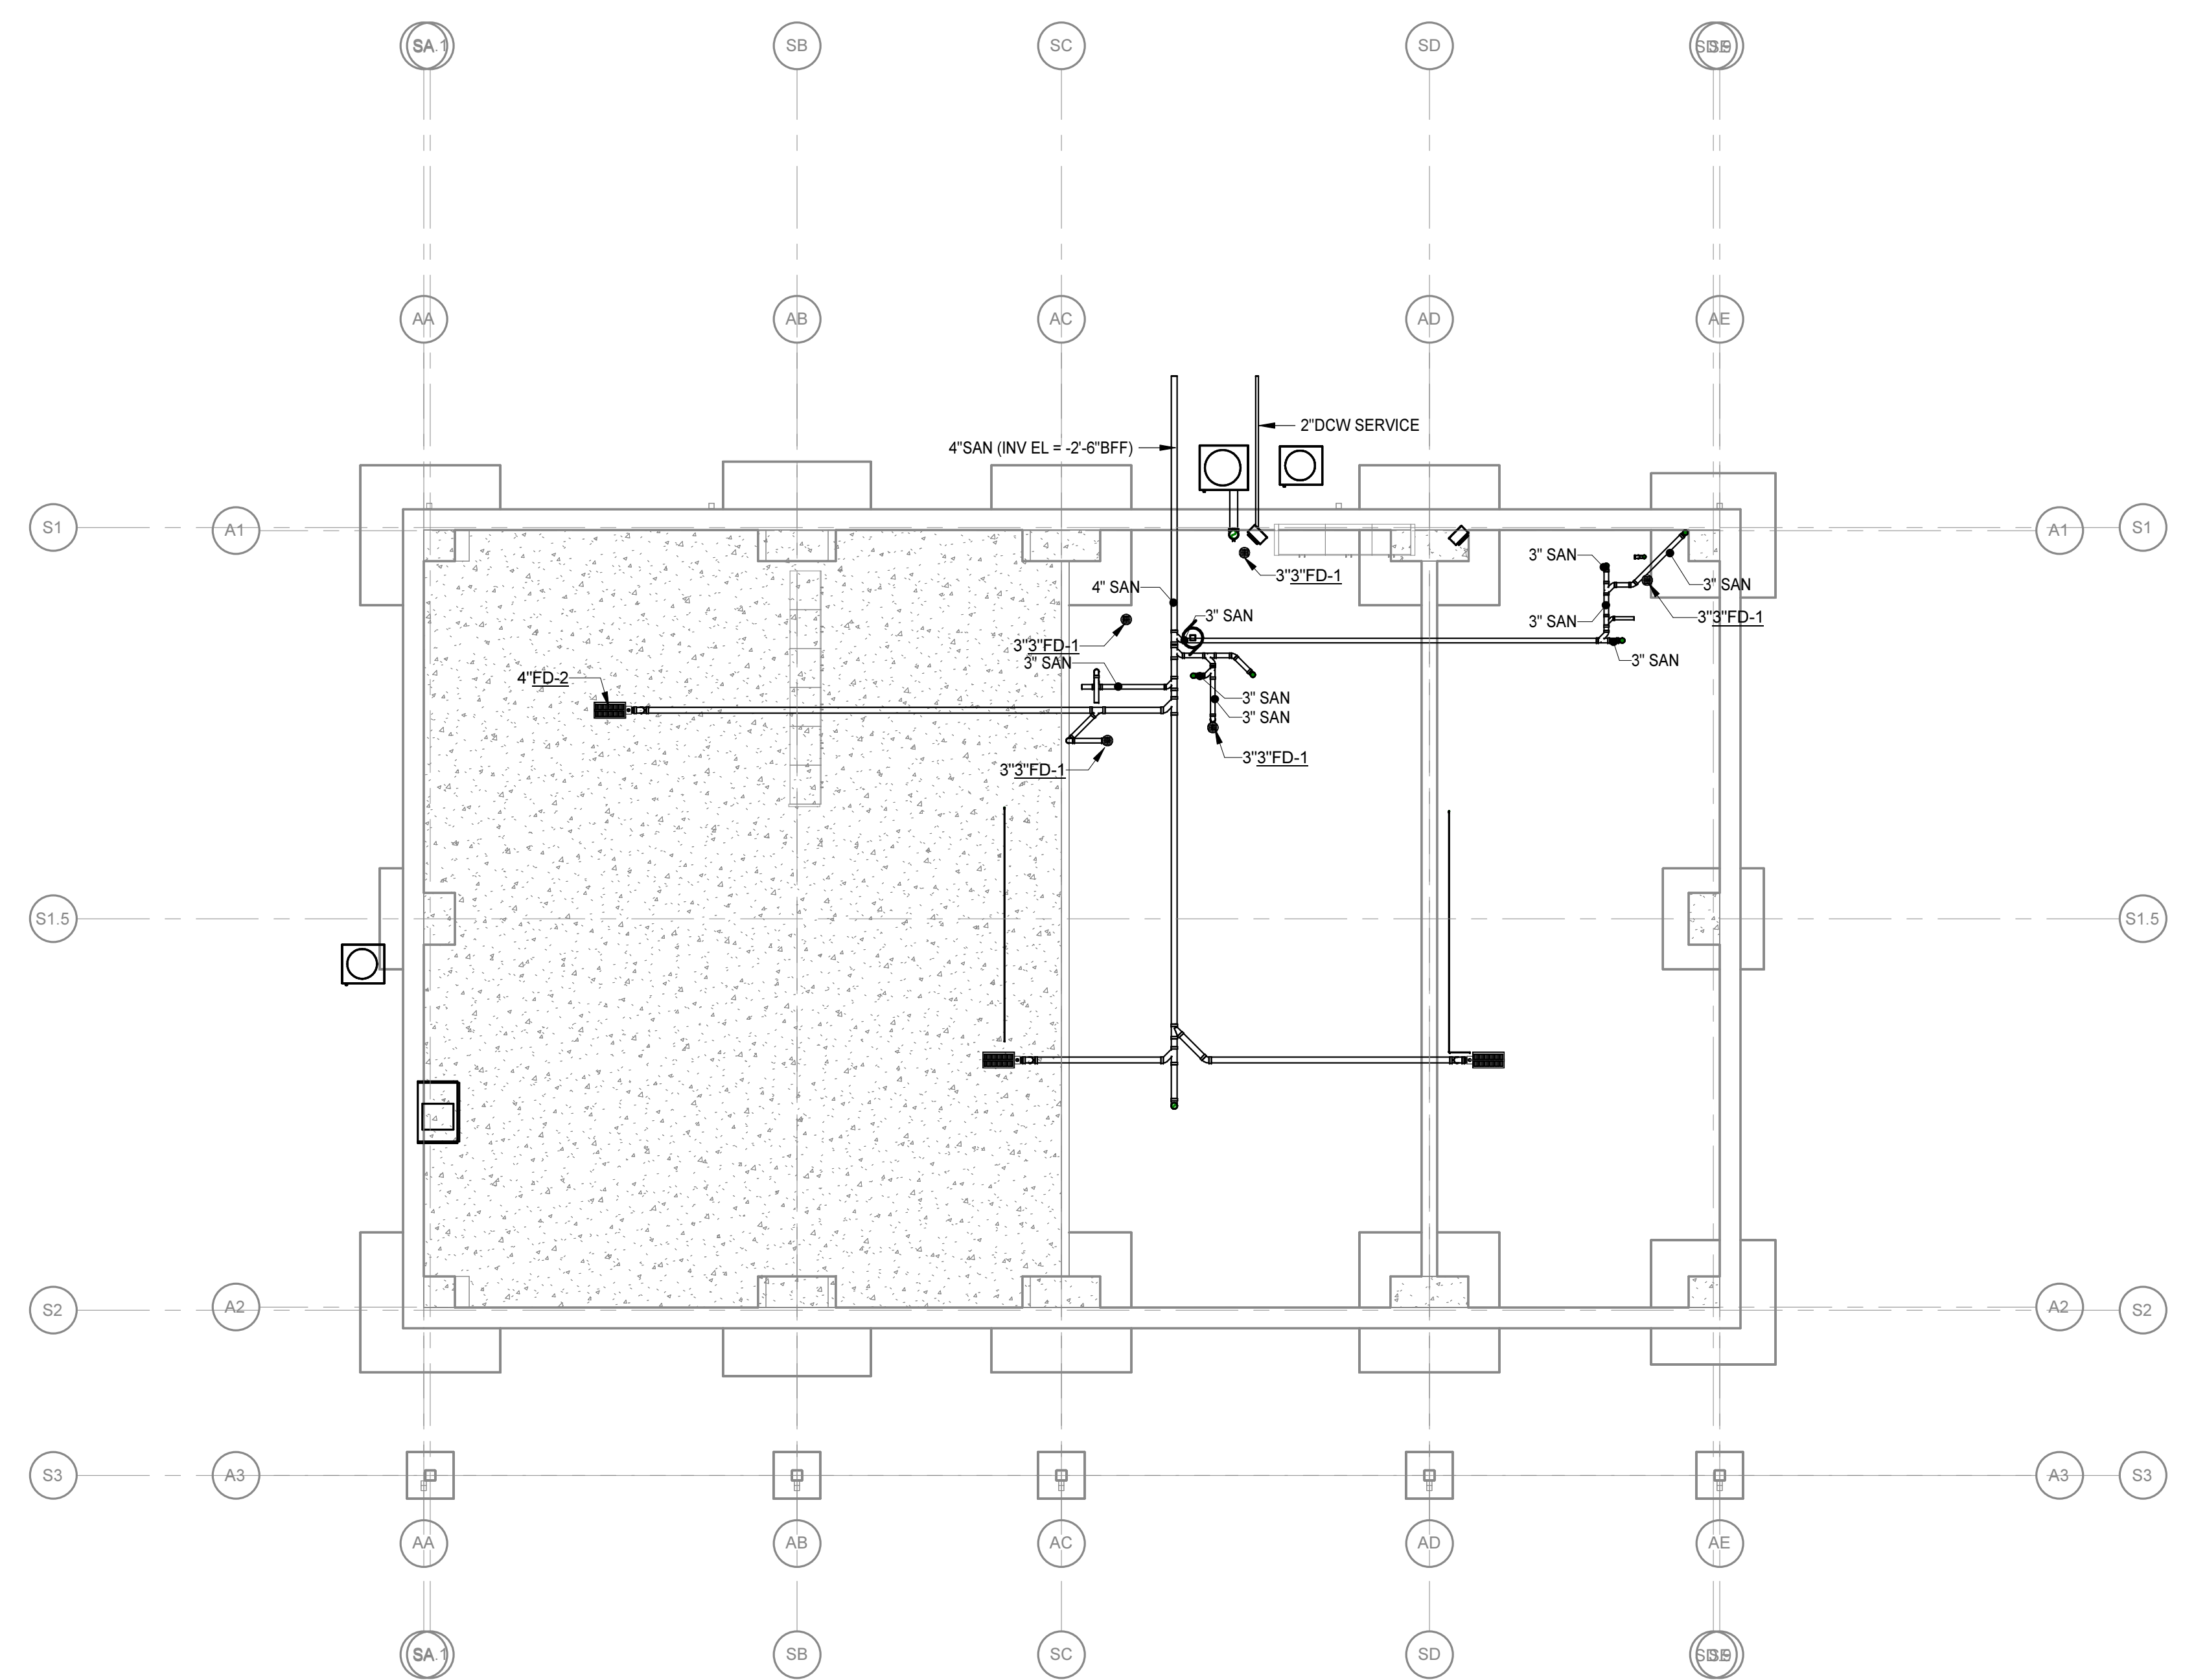


FOUNDATION PLAN - PLUMBING
 1/8" = 1'-0"

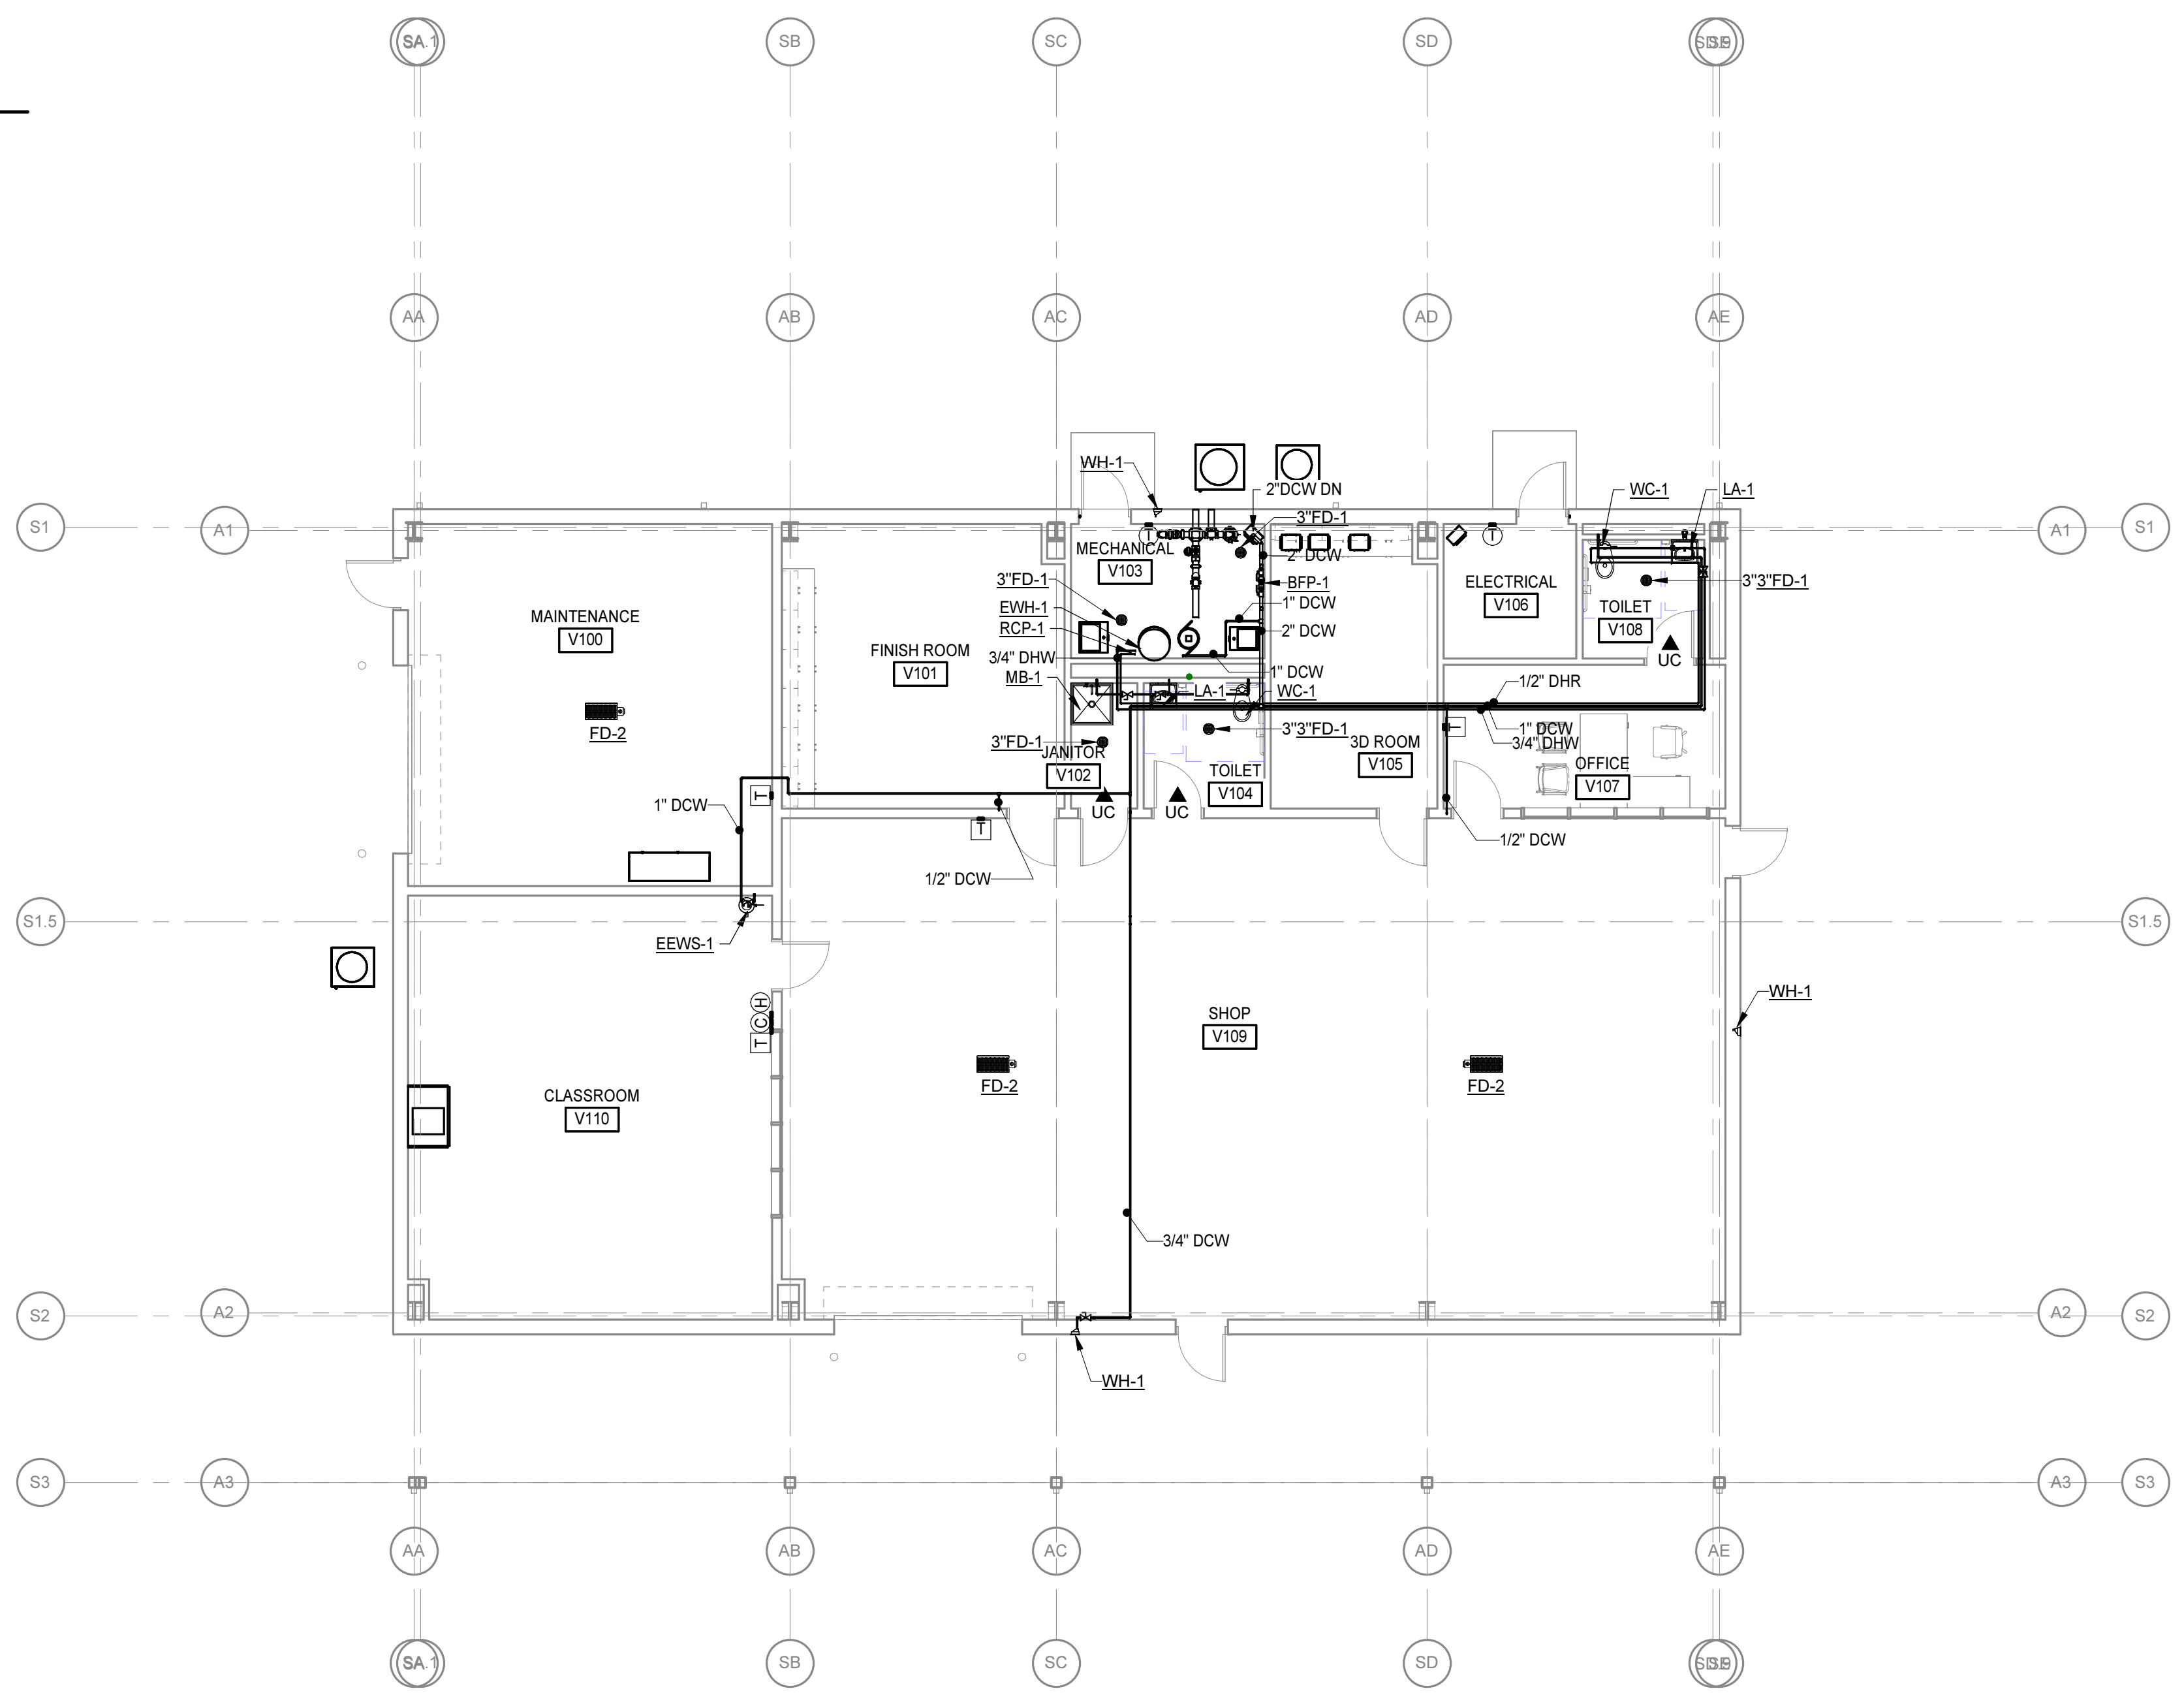

FIRST FLOOR PLAN - PLUMBING
 1/8" = 1'-0"

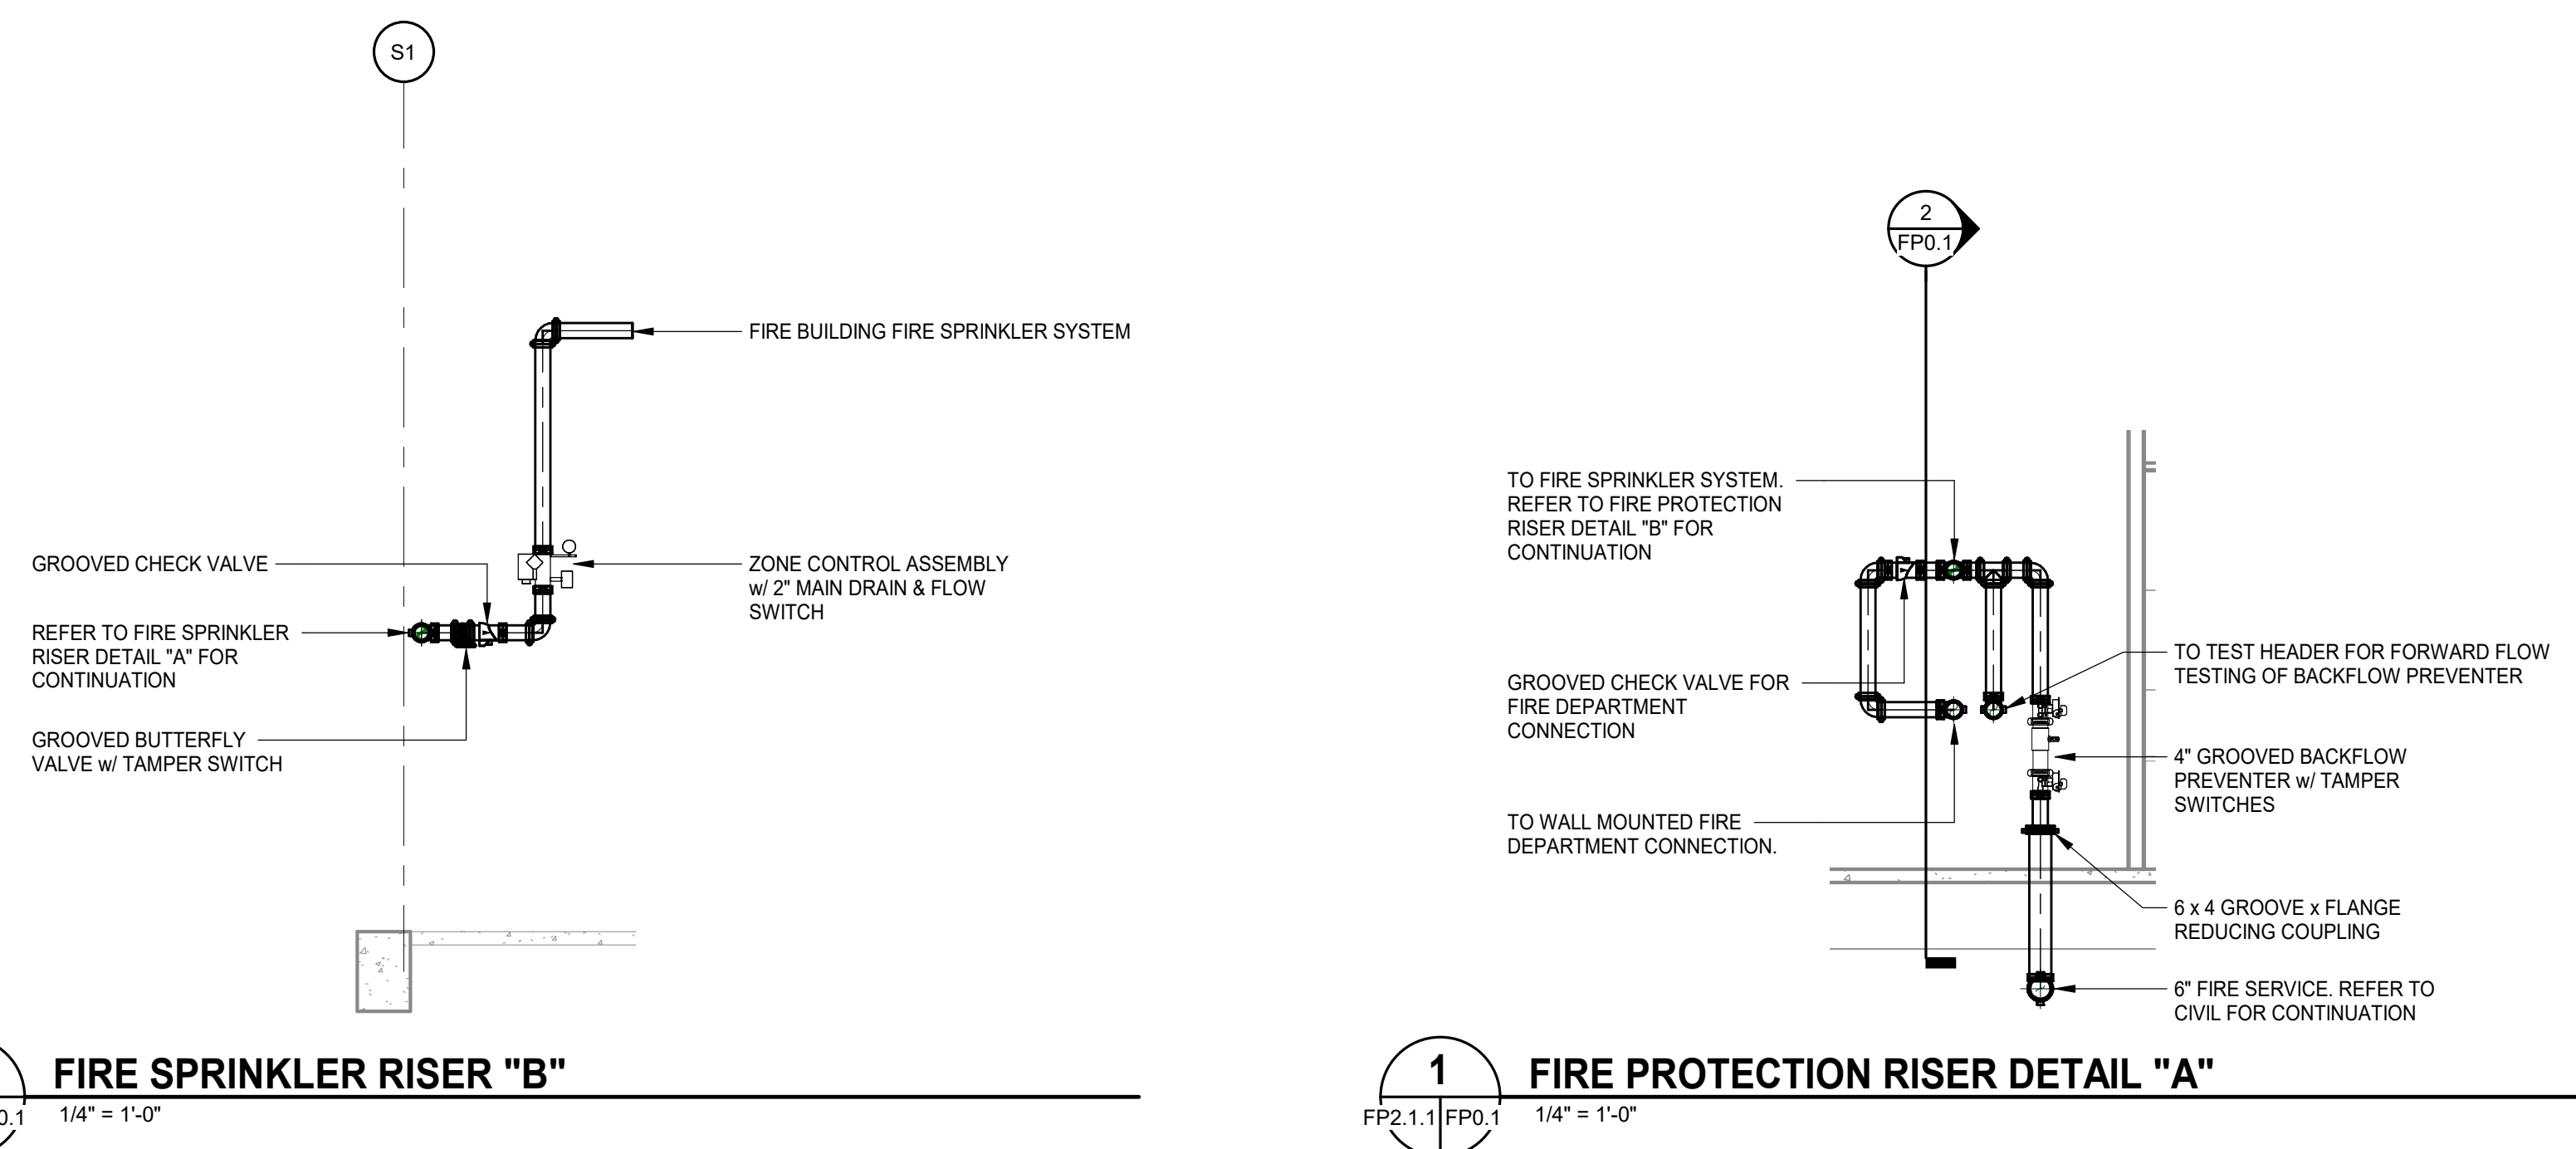

ABBREVIATIONS	
@	AT ABOVE
ABV	ABOVE FINISHED FLOOR
AFB	ABOVE FINISHED GRADE
AFG	AIR HANDLING UNIT
AHU	BUILDING
BLDG	CENTERLINE
CL	CEILING
CLG	COLUMN
COL	CONCRETE
CONC	CONTINUATION
CONT	CORRIDOR
CORR	CLASSROOM
CR	CU
CU	CUBIC FEET
CU FT	DOMESTIC COLD WATER
DCW	DEGREES(S)
DEG	DEMOLISH OR DEMOLITION
DEMO	DIAMETER
DIA	DUCTILE IRON PIPE
DIP	DOWN
DN	DRY PIPE
DP	DOWNSPOUT
DS	DETAIL
DTL	DRAWING
DWG	EAST
E	ELECTRIC CEILING HEATER
ECGH	EXHAUST FAN
EF	EXTRA HAZARD GROUP 1
EH-1	EXTRA HAZARD GROUP 2
EH-2	ELECTRICAL
ELEC	EQUAL
EQ	EQUIPMENT
EQUIP	EXPANSION TANK
ET	EXISTING TO REMAIN
ETR	ELECTRIC WATER HEATER
EW	EXISTING
EX	EXPANSION
EXP	FARENHEIT
F	FIRE DEPARTMENT CONNECTION
FD	FINISHED GRADE
FG	FIRE HYDRANT
FG	FIRE HOSE CABINET
FH	FIRE HOSE STATION
FHC	FIRE HOSE VALVE CABINET
FHS	FIRE PROTECTION
FHVC	FOOT OR FEET
FLR	FIRE VALVE CABINET
FLOOR	FIRE VALVE CONNECTION
FP	FIRE VALVE
FT	FIRE VALVE CABINET
FT	FIRE VALVE CABINET
FV	FIRE VALVE CABINET
FV	FIRE VALVE CABINET
GAL	GALLONS
GAL	GALLONS PER MINUTE
GPM	GAS-FIRED UNIT HEATER
GUH	HEAD
GUH	HEAD
HD	HEAD
HD	HEAD
HORIZ	HORIZONTAL
HP	HORSEPOWER
HP	HOT WATER
HW	HOT WATER
HW	HOT WATER
ID	INSIDE DIAMETER
ID	INSIDE DIAMETER
IN	INCH
IN	INCH
INSUL	INSULATE OR INSULATION
JAN	JANITOR
JAN	JANITOR
KIT	KITCHEN
KIT	KITCHEN
KW	KILOWATT(S)
KW	KILOWATT(S)
LAB	LABORATORY
LAB	LABORATORY
LAV	LAVATORY
LAV	LAVATORY
LBS	POUNDS
LBS	POUNDS
LF	LINEAR FOOT (FEET)
LH	LIGHT HAZARD
LH	LIGHT HAZARD
MATL	MATERIAL
MAX	MAXIMUM
MECH	MECHANICAL
MFR	MANUFACTURER
MFR	MANUFACTURER
MN	MANHOLE
MN	MANHOLE
MIN	MINIMUM
MISC	MISCELLANEOUS
MTD	MOUNTED
N	NORTH
NA	NOT APPLICABLE/AVAILABLE
NC	NORMALLY CLOSED
NC	NORMALLY CLOSED
NIC	NOT IN CONTRACT
NO	NORMALLY OPEN
NO	NORMALLY OPEN
NO. OR #	NUMBER
OC	ON CENTER
OD	OUTSIDE DIAMETER
OFCI	OWNER FURNISHED CONTRACTOR INSTALLED
OFF	OFFICE
OH-1	ORDINARY HAZARD GROUP 1
OH-2	ORDINARY HAZARD GROUP 2
P	PUMP
PC	PRECAST
PV	POST INDICATOR VALVE
PV	POST INDICATOR VALVE
POLY	POLYETHYLENE
PREFAB	PREFABRICATE(D)
PROJ	PROJECT
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PSIG	POUNDS PER SQUARE INCH GAUGE
PVC	POLYVINYL CHLORIDE
R	RISER
REF	REFERENCE
REQ	REQUIRED
RM	ROOM
RPM	REVOLUTIONS PER MINUTE
RTU	ROOF TOP UNIT
S	SOUTH
SAN	SANITARY
SCH	SCHEDULE
SD	SMOKE DAMPER
SHT	SHEET
SIM	SIMILAR
SP	STATIC PRESSURE
SPEC	SPECIFICATION
SPR	SPRINKLER
SQ	SQUARE
STD	STANDARD
STL	STEEL
STOR	STORAGE
SW	SWITCH
T	TEMPERATURE
THK	THICKNESS
TLT	TILE
TOSL	TOP OF SLAB
TYP	TYPICAL
UG	UNDERGROUND
UH	UNIT HEATER
UN	UNLESS UNDCATED
UNO	UNLESS NOTED (INDICATED) OTHERWISE
V	VOLTS
VERT	VERTICAL
W	WEST
W	WITH
W/O	WITHOUT
WH	WATER HEATER

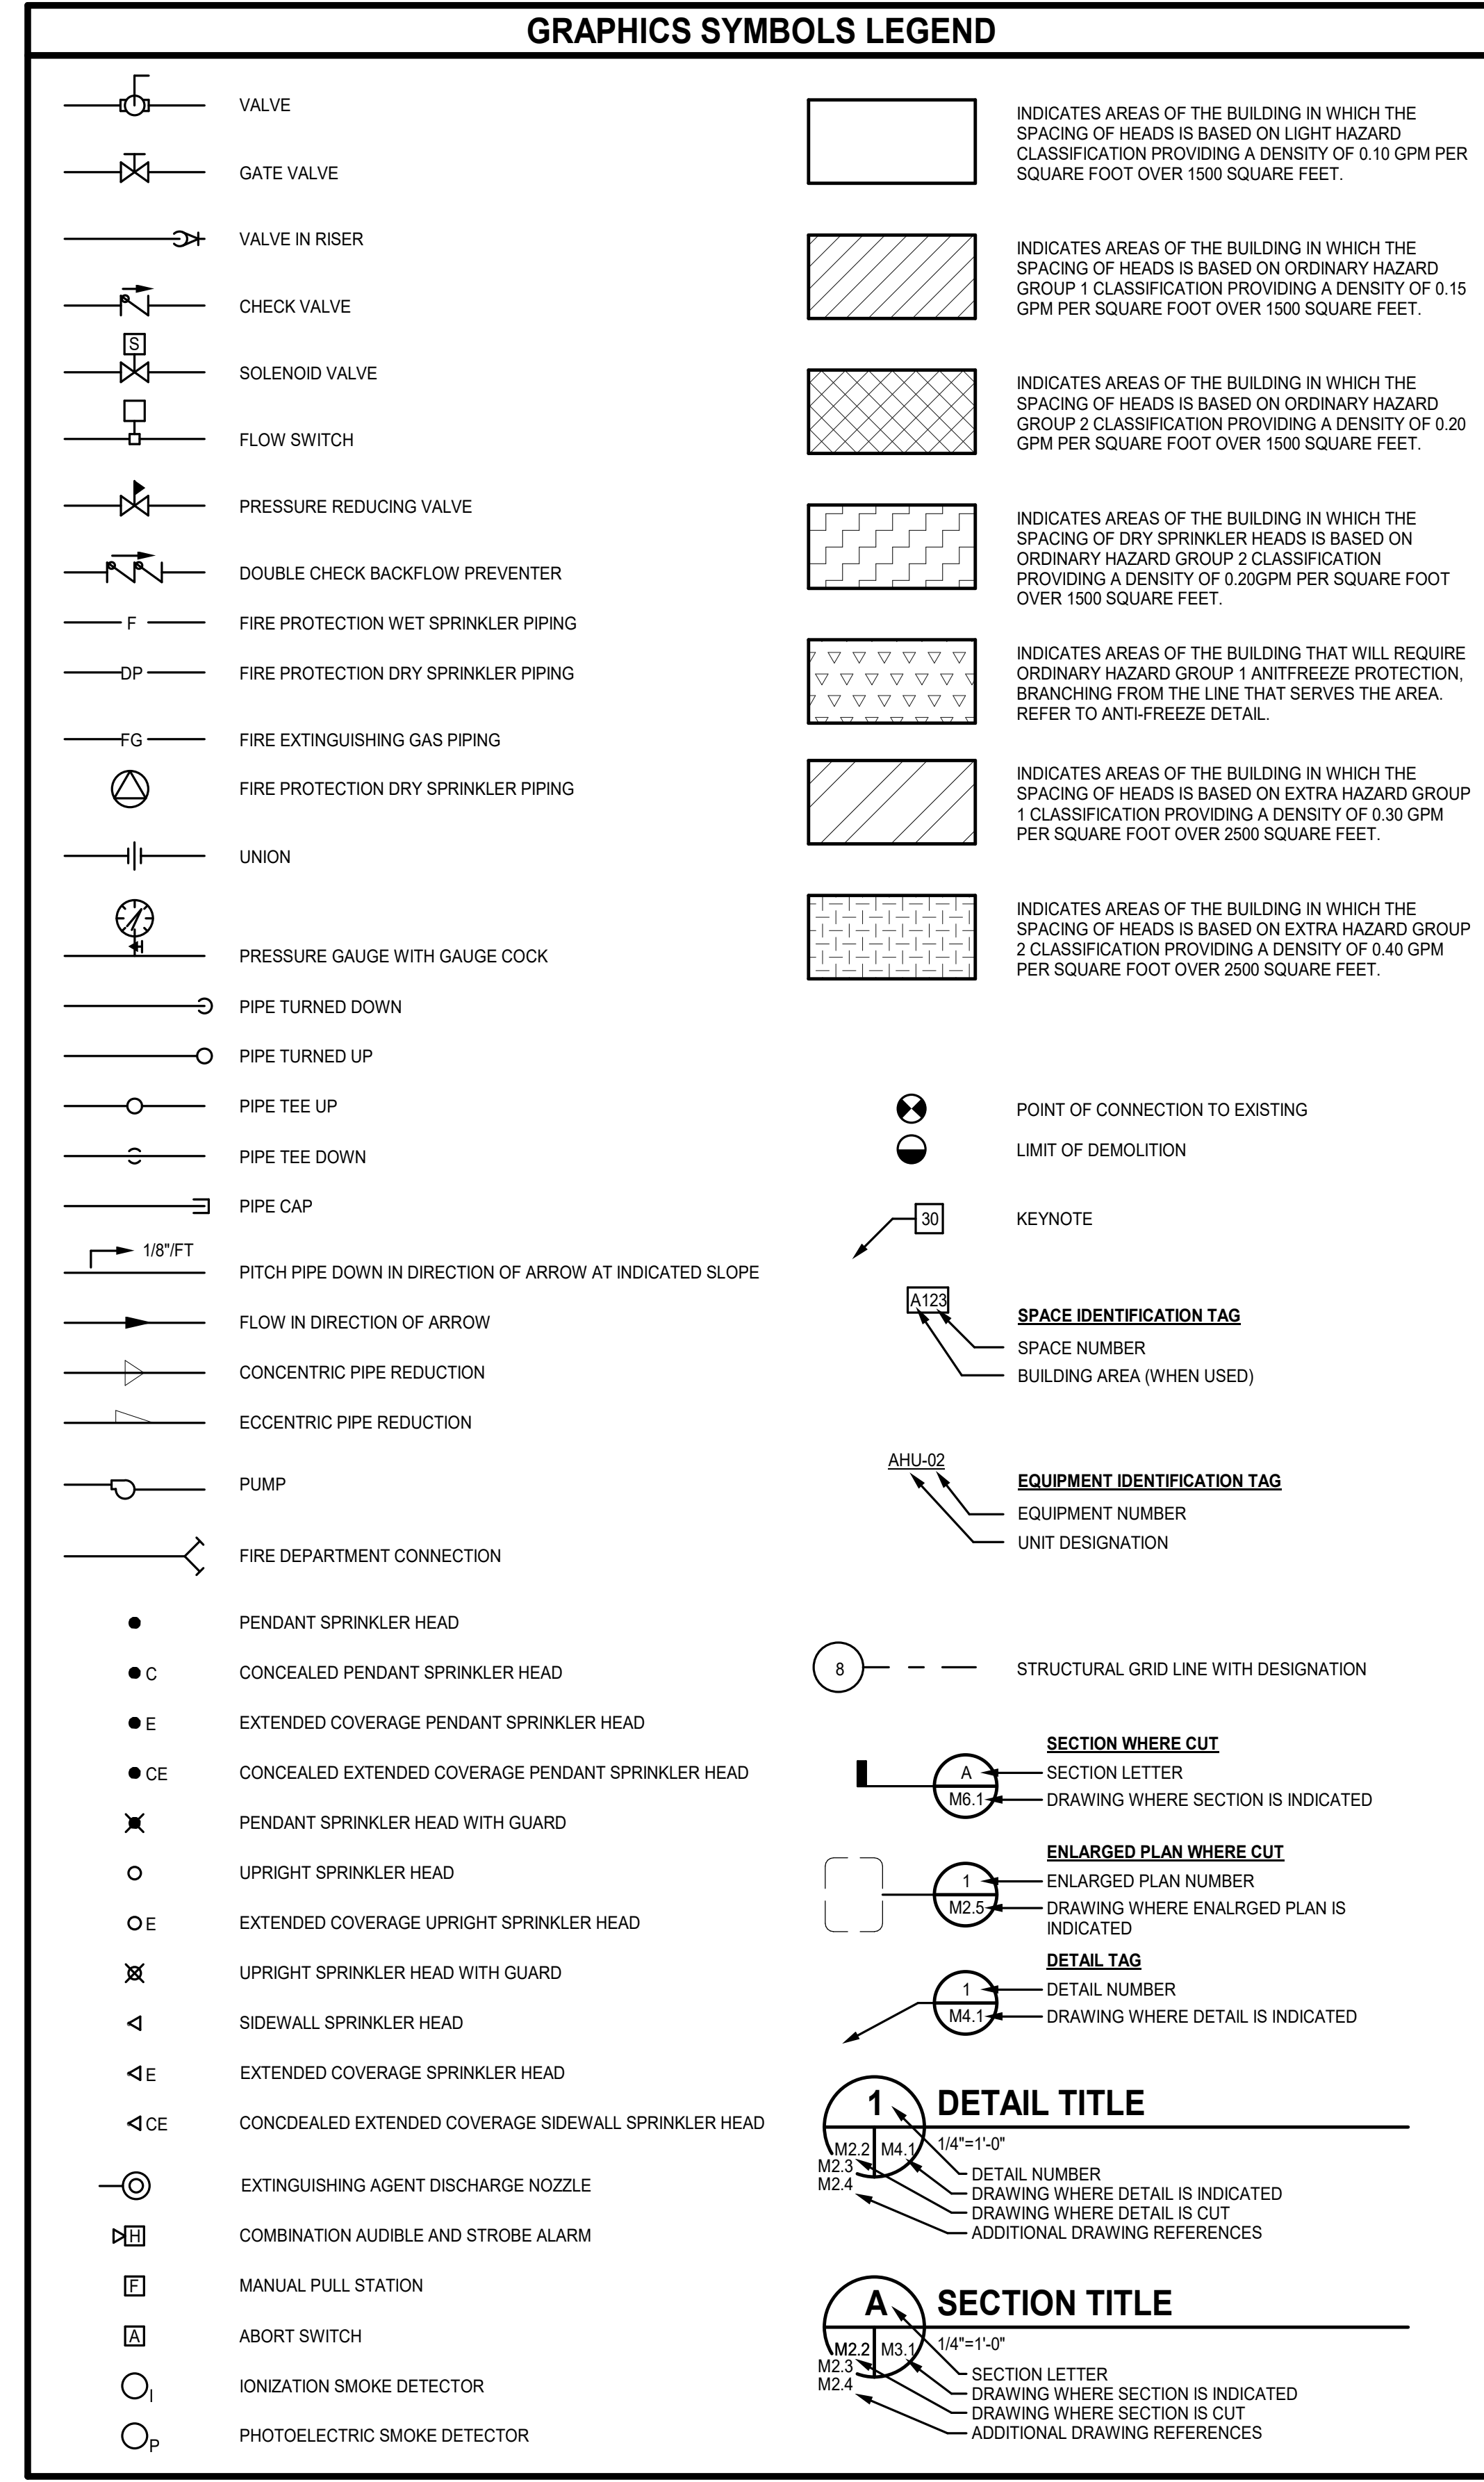

GENERAL NOTES

THE CONTRACT DOCUMENTS ARE COMPLEMENTARY AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL. IN THE CASE OF A CONFLICT, DISAGREEMENT, OR AMBIGUITY, PROVIDE THE BETTER QUALITY. IN THE CASE OF A CONFLICT, DISAGREEMENT, OR AMBIGUITY, PROVIDE THE GREATER QUANTITY OF WORK.

COORDINATE THE LOCATION OF ALL SPRINKLER PIPING WITH THE WORK OF OTHER TRADES. SPRINKLER PIPING SHALL NOT BE INSTALLED WHERE ITS LOCATION INHIBITS ACCESS TO EQUIPMENT ABOVE THE CEILING, FILTER ACCESS OR INFRINGES UPON CLEARANCES DICTATED BY THE NATIONAL ELECTRIC CODE.

VERIFY DIMENSIONS AND ROUTING IN FIELD BEFORE FABRICATION OF PIPING AND FIXTURES.

REFER TO THE LIFE SAFETY PLAN FOR LOCATIONS OF FIRE AND SMOKE SEPARATION ASSEMBLIES.

REFER TO STRUCTURAL DRAWINGS FOR DETAILS AND MAXIMUM SPACING REQUIREMENTS REGARDING HANGER ATTACHMENTS TO STEEL BAR JOISTS.

PROVIDE A COMPLETE WET PIPE SPRINKLER SYSTEM THROUGHOUT THE BUILDING IN ACCORDANCE WITH 2018 VIRGINIA BUILDING CODE, 2016 NFPA 13 AND ALL OTHER REQUIREMENTS SET FORTH BY LOCAL AUTHORITY HAVING JURISDICTION. INSTALLATION DRAWINGS SHALL BE PREPARED BY A PROFESSIONAL ENGINEER LICENSED TO PRACTICE IN THE STATE OF SOUTH CAROLINA OR BY A NICET LEVEL III OR IV DESIGNER CERTIFIED IN THE FIELD OF WATER BASED SYSTEMS LAYOUT.

PIPE ALL SYSTEM DRAINS TO AN APPROVED LOCATION ON THE OUTSIDE PERIMETER OF BUILDING. DO NOT DISCHARGE DRAIN INTO A JANITORS SINK WITHOUT APPROVAL FROM PLUMBING ENGINEER.

DESIGN FLOW DATA

THE FOLLOWING DATA SHALL BE USED FOR BID PURPOSES ONLY. CONFIRM DATA PRIOR TO CALCULATING PIPE SIZES.

LOCATION OF TEST: BROWNS FERRY RD & B A GRANTHAM RD

STATIC PRESSURE: 70 psi

RESIDUAL PRESSURE: 60 psi

FLOW AT TIME OF TEST: 1130 gpm

DATE OF TEST: 8/29/2023

SPRINKLER HEADS

IN SUSPENDED ACOUSTICAL CEILINGS: PROVIDE RECESSED, QUICK RESPONSE, GLASS BULB PENDENT TYPE SPRINKLERS w/ CHROME FINISH AND MATCHING ESCUTCHEON.

FOR HORIZONTAL SIDEWALL APPLICATIONS: PROVIDE RECESSED, QUICK RESPONSE, GLASS BULB TYPE SPRINKLERS w/ CHROME FINISH AND MATCHING ESCUTCHEON.

IN EQUIPMENT, STORAGE AND OTHER SIMILAR ROOMS WITHOUT SUSPENDED CEILINGS: PROVIDE STANDARD UPRIGHT, QUICK RESPONSE, QUICK RESPONSE w/ BRASS FINISH.

IN AREAS SUBJECT TO FREEZING TEMPERATURES SUPPLIED BY WET PIPE SPRINKLER SYSTEM: PROVIDE QUICK RESPONSE, FUSIBLE LINK TYPE DRY PIPE SPRINKLERS.


PROVIDE INTERMEDIATE TEMPERATURE SPRINKLERS WHEN INSTALLED 2'-6" OR LESS TO AN HVAC SUPPLY DIFFUSER IN CEILINGS AS REQUIRED BY NFPA 13 TABLE 8.3.2.5(a) ITEM (C) FOR HORIZONTAL DISCHARGE.

INSTALL SPRINKLERS IN CENTER OF ACOUSTICAL TILE CEILING PANELS.

2/25/2024 5:43:09 PM

J
I
H
G
F
E
D
C
B
A

1 2 3 4 5 6 7 8 9 10

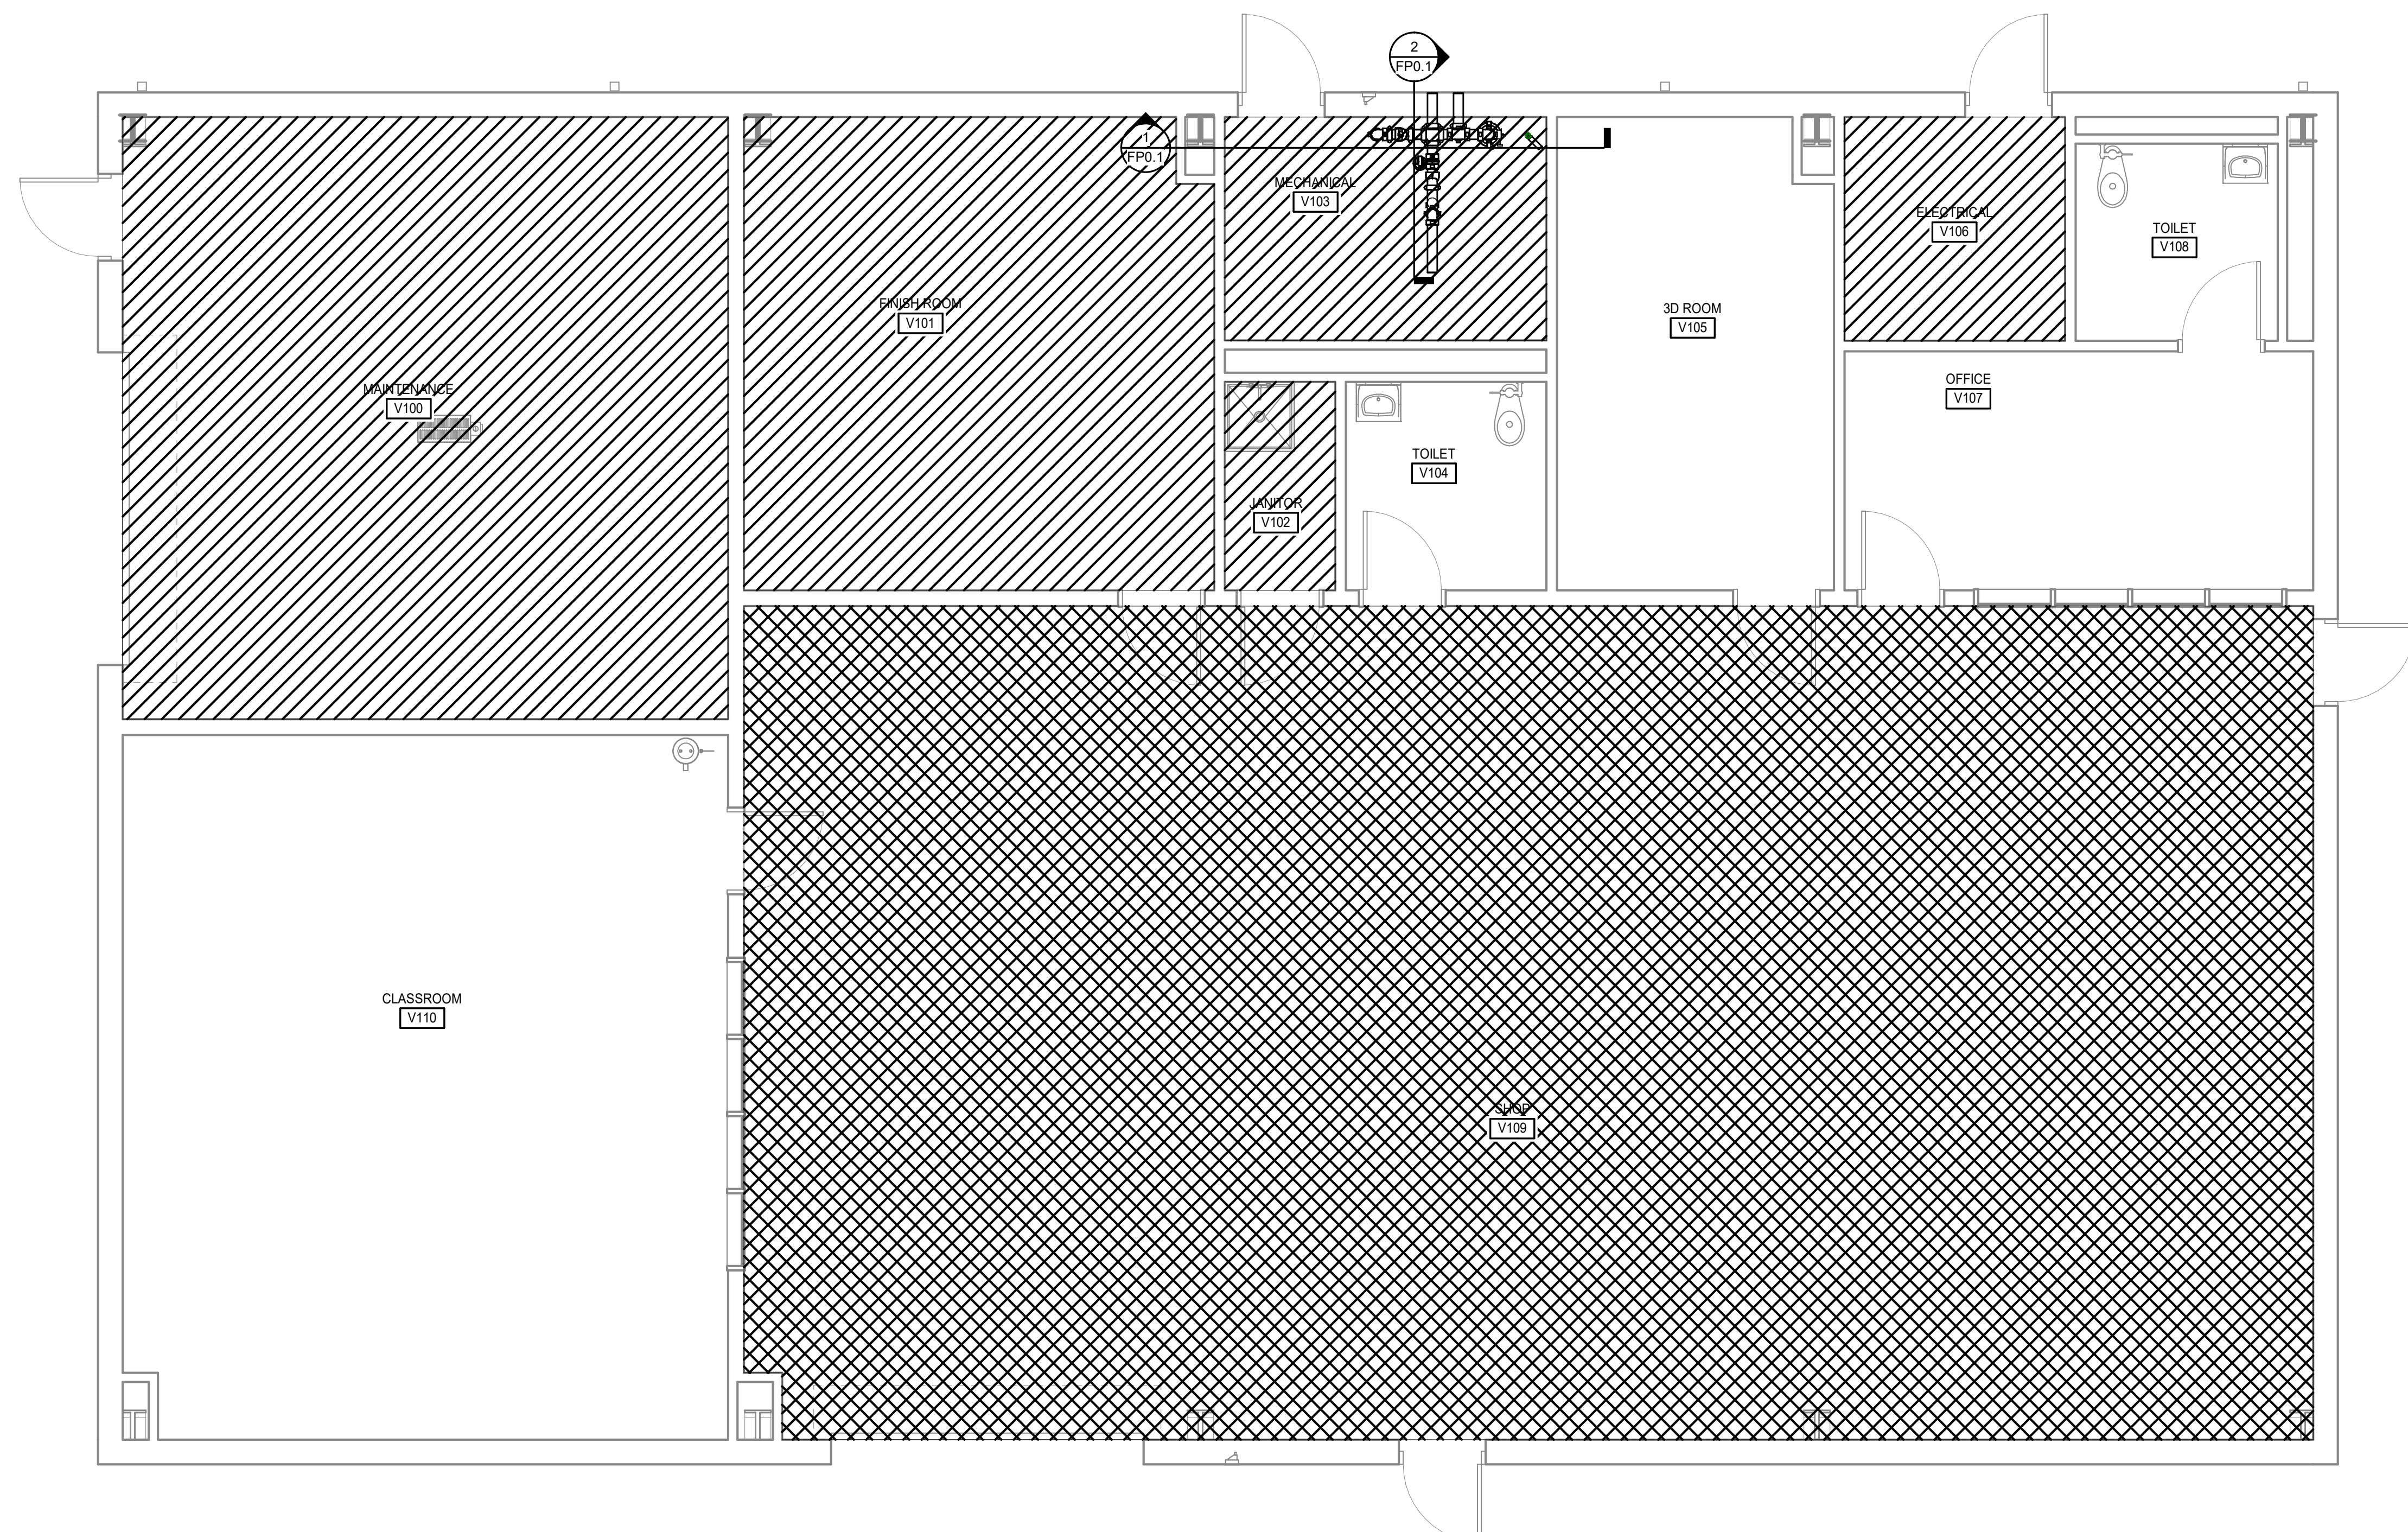


FIRST FLOOR PLAN - FIRE PROTECTION
 1/4" = 1'-0"

PROJECT NO:	611315
DATE:	DECEMBER 8, 2023

DATE	REVISIONS	DESCRIPTION

A
B
C
D
E
F
G
H
J

EQUIPMENT ABBREVIATION

AHU	AIR-HANDLING UNIT
AS	AIR SEPARATOR
B	BOILER
BCU	BLOWER COIL UNIT
OCC	CLOSED-CIRCUIT COOLING TOWER
CH	CHILLER
CHWP	CHILLED WATER PUMP
CRAC	COMPUTER ROOM AIR CONDITIONER
CT	COOLING TOWER
CUH	CABINET UNIT HEATER
CWP	CONDENSER WATER PUMP
ECH	ELECTRIC CEILING HEATER
ERU	ENERGY RECOVERY UNIT
ERV	ENERGY RECOVERY VENTILATOR
ET	EXPANSION TANK
EUH	ELECTRIC UNIT HEATER
FCU	FAN COIL UNIT
HP	HEAT PUMP
HWP	HOT WATER PUMP
HX	HEAT EXCHANGER
MAU	MAKEUP AIR UNIT
OAU	OUTDOOR AIR UNIT
P	PUMP
PTAC	PACKAGED TERMINAL AIR CONDITIONER
PTHP	PACKAGED TERMINAL HEAT PUMP
RTU	ROOFTOP UNIT
SSI	SPLIT-SYSTEM INDOOR UNIT
SSO	SPLIT-SYSTEM OUTDOOR UNIT
TU	TERMINAL UNIT
UH	UNIT HEATER
WSHP	WATER-SOURCE HEAT PUMP

CONTROLS ABBREVIATIONS

AF	AIRFLOW
AI	ANALOG INPUT TO CONTROLLER
ALM	ALARM
AMS	AIRFLOW MEASURING STATION
AO	ANALOG OUTPUT FROM CONTROLLER
ATS	AVERAGING TEMPERATURE SENSOR
BAS	BUILDING AUTOMATION SYSTEM
BI	BINARY INPUT TO CONTROLLER
BO	BINARY OUTPUT FROM CONTROLLER
CO2	CARBON DIOXIDE SENSOR
CSR	CURRENT-SENSING RELAY
DM	DAMPER MOTOR
DP	DIFFERENTIAL PRESSURE
DPT	DIFFERENTIAL PRESSURE TRANSMITTER
FM	FLOW METER
FZ	FREEZESTAT
HS	HUMIDITY SENSOR
POS	POSITION
R	RELAY
SD	SMOKE DETECTOR
SPD	SPEED
SS	START/STOP
STS	STATUS
TS	TEMPERATURE SENSOR
VFD	VARIABLE-FREQUENCY DRIVE

ABBREVIATIONS

A	AMPERES
AD	ACCESS DOOR
AFF	ABOVE FINISHED FLOOR
ALT	ALTERNATE
APD	AIR PRESSURE DROP
DHP	DRIVE HORSEPOWER
BTUH	BRITISH THERMAL UNITS PER HOUR
CFM	CUBIC FEET PER MINUTE
CHWR	CHILLED WATER RETURN
CHWS	CHILLED WATER SUPPLY
CLG	COOLING
COM	COMMON
CWR	CONDENSER WATER RETURN
CWS	CONDENSER WATER SUPPLY
D	DRAIN
DB	DRY BULB TEMPERATURE
dBA	A-WEIGHTED DECIBELS
DCW	DOMESTIC COLD WATER
DIA	DIAMETER
DN	DOWN
DWG	DRAWING
EA	EXHAUST AIR
EAT	ENTERING AIR TEMPERATURE
EER	ENERGY EFFICIENCY RATIO
EQ	EQUAL
ESP	EXTERNAL STATIC PRESSURE
EWT	ENTERING WATER TEMPERATURE
EX	EXISTING
F	DEGREES FAHRENHEIT
FC	FAIL CLOSED
FD	FIRE DAMPER
FLA	FULL LOAD AMPS
FO	FAIL OPEN
FS	FEET PER MINUTE
FT	FOOT, FEET
GA	GAUGE
GAL	GALLON(S)
GPH	GALLONS PER HOUR
GPM	GALLONS PER MINUTE
HP	HORSEPOWER
HPWR	HEAT PUMP WATER RETURN
HPWS	HEAT PUMP WATER SUPPLY
HTG	HEATING
HWR	HOT WATER RETURN
HWS	HOT WATER SUPPLY
HX	HEAT EXCHANGER
HZ	HERTZ
IN	INCH
PLV	INTEGRATED PART-LOAD VALVE
KW	KILOWATT(S)
LAT	LEAVING AIR TEMPERATURE
LBS	POUNDS
LWT	LEAVING WATER TEMPERATURE
MAX	MAXIMUM
MBH	ONE THOUSAND BTUH
MCA	MINIMUM CIRCUIT AMPACITY
MFR	MANUFACTURER
MIN	MINIMUM
MOCP	MAXIMUM OVERCURRENT PROTECTION
MOD	MOTOR-OPERATED DAMPER
NC	NORMALLY CLOSED (FOR PLANS, DETAILS)
NC	NOISE CRITERIA (FOR SCHEDULES)
NIC	NOT IN CONTRACT
NO	NORMALLY OPEN
OA	OUTSIDE AIR
OC	ON CENTER
OFCI	OWNER FURNISHED CONTRACTOR INSTALLED
PH	PHASE
PSIG	POUNDS PER SQUARE INCH GAUGE
RA	RETURN AIR
RD	REFRIGERANT DISCHARGE
RH	RELATIVE HUMIDITY
RL	REFRIGERANT LIQUID
RPM	REVOLUTIONS PER MINUTE
RS	REFRIGERANT SUCTION
SA	SUPPLY AIR
SEER	SEASONAL ENERGY EFFICIENCY RATIO
TD	TRANSFER DUCT
TYP	TYPICAL
UNO	UNLESS NOTED (INDICATED) OTHERWISE
V	VOLTAGE, VOLTS
VD	VOLUME DAMPER
VFD	VARIABLE-FREQUENCY DRIVE
W	WATT(S)
W	WITH
W/O	WITHOUT
WB	WET BULB TEMPERATURE
WC	WATER COLUMN
WPD	WATER PRESSURE DROP
WWM	WELDED WIRE MESH

CONTROL SYMBOL LEGEND

	CIRCULATOR OR PUMP		NORMALLY OPEN CONTACT
	MOTORIZED 2-WAY VALVE		NORMALLY CLOSED CONTACT
	MOTORIZED 3-WAY VALVE		WIRING OR DEVICE PROVIDED UNDER DIVISION 23
	VARIABLE FREQUENCY DRIVE		WIRING OR DEVICE NOT PROVIDED UNDER DIVISION 23
	DIRECT DIGITAL CONTROLLER		WIRING CONNECTION BY DIVISION 23
	THERMOSTAT		WIRING CONNECTION BY OTHERS
	FREEZESTAT		NUMBER OF CONDUCTORS INDICATED BY SLASH MARKS
	CONTACTOR		MOTORIZED PARALLEL BLADE DAMPER
	RELAY		MOTORIZED OPPOSED BLADE DAMPER
	SPACE TEMPERATURE SENSOR		MOTORIZED BUTTERFLY BLADE DAMPER
	LINE VOLTAGE THERMOSTAT		SUPPLY, RETURN, OR EXHAUST FAN
	HAND-OFF-AUTOMATIC SWITCH		AIRFLOW DIRECTION
	DUCT-MOUNTED SMOKE DETECTOR		CONTROL POINT INDICATOR
	TRANSFORMER		INPUT OR OUTPUT (ANALOG INPUT)
	FUSE		DEVICE TYPE (AIR TEMPERATURE SENSOR)
			CONTROL POINT INDICATOR
			INPUT OR OUTPUT (ANALOG INPUT)
			DEVICE TYPE (WATER TEMPERATURE SENSOR WITH BULB TYPE ELEMENT IN PIPING WELL)
			CONTROL POINT INDICATOR
			INPUT OR OUTPUT (ANALOG INPUT)
			DEVICE TYPE (CURRENT SENSING RELAY)

GRAPHIC SYMBOL LEGEND

	CORRIDOR		SPACE TAG
	AHU-12		SPACE NAME
	S1		SPACE NUMBER
	M3.1		BUILDING PART NUMBER IN MULTI-PART BUILDING
	15		EQUIPMENT TAG
	C		EQUIPMENT NUMBER
	15		EQUIPMENT ABBREVIATION
	15		DIFFUSER, GRILLE OR REGISTER TAG
	15		DETAIL TAG
	15		KEYNOTE
	15		STRUCTURAL GRID LINE WITH DESIGNATION
	15		EXISTING TO BE REMOVED
	15		DETAIL TITLE
	15		SECTION TITLE
	15		SECTION CALLOUT
	15		ENLARGED PLAN CALLOUT
	15		MECHANICAL EQUIPMENT WITH REQUIRED SERVICE CLEARANCE INDICATED

DUCTWORK LEGEND

	RECTANGULAR DUCT (FIRST DIMENSION REFERS TO SIDE VIEWED)		MANUAL BALANCING DAMPER IN DUCT
	ROUND DUCT SIZE		FIRE DAMPER IN DUCT
	FLAT OVAL DUCT SIZE		SMOKE DAMPER IN DUCT
	DOUBLE WALL, EXPOSED DUCT		COMBINATION FIRE/SMOKE DAMPER IN DUCT
	FABRIC DUCT		FIRE DAMPER WITH SECURITY BARS IN DUCT
	FLEXIBLE DUCTWORK		SMOKE DAMPER WITH SECURITY BARS IN DUCT
	FLEXIBLE CONNECTOR		COMBINATION FIRE/SMOKE DAMPER WITH SECURITY BARS IN DUCT
	DUCT-MOUNTED SMOKE DETECTOR		MOTORIZED DAMPER IN DUCT
	DUCT WITH DUCT LINER		SMOKE CONTROL MANUAL BALANCING DAMPER IN DUCT
	DUCT ACCESS DOOR		SMOKE CONTROL MOTORIZED DAMPER IN DUCT
	DUCT WITH END CAP		SECURITY BARS IN DUCT
	LINEAR SLOT DIFFUSER, LENGTH AS INDICATED		DUCT WITH ACCESS PANEL
	LINEAR BAR GRILLE, LENGTH AS INDICATED		SUPPLY/MAKEUP AIR DUCT SECTIONS
	RETURN OR EXHAUST GRILLE		RETURN AIR DUCT SECTIONS
	SUPPLY DIFFUSER WITH DIRECTIONAL BLOW, SOLID HATCH INDICATES BLANK OFF PANEL		EXHAUST AIR DUCT SECTIONS
	POINT OF CONNECTION TO EXISTING		SMOKE DETECTOR
	LIMIT OF DEMOLITION		HUMIDITY SENSOR
	SUPPLY AIRFLOW ARROW		THERMOSTAT, LINE VOLTAGE
	RETURN OR EXHAUST AIRFLOW ARROW		THERMOSTAT, LOW VOLTAGE
	DOOR UNDERCUT		TEMPERATURE SENSOR
	DOOR LOUVER		CARBON DIOXIDE SENSOR
	SENSOR WELL		CARBON MONOXIDE SENSOR

PIPING LEGEND

	END OF LINE CLEANOUT PLUG		VALVE
	CLEANOUT PLUG		MANUAL BALANCING VALVE WITH FLOW TAPS
	PRESSURE GAUGE WITH GAUGE COCK		AUTOMATIC BALANCING VALVE WITH FLOW TAPS
	LIQUID FILLED THERMOMETER		SWING CHECK VALVE
	UNION		PRESSURE REDUCING VALVE
	STRAINER WITH BLOWDOWN VALVE AND 3/4" HOSE END CONNECTION		TRIPLE DUTY VALVE
	FLEXIBLE PIPE CONNECTOR		GAS COCK
	MANUAL AIR VENT		PRESSURE-RELIEF VALVE
			TWO-WAY CONTROL VALVE
			THREE-WAY CONTROL VALVE
			DIRECTION OF FLOW

GENERAL NOTES

- THE CONTRACT DOCUMENTS ARE COMPLEMENTARY AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL. IN THE CASE OF A CONFLICT, DISAGREEMENT, OR AMBIGUITY, PROVIDE THE GREATER QUANTITY OF WORK.
- DRAWINGS ARE DIAGRAMMATIC AND INTENDED TO CONVEY SCOPE AND GENERAL ARRANGEMENT ONLY. DO NOT SCALE DRAWINGS. LOCATIONS OF ALL ITEMS INDICATED ON THE DRAWINGS OR CALLED FOR IN THE SPECIFICATIONS THAT ARE NOT DEFINITELY FIXED BY DIMENSIONS ARE APPROXIMATE. COORDINATE CONTRACT DOCUMENTS PROJECT REQUIREMENTS, WORK OF OTHERS, AND EQUIPMENT AND MATERIALS PURCHASED WITH FIELD DIMENSIONS, MANUFACTURERS REQUIREMENTS FOR INSTALLATION, OPERATION, AND MAINTENANCE. CONTRACTORS INTENDED MEANS AND METHODS OF INSTALLATION, AND CONTRACTORS FABRICATED ITEMS TO ENSURE A PROPER FIT AND INSTALLATION.
- MAINTAIN MAXIMUM HEADROOM AND SPACE CONDITIONS AT ALL POINTS, WHERE HEADROOM AND SPACE CONDITIONS APPEAR INADEQUATE, NOTIFY THE ARCHITECTS PRIOR TO PROCEEDING WITH INSTALLATION. MAINTAIN A MINIMUM OF 7'-0" CLEARANCE ABOVE FINISHED FLOOR TO UNDERSIDE OF PIPES, DUCTS, CONDUITS, SUSPENDED EQUIPMENT, ETC., THROUGHOUT ACCESS ROUTES IN MECHANICAL ROOMS.
- FIELD VERIFY AND COORDINATE ALL DUCT AND PIPING DIMENSIONS BEFORE FABRICATION. MAKE MODIFICATIONS IN THE LAYOUT AS NEEDED TO PREVENT CONFLICT WITH WORK OF OTHER TRADES OR FOR PROPER EXECUTION OF THE WORK.
- INSTALL ALL EQUIPMENT AND APPURTENANCES IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS, CONTRACT DOCUMENTS, AND APPLICABLE CODES AND REGULATIONS.
- COORDINATE LOCATIONS AND SIZES OF ALL FLOOR, WALL, AND ROOF OPENINGS WITH ALL OTHER TRADES. COORDINATE ALL PIPING AND EQUIPMENT SUPPORTED FROM STRUCTURE WITH GENERAL CONSTRUCTION WORK.
- PROVIDE TRAPPED DRAIN PIPING FROM DRAIN PANS OF ALL COOLING COILS, FANS AND OTHER ACTIVE DRAINS EXPOSED TO SYSTEM AIRSTREAM. PROVIDE TRAP AT CONNECTION WITH WATER SEAL, DEPTH ONE INCH GREATER THAN UNIT OPERATING PRESSURE. DIRECT DRAINS TO NEAREST FLOOR DRAIN, MOP SINK, OR OTHER LOCATION APPROVED BY THE ARCHITECT.
- INSTALL PIPING, DUCTWORK, AND CONDUIT CONCEALED IN AREAS HAVING CEILINGS AND/OR FURRED SPACES UNLESS OTHERWISE INDICATED.
- ALL EQUIPMENT, VALVES, DAMPERS, DAMPER AND VALVE OPERATORS SHALL BE PROVIDED WITH ADEQUATE ACCESS FOR SERVICING, MAINTENANCE, AND REPLACEMENT.
- SIZE ALL SPLIT-SYSTEM REFRIGERANT PIPING IN ACCORDANCE WITH THE MANUFACTURERS INSTALLATION INSTRUCTIONS.
- DUCT DIMENSIONS MAY BE MODIFIED ONLY WITH PRIOR APPROVAL FROM ARCHITECT. DUCT DIMENSIONS ARE IN INCHES AND INSIDE CLEAR.
- FOR LOCATION OF REGISTERS, GRILLES, AND DIFFUSERS WITHIN CEILING GRID, REFER TO ARCHITECTURAL REFLECTED CEILING PLANS.
- ELEVATION INDICATED FOR RECTANGULAR DUCT, GRILLE AND LOUVER OPENINGS IS TO THE TOP OF ROUGH OPENING UNLESS OTHERWISE INDICATED. ELEVATION INDICATED FOR ROUND DUCTWORK AND PIPING IS TO CENTERLINE.
- BRANCH PIPING RUNOUTS TO TERMINAL UNITS SHALL BE 3/4" DIAMETER UNLESS INDICATED OTHERWISE.
- REFER TO STRUCTURAL DRAWINGS FOR DETAILS AND MAXIMUM SPACING REQUIREMENTS REGARDING HANGERS ATTACHMENTS TO STEEL BAR JOISTS.

MOSELEY ARCHITECTS

5200 NORFOLK STREET, RICHMOND, VA 23230
PHONE (804) 794-7555 FAX (804) 355-5690
MOSELEYARCHITECTS.COM

Professional Seal

J. P. MOSELEY

Professional Engineer

No. 26273

03/08/24

JUSTIN P. CARROLL

Professional Seal

MOSELEY ARCHITECTS

No. 3983

REGISTERED ARCHITECT


GEORGETOWN COUNTY RE-ENTRY FACILITY

611315
GEORGETOWN COUNTY
GEORGETOWN, SOUTH CAROLINA

PROJECT NO:	611315
DATE:	MARCH 8, 2024
REVISIONS	
DATE:	DESCRIPTION

LEGENDS, ABBREVIATIONS AND GENERAL NOTES

M0.1

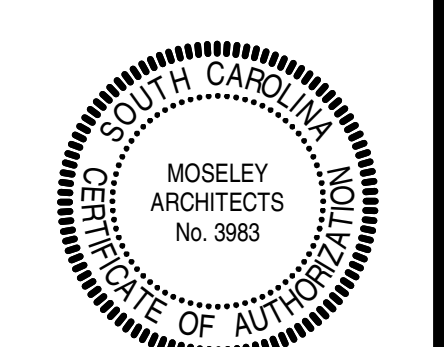


PROJECT NO: 611315
 DATE: MARCH 8, 2024

REVISIONS

DATE DESCRIPTION

KEYNOTES
 APPLIES TO THIS DRAWING
 REPRESENTED BY [n]

1. EXTEND 3/4" CONDENSATE DRAIN TO MECHANICAL ROOM FLOOR DRAIN.
2. EXTEND 3/4" CONDENSATE DRAIN TO EXTERIOR. PROVIDE SPLASHBLOCK.
3. PROVIDE HOODED WALL VENT WITH SCREEN AND BACKDRAFT DAMPER, FAMCO MODEL RDWVG (BASIS OF DESIGN) OR EQUIVALENT. COLOR PER ARCHITECT.
4. MINIMUM LOUVER FREE AREA IS 0.4 SF. SEE ARCHITECTURAL PLANS FOR LOUVER SIZE.
5. MINIMUM LOUVER FREE AREA IS 0.2 SF. SEE ARCHITECTURAL PLANS FOR LOUVER SIZE. PROVIDE MOTORIZED DAMPER (120V, 2-POSITION, INCLUDE TRANSFORMERS AS REQUIRED) AND SECTION OF DUCTWORK ON THE BACK SIDE OF LOUVER OR A COMBINATION LOUVER-DAMPER. INTERLOCK WITH ROOM EXHAUST FAN SERVING SPACE.
6. MINIMUM LOUVER FREE AREA IS 0.45. SEE ARCHITECTURAL PLANS FOR LOUVER SIZE.

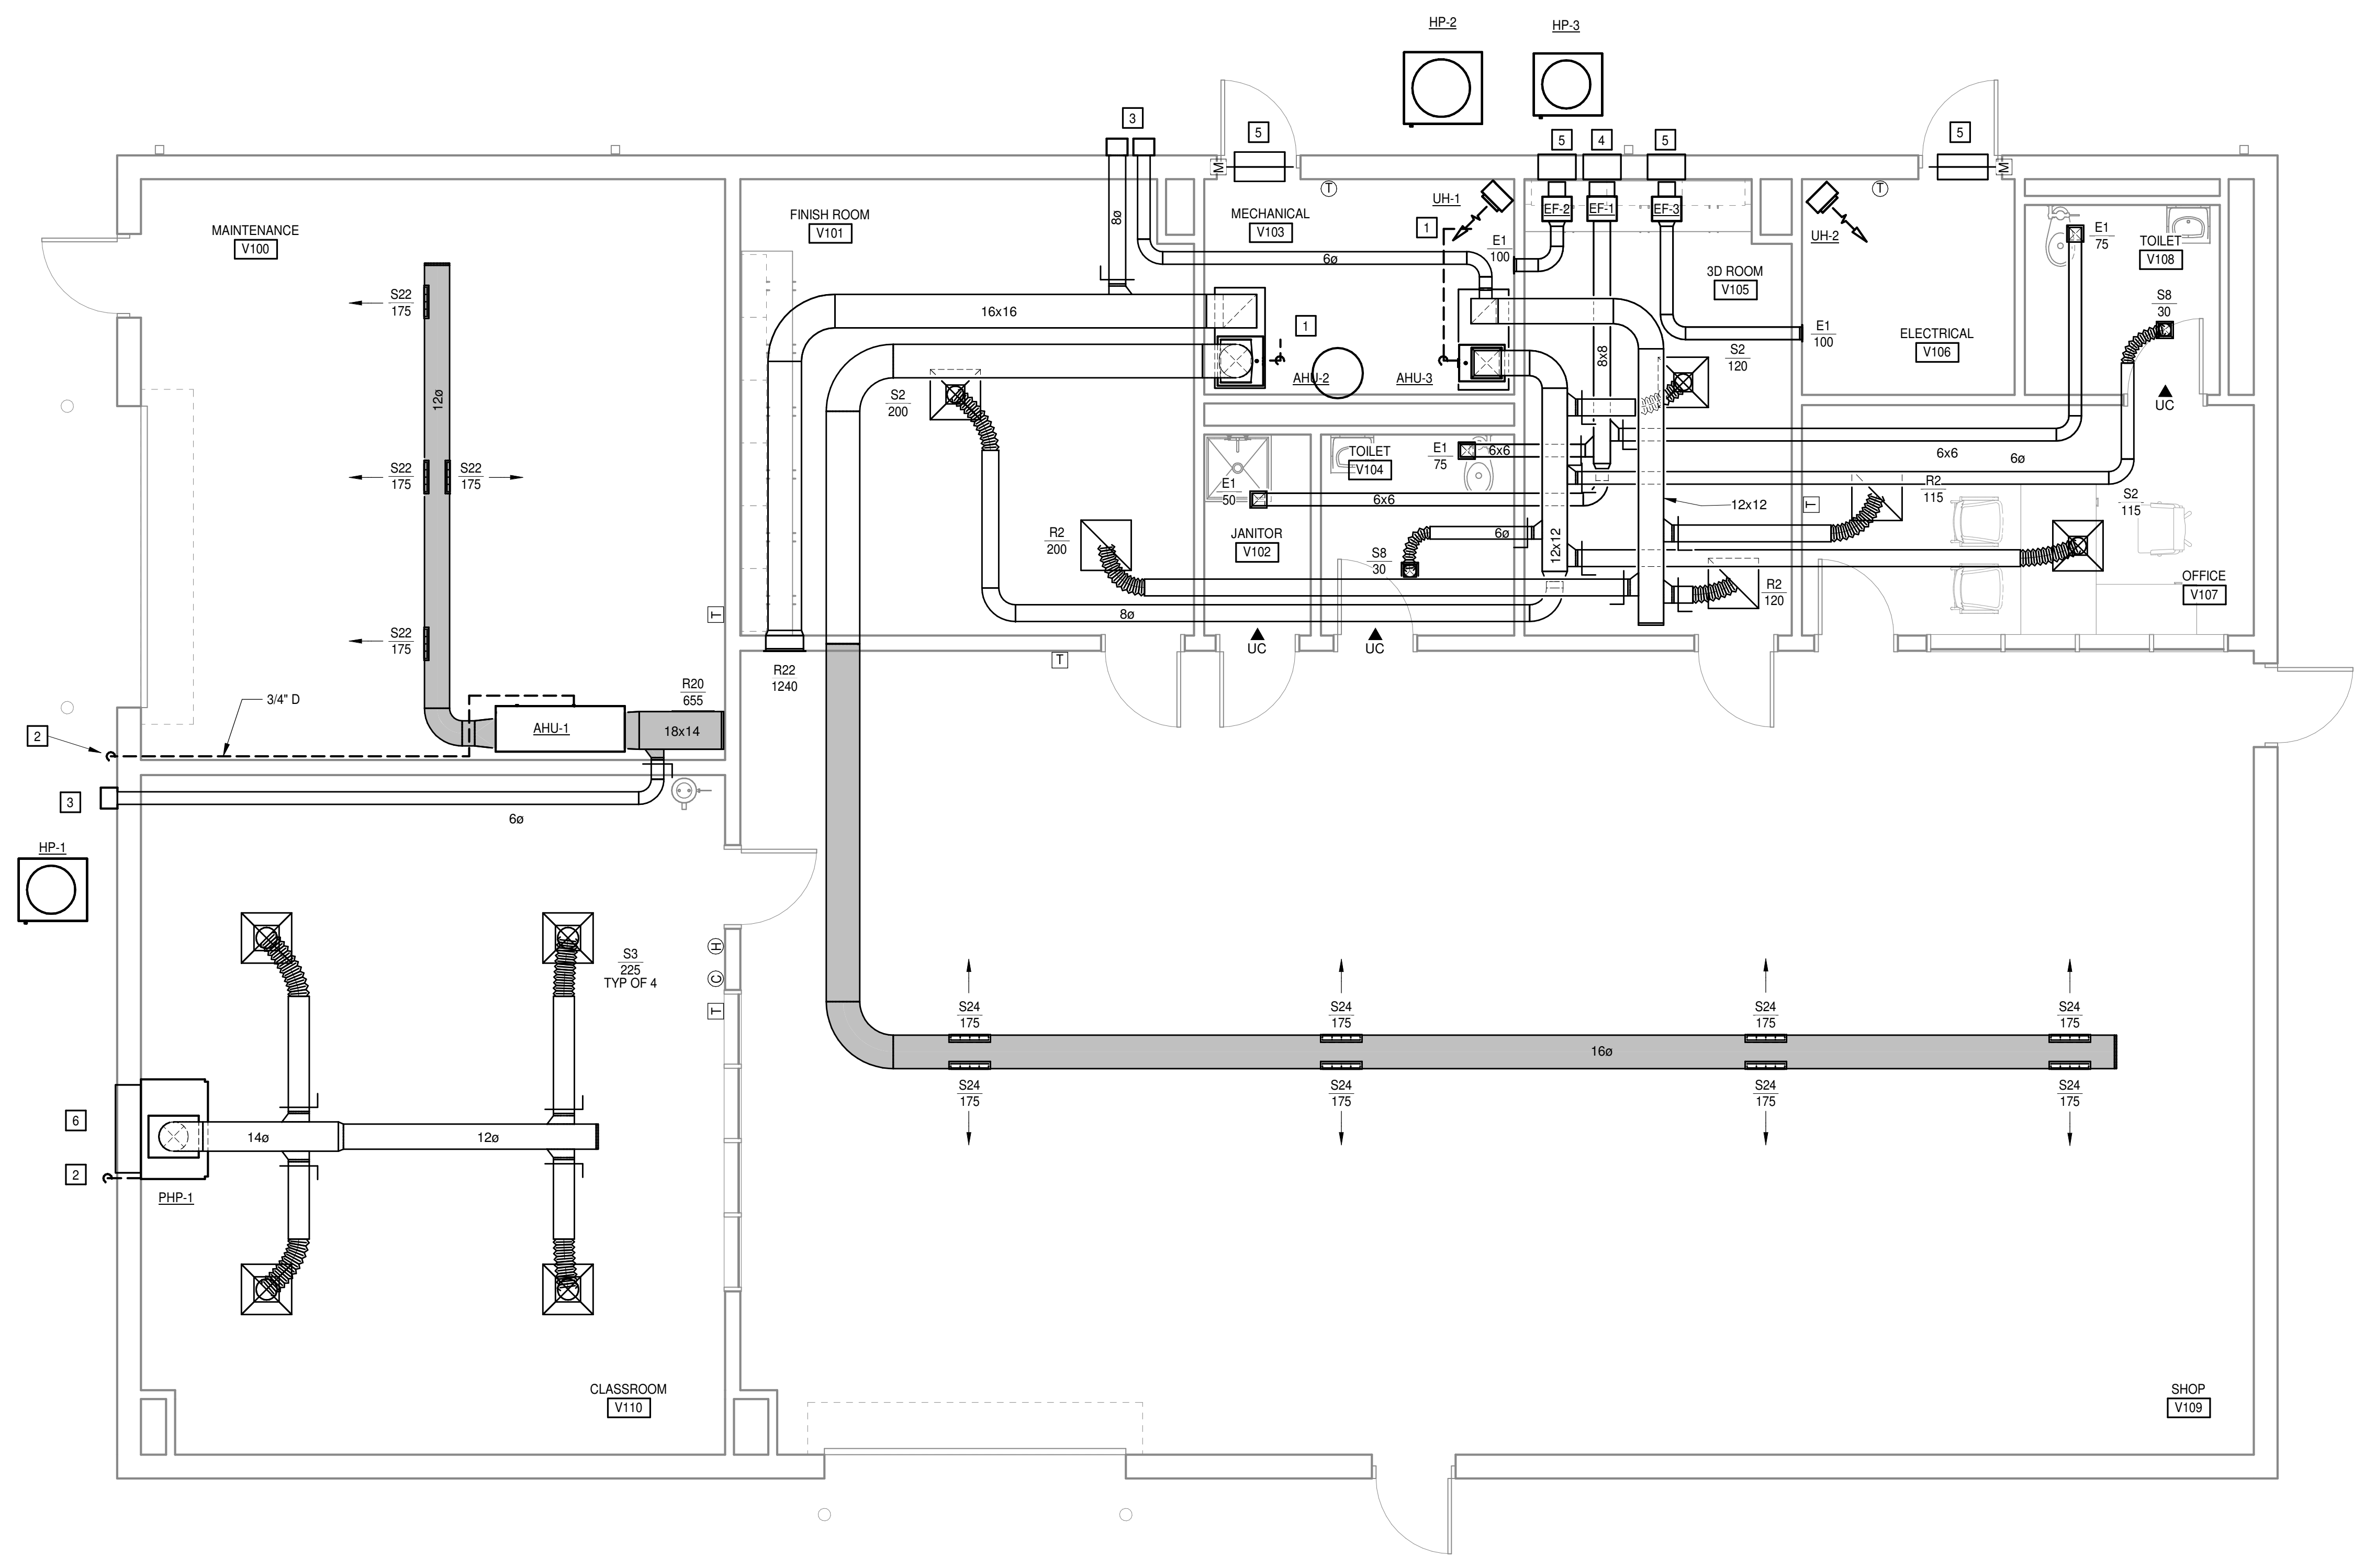

FIRST FLOOR PLAN - DUCTWORK
 1/4" = 1'-0"

GRILLE, REGISTER, & DIFFUSER SCHEDULE

TAG	MANUFACTURER	MODEL NUMBER	NECK SIZE	FACE SIZE	MAX NO LEVEL	NOTES
E1	PRICE	530	6X6	8X8	25	1.2
R2	PRICE	PDDR	8"	24X24	25	1.2
R20	PRICE	530	18X12	20X14	25	1.2
R22	PRICE	PDDR	18X18	20X20	25	1.2
S2	PRICE	SPD	8"	24X24	25	1.2
S3	PRICE	SPD	10"	24X24	25	1.2
S8	PRICE	510	6X6	8X8	25	1.2
S22	PRICE	SDGE	14X8	16X10	25	3
S24	PRICE	SDGE	18X12	20X14	25	3

NOTES:
 1. PROVIDE WITH BORDER TYPE 3 FOR LAY-IN & BORDER TYPE 1 FOR CEILING SURFACE MOUNTED. PROVIDE PLASTER FRAME WHEN SURFACE MOUNTED (IF AVAILABLE). COORDINATE WITH ARCHITECTURAL TO DETERMINE WHICH GRILLES/DIFFUSERS WILL BE SURFACE MOUNTED OR LAY-IN.
 2. INCLUDE OPPOSED BLADE DAMPER, ACCESSIBLE THROUGH GRILLE WHERE AVAILABLE.
 3. PROVIDE WITH AIR EXTRACTOR.

WALL MOUNTED HEAT PUMP SCHEDULE

TAG	MANUFACTURER	SUPPLY AIR (CFM)	OUTSIDE AIR	MODEL NUMBER	PACKAGED COOLING		HEAT PUMP HEATING		ELECTRIC DATA			WEIGHT (LBS)					
					TOTAL CAPACITY (BTUH)	INDOOR EAT (°F)	HEATING CAPACITY (BTUH)	EAT (°F)	LAT (°F)	ELECTRIC HEAT (KW)	MCA (A)		MOCP (A)	SERVICE (V) (PH) (HZ)			
PHP-1	BAIRD	900	225 CFM	130H10B06RN	27,800	80	67	26,800	45.0	70.0	6	35.0	35	208	3	60	900

GENERAL NOTES:
 1. SINGLE-POINT POWER CONNECTION, FACTORY (TOGGLE) DISCONNECT.
 2. PROVIDE 2" PLEATED FILTER.
 3. UNITS TO HAVE TEMPERATURE, HUMIDITY, OCCUPANCY, AND CO2 CONTROL CAPABILITY. SENSORS AND CONTROLLER BY CONTROLS CONTRACTOR.
 4. PROVIDE ECM SUPPLY FAN MOTOR.
 5. PROVIDE ENERGY RECOVERY VENTILATOR AND DUCTED DISCHARGE EXTENSION PLENUM.
 6. BALANCE OUTSIDE AIR TO AIRFLOW LISTED IN SCHEDULE UNLESS NOTED OTHERWISE ON THE FLOOR PLANS.
 7. 28 INCH TALL CABINET EXTENSION.

SPLIT SYSTEM HEAT PUMP INDOOR UNIT WITH ELECTRIC HEAT SCHEDULE

TAG	SUPPLY AIR (CFM)	OUTSIDE AIR (CFM)	ESP (IN WC)	MANUFACTURER	MODEL NUMBER	COOLING		INDOOR EAT (°F)		HEATING		ELECTRIC HEAT (KW)	SERVICE			WEIGHT (LBS)	NOTES		
						TOTAL CAPACITY (BTUH)	SENSIBLE CAPACITY (BTUH)	DB	WB	CAPACITY (BTUH)	INDOOR EAT DB		MCA (A)	MOCP (A)	V			PH	HZ
AHU-1	700	45	0.8	TRANE	GAM5A0A2AM1SA	23600	17200	80.0	67.0	22400	70.0	5.8	36.0	40	208	1	60	170	1,2,3,4
AHU-2	1400	180	0.8	TRANE	GAM5A0C48M41SA	47000	35000	80.0	67.0	42500	70.0	7.2	51.0	60	208	1	60	166	1,2,3,4
AHU-3	495	60	0.8	TRANE	GAM5A0A18M11SA	17600	13200	80.0	67.0	17000	70.0	3.6	25.0	25	208	1	60	120	1,2,3,4

NOTES (APPLY TO INDOOR AND OUTDOOR UNITS):
 1. SCROLL COMPRESSORS, HIGH & LOW PRESSURE SWITCHES, SOLID STATE HEAD PRESSURE CONTROL (FAN SPEED), LOW AMBIENT CONTROL.
 2. EVAPORATOR FREEZE STAT & ISOLATION RELAY, CRANKCASE HEATER, START ASSIST RELAY, EXTERNAL SERVICE VALVES, TXV, SHORT CYCLE PROTECTION, BI-FLOW REFRIGERANT FILTER DRYER.
 3. OUTDOOR THERMOSTAT FOR STRIP LOCKOUT, SINGLE POINT AHU POWER CONNECTION, TOTALLY ENCLOSED BALL BEARING OUTDOOR FAN MOTOR.
 4. DISCONNECT SWITCH PROVIDED BY DIVISION 26.



FAN SCHEDULE

TAG	MANUFACTURER	MODEL NUMBER	SERVING	TYPE	AIRFLOW (CFM)	ESP (IN WC)	FAN WHEEL (RPM)	DRIVE TYPE	SONES	CONTROL METHOD	MOTOR (HP)	ELECTRIC DATA			WEIGHT (LBS)	NOTES
												(V)	(PH)	(HZ)		
EF-1	GREENHECK	CSP-390-VG	TOILETS	IN-LINE	200	0.25 in-wg	870	DIRECT	0.6	SHOP ROOM LIGHTSWITCH	1/4	120	1	60	34	1.2
EF-2	GREENHECK	CSP-190-VG	MECHANICAL	IN-LINE	100	0.25 in-wg	1400	DIRECT	3	LINE VOLTAGE TSTAT	1/4	120	1	60	34	1.2
EF-3	GREENHECK	CSP-190-VG	ELECTRICAL	IN-LINE	100	0.25 in-wg	1400	DIRECT	3	LINE VOLTAGE TSTAT	1/4	120	1	60	34	1.2


NOTES:
 1. PROVIDE VARI-GREEN FAN MOTOR.
 2. PROVIDE FAN WITH FUSED DISCONNECT SWITCH, GRAVITY BACKDRAFT DAMPER, ROOF CURB (IF ROOF MTD), SPEED CONTROLLER AND VIBRATION ISOLATORS.

SPLIT SYSTEM OUTDOOR UNIT SCHEDULE


TAG	MANUFACTURER	MODEL NUMBER	AMBIENT AIR TEMPERATURE (°F)	INDOOR EAT (°F)		SERVICE			WEIGHT (LBS)	NOTES	
				MCA (A)	MOCP (A)	V	PH	HZ			REFRIGERANT
HP-1	TRANE	4TWR4024	95.0	14	25	208	1	60	R-410A	161	1,2,3,4
HP-2	TRANE	4TWR4048	95.0	26	45	208	1	60	R-410A	234	1,2,3,4
HP-3	TRANE	4TWR4018	95.0	12	20	208	1	60	R-410A	161	1,2,3,4

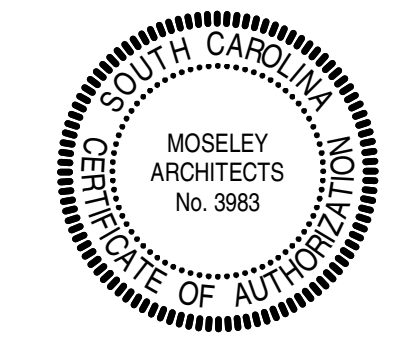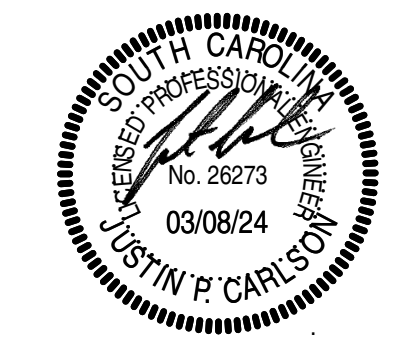


PROJECT NO:	611315
DATE:	MARCH 8, 2024
REVISIONS	
DATE	DESCRIPTION

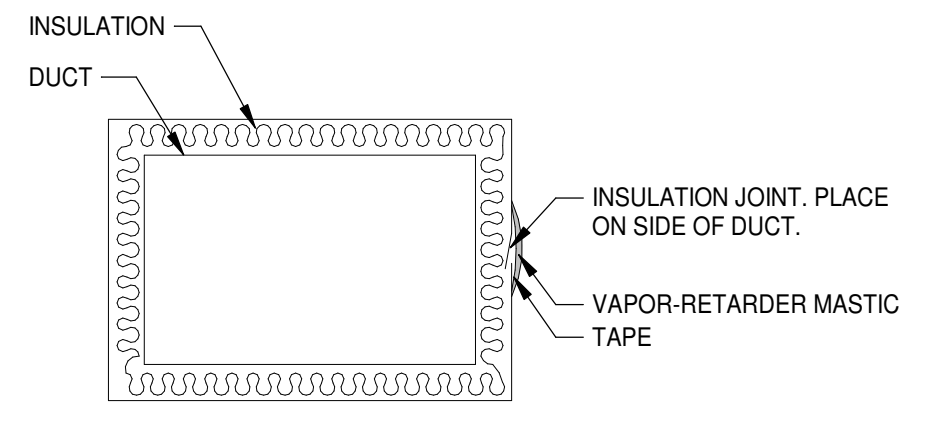


DUCT INSULATION JOINT DETAIL
 NO SCALE
 REFER TO SPECIFICATION SECTION 230700 FOR ADDITIONAL INFORMATION.

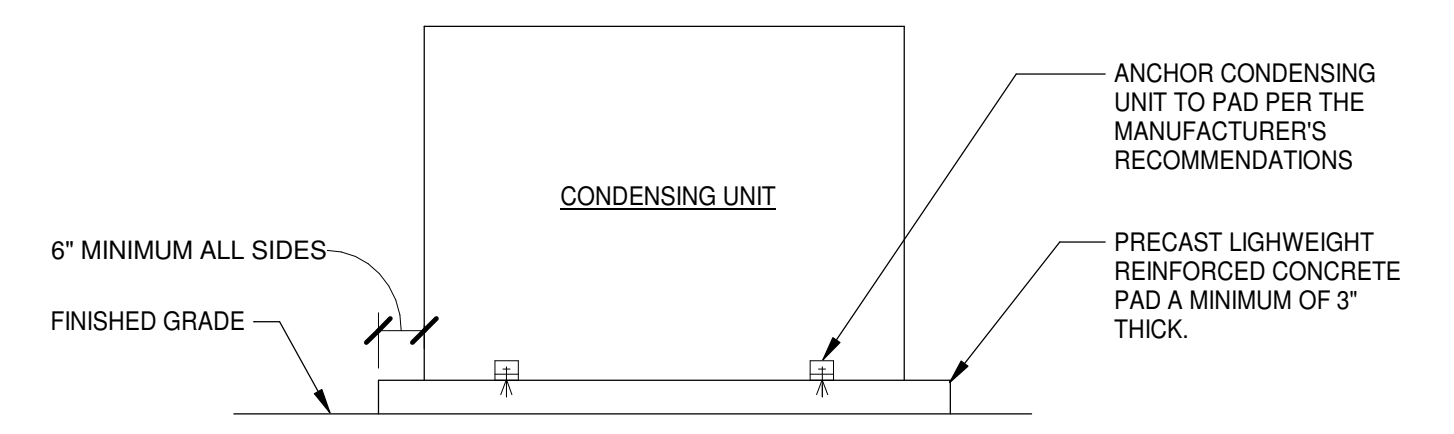


CONDENSING UNIT MOUNTING DETAIL
 NO SCALE

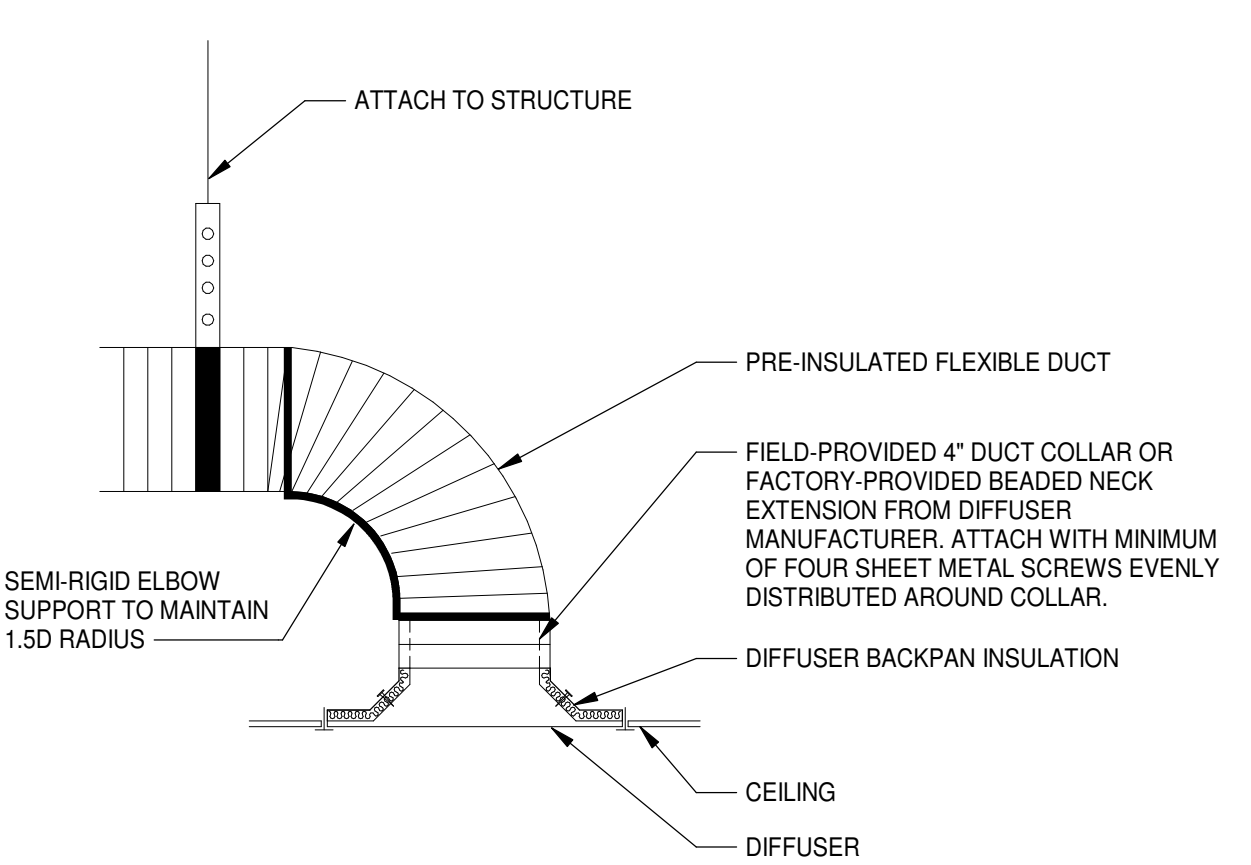


FLEXIBLE DUCT TO DIFFUSER CONNECTION DETAIL
 NO SCALE

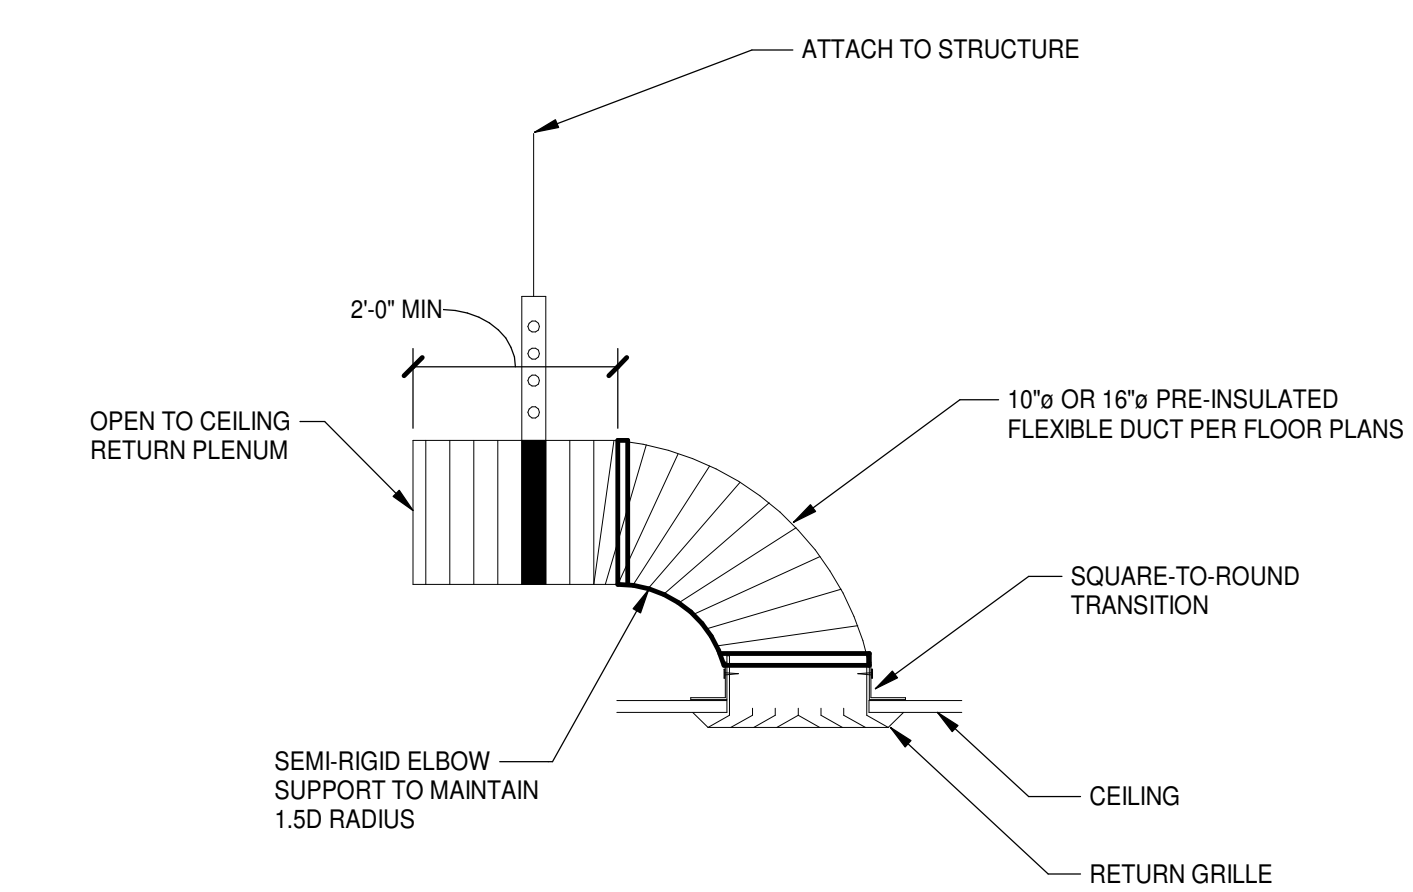


RETURN AIR BOOT DETAIL
 NO SCALE

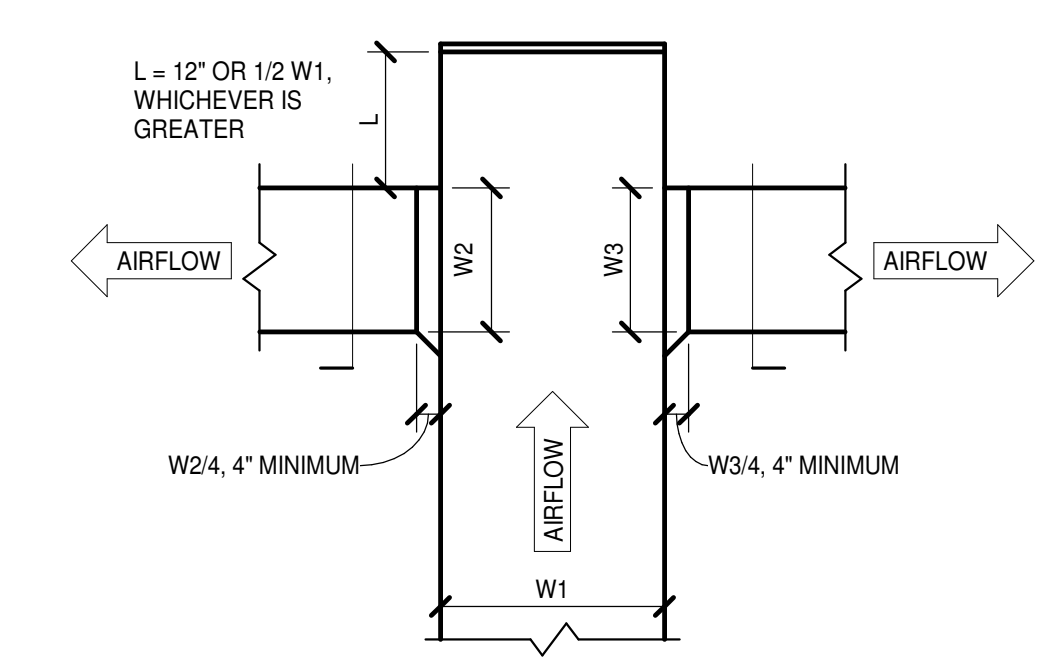


END OF DUCT MAIN DETAIL
 NO SCALE
 NOTE:
 1. REFER TO BRANCH CONNECTION TO DIFFUSER DETAILS FOR BRANCH TAKE-OFF REQUIREMENTS.

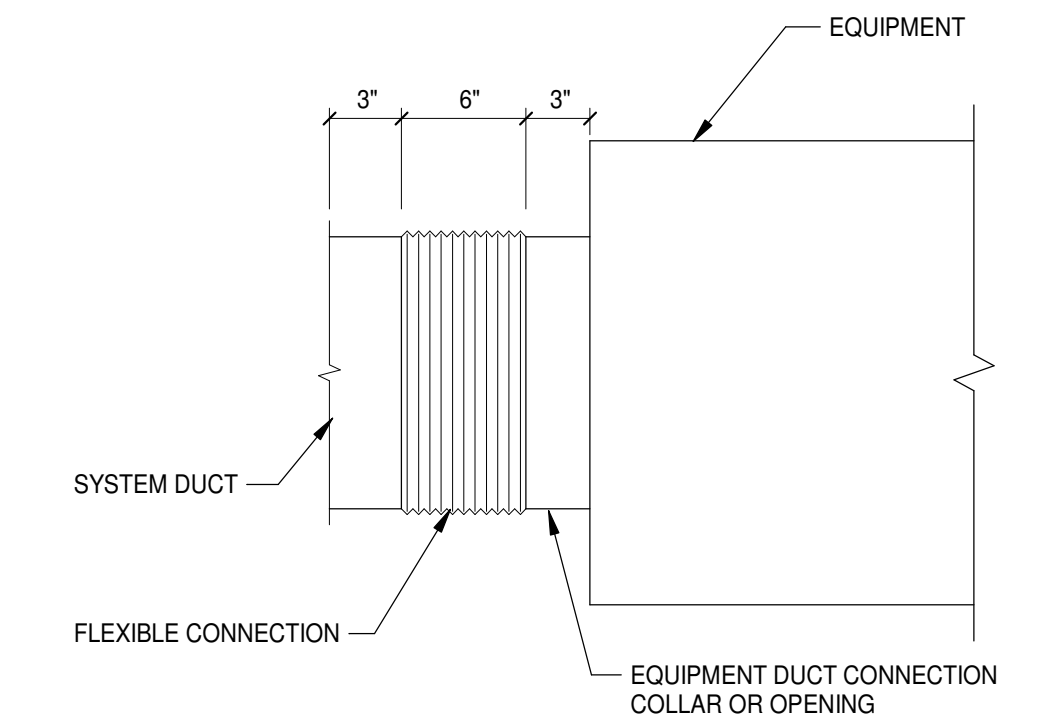


EQUIPMENT DUCT CONNECTION DETAIL
 NO SCALE
 NOTE: THIS DETAIL APPLIES TO ALL DUCT CONNECTIONS TO AIR HANDLING UNITS AND FANS UNLESS OTHERWISE INDICATED

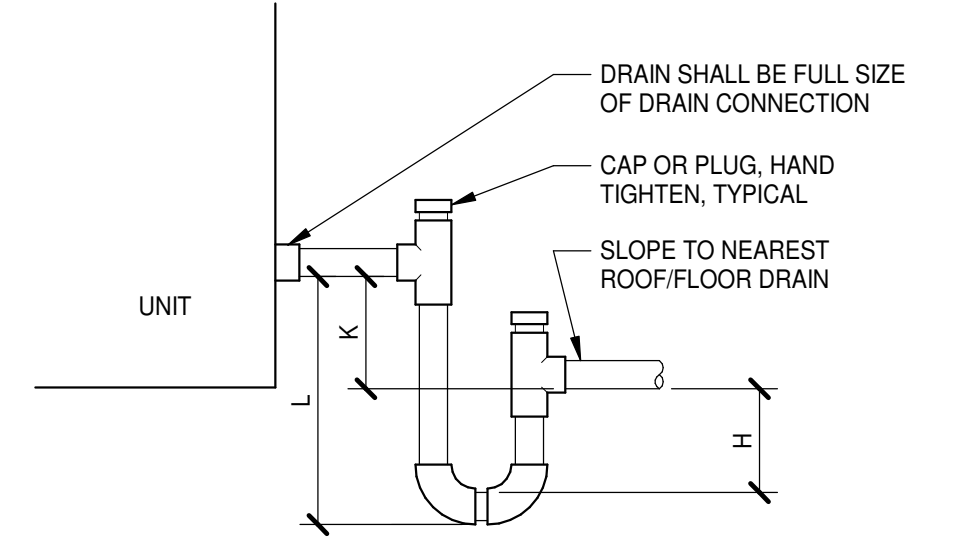

NEGATIVE PRESSURE CONDENSATE DRAIN DETAIL
 NO SCALE
 $K = 1"$ FOR EACH 1" OF MAXIMUM NEGATIVE STATIC PRESSURE + 1"
 $H = 12K$
 $L = H + K + \text{PIPE DIAMETER} + \text{INSULATION}$
 NOTES:
 1. LOCATE TRAP AS CLOSE AS POSSIBLE TO UNIT OUTLET WITH BOTTOM BELOW SUPPORT STRUCTURE.
 2. COORDINATE MOUNTING/CURB HEIGHT AS REQUIRED TO PROVIDE PROPER CONDENSATE DRAINAGE/TRAP HEIGHT.
 3. NOTIFY ARCHITECT BEFORE FABRICATION IF PHYSICAL CONDITIONS PREVENT INSTALLATION OF DEPTH INDICATED.

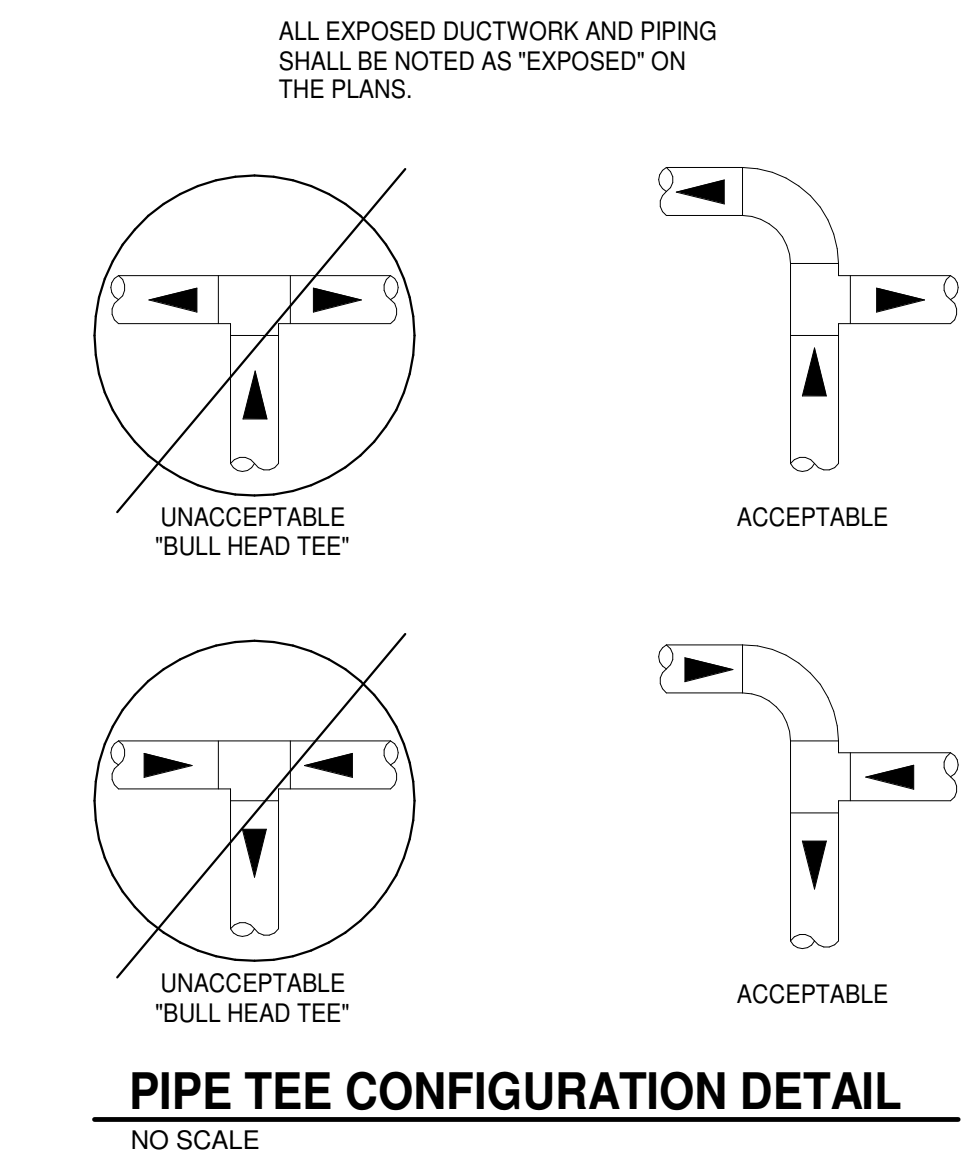


PIPE TEE CONFIGURATION DETAIL
 NO SCALE

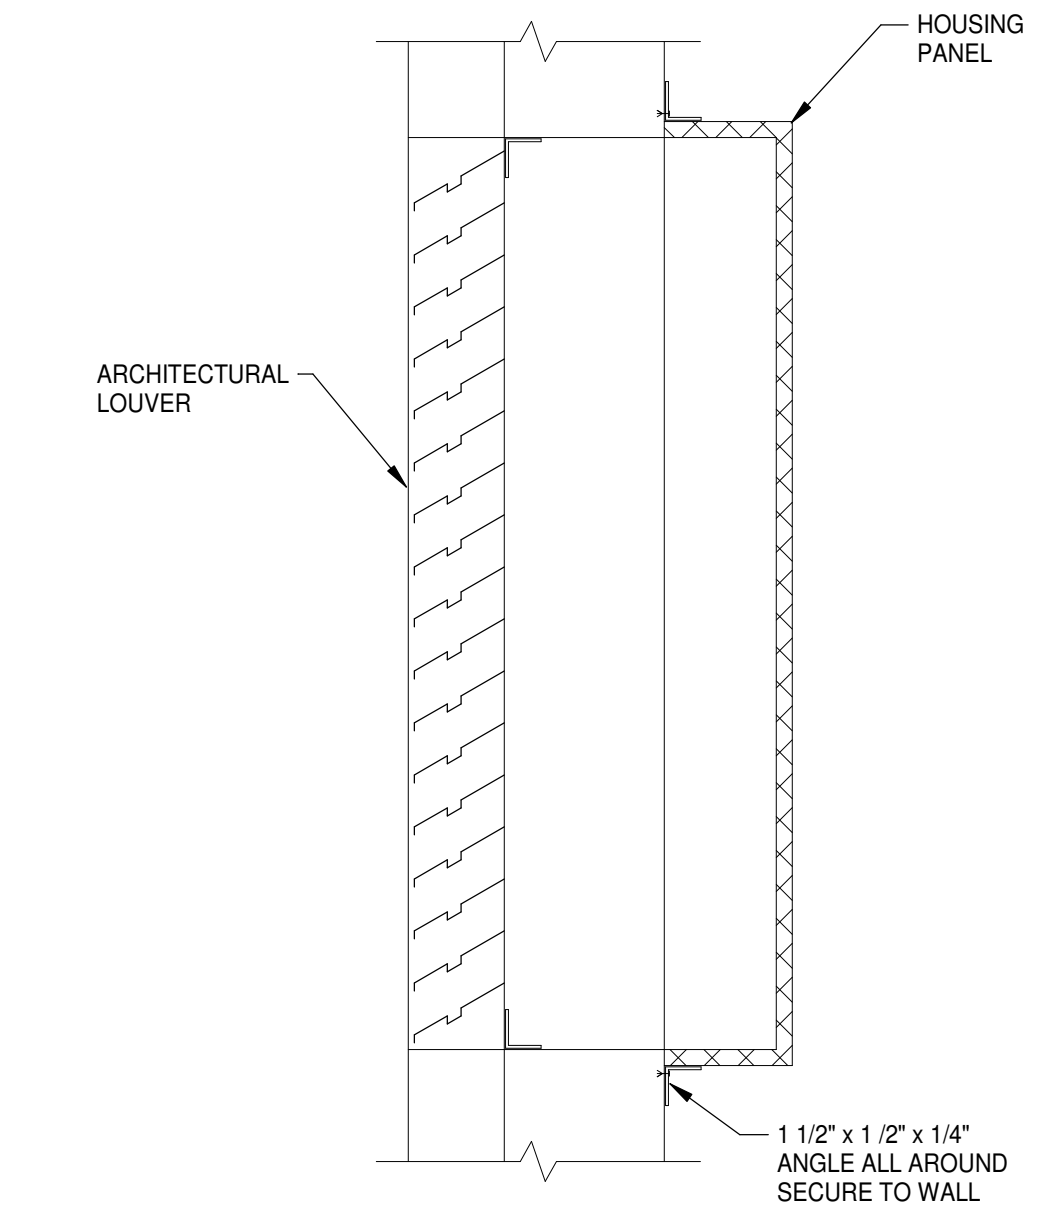


WALL LOUVER DETAIL
 NO SCALE


AIR HANDLING UNIT INSTALLATION:
 PROVIDE DUCTED PLENUM STAND. STAND SHALL BE COMPLETELY INSULATED. STAND SHALL BE RIGID ENOUGH TO SUPPORT UNIT AND DUCTWORK WITHOUT DEFLECTION. INSURE THAT THERE IS AN AIRTIGHT SEAL BETWEEN UNIT AND STAND. POORLY CONSTRUCTED STANDS WILL BE REJECTED.
 PROVIDE SECONDARY DRAIN PAN WITH A FLOAT SWITCH WIRED TO SHUTDOWN THE AIR HANDLER AND THE CONDENSING UNIT.
 INSTALL ALL ITEMS SHIPPED LOOSE WITH THE UNIT. INSTALL ELECTRIC HEAT COILS. PROVIDE FOR ELECTRICAL SUBCONTRACTOR INVOLVEMENT AS NEEDED. COORDINATE WITH THE SUPPLIER TO UNDERSTAND WHAT FEATURES AND OPTIONS ARE FIELD INSTALLED.
 INSURE THAT PROPER ACCESS TO THE UNIT IS MAINTAINED. DO NOT RUN PIPING IN FRONT OF ACCESS PANELS.
 INSTALL REFRIGERANT PIPING AS HIGH AS POSSIBLE DROPPING AS NECESSARY TOWARDS CONDENSING UNIT. CONTRACTOR SHALL INVESTIGATE OBSTRUCTIONS AND SELECT THE ROUTE RESULTING IN THE BEST PIPE APPLICATION.
 SUPPORT HORIZONTAL REFRIGERANT SUCTION PIPING 4 FEET ON CENTER. LIQUID LINE MAY BE STRAPPED TO THE INSULATED SUCTION LINE WITH DUCT TAPE.

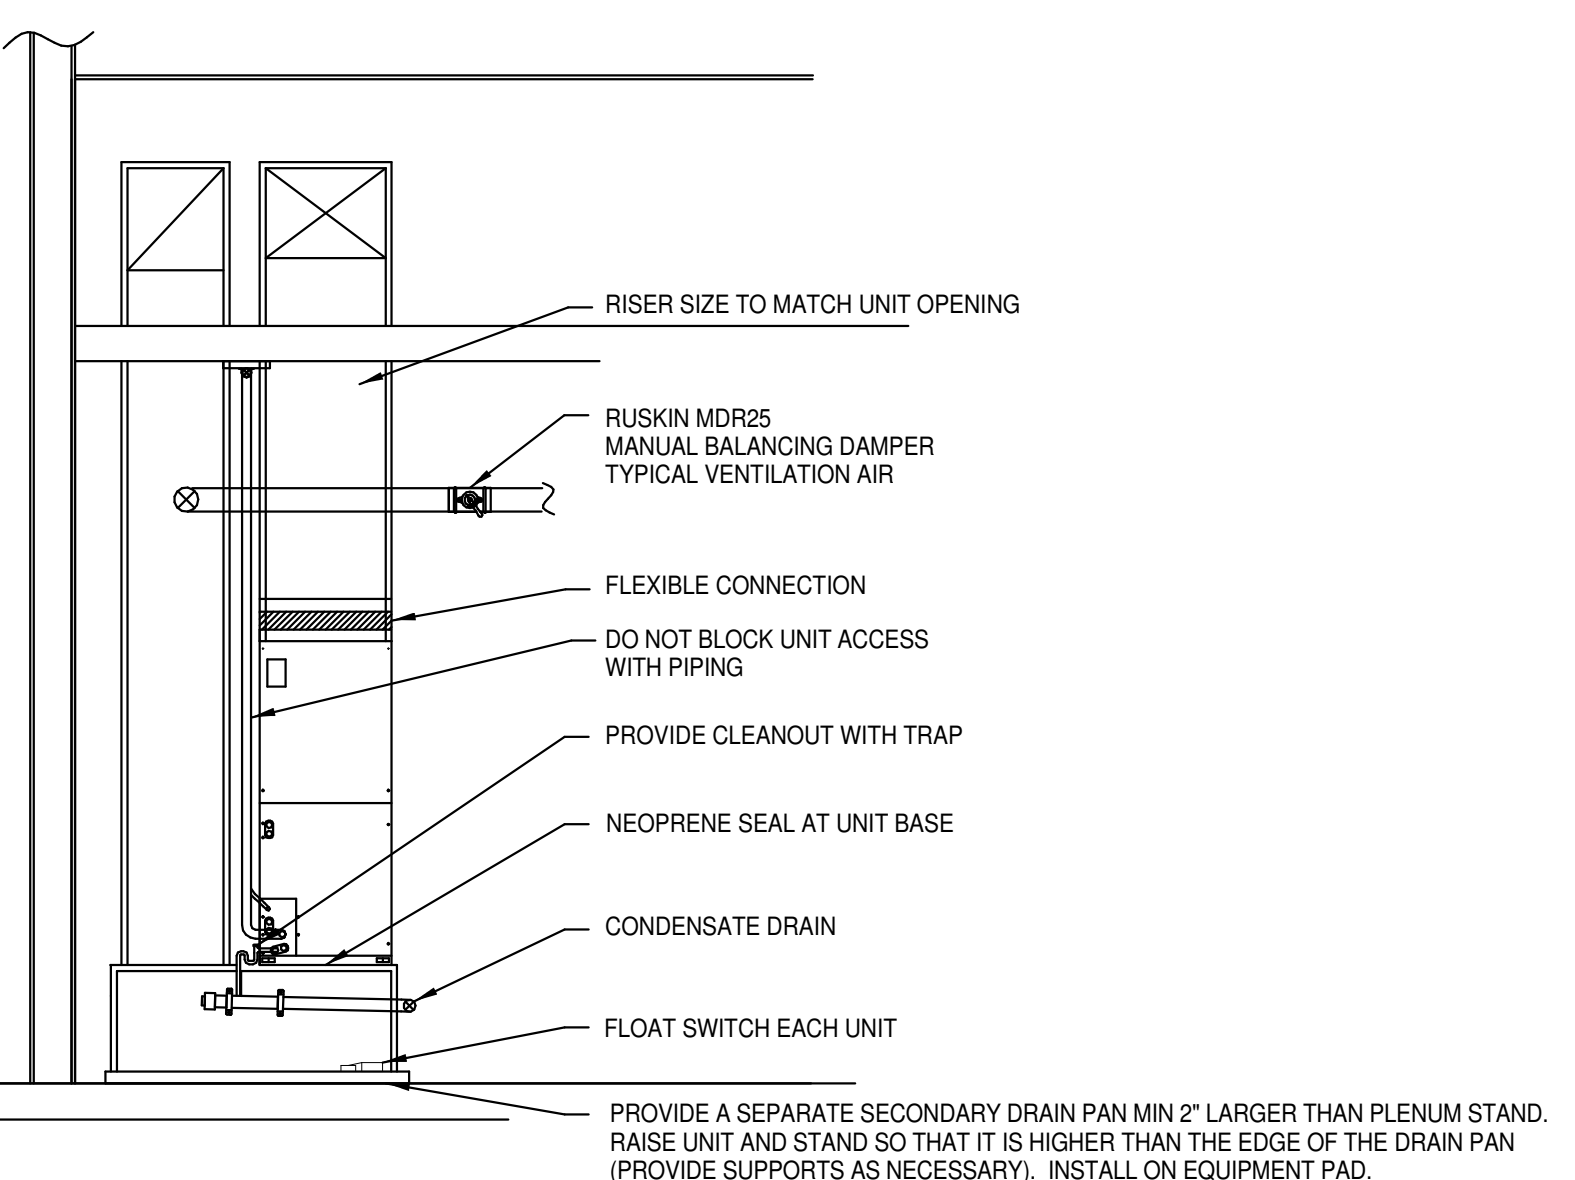


SPLIT SYSTEM HEAT PUMP
 NO SCALE

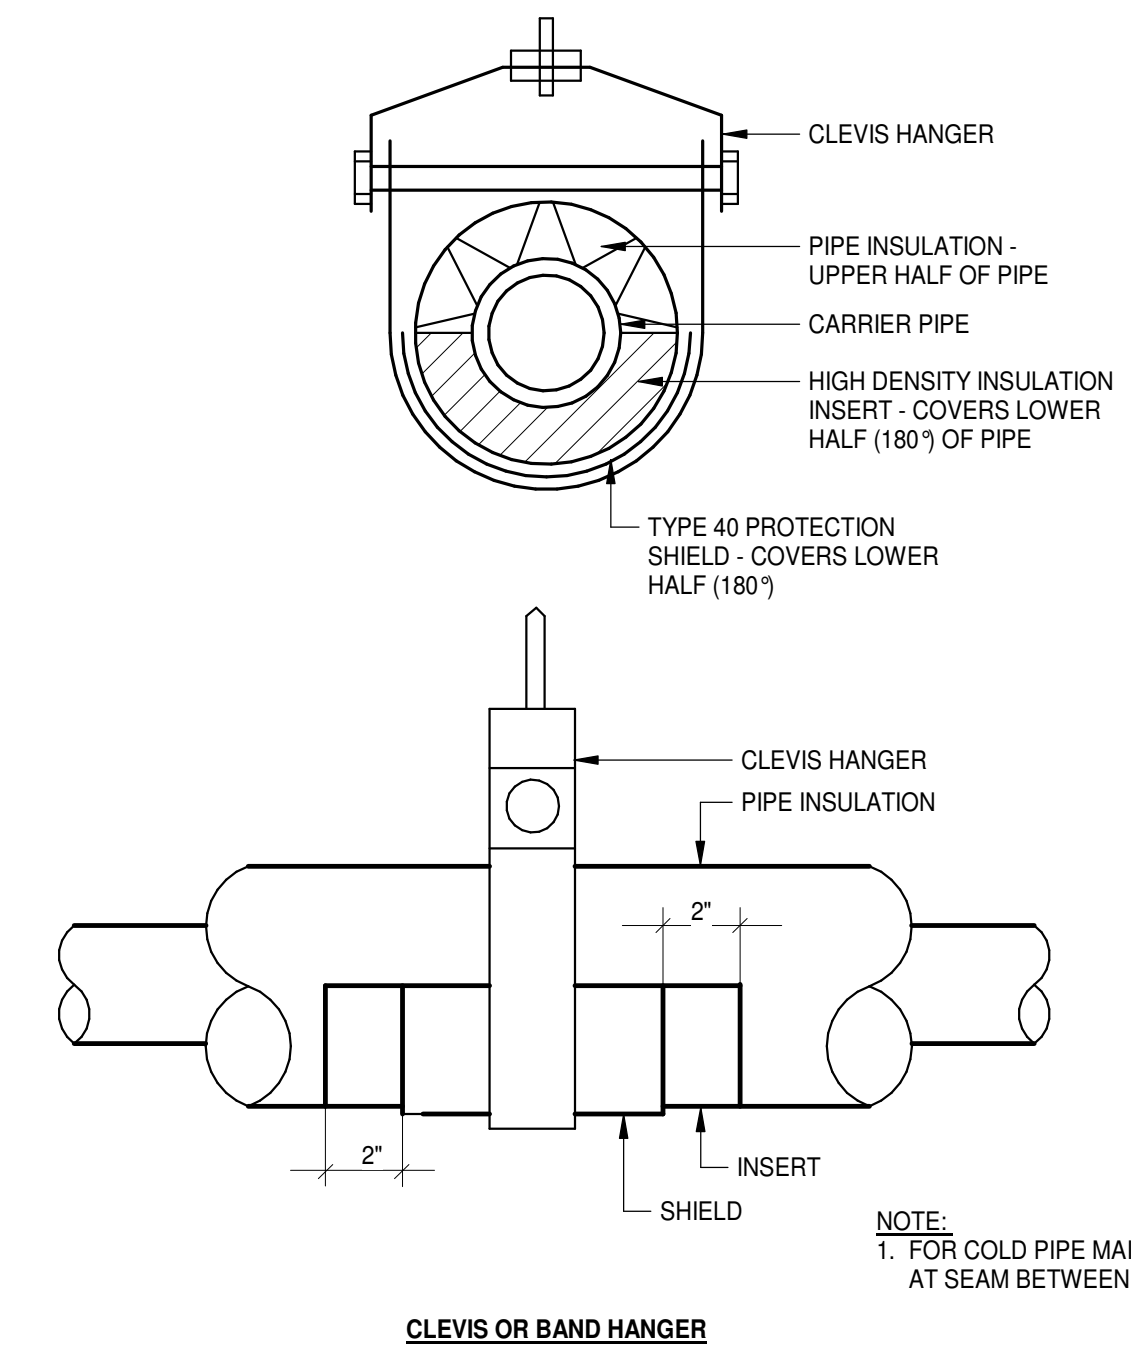


PIPE SUPPORT AND THERMAL SHIELD DETAILS
 NO SCALE
 NOTE:
 1. FOR COLD PIPE MAINTAIN INTEGRITY OF VAPOR BARRIER AT SEAM BETWEEN INSERT AND PIPE INSULATION.

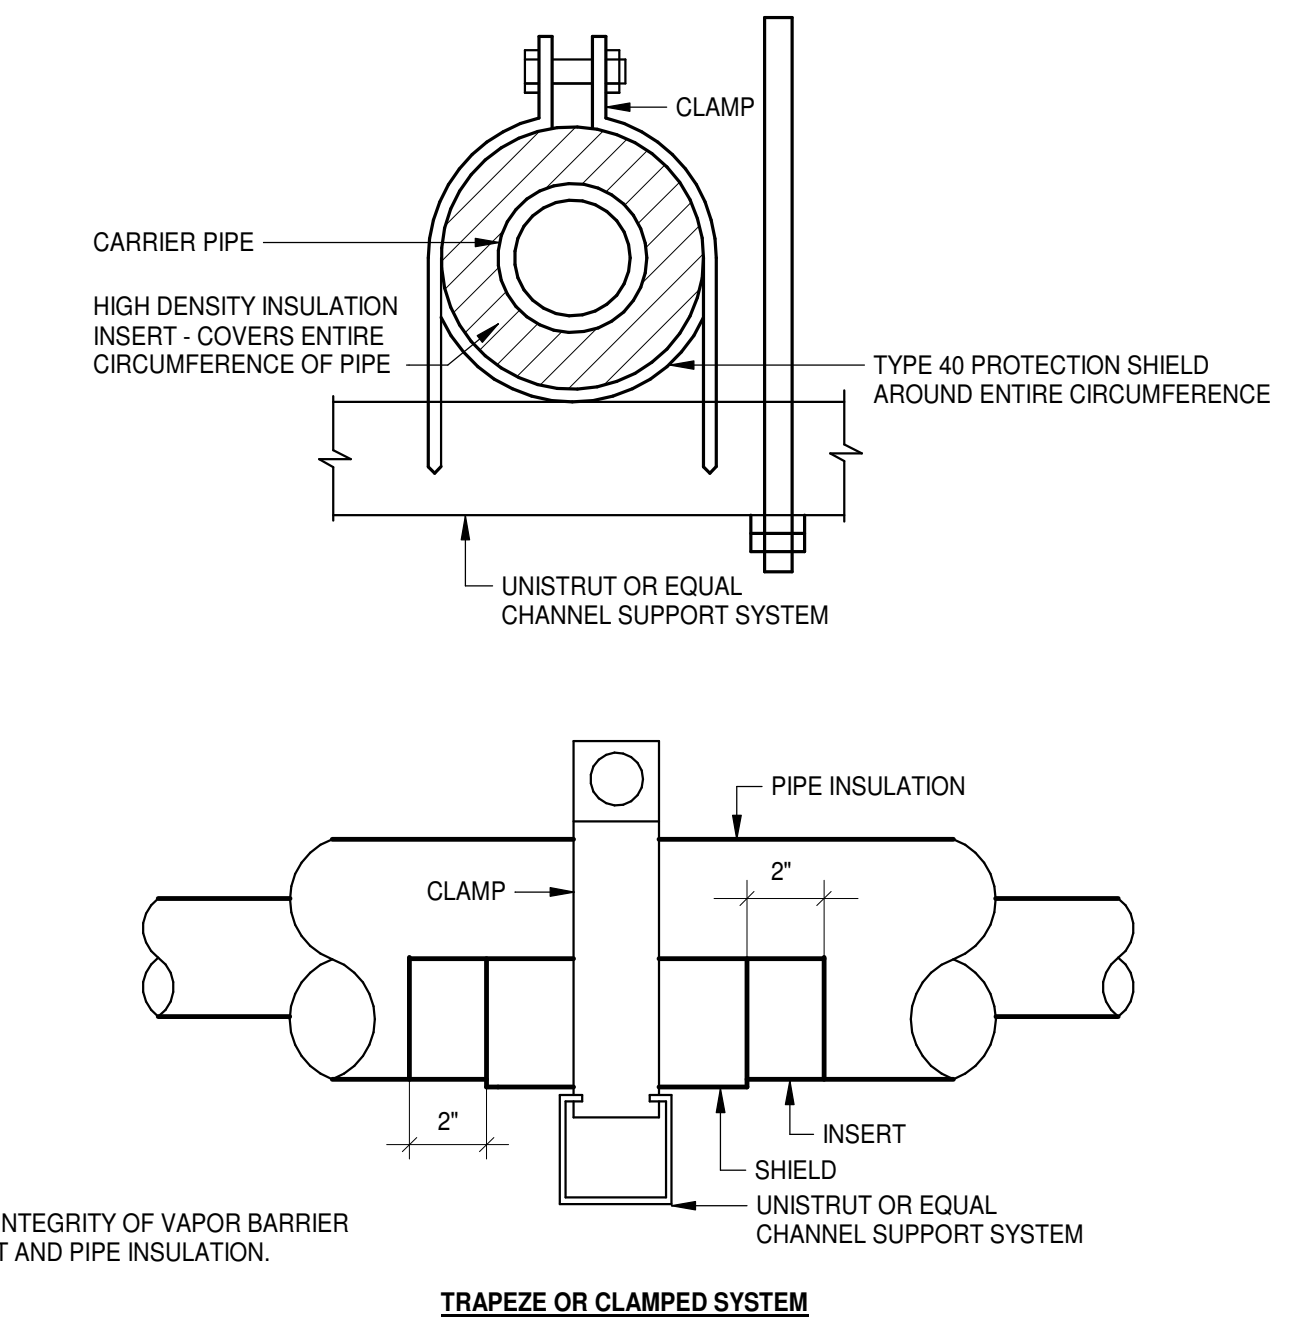


TRAPEZE OR CLAMPED SYSTEM

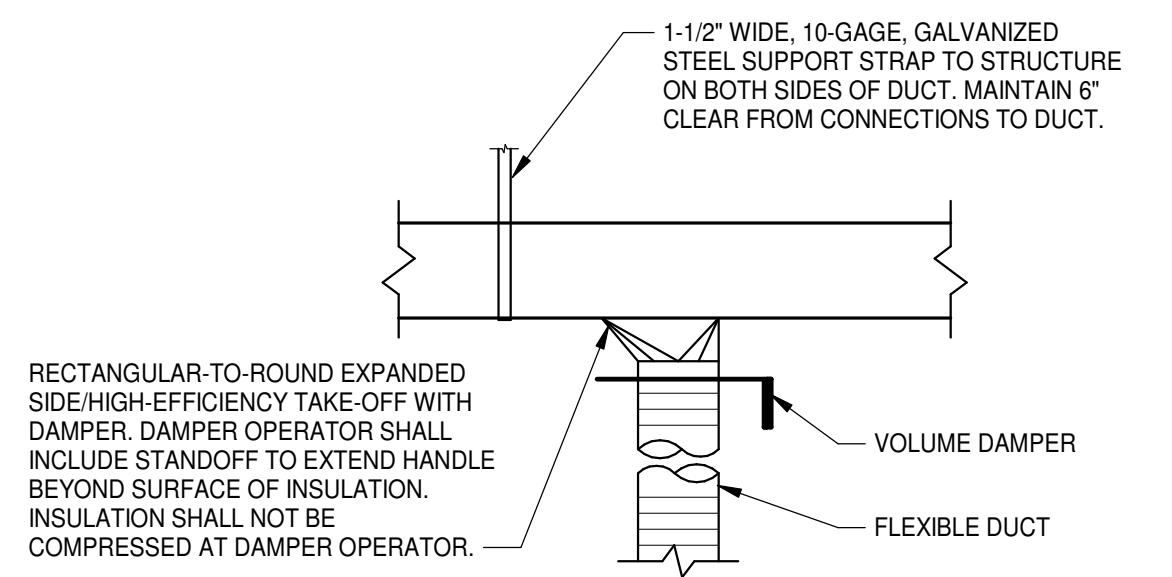


BRANCH CONNECTION TO DIFFUSER DETAILS
 NO SCALE
 NOTES:
 1. FLEXIBLE DUCT SHALL BE INSTALLED OVER METAL DUCT (BEAD/LIP ON METAL DUCT) AND ANCHORED WITH NYLON MECHANICAL BANDS OR PANDUIT STRAP.
 2. IN EXPOSED AREAS, PROVIDE RIGID GALVANIZED STEEL BRANCH DUCT TO DIFFUSERS IN LIEU OF FLEXIBLE DUCT UNLESS INDICATED OTHERWISE. SUPPORT IN ACCORDANCE WITH REQUIREMENTS SPECIFIED FOR METAL DUCTS.

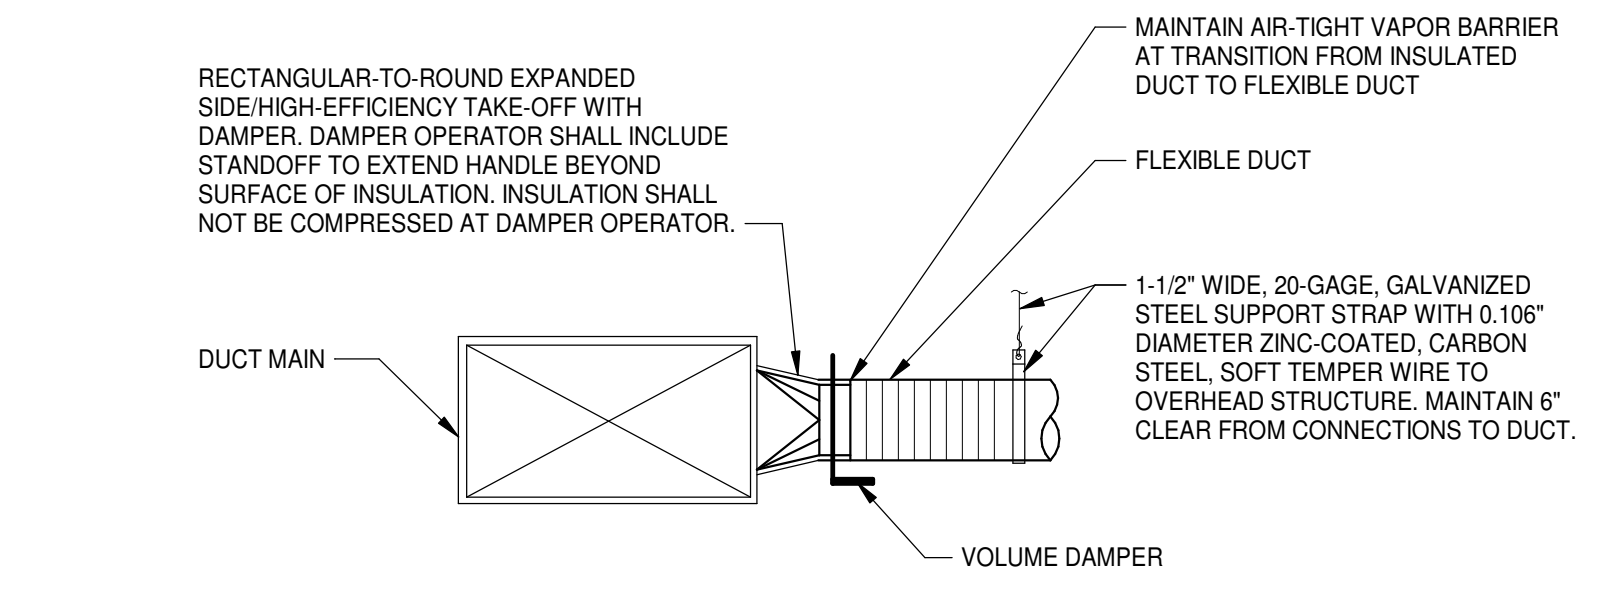


DIVIDED FLOW BRANCH DETAILS
 NO SCALE

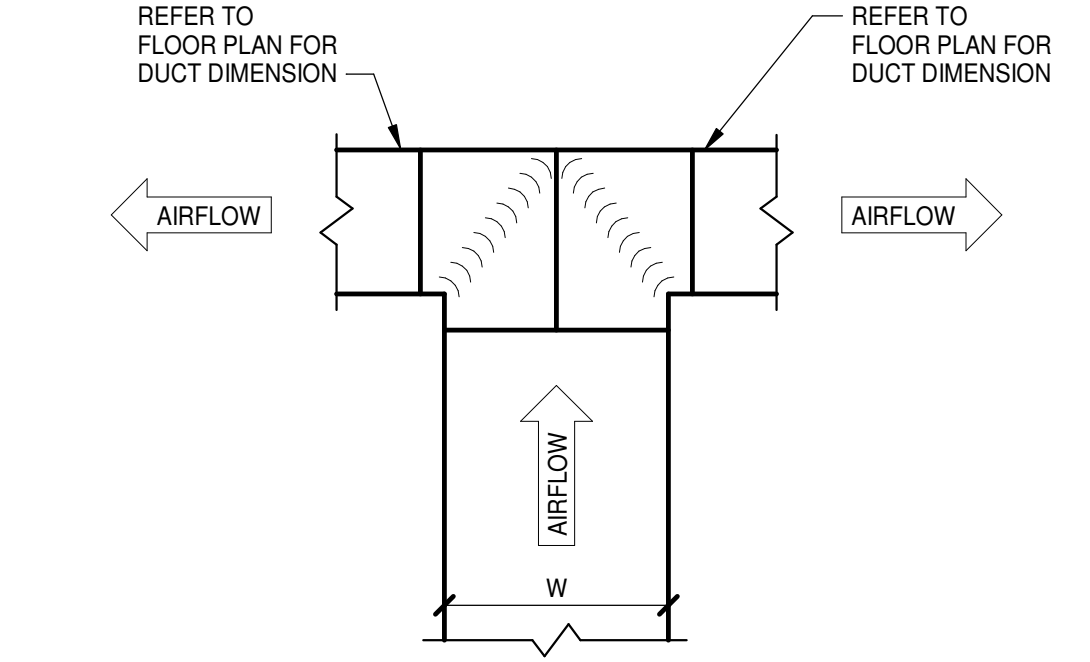

BRANCH CONNECTION TO DIFFUSER DETAILS
 NO SCALE
 NOTES:
 1. APPLIES WHERE "W" EXCEEDS 24" OR WHEN AIRFLOW EXCEEDS 1,500 CFM.

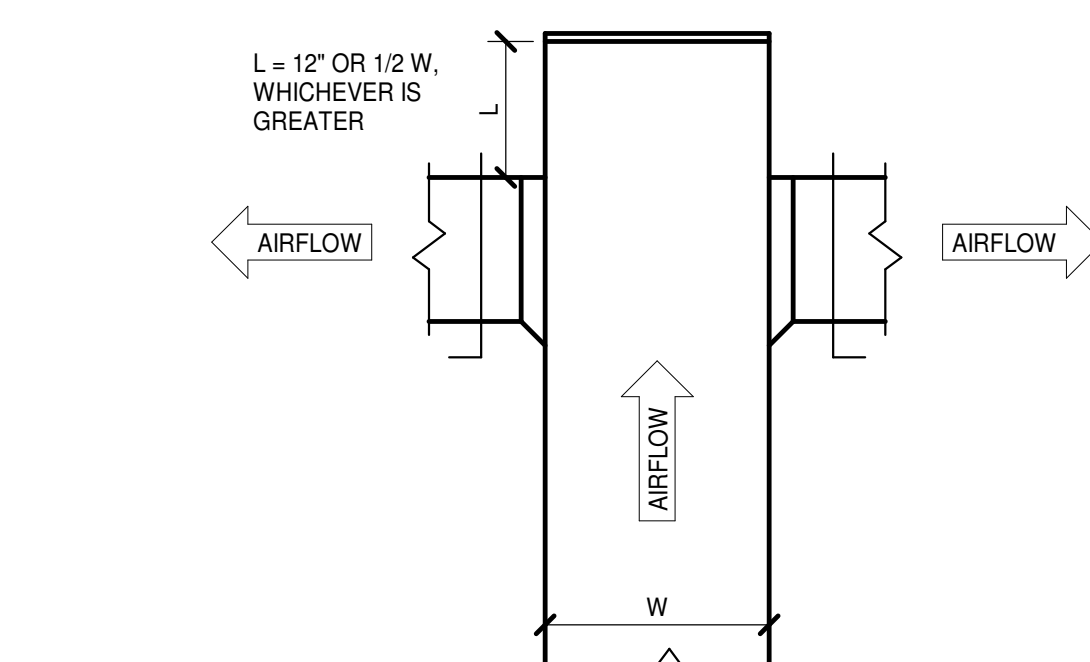

BRANCH CONNECTION TO DIFFUSER DETAILS
 NO SCALE
 NOTES:
 1. REFER TO BRANCH CONNECTION TO DIFFUSER DETAILS FOR BRANCH TAKE-OFF REQUIREMENTS.
 2. APPLIES TO:
 A. WHERE "W" IS LESS THAN 24"
 B. ROUND DUCT BRANCHES TO DIFFUSERS
 C. WHEN AIRFLOW IS EQUAL TO OR LESS THAN 1,500 CFM.

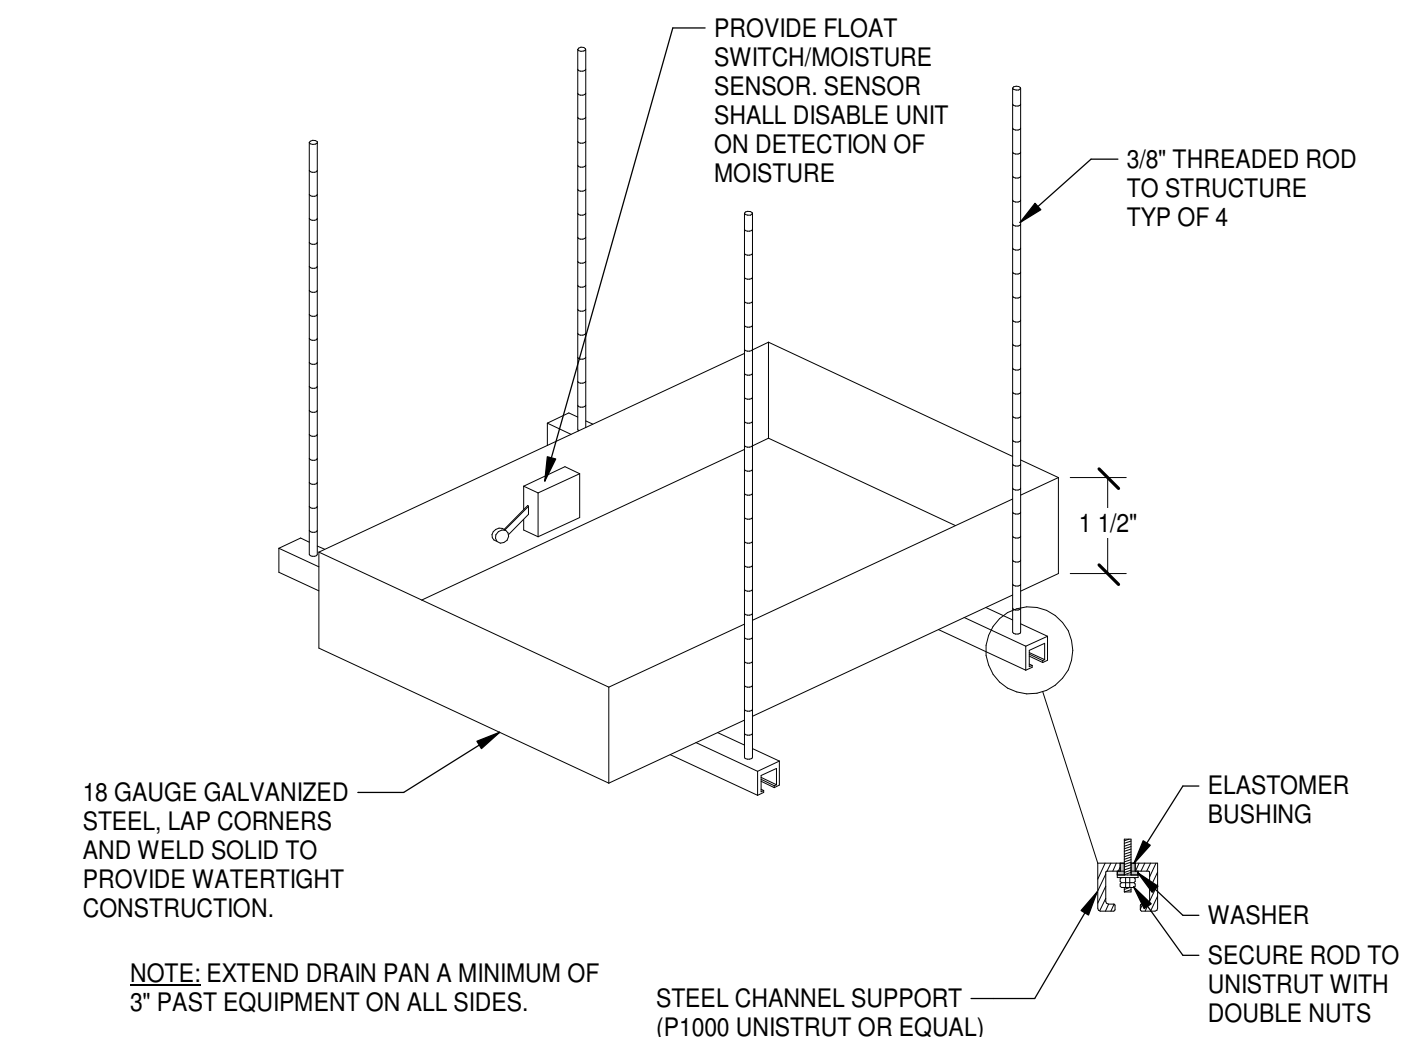

AUXILIARY DRAIN PAN MOUNTING DETAIL
 NO SCALE
 NOTE: EXTEND DRAIN PAN A MINIMUM OF 3" PAST EQUIPMENT ON ALL SIDES.

FIRE ALARM LEGEND

SYMBOL DESCRIPTION

- XV** FIRE ALARM AUDIO/VISUAL NOTIFICATION DEVICE, MOUNT AT 80" AFF AND NOT MORE THAN 96". SUBSCRIPT NUMBER INDICATES STROBE CANDELA RATING.
- AV** FIRE ALARM VISUAL STROBE NOTIFICATION DEVICE, 80" AFF AND NOT MORE THAN 96". SUBSCRIPT NUMBER INDICATES STROBE CANDELA RATING.
- XV** FIRE ALARM AUDIO/VISUAL NOTIFICATION DEVICE WITH DEVICE GUARD, 80" AFF AND NOT MORE THAN 96". SUBSCRIPT NUMBER INDICATES STROBE CANDELA RATING. # / # INDICATES STROBE SETTING AND REDUCED EFFECTIVE OUTPUT WHEN DEVICE GUARD IS PRESENT.
- AV** FIRE ALARM VISUAL STROBE NOTIFICATION DEVICE, 80" AFF AND NOT MORE THAN 96". SUBSCRIPT NUMBER INDICATES STROBE CANDELA RATING. # / # INDICATES STROBE SETTING AND REDUCED EFFECTIVE OUTPUT WHEN DEVICE GUARD IS PRESENT.
- F** FIRE ALARM MANUAL PULL STATION, MOUNT AT +3'-10" AFF.
- FX** FIRE ALARM MANUAL PULL STATION. KEY OPERATED, MOUNT AT +3'-10" AFF.
- SD** FIRE ALARM DUCT SMOKE DETECTOR. FURNISH AND CONNECT UNDER DIVISION 28. INSTALL UNDER DIVISION 23. VERIFY LOCATION WITH DIVISION 23 PRIOR TO ROUGH-IN. PROVIDE ACCESSIBLE KEY OPERATED REMOTE TEST SWITCH FOR EACH DETECTOR.
- S** SMOKE DETECTOR, CEILING MOUNT.
- H** HEAT DETECTOR, CEILING MOUNT.
- CO** CO DETECTOR, CEILING MOUNT.
- S** DEVICE WITH DEVICE GUARD. SYMBOL MAY VARY
- TS** FIRE ALARM TAMPER SWITCH. PROVIDE UNDER DIVISION 23. MONITOR UNDER DIVISION 28.
- FS** FIRE ALARM FLOW SWITCH. PROVIDE UNDER DIVISION 23. MONITOR UNDER DIVISION 28.
- PS** FIRE ALARM PRESSURE SWITCH. PROVIDE UNDER DIVISION 23. MONITOR UNDER DIVISION 28.
- M** FIRE ALARM MONITOR MODULE. NOT ALL MONITOR MODULES ARE INDICATED ON DRAWINGS. PROVIDE QUANTITY AND IN LOCATIONS REQUIRED TO ACCOMPLISH SPECIFIED MONITORING FUNCTIONS.
- C** FIRE ALARM CONTROL MODULE. NOT ALL CONTROL MODULES ARE INDICATED ON DRAWINGS. PROVIDE QUANTITY AND IN LOCATIONS REQUIRED TO ACCOMPLISH SPECIFIED CONTROL FUNCTIONS.
- S** FIRE ALARM SPRINKLER BELL, MOUNT AT +10'-0" AFF.

POWER LEGEND

SYMBOL DESCRIPTION

- APPLIANCE RECEPTACLE, MOUNT AT +1'-6" AFF. PROVIDE NEMA CONFIGURATION TO MATCH PLUG FOR EQUIPMENT SERVED.
- DP** DUPLEX RECEPTACLE, NEMA 5-20R, MOUNT AT +1'-6" AFF.
- DP** DUPLEX RECEPTACLE, NEMA 5-20R, MOUNT AT +3'-10" AFF.
- DP** DUPLEX RECEPTACLE, NEMA 5-20R, MOUNT AT +7'-6" AFF.
- GFCI DP** DUPLEX RECEPTACLE, NEMA 5-20R, MOUNT AT +1'-6" AFF. PROVIDE NEMA 3R "WHILE IN USE" ENCLOSURE.
- GFCI DP** DUPLEX RECEPTACLE, NEMA 5-20R, MOUNT AT +1'-6" AFF.
- GFCI DP** DUPLEX RECEPTACLE, NEMA 5-20R, MOUNT AT +3'-10" AFF.
- DD** DOUBLE DUPLEX RECEPTACLE, NEMA 5-20R, MOUNT AT +1'-6" AFF.
- DD** DOUBLE DUPLEX RECEPTACLE, NEMA 5-20R, MOUNT AT +3'-10" AFF.
- CR** CORD REEL, OUTLET, CEILING MOUNT.
- MS** METALLIC SURFACE RACEWAY, DEVICES AS INDICATED, MOUNT AT +1'-6" AFF, UNO.
- J** JUNCTION BOX, CONCEALED ABOVE CEILING, UNO.
- M** MUSHROOM SWITCH, HEAVY DUTY WITH LEGEND PLATE, MOUNT W/HANDLE AT +3'-10" AFF, UNO.
- M** MANUAL MOTOR STARTER, OVERLOAD PROTECTION AS REQUIRED PER NAME PLATE RATINGS, WITH 'ON' INDICATOR PILOT LIGHT. FLUSH MOUNT W/HANDLE AT +3'-10" AFF, UNO.
- DIS** DISCONNECT SWITCH, FUSIBLE OR NON-FUSIBLE AS INDICATED. MOUNT W/HANDLE AT +4'-6" AFF, UNO.
- M** MAGNETIC MOTOR STARTER, WITH OVERLOAD RELAYS AS REQUIRED TO SERVE MANUFACTURER REQUIREMENTS OF EQUIPMENT SERVED. PROVIDE WITH HAND-OFF-AUTOMATIC SELECTOR SWITCH AND INDICATOR LIGHTS. MOUNT W/HANDLE AT +4'-6" AFF, UNO.
- COM** COMBINATION MAGNETIC STARTER AND DISCONNECT SWITCH. WITH OVERLOAD ELEMENTS AND FUSING AS REQUIRED TO SERVE MANUFACTURER REQUIREMENTS OF EQUIPMENT SERVED. PROVIDE WITH HAND-OFF-AUTOMATIC SELECTOR SWITCH AND INDICATOR LIGHTS. MOUNT W/HANDLE AT +4'-6" AFF, UNO.
- E** EQUIPMENT POWER CONNECTION.
- M** MOTOR CONNECTION.
- M** CONNECTION TO DIV 23 MOTORIZED DAMPER, VERIFY LOCATION.
- P** POWER FOR ELECTRIC DOOR LOCK CONNECTION.
- E** EMERGENCY GENERATOR.
- P** PANELBOARD.
- T** TRANSFORMER, PROVIDE CONCRETE HOUSEKEEPING PAD UNLESS NOTED OTHERWISE.
- XXX** FEEDER TAG. REFER TO FEEDER SCHEDULE

COMMUNICATIONS LEGEND

NOTE: REFER TO DETAILS ON E4.1 FOR BOX & CONDUIT, CABLING AND TERMINAL JACK REQUIREMENTS.

SYMBOL DESCRIPTION

- TE** TELECOMMUNICATIONS OUTLET, MOUNT AT +3'-10" AFF.
- TE** TELECOMMUNICATIONS OUTLET, MOUNT AT +1'-6" AFF.
- IN** INMATE PHONE, MOUNT AT +3'-10" AFF.
- VF** RECESSED FLOOR MOUNT DEVICE COMPLETE WITH FITTINGS FOR FLOOR COVERING.
- V** VIDEO VISIT STATION, REFER TO ARCHITECTURAL PLANS FOR MOUNTING HEIGHT
- CATV** OUTLET, REFER TO DETAIL ON E4.1 AND ARCHITECTURAL DRAWING FOR MOUNTING HEIGHTS.
- RC** REFER TO DETAIL ON E4.1 AND ARCHITECTURAL DRAWING FOR MOUNTING HEIGHTS.
- PO** POWER/COMMUNICATIONS RECESSED FLOOR BOX. SUBSCRIPT LETTER INDICATES OUTLET TYPE. REFER TO "TYPICAL COMMUNICATION OUTLET DETAIL" FOR BOX AND CONDUIT REQUIREMENTS.
- PO** POWER/COMMUNICATIONS POKE-THRU FLOOR BOX. SUBSCRIPT LETTER INDICATES OUTLET TYPE. (2) 3/4" CONDUITS, (1) EACH AT OPPOSITE SIDES, TO STUB UP AT NEAREST COMMUNICATION CROSS-CONNECT, UNO. REFER TO "TYPICAL COMMUNICATION OUTLET DETAIL".
- FP** SYSTEM FURNITURE COMMUNICATIONS CONNECTION VIA FLUSH WALL BOX MOUNTED +4" AFF. PROVIDE 1/2" CONDUIT WITH BUSHINGS FROM BOX TO ABOVE CEILING. COORDINATE WITH FURNITURE PROVIDER PRIOR TO ROUGH-IN.
- WA** WIRELESS ACCESS POINT
- T** TELECOMMUNICATIONS EQUIPMENT RACK.
- T** 2" EMT CONDUIT SLEEVE WITH NYLON BUSHING EACH END UNO, THRU WALL AT +6" ABOVE FINISHED CEILING.
- TGB** TELECOMMUNICATIONS GROUND BUS BAR, MOUNT AT +1'-6" AFF.
- MD** SMOKE DAMPERS. REFER TO DETAILS MATRIX ON E4.1

- ### GENERAL NOTES
- THE CONTRACT DOCUMENTS ARE COMPLEMENTARY AND WHAT IS REQUIRED BY ONE SHALL BE AS BINDING AS IF REQUIRED BY ALL. IN THE CASE OF A CONFLICT, DISAGREEMENT, OR AMBIGUITY, PROVIDE THE BETTER QUALITY. IN THE CASE OF A CONFLICT, DISAGREEMENT, OR AMBIGUITY, PROVIDE THE GREATER QUANTITY OF WORK.
 - FOLLOW MOUNTING HEIGHTS INDICATED IN THE ELECTRICAL LEGEND UNLESS OTHERWISE INDICATED. MEASURE ALL MOUNTING HEIGHTS FROM THE DEVICE CENTER LINE UNLESS OTHERWISE INDICATED.
 - FIELD VERIFY EXACT FEEDER LOCATIONS FOR MECHANICAL EQUIPMENT PRIOR TO ROUGH-IN.
 - EQUIPMENT CONNECTIONS ARE INDICATED IN THEIR APPROXIMATE LOCATIONS. VERIFY EXACT LOCATIONS OF ALL CONNECTIONS WITH OTHER TRADES SUPPLYING EQUIPMENT TO AVOID CONFLICTS AT INSTALLATION.
 - LOCATED ALL SWITCHES FOR LOCAL CONTROL OF LIGHTING ON STRIKE SIDE OF SINGLE DOORS UNLESS OTHERWISE INDICATED.
 - PROVIDE SPECIFIC BREAKER ARRANGEMENT FOR THE PANEL BOARDS WHEREVER PHYSICALLY POSSIBLE. PROVIDE AS-BUILT DRAWINGS INDICATING ACTUAL BRANCH CIRCUIT ARRANGEMENT. PROVIDE TYPE WRITTEN PANELBOARD DIRECTORIES INDICATING ACTUAL BRANCH CIRCUIT ARRANGEMENT.
 - PROVIDE AS-BUILT DRAWINGS INDICATING ACTUAL BRANCH CIRCUIT ARRANGEMENT. PROVIDE TYPE WRITTEN PANELBOARD DIRECTORIES INDICATING ACTUAL BRANCH CIRCUIT ARRANGEMENT. HAND WRITTEN SCHEDULES ARE NOT ACCEPTABLE.
 - ALL CONDUIT RUNS INDICATED ARE DIAGRAMMATIC. COORDINATE ROUTING IN ALL SPACES WITH OTHER TRADES.
 - ALL PANELBOARDS INDICATED ARE HOUSED IN A SINGLE WIDTH ENCLOSURE, UNO. THE CONTRACTOR SHALL FIELD VERIFY ROOM LAYOUT AND ADJUST ACCORDINGLY, AT NO COST TO THE OWNER, IF PROVIDING ANY PANELBOARD ENCLOSURES.
 - WHERE POWER AND COMMUNICATION OUTLETS ARE INDICATED IN CLOSE PROXIMITY ON THE DRAWINGS, FIELD COORDINATE THE LOCATIONS TO PLACE THE OUTLETS ADJACENT TO EACH OTHER.
 - ALL EXTERIOR RECEPTACLES SHALL BE LABELED "WV" - WEATHER RESISTANT.
 - WHEN GROUPING MULTIPLE LINE TO NEUTRAL BRANCH CIRCUITS IN A CONDUIT, PROVIDE DEDICATED COLOR CODED NEUTRAL CONDUCTORS FOR EACH CIRCUIT. DO NOT USE BREAKER TIES AND SHARED NEUTRALS EVEN THOUGH PERMITTED BY NEC.
 - PROVIDE A 2" WIDE YELLOW LINE PAINTED ON THE FLOOR INDICATING THE ELECTRICAL WORKING SPACE. IN FRONT OF ALL ELECTRICAL PANELS IN ELECTRICAL ROOMS. REFER TO PLANS FOR ELECTRICAL WORKING SPACE DETAILS. STENCIL "NO STORAGE IN 2' HIGH, YELLOW LETTERS CENTERED IN THE OUTLINED AREA.

ONE LINE DIAGRAM LEGEND

SYMBOL DESCRIPTION

- CB** CIRCUIT BREAKER
- FS** FUSED SWITCH
- T** TRANSFORMER
- TS** TRANSFER SWITCH
- XXX** FEEDER DESIGNATION
- CT** CURRENT TRANSFORMER
- PT** POTENTIAL TRANSFORMER


LIGHTING LEGEND

SYMBOL DESCRIPTION

- S** LIGHT SWITCH, RATED 120/277 VOLTS, 20-AMPS, MOUNT AT +3'-10" AFF. SUBSCRIPT/SUPERSUBSCRIPT LETTERS, NUMBERS, AND SYMBOLS INDICATES SWITCH TYPE AS FOLLOWS:
 - S3** INDICATES 3-WAY LIGHT SWITCH
 - S4** INDICATES 4-WAY LIGHT SWITCH
 - S** INDICATES DIMMER SWITCH
 - SP** INDICATES PILOT LIGHT, ON WHEN SWITCH IS ON
 - S** INDICATES KEY OPERATED LIGHT SWITCH
 - SOS** INDICATES SWITCH WITH INTEGRAL OCCUPANCY SENSOR
 - SOD** INDICATES DIMMER SWITCH WITH INTEGRAL OCCUPANCY SENSOR
- LC** LOWER CASE LETTER INDICATES LIGHT FIXTURE CONTROL DESIGNATION
 - OMNI** DIRECTIONAL LIGHTING CONTROL, OCCUPANCY DETECTOR, CEILING MOUNT.
 - PE** PHOTOELECTRIC CELL FOR LIGHTING CONTROL, WALL MOUNT AT +10'-0" AFF. AIM NORTH.
 - LI** LIGHT FIXTURE, CEILING MOUNT.
 - LE** LIGHT FIXTURE ON EMERGENCY POWER, CEILING MOUNT.
 - L** LIGHTING FIXTURE.
 - LE** LIGHTING FIXTURE ON EMERGENCY POWER.
 - W** WALL WASHER LIGHTING FIXTURE.
 - LI** LIGHT FIXTURE, WALL MOUNT, HEIGHT AS INDICATED.
 - ES** EXIT SIGN, CEILING MOUNT. DIRECTIONAL ARROWS AS INDICATED. SHADING INDICATES FACE(S) OF SIGN.
 - ES** EXIT SIGN, WALL MOUNT. DIRECTIONAL ARROWS AS INDICATED. SHADING INDICATES FACE(S) OF SIGN.
 - P** LIGHT FIXTURE, POLE MOUNT.

ABBREVIATIONS

1P SINGLE PHASE
3P THREE PHASE
3R WEATHERPROOF (NEMA 3R)
A AMPS
AFF ABOVE FINISHED FLOOR
AL ALUMINUM
ATS AUTOMATIC TRANSFER SWITCH
BFC BELOW FINISHED CEILING
BFG BELOW FINISHED GRADE
BKR BREAKER
C CONDUIT
CATV COMMUNITY ANTENNA TELEVISION (CABLE)
CB CIRCUIT BREAKER
CBL CABLE
CCTV CLOSED CIRCUIT TELEVISION
CKT CIRCUIT
CLG CEILING
CLR CLEAR
CO COMPANY
COMB COMBINATION
COMM COMMUNICATIONS
CU COPPER
DIA DIAMETER
DISC DISCONNECT
DIV DIVISION
DWG DRAWING
EBH ELECTRIC BASEBOARD HEATER
EC EMPTY CONDUIT
ECS EMERGENCY COMMUNICATIONS STATION
ELEC ELECTRICAL
ELEV ELEVATOR
EPO EMERGENCY POWER OFF
EQ EQUIPMENT
ETR EXISTING TO REMAIN
EWC ELECTRIC WATER COOLER
EX EXISTING
EXT EXTERIOR
FA FIRE ALARM
FAAP FIRE ALARM ANNUNCIATOR PANEL
FACP FIRE ALARM CONTROL PANEL
FAGP FIRE ALARM GRAPHIC PANEL
FAXP FIRE ALARM EXTENDER PANEL
FFSCP FIRE FIGHTER'S SMOKE CONTROL PANEL
FLA FULL LOAD AMPS
FPMR FUSE PER MANUFACTURERS REQUIREMENTS/RECOMMENDATIONS
FPND FUSE PER NAMEPLATE DATA
G GROUND
GE GROUND FAULT PROTECTION FOR EQUIPMENT, 6-50mA PER NEC 427.22 (PROVIDE ACCESSORY FOR INDICATED BREAKER)
GFCI GROUND FAULT CIRCUIT INTERRUPT
GFP GROUND FAULT PROTECTION FOR PERSONNEL, 4-6mA (PROVIDE ACCESSORY FOR INDICATED BREAKER)
HKP HOUSEKEEPING PAD
HP HORSEPOWER
HPS HIGH PRESSURE SODIUM
HZ HERTZ
IAW IN ACCORDANCE WITH
IG ISOLATED GROUND
J-BOX JUNCTION BOX
KHFSS KITCHEN HOOD FIRE SUPPRESSION SYSTEM
KHZ KILOHERTZ
KVA KILOWATT AMPS
KW KILOWATTS
KWH KILOWATT HOURS
L LOCKOUT TO PREVENT UNAUTHORIZED SWITCHING (PROVIDE ACCESSORY FOR INDICATED BREAKER)
LC ROUTE CIRCUIT TO LOAD VIA LIGHTING CONTRACTOR. REFER TO LC SCHEDULE
LED LIGHT EMITTING DIODE
LTG LIGHTING
LTS LIGHTS
MAX MAXIMUM
MCA MINIMUM CIRCUIT AMPACITY
MCB MAIN CIRCUIT BREAKER
MCC MOTOR CONTROL CENTER
MH METAL HALIDE
MHZ MEGAHERTZ
MIN MINIMUM
ML MAINTENANCE LOCK (PROVIDE ACCESSORY FOR INDICATED BREAKER)
MLO MAIN LUG ONLY
MNS MASS NOTIFICATION SYSTEM
MOSP MAXIMUM OVER CURRENT PROTECTION
MOUNT MOUNTED
N NEUTRAL
N/C NORMALLY CLOSED
N/O NORMALLY OPEN
NO NUMBER
OFCI OWNER FURNISHED CONTRACTOR INSTALLED
P PILOT LIGHT (AT THE SWITCH HANDLE)
PBD PANELBOARD
PD PROTECTIVE DEVICE
RCPPT RECEPTACLE
REC RECEPTACLE
SEC SECURITY
SPD SURGE PROTECTIVE DEVICE
SPEC SPECIFICATIONS
ST SHUNT TRIP, 120V COIL, (PROVIDE ACCESSORY FOR INDICATED BREAKER)
SW SWITCH
SWBD SWITCHBOARD
TBB TELECOMMUNICATIONS BONDING BACKBONE
TO TELECOMMUNICATIONS TOSSET
TELECOM TELECOMMUNICATIONS
TGB TELECOMMUNICATIONS GROUNDING BUS BAR
TMGB TELECOMMUNICATIONS MAIN GROUNDING BUS BAR
TYP TYPICAL
UNO UNLESS NOTED (INDICATED) OTHERWISE
V VOLTS
VFD VARIABLE FREQUENCY DRIVE
W WATTS
W WITH
WG WIRE GUARD
WP WEATHERPROOF
XFER TRANSFER
XFMR TRANSFORMER

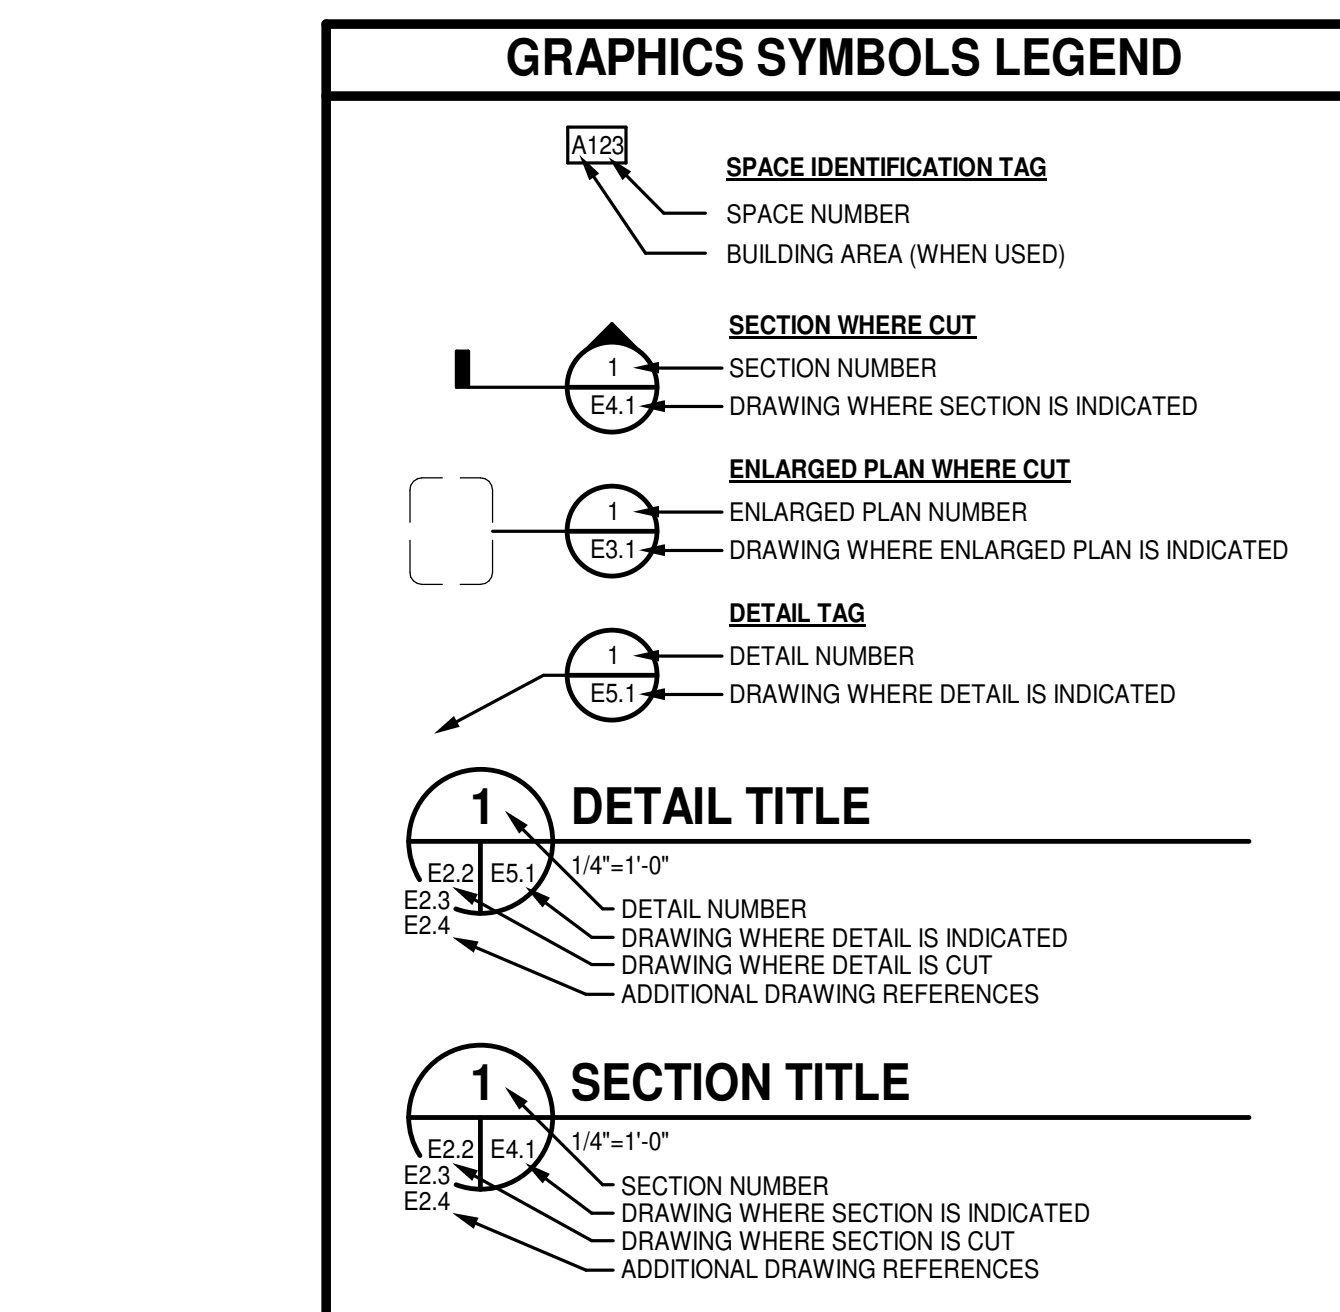


COPPER FEEDER SCHEDULE

FEEDER ID	# OF SETS	BUILDING WIRE QUANTITY & SIZE TYPE	THHN - DRY TYPE THWN - WET	MINIMUM CONDUIT SIZE	FEEDER ID	# OF SETS	BUILDING WIRE QUANTITY & SIZE TYPE	THHN - DRY TYPE THWN - WET	MINIMUM CONDUIT SIZE
30	1	3#10,#10 G		3/4"	30Y	1	4#10,#10 G		3/4"
35	1	3#8,#10 G		3/4"	35Y	1	4#8,#10 G		3/4"
40	1	3#8,#10 G		3/4"	40Y	1	4#8,#10 G		3/4"
45	1	3#6,#10 G		1"	45Y	1	4#6,#10 G		1"
50	1	3#6,#10 G		1"	50Y	1	4#6,#10 G		1"
60	1	3#4,#10 G		1"	60Y	1	4#4,#10 G		1"
70	1	3#4,#8 G		1 1/4"	70Y	1	4#4,#8 G		1 1/4"
80	1	3#3,#8 G		1 1/4"	80Y	1	4#3,#8 G		1 1/4"
90	1	3#2,#8 G		1 1/4"	90Y	1	4#2,#8 G		1 1/4"
100	1	3#1,#8 G		1 1/4"	100Y	1	4#1,#8 G		1 1/4"
110	1	3#2,#6 G		1 1/2"	110Y	1	4#2,#6 G		1 1/2"
125	1	3#1,#6 G		1 1/2"	125Y	1	4#1,#6 G		1 1/2"
150	1	3#10,#6 G		2"	150Y	1	4#10,#6 G		2"
175	1	3#20,#6 G		2"	175Y	1	4#20,#6 G		2"
200	1	3#30,#6 G		2"	200Y	1	4#30,#6 G		2"
225	1	3#40,#4 G		2 1/2"	225Y	1	4#40,#4 G		2 1/2"
250	1	3-250CM,#4 G		2 1/2"	250Y	1	4-250CM,#4 G		2 1/2"
300	1	3-350CM,#4 G		2 1/2"	300Y	1	4-350CM,#4 G		2 1/2"
350	2	3#20,#3 G		3"	350Y	2	4#20,#3 G		3"
400	2	3#30,#3 G		3"	400Y	2	4#30,#3 G		3"
400S	2	3#30		2"					

NOTES:
1. ELECTRICAL CONTRACTOR TO VERIFY CONDUIT SIZE REQUIRED IF WIRE TYPES OTHER THAN THOSE LISTED ABOVE ARE USED.
2. FEEDER SIZES BASED ON TABLE 310.15(B)(16), 75° C.
3. SIZES ADJUSTED PER NEC 110.14.

MOSELEYARCHITECTS

6210 ARDREY KELL ROAD • THE HUB AT WAVERLY, SUITE 425 • CHARLOTTE, NC 28277
PHONE (704) 540-3755 FAX (704) 540-3754
MOSELEYARCHITECTS.COM

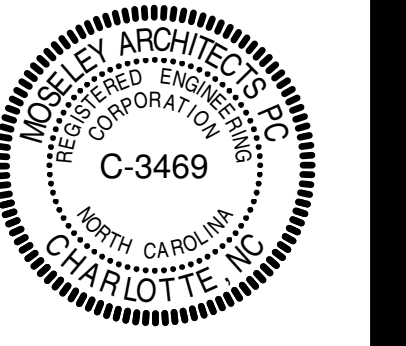


GEORGETOWN COUNTY RE-ENTRY FACILITY

611315
GEORGETOWN COUNTY
GEORGETOWN, SOUTH CAROLINA

PROJECT NO: 611315
DATE: FEBRUARY 09, 2024

REVISIONS	
DATE	DESCRIPTION

LEGENDS, ABBREVIATIONS AND GENERAL NOTES

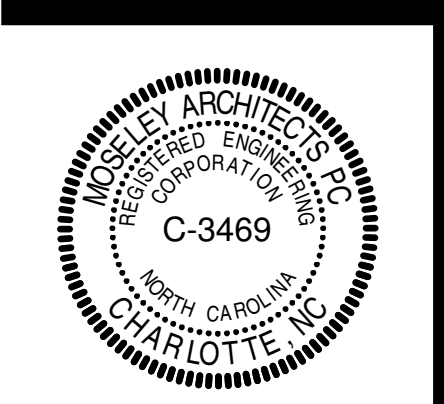

PROJECT NO:	611315
DATE:	FEBRUARY 09, 2024
REVISIONS	
DATE	DESCRIPTION

KEYNOTES
 APPLIES TO THIS DRAWING REPRESENTED BY

- PROVIDE 3#10 #10G.3/4" AND 240V, 3P, 30A NEMA 3R, DISCONNECT, FUSED PER MANUFACTURER'S RECOMMENDATION FOR WALK-IN COOLER CONDENSER UNIT.
- PROVIDE 2#10 #10G.3/4" AND 120V, 1P, 30A DISCONNECT, FUSED PER MANUFACTURER'S RECOMMENDATION FOR WALK-IN COOLER EVAPORATOR UNIT.
- PROVIDE 4"X8"X3/4" FIRE RESISTANT PLYWOOD MOUNTED WITH LONG DIMENSION MOUNTED VERTICALLY ON WALLS AS INDICATED.

LIGHT FIXTURE SCHEDULE

TYPE	DESCRIPTION	MANUFACTURER	FIXTURE	SERIES NO.	VOLTAGE	WATTAGE	LUMENS	LAMP	COLOR TEMP.	MOUNTING	OPTIONS	COMMENTS
A1	2x4 LED TROFFER	LITHONIA	2RTL4 48L G210 LP850	120 V	48	4800 lm	LED	5000 K	RECESSED			PROVIDE FLANGE KIT WHEN MOUNTED IN DRYWALL CEILING
A2	2x4 LED TROFFER	LITHONIA	2RTL4 48L G210 LP850	120 V	48	4800 lm	LED	5000 K	RECESSED	1400LM BATTERY		PROVIDE FLANGE KIT WHEN MOUNTED IN DRYWALL CEILING
A5	2x2 LED TROFFER	LITHONIA	2RTL2 48L G210 LP850	120 V	42	4200 lm	LED	5000 K	RECESSED			PROVIDE FLANGE KIT WHEN MOUNTED IN DRYWALL CEILING
A6	2x2 LED TROFFER	LITHONIA	2RTL2 48L G210 LP850	120 V	42	4200 lm	LED	5000 K	RECESSED			PROVIDE FLANGE KIT WHEN MOUNTED IN DRYWALL CEILING
K1	STRIP LIGHT	LITHONIA	CDS L48 DM 50K 80CRI	120 V	48	4800 lm	LED	5000 K	SURFACE OR CHAIN 12'-0" AFF UNO			
K2	STRIP LIGHT	LITHONIA	CDS L48 DM 50K 80CRI	120 V	48	4800 lm	LED	5000 K	SURFACE OR CHAIN 12'-0" AFF UNO	1400LM BATTERY		
R2	EXTERIOR WALL MOUNT	LITHONIA	TWPX1LED	120 V	40	3100 lm	LED	5000 K	WALL 12'-6" AFF UNO	1400LM BATTERY		
X1	SINGLE FACE EXIT SIGN	LITHONIA	LES 1 R	120 V	5		LED	5000 K	UNIVERSAL	BATTERY		CHEVRONS AS INDICATED

PANELBOARD SCHEDULE LV1 LOCATION: ELECTRICAL V106 FED FROM: ATS

400 AMP MCB 120/208 Wye 3 PH 4 W MOUNT: SURFACE PANEL ASSEMBLY RATED (KAIC): 22 KAIC

CKT	BRKR	POLE	LOAD	A	B	C	LOAD	POLE	BRKR	CKT
1	20 A	1	REC V100	0.7	1.5		LTG SHOP	1	20 A	2
3	20 A	1	REC V100			0.7	1.0	0.5	0.5	LTG ADMIN
5	20 A	1	REC V101							EXTERIOR LIGHTING
7	20 A	1	REC V105	0.9	0.3					FAAP (L) (RED HANDLE)
9	20 A	1	REC V103, V106		0.7	0.3				MOTOR DOOR V109
11	20 A	1	REC V106			0.2	0.5			SPARE ONLY
13	20 A	1	REC V106	0.2						SPARE ONLY
15	20 A	1	REC V107			0.7	3.2			PH-1 (ML)
17										GENERATOR BATTERY...
19										GENERATOR BLOCK HEATER (ML)
21										EF-1 (L)
23										EF-3 (L)
25										RCP-1 (ML)
27										EF-2 (L)
29	20 A	1	REC V110	0.4	0.5					EF-2 (L)
31	20 A	1	REC V101			0.4	0.4			SPARE
33	20 A	1	REC V101			0.0	0.0			SPARE
35	20 A	1	SPARE	0.0	0.0					SPARE
37	20 A	1	SPARE							SPARE
39	25 A	2	HP-1 (ML)		1.5	2.9				AHU-1 (ML)
41	25 A	2	HP-2 (ML)				1.5	2.9		AHU-2 (ML)
43	45 A	2	HP-2 (ML)	2.6	4.4					AHU-3 (ML)
45	20 A	2	UH-2 (ML)			0.1	1.8			EWH-1 (ML)
47	20 A	2	UH-3 (ML)	0.1	1.8					SPARE
49	20 A	2	UH-2 (ML)			1.5	4.0			UH-1 (ML)
51	20 A	2	UH-2 (ML)							SPARE
53	100 A	3	LV2	4.9	4.0					SPARE
55						3.3	1.5			SPARE
57	100 A	3	LV2			2.8	1.5			SPARE
59										SPARE

PANELBOARD SCHEDULE LV2 LOCATION: SHOP V109 FED FROM: LV1

100 A MCB 120/208 Wye 3 PH 4 W MOUNT: SURFACE PANEL ASSEMBLY RATED (KAIC): 22 KAIC


CKT	BRKR	POLE	LOAD	A	B	C	LOAD	POLE	BRKR	CKT
1	20 A	1	REC V109	0.7	0.7					CORD REEL V109
3	20 A	1	REC V109	0.7	0.7					CORD REEL V109
5	20 A	1	REC V109			0.7	0.7			CORD REEL V109
7	20 A	1	REC V109	1.2	0.7					CORD REEL V109
9	20 A	1	REC V109			0.7	0.7			CORD REEL V109
11	20 A	1	REC V109			0.7	0.7			CORD REEL V109
13	20 A	1	REC V109	1.6						SPACE ONLY
15	20 A	1	MOTOR DOOR V109			0.5				SPACE ONLY
17	20 A	1	SPARE	0.0			0.0			SPACE ONLY
19	20 A	1	SPARE			0.0				SPACE ONLY
21	20 A	1	SPARE			0.0				SPACE ONLY
23	20 A	1	SPARE			0.0				SPACE ONLY
			5 kVA	3 kVA	3 kVA					
			42 A	28 A	23 A					

Load Classification


Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals
INTERIOR LIGHTING	0 VA	0.00%	0 VA	
EXTERIOR LIGHTING	0 VA	0.00%	0 VA	
RECEPTACLES	6320 VA	100.00%	6320 VA	Total Conn. Load: 11.0 kVA
AC / HEAT PUMP	0 VA	0.00%	0 VA	Total Est. Demand: 11.0 kVA
ELECTRIC HEAT	0 VA	0.00%	0 VA	Total Conn. Current: 31 A
KITCHEN	0 VA	0.00%	0 VA	Total Est. Demand... 31 A
MISCELLANEOUS	500 VA	100.00%	500 VA	

DIV 23 ELECTRICAL CONNECTION SCHEDULE


TAG	VOLTAGE	# OF POLES	LOAD	PANEL	CKT#	WIRE	DISCONNECTING MEANS	REMARKS
AHU-1	208 V	2	5.8 kVA	LV1	40,42	3#8.#10G.3/4" C	PROVIDED WITH UNIT	
AHU-2	208 V	2	8.7 kVA	LV1	44,46	3#4.#10G.1" C	PROVIDED WITH UNIT	
AHU-3	208 V	2	3.8 kVA	LV1	48,50	3#10.#10G.3/4" C	PROVIDED WITH UNIT	
D-1	120 V	1	0.1 kVA	LV1	30	2#12.#12G.3/4" C	MOTOR RATED SWITCH	INTERLOCK WITH FAN
D-2	120 V	1	0.1 kVA	LV1	34	2#12.#12G.3/4" C	MOTOR RATED SWITCH	INTERLOCK WITH FAN
EF-1	120 V	1	0.3 kVA	LV1	28	2#12.#12G.3/4" C	PROVIDED WITH UNIT	
EF-2	120 V	1	0.3 kVA	LV1	34	2#12.#12G.3/4" C	PROVIDED WITH UNIT	
EF-3	120 V	1	0.3 kVA	LV1	30	2#12.#12G.3/4" C	PROVIDED WITH UNIT	
EWH-1	208 V	3	12.0 kVA	LV1	52,54,56	3#8.#10G.1" C	240V, 60A, 3P, NEMA 1, DISC, FPN2	
HP-1	208 V	2	2.9 kVA	LV1	39,41	3#10.#10G.3/4" C	240V, 30A, 3P, NEMA 3R, DISC, FPN2	
HP-2	208 V	2	5.2 kVA	LV1	43,45	3#8.#10G.1" C	240V, 60A, 3P, NEMA 3R, DISC, FPN2	
HP-3	208 V	2	0.2 kVA	LV1	47,49	3#12.#12G.3/4" C	240V, 30A, 3P, NEMA 3R, DISC, FPN2	
PHP-1	208 V	3	9.8 kVA	LV1	18,19,20	3#8.#10G.3/4" C	PROVIDED WITH UNIT	
RCP-1	120 V	1	0.5 kVA	LV1	32	2#12.#12G.3/4" C	MOTOR RATED SWITCH	
UH-1	208 V	2	3.0 kVA	LV1	58,60	2#12.#12G.3/4" C	PROVIDED WITH UNIT	
UH-2	208 V	2	3.0 kVA	LV1	51,53	2#12.#12G.3/4" C	PROVIDED WITH UNIT	

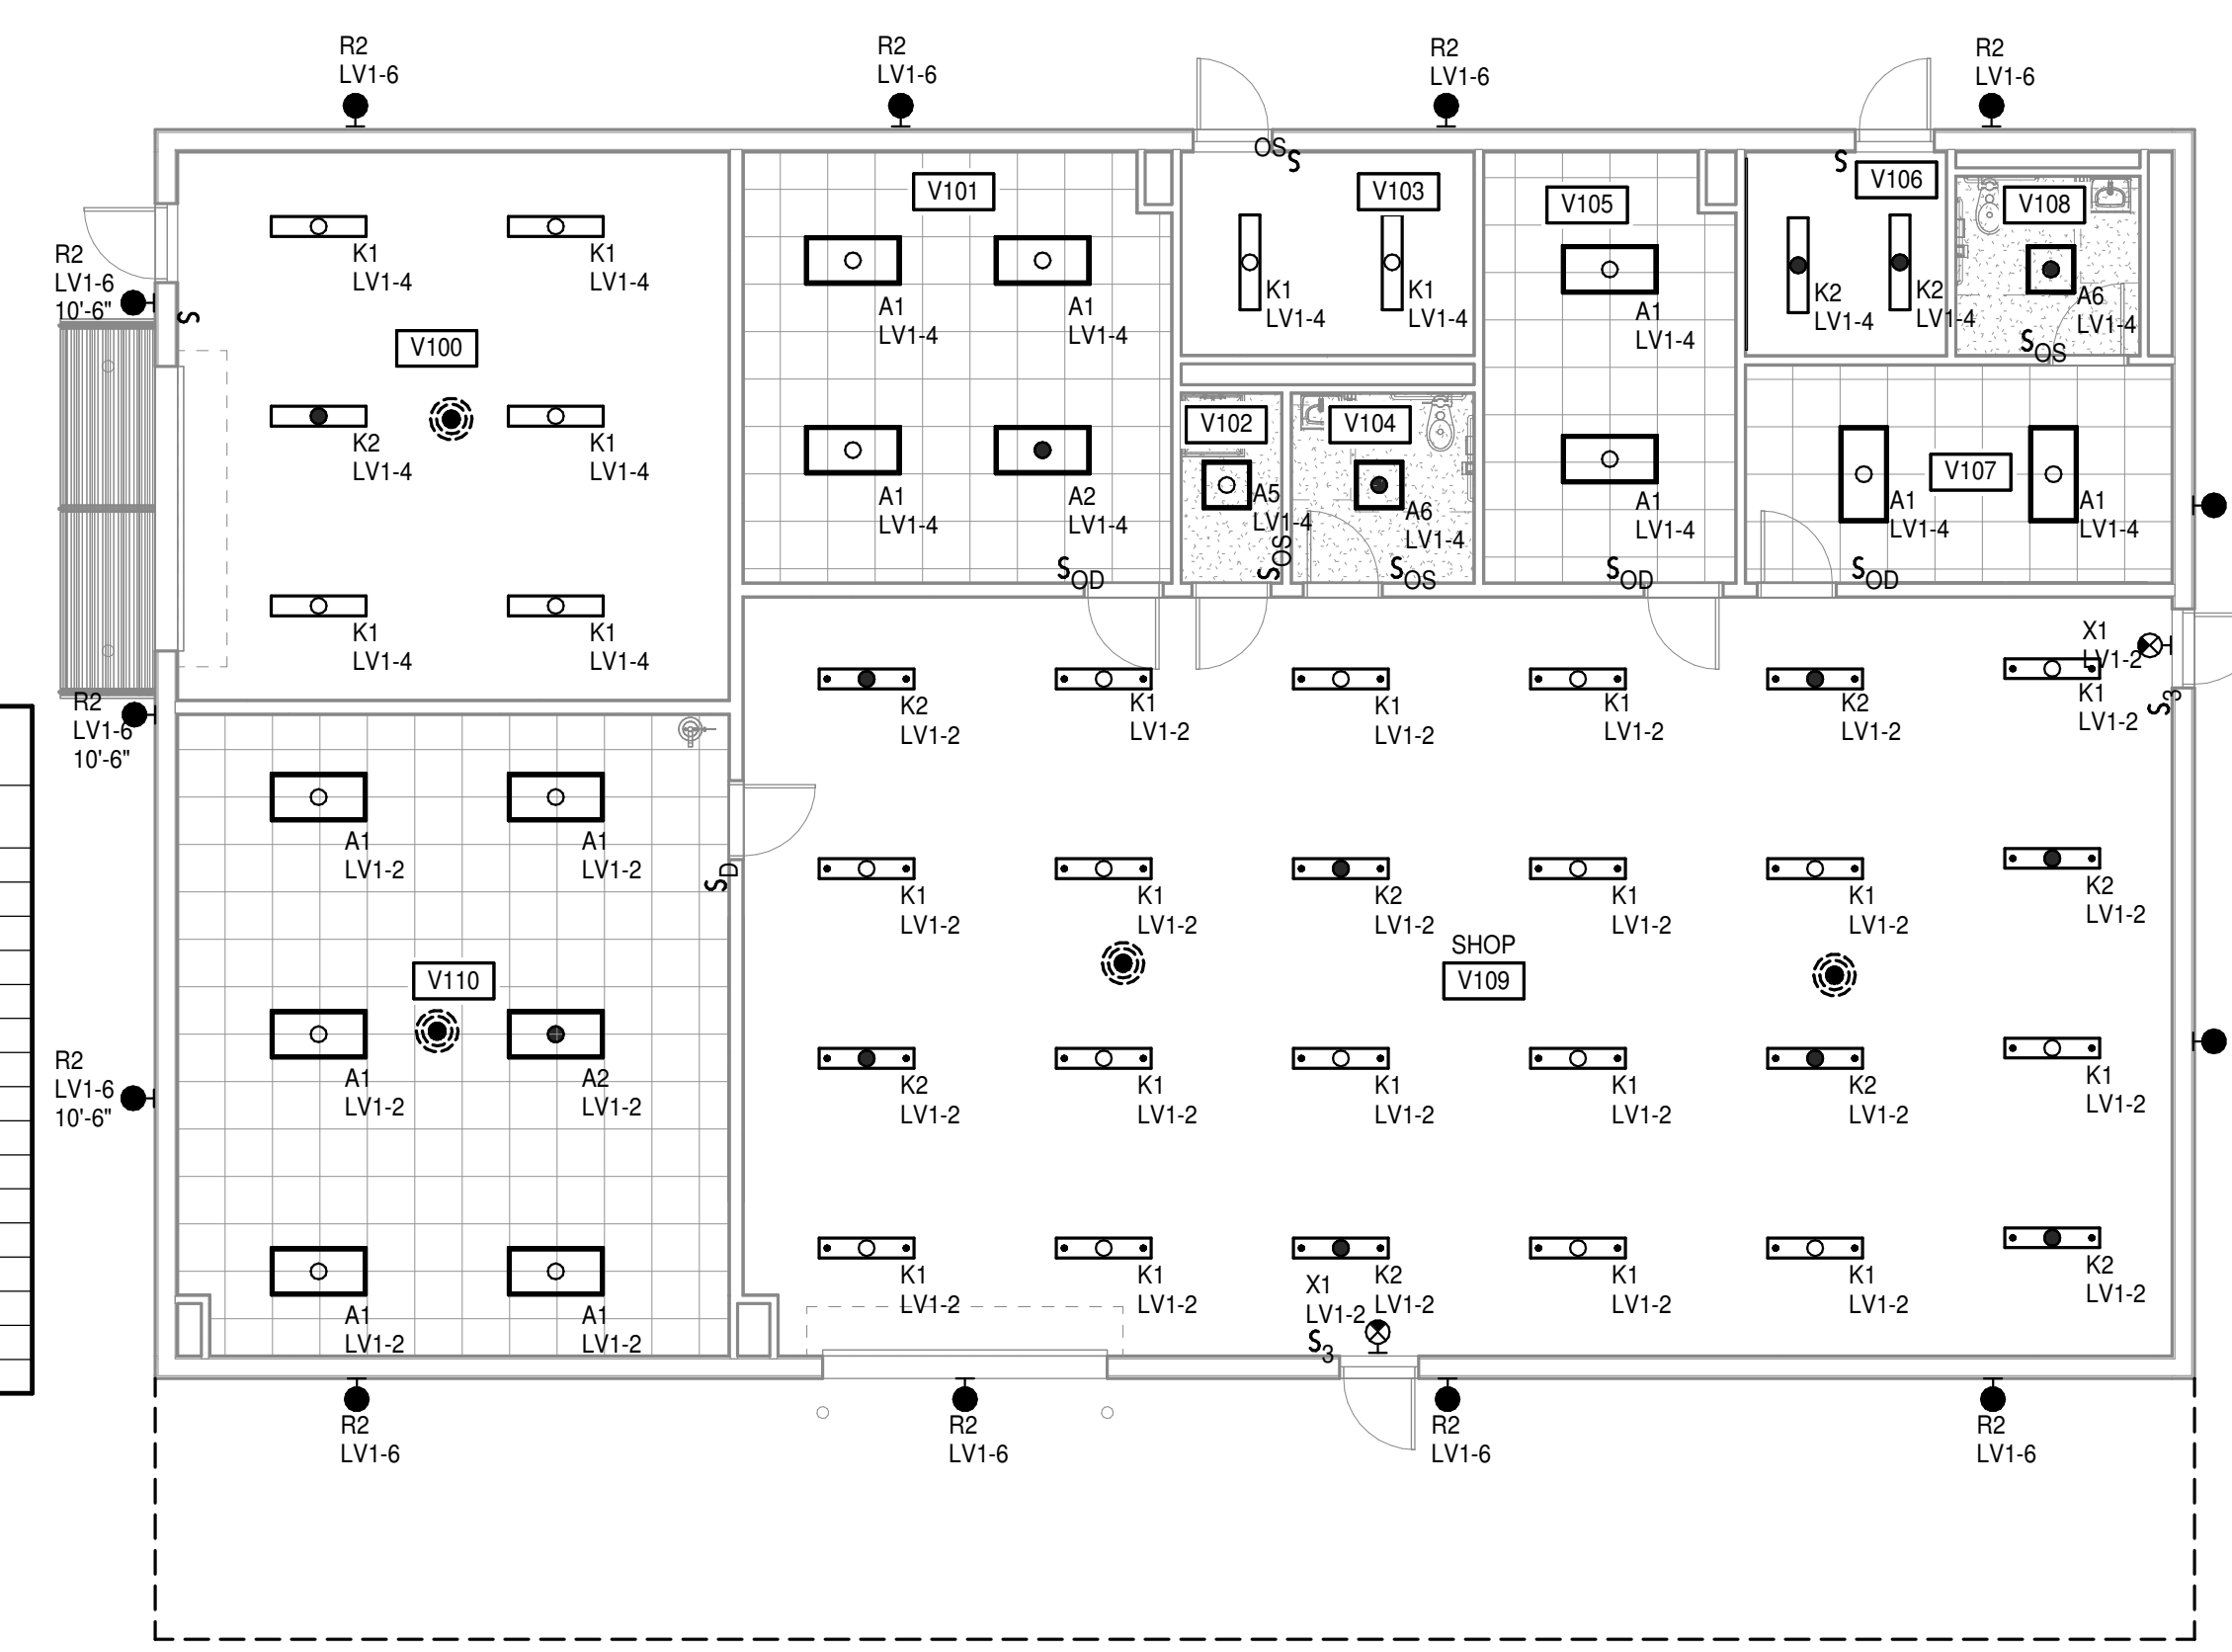


FLOOR PLAN - LIGHTING
 1/8" = 1'-0"

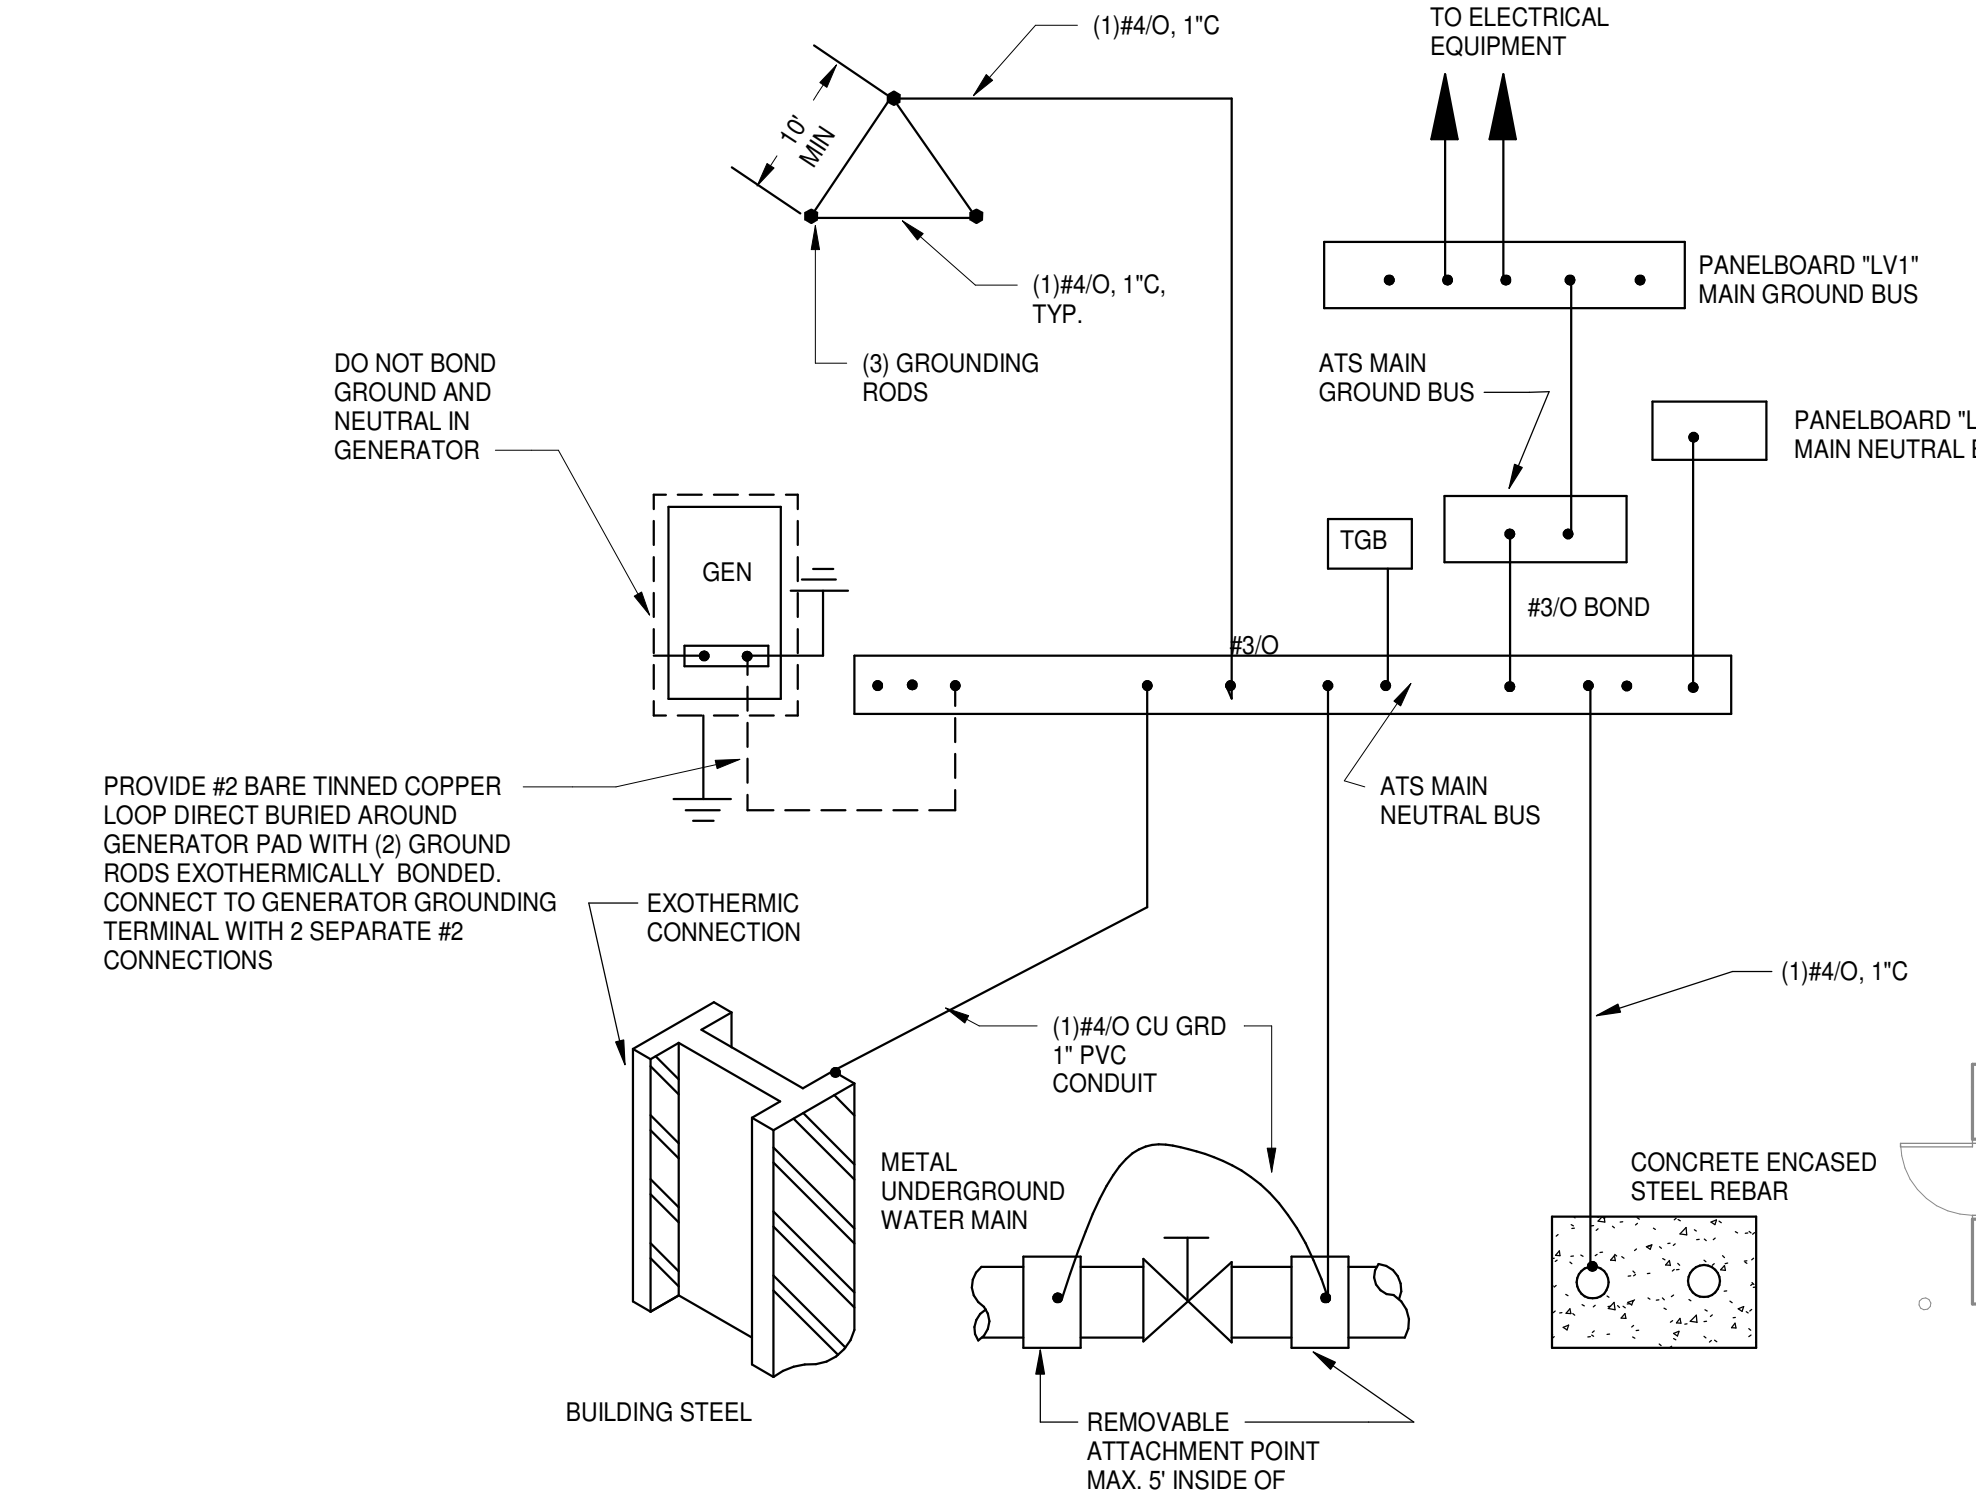

GROUNDING SYSTEM DIAGRAM
 NO SCALE

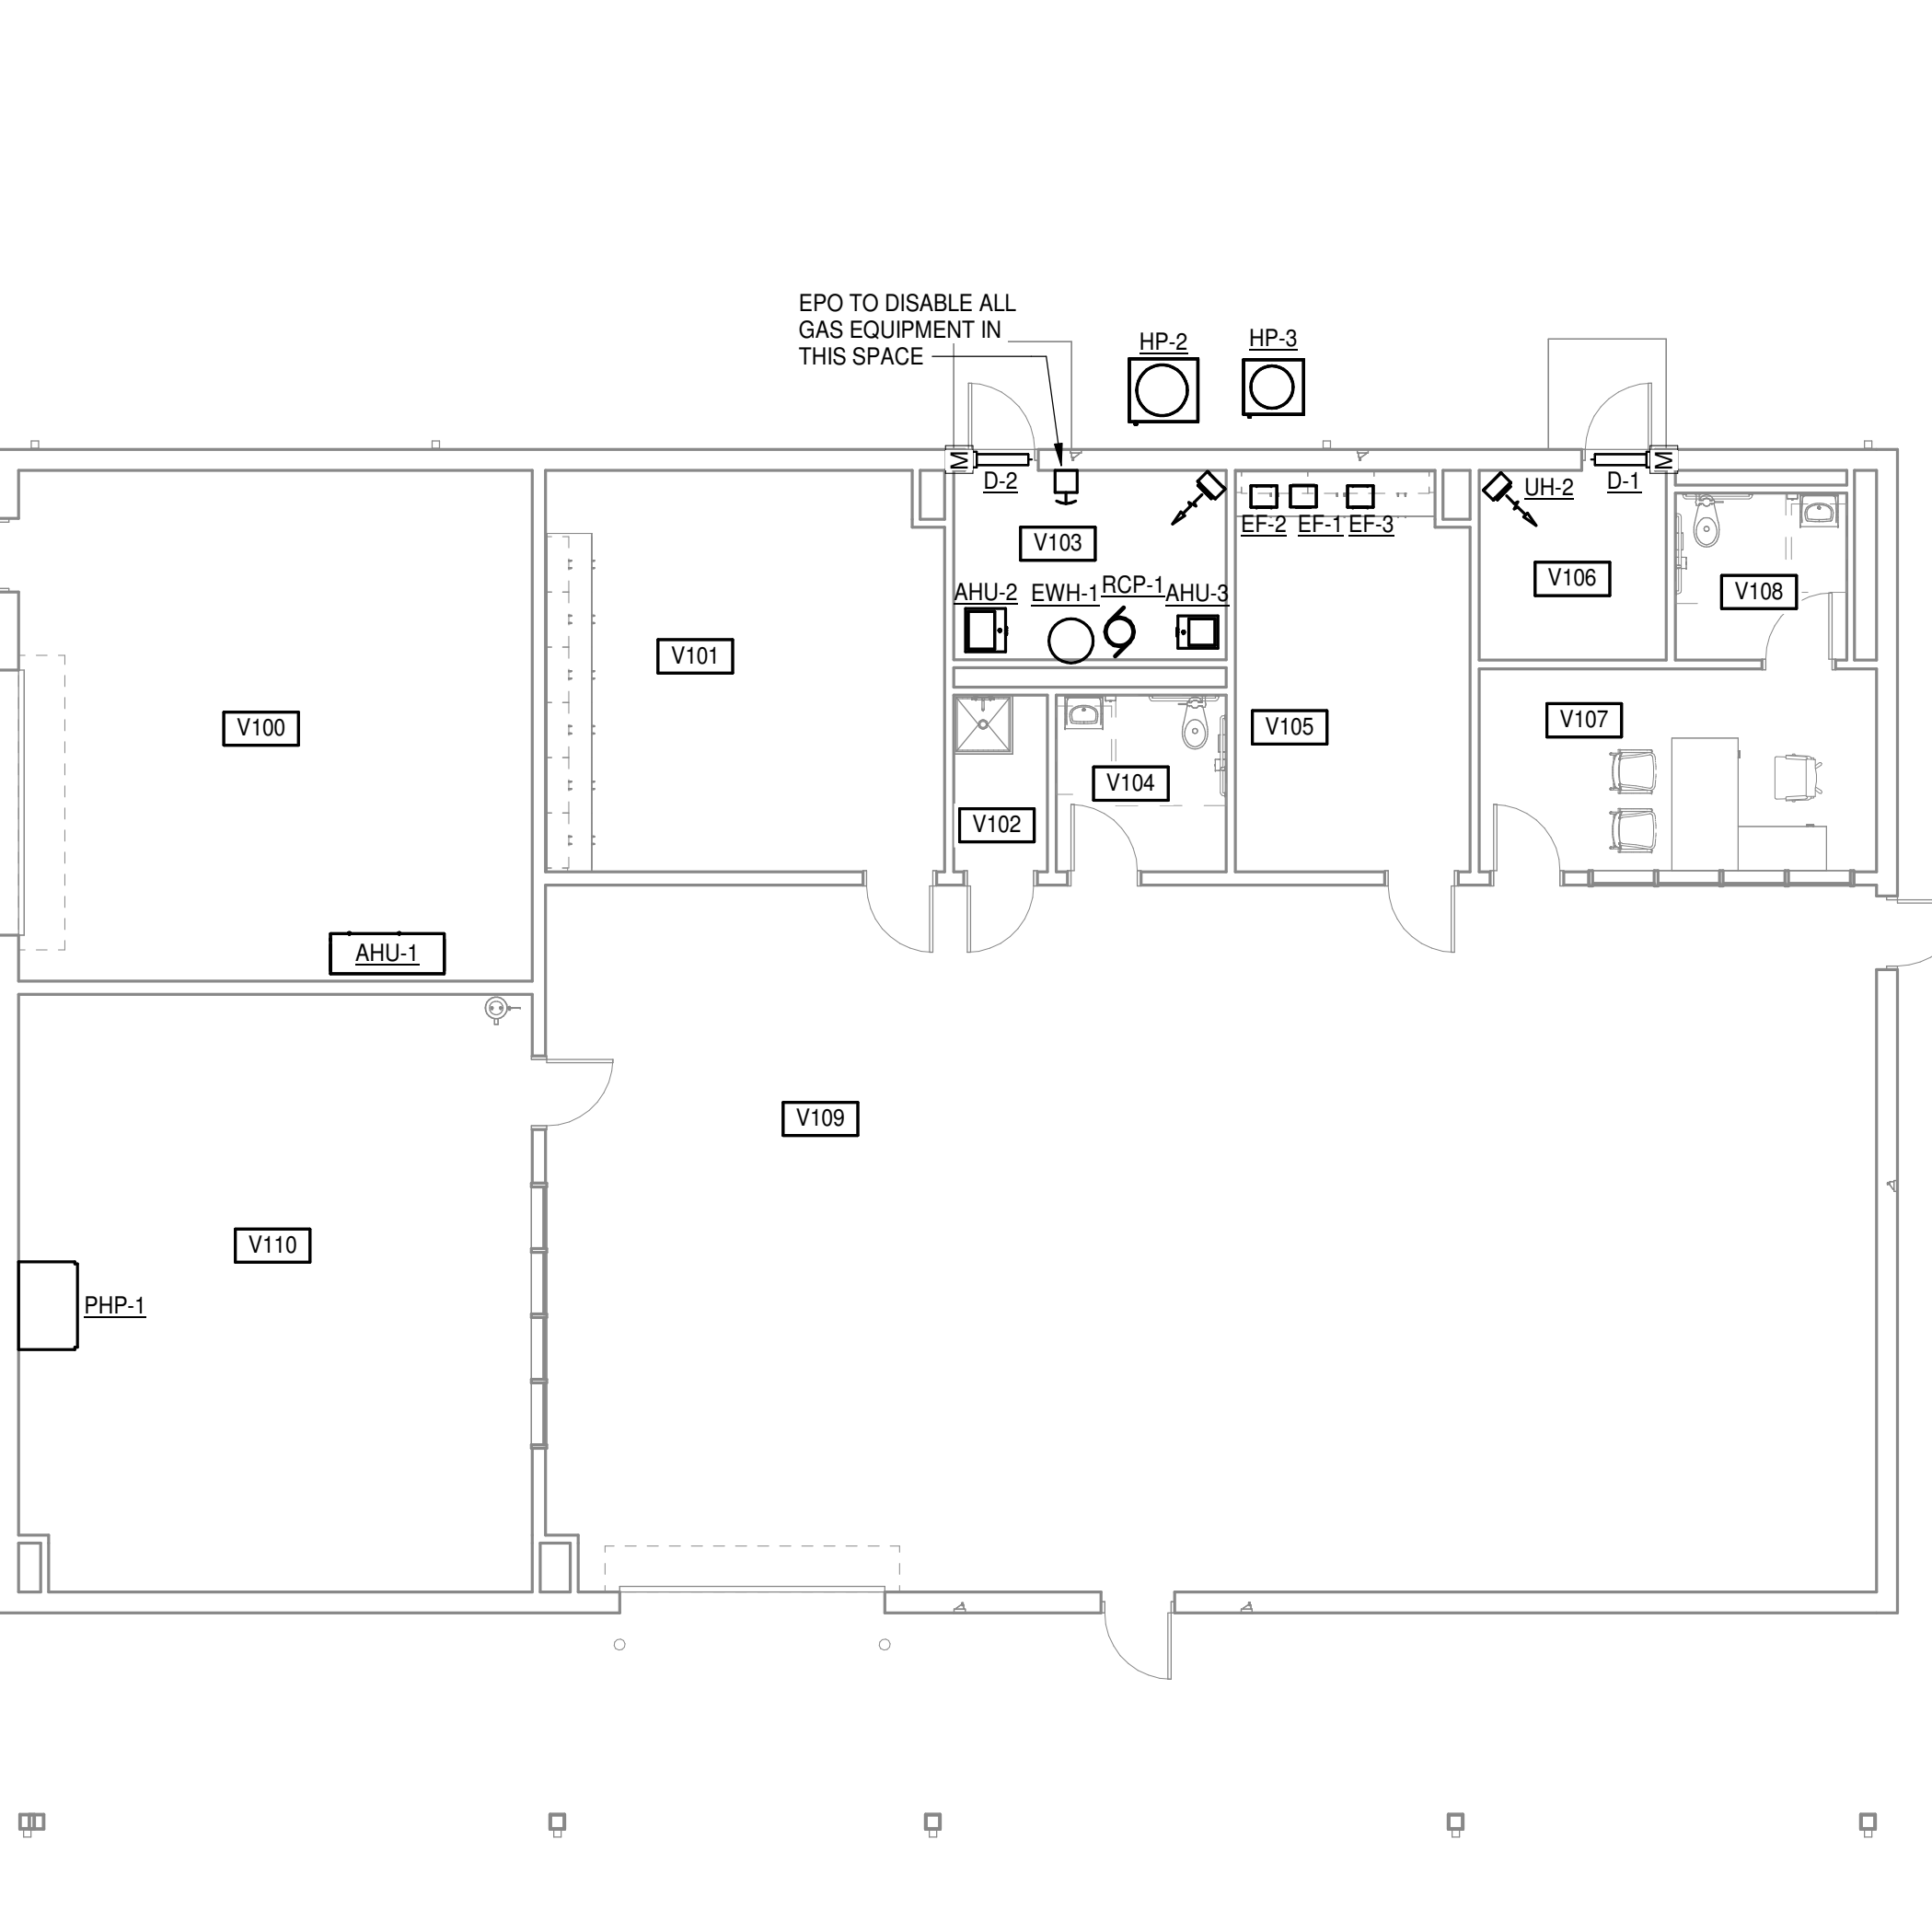

FLOOR PLAN - MECHANICAL POWER
 1/8" = 1'-0"

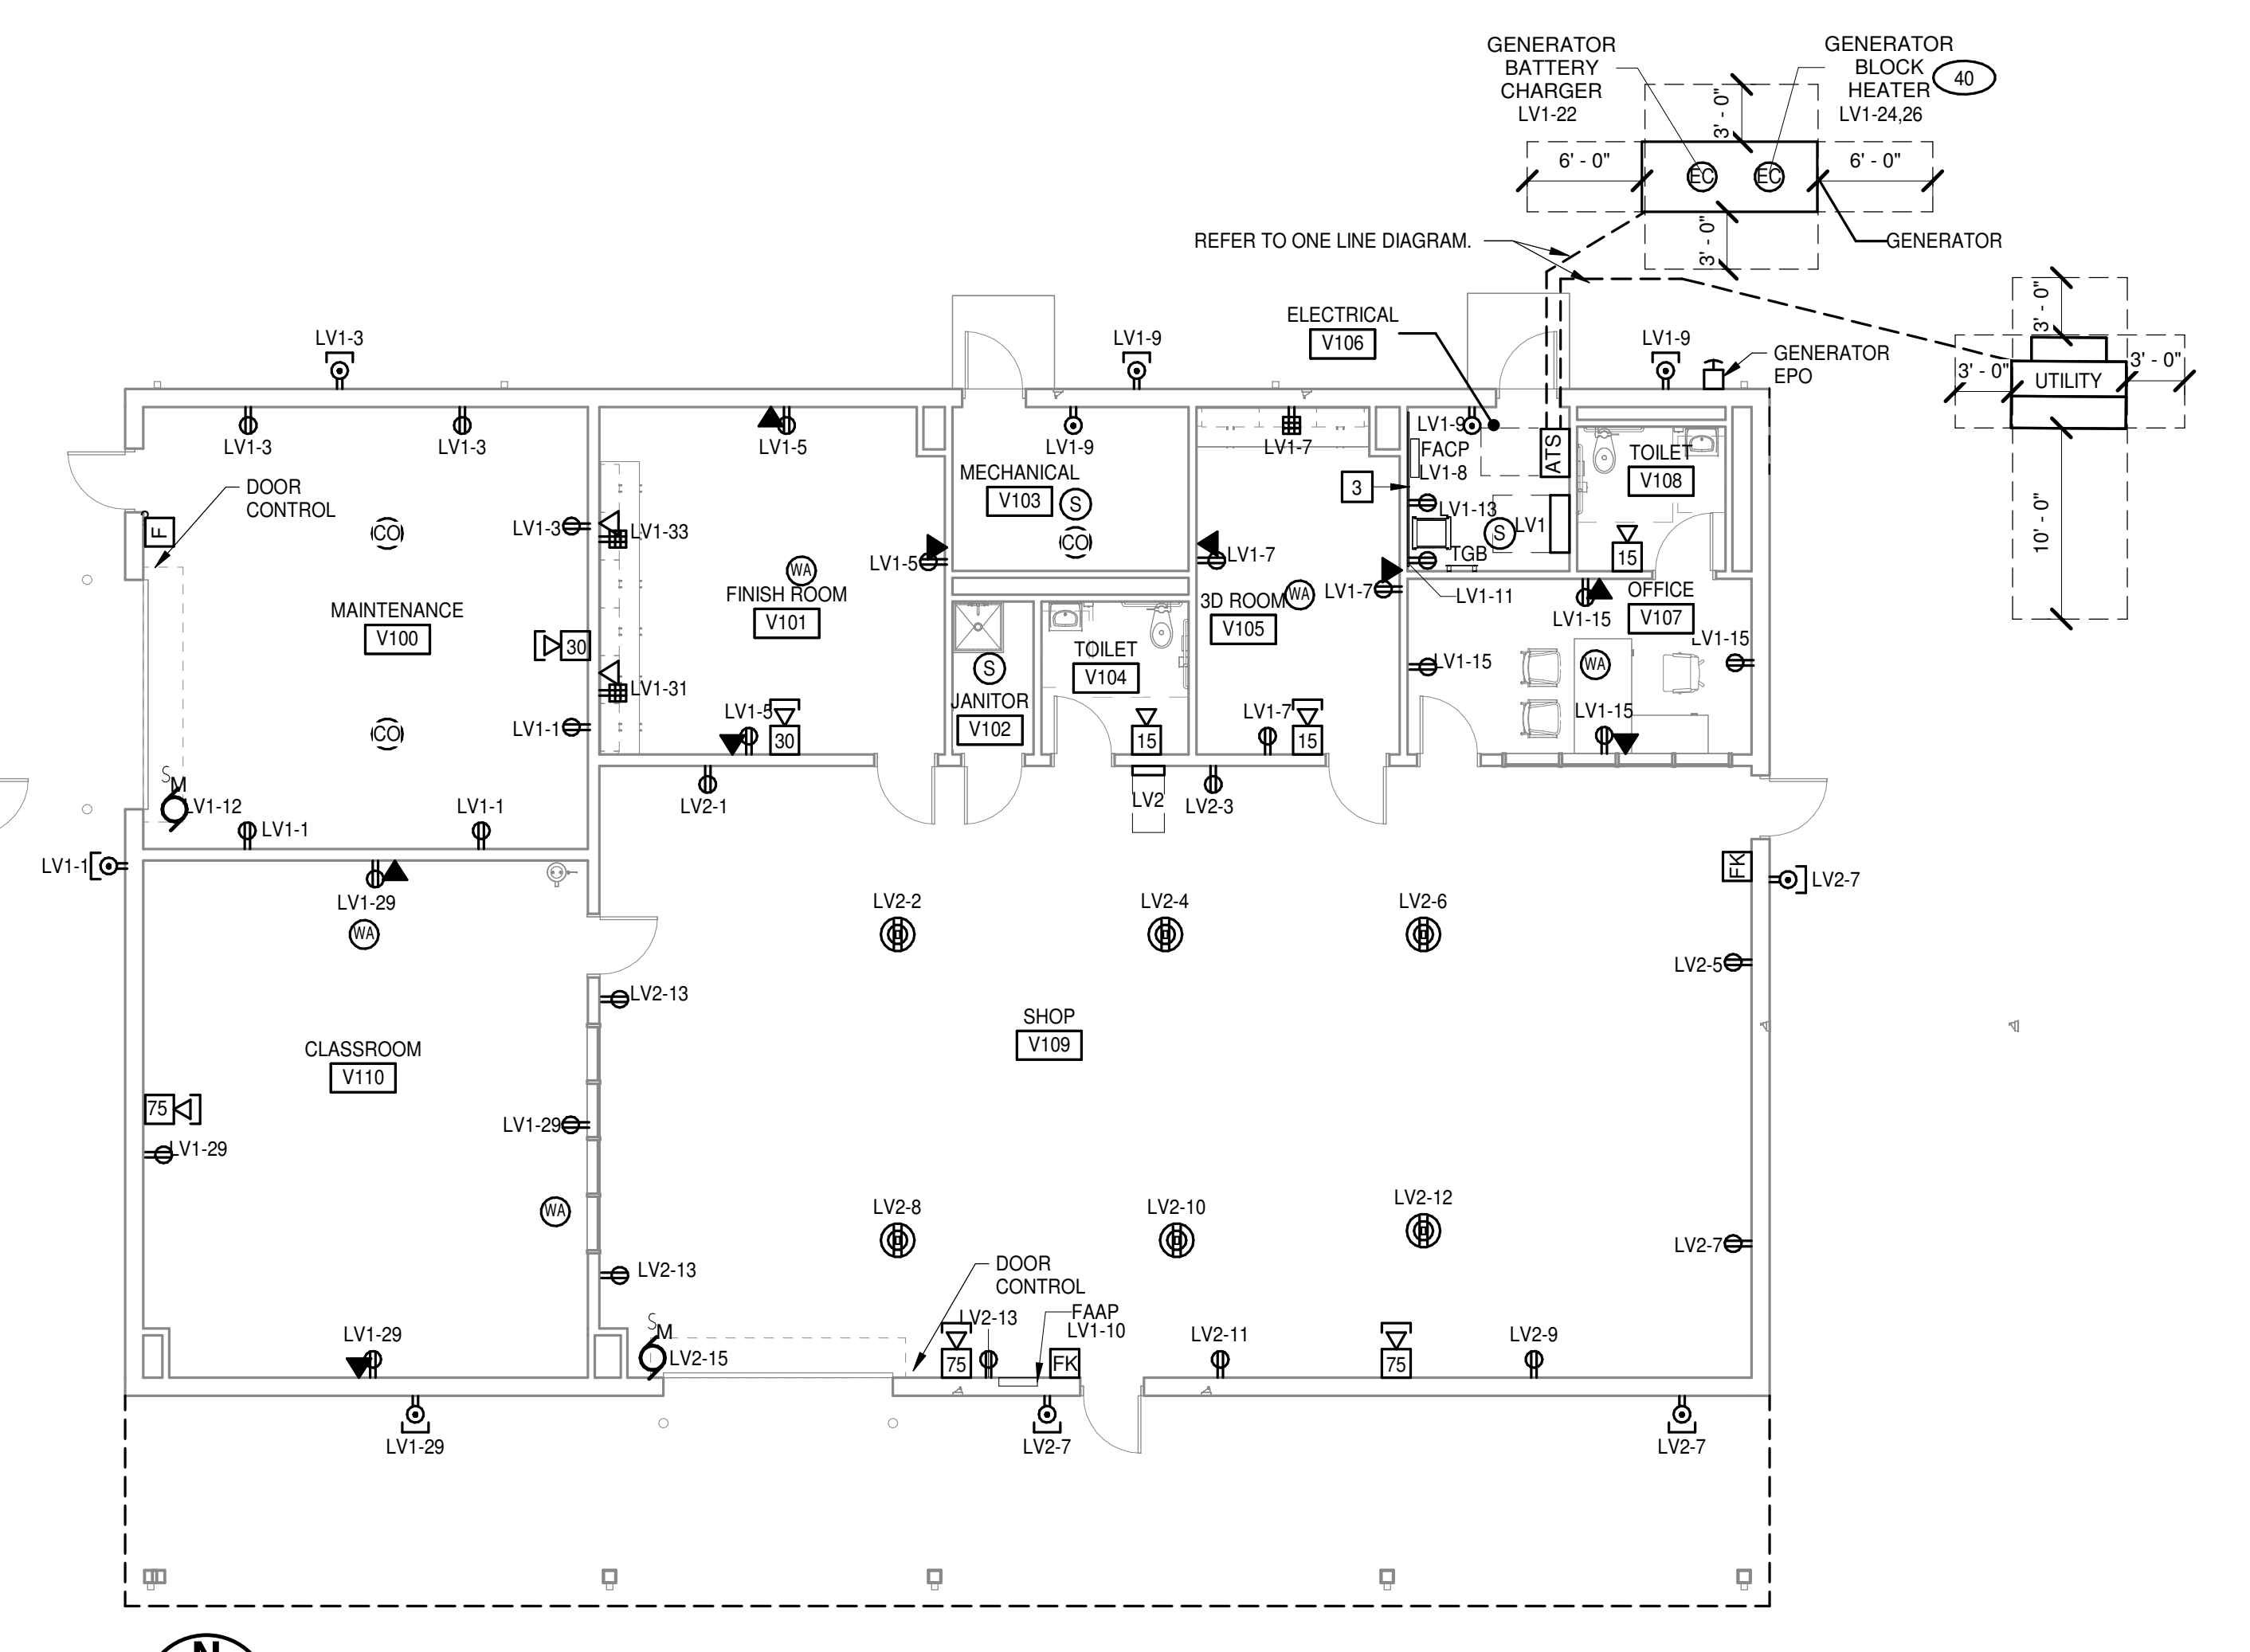

FLOOR PLAN - ELECTRICAL
 1/8" = 1'-0"

ONE LINE GENERAL NOTES:

- REFER TO PANEL SCHEDULES FOR PANEL CHARACTERISTICS INCLUDING MAIN BREAKER REQUIREMENTS. GROUND PER SERVICE GROUND DETAIL ON THIS DRAWING.
- PROVIDE A RED PLAQUE WITH WHITE LETTERING ON THE FRONT OF ALL EQUIPMENT STATING: "THIS PANEL IS CAPABLE OF BEING ENERGIZED FROM MULTIPLE SOURCES."

POWER ONE LINE DIAGRAM
 NO SCALE

2/8/2024 2:11:03 PM