

ST. JOHNS RIVER WATER MANAGEMENT DISTRICT

UPPER ST. JOHNS RIVER BASIN



STRUCTURE 252C WRI PLATFORM

INDIAN RIVER COUNTY, FLORIDA



INDEX OF PLANS

SHEET NO.	SHEET TITLE
C1	COVER SHEET AND VICINITY MAP
S1	PLAN AND SECTION
S2	DETAILS

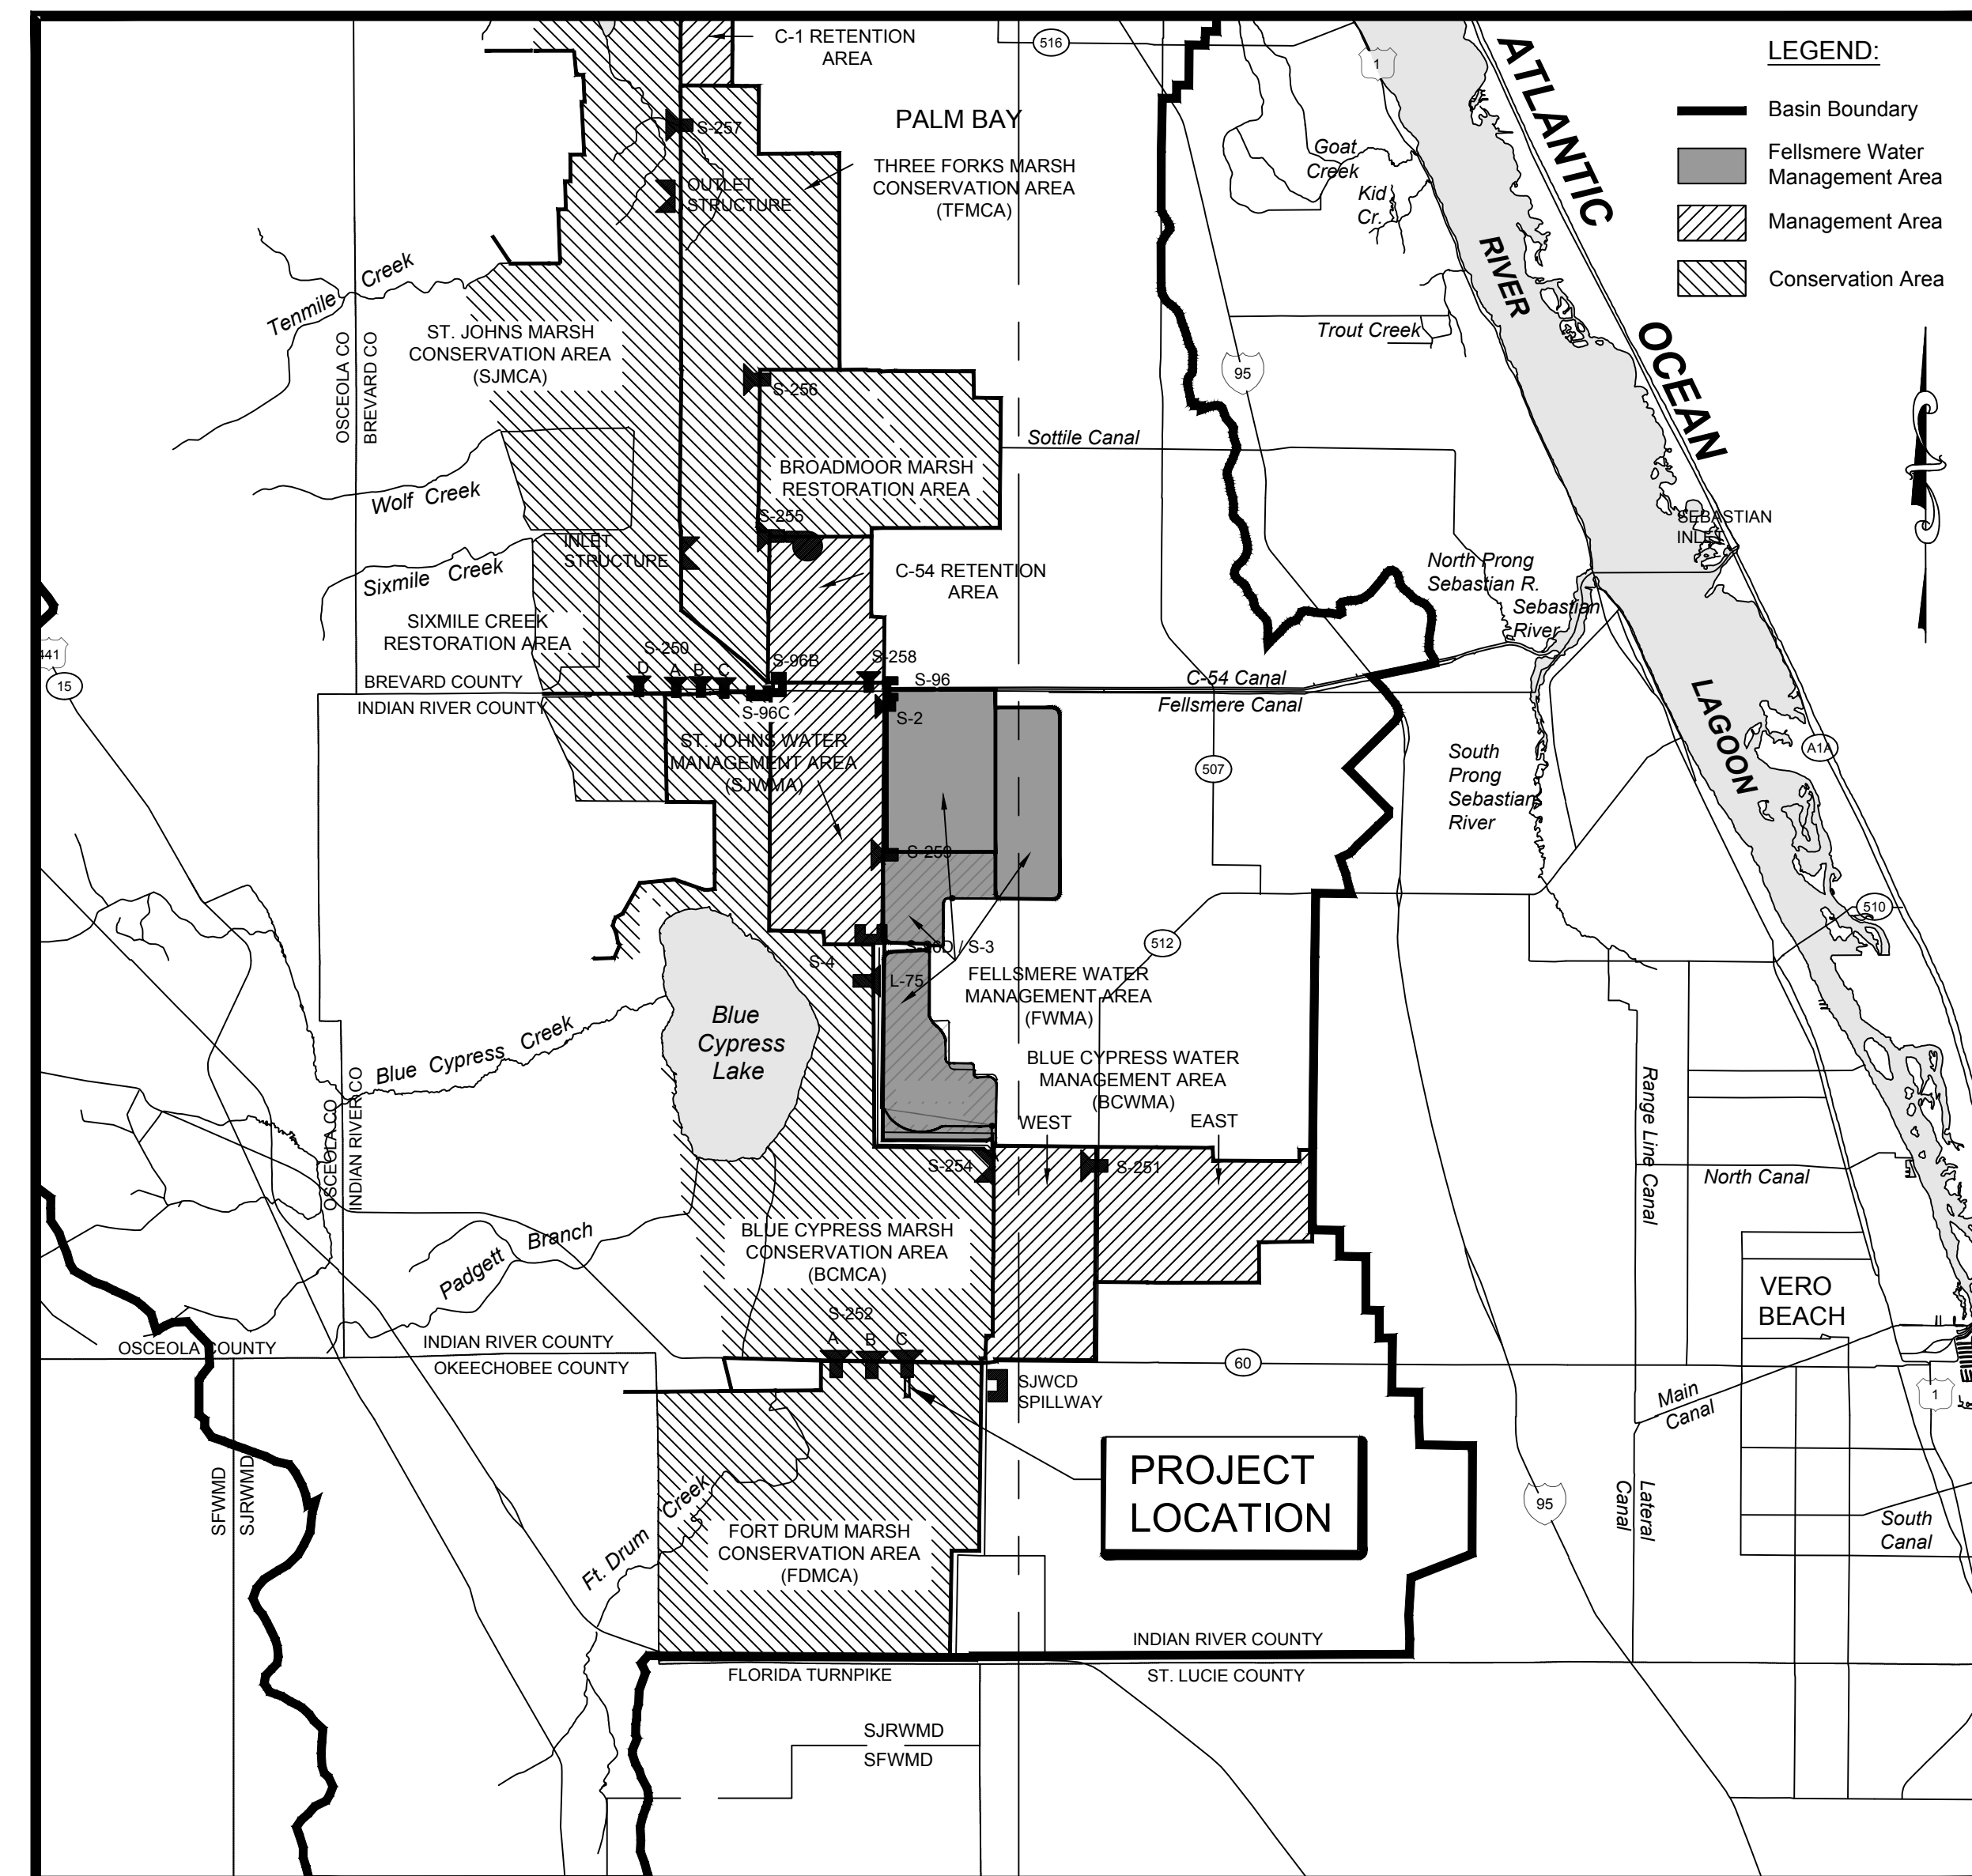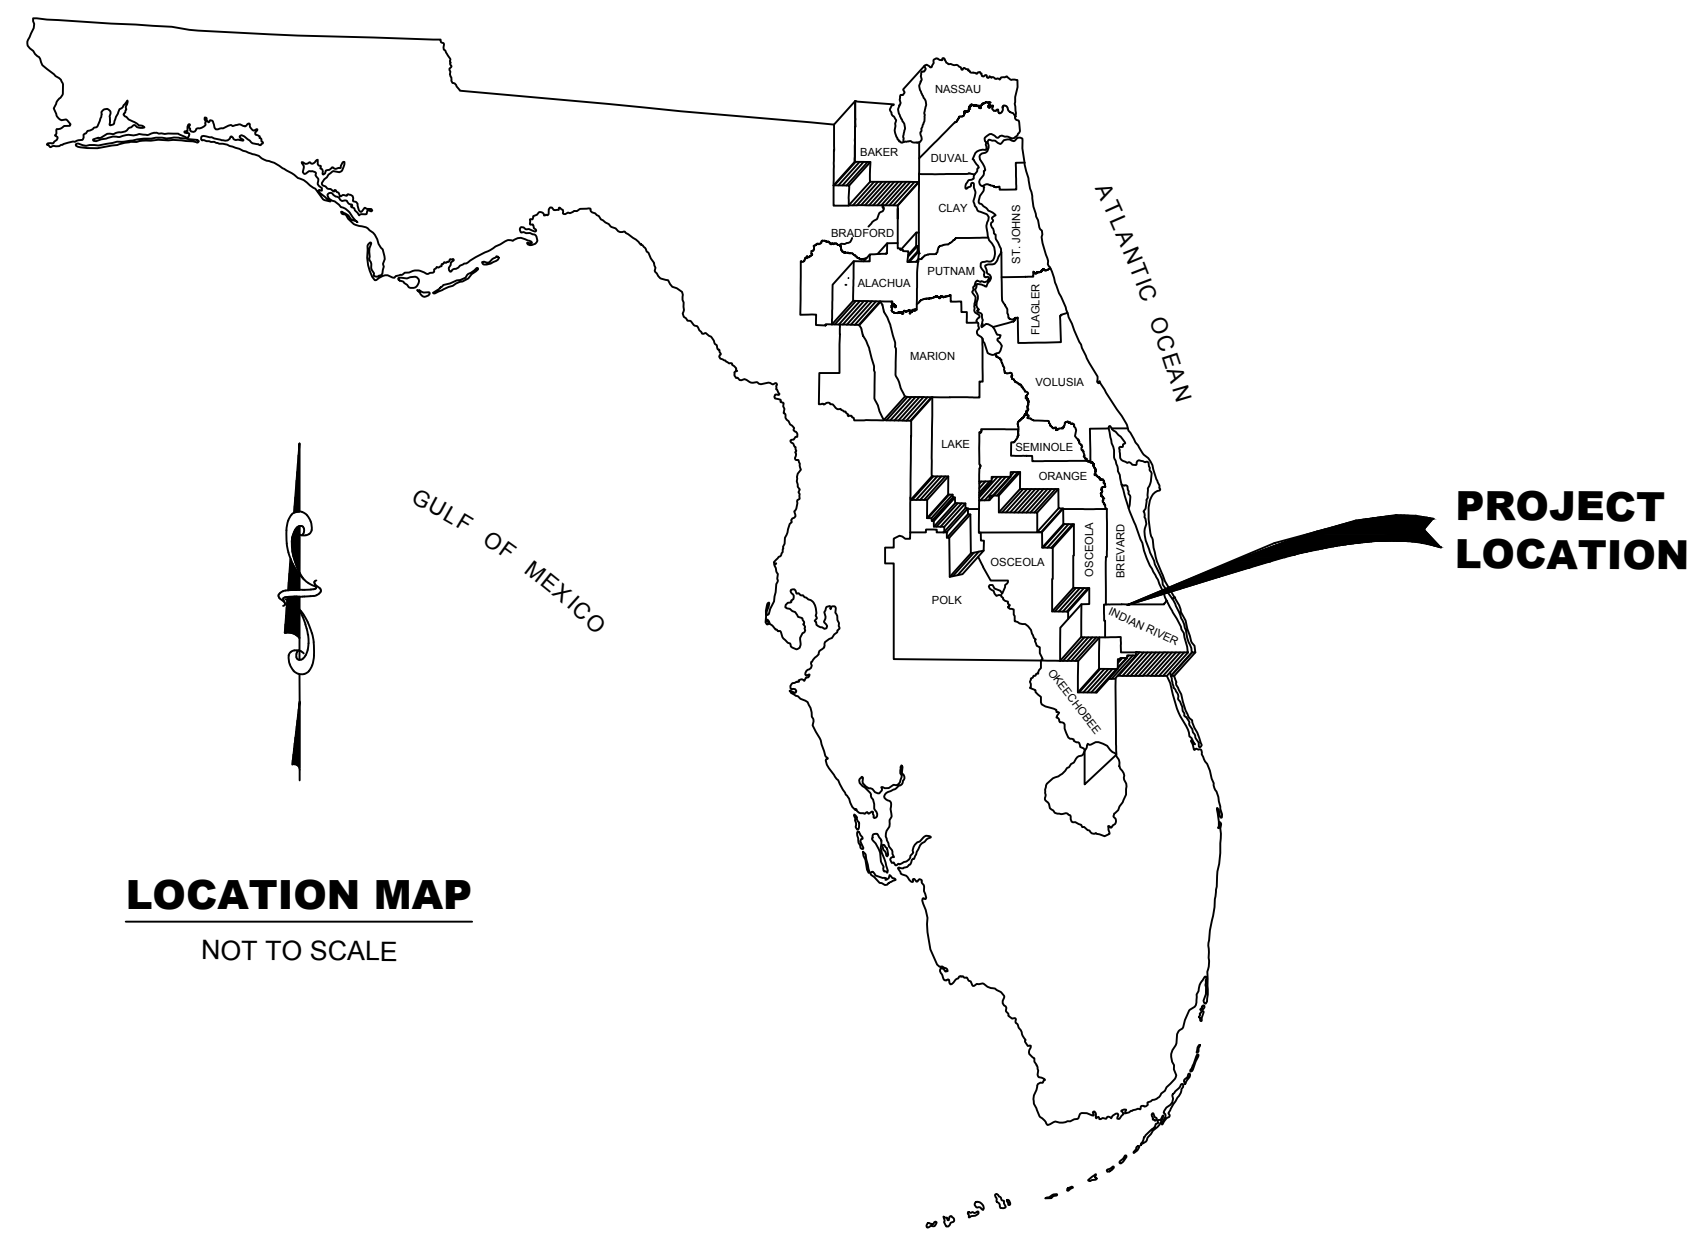

VICINITY MAP

ENGINEER'S NOTES:


1. These drawings are prepared for the sole and exclusive use of the St. Johns River Water Management District and shall not be relied upon by any other entity or individual.
2. Reproductions of these drawings are "NOT VALID WITHOUT THE SIGNATURE AND THE ORIGINAL SEAL OF A FLORIDA LICENSED ENGINEER."

NO.	REVISION	BY	DATE	APPROVED	DATE
1	ISSUED FOR BID	N.J.G.	01/28/19	W.R.C.	01/28/19




**FOR BID PURPOSES ONLY
NOT FOR CONSTRUCTION**

CERTIFICATION:	DRAWING FILENAME:
WILLIAM R. COTE	252C WALKWAY COVER.dwg
P.E. NUMBER: 53746	SHEET:
DATE: JANUARY 28, 2019	C1

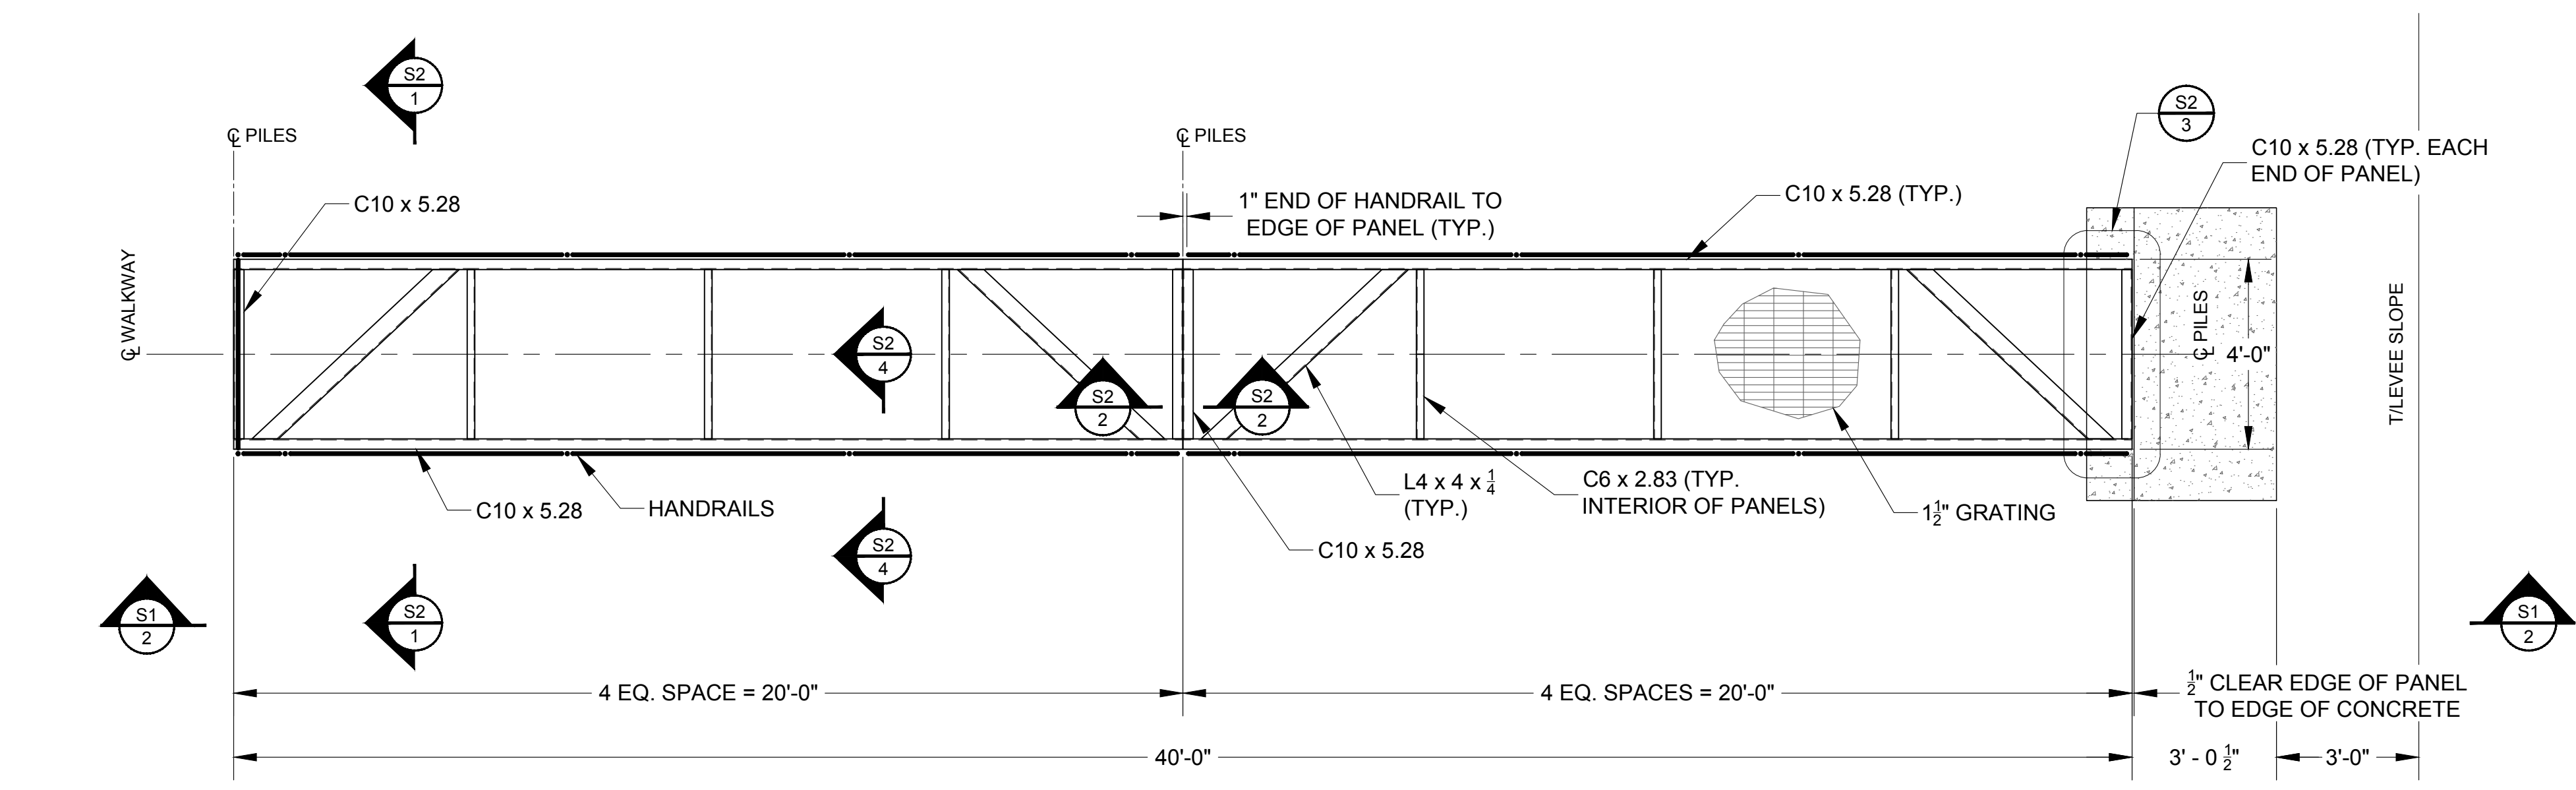

S1
1
PLAN
SCALE: 3/8" = 1'-0"

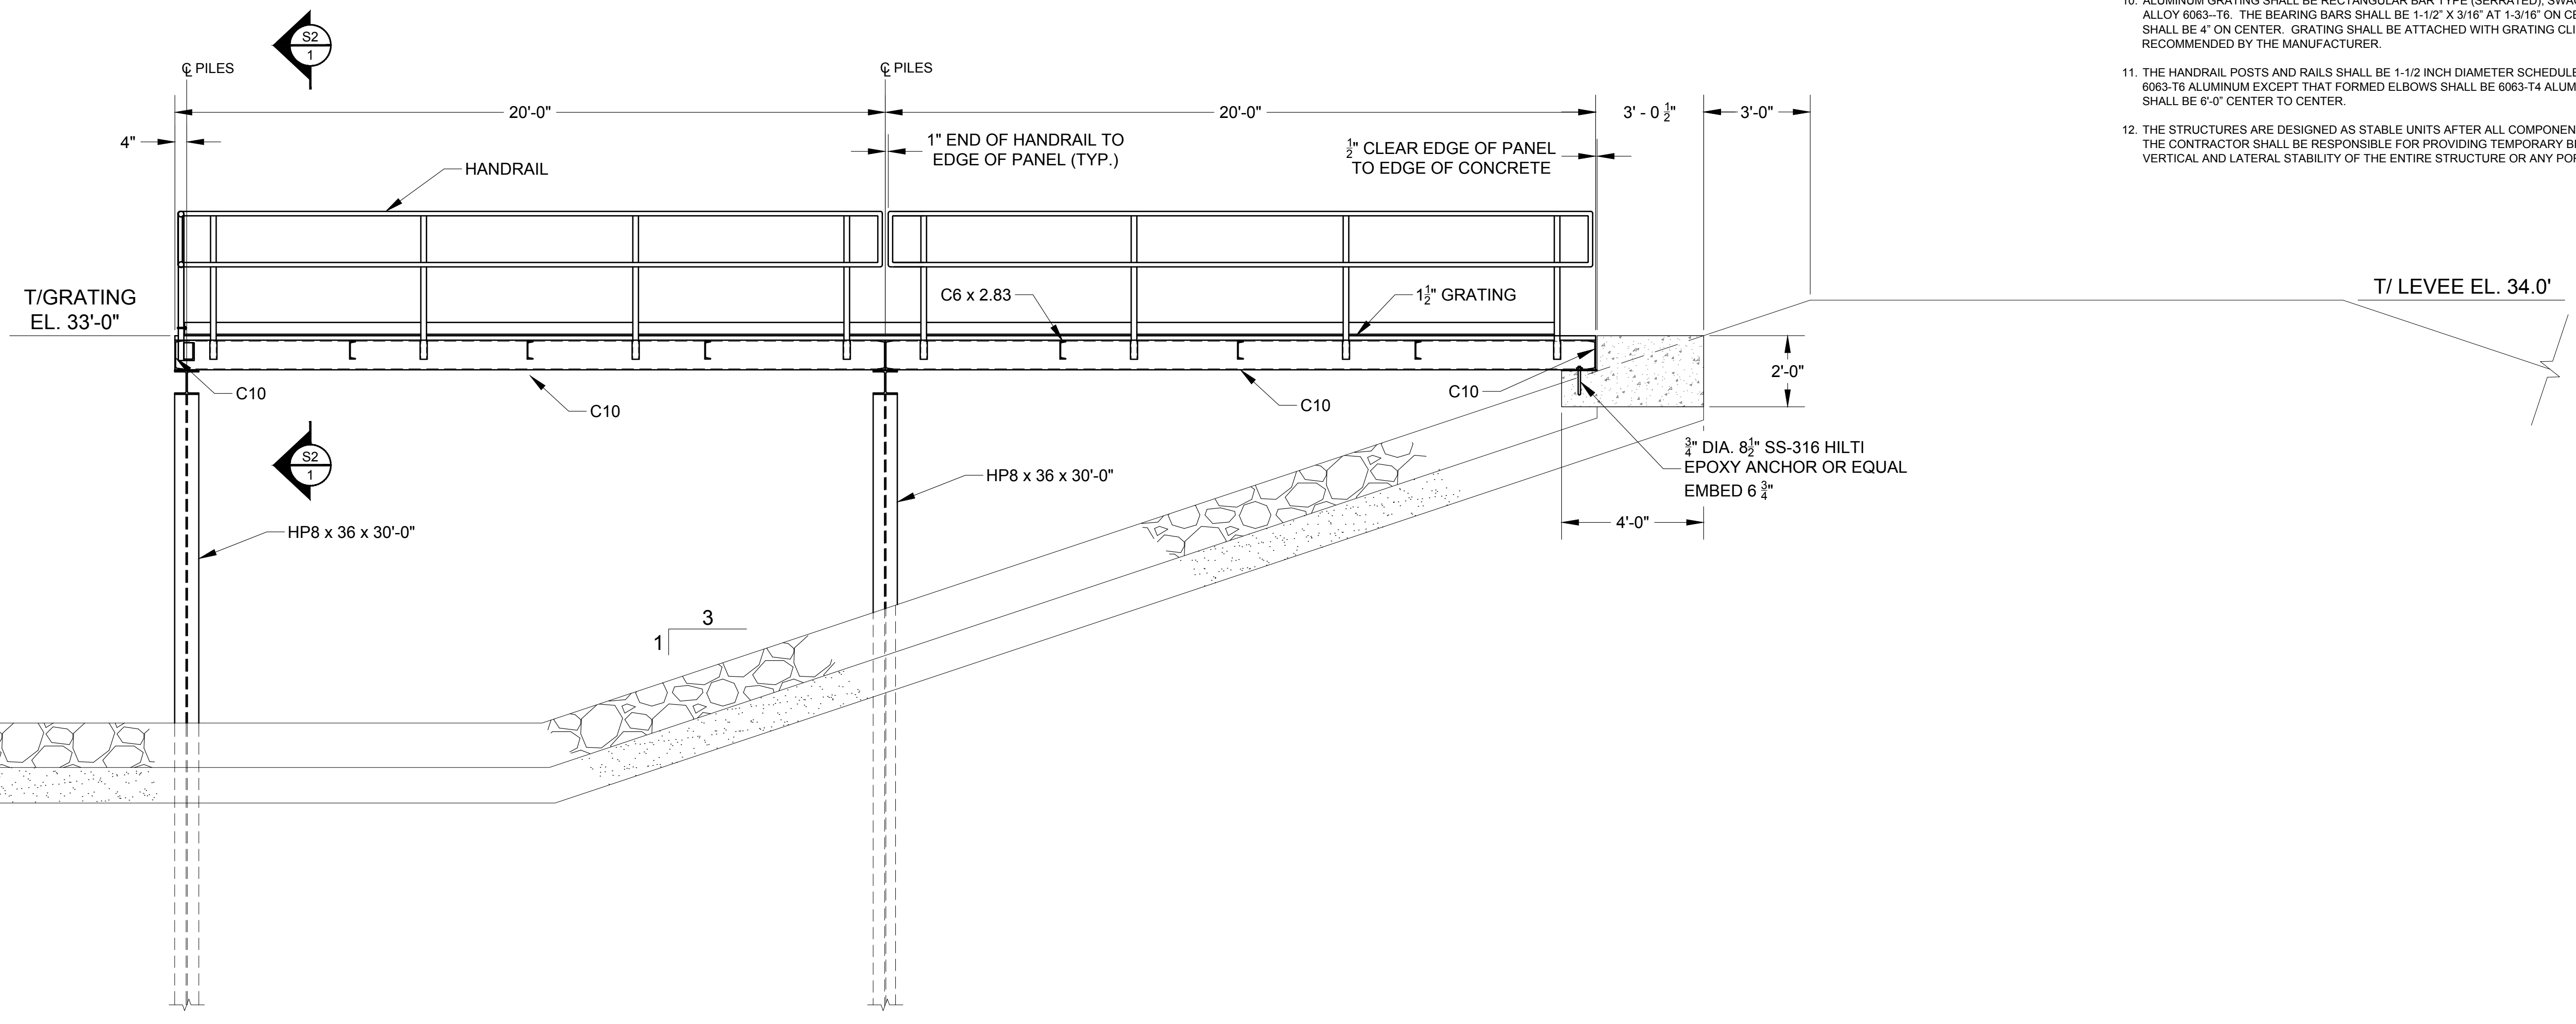

S1
2
SECTION
SCALE: 3/8" = 1'-0"

NOTE SPECIFICATIONS:

STRUCTURAL STEEL:

1. STRUCTURAL STEEL DESIGN, FABRICATION, AND ERECTION SHALL BE IN ACCORDANCE WITH THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC) "SPECIFICATION FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS", NINTH EDITION.
2. WELDING SHALL BE IN ACCORDANCE WITH THE AMERICAN WELDING SOCIETY (AWS) "STRUCTURAL WELDING CODE" AWS D1.1.
3. ALL STRUCTURAL AND MISCELLANEOUS STEEL SHALL BE NEW AND CONFORM TO THE REQUIREMENTS OF THE AMERICAN SOCIETY OF TESTING AND MATERIALS (ASTM) STANDARD A36 UNLESS NOTED OTHERWISE.
4. ALL BOLTS SHALL BE STAINLESS STEEL CONFORMING TO ASTM A276, TYPE 304.
5. ALL WELDING SHALL UTILIZE E70XX LOW-HYDROGEN ELECTRODES UNLESS NOTED OTHERWISE.

STRUCTURAL ALUMINUM:

1. STRUCTURAL ALUMINUM DESIGN AND FABRICATION SHALL BE IN ACCORDANCE WITH THE ALUMINUM ASSOCIATION, INC. "SPECIFICATIONS FOR ALUMINUM STRUCTURES", LATEST EDITION.
2. WELDING SHALL BE IN ACCORDANCE WITH THE AMERICAN WELDING SOCIETY (AWS) "STRUCTURAL WELDING CODE - ALUMINUM" AWS D1.2.
3. ALUMINUM STRUCTURAL SHAPES SHALL BE NEW AND CONSIST OF ALLOY 6061-T6 CONFORMING TO THE REQUIREMENTS OF THE AMERICAN SOCIETY OF TESTING AND MATERIALS (ASTM) STANDARD B308.
4. ALUMINUM BARS, RODS, AND WIRE SHALL BE NEW AND CONSIST OF ALLOY 6061-T6 CONFORMING TO THE REQUIREMENTS OF ASTM STANDARD B211.
5. ALUMINUM PLATE SHALL BE NEW AND CONSIST OF ALLOY 5052-H32 CONFORMING TO THE REQUIREMENTS OF ASTM STANDARD B209.
6. ALL BOLTS, NUTS, AND WASHERS SHALL CONSIST OF SS316 STAINLESS STEEL CONFORMING TO THE REQUIREMENTS OF ASTM STANDARDS F593 AND F594. MINIMUM BOLT SIZE SHALL BE 3/4-INCH UNLESS OTHERWISE NOTED.
7. ALL WELDING SHALL UTILIZE ER4043 FILLER ALLOY AND SHALL BE SHOP WELDED TO THE GREATEST EXTENT POSSIBLE.
8. THE MINIMUM THICKNESS OF ALL CONNECTION ANGLES AND GUSSET PLATES SHALL BE 1/4-INCH UNLESS NOTED OTHERWISE.
9. FIELD CORRECTING OF FABRICATED COMPONENTS SHALL NOT BE PERMITTED ON STRUCTURAL MEMBERS WITHOUT PRIOR APPROVAL OF THE ENGINEER.
10. ALUMINUM GRATING SHALL BE RECTANGULAR BAR TYPE (SERRATED), SWAGE-LOCKED, AND CONSIST OF ALUMINUM ALLOY 6063-T6. THE BEARING BARS SHALL BE 1-1/2" X 3/16" AT 1-3/16" ON CENTER. RECTANGULAR CROSS BARS SHALL BE 4" ON CENTER. GRATING SHALL BE ATTACHED WITH GRATING CLIPS TYPE AND SPACING AS RECOMMENDED BY THE MANUFACTURER.
11. THE HANDRAIL POSTS AND RAILS SHALL BE 1-1/2 INCH DIAMETER SCHEDULE 40 PIPE FORMED FROM EXTRUDED 6063-T6 ALUMINUM EXCEPT THAT FORMED ELBOWS SHALL BE 6063-T4 ALUMINUM. THE MAXIMUM POST SPACING SHALL BE 6'-0" CENTER TO CENTER.
12. THE STRUCTURES ARE DESIGNED AS STABLE UNITS AFTER ALL COMPONENTS, INCLUDING BRACING, ARE IN PLACE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING TEMPORARY BRACING AS REQUIRED TO ENSURE THE VERTICAL AND LATERAL STABILITY OF THE ENTIRE STRUCTURE OR ANY PORTION THEREOF DURING CONSTRUCTION.

**FOR BID PURPOSES ONLY
NOT FOR CONSTRUCTION**

NO.	REVISION	BY	DATE	APPROVED	DATE

UPPER ST. JOHNS RIVER BASIN
STRUCTURE 252C WRI PLATFORM
INDIAN RIVER COUNTY, FLORIDA

ST. JOHNS RIVER
WATER MANAGEMENT DISTRICT
P.O. BOX 1429 PALATKA, FLORIDA


DRAWN: N.J.G. DATE: JANUARY 28, 2019 REVIEWER: W.R.C.
SCALE: 3/8" = 1'-0" DESIGNER: W.R.C. SECTION CHIEF: W.R.C.

PLAN AND SECTION


CERTIFICATION:
WILLIAM R. COTE
P.E. NUMBER: 53746
DATE: JANUARY 28, 2019

FILE NAME:
252C WALKWAY.dwg
PROJECT NO.:
SHEET:
S1


U:\Projects\CAD\Drawings\BBS-252C WRI PLATFORM\CONSTRUCTION\252C WALKWAY.dwg

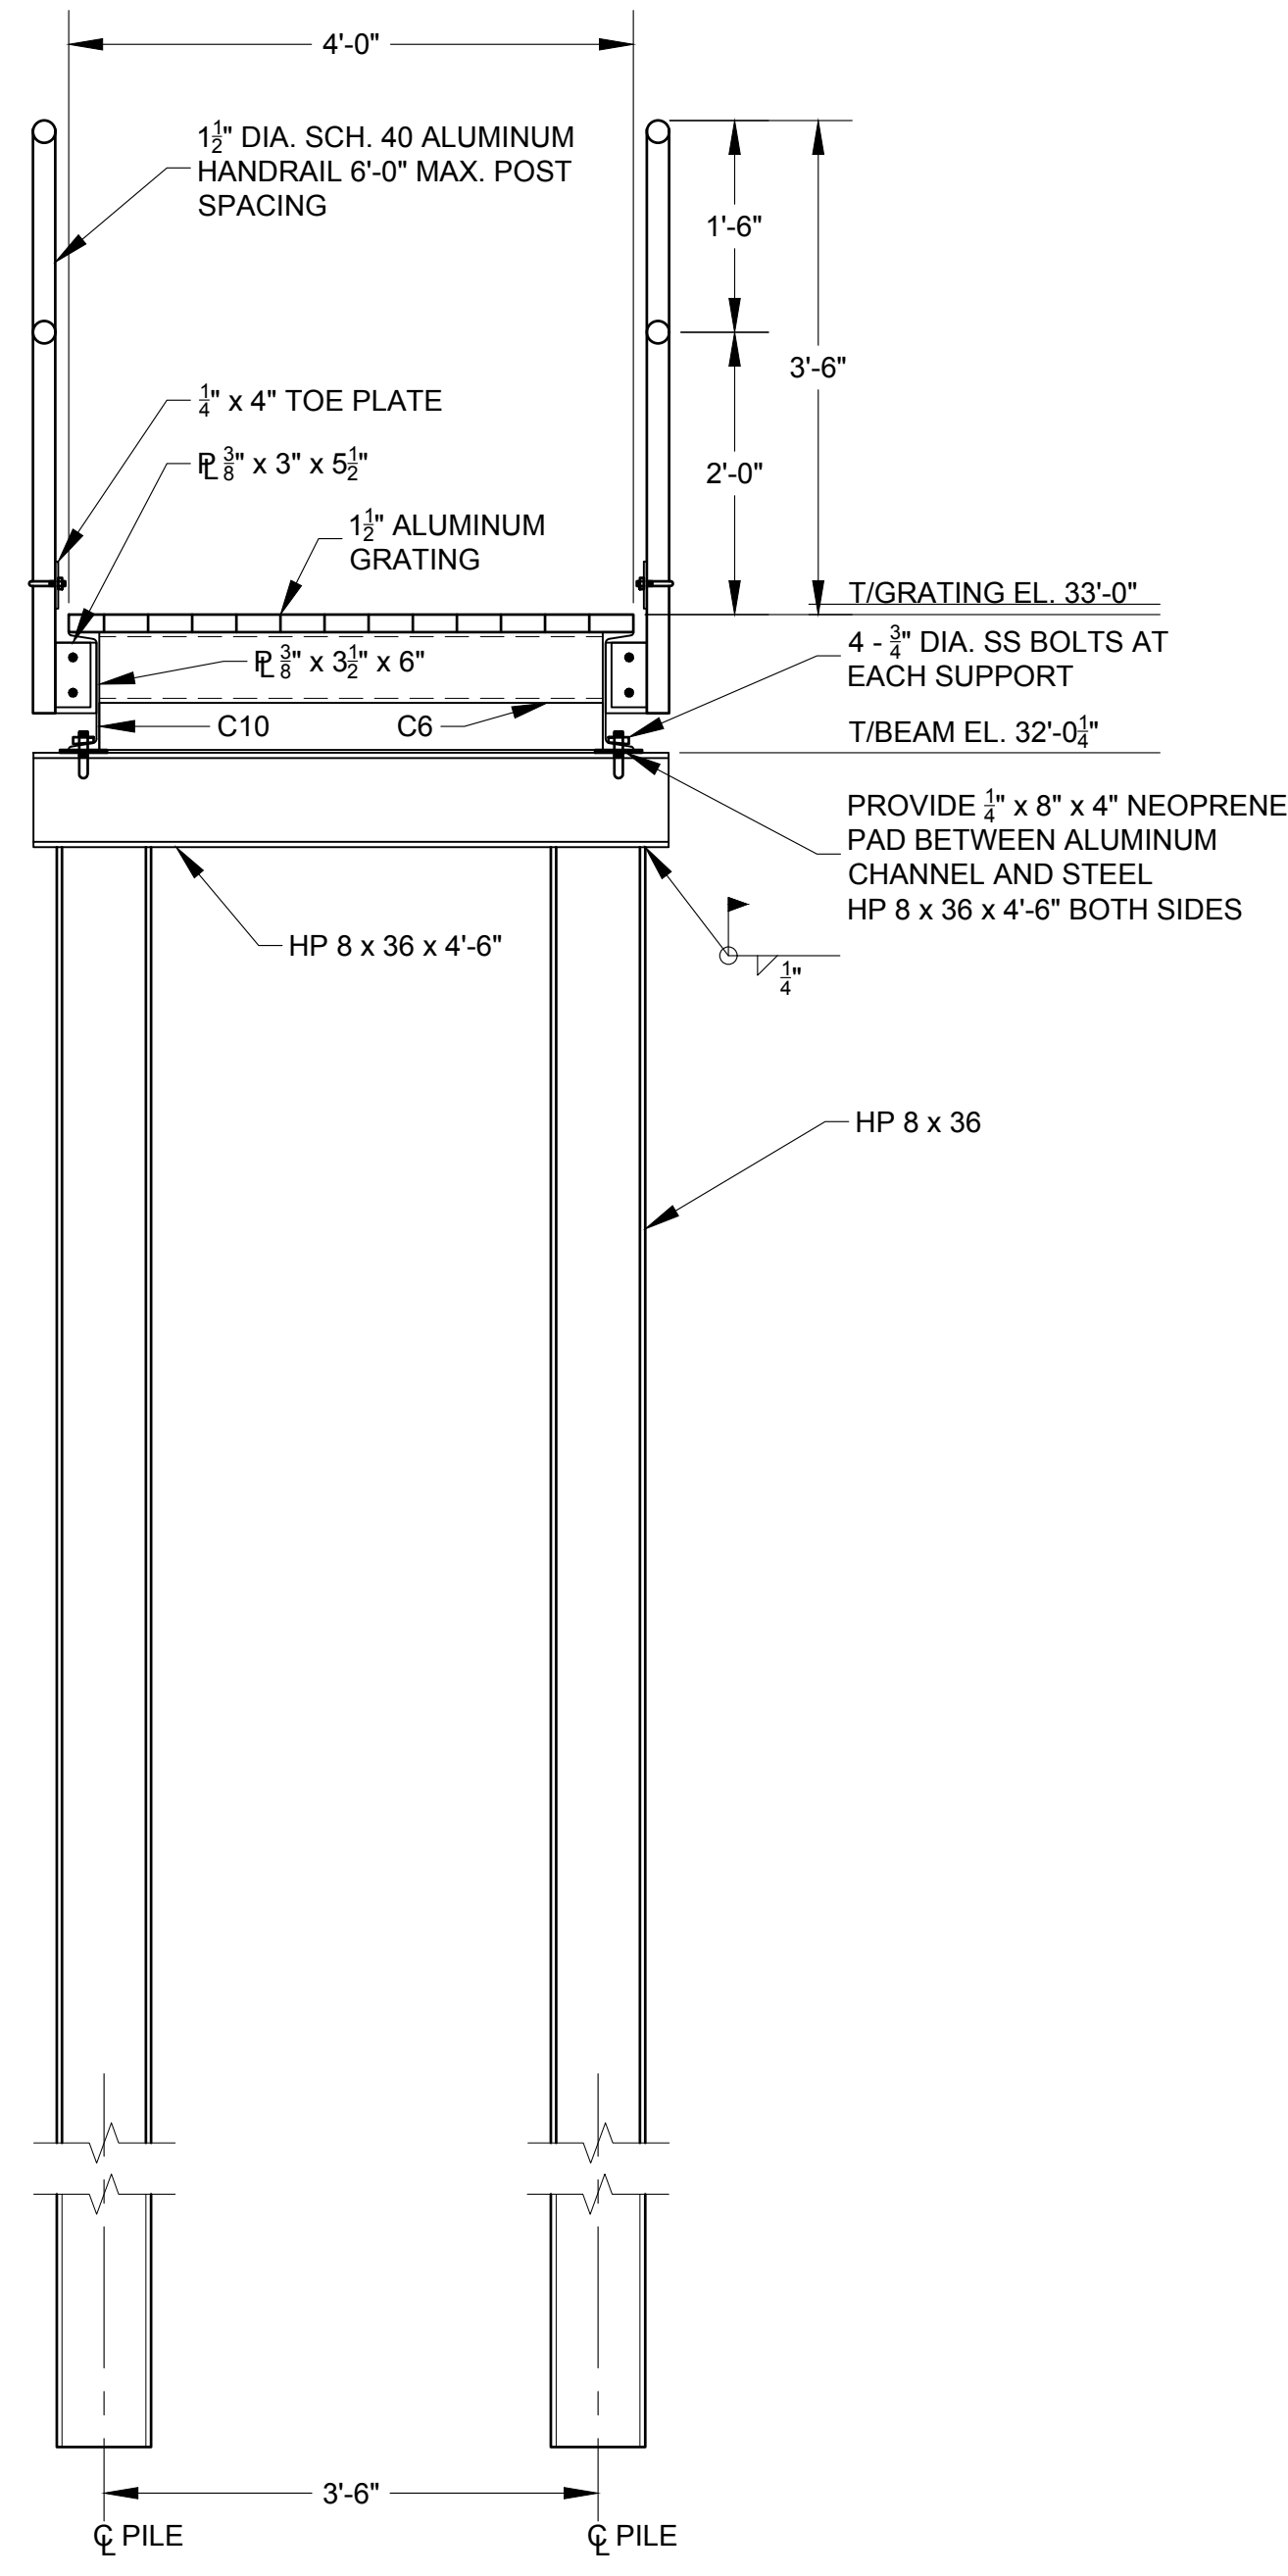


S2 1 TYPICAL SECTION
SCALE: 3/4"=1'-0"

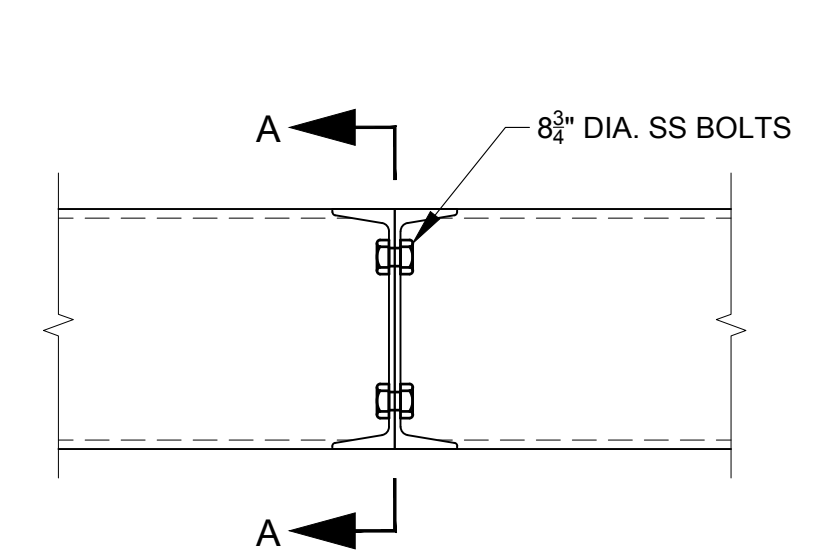


S2 2 TYPICAL WALKWAY PANEL CONNECTION
SCALE 1 1/2"=1'-0"

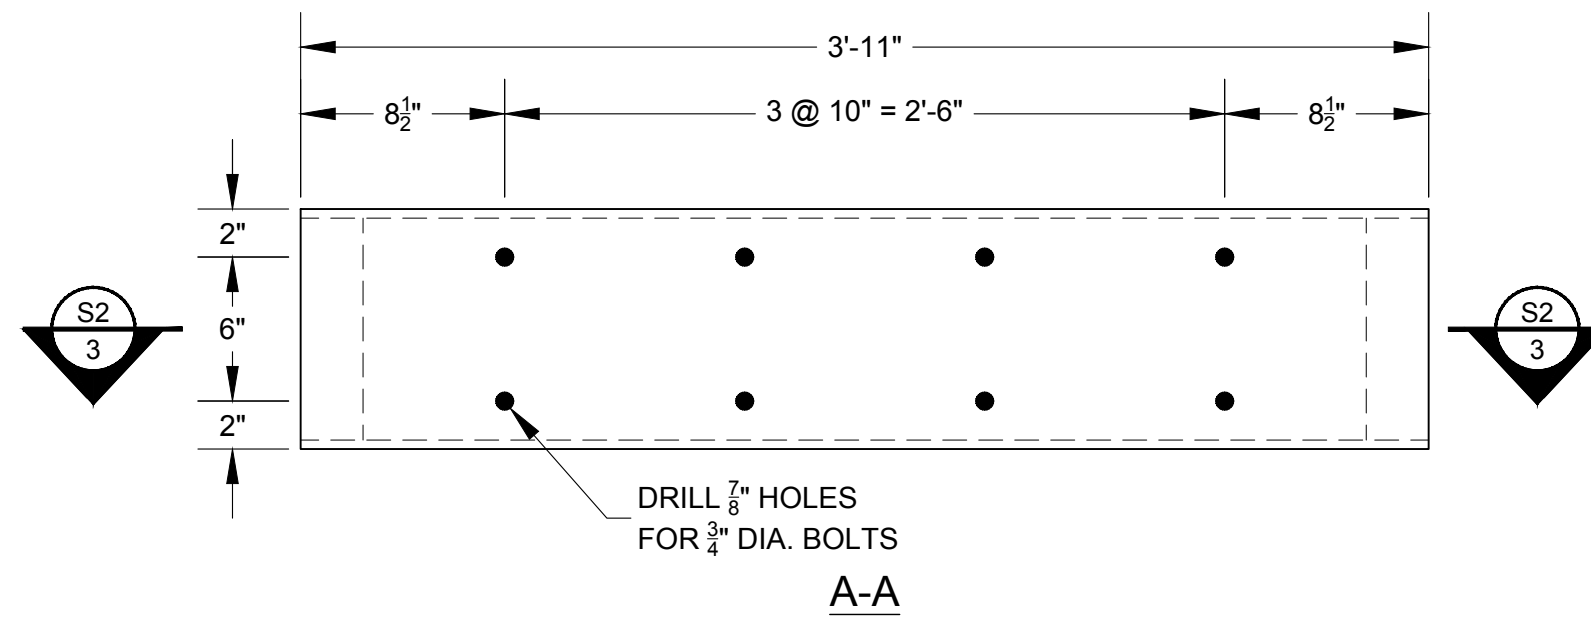


S2 3 END PANEL DETAIL AT CONCRETE FOOTING ONLY
SCALE 1 1/2"=1'-0"

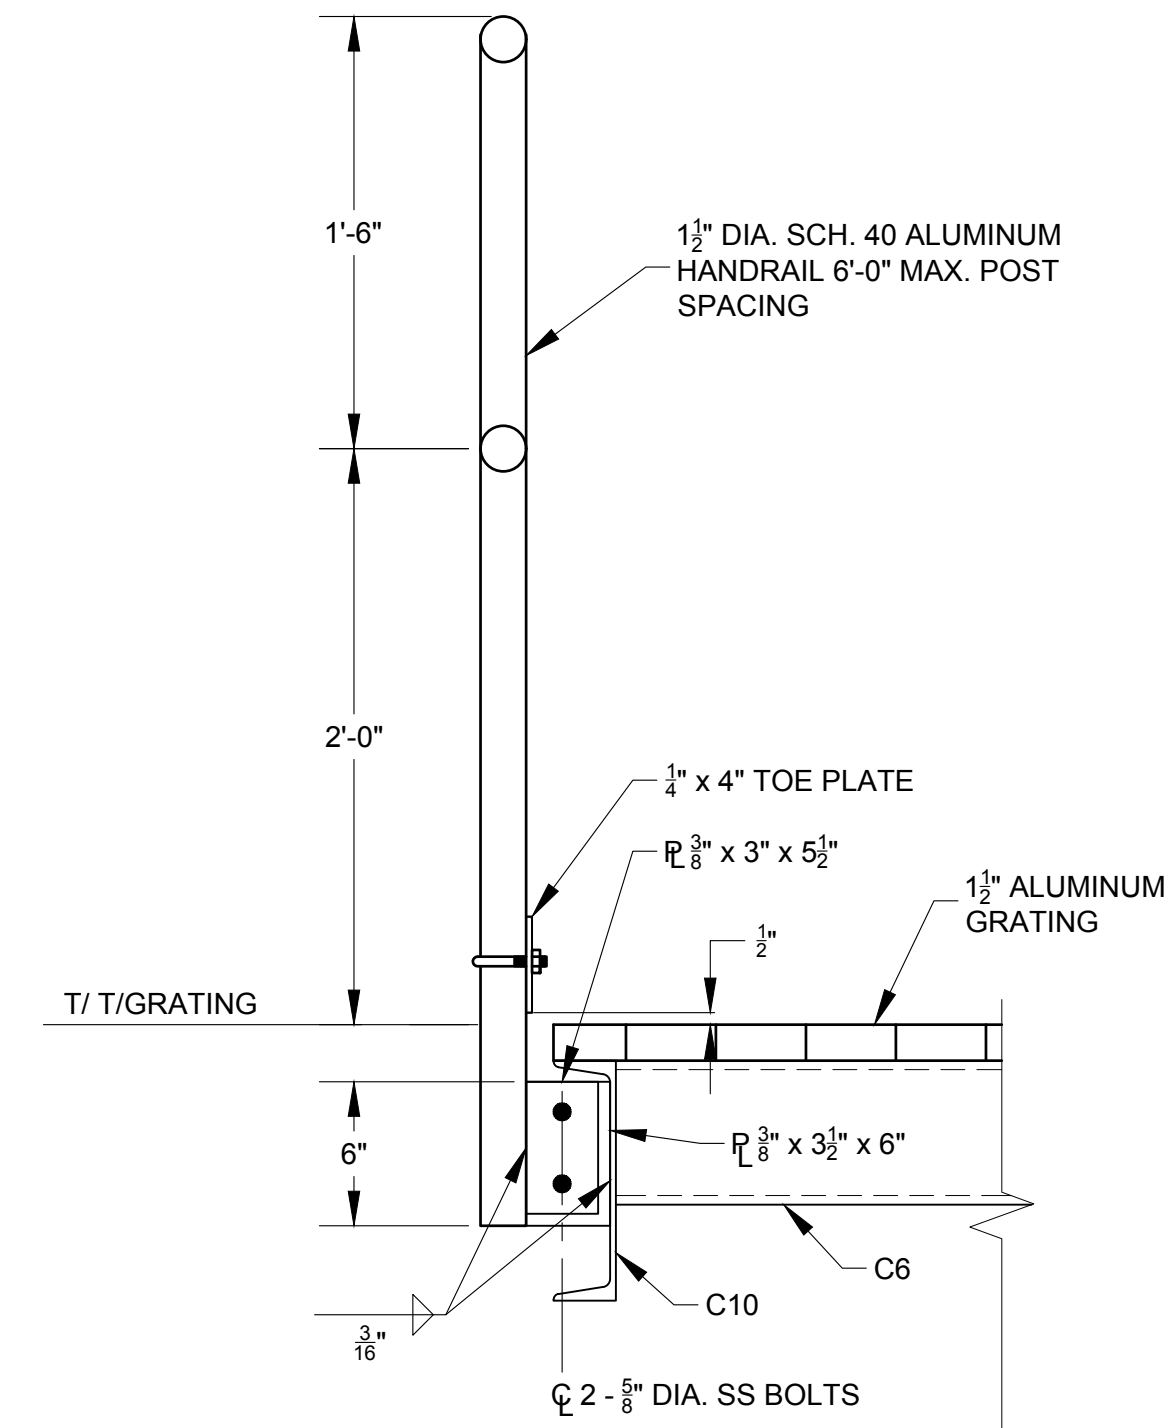


S2 4 HANDRAIL DETAIL
SCALE 1 1/2"=1'-0"

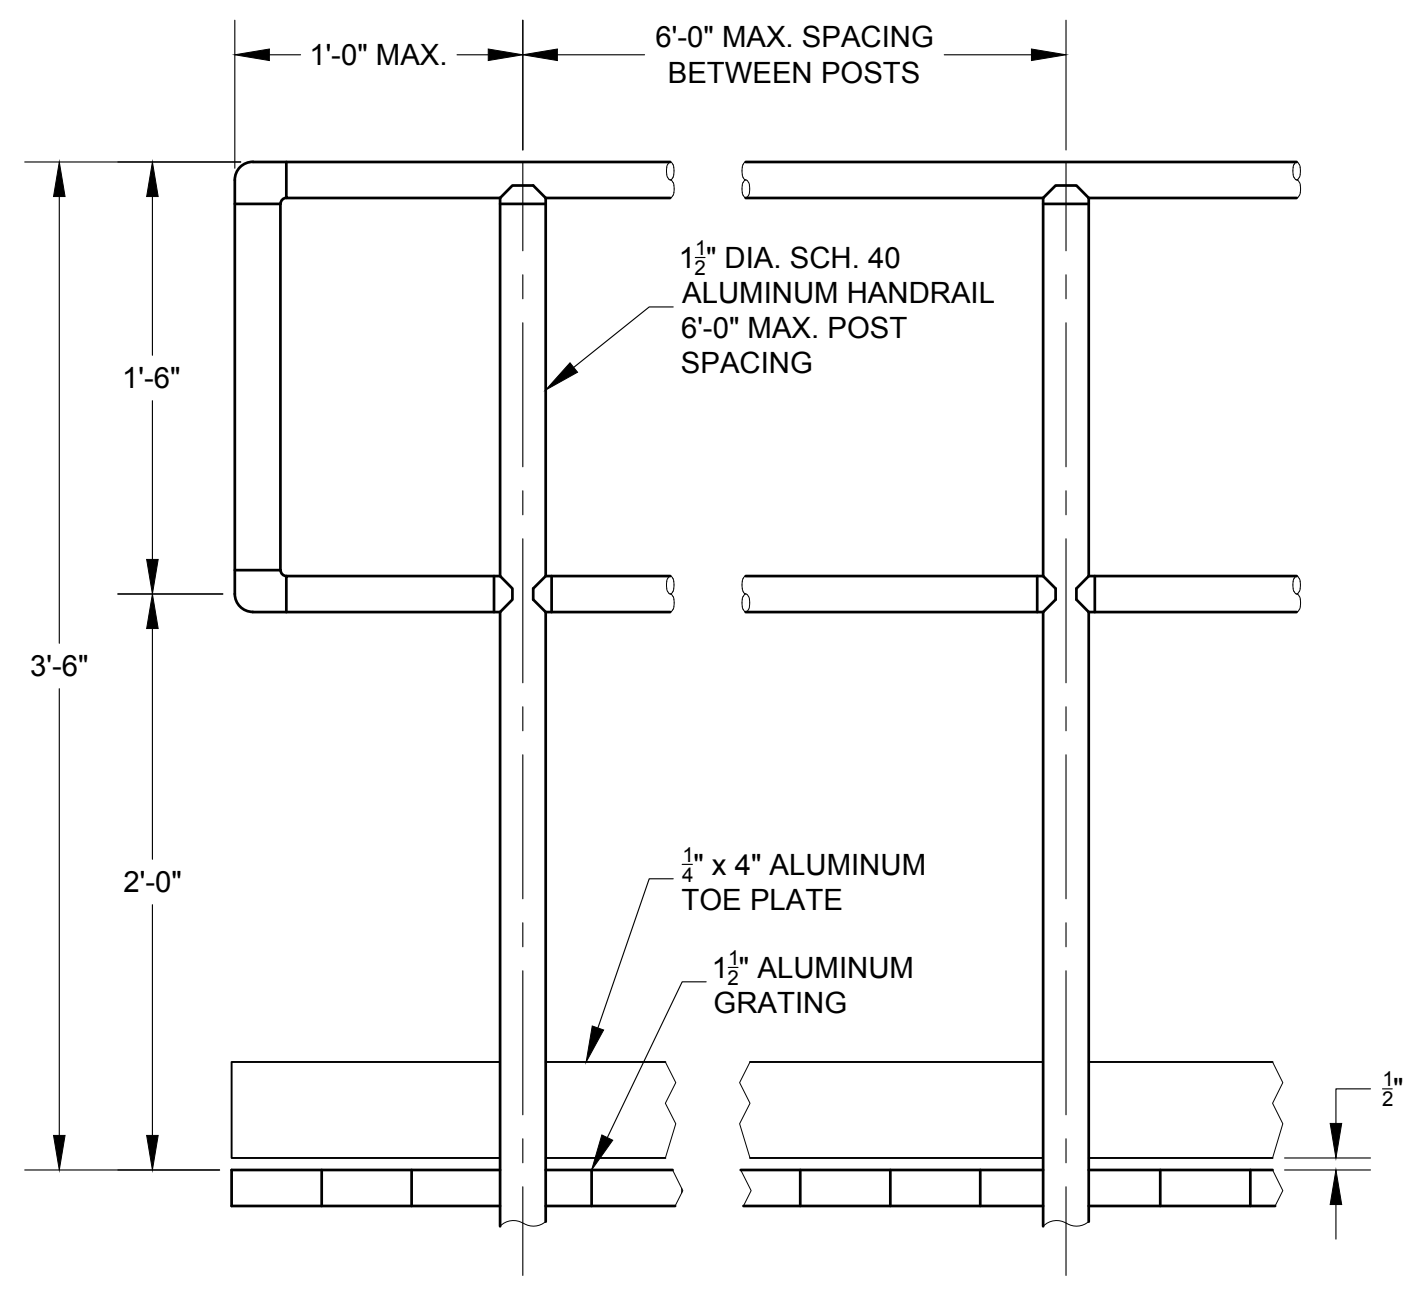

S2 5 TYPICAL HANDRAIL END DETAIL
SCALE 1 1/2"=1'-0"

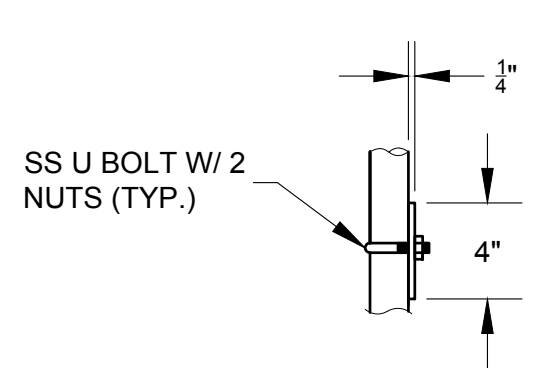


S2 6 TOE PLATE DETAIL
SCALE 1 1/2"=1'-0"

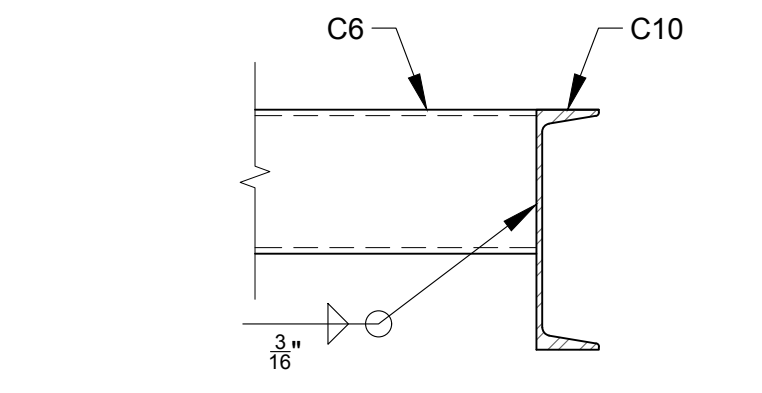


S2 7 TYPICAL C6 BEAM CONNECTION
SCALE 1 1/2"=1'-0"

NOTE SPECIFICATIONS:

- CONCRETE:**
1. ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE FLORIDA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, LATEST EDITION, SECTION 400 WITH SUPPLEMENTS AND ALL PERTINENT SPECIFICATIONS CONTAINED THEREIN.
 2. ALL CONCRETE SHALL BE FDOT CLASS I WITH A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 3000 PSI. PORTLAND CEMENT SHALL BE TYPE II IN ACCORDANCE WITH ASTM C-150. THE AGGREGATES SHALL CONFORM TO ASTM C-33 AND SHALL HAVE A 3/4-INCH MAXIMUM SIZE.
 3. REINFORCING STEEL SHALL BE GRADE 60 DEFORMED BILLET STEEL BARS CONFORMING TO ASTM A-615.
 4. THE MINIMUM CLEAR CONCRETE COVER FOR REINFORCEMENT SHALL BE 3 INCHES FOR CONCRETE CAST AGAINST EARTH AND 2 INCHES ELSEWHERE, UNLESS OTHERWISE NOTED.
 5. CONCRETE ANCHORS SHALL UTILIZE THE HILTI HIT-RE 500-SD EPOXY ADHESIVE ANCHORING SYSTEM, OR EQUAL. THREADED ANCHOR RODS, SHALL BE 3/4" DIA. X 8-1/2" LONG HAS-R 316 STAINLESS STEEL WITH A MINIMUM EMBEDMENT DEPTH OF 6-3/4". NUTS AND WASHERS SHALL ALSO BE SS-316.

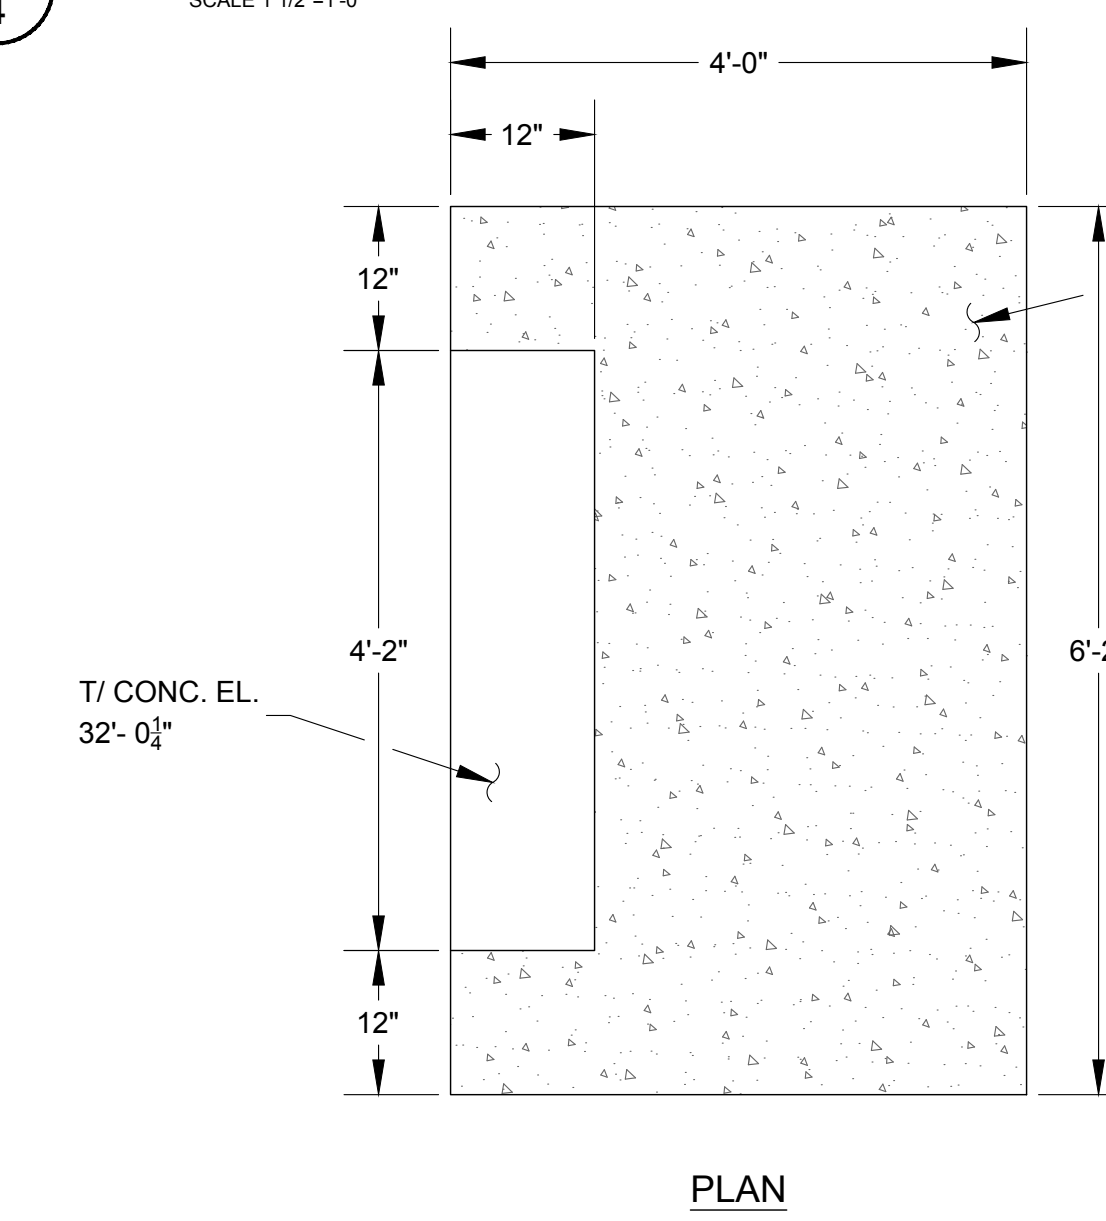

S2 8 WALKWAY FOOTING DETAIL
SCALE 3/4"=1'-0"

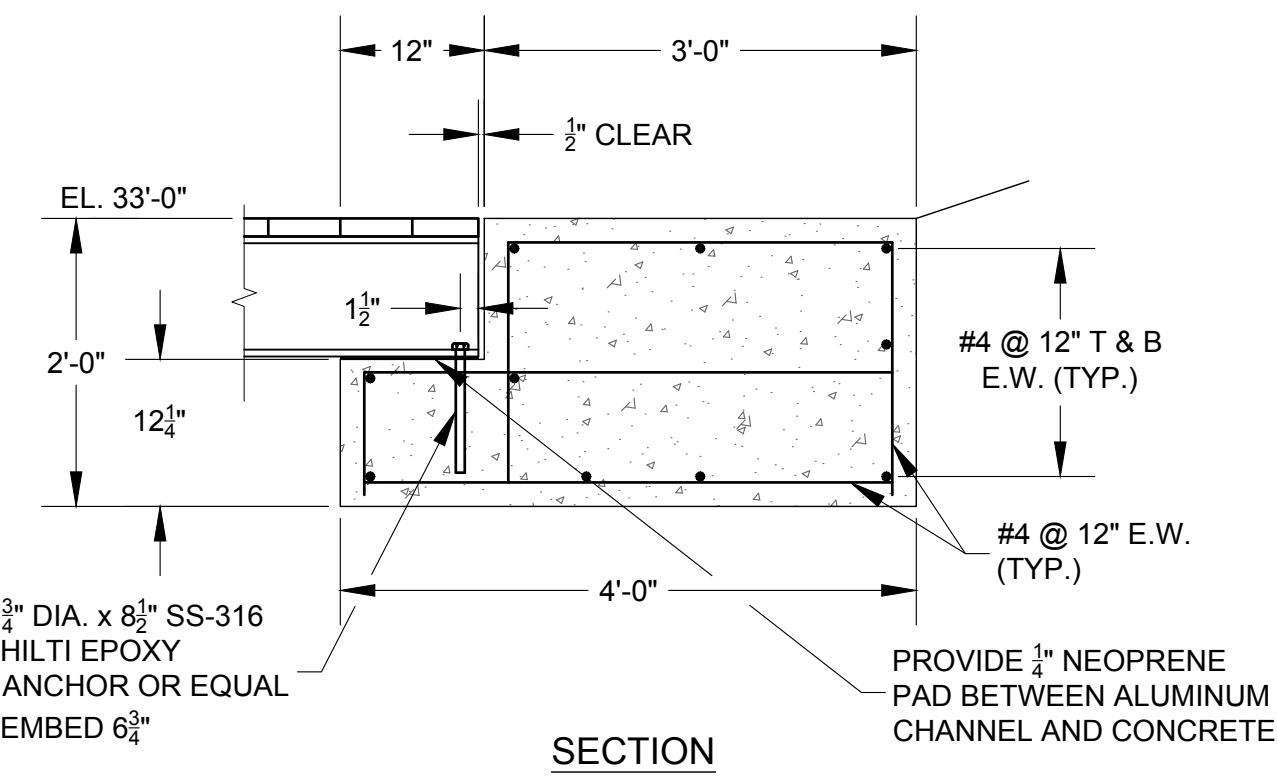

**FOR BID PURPOSES ONLY
NOT FOR CONSTRUCTION**

U:\Projects\CADD\US\BBS-252C WRI PLATFORM\CONSTRUCTION\252C WALKWAY DETAILS.dwg

NO.	REVISION	BY	DATE	APPROVED	DATE
1	ISSUED FOR BID	N.J.G.	01/28/19	W.R.C.	01/28/19

UPPER ST. JOHNS RIVER BASIN
STRUCTURE 252C WRI PLATFORM
INDIAN RIVER COUNTY, FLORIDA

ST. JOHNS RIVER
WATER MANAGEMENT DISTRICT
P.O. BOX 1429 PALATKA, FLORIDA

DRAWN: N.J.G. DATE: JANUARY 28, 2019 REVIEWER: W.R.C.
SCALE: AS NOTED DESIGNER: W.R.C. SECTION CHIEF: W.R.C.

DETAILS

CERTIFICATION:
WILLIAM R. COTE
P.E. NUMBER: 53746
DATE: JANUARY 28, 2019

FILE NAME:
252C WALKWAY DETAILS.dwg
PROJECT NO.:
SHEET:
S2