
# **MARTIN COUNTY SCHOOL DISTRICT ADMINISTRATIVE OFFICES EXTERIOR FINISHES** 100% CONSTRUCTION DOCUMENTS



4

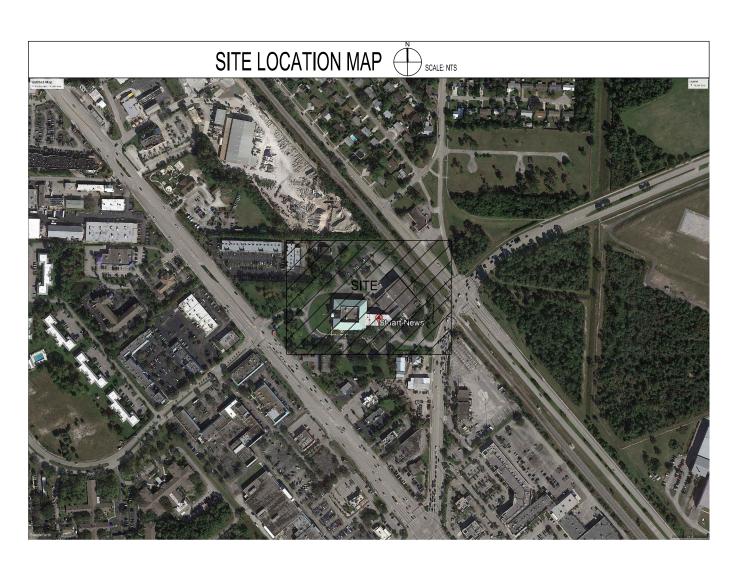

5

В

Α

# **BOARD MEMBERS:**

# **MARSHA POWERS TONY ANDERSON CHRISTIA LI ROBERTS VICTORIA DEFENTHALER MICHAEL DITERLIZZI DR. JOHN D. MILLAY**

# CHAIR **VICE CHAIR MEMBER** MEMBER MEMBER

# **SUPERINTENDENT**

# PROJECT NARRATIVE

THIS PROJECT INCLUDES THE EXTERIOR PAINTING OF ALL THE BUILDINGS AND SITE ACCESSORIES LOCATED AT THE MARTIN COUNTY SCHOOL DISTRICT ADMINISTRATIVE OFFICE. ALL NEW WORK SHALL BE IN ACCORDANCE WITH DRAWINGS AND SPECIFICATIONS SET FORTH IN THESE DOCUMENTS, FROM DIRECTION GIVEN FROM THE MARTIN COUNTY SCHOOL DISTRICT AND PER MANUFACTURERS RECOMMENDED INSTALLATION REQUIREMENTS. ALL AREAS, REGARDLESS OF THE LOCATION, WILL BE REQUIRED TO BE REPAIRED AND PREPPED FOR THE INSTALLATION OF THE SCOPE OF WORK. CONTRACTOR SHALL VISIT THE SITE TO RECOGNIZE THE AREAS WITHIN THE SCOPE OF WORK. ALL NEW WORK SHALL BE IN CONFORMANCE WITH THE MARTIN COUNTY SCHOOL DISTRICT STANDARDS, APPLICABLE CODES AND AUTHORITY HAVING JURISDICTION. THIS INCLUDES THE REQUIREMENTS OF SREF THE 2017 FLORIDA BUILDING CODE SIXTH EDITION AND THE FLORIDA FIRE PREVENTION CODE.

ARCHITECT'S STATEMENT OF COMPLIANCE: TO THE BEST OF OUR KNOWLEDGE, THESE DRAWINGS AND THE PROJECT MANUAL ARE COMPLETE AND COMPLY WITH THE MINIMUM REQUIREMENTS OF THE 2017 FLORIDA BUILDING CODE SIXTH EDITION.

3

SHEET NO.	TITLE	ORIGINAL DATE	REVISION NO.	LATEST REVISION DATE
	ARCHITECTURAL			
G-100	COVER SHEET & INDEX	07/14/2021		
A-001	SPECIFICATION - PAINT	07/14/2021		
A-201	ELEVATIONS	07/14/2021		
A-202	ELEVATIONS	07/14/2021		
A-203	ELEVATIONS	07/14/2021		
A-204	ELEVATIONS	07/14/2021		
A-205	ELEVATIONS	07/14/2021		
A-206	ELEVATIONS	07/14/2021		
A-207	ELEVATIONS	07/14/2021		

2

JOLY UR M M	40
	www.HarvardJolly.com AR0013140
A R C H I T E O	2047 Vista Parkway, Suite 100 West Palm Beach, FL 33411   561-478-4457

 $\overline{O} + \omega \overline{O}$ ial Ch tion ount Ĕ Fr ¥Q<u>0</u> Martin C 1939 Stu Stu District Ey

Com	nm. No:	17042.06		
Date	):	07/14/2021		
Drav	vn:	MFH		
	Rev	visions		
No. Date		Note		
	E BEST OF M			

TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE MINIMUM BUILDING CODES.

Daniel T Canavan, AIA ©2021 HARVARD JOLLY, INC.

COVER SHEET & INDEX

G-100

Inclusions: Exterior of main building, attached warehouse & maintenance garage including body of the building, soffits, railings, entrance doors, roll-up doors, retaining wall, incidental metal, iron work under the entranceway & roof

- The contractor is to pressure clean the exterior surfaces to be painted. (see <u>Pressure Washing Surface Preparation</u>) • Seal all exterior surfaces to be painted (see Coatings Schedule)
- (Sealants)(Specify full removal and replacement) (see Caulks & Sealants) Masonry
- Body of building, retaining wall
- Metal o Roof, handrails, entry doors, roll-up doors, iron work under entranceway, gutters,
- Misc. Conduit
- Choice of color may determine how many coats will be required to cover existing colors to be painted.

Exclusions Walkways, stairs, window & door frames

The work will consist of all preparation, painting, finishing work and related items necessary to complete work described in these specifications and listed in the remaining pages included within this specification.

Contractor shall strictly adhere to all applicable federal, state and local regulations associated with proper lead-safe work renovation, repair and painting practices and procedures. State and local regulations may be stricter than those set under the federal regulations. The federal practices and procedures are detailed in EPS's Lead Renovation, Repair and Painting Program Regulations Rule (RRP) 40 CFR Part 745, Subpart E, and as amended. Specifies associated with the RRP Rule pertaining to "Firm Certification", individual "Certified Renovator" Certification, pre-work activities (notification & testing), occupant protection / work site preparation measures, safe work / prohibitive work practices, clean-up / cleanup verification / waste disposal / clearance testing (if applicable), record keeping, and worker training criteria can be obtained on EPA's website www.epa.gov/lead .

WARNING! Removal of old paint by sanding, scraping or other means may generate dust or fumes that contain lead. Exposure to lead dust or fumes may cause brain damage or other adverse health effects, especially in children of pregnant women. Controlling exposure to lead or other hazardous substances requires the use of proper protective equipment, such as property fitted respirator (NIOSH approved) and proper containment and cleanup. For more information call the National Lead Information Center at 1-800-424-LEAD (in US) or contact your local health authority. Removal must be done in accordance with EPA Renovation, Repair and Painting Rule and all related state and local regulations. Care should be taken to follow all state and local regulations which may be stricter than those set under the federal RRP Rule.

# Coating Schedule

Please note that all masonry finish coats specified within have been tested for and have passed the ASTM D6904-03 wind driven rain test.

Stucco, EIFS, Other Masonry Surfaces & Gutters

A. Prime Coat:	Loxon® Acrylic Conditioner (LX03x100 series) (applied 200-300 sq. ft. per gallon)						
B. Repairs & Fresh Stucco:	Loxon® Concrete Masonry Primer/Sealer Latex (LX02W50) (applied 5.3-8 mils WFT or 2.1-3.2 DFT)						
C. Finish Coat:	Resilience® Exterior Latex Satin (4 mils WFT or 1.6 DFT)						
Metal Railings							
A. Prime Coat:	Pro Industrial™ Pro-Cryl Universal Metal Primer (B66 Series) (5-10 mils WFT or 2-4 mils DFT)						
B. Finish Coat:	Pro Industrial™ Urethane Alkyd Enamel (B54 Series) ( 4-5 mils WFT or 1.4-1.7 mils DFT)						
Metal Entry Doors & Iron Work Under The Entranceway							
A. Prime Coat:	Pro Industrial™ Pro-Cryl Universal Metal Primer (B66 Series) (B66 Series) (5-10 mils WFT or 2-4 mils DFT)						
B. Finish Coat:	Pro Industrial Urethane Alkyd Enamel (B54 Series) (4-5 mils WTF or 1.4-1.7 mils DFT)						
Metal Roll-Up Doors							
A. Prime Coat:	Pro Industrial™ Pro-Cryl (B66-310 Series) (5-10 mils WFT or 2-4 mils DFT)						
B. Finish Coat:	Pro Industrial Pre-Catalyzed Waterbased Urethane (B65 Series)						
Metal Roof							
A. Prime Coat:	Pro Industrial Pro-Cryl(B66-310 Series) (5-10 mile WFT or 2-4 mile DFT)						
B. Finish Coat:	Sher-Cryl High Performance Acrylic (B66-300/350 Series)						

# **Crack Repair**

Identify all cracks in the existing substrates and repair per manufacturer's recommendation

A.For hairline cracks 1/16 inch or less wide -- seal with Sherwin-Williams Concrete and Masonry Elastomeric Patching Compound (smooth or textured). B.For cracks 1/16-3/5 inch, route the crack open to a uniform size by mechanical methods. Clean out crack with water and allow to completely dry. Seal with Sherwin-Williams Concrete and Masonry Elastomeric Patching Compound (smooth or textured).

C.For cracks deeper than ½ inch or wider than 1/4 inch, backer rods should be used to fill the gap and to eliminate three point adhesions. See data sheet for additional information

# Caulks and Sealants

#### Execution

A.Do not begin application of caulk or sealants until substrates have been properly prepared. Notify owner or owner's representative of unsatisfactory conditions before proceeding. B.If substrate preparation is the responsibility of another installer, notify owner or owner's representative of unsatisfactory preparation before proceeding. C.Proceed with work only after conditions have been corrected, and approved by all parties, otherwise application of caulks and sealants will be considered as an acceptance of surface conditions

#### Surface Preparation

Α

A.Clean all joints by removing any foreign matter or contaminants that would impede adhesion of the sealant to the building material. The surface must be dry and in sound condition. Remove oil, dust, dirt, loose rust, peeling paint or other contamination to ensure good adhesion.

B.Porous materials are usually treated by mechanical means and nonporous surfaces by a solvent wipe that is compatible with the building substrate being used. Note: For porous surfaces, the use of detergent or soap & water is NOT recommended.

C.Existing sealants intended to be painted should be tested to assure coatings will fully adhere. Silicone sealants cannot be painted unless tested and approved by Sherwin-Williams and Owner.

**D**.Priming: When required, apply a primer. Do NOT allow it to pool or puddle.

**E**.Install backup materials as required to ensure that the recommended depth is regulated when using the backup material.

F. No exterior caulking should be done immediately after a rain, during foggy weather, when rain is predicted, or when the temperature is below 50°F, unless products are designed specifically for these conditions.

#### Caulks and Sealants, continued Caulk & Sealant Installation

### A.Apply all caulks and sealants with manufacturer specifications in mind. B.Do not apply to wet or damp surfaces 2. Wait until wood is fully dry after rain or morning fog or dew.

**C.**Apply sealants using methods recommended by manufacturer.

D.Uniformly apply caulks and sealants without skips, voids or sags. Tool bead to a consistent, smooth surface

PVC, Plastic, Brick, Stone, Masonry, Marble, Stucco, Cementitious Siding, Vinyl Siding, Wood: 1. Exterior Polyurethane:

Sherwin-Williams Loxon S1

**Concrete: Vertical Applications** Exterior Polvurethane: Sherwin-Williams Loxon S1

Concrete: Horizontal Applications

Exterior Polyurethane: Sherwin-Williams: Loxon SL1 One Component Self Leveling for Horizontal Surfaces

Gaps: Window & Door Frames 1. Interior/Exterior Insulating Foam: Sherwin-Williams STOP GAP! Minimal Expanding Insulating Foam

Gaps: Large Areas Interior/Exterior Insulating Foam:

Glass: Glazing

1. Exterior Latex

Glass: Non-Structural Sealing 1. Exterior:

Sherwin-Williams White Lightning All Purpose Silicone Ultra

Metal: Ferrous and Non-Ferrous Exterior Polyurethane:

Sherwin-Williams Loxon S1 One Component Smooth

Exterior Polyurethane/Silicone Hybrid: Sherwin-Williams Loxon H1 One Component Polyurethane/Silicone Hybrid

### Contractor Responsibilities

#### Pre-Bid

It is recommended that a pre-bid meeting be conducted with all interested parties attending. The purpose is to review the general requirements of the project and perform a general inspection. The meeting shall be assigned at the owner's discretion. The time, date, and place are also at the owner's discretion. Sherwin-Williams will also attend the meeting. It is the responsibility of the bidder to fully understand the scope of work and the conditions under which work is to be performed. Failure to attend shall not relive a bidder from full performance of any contract awarded to the satisfaction of the solicitor. Bidders are strongly recommended to attend.

#### Scope of Work

Work in general includes surface preparation, surface repair, caulking, sealants, patching and application of the paint coating to the substrates and systems outlined in this specification and approved by owner or owner's agent.

#### Materials

1. All materials specified are from The Sherwin-Williams Company.

Protection of Substrates Not to be painted Contractor shall protect his/her work at all times and shall protect all adjacent work and materials by suitable covering or other methods during progress of work. The contractor will protect all adjacent areas not to be painted by taking appropriate measures. Areas to be protected are windows, brick, surrounding lawn, trees, shrubbery, floor and steps. Upon completion of work, he/she shall remove all paint droppings and over-spray from floors, glass, concrete and other surfaces not specified to be painted.

### Minimum Specifications

Sherwin-Williams representative

1. If instructions contained in this specification, bid documents or painting schedule are at variance with the paint manufacturer's instructions or the management representative.

#### Resolution of Conflicts

Contractor shall be responsible for stopping work and request prompt clarification when instructions are lacking, when conflicts occur in the specifications and/or paint manufacturer's literature, or the procedures specified are not clearly understood. Any questions concerning these specifications should be clarified prior to commencing the job. Any changes to these specifications would require written approval by Sherwin-Williams, the customer or customer's representative.

#### Coordination of Work

job and with the Management Company or owner. Safety

www.sherwin-williams.com

Jobsite Visitation

# 1. The contractor shall be responsible for visiting the jobsite and familiarizing himself with the job and working conditions.

2. All work during application is subject to inspection by the owner or his representative.

by any Sherwin-Williams representative.

written approval of the owner, agent, or Sherwin-Williams representative.

# Surface Preparation

Each surface shall be cleaned, scrapped, sanded and prepared as specified. The painting contractor is responsible for the finish of his work. Should any surface be found unsuitable to produce a proper paint or sealant finish, the project representative shall be notified, in writing, and no materials shall be applied until the unsuitable surfaces have been made satisfactory. Commencing of work in a specific area shall be construed as acceptance of surfaces and thereafter as fit and proper to receive finish. Contractor shall be fully responsible for satisfactory work.

2. All deteriorated or delaminated substrates (i.e. wood, hardboard siding, T-111, stucco and masonry surfaces) shall be replaced with new materials. New substrates will be box primed (6 sides) before installation in accordance with specifications. Delaminating substrate is defined as a substrate surface that paint is being applied to lifting or peeling away from the previous coating/s or original substrate/s.

3. All exterior surfaces to be painted shall be pressure cleaned, scrapped to remove all dirt, mildew, peeling paint, chalk and any foreign materials detrimental to the new finish (see Pressure Washing)

4. Thoroughly sand all glossy surfaces to create a profile for paint and/or primer to adhere to.

5. Apply caulks and sealants where appropriate. All existing underperforming caulks or sealants should be removed and replaced with sealant as specified. Allow sealant to cure for specified time in dry weather before paint is applied. NOTE: It is recommended to apply all primers first and then apply sealant before topcoat is applied. See specified sealants section.

1. Wait at least 30 days before applying to new concrete or masonry, or follow manufacturer's procedures to apply appropriate sealants prior to 30 days.

Sherwin-Williams STOP GAP! Triple Expanding Insulating Foam

Sherwin-Williams White Lightning Window & Door Siliconized Acrylic Latex Glazing Compound

2. All paints shall be delivered to the job site in the original container with the manufacturer's label intact.

The paint shall be used and applied per label and data sheet instructions. The material shall not be thinned or modified in any way unless specified herein. Manufacturer's recommendation for proper surface preparation shall be followed. All data sheets on specified materials are available from your local Sherwin-Williams representative or www.paintdocs.com.

All paint and sundries at the job site shall be available for inspection at any time upon commencement of the job by the owner, owner's agent, or a

applicable standard, and codes listed, surfaces shall be prepared and painted to suit the higher standard, as determined by Sherwin-Williams, the customer or

1. The general contractor and subcontractor shall be responsible for coordination of his work with the other crafts and contractors working on the same

All pertinent safety regulations shall be adhered to rigidly. In addition, all safety noted on the manufacturer's Product Data Sheets and labels shall be observed. Material Safety Data Sheets and Product Data Sheets are available from your local Sherwin-Williams store or representative or by visiting

2. Verify the existence of lead-based paints on the project. Buildings constructed after 1978 are less likely to contain lead-based paints. If lead-based paints are suspected on the project, all removal must be done in accordance with the EPA Renovation, Repair and Painting Rule or similar state regulation. Verify that owner has completed a Hazardous Material Assessment Report for the project prior to issuing of Drawings.

3. It will be the paint contractor's responsibility to own and use a wet film thickness gauge to check his application thickness as he proceeds.

4. Contractor and owner have complete responsibility for ensuring that the project specifications are followed, notwithstanding periodic visits to the project

5. Any questions concerning these specifications should be clarified prior to commencing the job. Any changes to these specifications would require

Surface Preparation, continued

- 1. Each surface shall be cleaned, scrapped, sanded and prepared as specified. The painting contractor is responsible for the finish of his work.
- 2. Knots and pitch streaks shall be scraped, sanded and spot primed before full priming coat is applied. All nail holes or small openings shall be patched after priming coat is applied. Any wood that is rotten, cracked, delaminated or water damaged should be replaced. Any loose or peeling paint should be removed by sanding and scraping. All hard, glossy surfaces should be sanded down to create a profile for new paint to adhere. Fill nail holes, imperfections and cracks with putty (color to match primer). Edges, corners and raised grain shall be prepared by sanding. Apply sealants to all joints between wood items with a specified sealant.
- 3. All masonry surfaces should be scrapped and cleaned to remove all peeling paint, delaminated surfaces or substrates, chalk, dirt, stains, fflorescence and other surface contaminants. These areas shall be pressure washed and scrubbed with a cleaner/degreaser solution. After cleaning if there is still chalk evident this should be brought to the owner's attention in writing before any further work is done. Use an industry accepted patch or filler to assure a visually aesthetic finished substrate. Any masonry surface should be toughly tested to assure the surface pH levels are within accepted range of coating/s to be applied.
- 4. Brick must be free of dirt, loose or peeling paint, loose and excess mortar, delaminating layers of the brick, and foreign material. All brick should be allowed to weather for at least one year followed by wire brushing to remove efflorescence. Treat the bare brick with one coat of Loxon Conditioner. Any areas of breakage shall by patch and dried using specified Sherwin-Williams patching compound in accordance with Product Data Sheet instructions before coatings are applied.
- 5. All galvanized gutters and flashing should be thoroughly cleaned and sanded to remove loose and peeling paint. Any bare galvanized metal should be wiped down with a non-petroleum solvent cleaner.
- 6. All ferrous metals should be thoroughly cleaned and all loose rust or mill scale be removed by wire brush, scraper and/or power tool, such as an electric drill with wire brush attachment. Any rust spots or bare metal should receive the specified prime coat. Any hard, glossy surfaces should be sanded or dulled. Previously painted hand rails in sound condition should be washed down with a strong degreasing cleaner such as Krud Kutter, M-1 House Wash or Simple Green.
- 7. All vinyl siding should be clean thoroughly by scrubbing with a warm, soapy water solution. Rinse thoroughly. Do not paint vinyl siding with any color darker than the original color, unless the product and color are designed for such use. Painting with darker colors may cause siding to warp.
- 8. Cement Composition Siding/Panel/Fiber Cement Sidings: Remove all surface contamination by washing with an appropriate cleaner, rinse noroughly and allow to dry. Existing peeled or checked paint should be scraped and sanded to a sound surface. Pressure clean, if needed, to remove all dirt, dust, grease, oil, loose particles, laitance, foreign material, and peeling or defective coatings. Allow the surface to dry thoroughly. The pH of the surface should be 12 or less, unless the products are designed to be applied to high pH substrates..

EIFS: Remove all surface contamination by washing with an appropriate cleaner, rinse thoroughly and allow to dry. Remove and replace any peeling or delaminating surfaces. Replace EIFS to manufactures recommendation.

#### Moisture

All areas that could cause paint failure due to moisture should be addressed and eliminated. This would include but is not limited to:

- 1. Gutters and downspouts not working properly.
- 2. Previous coats of paint not adhering properly.
- Wood checking (cracks and splits in wood)
- Deteriorated caulking or sealant.
- 5. Gaps between substrates.
- 6. Rotten wood.
- 7. Areas affected by water splashing.
- 8. Painting in inclement weather.
- 9. Painting an un-dry substrate.
- 10. Un-caulked nail holes.

Pressure Washing & Surface Preparation

1. Pressure wash or water blast to remove oil, grease, dirt, loose mill scale and loose paint by water at pressures of 2500-3000 p.s.i. Power tool clean per SSPC-SP3 to remove loose rust and mill scale. Hand tool clean per SSPC-SP2 and sand all glossy surfaces to promote adhesion.

2. Remove mildew per the following:

a. Tools: Stiff brush, garden pump sprayer or chemical injector power washer method. b. Remove before painting by washing with a solution of 1 part liquid bleach and 3 parts water. Apply the solution and scrub the mildewed area. Allow the solution to remain on the surface for 10 minutes. Rinse thoroughly with water and allow the surface to dry before painting. Wear protective eyewear, waterproof gloves, and protective clothing. Quickly wash off any of the mixture that comes in contact with your skin. Do not add detergents or ammonia to the bleach/water solution.

Application

- 1. Contractor shall be responsible for notification of owner's representative before beginning work if conditions substantially exceed Scope of Work.
- Contractor shall protect his/her work at all times and shall protect all adjacent work and materials by suitable covering or other method during progress of the work. Upon completion of work, he/she shall remove all paint and varnish spots from floors, glass and other surfaces. He shall remove from premises all rubbish and accumulated materials of whatever nature not caused by others and shall leave his part of work in a clean, orderly, and acceptable condition.
- 3. Remove and protect hardware, accessories, device plates, lighting fixtures, factory finished work and similar items or provide ample in-place protection. Upon completion of each space, carefully replace all removed items.
- 4. Cover all electrical panel box covers and doors before painting walls. Omit if covers have been previously painted.
- 5. Materials shall be applied under adequate illumination, evenly spread and flowed on smoothly to avoid runs, sags, holidays, brush marks, air bubbles and excessive roller stipple. The finished paint film should be a consistent color and sheen to provide a uniform appearance.
- 6. All coats shall be dry to manufacturer's instructions before applying additional coats.
- 7. Any masonry surface with an elevated pH level or "hot spots" shall be sealed with a suitable primer/sealer prior to application of finish coat. High pH is considered at a level of 12 pH or greater.
- 8. When spray painting is specified, contractor shall finish 100 square feet by spraying a sample of finish upon request of owner. This shall be finished with materials specified and shall be called a Pilot Wall.
- 9. Exterior doors with paintable tops, bottoms, and side edges should be painted or sealed using the Door Manufacturer's paint specification and recommendations.
- 10. Building by building inspections will be made by the owner or his representative. If requested, a Sherwin-Williams representative may participate in these visits for technical consultation
- 11. All repairs, replacements and applications are to meet or exceed all manufacturers' and attached specifications.
- 12. Elastomeric coatings shall not be applied directly over pre-existing elastomeric coatings.

3

13. Coverage and hide shall be complete. When color, stain, dirt, or undercoats show through final coat of paint, surface shall be covered by additional coats until paint film is of uniform finish, color, appearance and coverage (regardless of amount of coats specified).

#### Workmanship & Application Conditions

- 1. Keep surface dust, dirt and debris free before, during, and after painting, until paint is cured.
- 2. Execute work in accordance with label directions. Coating application shall be made in conformance to this specification and to the manufacturer's paint instruction on the labels and Product Data Sheets.
- 3. All work shall be accomplished by persons with the necessary skill and expertise and qualified to do the work in a competent and professional
- manner 4. All shrubbery, outside carpeting and sprinkler systems shall be fully protected against damage during each stage of the painting project.
- 5. Paint all previously painted surfaces, including, but not limited to: stair systems, light poles and fixtures, pool fence, and underside of balconies. Any potentially hazardous substrate shall be reviewed with owner and owner's agent. All necessary safety precautions must be fully taken to ensure worker's safety
- 6. All exterior substrates designated not to receive paint coatings shall be kept free of paint residue, i.e., windows, outdoor carpeting, walkways, etc. 7. Owner shall provide water and electricity from existing facilities.
- 8. Normal safety and "wet paint" signs, necessary lighting and temporary roping off around work areas shall be installed and maintained in accordance with OSHA requirements while the work is in progress.
- 9. A progress schedule shall be furnished by the contractor to the owner for approval and shall be based on the contract completion date. Contractor shall advise the owner of those areas in which work is to be performed sufficiently in advance of the work schedule to permit the owner to prepare for the work, advise residents, move vehicles, etc.
- 10. Do not paint over any code required labels or any equipment identification, performance rating, name or nomenclature plates.
- 11. Coverage and hide shall be complete. When color, stain, dirt, or undercoats show through final coat of paint, surface shall be covered by additional coats until paint film is of uniform finish, color, appearance and coverage (regardless of amount of coats specified).

### Weather

1. All materials are to be applied in accordance with the product data page in regards to weather conditions. Stop exterior work early enough in the day to permit paint film to set up before condensation caused by night temperature drops occurs. 2. Do not begin painting until surfaces are moisture free.

#### Custodian

1. Upon conclusion of the project, the Contractor or paint manufacture/supplier shall furnish a coating maintenance manual, such as Sherwin-Williams "Custodian Project Color and Product Information" report or equal. Manual shall include an Area Summary with finish schedule, Area Detail designating where each product/color/finish was used, product data pages, Material Safety Data Sheets, care and cleaning instructions, touch-up procedures, and color samples of each color and finish used.


Ð inistrative r Finishe ity Schoo ederal H ederal H Florida 34 uction Do terior Fin terior Fin ounty Sc SE Federa ပ္ပလ District Ey Martir 193 600


Comm. No: 17042.06 07/14/2021 Date: MFH Drawn: Revisions No. Date Note

THE BEST OF MY KNOWLEDGE, T PLANS AND SPECIFICATIONS COMPLY WITH THE MINIMUM BUILDING CODES.


Daniel T Canavan, AIA ©2021 HARVARD JOLLY, INC.

SPECIFICATIONS

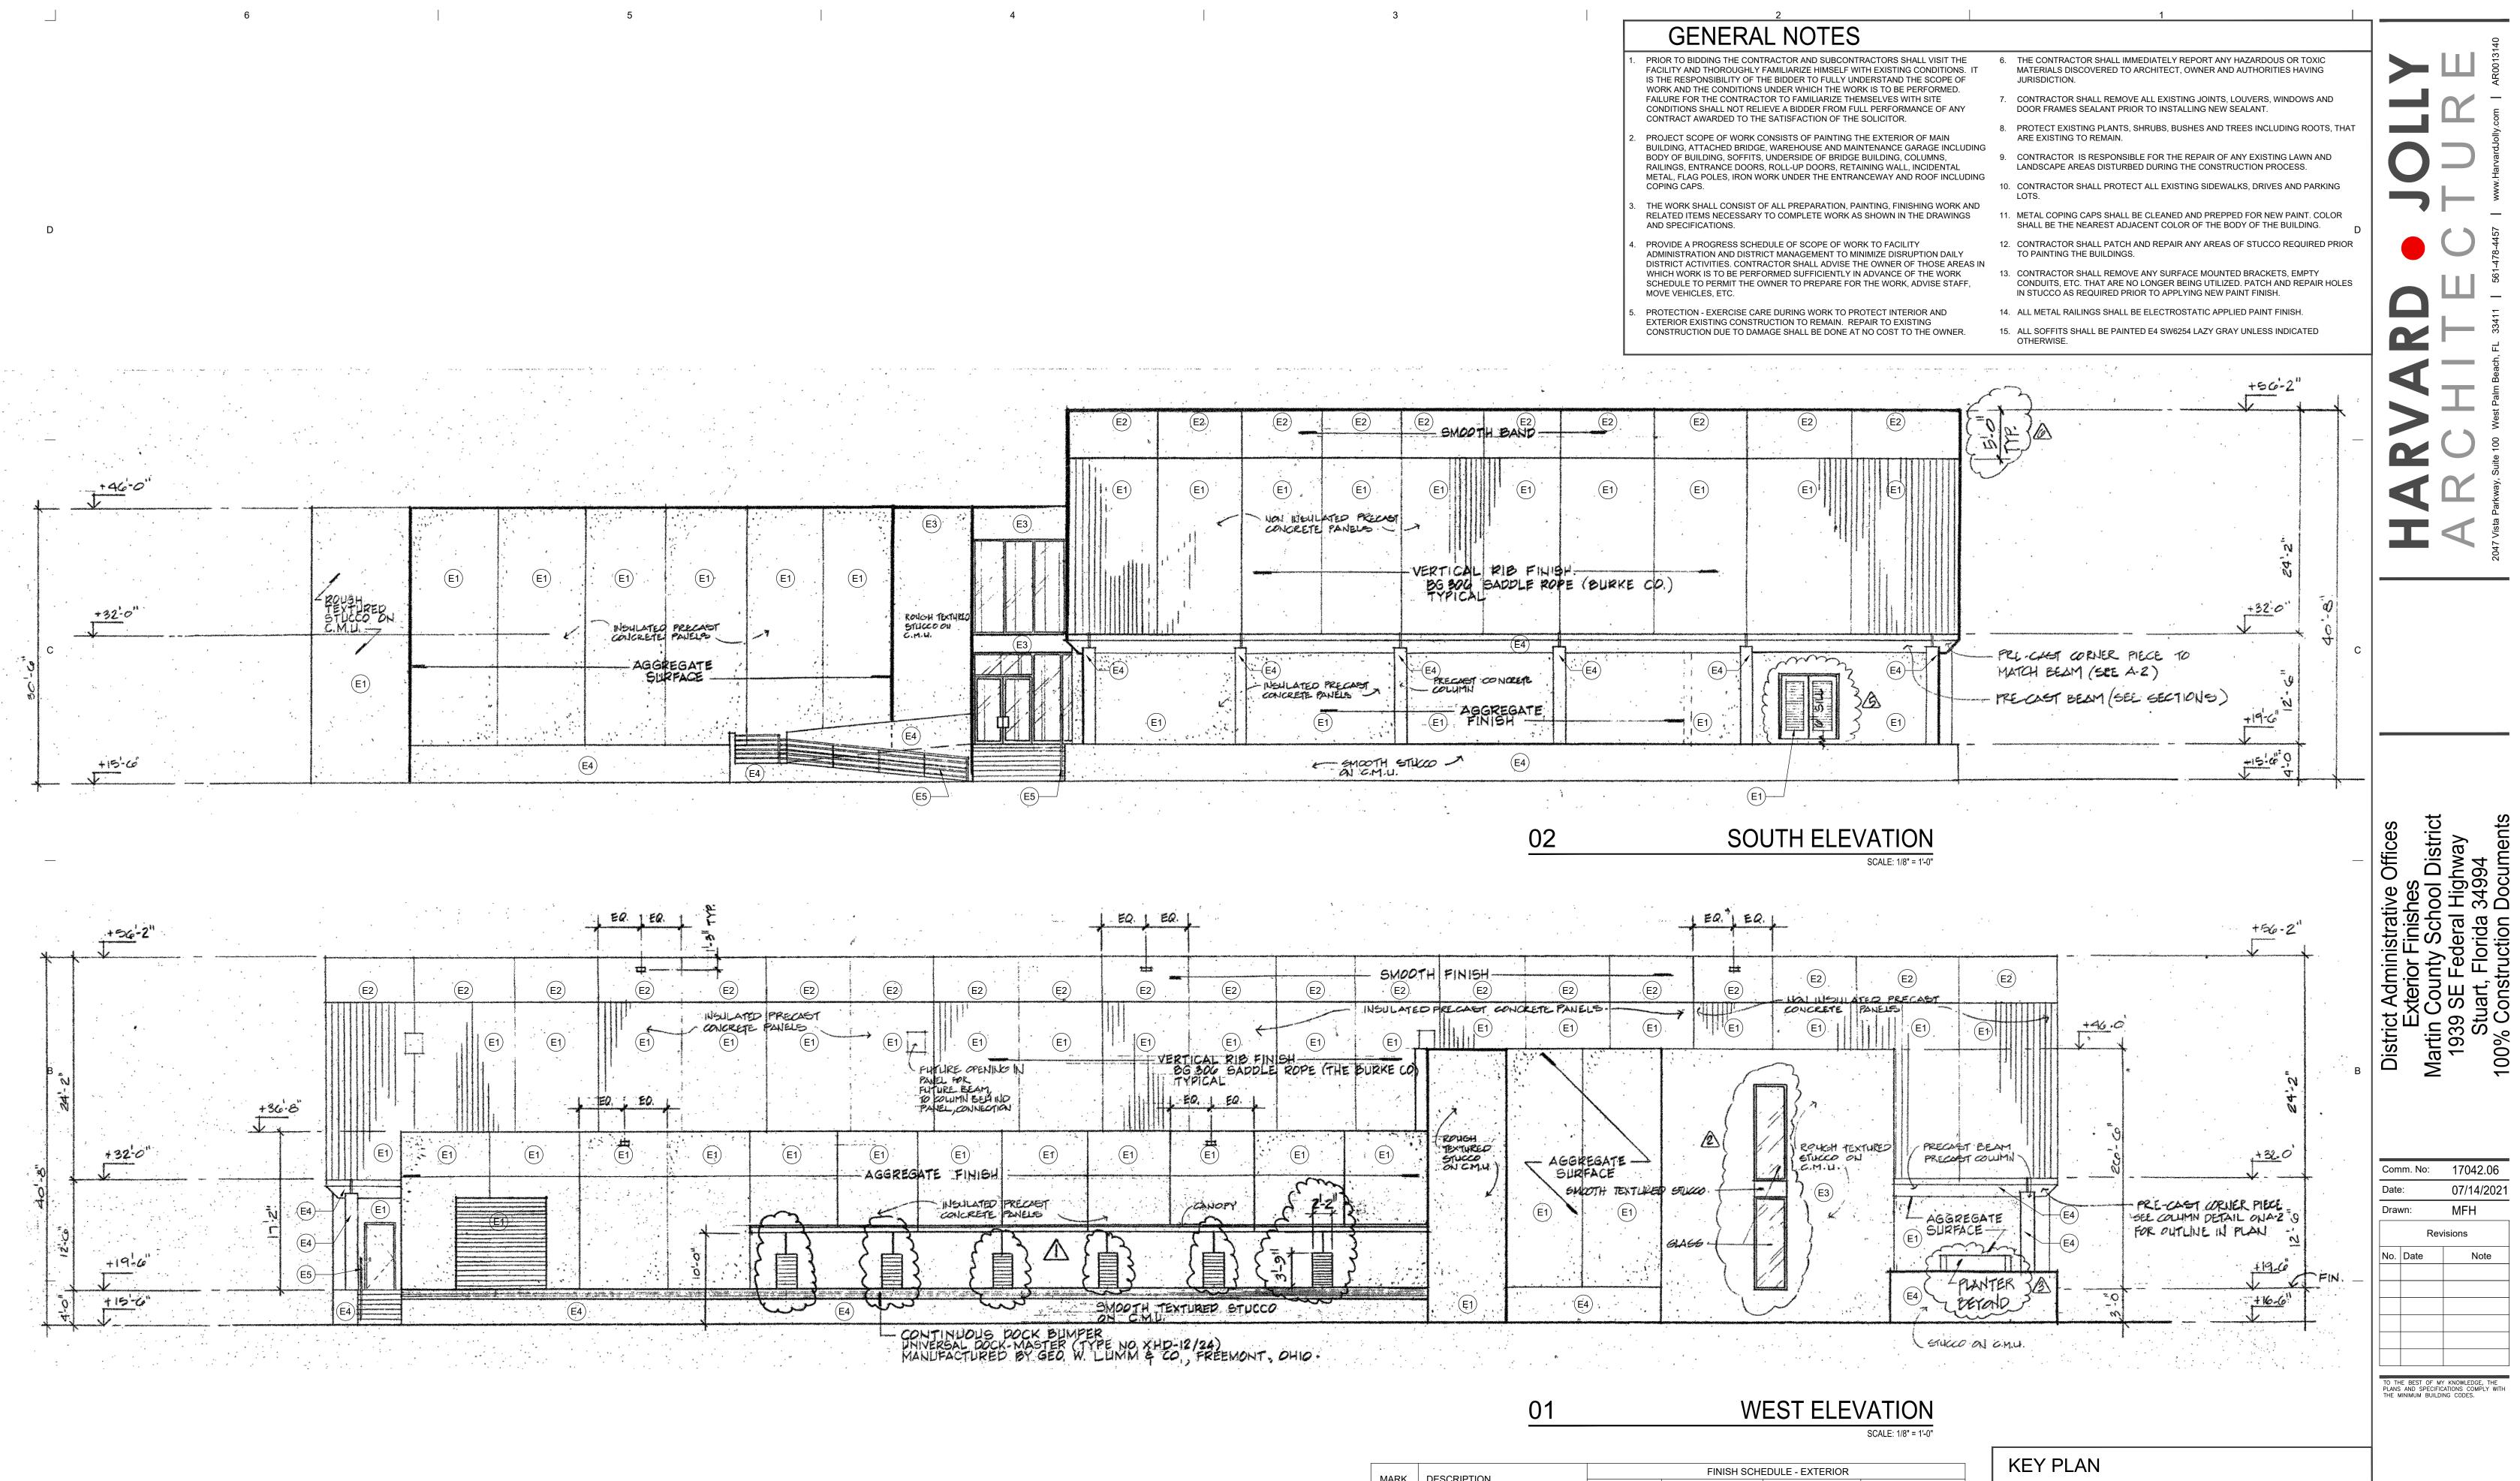

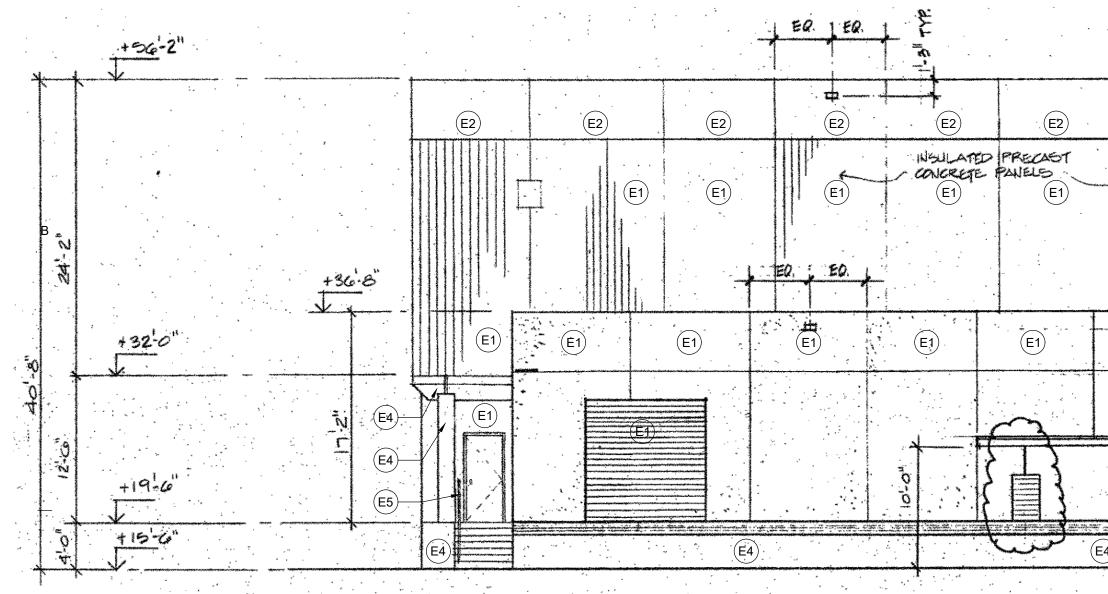


Α

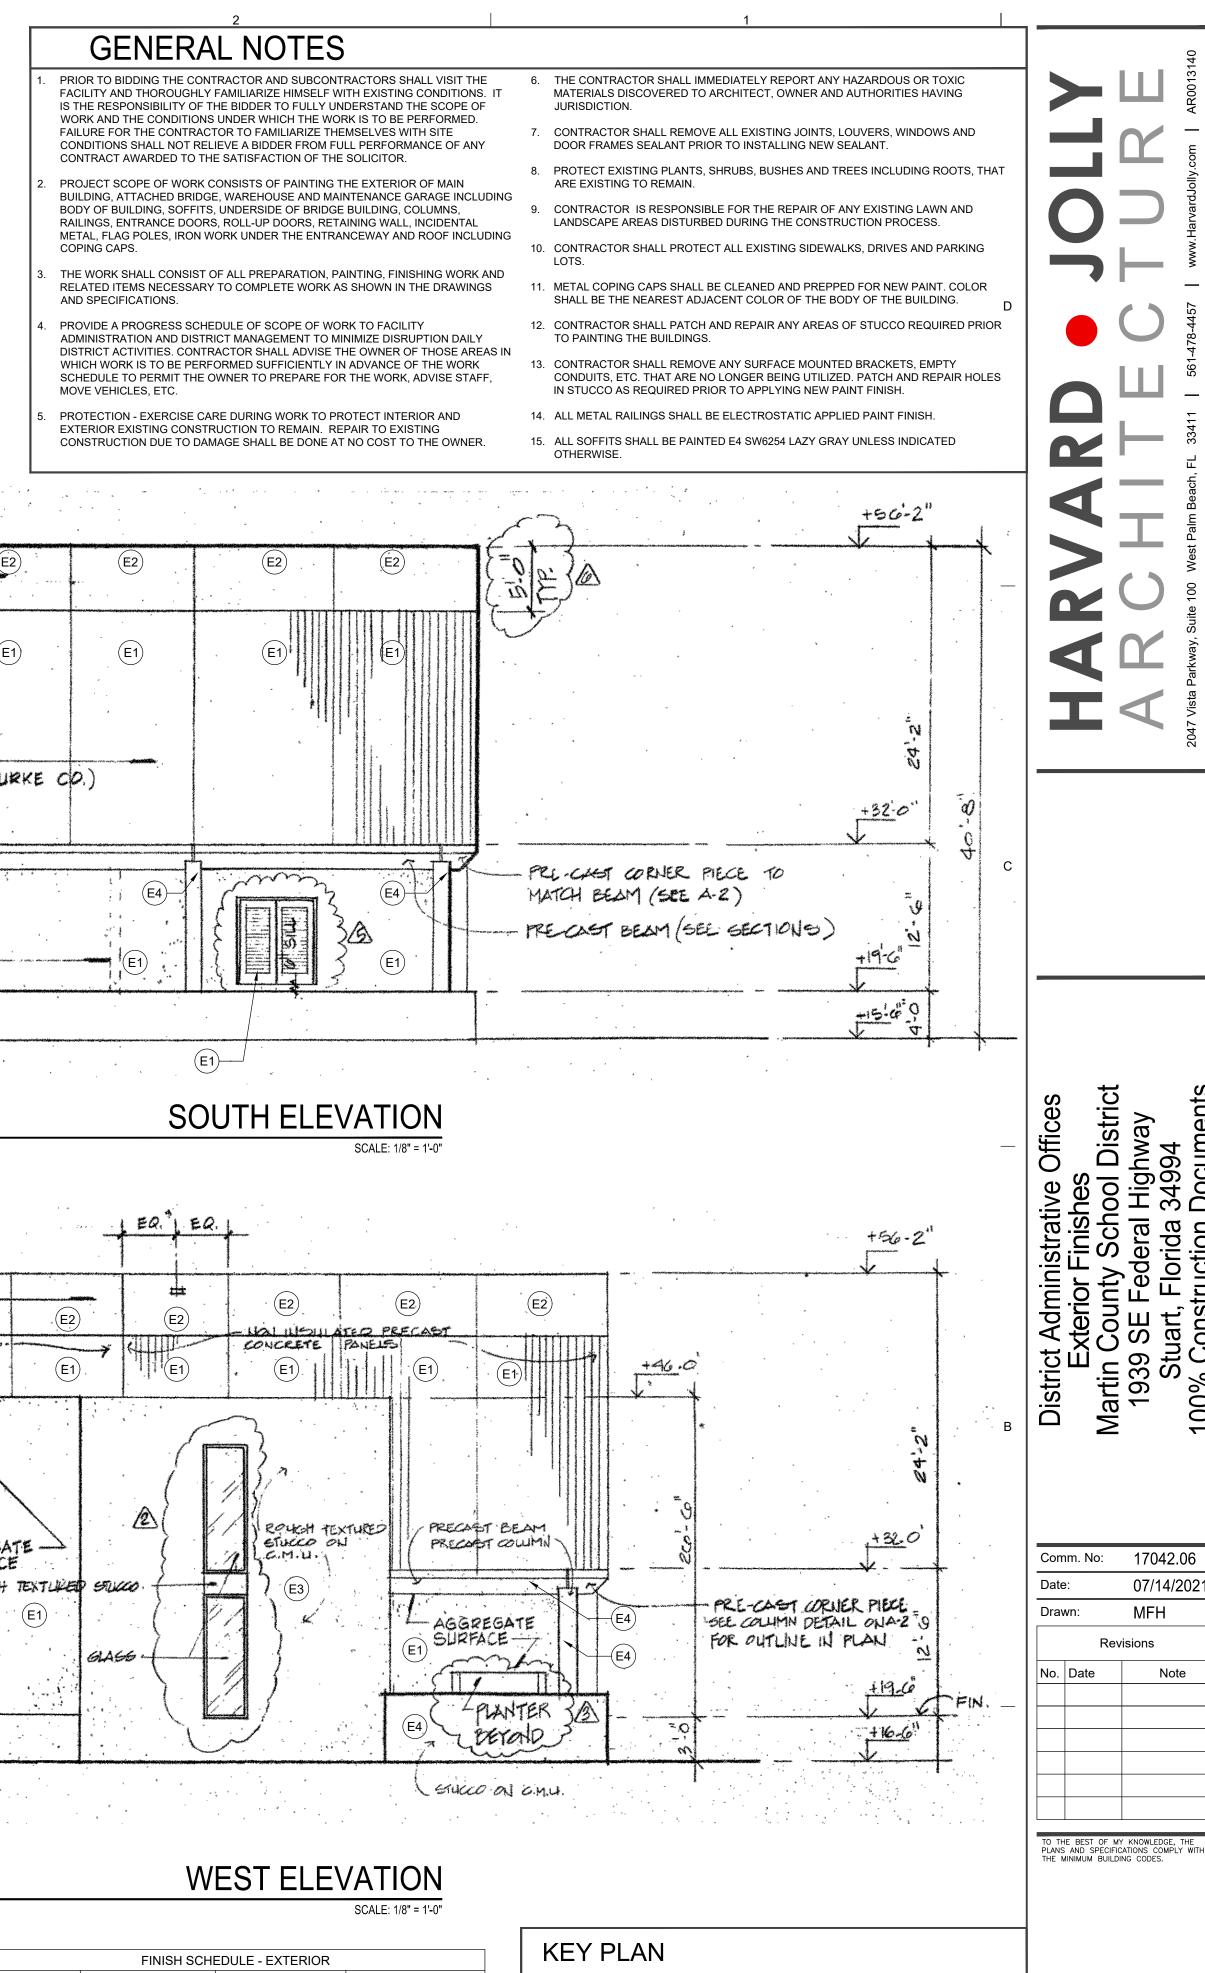


	FUTURE OPENIN PANEL FOR FUTURE BEAM, TO COLUMN BEAM, TO COLUMN BEAM, PANEL, CONNECTION	b		-BG 306 SAD TYPICAL -EO EO.	DLE ROPE (T)	IE BURKE CO					1	-
E1 AGGRE	E1 BATE FINISH	(E1)	E1	E1	E1)	E1)	TEXTURED STUCCO ON CM.4		EGATE -			/.
ÆS	INSULATED CONCRETE	PRECAST		CANOPY	C 22	<u> S</u>			oth textured (E1)	9 571400. f		
		$\mathbb{R}^{\Delta}$				2				GLASS .		
the		San	SMOOTH TH	EXTUREP. STU	000		Ę1	E4				


DESCRIPTION	FINISH SC				
DESCRIPTION	MANUF. B.O.D.	CATALOG NO.			
PAINT COLOR 1	SHERWIN WILLIAMS OR EQUAL	SW 6252			
PAINT COLOR 2	SHERWIN WILLIAMS OR EQUAL	SW 6254			
PAINT COLOR 3	SHERWIN WILLIAMS OR EQUAL	SW 6804			
PAINT COLOR 4	SHERWIN WILLIAMS OR EQUAL	SW 9161			
PAINT COLOR 5	SHERWIN WILLIAMS OR EQUAL	SW 6257			
	PAINT COLOR 2 PAINT COLOR 3 PAINT COLOR 4	MANUF. B.O.D.PAINT COLOR 1SHERWIN WILLIAMS OR EQUALPAINT COLOR 2SHERWIN WILLIAMS OR EQUALPAINT COLOR 3SHERWIN WILLIAMS OR EQUALPAINT COLOR 4SHERWIN WILLIAMS OR EQUALPAINT COLOR 5SHERWIN WILLIAMS OR EQUAL			



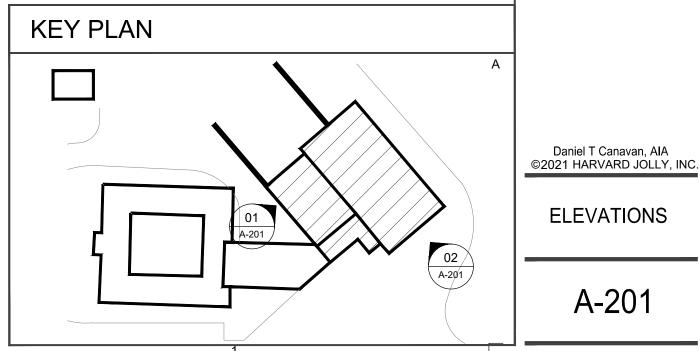

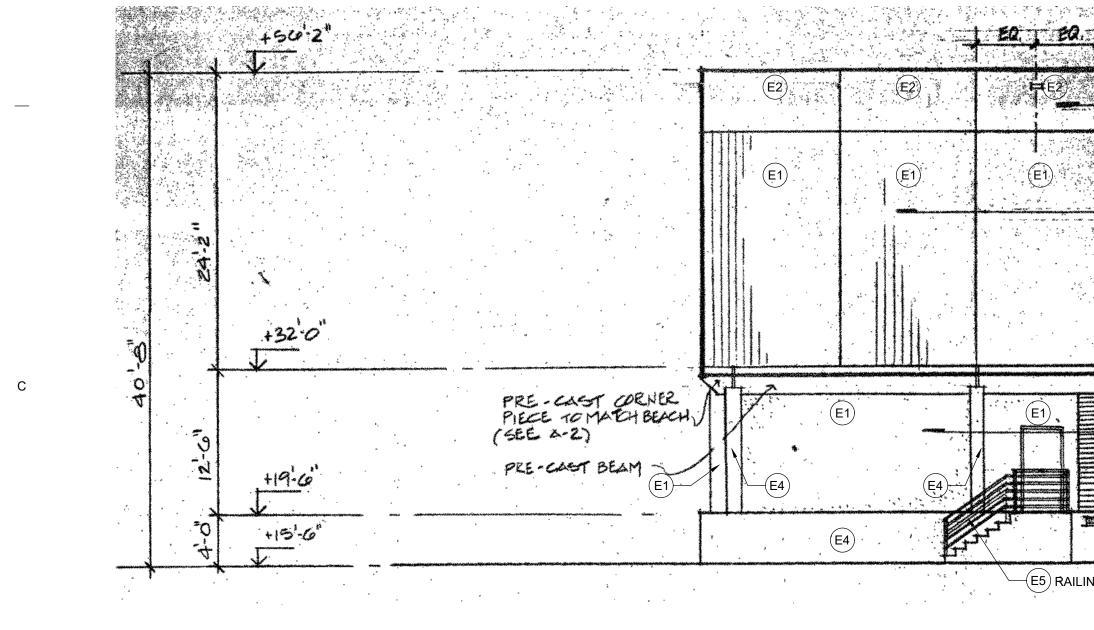

4

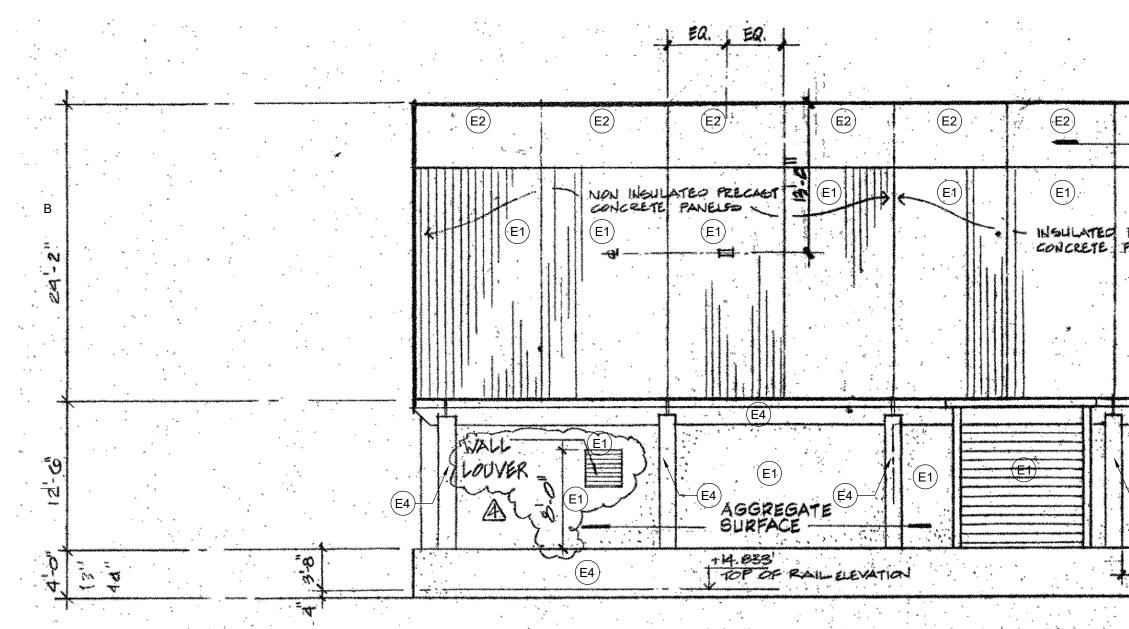

Α

D

5 3

MARK	DESCRIPTION		FINISH SCHEDULE - EXTERIOR					
IVIARN	DESCRIPTION	MANUF. B.O.D.	CATALOG NO.	COLOR	COMMON COLOR			
E1)	PAINT COLOR 1	SHERWIN WILLIAMS OR EQUAL	SW 6252	ICE CUBE	WHITE			
E2	PAINT COLOR 2	SHERWIN WILLIAMS OR EQUAL	SW 6254	LAZY GRAY	LIGHT GRAY			
E3	PAINT COLOR 3	SHERWIN WILLIAMS OR EQUAL	SW 6804	DIGNITY BLUE	BLUE			
E4)	PAINT COLOR 4	SHERWIN WILLIAMS OR EQUAL	SW 9161	DUSTBLU	MEDIUM GRAY			
E5	PAINT COLOR 5	SHERWIN		GIBRALTAR	DARK GRAY			


		+ EQ. + EQ. +				
E2	SMOOTH SURFACE -	E2	E2	E2		
EI)	E1 E1	E1 E1	E1 (	ĒĴ	1. EQ. 1 EQ. 1	
YEET	AL RIB SURFACE				E1 •	E1 E1
		CALCRETE PANEL		E1	<b>E</b> 1	E1 E1
	E4 E1 AGGREGATE FINISH	E1 INGULATED PRECASST				HOULATED CONCRETE
Deck Level	E4 EK STRATH TE	XTURED STUCCO	(E4) (			
- (E5) RAILINGS, TYPICAL		· · · · · · · · · · · · · · · · · · ·			E5	Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.Υ.
					02	NO

3

• •	EQ. EQ.					EQ. EQ.	<b></b>			•
E2	E2 H	E2	E2 SMOOTH	SURFACE	E2	ta (E2)	K. (E2)	E2	E2	E2
E1 PRECASST PANELOS	E1)		E1 VERTICAL BG 300 TYPICA	E1 BA	E1	EI) 2KE CO	E1 PRECAS CANOPY PRECAS	EI T CONCRETE ASSEMBLY CONCRETE DEAM		E1)
E4	E1 E4 EQ	- INSULATE	GATE E1,	EQ.		ET ET ET ET ET ET ET ET ET ET	E1		E1 E4	AGO SU EØ

3

01

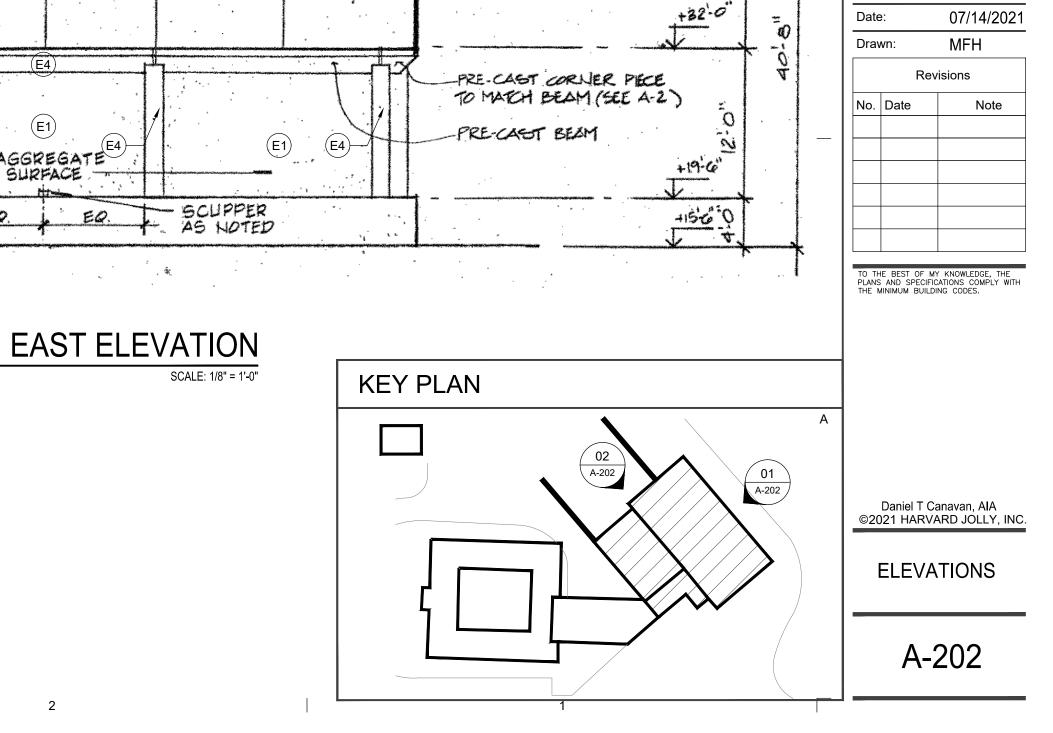

# ORTH ELEVATION SCALE: 1/8" = 1'-0"

EQ.

(E2)

(E1)

. man .....

\_ {


E2

(E1)

· · · .

~

L EQ.

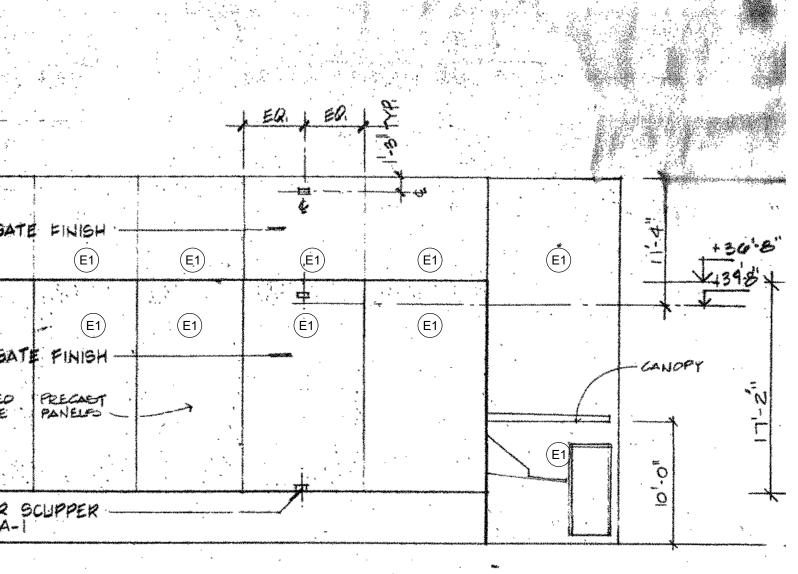

1.

(E2)

(E1)



С

Off


Φ

+56-2"

 $\Box$ 

District Administrative Exterior Finishes Martin County Schoo 1939 SE Federal Hig Stuart, Florida 34 200% Construction Do

Comm. No: 17042.06

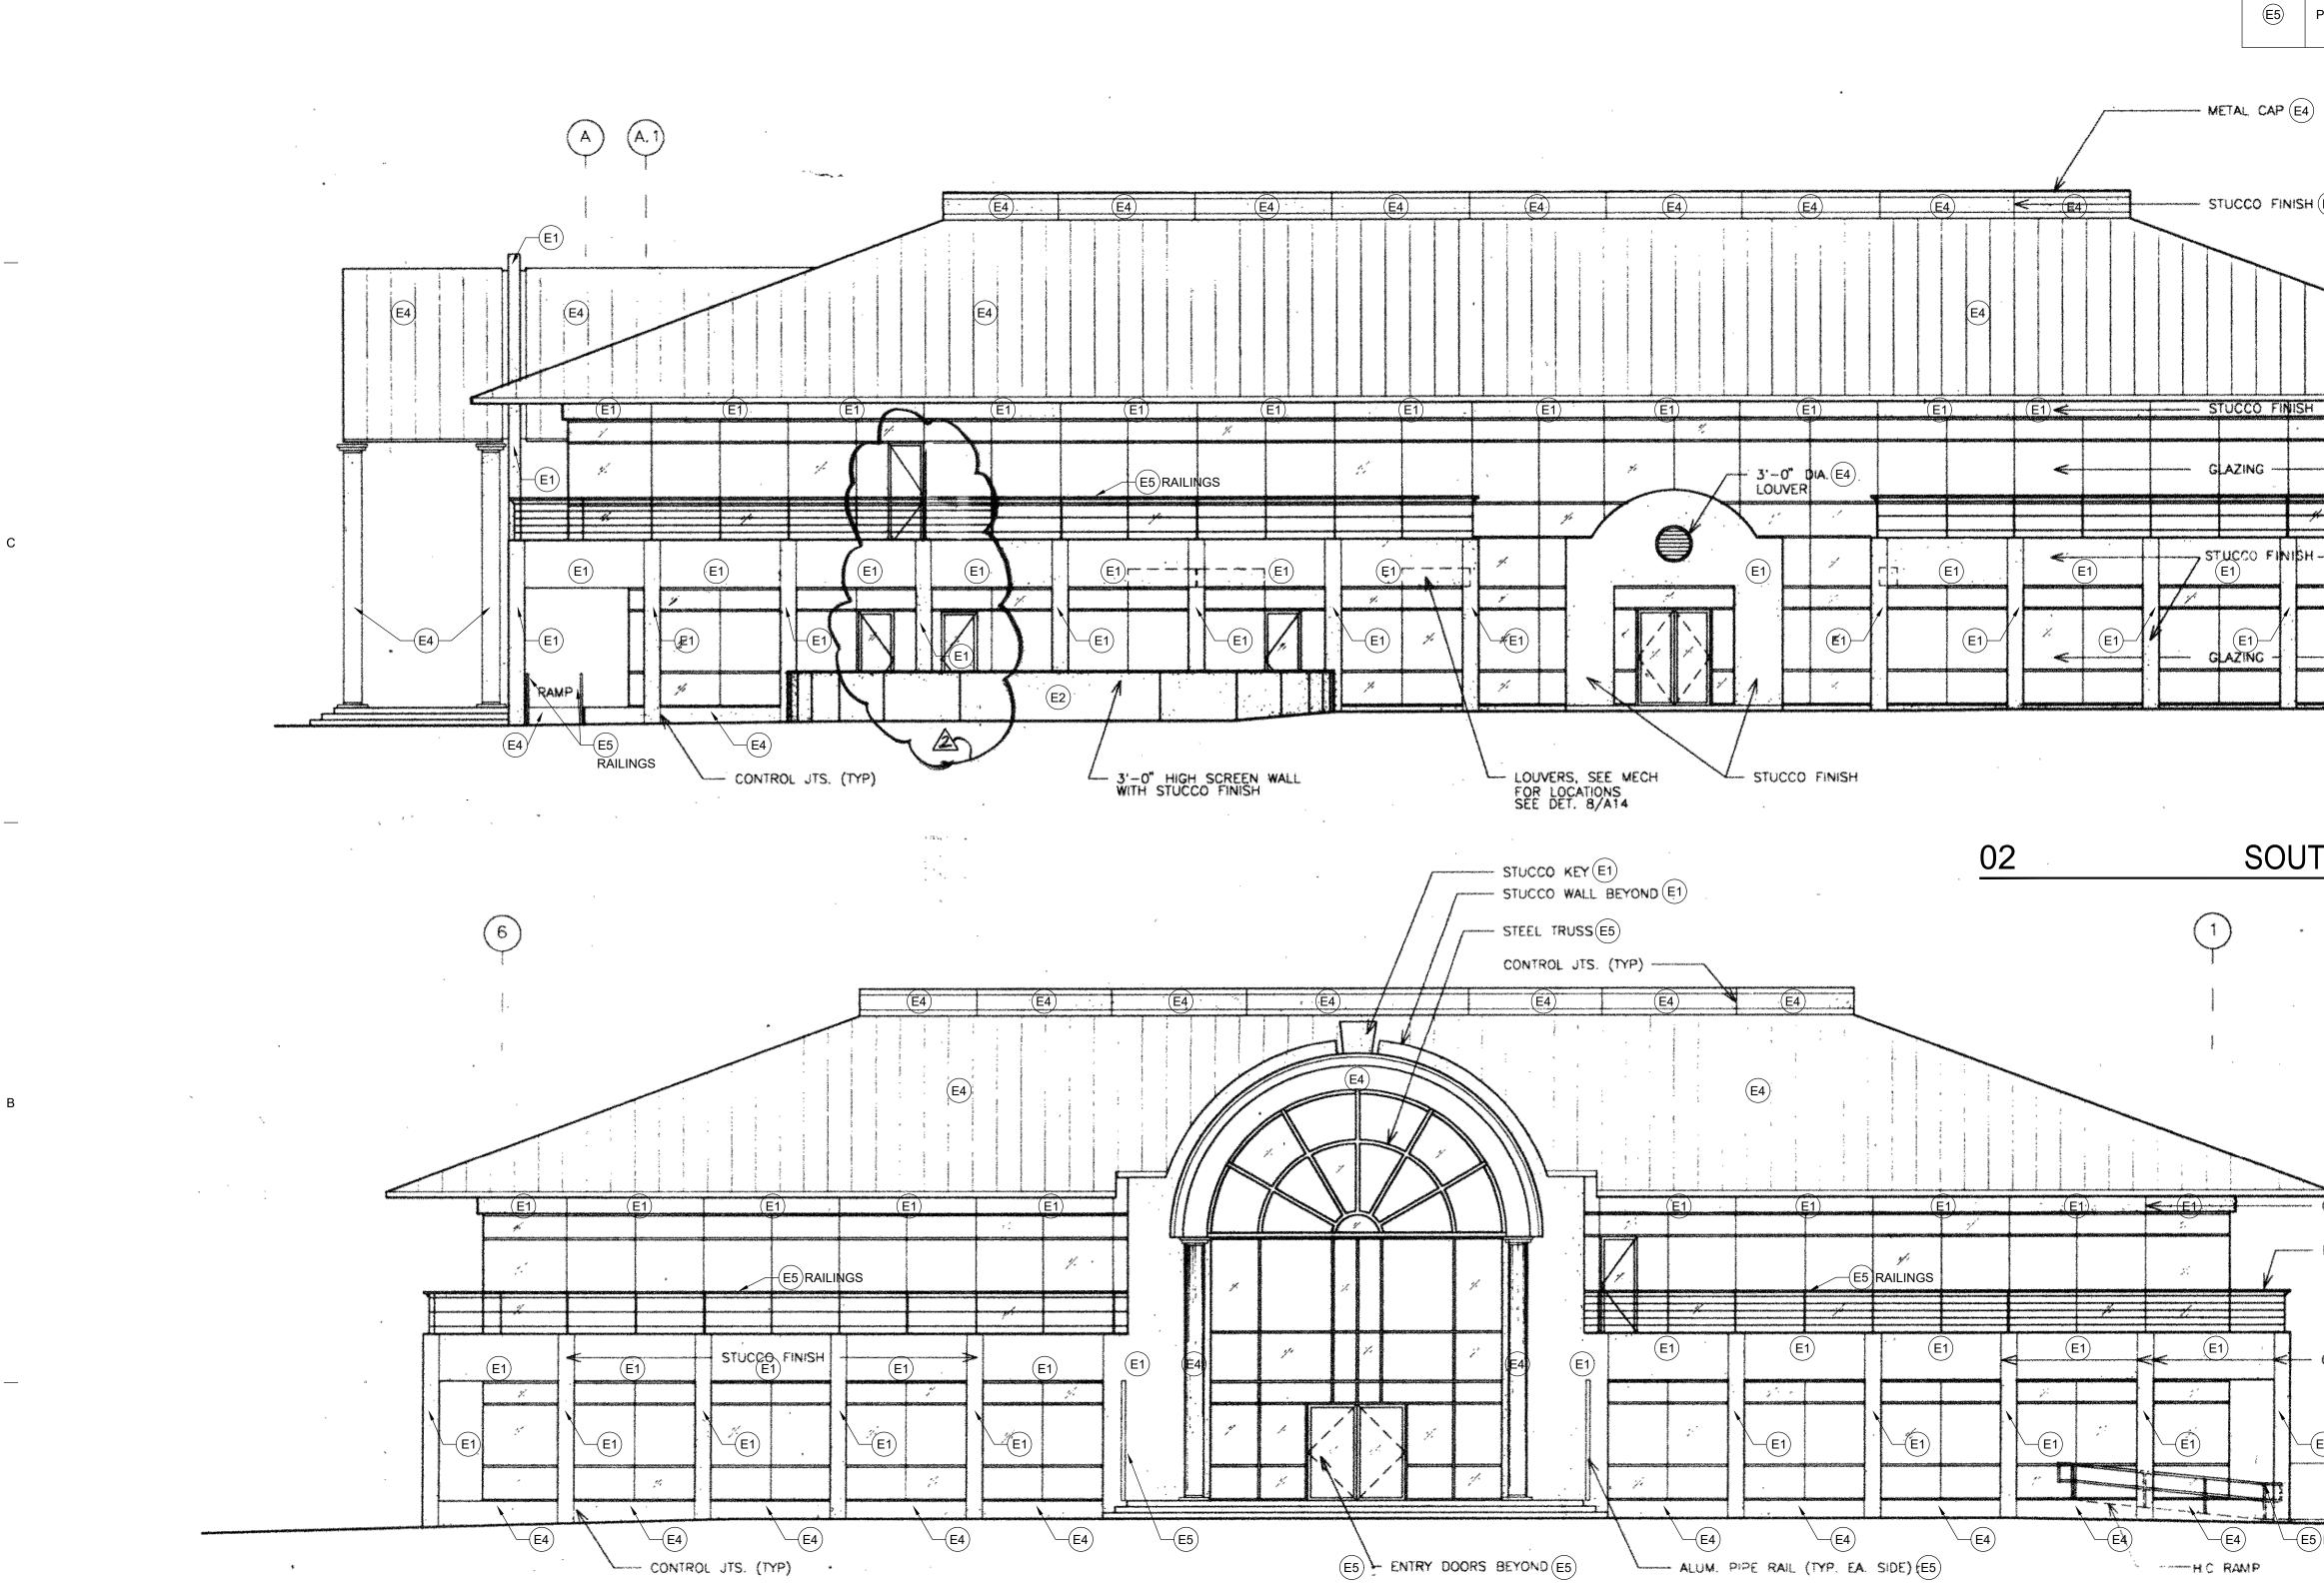

5

А

5



(E1)


WEST ELEVATION 01

|

3

4


	2			1				
		FINISH SCHEDULE - EXTERIOR						
MARK	DESCRIPTION	MANUF. B.O.D.	CATALOG NO.	COLOR	COMMON COLOR			
E1	PAINT COLOR 1	SHERWIN WILLIAMS OR EQUAL	SW 6252	ICE CUBE	WHITE			
E2	PAINT COLOR 2	SHERWIN WILLIAMS OR EQUAL	SW 6254	LAZY GRAY	LIGHT GRAY			
E3	PAINT COLOR 3	SHERWIN WILLIAMS OR EQUAL	SW 6804	DIGNITY BLUE	BLUE			
E4	PAINT COLOR 4	SHERWIN WILLIAMS OR EQUAL	SW 9161	DUSTBLU	MEDIUM GRAY	D		
E5	PAINT COLOR 5	SHERWIN WILLIAMS OR EQUAL	SW 6257	GIBRALTAR	DARK GRAY			
CAP	4 E				•			
) Finis	.H (E4)	STANDIN	G SEAM METAL R	OOF E4				
na de se de la compañía de la compa								

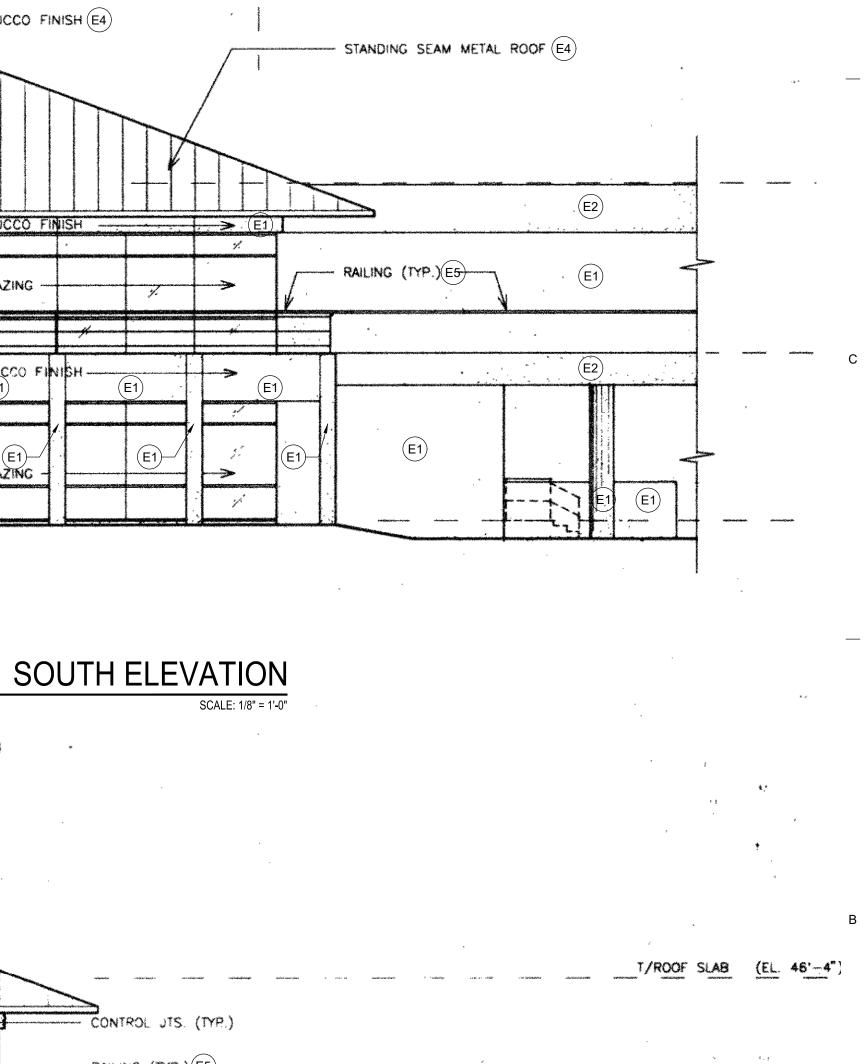


RAILING (TYP.) E5 SECOND FLOOR (EL. 32'-2" - CONTROL JTS. (TYP.) - 3'-0" HIGH SCREEN WALL WITH STUCCO FINISH -(E1) (E1) FIRST FLOOR (EL. 18'-2") ۰ Ŷ

SCALE: 1/8" = 1'-0"

2

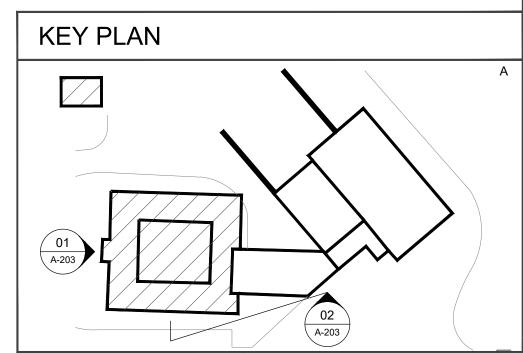


District Administrative Offices Exterior Finishes Martin County School District 1939 SE Federal Highway Stuart, Florida 34994 100% Construction Documents




TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE MINIMUM BUILDING CODES.

Daniel T Canavan, AlA ©2021 HARVARD JOLLY, INC.

ELEVATIONS

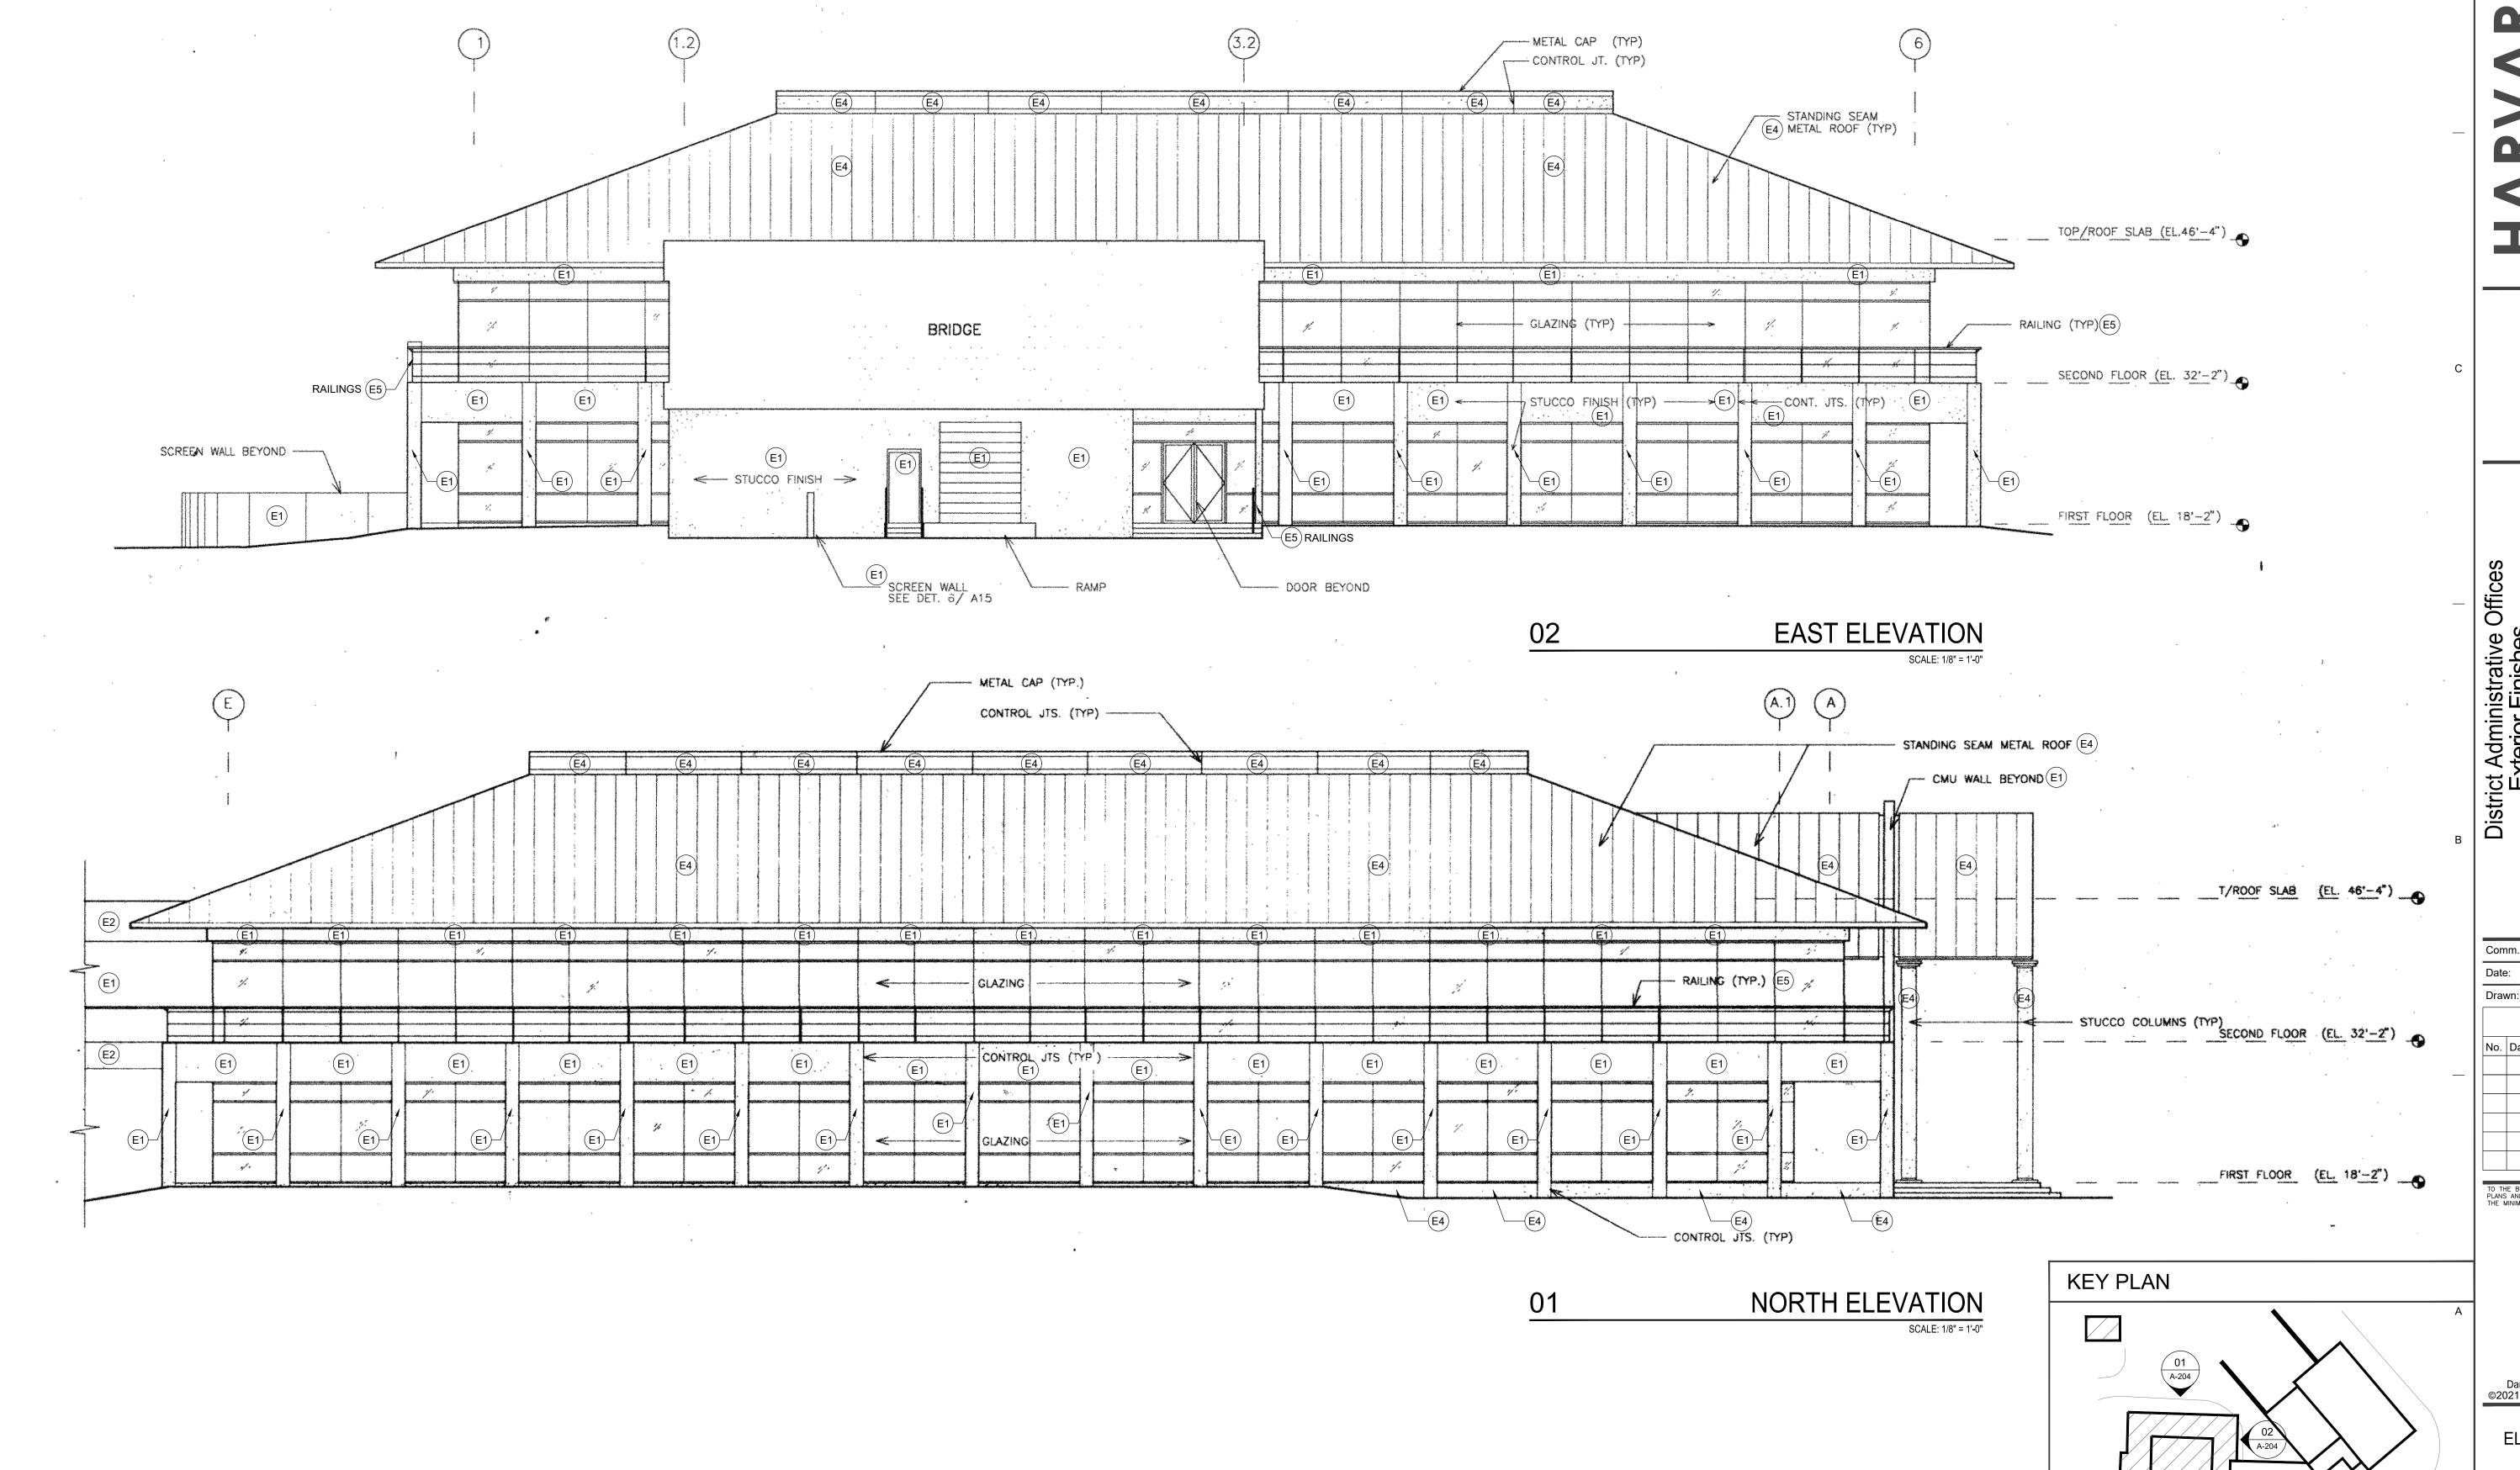

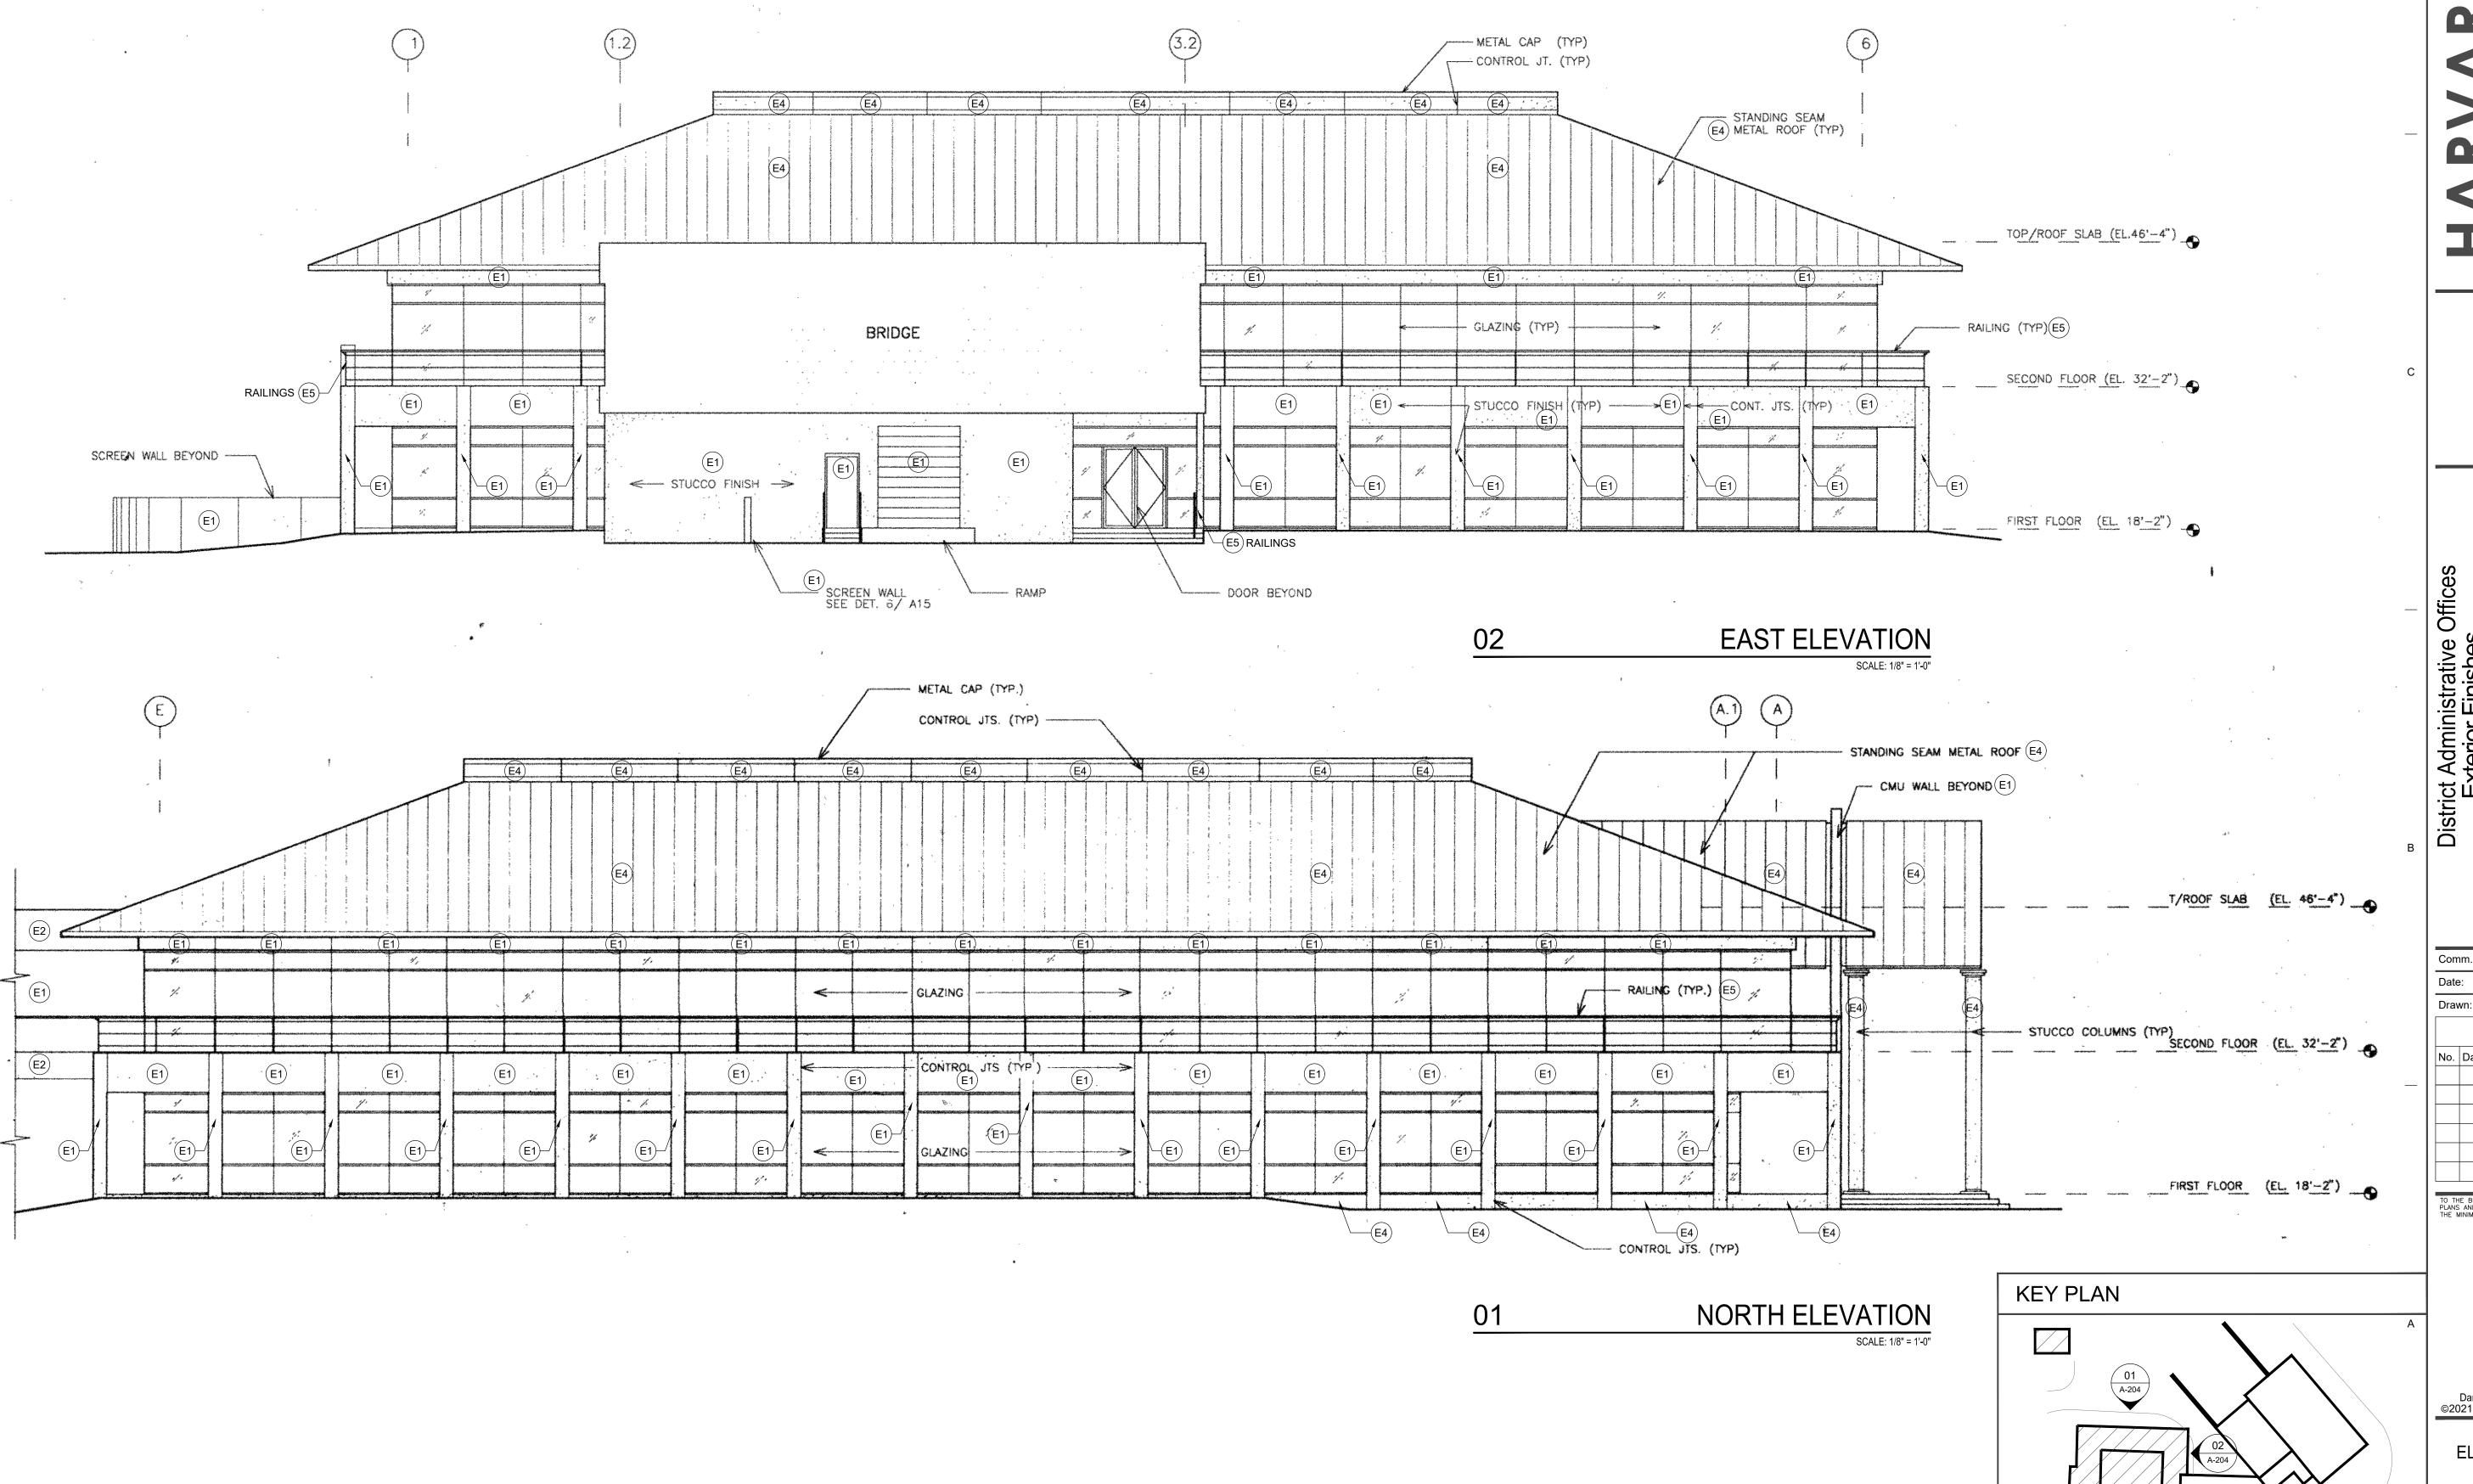


р

Α

5

5

4



2

3

4

PAINT COLOR 3		SHERWIN WILLIAMS OR EQUAL	SW 6804	DIGNITY BLUE	BLUE
PAINT COLOR 4		SHERWIN WILLIAMS OR EQUAL	SW 9161	DUSTBLU	MEDIUM G
PAINT COLOR 5		SHERWIN WILLIAMS OR EQUAL	SW 6257	GIBRALTAR	DARK GRA
	( <u>6</u> )				
	<b>V</b> estioner				

DESCRIPTION	FINISH SCHEDULE - EXTERIOR						
DESCRIPTION	MANUF. B.O.D.	CATALOG NO.	COLOR	COMMON COLOR			
PAINT COLOR 1	SHERWIN WILLIAMS OR EQUAL	SW 6252	ICE CUBE	WHITE			
PAINT COLOR 2	SHERWIN WILLIAMS OR EQUAL	SW 6254	LAZY GRAY	LIGHT GRAY			
PAINT COLOR 3	SHERWIN WILLIAMS OR EQUAL	SW 6804	DIGNITY BLUE	BLUE			
PAINT COLOR 4	SHERWIN WILLIAMS OR EQUAL	SW 9161	DUSTBLU	MEDIUM GRAY			
PAINT COLOR 5	SHERWIN WILLIAMS OR EQUAL	SW 6257	GIBRALTAR	DARK GRAY			

Т


District Administrative Offices Exterior Finishes Martin County School District 1939 SE Federal Highway Stuart, Florida 34994 100% Construction Documents

Comm. No: 17042.06 07/14/2021 MFH Drawn: Revisions No. Date Note

TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE MINIMUM BUILDING CODES.

Daniel T Canavan, AIA ©2021 HARVARD JOLLY, INC.

ELEVATIONS

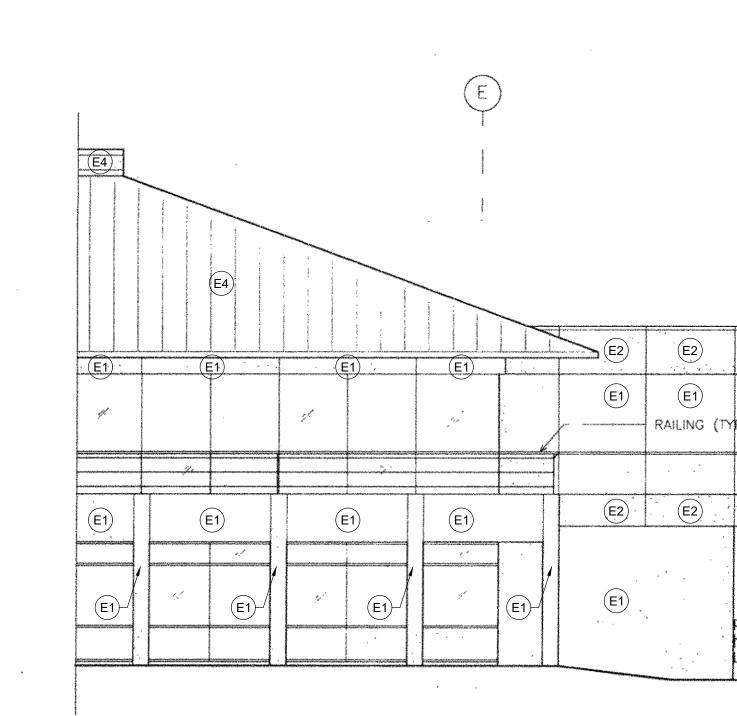

.

(E2) E2 (E2) . 11. 1 1 EXISTING BLDG. LINE "(E1) E1 E1 **E**1 (E2) (E2) (E2) E1) E1

(E1)

D

С

В

\_\_\_\_

Α

E5

· (E1)-/

.

| 5

(E2)

(E2)

MARK	DESCRIPTION		FINISH SCHEDULE - EXTERIOR			
		MANUF. B.O.D.	CATALOG NO.	COLOR	COMMON COLOR	
E1	PAINT COLOR 1	SHERWIN WILLIAMS OR EQUAL	SW 6252	ICE CUBE	WHITE	
E2	PAINT COLOR 2	SHERWIN WILLIAMS OR EQUAL	SW 6254	LAZY GRAY	LIGHT GRAY	
E3	PAINT COLOR 3	SHERWIN WILLIAMS OR EQUAL	SW 6804	DIGNITY BLUE	BLUE	
E4	PAINT COLOR 4	SHERWIN WILLIAMS OR EQUAL	SW 9161	DUSTBLU	MEDIUM GRAY	
E5	PAINT COLOR 5	SHERWIN WILLIAMS OR EQUAL	SW 6257	GIBRALTAR	DARK GRAY	

	F												
		•		co	NTROL JTS	S. (TYP)							
	E2	E2	E2	E2		E2	) , , , , , , , , , , , , , , , , , , ,		E2		E2	E2	E2
YP.	E1 )E5	E1	E1	E1 ST	UCCO FINIS	SH (TYP)			<u>(E1)</u>		E1	E1 *	
	E2		E2	(E2)				a I	(E2)				(Eź
		E2 SCREEN WASEE DET. 6	E2 $E_{1}$ $A_{15}$ E1 $R_{1}$ (EL. 18'-2")	ŚTU	JCCO BANE JCCO FINIS NC. COLUM		(E1)-/				E1	E2	
		JEE MECH	*						<u>0</u>	2			SOL
,	(	~						$\sim$					<b>`</b>
		(H)		G			(	(F)					
		H H I		G   			(	F					


3

4

01

2

4 3

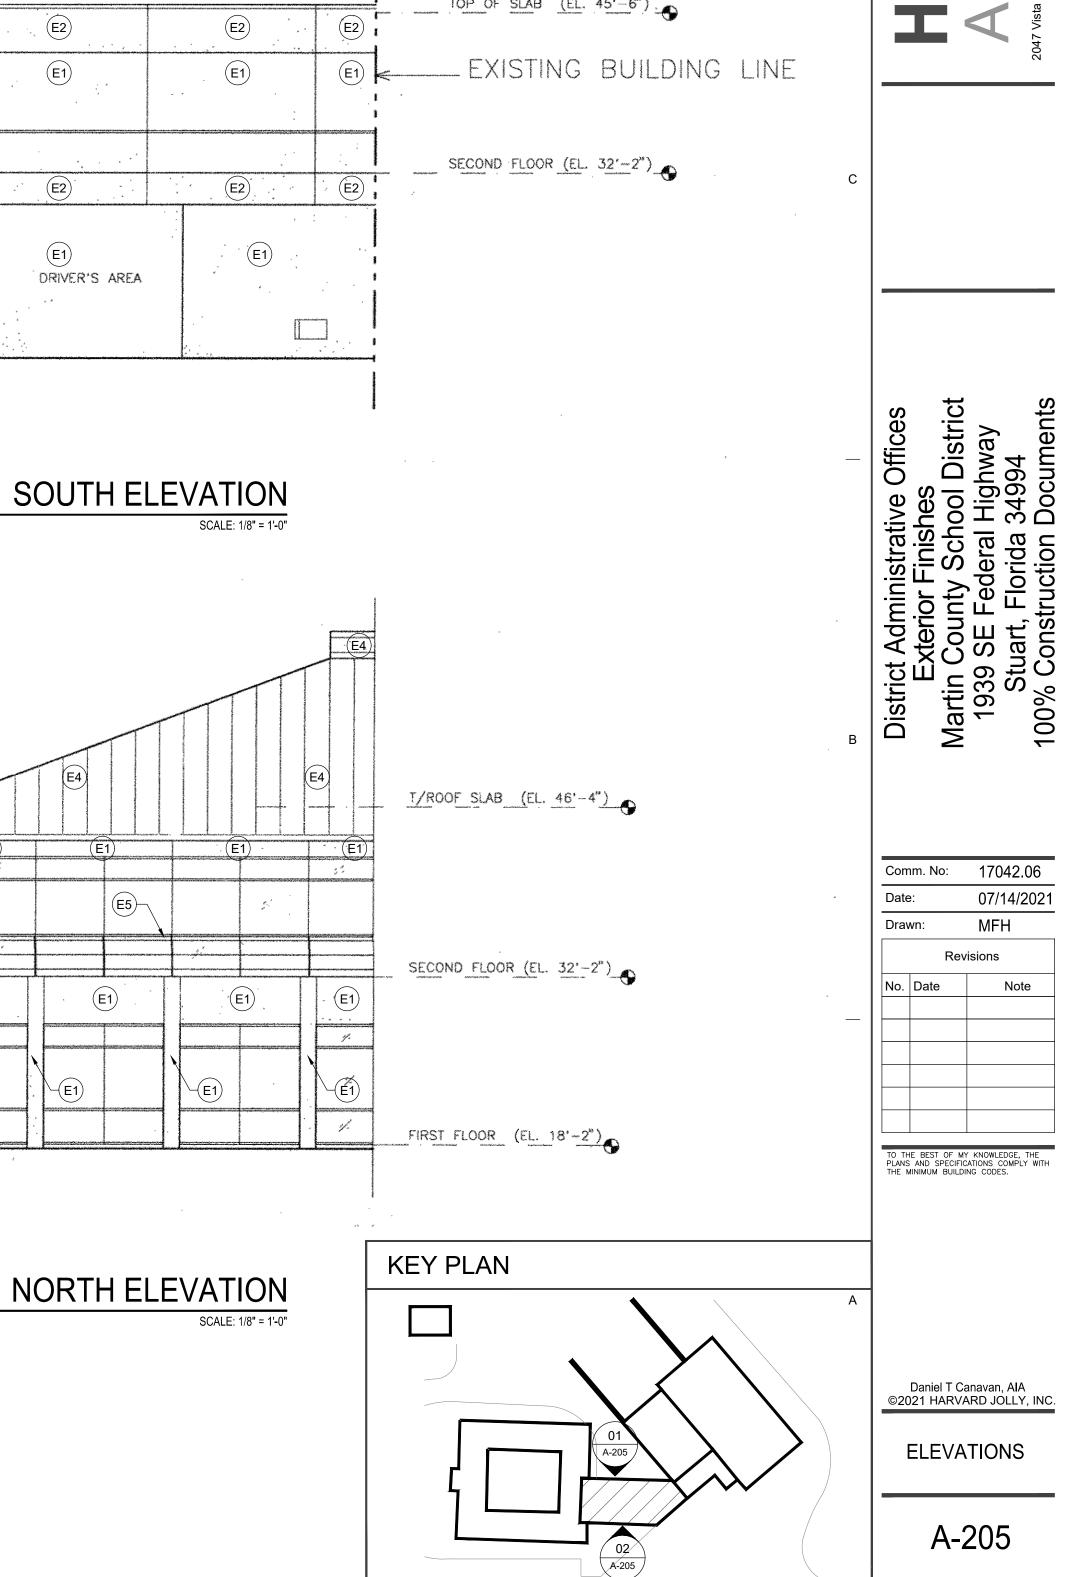

TOP OF SLAB (EL. 45'-6")



3

4

5

D

С

В

Α

6



04



03

5

NORTH ELEVATION SCALE: 1/8" = 1'-0"

NORTH ELEVATION SCALE: 1/8" = 1'-0"



4



- COPING CAPS.
- AND SPECIFICATIONS.
- MOVE VEHICLES, ETC.



02



01

MARK	DESCRIPTION		FINISH SCHEDULE - EXTE			
IVIANN	DESCRIPTION	MANUF. B.O.D.	CATALOG NO.	COLOR		
E1)	PAINT COLOR 1	SHERWIN WILLIAMS OR EQUAL	SW 6252	ICE CUBE		
E2	PAINT COLOR 2	SHERWIN WILLIAMS OR EQUAL	SW 6254	LAZY GRAY		
E3	PAINT COLOR 3	SHERWIN WILLIAMS OR EQUAL	SW 6804	DIGNITY BLU		
E4	PAINT COLOR 4	SHERWIN WILLIAMS OR EQUAL	SW 9161	DUSTBLU		
E5	PAINT COLOR 5	SHERWIN WILLIAMS OR EQUAL	SW 6257	GIBRALTAR		

3

٩L	NO	TES
٩L	NO	TES

PRIOR TO BIDDING THE CONTRACTOR AND SUBCONTRACTORS SHALL VISIT THE FACILITY AND THOROUGHLY FAMILIARIZE HIMSELF WITH EXISTING CONDITIONS. IT IS THE RESPONSIBILITY OF THE BIDDER TO FULLY UNDERSTAND THE SCOPE OF WORK AND THE CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED. FAILURE FOR THE CONTRACTOR TO FAMILIARIZE THEMSELVES WITH SITE CONDITIONS SHALL NOT RELIEVE A BIDDER FROM FULL PERFORMANCE OF ANY CONTRACT AWARDED TO THE SATISFACTION OF THE SOLICITOR.

PROJECT SCOPE OF WORK CONSISTS OF PAINTING THE EXTERIOR OF MAIN BUILDING, ATTACHED BRIDGE, WAREHOUSE AND MAINTENANCE GARAGE INCLUDING BODY OF BUILDING, SOFFITS, UNDERSIDE OF BRIDGE BUILDING, COLUMNS, RAILINGS, ENTRANCE DOORS, ROLL-UP DOORS, RETAINING WALL, INCIDENTAL METAL, FLAG POLES, IRON WORK UNDER THE ENTRANCEWAY AND ROOF INCLUDING

THE WORK SHALL CONSIST OF ALL PREPARATION, PAINTING, FINISHING WORK AND RELATED ITEMS NECESSARY TO COMPLETE WORK AS SHOWN IN THE DRAWINGS

PROVIDE A PROGRESS SCHEDULE OF SCOPE OF WORK TO FACILITY ADMINISTRATION AND DISTRICT MANAGEMENT TO MINIMIZE DISRUPTION DAILY DISTRICT ACTIVITIES. CONTRACTOR SHALL ADVISE THE OWNER OF THOSE AREAS IN WHICH WORK IS TO BE PERFORMED SUFFICIENTLY IN ADVANCE OF THE WORK SCHEDULE TO PERMIT THE OWNER TO PREPARE FOR THE WORK, ADVISE STAFF,

PROTECTION - EXERCISE CARE DURING WORK TO PROTECT INTERIOR AND EXTERIOR EXISTING CONSTRUCTION TO REMAIN. REPAIR TO EXISTING CONSTRUCTION DUE TO DAMAGE SHALL BE DONE AT NO COST TO THE OWNER. 6. THE CONTRACTOR SHALL IMMEDIATELY REPORT ANY HAZARDOUS OR TOXIC MATERIALS DISCOVERED TO ARCHITECT, OWNER AND AUTHORITIES HAVING JURISDICTION. 7. CONTRACTOR SHALL REMOVE ALL EXISTING JOINTS, LOUVERS, WINDOWS AND

- DOOR FRAMES SEALANT PRIOR TO INSTALLING NEW SEALANT.
- 8. PROTECT EXISTING PLANTS, SHRUBS, BUSHES AND TREES INCLUDING ROOTS, THAT ARE EXISTING TO REMAIN.
- 9. CONTRACTOR IS RESPONSIBLE FOR THE REPAIR OF ANY EXISTING LAWN AND LANDSCAPE AREAS DISTURBED DURING THE CONSTRUCTION PROCESS.
- 10. CONTRACTOR SHALL PROTECT ALL EXISTING SIDEWALKS, DRIVES AND PARKING LOTS.

11. METAL COPING CAPS SHALL BE CLEANED AND PREPPED FOR NEW PAINT. COLOR SHALL BE THE NEAREST ADJACENT COLOR OF THE BODY OF THE BUILDING.


- 12. CONTRACTOR SHALL PATCH AND REPAIR ANY AREAS OF STUCCO REQUIRED PRIOR TO PAINTING THE BUILDINGS. 13. CONTRACTOR SHALL REMOVE ANY SURFACE MOUNTED BRACKETS, EMPTY CONDUITS, ETC. THAT ARE NO LONGER BEING UTILIZED. PATCH AND REPAIR HOLES
- IN STUCCO AS REQUIRED PRIOR TO APPLYING NEW PAINT FINISH. 14. ALL METAL RAILINGS SHALL BE ELECTROSTATIC APPLIED PAINT FINISH.
- 15. ALL SOFFITS SHALL BE PAINTED E4 SW6254 LAZY GRAY UNLESS INDICATED OTHERWISE.

# SOUTH ELEVATION SCALE: 1/8" = 1'-0"

# EAST ELEVATION SCALE: 1/8" = 1'-0"

		_			
IOR					
	COMMON COLOR			А	
	WHITE	03 A-206			
	LIGHT GRAY		02 A-206		©20
-	BLUE				E
	MEDIUM GRAY				
	DARK GRAY				
	1				

>	Ш	AR001314(
	2	Jolly.com
0		www.HarvardJolly.com
	$\mathbf{O}$	—
	Ш	11   561-4
2		each, FL 334
<b>N</b>	Т	West Palm Be
2	0	ly, Suite 100
<b>H</b>	A A	2047 Vista Parkway, Suite 100 West Palm Beach, FL 33411   561-478-4457
		2047

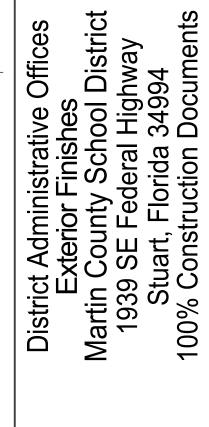

Comm. No: 17042.06   Date: 07/14/202*   Drawn: MFH   Revisions   No. Date   No. Date   No. Date   No. Date   0 0   0 0   0 0   0 0   0 0   0 0   0 0   0 0   0 0   0 0   0 0			
Drawn: MFH Revisions	Com	ım. No:	17042.06
Revisions	Date	Date: 07/14/202	
	Drav	Drawn: MFH	
No. Date Note Note		Rev	isions
	No.	Date	Note

TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE MINIMUM BUILDING CODES.

Daniel T Canavan, AIA 021 HARVARD JOLLY, INC.

ELEVATIONS



5

06




D

\_\_\_\_\_

А

6

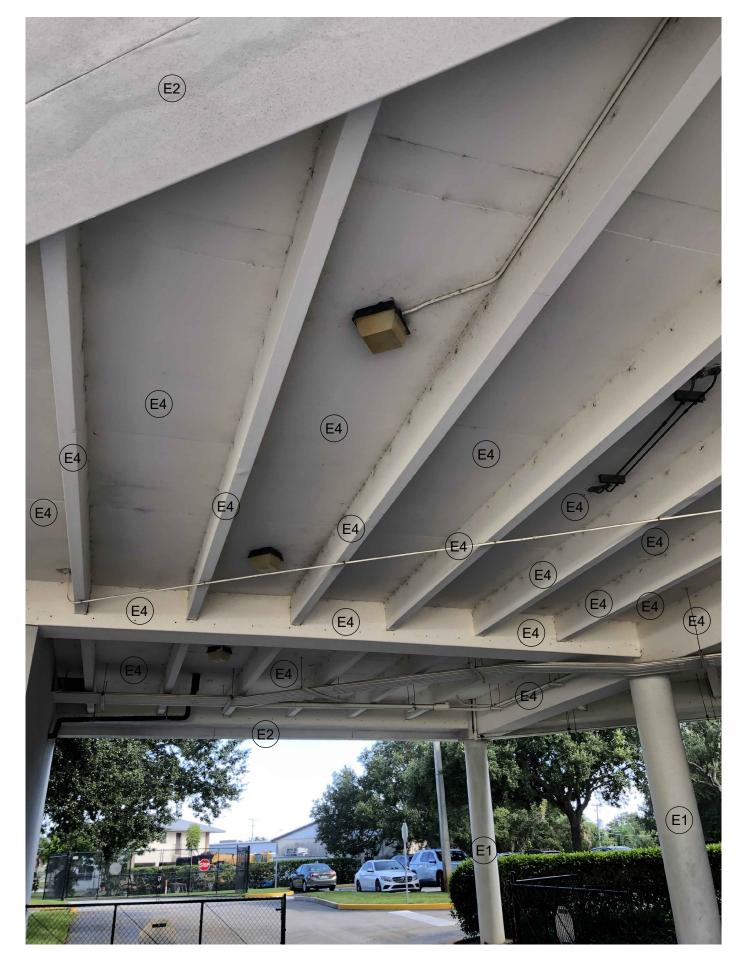

BRIDGE SCALE: NTS 04

5

03

| 4

RETAINING WALL SCALE: NTS TYPICAL FOR ALL EXPOSED SIDES OF RETAINING WALL

4



2

BRIDGE SCALE: NTS



02

3


3

BRIDGE SCALE: NTS

MARK	DECODIDITION	FINISH SCHEDULE - EXTERIOR				
WARK	DESCRIPTION	MANUF. B.O.D.	CATALOG NO.	COLOR	COMMON COLOR	
E1)	PAINT COLOR 1	SHERWIN WILLIAMS OR EQUAL	SW 6252	ICE CUBE	WHITE	
E2	PAINT COLOR 2	SHERWIN WILLIAMS OR EQUAL	SW 6254	LAZY GRAY	LIGHT GRAY	
E3	PAINT COLOR 3	SHERWIN WILLIAMS OR EQUAL	SW 6804	DIGNITY BLUE	BLUE	
E4	PAINT COLOR 4	SHERWIN WILLIAMS OR EQUAL	SW 9161	DUSTBLU	MEDIUM GRAY	
E5	PAINT COLOR 5	SHERWIN WILLIAMS OR EQUAL	SW 6257	GIBRALTAR	DARK GRAY	

05 RETAIN TYPICAL FOR ALL EXPOSED SIDES OF RETAINING WALL **RETAINING WALL A** SCALE: NTS



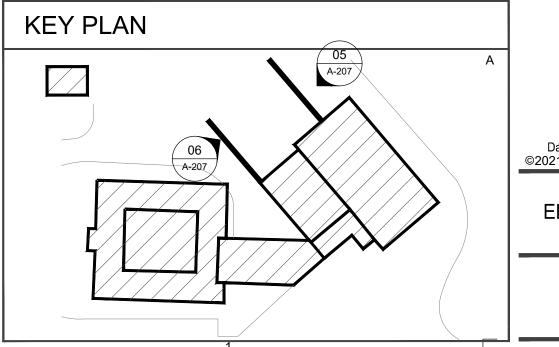

Highway 4994 ocuments Offic  $\square$ e ( es Martin County Schoo 1939 SE Federal Hi Stuart, Florida 34 100% Construction Do District Comm. No: 17042.06 07/14/2021 Date: MFH Drawn: Revisions No. Date Note TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE MINIMUM BUILDING CODES.

I

Daniel T Canavan, AIA ©2021 HARVARD JOLLY, INC.

ELEVATIONS

2