


Addendum #2

- 1) The drawings refer to a fully automated filter system. The specs call out for a BECS backwash control system. This system is not a stand-alone system and needs a BECS 7 chemical controller to operate the system. The chemical controller is listed to remain. Please clarify if the intent is to replace the chemical controller or use a different filter control system.
 - a) It has been identified that the controller on-site does not have the capability to control the specified filter system. Please include the attached Semi-Automatic control system in your bid.

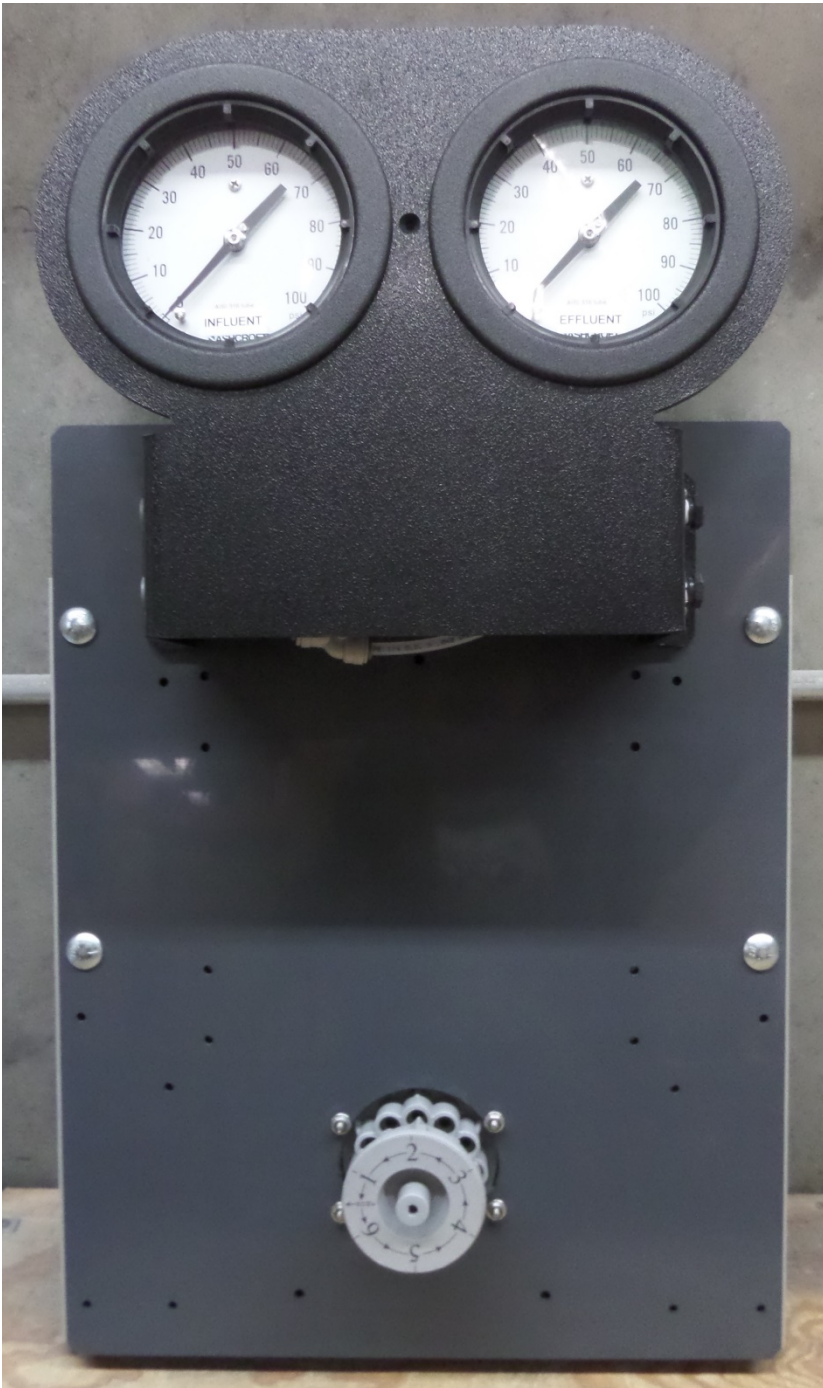

Quantity:

EKO3 Systems, Inc

Model#

Semi-automatic
backwash controller for
Eko³ filter system with
priority valve; includes
pressure gauges and dial
valve