

**NOTES:**

1. SAND MAY BE USED AS BACKFILL MATERIAL IN TRENCHES 6' DEEP OR LESS.
2. ANY TRENCH GREATER THAN 6' IN DEPTH SHALL BE REQUIRED TO BE BACKFILLED WITH CR610 CRUSHED STONE OR AS DIRECTED BY THE CITY ENGINEER.
3. GRANULAR BACKFILL MATERIAL SHALL BE COMPACTED TO 95% MAXIMUM DRY DENSITY.


**TYPICAL PAVEMENT REPAIR DETAIL**

**NOT TO SCALE**

<i>CITY OF LAKELAND ENGINEERING DIVISION</i>		
<b>TYPICAL PAVEMENT REPAIR DETAIL</b>		
REV.	DESCRIPTION	DATE
1	ORIGINAL ISSUE	8/2008
2	LA610 ADDED	1/2011

# Curb and Gutter Detail

## The Pointe

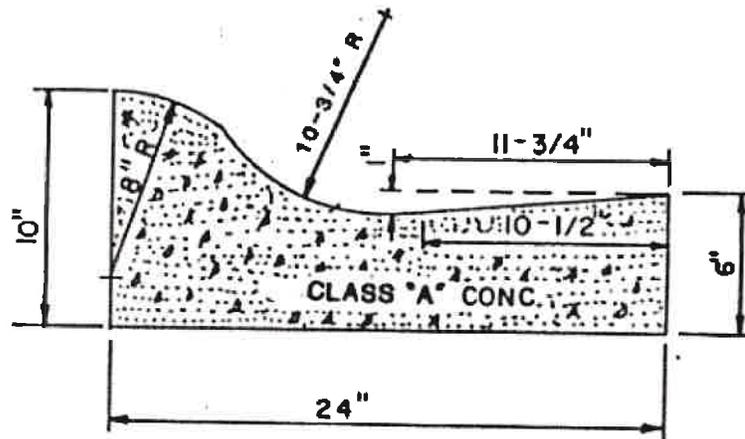

DETAIL  
ROLL-OVER CURB & GUTTER  
NO SCALE



# Concrete Sidewalk Paver Detail

## The Pointe

